WATER DIVISION INSPECTION REPORT AFIN: **70-00341** PERMIT #: **AR0033723** DATE: 8/9/2017 COUNTY: 70 Union MEDIA: WN PDS #: 099007 Ν GPS LAT: 33.176911 LONG: -92.657626 LOCATION: Entrance Department of Environmental Quality **FACILITY INFORMATION** INSPECTION INFORMATION FACILITY TYPE: **EWU - South Plant Collection System** 101531 S - State 1 - Municipal LOCATION FACILITY EVALUATION RATING 325 Quail Crossing SSO/Collection System 5 - Satisfactory EXIT TIME: PERMIT EFFECTIVE DATE: El Dorado, AR 71730 8/9/2017 13:08 14:22 1/1/2015 **RESPONSIBLE OFFICIAL** PERMIT EXPIRATION DATE: NAME: / TITLE 12/31/2019 Frank Hash / Mayor FAYETTEVILLE SHALE RELATED: N COMPANY: El Dorado Water Utilities FAYETTEVILLE SHALE VIOLATIONS: N MAILING ADDRESS: P.O. Box 2170 **INSPECTION PARTICIPANTS** CITY, STATE, ZIP: John Peppers/Superintendent/870-862-6451 (ext. 117) El Dorado AR 71730 PHONE & EXT: / FAX: 870-862-7911 mayorhash@eldoradoar.org CONTACTED DURING INSPECTION: Yes **AREA EVALUATIONS** (S=Satisfactory, M=Marginal, U=Unsatisfactory, N=Not Applicable/Evaluated) STORMWATER PERMIT FLOW MEASUREMENT RECORDS/REPORTS **LABORATORY FACILITY SITE REVIEW** ** ** **OPERATION & MAINTENANCE EFFLUENT/RECEIVING WATER** SELF-MONITORING PROGRAM SAMPLING SLUDGE HANDLING/DISPOSAL **PRETREATMENT** S | OTHER: Collection System **SUMMARY OF FINDINGS** No violations observed during inspection. **GENERAL COMMENTS** The EWU South WWTP collection system consists of five lift stations that have all recently been replaced with

new pumps and a SCADA system. Being that all lift stations are relatively new, no operational concerns were observed. During the inspection, we discussed that Sanitary Sewer Overflows (SSOs) that are within the range of human contact or directly impact waters of the State would be reported within twenty-four hours and will require a five-day follow-up report. The facility uses the ADEQ online SSO reporting database.

INSPECTOR'S SIGNATURE:

Michael Young

DATE: 09/7/2017

SUPERVISOR'S SIGNATURE:

Kerri McCabe


DATE: 9/7/2017

COLLECTION SYSTEM INSPECTION AND OVERALL RAT	ING	⊠S □M □U □NA □NE			
PROVIDE A BRIEF DESCRIPTION OF THE COLLECTION SYSTEM: Gravity Fed>Lift Station>South Pond					
POPULATION SERVED/NUMBER OF RESIDENTIAL AND COMMERCIAL CONNECTIONS: 10,000					
FEET OF SEWER SYSTEM: Unknown					
AGE OF SYSTEM: 60+ Years					
DOES THE SYSTEM EXPERIENCE PROBLEMS DURING DRY OR WET WEATHER (EXPLAIN):		⊠Y □N □NA □NE			
IS THERE A SYSTEM IN PLACE FOR REPORTING SSOS TO ADEQ (DESCRIBE):		⊠Y □N □NA □NE			
ARE ALL SSOs REPORTED REGARDLESS OF SIZE:		☑Y □N □NA □NE			
HAVE SSOs REACHED "WATERS OF THE STATE" (LIST DATE AND LOCATION OF EACH):		⊠Y □N □NA □NE			
PUMP STATIONS		□S □M □U □NA □NE			
NUMBER OF PUMP STATIONS IN SYSTEM: <u>5</u>	NUMBER WITH BACKUP POWER: 5				
HOW OFTEN ARE PUMP STATIONS INSPECTED/MONITO	RED: Daily				
ARE MAINTENANCE RECORDS AND/OR OPERATOR LOG	SS KEPT: <u>Yes</u>				
ADEQUATE INVENTORY OF SPARE PARTS: Yes	ADEQUATE INVENTORY OF SPARE PARTS: Yes				
TYPE OF REMOTE ELECTRONIC MONITORING USED (I.E. SCADA OR AUTO DIALERS): SCADA					
BRIEF SUMMARY OF EMERGENCY PROCEDURES: SCADA autodials 24-hours					
NUMBER OF PUMP STATIONS VISITED DURING INSPECTION (SEE ATTACHED CHECKLISTS FOR EACH): 2					
SATELLITE SYSTEMS		⊠S □M □U □NA □NE			
DOES THE COLLECTION SYSTEM RECEIVE FLOW FROM	I SATELLITE SYSTEMS: <u>Yes</u>				
TYPE(S) OF WASTE WATER RECEIVED:_ ZRESIDENTIA					
BRIEFLY DESCRIBE THE SATELLITE SYSTEM: <u>El Dorado Rural Water serves connections outside of city limits.</u> Houses have grinder pumps and 2" force main line delivers wastewater to EWU.					
ANY KNOWN PROBLEMS WITH SATELLITE SYSTEM: None					
NAME, ADDRESS AND PHONE NUMBER OF PERSON RE W Hillsboro St, El Dorado, AR 71730	SPONSIBLE FOR SATELLITE	SYSTEM: Bill Gaunt 3400			

PUMP STATION VISIT (COMPLETE A SEPARATE CHI	ECKLIST FOR EACH PUMP S	STATION VISITED)
GENERAL INFORMATION AND OVERALL EVALUATION		⊠S □M □U □NA
NAME AND/OR LOCATION OF PUMP STATION: Lift Station	on #2	
TYPE(S) OF WASTE WATER RECEIVED: ☑RESIDENTIAL	. ☑COMMERCIAL □INDUSTRIA	AL OTHER:
NUMBER OF PUMPS: 2		
NUMBER AND SIZE OF PUMPS APPEARS ADEQUATE:		☑S □M □U □NA □NE
EVIDENCE OF RECENT OVERFLOWS OR HIGH LEVELS:		□Y ØN □NA □NE
GENERAL OPERATION AND MAINTENANCE		ØS □M □U □NA
CLEAN AND WELL MAINTAINED WITH MINIMAL STORAGE OF UNRELATED EQUIPMENT:		⊠S □M □U □NA □NE
GATES/DOORS/HATCHES/LIDS/ETC. LOCKED TO PREVENT UNAUTHORIZED ACCESS AND/OR TAMPERING:		⊠S □M □U □NA □NE
WET WELLS, SUMPS AND PITS ADEQUATELY COVERED, GRATED OR OTHERWISE PROTECTED:		ØS □M □U □NA □NE
ELECTRICAL CONTROLS COVERS CONDUIT AND EQUIPMENT PROPERLY INSTALLED AND MAINTAINED:		ØS □M □U □NA □NE
GUARDS AND SHIELDS IN PLACE AROUND MOVING EQUIPMENT (BELTS, PULLEYS, DRIVESHAFTS, ETC.):		ØS □M □U □NA □NE
ADEQUATE VENTILATION TO PREVENT EXCESSIVE CONDENSATION AND/OR GASES AND FUMES:		ØS OM OU ONA ONE
ADEQUATE LIGHTING FOR ROUTINE INSPECTION/MAINTENANCE:		☑S □M □U □NA □NE
SEALS, VALVES AND PACKING ADEQUATELY MAINTAINED TO PREVENT LEAKS:		☑S □M □U □NA □NE
MINIMAL ACCUMULATION OF GREASE AND SOLIDS IN WET WELLS:		☑S □M □U □NA □NE
BACKUP POWER AND ALARMS		⊠S □M □U □NA
PROVISIONS FOR GENERATOR AND/OR EMERGENCY TRANSFER PUMP:		☑S □M □U □NA □NE
AUDIBLE/VISUAL ALARM WITH EMERGENCY CONTACT INFORMATION POSTED:		☑S □M □U □NA □NE
SCADA SYSTEM (LIST PARAMETERS MONITORED): All		ØY □N □NA □NE

PUMP STATION VISIT (COMPLETE A SEPARATE CHECKLIST FOR EACH PUMP STATION VISITED)				
GENERAL INFORMATION AND OVERALL EVALUATION	ØS □M □U □NA			
NAME AND/OR LOCATION OF PUMP STATION: Lift Station	on #4			
TYPE(S) OF WASTE WATER RECEIVED: MRESIDENTIAL MCOMMERCIAL MINDUSTRIAL MOTHER:				
NUMBER OF PUMPS: 2				
NUMBER AND SIZE OF PUMPS APPEARS ADEQUATE:		⊠S □M □U □NA □NE		
EVIDENCE OF RECENT OVERFLOWS OR HIGH LEVELS:		□Y ☑N □NA □NE		
GENERAL OPERATION AND MAINTENANCE		⊠S □M □U □NA		
CLEAN AND WELL MAINTAINED WITH MINIMAL STORAGE OF UNRELATED EQUIPMENT:		ØS □M □U □NA □NE		
GATES/DOORS/HATCHES/LIDS/ETC. LOCKED TO PREVENT UNAUTHORIZED ACCESS AND/OR TAMPERING:		⊠S □M □U □NA □NE		
WET WELLS, SUMPS AND PITS ADEQUATELY COVERED, GRATED OR OTHERWISE PROTECTED:		⊠S □M □U □NA □NE		
ELECTRICAL CONTROLS COVERS CONDUIT AND EQUIPMENT PROPERLY INSTALLED AND MAINTAINED:		⊠S □M □U □NA □NE		
GUARDS AND SHIELDS IN PLACE AROUND MOVING EQUIPMENT (BELTS, PULLEYS, DRIVESHAFTS, ETC.):		⊠S □M □U □NA □NE		
ADEQUATE VENTILATION TO PREVENT EXCESSIVE CONDENSATION AND/OR GASES AND FUMES:		☑S □M □U □NA □NE		
ADEQUATE LIGHTING FOR ROUTINE INSPECTION/MAINTENANCE:		☑S □M □U □NA □NE		
SEALS, VALVES AND PACKING ADEQUATELY MAINTAINED TO PREVENT LEAKS:		☑S □M □U □NA □NE		
MINIMAL ACCUMULATION OF GREASE AND SOLIDS IN WET WELLS:		☑S □M □U □NA □NE		
BACKUP POWER AND ALARMS		☑S □M □U □NA		
PROVISIONS FOR GENERATOR AND/OR EMERGENCY TRANSFER PUMP:		ØS DM DU DNA DNE		
AUDIBLE/VISUAL ALARM WITH EMERGENCY CONTACT INFORMATION POSTED:		☑S □M □U □NA □NE		
SCADA SYSTEM (LIST PARAMETERS MONITORED): AII		☑Y □N □NA □NE		

Water Division Photographic Evidence Sheet							
Location:	EW	U - South Plant Collection Sy	ystem				
Photograp	her:	Michael Young	Date:	08/09/2017	Time: 1	4:53	
Witness: John Peppers			Photo #:	1			
Description 1:00 Otation 110 manufacture better National Company of the COADA and Lot of the Africa							

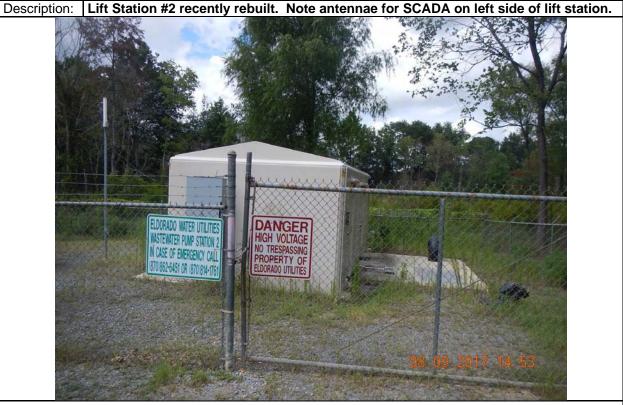

Photographer:Michael YoungDate:08/09/2017Time:15:21Witness:John PeppersPhoto #:2

Description: Solvent used in lift stations for grease.

