



CITY OF HOT SPRINGS

Davidson Wastewater Treatment Plant
320 Davidson Drive Hot Springs, Arkansas 71901
Phone: (501) 621-5041

SSO ANALYSIS REPORT

Date of overflow event: 4/9/24

Location of event: Gulpha Creek (Manhole 1750)


Sample collection date: 4/16/24

Samples analyzed for: E. Coli

ANALYSIS RESULTS

<u>Site #</u>	<u>Time collected</u>	<u>Results</u>
Site 2:	1044	E. Coli – 81.3 cfu per 100mls
Site 3:	1052	E. Coli – 1732.9 cfu per 100m
Site 4:	1056	E. Coli – 727.0 cfu per 100mls
Site 5:	1103	E. Coli – 55.4 cfu per 100mls

Testing will continue until two consecutive results are below the 630 cfu's per 100 mls at site #2, site #3, site #4, and site #5.

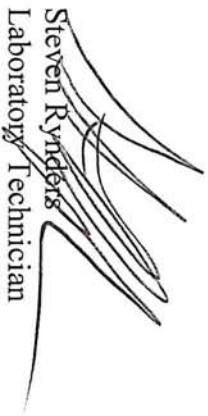

Steven Rynders
Laboratory Technician

Harold Mauldin
Facilities Operations Manager
City of Hot Springs