



CITY OF HOT SPRINGS

Davidson Wastewater Treatment Plant

320 Davidson Drive Hot Springs, Arkansas 71901

Phone: (501) 621-5041

SSO ANALYSIS REPORT

Location of event: Hot Springs Creek

Date of overflow event: 1/2/23-1/3/23

Sample collection date: 1/9/23

Samples analyzed for E. Coli.


ANALYSIS RESULTS

Site #2 E. Coli – 121.1 cfu per 100mls

Site #3 E. Coli – 172.3 cfu per 100mls

Site #4 E. Coli – 33.6 cfu per 100mls

On 01/06/23 and 01/09/23 the results for E coli analysis were below the EPA recommended 630 cfu's per 100mls at Site #2, Site #3, and Site #4. This satisfies the Sampling portion of the Administrative Order.

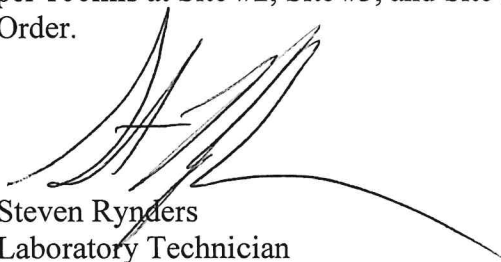

Steven Rynders
Laboratory Technician

Harold Mauldin
Facilities Operations Manager
City of Hot Springs