

Anderson, Alan

From: Stuttgart Municipal Water <stuttgartarwater@centurytel.net>
Sent: Monday, May 07, 2018 3:31 PM
To: Anderson, Alan
Subject: Follow up
Attachments: IMG_0577.jpg; IMG_0578.jpg; IMG_0579.jpg; IMG_0580.jpg; IMG_0581.jpg; IMG_0582.jpg; IMG_0583.jpg

Alan,
Just to follow up on progress of consent order:

Both Primary Pumps have been installed and are working; [see img 581, 582, 583](#)

New CL2 feeders are online and working; [see img 577, 578, 579, 580](#)

Gear drives are on order with an 18 week delivery on the drive units from Westec. Cost of the units is \$70,000 plus installation.

The pond level is coming down so we can start removing sludge again very soon.

If you have any questions please call me.

Thanks,

Tommy Lawson
Stuttgart Municipal Water Works
870-674-7115









CORROSIVE
8

evogua
ultrasonic cleaner






Blow k/og -> manual
Myl Blowing -> Auto

S02

S10k
USFilter

WALACE & TI
Unit Number AAA11
Serial Number 594 146

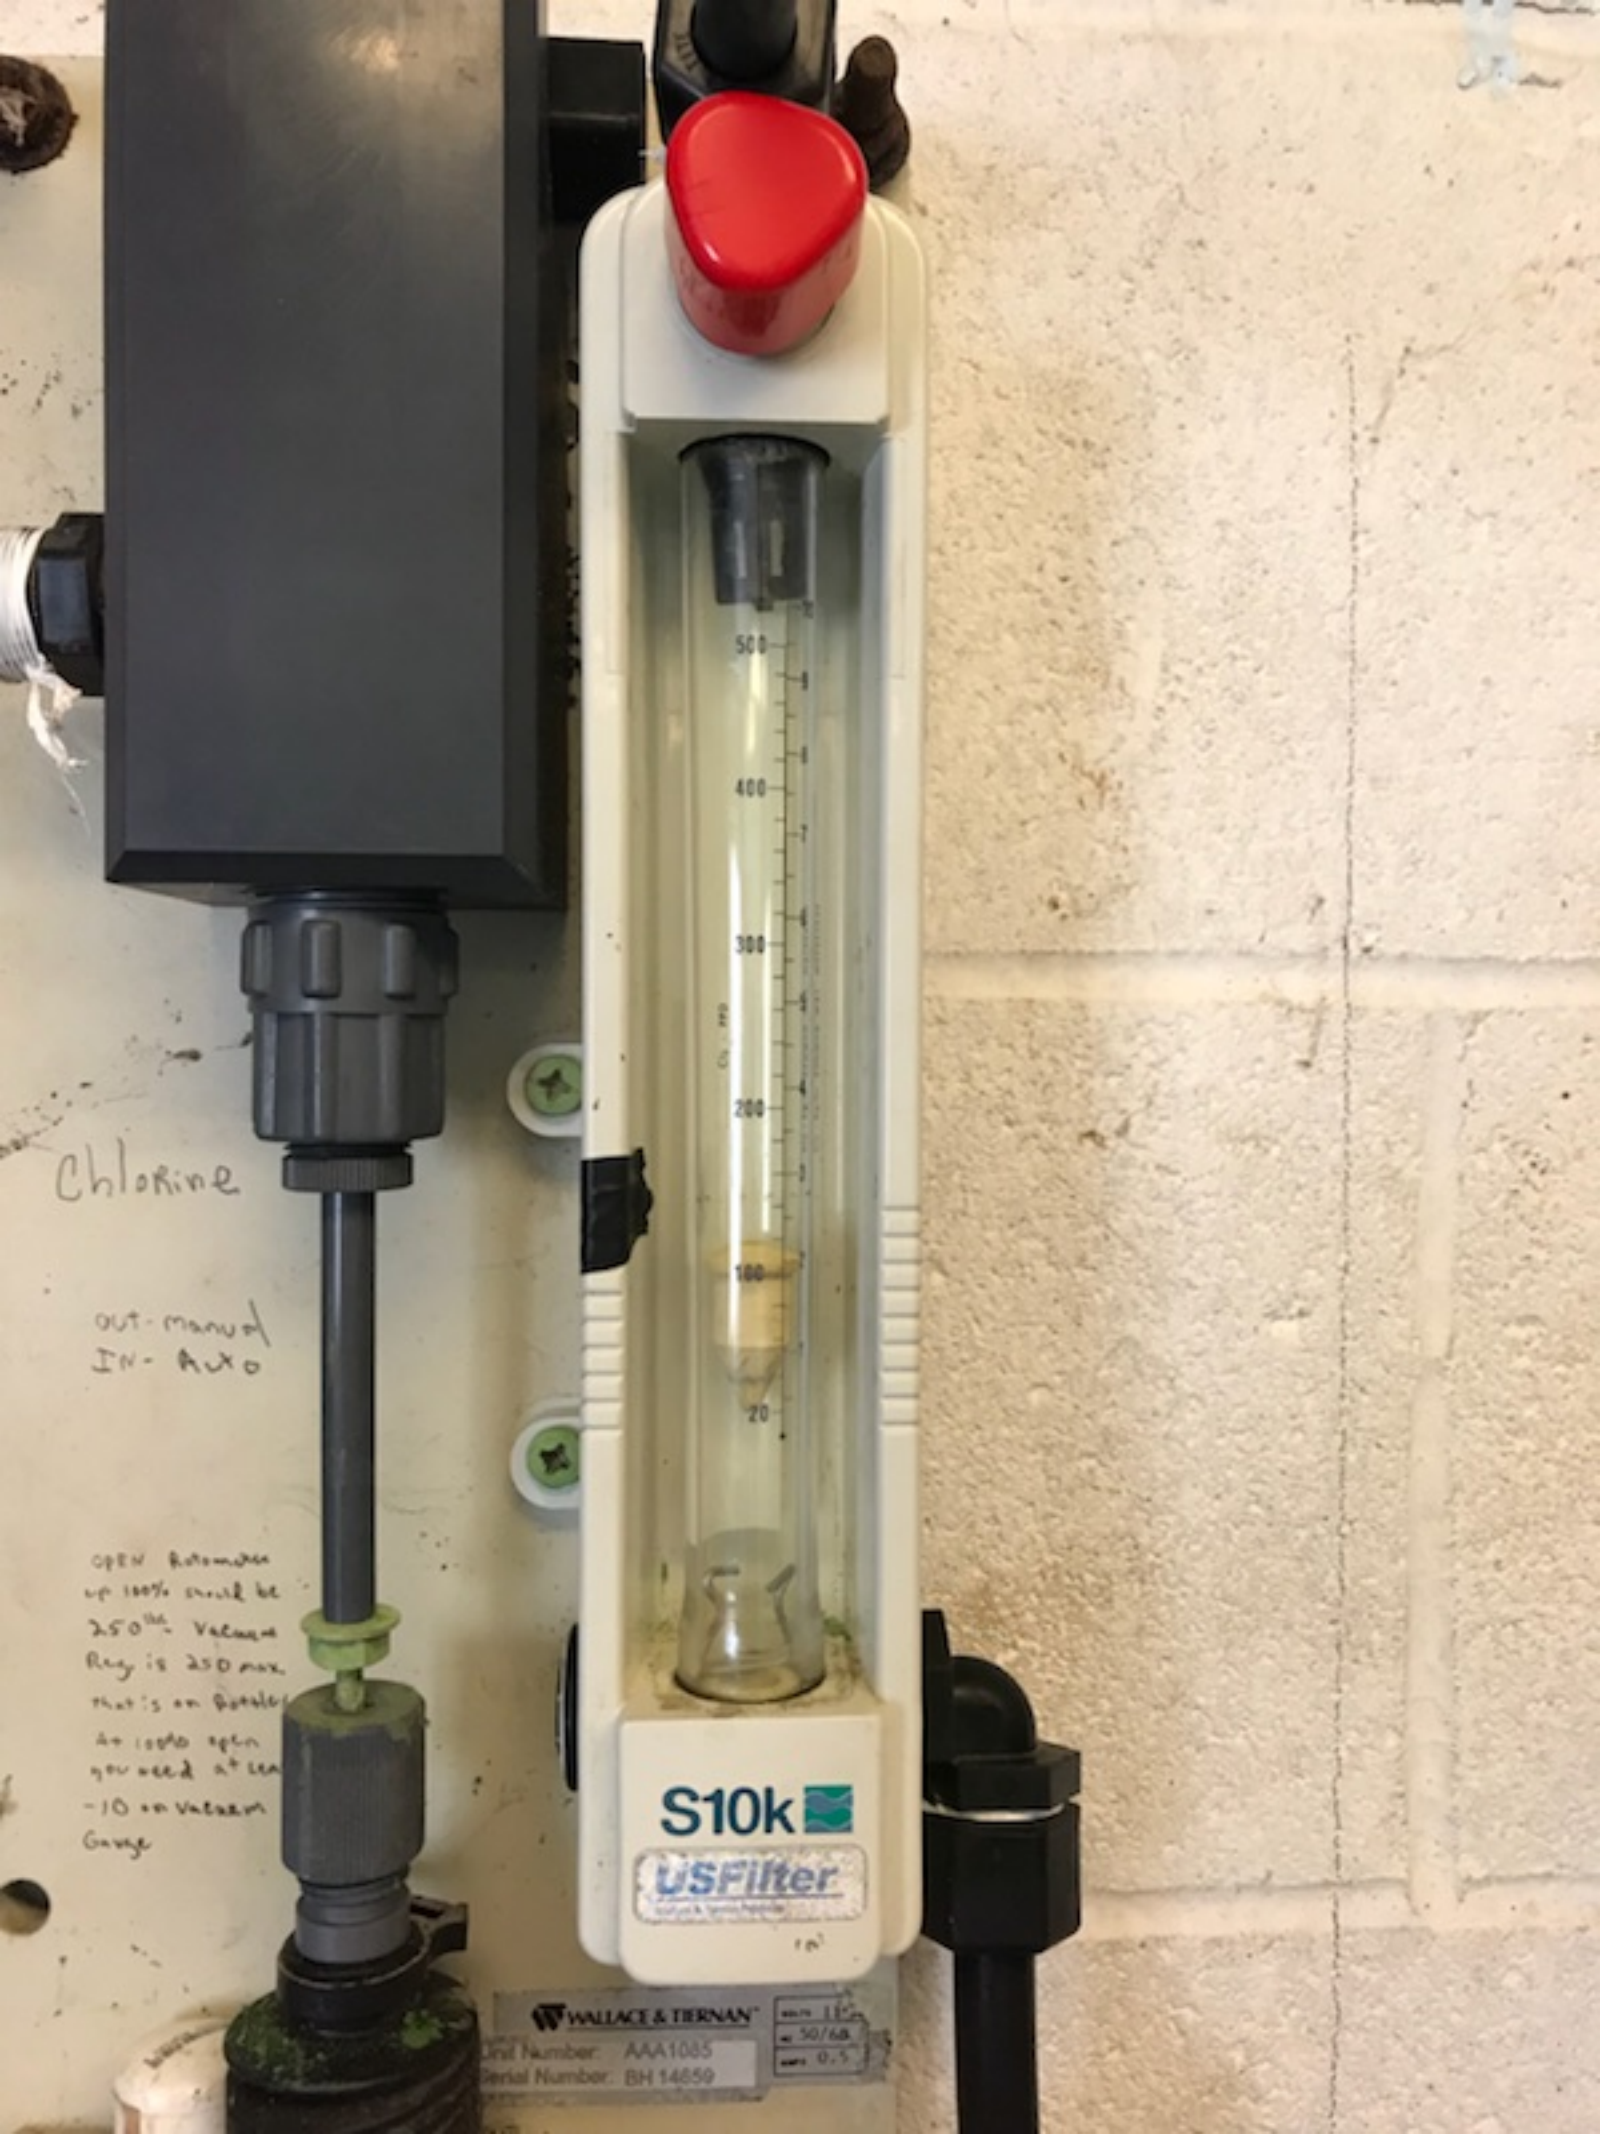

Chlorine

out-manual
IN- Auto

OPEN Rotometer
up 100% should be
250th Volume
Reg is 250 max.
that is on bottle
At 100% open
you need at least
-10 on Volume
Gauge



WALLACE & TIERNAN
Part Number: AAA1085
Serial Number: BH 14659
Scale 11
in 50/68
rate 0.5