

# NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
Office of Water Quality – Enforcement Branch  
5301 Northshore Drive  
North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
Facility: WALNUT RIDGE WW TREATMENT PLANT  
Address: 1002 OAK STREET  
City: WALNUT RIDGE State: AR Zip: 72476  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
3/7/22	BOD 7 DAY AVERAGE		18.9	15.0
3/8/22	BOD 7 DAY AVERAGE		17.9	15.0
3/9/22	BOD 7 DAY AVERAGE		15.6	15.0
3/14/22	BOD 7 DAY AVERAGE		15.1	15.0

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust wasting & aeration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

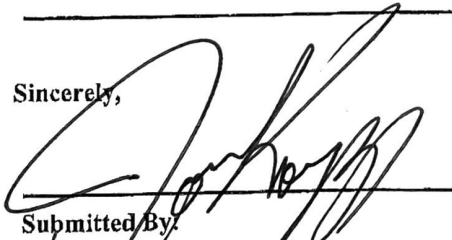

Submitted By:

Date

5-4-22

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*Netform 2*

# NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
Office of Water Quality – Enforcement Branch  
5301 Northshore Drive  
North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
Facility: WALNUT RIDGE WW TREATMENT PLANT  
Address: 1002 OAK STREET  
City: WALNUT RIDGE State: AR Zip: 72476  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
3/7/22	FECAL 7 DAY GEO		> 2000.0	2000.0
3/23/22	FECAL 7 DAY GEO		> 2000.0	2000.0
MARCH	BOD MONTHLY AVERAGE	130.305		99.2
MARCH	BOD MONTHLY AVERAGE		13.798	10.0

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust wasting & aeration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

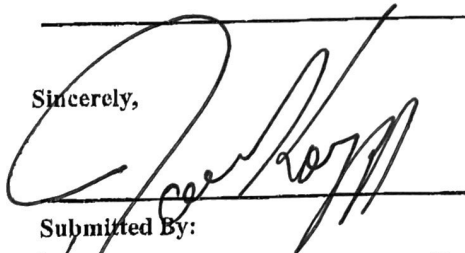

Submitted By:

Date

5-4-22

Submitted electronically via NetDMR

Certification Statement: I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*ncrform 2*

# NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
Office of Water Quality – Enforcement Branch  
5301 Northshore Drive  
North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
Facility: WALNUT RIDGE WW TREATMENT PLANT  
Address: 1002 OAK STREET  
City: WALNUT RIDGE State: AR Zip: 72476  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
3/14/22	TRC INSTANTANEOUS MAX		0.04	0.011
3/16/22	TRC INSTANTANEOUS MAX		0.05	0.011
3/21/22	TRC INSTANTANEOUS MAX		0.03	0.011
3/22/22	TRC INSTANTANEOUS MAX		0.03	0.011
3/23/22	TRC INSTANTANEOUS MAX		0.04	0.011

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust wasting & geration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

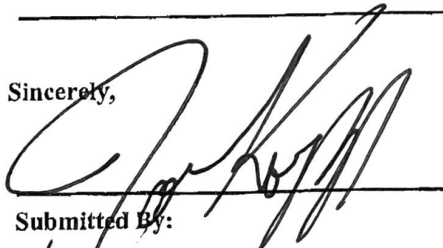

Submitted By:

Date

5-4-22

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*NCR Form 2*

## NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
 Office of Water Quality – Enforcement Branch  
 5301 Northshore Drive  
 North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
 Facility: WALNUT RIDGE WW TREATMENT PLANT  
 Address: 1002 OAK STREET  
 City: WALNUT RIDGE State: AR Zip: 72476  
 Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
2/28/22	TRC INSTANTANEOUS MAX		0.5	0.011
3/1/22	TRC INSTANTANEOUS MAX		0.04	0.011
3/7/22	TRC INSTANTANEOUS MAX		0.09	0.011
3/8/22	TRC INSTANTANEOUS MAX		0.05	0.011

We feel this problem was due to:

Washout due to heavy rain-fall  
 \_\_\_\_\_  
 \_\_\_\_\_


We plan on correcting the problem in this manner:

Adjust wasting & geration  
 \_\_\_\_\_  
 \_\_\_\_\_

Time estimated that it will take to correct problem:

ASAP  
 \_\_\_\_\_  
 \_\_\_\_\_

Sincerely,

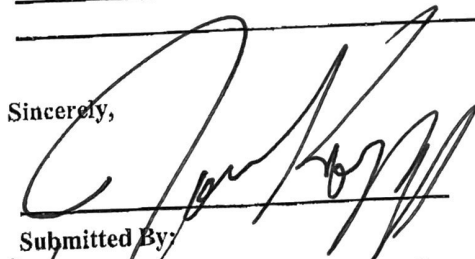

5-4-22  
 Date

Submitted By:

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*ncrform 2*

## NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
 Office of Water Quality – Enforcement Branch  
 5301 Northshore Drive  
 North Little Rock, AR 72118


RE: Permit No: AR0046566 Discharge Number: 001-A  
 Facility: WALNUT RIDGE WW TREATMENT PLANT  
 Address: 1002 OAK STREET  
 City: WALNUT RIDGE State: AR Zip: 72476  
 Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
MARCH	NH3 MONTHLY AVERAGE		8.76	6.0
3/7/22	NH3 7 DAY AVERAGE		13.6	9.0
3/15/22	NH3 7 DAY AVERAGE		24.8	9.0
3/16/22	NH3 7 DAY AVERAGE		10.5	9.0

3/30/22 NH3 7 Day Avg 10.4 9.0  
 We feel this problem was due to:  
Washout due to heavy rainfall

We plan on correcting the problem in this manner:  
Adjust wasting & aeration

Time estimated that it will take to correct problem:  
ASAP

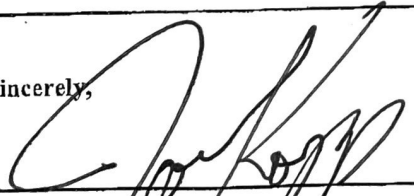Sincerely,  
  
 Submitted By: \_\_\_\_\_ Date: 5-4-22

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

NCR Form 2

# NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
Office of Water Quality – Enforcement Branch  
5301 Northshore Drive  
North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
Facility: WALNUT RIDGE WW TREATMENT PLANT  
Address: 1002 OAK STREET  
City: WALNUT RIDGE State: AR Zip: 72476  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
3/22/22	DO INSTANTANEOUS MINIMUM		3.04	6.0
MARCH	TSS MONTHLY AVERAGE	152.971		148.9
3/30/22	TSS 7 DAY AVERAGE		23.0	22.5
MARCH	NH3 MONTHLY AVERAGE	81.3		59.5

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust wasting & aeration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

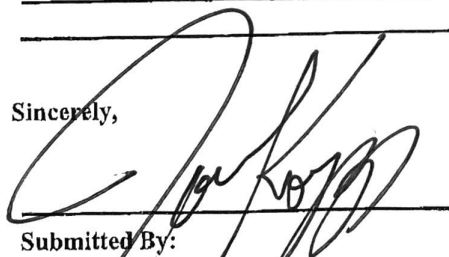

Submitted By:

Date

5-4-22

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*NetForm 2*

# NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
Office of Water Quality – Enforcement Branch  
5301 Northshore Drive  
North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
Facility: WALNUT RIDGE WW TREATMENT PLANT  
Address: 1002 OAK STREET  
City: WALNUT RIDGE State: AR Zip: 72476  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
2/15/22	Hg 7 DAY AVERAGE		0.1	0.0269
2/9/22	FECAL 7 DAY GEO		> 2000.0	2000.0
2/22/22	FECAL 7 DAY GEO		> 2000.0	2000.0
2/23/22	FECAL 7 DAY GEO		5493.0	2000.0

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust Wasting & aeration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

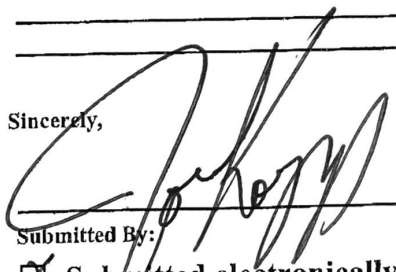

Submitted By:

Date

5-4-2022

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*M. Crform 2*

## NON-COMPLIANCE REPORT

Arkansas Department of Environmental Quality  
 Office of Water Quality – Enforcement Branch  
 5301 Northshore Drive  
 North Little Rock, AR 72118

RE: Permit No: AR0046566 Discharge Number: 001-A  
 Facility: WALNUT RIDGE WW TREATMENT PLANT  
 Address: 1002 OAK STREET  
 City: WALNUT RIDGE State: AR Zip: 72476  
 Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

Date of Non-Compliance	Parameter Exceeded	Quantity or Loading	Quality or Concentration	Permit Limits
3/15/22	BOD 7 DAY AVERAGE		30.9	15.0
3/29/22	BOD 7 DAY AVERAGE		19.0	15.0

We feel this problem was due to:

Washout due to heavy rainfall


We plan on correcting the problem in this manner:

Adjust wasting & aeration

Time estimated that it will take to correct problem:

ASAP

Sincerely,

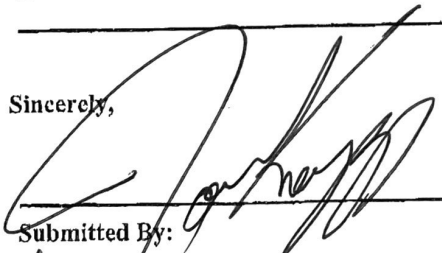  
 Submitted By: \_\_\_\_\_

5-4-22  
 Date

Submitted electronically via NetDMR

**Certification Statement:** I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. (Revised March 2016)

*ncrform 2*