

Arkansas Department of Health
Review of Hydrogen Sulfide Air Monitoring Data in Crossett, AR

Special Data Review Announcement: June 26, 2016

Continuous hydrogen sulfide (*or*, H₂S) air quality monitoring has been conducted by the TRC Environmental Corporation (TRC) on behalf of the Georgia-Pacific Crossett Mill in Crossett, AR. Arkansas Department of Health (ADH) has reviewed the air quality monitoring data from the TRC database and determined that higher than average readings occurred intermittently from approximately 4:30 a.m. to approximately 6:45 a.m. on June 26, 2016. The continuous air quality monitoring data suggest this was an isolated (single day) event, since average hydrogen sulfide readings have returned to background levels.

Personnel from the Georgia-Pacific Crossett Mill notified ADH of the higher than average readings on Monday, June 27, 2016. A 24-hour calibration process was used in order to validate these data. According to Georgia-Pacific personnel, a specific cause has not yet been identified. Georgia-Pacific personnel will continue to evaluate both the plant conditions and the wastewater treatment system operations. Higher readings at the monitor are generally seen during very low wind speed conditions that occur at night or during the early morning, and these may be factors adding to the higher hydrogen sulfide air levels.

The health screening levels used in this review apply to the general public, including sensitive individuals, such as people with asthma or other chronic respiratory conditions. The screening values are intended to provide health-based standards for interpreting air monitoring data. Monitoring data may be used as a tool to help determine whether a facility is controlling hydrogen sulfide releases. See the figure below for a picture of the higher concentration spikes reported from the air quality monitoring data as compared to the screening value.


The higher concentrations of hydrogen sulfide detected at the monitoring station happened in the early hours of the morning when many people may have been indoors. The possible health effects were likely to have been temporary and more likely to have occurred in sensitive individuals, such as people with asthma and other chronic respiratory conditions. Should anyone feel they are experiencing possible health effects related to this event, please contact a physician or health care professional.

Hydrogen sulfide is a heavier-than-air, colorless gas with an odor of rotten eggs. Odors can alert people that something may be harmful, but generally you can smell many chemicals before they are at levels that are harmful to your health. People usually can smell hydrogen sulfide at low concentrations in air, usually at levels much lower than the health screening levels set to determine health effects.

It is important to note that hydrogen sulfide exposures at low levels have not been shown to result in any lasting health effects. Hydrogen sulfide is not known to cause cancer.

For more information, see the Agency for Toxic Substances and Disease Registry (ATSDR) Hydrogen Sulfide fact sheet [linked to this website]. For inquiries related to the hydrogen sulfide air quality monitoring, contact the ADH Office of Health Communications and Marketing at (501) 280-4768.

Hydrogen Sulfide (H₂S) 30 Minute Rolling Average (ppb)

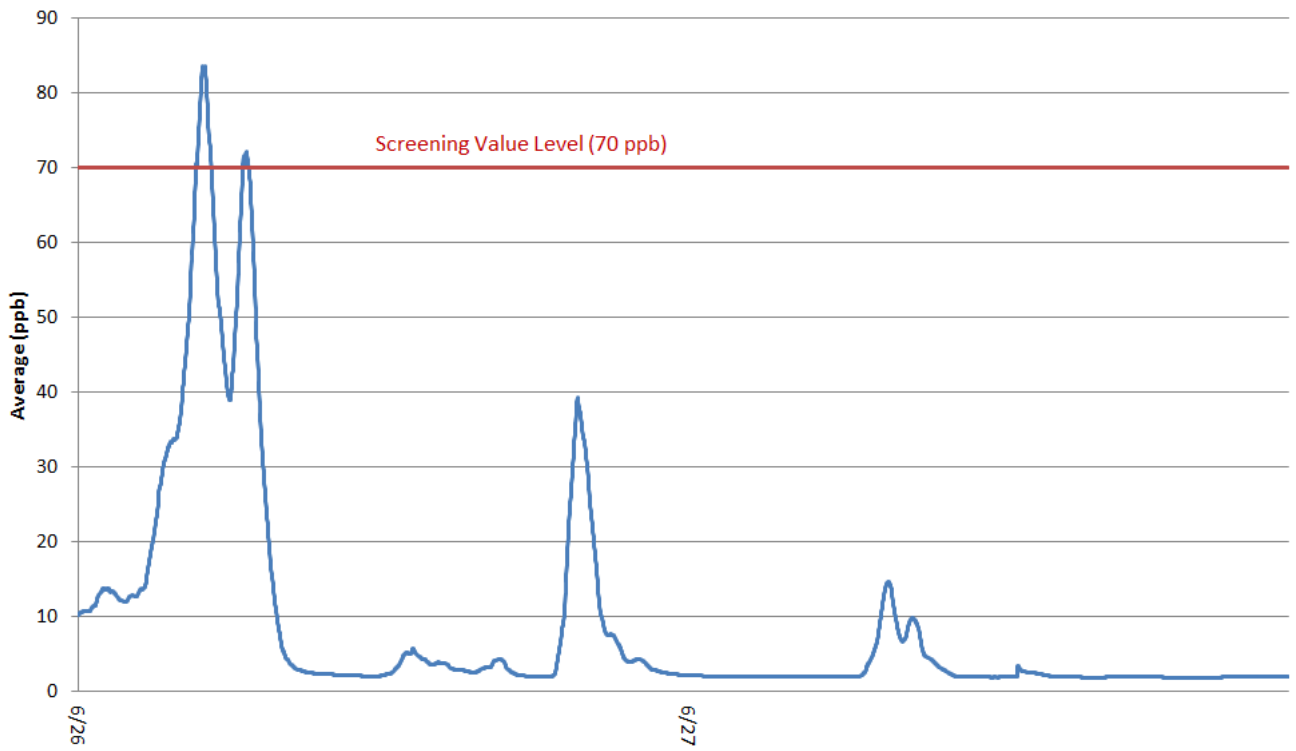

TRC. (2016). 30 Minute Rolling Average (Original Data). Retrieved by ADH on June 27, 2016.

Date: 06/26/2016 to 06/27/2016

— GP Crossett Mill - H₂S

— Screening Value

ppb = parts per billion