\$EPA

Signature of Reviewer **Jason Bolenbaugh**

Form Approved OMB No. 2040-0003

UNITED STATES ENVIRONMENTAL PROTECTION AGENCY Washington, D.C. 20460																							
NPDES Compliance Inspection Report																							
	Section A: National Data System Coding																						
1 N 2 5 3 A R 0 0 2 2 1 8 7 11 12 1 3 0 5 1 0 17 18										ppec. Type Inspector Fac. Type 19 S 20 1													
											I I						ı						
Inspection Work Days Facility Evaluation Rating BI QA										Reserve	d												
67 69 70 N 72							ı	N	73			74	75		80				80				
Section B: Facility Data																							
Name and Location of Facility Inspected (For industrial users discharging to POTW, also include POTW name and NPDES permit number Clarksville Light and Water Pollution Control Facility Entry Time/Date 0724 hrs / May 10, 2013										Permit Effective Date April 1, 2009													
Located on South Crawford Highway one mile South of Interstate 40 Exit 57 in Sections 7 & 8, Township 9 North, Range 23 West, in Johnson County, Arkansas Exit Time/Date 1220 hrs / May 10, 2013									Permit Expiration Date March 31, 2014														
Mr. Gregg Rainey / Pollution Control Facility Superintendent / Phone: 479-754-7929 / Fax: 479-754-6885									ner Facility Data AJOR MUNICIPAL														
Ms. Clar P.O	ne, Address of Responsible Official Jeanette Small, General Manage Ksville Light and Water Co. Box 1807	r		and Fax	Numb	er						-		acted	_								
Clar	ksville, AR 72830 / Phone 479-	754-6	241									Yes	✓]	No									
			(S = Satis							uring l	•		Eval	uated)							
S	Permit	N	Flo	w Measu	remen	ıt			S	Op	perations & Maintenance						N	Sampling					
S	Records/Reports	N	Self	f-Monito	ring P	rogr	am		N	Slu	ndge Handling/Disposal					N	Pollution Prevention						
S	Facility Site Review	N	Cor	mpliance	Sched	lules			N	Pre	etreatment					N	N Multimedia						
N	Effluent/Receiving Waters	N	Lab	oratory					N	Sto	orm Water					S	Other: Collection System						
		Se	ction	D: Sumr	nary o	f Fin	nding	s/Con	nment	s (Att	ach a	lditio	nal s	heets	if nec	essar	y)						
A Sanitary Sewer Overflow Inspection was Performed on May 10, 2013. The facility had not experienced any overflow that reached waters of the state in the 12 months prior to this inspection. Back-up power is available for all 16 lift stations in the system. Each pump station has a dedicated electronic monitoring system operating on both radio signal and telephone line connection to notify the proper personnel. In addition to the elaborate electronic monitoring system, the facility also conducts daily inspections of all lift stations in order to identify potential problems so they may be repaired before they occur rather than waiting for the electronic system to notify personnel that a problem has already occurred. Three lift stations were investigated and found to be very clean and well-maintained. Very little to no accumulated grease was observed in the wet wells. According to Superintendent Rainey, the facility each year continues to work to reduce its wet weather flow issues with an extensive program of line replacement and system repairs. Overall, the inspection revealed that Clarksville Light and Water was doing an excellent job of monitoring, maintaining and operating its collection system.																							
Name(s) and Signature(s) of Inspector(s)) Bruce Kirkpatrick Agency/Office/Telephone/Fax AR Dept. of Environmental Quality-Jasper PHONE# (870) 446-6170 / FAX# (870) 446-2181									Date May 30, 2013														

Agency/Office/Phone and Fax Numbers **ADEQ**

Date 6/3/2013

COLLECTION SYSTEM INSPECTION AND OVERA	ALL RATING	⊠s □N	□u	□NA	□NE					
PROVIDE A BRIEF DESCRIPTION OF THE COLLECTION SYSTEM:										
95 miles of gravity sewer, 7 miles of pressure sewer and 16 lift stations POPULATION SERVED/NUMBER OF RESIDENTIAL AND COMMERCIAL CONNECTIONS: approximately 4000										
connections										
FEET OF SEWER SYSTEM: 102 miles	FEET OF SEWER SYSTEM: 102 miles									
AGE OF SYSTEM: Approximately 60 years old										
DOES THE SYSTEM EXPERIENCE PROBLEMS DURING DR (EXPLAIN): Wet weather infiltration and inflow	RY OR WET WEATHER	Ø	□N	□NA	□NE					
IS THERE A SYSTEM IN PLACE FOR REPORTING SSOS TO ADEQ On-Line Report / call to ADEQ Water Enforcement / n		ΔA	□N	□NA	□NE					
ARE ALL SSOs REPORTED REGARDLESS OF SIZE:		⊠ Y	□N	□NA	□NE					
HAVE SSOs REACHED "WATERS OF THE U.S." (LIST DATE	AND LOCATION OF EACH):		ØΝ	□NA	□NE					
No SSO's reached waters of the State in the 12 months prior to this inspection.										
PUMP STATIONS		⊠s □w	□υ	\square NA	□NE					
NUMBER OF PUMP STATIONS IN SYSTEM: 16 NUMBER WITH BACKUP POWER: 16										
HOW OFTEN ARE PUMP STATIONS INSPECTED/MONITORED: <u>Daily</u>										
ARE MAINTENANCE RECORDS AND/OR OPERATOR LOGS KEPT: Yes										
ADEQUATE INVENTORY OF SPARE PARTS: <u>Yes</u>										
TYPE OF REMOTE ELECTRONIC MONITORING USED (I.E. SCADA OR AUTO DIALERS): radio and telephone										
BRIEF SUMMARY OF EMERGENCY PROCEDURES: Fixed and/or portable generator/ pump truck										
NUMBER OF PUMP STATIONS VISITED DURING INSPECTION (SEE ATTACHED CHECKLISTS FOR EACH): 3										
SATELLITE SYSTEMS			□U	ØNA	□NE					
DOES THE COLLECTION SYSTEM RECEIVE FLOW FROM S	SATELLITE SYSTEMS: No									
TYPE(S) OF WASTE WATER RECEIVED:										
BRIEFLY DESCRIBE THE SATELLITE SYSTEM:										
ANY KNOWN PROBLEMS WITH SATELLITE SYSTEM:										

NAME, ADDRESS AND PHONE NUMBER OF PERSON RESPONSIBLE FOR SATELLITE SYSTEM:

AFIN: **36-00038**

Permit #: AR0022187


ADEQ Water NPDES Inspection

PUMP STATION VISIT (COMPLETE A SEPARATE CHECKLIST FOR EACH PUMP STATION VISITED)							
GENERAL INFORMATION AND OVERALL EVAL	⊠S □M □U □NA						
NAME AND/OR LOCATION OF PUMP STATION: Ray Road							
TYPE(S) OF WASTE WATER RECEIVED: MRESIDENTIAL	AL OTHER:						
NUMBER OF PUMPS: 2	NUMBER OPERATIONAL: 2						
NUMBER AND SIZE OF PUMPS APPEARS ADEQUATE:	☑S □M □U □NA □NE						
EVIDENCE OF RECENT OVERFLOWS OR HIGH LEVELS:		□Y ☑N □NA □NE					
GENERAL OPERATION AND MAINTENANCE		⊠S □M □U □NA					
CLEAN AND WELL MAINTAINED WITH MINIMAL STORAG EQUIPMENT:	E OF UNRELATED	☑S □M □U □NA □NE					
GATES/DOORS/HATCHES/LIDS/ETC. LOCKED TO PREVE ACCESS AND/OR TAMPERING:		ØS □M □U □NA □NE					
WET WELLS, SUMPS AND PITS ADEQUATELY COVERED PROTECTED:	☑S □M □U □NA □NE						
ELECTRICAL CONTROLS COVERS CONDUIT AND EQUIF INSTALLED AND MAINTAINED:	☑S □M □U □NA □NE						
GUARDS AND SHIELDS IN PLACE AROUND MOVING EQUINORING EQ	, ,	☑S □M □U □NA □NE					
ADEQUATE VENTILATION TO PREVENT EXCESSIVE COL GASES AND FUMES:	NDENSATION AND/OR	☑S □M □U □NA □NE					
ADEQUATE LIGHTING FOR ROUTINE INSPECTION/MAIN	TENANCE:	☑S □M □U □NA □NE					
SEALS, VALVES AND PACKING ADEQUATELY MAINTAIN	ED TO PREVENT LEAKS:	☑S □M □U □NA □NE					
MINIMAL ACCUMULATION OF GREASE AND SOLIDS IN V	VET WELLS:	ØS □M □U □NA □NE					
BACKUP POWER AND ALARMS		☑S □M □U □NA					
PROVISIONS FOR GENERATOR AND/OR EMERGENCY T	RANSFER PUMP:	☑S □M □U □NA □NE					
AUDIBLE/VISUAL ALARM WITH EMERGENCY CONTACT	INFORMATION POSTED:	☑S □M □U □NA □NE					
SCADA SYSTEM (LIST PARAMETERS MONITORED): pov	ver/high level	⊠Y □N □NA □NE					

Permit #: AR0022187

PUMP STATION VISIT (COMPLETE A SEPARATE	CHECKLIST FOR EACH PU	MP STATION VISITED)					
GENERAL INFORMATION AND OVERALL EVAL	☑S □M □U □NA						
NAME AND/OR LOCATION OF PUMP STATION: <u>Stegall</u>							
TYPE(S) OF WASTE WATER RECEIVED: MRESIDENTIAL COMMERCIAL DINDUSTRIAL COTHI							
NUMBER OF PUMPS: 2							
NUMBER AND SIZE OF PUMPS APPEARS ADEQUATE:							
EVIDENCE OF RECENT OVERFLOWS OR HIGH LEVELS:	□Y ØN □NA □NE						
GENERAL OPERATION AND MAINTENANCE		⊠S □M □U □NA					
CLEAN AND WELL MAINTAINED WITH MINIMAL STORAG	E OF LINREL ATED						
EQUIPMENT:		☑S □M □U □NA □NE					
GATES/DOORS/HATCHES/LIDS/ETC. LOCKED TO PREVE ACCESS AND/OR TAMPERING:	☑S □M □U □NA □NE						
WET WELLS, SUMPS AND PITS ADEQUATELY COVERED PROTECTED:	☑S □M □U □NA □NE						
ELECTRICAL CONTROLS COVERS CONDUIT AND EQUIP INSTALLED AND MAINTAINED:	ØS □M □U □NA □NE						
GUARDS AND SHIELDS IN PLACE AROUND MOVING EQUENTIVESHAFTS, ETC.):	JIPMENT (BELTS, PULLEYS,	ØS □M □U □NA □NE					
ADEQUATE VENTILATION TO PREVENT EXCESSIVE CONGASES AND FUMES:	NDENSATION AND/OR	☑S □M □U □NA □NE					
ADEQUATE LIGHTING FOR ROUTINE INSPECTION/MAIN	TENANCE:	ØS □M □U □NA □NE					
SEALS, VALVES AND PACKING ADEQUATELY MAINTAIN	ED TO PREVENT LEAKS:	ØS DM DU DNA DNE					
MINIMAL ACCUMULATION OF GREASE AND SOLIDS IN W	VET WELLS:	☑S □M □U □NA □NE					
BACKUP POWER AND ALARMS		⊠S □M □U □NA					
PROVISIONS FOR GENERATOR AND/OR EMERGENCY T	RANSFER PUMP:	☑S □M □U □NA □NE					
AUDIBLE/VISUAL ALARM WITH EMERGENCY CONTACT I		ØS □M □U □NA □NE					
SCADA SYSTEM (LIST PARAMETERS MONITORED): pow	ver/high level	⊠Y □N □NA □NE					
		,					

PUMP STATION VISIT (COMPLETE A SEPARATE CHECKLIST FOR EACH PUMP STATION VISITED)							
GENERAL INFORMATION AND OVERALL EVAL	⊠S □M □U □NA						
NAME AND/OR LOCATION OF PUMP STATION: South Park							
TYPE(S) OF WASTE WATER RECEIVED: MRESIDENTIAL	AL OTHER:						
NUMBER OF PUMPS: 2	NUMBER OPERATIONAL: 2						
NUMBER AND SIZE OF PUMPS APPEARS ADEQUATE: ☑S □M □U □NA							
EVIDENCE OF RECENT OVERFLOWS OR HIGH LEVELS:		□Y ☑N □NA □NE					
		50 511 511 511					
GENERAL OPERATION AND MAINTENANCE		ØS DM DU DNA					
CLEAN AND WELL MAINTAINED WITH MINIMAL STORAG EQUIPMENT:		☑S □M □U □NA □NE					
GATES/DOORS/HATCHES/LIDS/ETC. LOCKED TO PREVE ACCESS AND/OR TAMPERING:	ENT UNAUTHORIZED	☑S □M □U □NA □NE					
WET WELLS, SUMPS AND PITS ADEQUATELY COVERED PROTECTED:	, GRATED OR OTHERWISE	☑S □M □U □NA □NE					
ELECTRICAL CONTROLS COVERS CONDUIT AND EQUIF INSTALLED AND MAINTAINED:	MENT PROPERLY	ØS □M □U □NA □NE					
GUARDS AND SHIELDS IN PLACE AROUND MOVING EQUIPMENT OF THE PROPERTY OF THE PRO	UIPMENT (BELTS, PULLEYS,	ØS □M □U □NA □NE					
ADEQUATE VENTILATION TO PREVENT EXCESSIVE COL GASES AND FUMES:	NDENSATION AND/OR	☑S □M □U □NA □NE					
ADEQUATE LIGHTING FOR ROUTINE INSPECTION/MAIN	TENANCE:	☑S □M □U □NA □NE					
SEALS, VALVES AND PACKING ADEQUATELY MAINTAIN	ED TO PREVENT LEAKS:	☑S □M □U □NA □NE					
MINIMAL ACCUMULATION OF GREASE AND SOLIDS IN V	VET WELLS:	☑S □M □U □NA □NE					
DAOKUD DOWED AND ALADMO							
BACKUP POWER AND ALARMS		ØS DM DU DNA					
PROVISIONS FOR GENERATOR AND/OR EMERGENCY T	RANSFER PUMP:	☑S □M □U □NA □NE					
AUDIBLE/VISUAL ALARM WITH EMERGENCY CONTACT	INFORMATION POSTED:	☑S □M □U □NA □NE					
SCADA SYSTEM (LIST PARAMETERS MONITORED): <u>pov</u>	ver/high level	⊠Y □N □NA □NE					

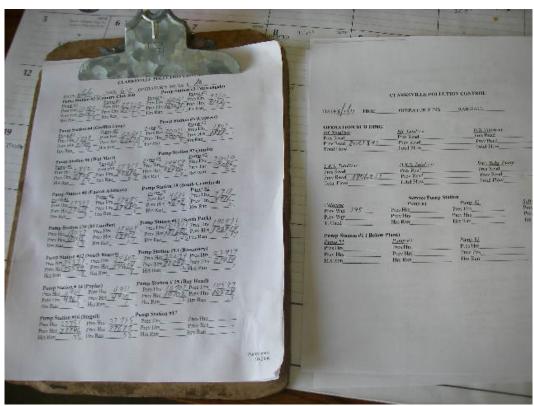

Facility records documenting daily lift station inspections




Ray Road Lift Station



Ray Road Lift Station wet well



Ray Road Lift Station SCADA call box

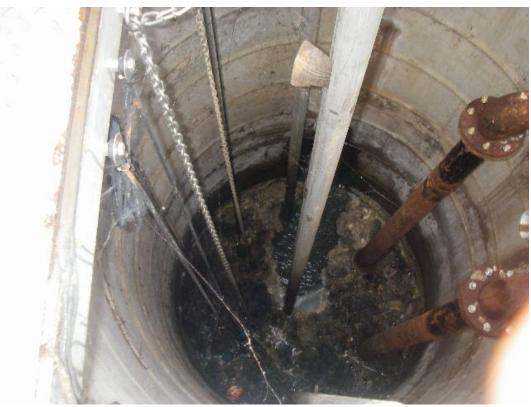


Stegall Lift Station wet well



Stegall Lift Station SCADA call box and electrical control panel



South Park Lift Station

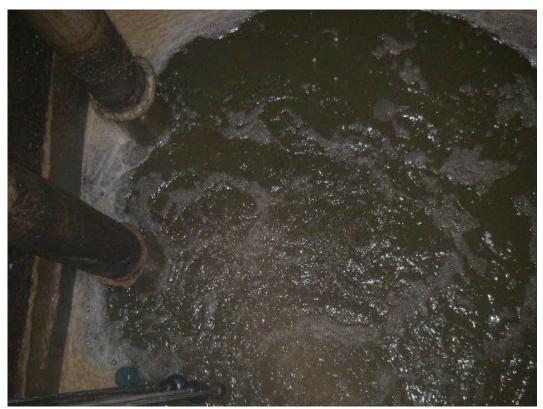

South Park Lift Station wet well



South Park Lift Station SCADA call box