

February 28, 2019

Honorable Allen Scott, Mayor City of Bryant 210 SW 3rd Street Bryant, AR 72022

RE: City of Bryant Inspection AFIN: 63-00065 Permit No.: AR0034002

Dear Honorable Mayor Scott:

On January 24, 2019, Water Quality Inspector Blain Sanders and I performed a Compliance Evaluation Inspection of the above referenced facility in accordance with the provisions of the Federal Clean Water Act, the Arkansas Water and Air Pollution Control Act, and the regulations promulgated thereunder. A copy of the inspection report is enclosed for your records.

No violations were noted at the time of the inspection. Please refer to the attached inspection report for any comments. If we can be of any assistance, please contact Jason Bolenbaugh at <u>Bolenbaugh@adeq.state.ar.us</u> or 501-682-0659.

Sincerely,

Keith Waters District 9 Field Inspector Office of Water Quality

CC: Greg Asher, WWT Superintendent, gasher@cityofbryant.com

Inspection Report: City of Bryant, AFIN: 63-00065, Permit #: AR0034002

			INSPECTION REPORT				
ADEQ		AFIN: 63-00065 PERMIT #: AR0034002			LCIIO	DATE: 1/24/2019	
				. 400707			
А	RKANSAS	COUNTY: 63 Saline		-	#: 106727	MEDIA: WN	
Dep	partment of Environmental Quality	GPS LAT: 34.59388					
NAME	FACILITY INFORMAT	INSPECTION INFORMATION FACILITY TYPE: INSPECTOR ID#:					
			1 - Municipal 97072 S - State				
SW 2 nd Street			FACILITY EVALUATION RATING: INSPECTION TYPE: 4 - Satisfactory Compliance Evaluation				
	yant		DATE(S): ENTRY TIME: EXIT TIME:			PERMIT EFFECTIVE DATE:	
	RESPONSIBLE OFFIC	CIAL	1/24/2019 07	12/1/2014 PERMIT EXPIRATION DATE:			
	norable Allen Scott / Mayor					11/30/2019	
COM	PANY:		FAYETTEVILLE SHALE RELATED: N				
	y of Bryant		FAYETTEVILLE	SHAL	E VIOLATIO	DNS: N	
	D SW 3rd Street				TION PARTI	CIPANTS	
	state, zip: yant AR 72022		NAME/TITLE/PHONE/FAX/EMAIL		uality Inspe	ector/501-683-6629	
PHO	IE & EXT: / FAX:		Keith Waters/Water Quality Inspector/501-683-6629 Blain Sanders/Water Quality Inspector/501-682-0657				
50' EMAI	1-943-0469 /		Gregg Asher/WWT Superintendent/				
LINA	-						
CC	NTACTED DURING INSPECTION						
	(S=S	AREA EVA atisfactory. M=Marginal. U=Unsati	ALUATIONS atisfactory, N=Not Applicable/Evaluated)				
**	PERMIT	** FLOW MEASUR	UREMENT ** STORMWATER				
**	RECORDS/REPORTS	** LABORATORY		**		SITE REVIEW	
**	OPERATION & MAINTENANCE		CEIVING WATER	**		NITORING PROGRAM	
**	SAMPLING OTHER:	A SLUDGE HAND	LING/DISPOSAL	^^	PRETREA	IMENI	
	OTHER.	SUMMARY C					
No	o violations were noted at the time						
		GENERAL (COMMENTS				
	Keith	1/4					
INS	SPECTOR'S SIGNATURE:				DATE: 2/22/2018		
		Keith Waters					
<u>e</u> 11	PERVISOR'S SIGNATURE:	in Relation from 100	on Bolenbaugh			DATE: 2/27/2019	
30	FERVISOR S SIGNATURE.	Jas	on bolenbaugh			DATE. 212112019	

Inspection Report: City of Bryant, AFIN: 63-00065, Permit #: AR0034002

PERMIT SATISFACTORILY ADDRESSES OBSERVATIONS DETAILS: 1. CORRECT NAME AND MAILING ADDRESS OF PERMITTEE: 2. NOTIFICATION GIVEN TO EPA/STATE OF NEW DIFFERENT OR INCREASED DISCHARGES:	ØS OM OU ONA ONE
1. CORRECT NAME AND MAILING ADDRESS OF PERMITTEE:	
2. NOTIFICATION GIVEN TO EPA/STATE OF NEW DIFFERENT OR INCREASED DISCHARGES:	
3. NUMBER AND LOCATION OF DISCHARGE POINTS AS DESCRIBED IN PERMIT:	
4. ALL DISCHARGES ARE PERMITTED:	
SECTION B: RECORDKEEPING AND REPORTING EVALUATION	
RECORDS AND REPORTS MAINTAINED AS REQUIRED BY PERMIT	
DETAILS:	
1. ANALYTICAL RESULTS CONSISTENT WITH DATA REPORTED ON DMRS:	
2. SAMPLING AND ANALYSES DATA ADEQUATE AND INCLUDE:	
a. DATES AND TIME(S) OF SAMPLING:	
b. EXACT LOCATION(S) OF SAMPLING:	
c. NAME OF INDIVIDUAL PERFORMING SAMPLING:	
d. ANALYTICAL METHODS AND TECHNIQUES:	
e. RESULTS OF CALIBRATIONS:	
f. RESULTS OF ANALYSES:	
g. DATES AND TIMES OF ANALYSES:	
h. NAME OF PERSON(S) PERFORMING ANALYSES:	
3. LABORATORY EQUIPMENT CALIBRATION AND MAINTENANCE RECORDS ADEQUATE:	
4. PLANT RECORDS INCLUDE SCHEDULES, DATES OF EQUIPMENT MAINTENANCE AND REPAIR:	
5. EFFLUENT LOADINGS CALCULATED USING DAILY EFFLUENT FLOW AND DAILY ANALYTICAL DATA:	
SECTION C: OPERATIONS AND MAINTENANCE	
TREATMENT FACILITY PROPERLY OPERATED AND MAINTAINED	
DETAILS:	
1. TREATMENT UNITS PROPERLY OPERATED:	
2. TREATMENT UNITS PROPERLY MAINTAINED:	
3. STANDBY POWER OR OTHER EQUIVALENT PROVIDED:	
4. ADEQUATE ALARM SYSTEM FOR POWER OR EQUIPMENT FAILURES AVAILABLE:	
5. ALL NEEDED TREATMENT UNITS IN SERVICE:	
6. ADEQUATE NUMBER OF QUALIFIED OPERATORS PROVIDED:	
7. SPARE PARTS AND SUPPLIES INVENTORY MAINTAINED:	
8. OPERATION AND MAINTENANCE MANUAL AVAILABLE:	
9. STANDARD OPERATING PROCEDURES AND SCHEDULES ESTABLISHED:	
10. PROCEDURES FOR EMERGENCY TREATMENT CONTROL ESTABLISHED:	
11. HAVE BYPASSES/OVERFLOWS OCCURRED AT THE PLANT OR IN THE COLLECTION SYSTEM IN THE LAST YEAR:	
12. IF SO, HAS THE REGULATORY AGENCY BEEN NOTIFIED:	
12. IF SO, HAS THE REGULATORY AGENCY BEEN NOTIFIED:	
14. HAVE ANY HYDRAULIC OVERLOADS OCCURRED AT THE TREATMENT PLANT: 15. IF SO, DID PERMIT VIOLATIONS OCCUR AS A RESULT:	<u> </u>

SF	ECTION D: SAMPLING	
	ERMITTEE SAMPLING MEETS PERMIT REQUIREMENTS	ØS OM OU ONA ONE
1.	SAMPLES TAKEN AT SITE(S) SPECIFIED IN PERMIT:	
2.	LOCATIONS ADEQUATE FOR REPRESENTATIVE SAMPLES:	
3.	FLOW PROPORTIONED SAMPLES OBTAINED WHEN REQUIRED BY PERMIT:	
4.	SAMPLING AND ANALYSES COMPLETED ON PARAMETERS SPECIFIED IN PERMIT:	
5.	SAMPLING AND ANALYSES PERFORMED AT FREQUENCY SPECIFIED IN PERMIT:	
6.	SAMPLE COLLECTION PROCEDURES ADEQUATE:	
a	a. SAMPLES REFRIGERATED DURING COMPOSITING: Ice is used in sampler during sampling	
t	D. PROPER PRESERVATION TECHNIQUES USED:	
c	2. CONTAINERS AND SAMPLE HOLDING TIMES CONFORM TO 40 CFR 136:	
7.	IF MONITORING IS PERFORMED MORE OFTEN THAN REQUIRED ARE RESULTS REPORTED ON THE DMR:	
SE	ECTION E: FLOW MEASUREMENT	
	ERMITTEE FLOW MEASUREMENT MEETS PERMIT REQUIREMENTS	ØS OM OU ONA ONE
	1. PRIMARY FLOW MEASUREMENT DEVICE PROPERLY INSTALLED AND MAINTAINED: TYPE OF DEVICE: 90 degree v notch weir	
2.	FLOW MEASURED AT EACH OUTFALL AS REQUIRED:	
3.	SECONDARY INSTRUMENTS (TOTALIZERS, RECORDERS, ETC.) PROPERLY OPERATED AND MAINTAINED: Badger 2100ME	
4.	CALIBRATION FREQUENCY ADEQUATE: Annually	
5.	RECORDS MAINTAINED OF CALIBRATION PROCEDURES:	
6.	CALIBRATION CHECKS DONE TO ASSURE CONTINUED COMPLIANCE: Monthly	
7.	FLOW ENTERING DEVICE WELL DISTRIBUTED ACROSS THE CHANNEL AND FREE OF TURBULENCE:	
8.	FLOW MEASUREMENT EQUIPMENT ADEQUATE TO HANDLE EXPECTED RANGE OF FLOW RATES:	
9.	HEAD MEASURED AT PROPER LOCATION:	
SE	ECTION F: LABORATORY	
PE	ERMITTEE LABORATORY PROCEDURES MEET PERMIT REQUIREMENTS	ØS OM OU ONA ONE
D	ETAILS:	
1.	EPA APPROVED ANALYTICAL PROCEDURES USED (40 CFR 136.3 FOR LIQUIDS, 503.8(B) FOR SLUDGES) :	MY ON ONA ONE
2.	IF ALTERNATIVE ANALYTICAL PROCEDURES ARE USED, PROPER APPROVAL HAS BEEN OBTAINED:	
3.	SATISFACTORY CALIBRATION AND MAINTENANCE OF INSTRUMENTS AND EQUIPMENT:	
4.	QUALITY CONTROL PROCEDURES ADEQUATE:	Øy 🛛 n 🖓 na 🖓 ne
5.	DUPLICATE SAMPLES ARE ANALYZED >10% OF THE TIME:	Øy On Ona One
6.	SPIKED SAMPLES ARE ANALYZED <u>>10%</u> OF THE TIME:	MY ON ONA ONE
7.	COMMERCIAL LABORATORY USED:	
a	a. LAB NAME: McClelland Consulting Engineers. Inc.	
t). LAB ADDRESS: CBOD5, TSS, NH3-N, FCB, TP, NO3=NO2=N, Cu, Zn,	
C	2. PARAMETERS PERFORMED: 900 West Markham St. Little Rock, AR 72201	
8.	BIOMONITORING PROCEDURES ADEQUATE:	Dy Dn Dna Øne
a	A. PROPER ORGANISMS USED:	DY DN DNA ØNE
t). PROPER DILUTION SERIES FOLLOWED:	Dy Dn Dna Øne
c	2. PROPER TEST METHODS AND DURATION:	Dy Dn Dna Øne
c	I. RETESTS AND/OR TRE PERFORMED AS REQUIRED:	

SECTION G: EFFLUENT/RECEIVING WATERS OBSERVATIONS										
BASED ON VISUAL OBSERVATIONS ONLY IS IN U INA INE										
DE	DETAILS:									
OU	ITFALL #:	OIL SHEEN	GREASE	TURBIDITY	VISIBLE FOAM	FLOATING SOLIDS	COLOR	OTHER		
	001	None	None	None	None	None	None			
SECTION H: SLUDGE DISPOSAL										
SLUDGE DISPOSAL MEETS PERMIT REQUIREMENTS 🛛 S 🗆 M 🗆 U 🗆 NA 🗆 NE										
DE	TAILS:	Centrifuge to d	ewater, send to	landfill weekly						
1.	SLUDGE M	ANAGEMENT ADEQU	ATE TO MAINTAIN EF	FLUENT QUALITY:			⊠s ⊡m			
2.	SLUDGE RI	ECORDS MAINTAINED	AS REQUIRED BY 40) CFR 503:			⊠s ⊡m			
3.	FOR LAND	APPLIED SLUDGE, TY	PE OF LAND APPLIE	D TO: (E.G., FOREST,	AGRICULTURAL, PUE	BLIC CONTACT SITE):				
		SAMPLING IN			-					
		ESULTS WITH	HIN PERMIT R	EQUIREMENT	S			U ⊠NA ⊡NE		
DE	TAILS:									
1.		OBTAINED THIS INSPE					ΠY			
2.		AMPLE: GRAB:		IETHOD: FREQUE	NCY:					
3.	SAMPLES F	PRESERVED:								
4.	FLOW PRO	PORTIONED SAMPLE	S OBTAINED:							
5.	SAMPLE O	BTAINED FROM FACIL	LITY'S SAMPLING DEV	ICE:						
6.	SAMPLE RE	EPRESENTATIVE OF	OLUME AND NATUR	E OF DISCHARGE:						
7.										
8.		CUSTODY PROCEDU								
9.	SAMPLES (COLLECTED IN ACCO	RDANCE WITH PERM	IT:			ΔY			
05		0700111/17								
		STORM WAT								
		ATER MANAG	EMENT MEET	S PERMIT RE	QUIREMENTS			U ØNA ⊡NE		
	TAILS:									
1.		DATED AS NEEDED:								
2.		NCLUDING ALL DISCH		E WATERS:						
3.		N PREVENTION TEAM								
4. 5		N PREVENTION TEAM								
5.										
6. 7		TENTIAL SOURCES A								
7. 8		RUCTURAL BMPS:	ANGLO ARE AUTOUR					On Øna One On Øna One		
8. 9.		N-STRUCTURAL BMPS:	<u>م</u>							
9. 10.		PERLY OPERATED A								
10.		INS CONDUCTED AS								

Inspection Report: City of Bryant, AFIN: 63-00065, Permit #: AR0034002

FLOW CALCULATION SHEET

Date: 1/2	4/2019	Time: 9:3	0					
lead in Ind	ches: 14.25	Feet:	1.2					
Type & Siz	e of Primary Flov	w Measuren	nent Device: 9	0 degree v-n	otch weir			
	¥							
Name & M	odel of Seconda	ry Flow Mea	surement Dev	/ice: Badge	er 2100MB			
				5/27/2018				
	t Calibration of S			J/Z1/ZU10				
Recorded I	Flow at Date & T	ime Listed A	Above: 1.57		(Facility Flow Meter)			
	Flow at Date &							
Flow is calcula	ted using flow charts in	: ISCO Open Cl	hannel Flow Measu	rement Handbook	-5 th Edition)			
% Error =	Recorded Valu		culated Value	X 100				
% Error = Calculated Value X 100								
	Cal							
	1.57	-	1.47	X 100				
% Error =		- 1.47	1.47	X 100				
% Error =			1.47	X 100				
	1.57	- 1.47 	1.47	- X 100				
% Error =	1.57 .10		1.47	- X 100				
% Error = % Error =	1.57 .10 1.47	— X 100	1.47	- X 100				

DMR Calculation Check

Reporting Period:	From	2018 Year	<u>8</u> Month	1 Day	_ To _	2018 Year	<u>8</u> Month	<u>31</u> Day		
Parameter Checked:	arameter Checked: CBOD5									
		Loading Mass			Concentration Monthly					
	Mo.	Mass Mo. Avg Ibs/day		Mo. A	Mo. Avg mg/l			g mg/l		
Reported Value:		26.6			2.0			0		
Calculated Value:		26.6		2.0			2.	0		
Permit Value:	ermit Value: 250.2			10.0			15	.0		


If calculated value does not equal reported value, explain:

DMR Calculation Check

Reporting Period:	From	2018 Year	9 Month	1 Day	_ To _	2018 Year	9 Month	<u>30</u> Day		
Parameter Checked:		NH3-N	-							
		Loading Mass			Concentration Monthly					
	Mo.	Avg Ibs/d	lay	Mo. A	vg r	ng/l	7-day Avg	mg/l		
Reported Value:	Reported Value: 1.9		0.1			.1				
Calculated Value:		1.9		0.1			0.1			
Permit Value:		60.0			2.4		6.1			

If calculated value does not equal reported value, explain:



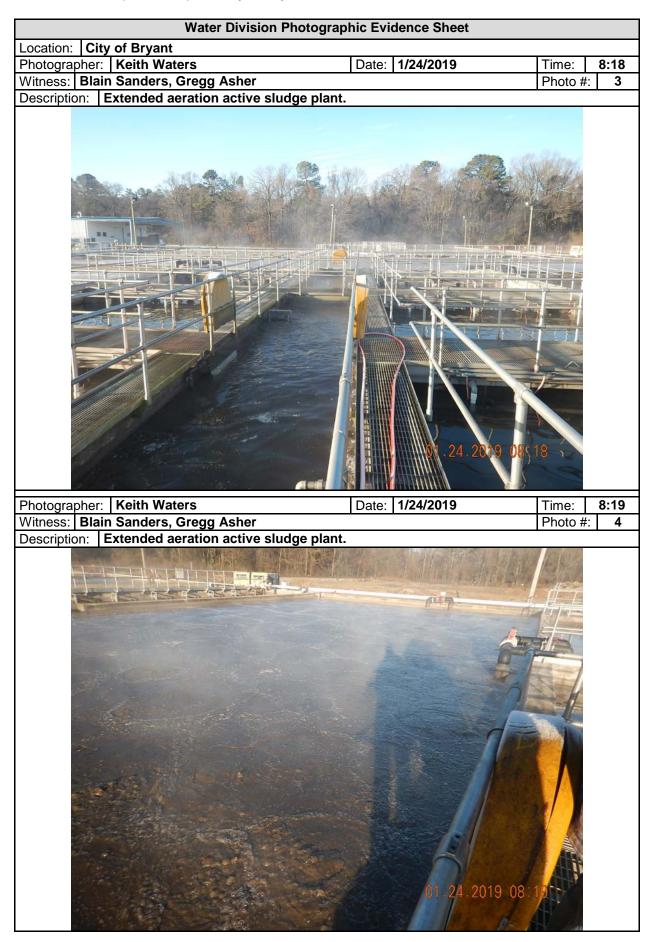





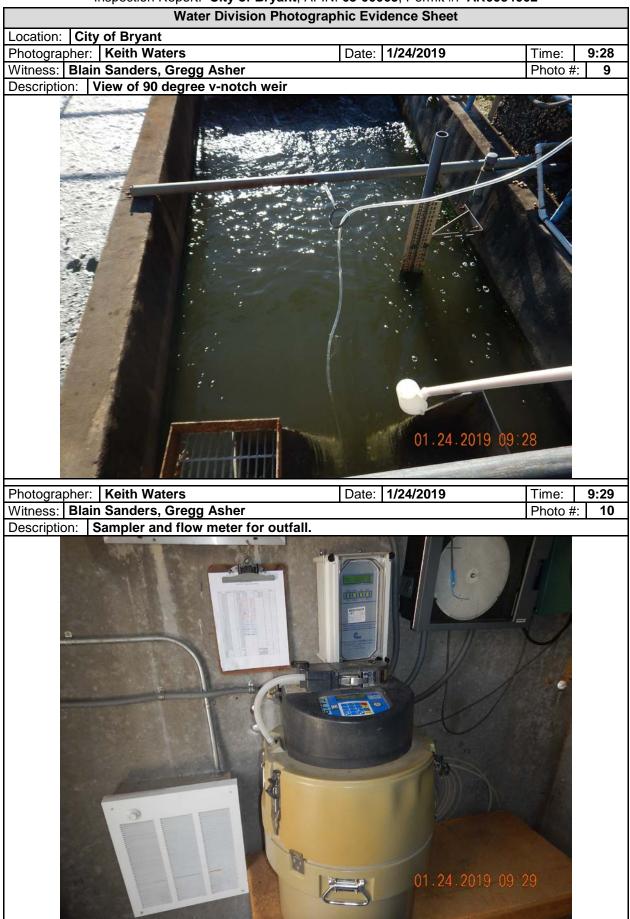




Figure 1: Google Earth image of the facility.

