

# ADEQ

ARKANSAS  
Department of Environmental Quality

July 21, 2020

Via email to: [thgross@aep.com](mailto:thgross@aep.com) & First Class Mail

Timothy Gross, Plant Manager  
American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
3711 Highway 355 South  
Fulton, AR 71838

Re: Notice of Final Permitting Decision; Permit No. 2123-AOP-R9

Dear Mr. Gross:

After considering the application, any public comments, and other applicable materials as required by APC&EC Reg. 8.211 and Ark. Code Ann. § 8-4-101 *et seq.*, this notice of final permitting decision is provided for:

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
3711 Highway 355 South  
Fulton, AR 71838

Permit Number: 2123-AOP-R9

Permitting Decision: approval with permit conditions as set forth in final Permit No. 2123-AOP-R9

Accessing the Permitting Decision and Response to Comments, if any:  
<https://www.adeq.state.ar.us/downloads/WebDatabases/PermitsOnline/Air/2123-AOP-R9.pdf>.

Accessing the Statement of Basis:  
<https://www.adeq.state.ar.us/downloads/WebDatabases/PermitsOnline/Air/2123-AOP-R9-SOB.pdf>.

The permitting decision is effective on the date stated in the attached Certificate of Service unless a Commission review has been properly requested under Arkansas Pollution Control & Ecology Commission's Administrative Procedures, Regulation No. 8, within thirty (30) days after service of this decision.

The applicant or permittee and any other person submitting public comments on the record may request an adjudicatory hearing and Commission review of the final permitting decisions as provided under Chapter Six of Regulation No. 8. Such a request shall be in the form and manner

required by Regulation 8.603, including filing a written Request for Hearing with the Commission secretary at 3800 Richards Rd, North Little Rock, Arkansas 72117. If you have any questions about filing the request, please call the Commission at 501-682-7890.

This permit is your authority to construct, operate, and maintain the equipment and control apparatus as set forth in your application initially received on 11/12/2019.

Sincerely,

A handwritten signature in black ink, appearing to read "William K. Montgomery", with a stylized flourish at the end.

William K. Montgomery  
Associate Director  
DEQ, Office of Air Quality

Enclosure: Certificate of Service

**CERTIFICATE OF SERVICE**

I, Cynthia Hook, hereby certify that the final permit decision notice has been mailed by first class mail to American Electric Power Service Corporation (John W. Turk Jr. Power Plant), 3711 Highway 355 South, Fulton, AR, 71838, on this 21st day of July, 2020.



---

Cynthia Hook, AA, Office of Air Quality

## RESPONSE TO COMMENTS

**AMERICAN ELECTRIC POWER SERVICE CORPORATION (JOHN W. TURK JR.  
POWER PLANT)  
PERMIT #2123-AOP-R9  
AFIN: 29-00506**

On March 3, 2020, the Director of the Arkansas Division of Environmental Quality gave notice of a draft permitting decision for the above referenced facility. During the comment period, written comments on the draft permitting decision were submitted on behalf of the facility. The Division's response to these issues follows.

*Note: The following page numbers and condition numbers refer to the draft permit. These references may have changed in the final permit based on changes made during the comment period.*

**Comment #1:**

It is requested that the averaging period for heat input be changed from a 24-hour average to a 30-day average.

**Response to Comment #1:**

A properly submitted permit application must be submitted for this change to be considered. An application is needed to demonstrate that the change is appropriate and to provide an opportunity for public notice and participation.

**Comment #2:**

It is requested that Plantwide Conditions under Mitigation of Visibility Impacts in Federal Class I Areas be updated. The permit revision for PSD-TX-3 Welsh Unit 2 has been obtained and Welsh Unit 2 has since been retired.

**Response to Comment #2:**

Plantwide Conditions 16 through 19 no longer apply and have been removed from the permit.

# ADEQ OPERATING AIR PERMIT

Pursuant to the Regulations of the Arkansas Operating Air Permit Program, Regulation 26:

Permit No. : 2123-AOP-R9

IS ISSUED TO:

American Electric Power Service Corporation (John W. Turk Jr. Power  
Plant)

3711 Highway 355 South  
Fulton, AR 71838  
Hempstead County  
AFIN: 29-00506

THIS PERMIT AUTHORIZES THE ABOVE REFERENCED PERMITTEE TO INSTALL,  
OPERATE, AND MAINTAIN THE EQUIPMENT AND EMISSION UNITS DESCRIBED IN  
THE PERMIT APPLICATION AND ON THE FOLLOWING PAGES. THIS PERMIT IS  
VALID BETWEEN:

July 21, 2020

AND

July 20, 2025

THE PERMITTEE IS SUBJECT TO ALL LIMITS AND CONDITIONS CONTAINED  
HEREIN.

Signed:



William K. Montgomery  
Associate Director  
DEQ, Office of Air Quality

July 21, 2020

Date

Table of Contents

|                                                                                     |     |
|-------------------------------------------------------------------------------------|-----|
| <b>SECTION I: FACILITY INFORMATION</b> .....                                        | 4   |
| <b>SECTION II: INTRODUCTION</b> .....                                               | 5   |
| <b>Summary of Permit Activity</b> .....                                             | 5   |
| <b>Process Description</b> .....                                                    | 5   |
| <b>Regulations</b> .....                                                            | 8   |
| <b>Emission Summary</b> .....                                                       | 8   |
| <b>SECTION III: PERMIT HISTORY</b> .....                                            | 15  |
| <b>SECTION IV: SPECIFIC CONDITIONS</b> .....                                        | 19  |
| SN-01 .....                                                                         | 19  |
| SN-02 .....                                                                         | 86  |
| SN-03 .....                                                                         | 92  |
| SN-04 .....                                                                         | 97  |
| SN-EP-01 through EP-10, EP-12, TP-16, and TP-20 .....                               | 102 |
| SN-TP-22 and TP-23 .....                                                            | 104 |
| SN-EP-15 through EP-24 .....                                                        | 106 |
| SN-F-01 through F-06 .....                                                          | 109 |
| SN-CT-01 .....                                                                      | 112 |
| SN-RD-01 .....                                                                      | 113 |
| SN-TK-01 .....                                                                      | 115 |
| SN-05 .....                                                                         | 117 |
| <b>SECTION V: COMPLIANCE PLAN AND SCHEDULE</b> .....                                | 120 |
| <b>SECTION VI: PLANTWIDE CONDITIONS</b> .....                                       | 121 |
| Title VI Provisions .....                                                           | 122 |
| Acid Rain (Title IV) .....                                                          | 123 |
| Transport Rule (TR) NO <sub>x</sub> Ozone Season Trading Program Requirements ..... | 123 |
| <b>SECTION VII: INSIGNIFICANT ACTIVITIES</b> .....                                  | 130 |
| <b>SECTION VIII: GENERAL PROVISIONS</b> .....                                       | 131 |
| Appendix A – 40 CFR Part 60, Subpart Da                                             |     |
| Appendix B – 40 CFR Part 60, Subpart Db                                             |     |
| Appendix C – 40 CFR Part 60, Subpart Y                                              |     |
| Appendix D – 40 CFR Part 60, Subpart IIII                                           |     |
| Appendix E – 40 CFR Part 63, Subpart ZZZZ                                           |     |
| Appendix F – Acid Rain Permit Application                                           |     |
| Appendix G – Cross-State Air Pollution Rule (CSAPR) Monitoring Provisions form      |     |
| Appendix H – Arkansas Continuous Emission Monitoring Systems Conditions             |     |
| Appendix I – 40 CFR Part 63, Subpart UUUUU                                          |     |

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

#### List of Acronyms and Abbreviations

|                  |                                             |
|------------------|---------------------------------------------|
| Ark. Code Ann.   | Arkansas Code Annotated                     |
| AFIN             | ADEQ Facility Identification Number         |
| C.F.R.           | Code of Federal Regulations                 |
| CO               | Carbon Monoxide                             |
| HAP              | Hazardous Air Pollutant                     |
| lb/hr            | Pound Per Hour                              |
| MVAC             | Motor Vehicle Air Conditioner               |
| No.              | Number                                      |
| NO <sub>x</sub>  | Nitrogen Oxide                              |
| PM               | Particulate Matter                          |
| PM <sub>10</sub> | Particulate Matter Smaller Than Ten Microns |
| SNAP             | Significant New Alternatives Program (SNAP) |
| SO <sub>2</sub>  | Sulfur Dioxide                              |
| SSM              | Startup, Shutdown, and Malfunction Plan     |
| Tpy              | Tons Per Year                               |
| UTM              | Universal Transverse Mercator               |
| VOC              | Volatile Organic Compound                   |

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

**SECTION I: FACILITY INFORMATION**

PERMITTEE: American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

AFIN: 29-00506

PERMIT NUMBER: 2123-AOP-R9

FACILITY ADDRESS: 3711 Highway 355 South  
Fulton, AR 71838

MAILING ADDRESS: 3711 Highway 355 South  
Fulton, AR 71838

COUNTY: Hempstead County

CONTACT NAME: Timothy Gross

CONTACT POSITION: Plant Manager

TELEPHONE NUMBER: (903) 831-1505

REVIEWING ENGINEER: John Mazurkiewicz

UTM North South (Y): Zone 15: 3723205.42 m

UTM East West (X): Zone 15: 423103.24 m



## **SECTION II: INTRODUCTION**

### **Summary of Permit Activity**

Southwestern Electric Power Company (SWEPCO), a unit of American Electric Power (AEP), is operating a coal-fired electric power generating facility near Fulton, Arkansas, in Hempstead County. This facility is named the John W. Turk, Jr. Power Plant. The main steam generating unit consists of one ultra-supercritical pulverized coal boiler powering a single steam turbine designed for base load operation with a nominal net power output of 600 megawatts. This boiler burns sub-bituminous coal and natural gas.

This permit renews the Title V permit for this facility with no changes in permitted emissions.

### **Process Description**

#### Coal Handling

Coal is unloaded from railcars by a partially enclosed rotary car dumper and dropped to underground hoppers. The coal unloading drop is designated TP-01. Surfactant sprays are used at TP-01 to minimize dusting through the open ends of the rotary car dumper building (SN-EP-01). The coal is removed from the hoppers by belt feeders 1 and 2, which drop the coal onto a partially underground coal conveyor C-1. This drop point is designated TP-02. Residual sprays are used at TP-02 to further minimize dusting. Emissions from TP-02 are exhausted through the coal dumper tunnel exhaust fan (SN-EP-02).

Coal conveyor C-1 carries the coal from under the dumper into the top of the enclosed central transfer house and drops onto either conveyor C-2 or C-51. Controlled Flow Transfer Chute (CFTC) technology is used at these drops designated TP-03 and TP-04 respectively.

The partially enclosed conveyor C-2 carries the coal from the central transfer house to the open sided head house structure above lowering well 1 (SN-EP-03). Conveyor C-2 drops coal via CFTC onto conveyor C-3, designated TP-05, or into the top of lowering well 1, designated TP-06. Conveyor C-3 carries the coal through a partially enclosed duct to the open sided head house structure above lowering well 2 (SN-EP-04) and drops the coal into the top of lowering well 2. This drop is designated TP-07.

Coal exits the lowering wells through alternating north/south and east/west penetrations through the wall of the concrete structures to form the active coal piles. The active pile around lowering well 1 is designated A and the active pile around lowering well 2 is designated B. Emissions are generated from wind erosion at active coal pile A (SN-F-01), active coal pile B (SN-F-02), dozing activities among the piles (SN-F-03), and inactive coal piles (SN-F-04).

Coal is moved from the coal piles to the reclaim table of a partially underground reclaim tunnel. Two rotary plows are located on partially enclosed skids sitting above conveyor C-4. This conveyor runs the length of the reclaim tunnel and then exits above ground to the central transfer

house. The rotary plow skids move along the length of the tunnel allowing the rotary plows to gather coal deposited on the reclaim table and drop it onto the portion of conveyor C-4 running under the skids. The drop from rotary plow 1 to conveyor C-4 is designated TP-08 and from rotary plow 2 to conveyor C-4 is designated TP-09. Surfactant sprays are used at the conveyor C-4 loading point of each rotary plow skid to control TP-08 and TP-09 emissions. Minimal emissions in the tunnel are exhausted through five coal reclaim tunnel exhaust fans (SN-EP-05).

Conveyor C-4 carries the coal from the reclaim tunnel to the enclosed central transfer house where it drops via CFTC onto conveyor C-51. This drop is designated TP-10. Minimal emissions generated from drops TP-03, TP-04, and TP-10 within the central transfer house are exhausted through two central transfer house exhaust fans (SN-EP-06).

The partially enclosed conveyor C-51 carries the coal to the top of the enclosed crusher house and drops it into surge bins. The top of the surge bins are equipped with pick-up/collection hoods connected to a single forced air dust collector fan that exhausts outside the crusher house (SN-EP-12). Coal is unloaded from the surge bins by crusher feeders 1 and 2. Where crusher feeder 1 drops coal into crusher 1 or into the crusher 1 bypass is designated TP-12. Where crusher feeder 2 drops coal into crusher 2 or into the crusher 2 bypass is designated TP-13. The crushed or bypassed coal is dropped onto conveyor C-61. The drop from crusher 1 or the crusher 1 bypass to conveyor C-61 is designated TP-14. The drop from crusher 2 or the crusher 2 bypass to conveyor C-61 is designated TP-15. Emissions are contained and controlled through totally enclosed chute work and the use of wet fog application points at TP-12, TP-13, and at the conveyor C-61 loading points for TP-14 and TP-15. Other minimal emissions generated from drops TP-12, TP-13, TP-14, and TP-15 within the crusher house are exhausted through two crusher house exhaust fans (SN-EP-07).

The partially enclosed conveyor C-61 carries the coal from the crusher house to the top of the plant transfer house and drops it through CFTC chute work onto conveyor C-71. This drop is designated TP-16 and vents to the plant transfer house exhaust fans (SN-EP-08). Conveyor C-71 carries the coal from the plant transfer house to the tripper house. CFTC technology is used at the conveyor-to-tripper conveyor drop, which moves along conveyor C-71 to select positions over each of the six in-plant storage silos. This tripper drop is designated TP-17. Emissions generated from drop TP-17 within the tripper house are exhausted through two tripper house exhaust fans (SN-EP-09). The top of the in-plant silos are equipped with pick-up/collection hoods connected to a single wet scrubber fan that exhausts outside the tripper house (SN-EP-10).

### Power Plant

An ultra-supercritical pulverized coal (PC) boiler (SN-01) produces steam to drive a condensing steam turbine to generate electricity. The PC boiler burns sub-bituminous coal as the main fuel and uses natural gas for startup and flame stabilization. A natural gas-fired auxiliary boiler (SN-02) is also used during startup of the PC boiler.

During normal operation, emissions from the PC boiler are controlled using low-NO<sub>x</sub> burners (LNB) with over-fire air (OFA), selective catalytic reduction (SCR), dry flue gas desulfurization

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

(DFGD)/spray dryer absorber (SDA), pulse jet fabric filtration (i.e., PJFF baghouse) and activated carbon injection (ACI).

Cooling water used in the steam turbine condenser is provided by a mechanical draft cooling tower (SN-CT-1). Plant makeup water is treated in the onsite water treatment facility.

Anhydrous ammonia for use in the SCR system is stored in tanks equipped with pressure vent valves set to minimize standing losses. The ammonia is vaporized and transported from the storage tanks to the injection location.

### Lime Handling

Lime for use in the (Spray Dry Absorber) SDA is delivered by rail, unloaded with a vacuum pneumatic system, and pneumatically conveyed to a lime storage silo. The exhaust points for this system are the two Lime Vacuum Blowers (SN-EP-15 and SN-EP-16). The lime storage silo is equipped with a bin vent filter (SN-EP-17), and two (2) surge bin dust collectors (SN-EP-18 and SN-EP-19) at the discharge of the silo. From the storage silo, the lime is pneumatically conveyed to either of the lime storage day bins in the reagent preparation area. The lime storage day bins are each equipped with a bin vent filter (SN-EP-18 and SN-EP-19). Recycled FGD waste is mixed with water in the recycle ash mix tanks. The fresh lime slurry and recycle slurry streams are then mixed and pumped to the SDA.

### Fly Ash and FGD Waste Handling

Fly ash and FGD waste removed from the flue gas is conveyed by means of a vacuum created by mechanical exhausters (two in service with one spare SN-EP-23, SN-EP-24, and SN-EP-25) to one of two ash transfer stations. The ash and FGD waste are then pneumatically conveyed to either the recycle ash or waste ash storage silos. The recycle ash and waste ash storage silos are equipped with bin vent filters (SN-EP-21 and SN-EP-22). Transport air for each vacuum pneumatic conveyance system passes through filter separators (SN-EP-23, SN-EP-24, and a stand-by SN-EP-25) before being exhausted to the atmosphere.

From the storage silos, the fly ash/FGD waste is mixed with water and then drop loaded into open top dump trucks (SN-TP-22). The dump trucks unload the fly ash/FGD waste to an onsite landfill (SN-TP-23). Emissions may be generated by wind erosion of the landfill (SN-F-6), dozing of the fly ash/FGD waste and overburden (SN-F-5), and by the haul roads (SN-RD-1). Bottom ash, which includes furnace ash from the boiler, pyrites from the mills, and economizer ash, is collected in a submerged, water-filled trough and then conveyed to a storage bunker. From the bunker, the bottom ash is loaded into trucks and hauled to disposal. Any emissions from the handling of bottom ash are accounted for above.

### Emergency Equipment

A diesel-fired emergency generator (SN-03) is used to supply power during outages, a small diesel-fired engine (SN-04) is used to pump water needed for fire suppression, and a diesel-fired

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
 Permit #: 2123-AOP-R9  
 AFIN: 29-00506

emergency engine (SN-05) is used to support the facility's coal pile runoff pond and associated coal pile runoff surge tanks. Diesel fuel is stored in tanks (insignificant activity).

### Regulations

The following table contains the regulations applicable to this permit.

| Regulations                                                                                                                                                          |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Arkansas Air Pollution Control Code, Regulation 18, effective March 14, 2016                                                                                         |
| Regulations of the Arkansas Plan of Implementation for Air Pollution Control, Regulation 19, effective October 10, 2019                                              |
| Regulations of the Arkansas Operating Air Permit Program, Regulation 26, effective March 14, 2016                                                                    |
| 40 CFR Part 52.21, Prevention of Significant Deterioration (PSD)                                                                                                     |
| 40 CFR Part 60, Subpart Da, <i>Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced after September 18, 1978</i> |
| 40 CFR Part 60, Subpart Db, <i>Standards of Performance for Industrial-Commercial-Institutional Steam Generating Units</i>                                           |
| 40 CFR Part 60, Subpart Y, <i>Standards of Performance for Coal Preparation Plants</i>                                                                               |
| 40 CFR Part 60, Subpart III, <i>Standards of Performance for Stationary Compression Ignition Internal Combustion Engines</i>                                         |
| 40 CFR Part 63, Subpart ZZZZ, <i>National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines</i>               |
| 40 CFR Part 63, Subpart UUUUU, <i>National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units</i>          |
| Cross-State Air Pollution Rule (CSAPR)                                                                                                                               |

### Emission Summary

The following table is a summary of emissions from the facility. This table, in itself, is not an enforceable condition of the permit.

| EMISSION SUMMARY          |             |                   |                         |        |
|---------------------------|-------------|-------------------|-------------------------|--------|
| Source Number             | Description | Pollutant         | Emission Rates          |        |
|                           |             |                   | lb/hr                   | tpy    |
| Total Allowable Emissions |             | PM                | 114.10                  | 468.50 |
|                           |             | PM <sub>10</sub>  | 176.4                   | 744.0  |
|                           |             | PM <sub>2.5</sub> | See Note <sup>1</sup> . |        |

| EMISSION SUMMARY    |                             |                              |                |          |
|---------------------|-----------------------------|------------------------------|----------------|----------|
| Source Number       | Description                 | Pollutant                    | Emission Rates |          |
|                     |                             |                              | lb/hr          | tpy      |
|                     |                             | SO <sub>2</sub>              | 480.7          | 2,102.8  |
|                     |                             | VOC                          | 74.3           | 96.71    |
|                     |                             | CO                           | 1,082.8        | 3,986.7  |
|                     |                             | NO <sub>x</sub>              | 506.9          | 1,334.5  |
|                     | HAPs                        | Acetaldehyde*                | 0.03           | 0.03     |
|                     |                             | Acrolein*                    | 0.03           | 0.03     |
|                     |                             | Benzene*                     | 0.72           | 0.05     |
|                     |                             | 1,3-Butadiene*               | 0.04           | 0.04     |
|                     |                             | Formaldehyde*                | 0.03           | 0.03     |
|                     |                             | Hexane*                      | 0.53           | 0.01     |
|                     |                             | Hydrogen Chloride            | 12.00          | 52.56    |
|                     |                             | Hydrogen Fluoride            | 1.20           | 5.26     |
|                     |                             | Lead**                       | 0.1603         | 0.6801   |
|                     |                             | Mercury                      | 7.34E-03       | 3.17E-02 |
|                     |                             | POM*                         | 0.03           | 0.03     |
|                     |                             | Sulfuric Acid                | 25.20          | 110.38   |
|                     |                             | Toluene*                     | 0.88           | 0.05     |
|                     |                             | 2,2,4-Trimethylpentane*      | 0.21           | 0.01     |
|                     |                             | Xylene*                      | 0.22           | 0.04     |
|                     | Total Other HAPs            | 9.00                         | 35.15          |          |
|                     | Total Other Chargeable HAPs | 0.13                         | 0.55           |          |
| Air Contaminants ** |                             | Ammonia                      | 37.50          | 164.40   |
|                     |                             | Total Other Air Contaminants | 0.16           | 0.68     |

| EMISSION SUMMARY |                                                                  |                              |                    |          |
|------------------|------------------------------------------------------------------|------------------------------|--------------------|----------|
| Source Number    | Description                                                      | Pollutant                    | Emission Rates     |          |
|                  |                                                                  |                              | lb/hr              | tpy      |
| 01               | Main Boiler                                                      | PM                           | 72.0               | 315.4    |
|                  |                                                                  | PM <sub>10</sub>             | 150.0              | 657.0    |
|                  |                                                                  | SO <sub>2</sub>              | 480.0              | 2102.4   |
|                  |                                                                  | VOC                          | 21.6               | 94.61    |
|                  |                                                                  | CO                           | 900.0 <sup>c</sup> | 3,942.0  |
|                  |                                                                  | NO <sub>x</sub>              | 420.0              | 1,314.0  |
|                  |                                                                  | Lead**                       | 0.16               | 0.68     |
|                  |                                                                  | Sulfuric Acid                | 25.2               | 110.38   |
|                  |                                                                  | Hydrogen Chloride            | 12.00              | 52.56    |
|                  |                                                                  | Mercury                      | 7.20E-03           | 3.16E-02 |
|                  |                                                                  | Hydrogen Fluoride            | 1.20               | 5.26     |
|                  |                                                                  | Total Other HAPs             | 7.97               | 34.89    |
|                  |                                                                  | Total Other Chargeable HAPs  | 0.13               | 0.55     |
|                  |                                                                  | Total Other Air Contaminants | 0.16               | 0.68     |
| Ammonia***       | 37.50                                                            | 164.40                       |                    |          |
| 02               | Auxiliary Boiler                                                 | PM                           | 4.3                | 1.1      |
|                  |                                                                  | PM <sub>10</sub>             | 4.3                | 1.1      |
|                  |                                                                  | SO <sub>2</sub>              | 0.4                | 0.1      |
|                  |                                                                  | VOC                          | 3.1                | 0.8      |
|                  |                                                                  | CO                           | 166.5              | 41.6     |
|                  |                                                                  | NO <sub>x</sub>              | 61.1               | 15.3     |
|                  |                                                                  | Lead**                       | 2.72E-04           | 6.80E-05 |
|                  |                                                                  | Mercury                      | 0.00014            | 0.000035 |
|                  |                                                                  | Total Other HAPs             | 1.03               | 0.26     |
| 03               | Emergency Diesel Generator<br>(2200 Hp with Serial No. 33180174) | PM                           | 0.6                | 0.2      |
|                  |                                                                  | PM <sub>10</sub>             | 0.6                | 0.2      |
|                  |                                                                  | SO <sub>2</sub>              | 0.1                | 0.1      |
|                  |                                                                  | VOC                          | 1.2                | 0.3      |
|                  |                                                                  | CO                           | 10.5               | 2.7      |
|                  |                                                                  | NO <sub>x</sub>              | 19.1               | 4.8      |
|                  |                                                                  | 1,3-Butadiene*               | 0.01               | 0.01     |
|                  |                                                                  | Acetaldehyde*                | 0.01               | 0.01     |
|                  |                                                                  | Acrolein*                    | 0.01               | 0.01     |
|                  |                                                                  | Benzene*                     | 0.02               | 0.01     |
|                  |                                                                  | Formaldehyde*                | 0.01               | 0.01     |
|                  |                                                                  | POM*                         | 0.01               | 0.01     |
|                  |                                                                  | Toluene*                     | 0.01               | 0.01     |
|                  |                                                                  | Xylene*                      | 0.01               | 0.01     |

| EMISSION SUMMARY |                                                               |                  |                |      |
|------------------|---------------------------------------------------------------|------------------|----------------|------|
| Source Number    | Description                                                   | Pollutant        | Emission Rates |      |
|                  |                                                               |                  | lb/hr          | tpy  |
| 04               | Fire Pump Diesel Engines<br>(460 Hp with Serial No. 79403491) | PM               | 0.2            | 0.1  |
|                  |                                                               | PM <sub>10</sub> | 0.2            | 0.1  |
|                  |                                                               | SO <sub>2</sub>  | 0.1            | 0.1  |
|                  |                                                               | VOC              | 1.2            | 0.1  |
|                  |                                                               | CO               | 2.7            | 0.2  |
|                  |                                                               | NO <sub>x</sub>  | 3.1            | 0.2  |
|                  |                                                               | 1,3-Butadiene*   | 0.01           | 0.01 |
|                  |                                                               | Acetaldehyde*    | 0.01           | 0.01 |
|                  |                                                               | Acrolein*        | 0.01           | 0.01 |
|                  |                                                               | Benzene*         | 0.01           | 0.01 |
|                  |                                                               | Formaldehyde*    | 0.01           | 0.01 |
|                  |                                                               | POM*             | 0.01           | 0.01 |
|                  |                                                               | Toluene*         | 0.01           | 0.01 |
| Xylene*          | 0.01                                                          | 0.01             |                |      |
| EP-01            | Rotary Car Dumper Building                                    | PM               | 0.1            | 0.2  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-02            | Coal Dumper Tunnel Exhaust Fan                                | PM               | 0.1            | 0.2  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-03            | Head House on Lowering Well 1                                 | PM               | 0.3            | 1.0  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.5  |
| EP-04            | Head House on Lowering Well 2                                 | PM               | 0.3            | 1.0  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.5  |
| EP-05            | Reclaim Tunnel Exhaust Fans (x5)                              | PM               | 0.1            | 0.1  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-06            | Central Transfer House Exhaust Fans (x2)                      | PM               | 0.1            | 0.2  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-07            | Crusher House Exhaust Fans (x2)                               | PM               | 0.1            | 0.2  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-08            | Plant Transfer House Exhaust Fans (x2)                        | PM               | 0.1            | 0.1  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-09            | Tripper House Exhaust Fans (x2)                               | PM               | 0.1            | 0.1  |
|                  |                                                               | PM <sub>10</sub> | 0.1            | 0.1  |
| EP-10            | Coal Silo Wet Scrubber                                        | PM               | 1.2            | 4.9  |
|                  |                                                               | PM <sub>10</sub> | 1.2            | 4.9  |
| EP-12            | Coal Crusher House Surge Bin – Dust Collector                 | PM               | 0.8            | 3.4  |
|                  |                                                               | PM <sub>10</sub> | 0.8            | 3.4  |

| EMISSION SUMMARY |                                                                    |                                |                  |                  |
|------------------|--------------------------------------------------------------------|--------------------------------|------------------|------------------|
| Source Number    | Description                                                        | Pollutant                      | Emission Rates   |                  |
|                  |                                                                    |                                | lb/hr            | tpy              |
| EP-15            | Lime Vacuum Blower Railcar Unloading (1) – Vacuum Exhauster        | PM                             | 0.2              | 0.9              |
|                  |                                                                    | PM <sub>10</sub>               | 0.2              | 0.9              |
| EP-16            | Lime Vacuum Blower Railcar Unloading (2) – Vacuum Exhauster        | PM                             | 0.2              | 0.9              |
|                  |                                                                    | PM <sub>10</sub>               | 0.2              | 0.9              |
| EP-17            | Lime Storage Silo Bin Vent Filter                                  | PM                             | 0.6              | 2.7              |
|                  |                                                                    | PM <sub>10</sub>               | 0.6              | 2.7              |
| EP-18            | Lime Storage Surge Bin (1) Bin Vent Filter                         | PM                             | 0.7              | 2.9              |
|                  |                                                                    | PM <sub>10</sub>               | 0.7              | 2.9              |
| EP-19            | Lime Storage Surge Bin (2) Bin Vent Filter                         | PM                             | 0.7              | 2.9              |
|                  |                                                                    | PM <sub>10</sub>               | 0.7              | 2.9              |
| EP-20            | Activated Carbon Bin Vent Filter                                   | PM                             | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
|                  |                                                                    | PM <sub>10</sub>               | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-20B           | Activated Carbon Bin Vent Filter                                   | PM                             | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
|                  |                                                                    | PM <sub>10</sub>               | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-21            | Fly Ash Waste Storage Silo -Bin Vent Filter                        | PM                             | 1.1              | 4.7              |
|                  |                                                                    | PM <sub>10</sub>               | 1.1              | 4.7              |
| EP-22            | Fly Ash Recycle Storage Silo -Bin Vent Filter                      | PM                             | 0.9              | 3.8              |
|                  |                                                                    | PM <sub>10</sub>               | 0.9              | 3.8              |
| EP-23            | Fly Ash/FGD (1) (to Ash Transfer Station) – Mechanical Exhauster   | PM                             | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
|                  |                                                                    | PM <sub>10</sub>               | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-24            | Fly Ash/FGD (2) (to Ash Transfer Station) – Mechanical Exhauster   | PM                             | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
|                  |                                                                    | PM <sub>10</sub>               | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-25            | Fly Ash/Byproduct (to Ash Transfer Station) – Mechanical Exhauster | PM                             | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
|                  |                                                                    | PM <sub>10</sub>               | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| TP-16            | Material Transfer (C-61 to C-71)                                   | This source vents to SN-EP-08. |                  |                  |
| TP-20            | Material Transfer (C-7A to storage silos)                          | This source vents to SN-EP-10. |                  |                  |
| TP-22            | Material Transfer (Fly Ash/FGD Waste to Truck)                     | PM                             | 0.1              | 0.2              |
|                  |                                                                    | PM <sub>10</sub>               | 0.1              | 0.1              |
| TP-23            | Fly Ash Disposal to Landfill                                       | PM                             | 0.1              | 0.2              |
|                  |                                                                    | PM <sub>10</sub>               | 0.1              | 0.1              |



| EMISSION SUMMARY |                                        |                         |                |      |
|------------------|----------------------------------------|-------------------------|----------------|------|
| Source Number    | Description                            | Pollutant               | Emission Rates |      |
|                  |                                        |                         | lb/hr          | tpy  |
| F-01             | Active Coal Pile                       | PM                      | 0.2            | 0.8  |
|                  |                                        | PM <sub>10</sub>        | 0.1            | 0.4  |
| F-02             | Active Coal Pile                       | PM                      | 0.2            | 0.8  |
|                  |                                        | PM <sub>10</sub>        | 0.1            | 0.4  |
| F-03             | Dozing Coal – Active and Inactive Pile | PM                      | 2.1            | 9.4  |
|                  |                                        | PM <sub>10</sub>        | 0.4            | 1.5  |
| F-04             | Inactive Coal Piles                    | PM                      | 1.1            | 4.7  |
|                  |                                        | PM <sub>10</sub>        | 0.6            | 2.4  |
| F-05             | Dozing of Solid Waste Disposal Area    | PM                      | 10.7           | 46.9 |
|                  |                                        | PM <sub>10</sub>        | 3.3            | 14.3 |
| F-06             | Solid Waste Disposal Storage           | PM                      | 4.4            | 19.0 |
|                  |                                        | PM <sub>10</sub>        | 1.6            | 6.7  |
| CT-01            | Cooling Tower                          | PM                      | 5.2            | 22.8 |
|                  |                                        | PM <sub>10</sub>        | 5.2            | 22.8 |
| RD-01            | Roads                                  | PM                      | 3.8            | 11.9 |
|                  |                                        | PM <sub>10</sub>        | 1.1            | 3.3  |
| TK-01            | Gasoline Storage Tank (4,000 gallon)   | VOC                     | 47.0           | 0.8  |
|                  |                                        | Benzene*                | 0.68           | 0.02 |
|                  |                                        | 1,3-Butadiene*          | 0.01           | 0.01 |
|                  |                                        | Hexane*                 | 0.53           | 0.01 |
|                  |                                        | Toluene*                | 0.85           | 0.02 |
|                  |                                        | 2,2,4-Trimethylpentane* | 0.21           | 0.01 |
|                  |                                        | Xylene*                 | 0.19           | 0.01 |
| 05               | 300 BHP Diesel Emergency Engine        | PM                      | 0.2            | 0.1  |
|                  |                                        | PM <sub>10</sub>        | 0.2            | 0.1  |
|                  |                                        | SO <sub>2</sub>         | 0.1            | 0.1  |
|                  |                                        | VOC                     | 0.2            | 0.1  |
|                  |                                        | CO                      | 3.1            | 0.2  |
|                  |                                        | NO <sub>x</sub>         | 3.6            | 0.2  |
|                  |                                        | 1,3-Butadiene*          | 0.01           | 0.01 |
|                  |                                        | Acetaldehyde*           | 0.01           | 0.01 |
|                  |                                        | Acrolein*               | 0.01           | 0.01 |
|                  |                                        | Benzene*                | 0.01           | 0.01 |
|                  |                                        | Formaldehyde*           | 0.01           | 0.01 |
|                  |                                        | POM*                    | 0.01           | 0.01 |
|                  |                                        | Toluene*                | 0.01           | 0.01 |
| Xylene*          | 0.01                                   | 0.01                    |                |      |

\*HAPs included in the VOC totals. Other HAPs are not included in any other totals unless specifically stated.

\*\*HAPs included in the PM totals.

\*\*\*Air Contaminants such as ammonia, acetone, and certain halogenated solvents are not VOCs or HAPs.

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

- a. Only two (2) of the three (3) fly ash transfer stations (SN-EP-23, SN-EP-24, and SN-EP-25) are able to operate simultaneously.
- b. Only one (1) of the two (2) activated carbon bin vent filters (SN-EP20 and SN-EP20B) are able to operate at any given time.
- c. 30-day rolling average
  1.  $PM_{2.5}$  limits are source specific, if required. Not all sources have  $PM_{2.5}$  limits.

### SECTION III: PERMIT HISTORY

Permit 2123-AOP-R0 was issued on November 5, 2008. This was the initial permit for Southwestern Electric Power Company (SWEPCO), a unit of American Electric Power (AEP), a new coal-fired electric power generating facility. This facility was named the John W. Turk, Jr. Power Plant. The main steam generating unit consists of one ultra-supercritical pulverized coal boiler powering a single steam turbine designed for base load operation with a nominal net power output of 600 megawatts. This boiler burns sub-bituminous coal and natural gas. The major permitted emission rates for the facility were 801.56 tpy PM, 732.26 tpy PM<sub>10</sub>, 2102.69 tpy SO<sub>2</sub>, 23.08 tpy VOC, 3952.0 tpy CO, 1336.6 tpy NO<sub>x</sub>, and 110.38 tpy H<sub>2</sub>SO<sub>4</sub>.

Permit 2123-AOP-R1 was issued on December 7, 2012. With this modification, the following changes were made to the permit:

1. Numerous administrative corrections were requested in a red line version of the permit submitted with the application, all of which were accepted except for three changes;
2. The size of the emergency diesel generator engine (SN-03) was changed from a 2 MW unit to a 1.325 MW unit. Corrected emissions calculations, emission rate tables (ERTs), and HAP ERTs were submitted to update the permitted emission rates of the permit;
3. Only one fire pump diesel engine (SN-04) was installed instead of two. Instead of two 300 Hp engines, only one 460 Hp engine was installed at the facility. Corrected emissions calculations, emission rate tables (ERTs), and HAP ERTs were submitted to update the permitted emission rates of the permit;
4. Numerous administrative corrections to the material handling systems were requested in a red line version of the permit submitted with application;
5. A 4,000 gallon above ground gasoline storage tank (SN-TK-01) was added;
6. Numerous insignificant activities were added;
7. The scenario for firing coal with sulfur greater than 0.45% by weight (wet basis) was removed; and
8. Federal requirements from all NSPSs and NESHAPs were updated.

The facility also requested to remove or modify Specific Conditions 10, 18, and 19 of Permit 2123-AOP-R0. These conditions, now Specific Conditions 10, 61, and 62, remained as written in Permit 2123-AOP-R0. This permitting action also incorporated the facility's Acid Rain permit application and the facility's Clean Air Interstate Rule (CAIR) permit application. The permitted emission increases included 0.01 tpy of SO<sub>2</sub>, 0.02 tpy of Benzene, 0.01 tpy of 1,3-Butadiene, 0.01 tpy of Hexane, 0.01 tpy of Lead, 0.02 tpy of Sulfuric Acid, 0.02 tpy of Toluene, 0.01 tpy of 2,2,4-Trimethylpentane, and 0.01 tpy of Xylene. The permitted emission decreases included 0.61 tpy of PM, 0.56 tpy of PM<sub>10</sub>, 0.58 tpy of VOC, 1.1 tpy of CO, 2.3 tpy of NO<sub>x</sub>, and 0.03 tpy of Beryllium.

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

Permit 2123-AOP-R2 was issued on March 28, 2013. With the modification, the following changes were made to the permit:

- Numerous administrative corrections to the material handling systems' process descriptions were updated;
- The maximum throughput on several coal conveyors were decreased from 1000 tons/hr to 950 tons/hr;
- The rotary car dumper building was separated out as its own fugitive emission point. It was initially combined under EP-01 with the dumper tunnel exhaust fan;
- EP-25 was added as a backup to EP-23 and EP-24, and only two of these three sources can operate at the same time;
- EP-20B was added as a backup to EP-20;
- EP-07, EP-08, and EP-09 were added to the coal handling system;
- The size of the inactive coal pile was increased from 14 acres to 26 acres; and
- The fan flow was increased from 1,000 ACFM to 9,000 ACFM at SN-EP-12.

The permitted emission decreases included 3.8 tpy of PM and 0.8 tpy of PM<sub>10</sub>.

Permit 2123-AOP-R3 was issued on May 14, 2015. As part of the renewal, the following changes were made:

- Minor corrections to the following sources:
  - SN-02: Increase Hexane short term limit to 1.0 lb/hr;
  - SN-03: Decrease Acetaldehyde short term limit to 0.01 lb/hr;
  - SN-03: Decrease Formaldehyde short term limit to 0.01 lb/hr;
  - SN-F-04: Increase PM<sub>10</sub> short term limit to 0.6 lb/hr;
  - SN-F-04: Increase PM<sub>10</sub> annual limit to 2.4 tpy;
  - SN-CT-01: Decrease PM<sub>10</sub> annual limit to 22.7 tpy; and
  - SN-TK-01: Decrease 1,3-Butadiene short term limit to 0.01 lb/hr.
- The calculations for SN-CT-01 were corrected;
- The emission calculations for the active coal piles was revised;
- The case-by-case MACT requirements for SN-01 and SN-02 were updated and clarified;
- The emission estimates for the dust collectors and fans represented by EP-10 through EP-25 were revised by adjusting the exhaust flow rates for several of the sources;
- The BACT limit specified in Specific Condition 5 has a CO limit based on a 30-day rolling average. However, Specific Condition 1 does not contain a clarification that the 900 lb/hr limit is a 30-day rolling average. The 30-day rolling average was added as a footnote to Specific Condition 1 as originally intended;
- Two (2) 10,000 gallon sulfuric acid tanks were added;
- A 10,000 gallon sodium hypochlorite tank was added;
- A 5,000 gallon sodium hypochlorite tank was added;
- A 1,500 gallon sodium bromide tank was added;
- A 11,000 gallon coagulant tank was added;
- A 1,500 gallon corrosion inhibitor/phosphoric acid tank was added,

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

- A 30,000 gallon anhydrous ammonia tank was added;
- Water washing activities of empty 55 gallon drums were added; and
- 15 containers of 5 gallons or less that do not emit any detectable VOCs or HAPs when closed were added.

The permitted emission increases include 8.5 tpy of PM and 11.5 tpy of PM<sub>10</sub>.

Permit 2123-AOP-R4 was issued on June 15, 2015. As part of this administrative amendment, Specific Condition 56 was updated consistent with the response to comments with the issuance of Permit 2123-AOP-R3. Specific Condition 56 now reads as:

The permittee shall install, calibrate, maintain, and operate continuous emission monitoring systems (CEMS) for SN-01 and record the output of the system to measure Mercury (Hg). The CEMS shall comply with the Department's "Continuous Emissions Monitoring Systems Conditions." The CEMS data may be used by the Department for enforcement purposes. Once the facility begins complying with MATS, this condition will no longer be applicable.

There were no permitted emission changes with this permitting action.

Permit 2123-AOP-R5 was issued on February 23, 2016. As part of this minor modification, the facility:

1. Added an emergency diesel engine (SN-05) rated at 130 BHP; and
2. Added a new 550 gallon diesel fuel storage tank to the Insignificant Activities.

The permitted emission increases included 0.1 tpy of PM/PM<sub>10</sub>, 0.1 tpy of SO<sub>2</sub>, 0.1 tpy of VOC, 0.5 tpy of CO, 0.4 tpy of NO<sub>x</sub>, 0.01 tpy of Acetaldehyde, 0.01 tpy of Acrolein, 0.01 tpy of Benzene, 0.01 tpy of 1,3-Butadiene, 0.01 tpy of Formaldehyde, 0.01 tpy of POM, 0.01 tpy of Toluene, and 0.01 tpy of Xylene.

The Clean Air Interstate Rule (CAIR) was vacated. Therefore, the CAIR requirements were removed. The facility is subject to the Cross-State Air Pollution Rule (CSAPR). The NO<sub>x</sub> trading program requirements were added to the Plantwide Conditions. The CSAPR form was added to the appendices.

Permit 2123-AOP-R6 was issued on March 15, 2017. As part of this minor modification, the facility replaced the existing 130 BHP emergency diesel engine (SN-05) with a new 300 BHP emergency diesel engine. The permitted emission decreases included 0.3 tpy of CO, and 0.2 tpy of NO<sub>x</sub>.

Permit 2123-AOP-R7 was issued on August 4, 2017. As part of this modification, the facility requested to clarify permit language concerning Lead, VOC, Mercury, HAP, and air contaminant emissions for SN-01 and SN-02. The remaining case-by-case MACT limits were also removed. The PM emission limit for SN-01 was lowered to the appropriate BACT level that was

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

established with the initial permit. The permitted emission increases include 0.5 tpy of PM<sub>10</sub>, 74.11 tpy of VOC, 36.6 tpy of CO. The permitted emission decreases include 341.05 tpy of PM. The increase in VOC emissions is based on the relaxation of the case-by-case MACT limit due to MATS. The new VOC limit is based on the existing BACT limit for SN-01 and SN-02. There were no physical changes or change in the method of operation at the facility. Therefore, this modification is not a PSD major modification.

Permit 2123-AOP-R8 was issued July 12, 2019. This permit incorporated a minor modification. The total dissolved solids limit for the cooling tower (SN-CT-01) was revised from 750 ppm to 7,500 ppm. Permitted emission limits were not revised.

**SECTION IV: SPECIFIC CONDITIONS**

SN-01  
 Main Boiler

Source Description

An ultra-supercritical pulverized coal (PC) boiler (600 MW) produces steam at temperatures above 1100 °F to drive a condensing steam turbine to generate electricity. The PC boiler burns sub-bituminous coal as the main fuel and uses natural gas for startup and flame stabilization.

Specific Conditions

1. The permittee shall not exceed the emission rates set forth in the following tables.
  - a. The permittee shall demonstrate compliance with the SO<sub>2</sub>, CO, and NO<sub>x</sub> limits through use of Continuous Emission Monitors (CEM) required in Specific Conditions 11 and 54. Compliance with the PM<sub>10</sub>, VOC, and Pb limits shall be demonstrated through compliance with the testing requirements of Specific Condition 7. [Reg.19.304 , Reg.19.501, Reg.19.901, and 40 C.F.R. § 52 Subpart E]

| Pollutant              | lb/hr              | tpy     |
|------------------------|--------------------|---------|
| PM <sub>10</sub>       | 150.0              | 657.0   |
| SO <sub>2</sub>        | 480.0              | 2,102.4 |
| VOC                    | 21.6               | 94.61   |
| CO                     | 900.0 <sup>a</sup> | 3,942.0 |
| NO <sub>x</sub>        | 420.0              | 1,314.0 |
| Pb (Lead) <sup>b</sup> | 0.16               | 0.68    |

a. 30-day rolling average

b. Emission rate also included in PM<sub>10</sub> emission rate

- b. Compliance with the PM and Sulfuric Acid (H<sub>2</sub>SO<sub>4</sub>) limits shall be demonstrated through compliance with the testing requirements of Specific Condition 7. [Reg.18.801, Reg.19.304 , Reg.19.501, Reg.19.901, 40 C.F.R. § 52 Subpart E, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant | lb/hr | tpy   |
|-----------|-------|-------|
| PM        | 72.0  | 315.4 |

| Pollutant                                       | lb/hr | tpy    |
|-------------------------------------------------|-------|--------|
| Sulfuric Acid (H <sub>2</sub> SO <sub>4</sub> ) | 25.20 | 110.38 |

2. The permittee shall not exceed the emission rates set forth in the following tables.
- a. The permittee shall demonstrate compliance with the emission rates for Hydrogen Chloride and Mercury through one of the methods set forth in Tables 5 and 7 of 40 C.F.R. Part 63, Subpart UUUUU as found in Specific Conditions 130 and 181, respectively. [Reg.18.801, Reg. 19.304, 40 C.F.R. § 63 Subpart UUUUU, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant         | lb/hr <sup>a</sup> | tpy      |
|-------------------|--------------------|----------|
| Hydrogen Chloride | 12.00              | 52.56    |
| Mercury           | 7.20E-03           | 3.16E-02 |

a. lb/hr rates are based on a 30-day rolling average

- b. Hydrogen Fluoride emission rates shall be demonstrated through compliance with Specific Condition 8. The permittee shall demonstrate compliance with the emission rates for all non-mercury metal compounds through emission testing for PM<sub>10</sub> conducted in compliance with Specific Condition 7. Compliance with the emission rates for compounds included in the VOC total shall be demonstrated through compliance with the work practice standards in Table 3 of 40 C.F.R. Part 63, Subpart UUUUU as found in Specific Condition 73. [Reg.18.801, Reg. 19.304, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant                     | lb/hr | Tpy   |
|-------------------------------|-------|-------|
| Hydrogen Fluoride             | 1.20  | 5.26  |
| Total Other HAPs*             | 7.97  | 34.89 |
| Total Other Chargeable HAPs   | 0.13  | 0.55  |
| Total Other Air Contaminants* | 0.16  | 0.68  |

\* Included in either the VOC total or PM total

3. The permittee shall not exceed the emission rates set forth in the following table. Compliance with the emission rates shall be demonstrated through compliance with Specific Condition 9. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]



| Pollutant | lb/hr | tpy    |
|-----------|-------|--------|
| Ammonia   | 37.50 | 164.40 |

4. The permittee shall not discharge into the atmosphere from SN-01 gases which exhibit an opacity greater than 10% (6-minute average) except for one 6-minute period per hour (during any 60 minute consecutive period) of not more than 27% as measured using EPA Reference Method 9. Compliance with this condition shall be demonstrated by comparison of the limit to the 6-minute average opacity reading obtained from the COMS installed in accordance with Specific Condition 11. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]
  
5. The permittee shall not exceed the BACT emission limits set forth in the following table. Compliance with SO<sub>2</sub>, CO and NO<sub>x</sub> emission rates shall be demonstrated by use of CEMs required in Specific Conditions 11 and 54. Compliance with other limits shall be demonstrated by the testing requirements of Specific Condition 7. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]

| <i>Pollutant</i>                     | <i>BACT Limit</i>                                 | <i>Averaging period</i>  |
|--------------------------------------|---------------------------------------------------|--------------------------|
| PM/ PM <sub>10</sub><br>(filterable) | 0.012 lb/MMBtu                                    | 3-hour                   |
| PM <sub>10</sub><br>(total)          | 0.025 lb/MMBtu                                    | 3-hour                   |
| SO <sub>2</sub>                      | 0.065 lb/MMBtu                                    | 30-day rolling average   |
|                                      | 480 lb/hr                                         | 24 hour rolling average  |
| VOC                                  | 0.0036 lb/MMBtu                                   | 3-hour                   |
| CO                                   | 0.15 lb/MMBtu                                     | 30-day rolling           |
| NO <sub>x</sub>                      | 0.067 lb/MMBtu for normal operations <sup>1</sup> | 24-hour rolling average  |
|                                      | 420 lb/hr                                         | 24-hour rolling average  |
|                                      | 0.05 lb/MMBtu                                     | 12-month rolling average |
| Pb (Lead)                            | 2.6E-05 lb/MMBtu                                  | 3-hour                   |
| H <sub>2</sub> SO <sub>4</sub> Mist  | 0.0042 lb/MMBtu                                   | 3-hour                   |

<sup>1</sup>Normal operation is defined as operation at or above 300 MW gross output from the Unit 1 generator.

6. The permittee shall not exceed the emission rates set forth in the following table for SN-01 (Main Boiler). Compliance with the Mercury and Hydrogen Chloride limits shall be demonstrated by Specific Condition 130 as found in 40 C.F.R. Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63 Subpart UUUUU]

| Pollutant         | Emission Limit | Averaging Time         |
|-------------------|----------------|------------------------|
| Mercury           | 1.2 lb/TBtu    | 30-day rolling average |
| Hydrogen Chloride | 0.002 lb/MMBtu | 30-day rolling average |

7. The permittee shall conduct testing at SN-01 to determine the emission rates for PM, PM<sub>10</sub>, VOC, Pb and Sulfuric Acid (H<sub>2</sub>SO<sub>4</sub>). This testing shall be performed in accordance with Plantwide Condition 3. This testing shall be repeated within 12 calendar months of the previous compliance test. Testing shall be performed in accordance with the methods listed in the following table or a Department approved alternative. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]

| Pollutant                                       | EPA Reference Method              |
|-------------------------------------------------|-----------------------------------|
| PM Filterable and PM <sub>10</sub> Filterable   | 5 or 17                           |
| PM Total and PM <sub>10</sub> Total             | 5 and 202 or 17 and 202           |
| VOC                                             | 25 or 25A                         |
| Pb                                              | 12 or 29                          |
| Sulfuric Acid (H <sub>2</sub> SO <sub>4</sub> ) | 8 or Controlled Condensate Method |

8. The permittee shall conduct testing at SN-01 to determine the emission rates for Hydrogen Fluoride. This testing shall be performed in accordance with Plantwide Condition 3. This testing shall be repeated within 12 calendar months of the previous compliance test. Testing shall be performed in accordance with the methods listed in the following table or a Department approved alternative. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]

| Pollutant         | EPA Reference Method |
|-------------------|----------------------|
| Hydrogen Fluoride | 26 or 26A            |

9. The permittee shall conduct testing at SN-01 to determine compliance with the emission rate for Ammonia. This testing shall be performed in accordance with Plantwide Condition 3. This testing shall be repeated within 12 calendar months of the previous

compliance test. Testing shall be performed in accordance with the methods listed in the following table or a Department approved alternative. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.18.1002 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and §8-4-311]

| Pollutant | EPA Reference Method |
|-----------|----------------------|
| Ammonia   | CTM-027              |

10. The permittee shall conduct an initial test at SN-01 to determine compliance with the emission rates for all other pollutants listed in Specific Condition 2 not otherwise requiring a CEM or specific testing (i.e. all pollutants except PM, Ammonia, Hydrogen Chloride, Hydrogen Fluoride and Mercury). This testing shall be performed in accordance with Plantwide Condition 3. Testing shall be performed in accordance with testing protocols submitted by the applicant and approved by the Department in advance. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.18.801; Reg19.304; 40 C.F.R. § 63, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and §8-4-311]
11. This source is considered an affected source under 40 CFR Part 60, Subpart Da, *Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced after September 18, 1978*, and is subject, but not limited to, Specific Conditions 12 through 54. [Reg.19.304 and 40 C.F.R. § 60 Subpart Da]
12. Except as provided in paragraphs (b)(1) and (b)(2) of §60.42Da, on and after the date the initial PM performance test is completed or required to be completed under §60.8, whichever date comes first, an owner or operator of an affected facility shall not cause to be discharged into the atmosphere any gases which exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity. [40 C.F.R § 60.42Da(b)]
13. Except as provided in paragraphs (d) and (f) of §60.42Da, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005, but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of either:
  - a. 18 ng/J (0.14 lb/MWh) gross energy output; or
  - b. 6.4 ng/J (0.015 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel.

[40 C.F.R § 60.42Da(c)]

14. As an alternative to meeting the requirements of paragraph (c) of §60.42Da, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, but before May 4, 2011, may elect to meet the requirements of this paragraph. On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of:
- a. 13 ng/J (0.030 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel, and
  - b. For an affected facility that commenced construction or reconstruction, 0.1 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.9 percent reduction) when combusting solid, liquid, or gaseous fuel, or
  - c. For an affected facility that commenced modification, 0.2 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.8 percent reduction) when combusting solid, liquid, or gaseous fuel.

[40 C.F.R § 60.42Da(d)]

15. Compliance with the emission limitation and percent reduction requirements under §60.43Da are both determined on a 30-day rolling average basis except as provided under paragraph (c) of §60.43Da. [40 C.F.R § 60.43Da(g)]
16. Except as provided in paragraphs (j) and (k) of §60.43Da, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility, any gases that contain SO<sub>2</sub> in excess of the applicable emissions limit specified in paragraphs (i)(1) through (3) of §60.43Da.
- a. For an affected facility which commenced construction, any gases that contain SO<sub>2</sub> in excess of either:
    - i. 180 ng/J (1.4 lb/MWh) gross energy output; or
    - ii. 5 percent of the potential combustion concentration (95 percent reduction).

[40 C.F.R § 60.43Da(i)]

17. Except as provided in paragraphs (f) and (h) of §60.44Da, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005 but before May 4,

- 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the applicable emissions limit specified in paragraphs (e)(1) through (3) of §60.44Da as determined on a 30-boiler operating day rolling average basis. [40 C.F.R § 60.44Da(e)]
18. For an affected facility which commenced construction, any gases that contain NO<sub>x</sub> in excess of 130 ng/J (1.0 lb/MWh) gross energy output. [40 C.F.R § 60.44Da(e)(i)]
  19. For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, the applicable PM emissions limit and opacity standard under §60.42Da, SO<sub>2</sub> emissions limit under §60.43Da, and NO<sub>x</sub> emissions limit under §60.44Da apply at all times except during periods of startup, shutdown, or malfunction. [40 C.F.R § 60.48Da(a)]
  20. After the initial performance test required under §60.8, compliance with the applicable SO<sub>2</sub> emissions limit and percentage reduction requirements under §60.43Da, NO<sub>x</sub> emissions limit under §60.44Da, and NO<sub>x</sub> plus CO emissions limit under §60.45Da is based on the average emission rate for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day after the initial performance test, and a new 30-boiler operating day rolling average emission rate for both SO<sub>2</sub>, NO<sub>x</sub> or NO<sub>x</sub> plus CO as applicable, and a new percent reduction for SO<sub>2</sub> are calculated to demonstrate compliance with the standards. [40 C.F.R § 60.48Da(b)]
  21. For the initial performance test required under §60.8, compliance with the applicable SO<sub>2</sub> emissions limits and percentage reduction requirements under §60.43Da, the NO<sub>x</sub> emissions limits under §60.44Da, and the NO<sub>x</sub> plus CO emissions limits under §60.45Da is based on the average emission rates for SO<sub>2</sub>, NO<sub>x</sub>, CO, and percent reduction for SO<sub>2</sub> for the first 30 successive boiler operating days. The initial performance test is the only test in which at least 30 days prior notice is required unless otherwise specified by the Administrator. The initial performance test is to be scheduled so that the first boiler operating day of the 30 successive boiler operating days is completed within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of the facility. [40 C.F.R § 60.48Da(c)]
  22. For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, compliance with applicable 30-boiler operating day rolling average SO<sub>2</sub> and NO<sub>x</sub> emissions limits is determined by calculating the arithmetic average of all hourly emission rates for SO<sub>2</sub> and NO<sub>x</sub> for the 30 successive boiler operating days, except for data obtained during startup, shutdown, or malfunction. [40 C.F.R § 60.48Da(d)]
  23. If an owner or operator has not obtained the minimum quantity of emission data as required under §60.49Da, compliance of the affected facility with the emission requirements under §60.43Da and §60.44Da of 40 CFR Part 60, Subpart Da for the day on which the 30-day period ends may be determined by the Administrator by following

the applicable procedures in section 7 of Method 19 of appendix A of 40 CFR Part 60. [40 C.F.R § 60.48Da(h)]

24. The owner or operator shall calculate  $\text{NO}_x$  emissions as  $1.194 \times 10^{-7}$  lb/scf-ppm times the average hourly  $\text{NO}_x$  output concentration in ppm (measured according to the provisions of §60.49Da(c)), times the average hourly flow rate (measured in scfh, according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. Alternatively, for oil-fired and gas-fired units,  $\text{NO}_x$  emissions may be calculated by multiplying the hourly  $\text{NO}_x$  emission rate in lb/MMBtu (measured by the CEMS required under §60.49Da(c) and (d)), by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. [40 C.F.R § 60.48Da(i)]
25. The owner or operator shall calculate  $\text{SO}_2$  emissions as  $1.660 \times 10^{-7}$  lb/scf-ppm times the average hourly  $\text{SO}_2$  output concentration in ppm (measured according to the provisions of §60.49Da(b)), times the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. Alternatively, for oil-fired and gas-fired units,  $\text{SO}_2$  emissions may be calculated by multiplying the hourly  $\text{SO}_2$  emission rate (in lb/MMBtu), measured by the CEMS required under §60.49Da, by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. [40 C.F.R § 60.48Da(m)]
26. Except as provided for in paragraph (p) of §60.48Da, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, shall demonstrate compliance with each applicable emission limit according to the requirements in paragraphs (o)(1) through (o)(5) of §60.48Da.
  - a. You must conduct a performance test to demonstrate initial compliance with the applicable PM emissions limit in §60.42Da(c)(2) or (d) by the applicable date specified in §60.8(a). Thereafter, you must conduct each subsequent performance test within 12 calendar months following the date the previous performance test was required to be conducted. You must conduct each performance test according to the requirements in §60.8 using the test methods and procedures in §60.50Da. The owner or operator of an affected facility that has not operated for 60 consecutive calendar days prior to the date that the subsequent performance test would have been required had the unit been operating is not required to perform the subsequent performance test until 30 calendar days after the next boiler operating day. Requests for additional 30 day extensions shall be granted by the

relevant air division or office director of the appropriate Regional Office of the U.S. EPA.

- b. As an alternative to complying with the requirements of paragraph (o)(2) of §60.48Da, an owner or operator may elect to monitor the performance of a fabric filter (baghouse) operated to comply with the applicable PM emissions limit in §60.42Da(c)(2) or (d) by using a bag leak detection system according to the requirements in paragraphs (o)(4)(i) through (v) of §60.48Da.
  - i. Each bag leak detection system must meet the specifications and requirements in paragraphs (o)(4)(i)(A) through (H) of §60.48Da.
    1. The bag leak detection system must be certified by the manufacturer to be capable of detecting PM emissions at concentrations of 1 milligram per actual cubic meter (0.00044 grains per actual cubic foot) or less.
    2. The bag leak detection system sensor must provide output of relative PM loadings. The owner or operator must continuously record the output from the bag leak detection system using electronic or other means ( e.g. , using a strip chart recorder or a data logger.)
    3. The bag leak detection system must be equipped with an alarm system that will react when the system detects an increase in relative particulate loading over the alarm set point established according to paragraph (o)(4)(i)(D) of §60.48Da, and the alarm must be located such that it can be noticed by the appropriate plant personnel.
    4. In the initial adjustment of the bag leak detection system, you must establish, at a minimum, the baseline output by adjusting the sensitivity (range) and the averaging period of the device, the alarm set points, and the alarm delay time.
    5. Following initial adjustment, you must not adjust the averaging period, alarm set point, or alarm delay time without approval from the permitting authority except as provided in paragraph (d)(1)(vi) of §60.48Da.
    6. Once per quarter, you may adjust the sensitivity of the bag leak detection system to account for seasonal effects, including temperature and humidity, according to the procedures identified in the site-specific monitoring plan required by paragraph (o)(4)(ii) of §60.48Da.
    7. You must install the bag leak detection sensor downstream of the fabric filter and upstream of any wet scrubber.
    8. Where multiple detectors are required, the system's instrumentation and alarm may be shared among detectors.

- ii. You must develop and submit to the permitting authority for approval a site-specific monitoring plan for each bag leak detection system. You must operate and maintain the bag leak detection system according to the site-specific monitoring plan at all times. Each monitoring plan must describe the items in paragraphs (o)(4)(ii)(A) through (F) of §60.48Da.
  1. Instillation of the bag leak detection system;
  2. Initial and periodic adjustment of the bag leak detection system, including how the alarm set-point will be established;
  3. Operation of the bag leak detection system, including quality assurance procedures;
  4. How the bag leak detection system will be maintained, including a routine maintenance schedule and spare parts inventory list;
  5. How the bag leak detection system output will be recorded and stored; and
  6. Corrective action procedures as specified in paragraph (o)(4)(iii) of §60.48Da. In approving the site-specific monitoring plan, the permitting authority may allow owners and operators more than 3 hours to alleviate a specific condition that causes an alarm if the owner or operator identifies in the monitoring plan this specific condition as one that could lead to an alarm, adequately explains why it is not feasible to alleviate this condition within 3 hours of the time the alarm occurs, and demonstrates that the requested time will ensure alleviation of this condition as expeditiously as practicable.
- iii. For each bag leak detection system, you must initiate procedures to determine the cause of every alarm within 1 hour of the alarm. Except as provided in paragraph (o)(4)(ii)(F) of §60.48Da, you must alleviate the cause of the alarm within 3 hours of the alarm by taking whatever corrective action(s) are necessary. Corrective actions may include, but are not limited to the following:
  1. Inspecting the fabric filter for air leaks, torn or broken bags or filter media, or any other condition that may cause an increase in particulate emissions;
  2. Sealing off defective bags or filter media;
  3. Replacing defective bags or filter media or otherwise repairing the control device;
  4. Sealing off a defective fabric filter compartment;
  5. Cleaning the bag leak detection system probe or otherwise repairing the bag leak detection system; or
  6. Shutting down the process producing the particulate emissions.



- iv. You must maintain records of the information specified in paragraphs (o)(4)(iv)(A) through (C) of §60.48Da for each bag leak detection system.
  - 1. Records of the bag leak detection system output;
  - 2. Records of bag leak detection system adjustments, including the date and time of the adjustment, the initial bag leak detection system settings, and the final bag leak detection system settings; and
  - 3. The date and time of all bag leak detection system alarms, the time that procedures to determine the cause of the alarm were initiated, if procedures were initiated within 1 hour of the alarm, the cause of the alarm, an explanation of the actions taken, the date and time the cause of the alarm was alleviated, and if the alarm was alleviated within 3 hours of the alarm.
  
- v. If after any period composed of 30 boiler operating days during which the alarm rate exceeds 5 percent of the process operating time (excluding control device or process startup, shutdown, and malfunction), then you must conduct a new PM performance test according to paragraph (o)(1) of §60.48Da. This new performance test must be conducted within 60 calendar days of the date that the alarm rate was first determined to exceed 5 percent limit unless a waiver is granted by the permitting authority.

[40 C.F.R § 60.48Da(o)]

27. Affirmative defense for exceedance of emissions limit during malfunction. In response to an action to enforce the standards set forth in paragraph §§60.42Da, 60.43Da, 60.44Da, and 60.45Da, you may assert an affirmative defense to a claim for civil penalties for exceedances of such standards that are caused by malfunction, as defined at 40 CFR 60.2. Appropriate penalties may be assessed, however, if you fail to meet your burden of proving all of the requirements in the affirmative defense as specified in paragraphs (s)(1) and (2) of §60.48Da. The affirmative defense shall not be available for claims for injunctive relief.
- a. To establish the affirmative defense in any action to enforce such a limit, you must timely meet the notification requirements in paragraph (s)(2) of §60.48Da, and must prove by a preponderance of evidence that:
    - i. The excess emissions:
      - 1. Were caused by a sudden, infrequent, and unavoidable failure of air pollution control and monitoring equipment, process equipment, or a process to operate in a normal or usual manner; and

2. Could not have been prevented through careful planning, proper design, or better operation and maintenance practices; and
  3. Did not stem from any activity or event that could have been foreseen and avoided, or planned for; and
  4. Were not part of a recurring pattern indicative of inadequate design, operation, or maintenance; and
- ii. Repairs were made as expeditiously as possible when the applicable emissions limits were being exceeded. Off-shift and overtime labor were used, to the extent practicable to make these repairs; and
  - iii. The frequency, amount, and duration of the excess emissions (including any bypass) were minimized to the maximum extent practicable during periods of such emissions; and
  - iv. If the excess emissions resulted from a bypass of control equipment or a process, then the bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; and
  - v. All possible steps were taken to minimize the impact of the excess emissions on ambient air quality, the environment, and human health; and
  - vi. All emissions monitoring and control systems were kept in operation if at all possible, consistent with safety and good air pollution control practices; and
  - vii. All of the actions in response to the excess emissions were documented by properly signed, contemporaneous operating logs; and
  - viii. At all times, the facility was operated in a manner consistent with good practices for minimizing emissions; and
  - ix. A written root cause analysis has been prepared, the purpose of which is to determine, correct, and eliminate the primary causes of the malfunction and the excess emissions resulting from the malfunction event at issue. The analysis shall also specify, using best monitoring methods and engineering judgment, the amount of excess emissions that were the result of the malfunction.
- b. The owner or operator of the affected source experiencing an exceedance of its emission limit(s) during a malfunction shall notify the Administrator by telephone or facsimile (FAX) transmission as soon as possible, but no later than two business days after the initial occurrence of the malfunction or, if it is not possible to determine within two business days whether the malfunction caused or contributed to an exceedance, no later than two business days after the owner or operator knew or should have known that the malfunction caused or contributed to an exceedance, but, in no event later than two business days after the end of the averaging period, if it wishes to avail itself of an affirmative defense to civil penalties for that malfunction. The owner or operator seeking to assert an affirmative defense shall also submit a written report to the Administrator within 45 days of the initial occurrence of the exceedance of the standard in §63.9991 to demonstrate, with all necessary supporting documentation, that it has met the

requirements set forth in paragraph (s)(1) of §60.48Da. The owner or operator may seek an extension of this deadline for up to 30 additional days by submitting a written request to the Administrator before the expiration of the 45 day period. Until a request for an extension has been approved by the Administrator, the owner or operator is subject to the requirement to submit such report within 45 days of the initial occurrence of the exceedance. [40 C.F.R § 60.48Da(s)]

28. An owner or operator of an affected facility subject to the opacity standard in §60.42Da(b) shall monitor the opacity of emissions discharged from the affected facility to the atmosphere according to the applicable requirements in paragraphs (a)(1) through (3) of §60.49Da. [40 C.F.R § 60.49Da(a)]
- a. Except as provided for in paragraphs (a)(2) and (4) of §60.49Da, the owner or operator of an affected facility subject to an opacity standard, shall install, calibrate, maintain, and operate a COMS, and record the output of the system, for measuring the opacity of emissions discharged to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of an FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the SO<sub>2</sub> control system), alternate parameters indicative of the PM control system's performance and/or good combustion are monitored (subject to the approval of the Administrator).
  - b. As an alternative to the monitoring requirements in paragraph (a)(1) of §60.49Da, an owner or operator of an affected facility that meets the conditions in either paragraph (a)(2)(i), (ii), (iii), or (iv) of §60.49Da may elect to monitor opacity as specified in paragraph (a)(3) of §60.49Da.
    - i. The affected facility uses a fabric filter (baghouse) to meet the standards in §60.42Da and a bag leak detection system is installed and operated according to the requirements in paragraphs §60.48Da(o)(4)(i) through (v)
29. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring SO<sub>2</sub> emissions, except where natural gas and/or liquid fuels (excluding residual oil) with potential SO<sub>2</sub> emissions rates of 26 ng/J (0.060 lb/MMBtu) or less are the only fuels combusted, as follows:
- a. For a facility that qualifies under the numerical limit provisions of §60.43Da, SO<sub>2</sub> emissions are only monitored as discharged to the atmosphere.
  - b. If the owner or operator has installed and certified a SO<sub>2</sub> CEMS according to the requirements of §75.20(c)(1) and appendix A to 40 CFR Part 75, and is continuing to meet the ongoing quality assurance requirements of §75.21 and appendix B to 40 CFR Part 75, that CEMS may be used to meet the requirements of §60.49Da, provided that:

- i. A CO<sub>2</sub> or O<sub>2</sub> continuous monitoring system is installed, calibrated, maintained and operated at the same location, according to paragraph (d) of §60.49Da; and
  - ii. The reporting requirements of §60.51Da are met. The SO<sub>2</sub> and, if required, CO<sub>2</sub> (or O<sub>2</sub>) data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of 40 CFR Part 75, nor shall the SO<sub>2</sub> data have been bias adjusted according to the procedures of 40 CFR Part 75. [40 C.F.R § 60.49Da(b)]
30. If the owner or operator has installed a NO<sub>x</sub> emission rate CEMS to meet the requirements of 40 CFR Part 75 and is continuing to meet the ongoing requirements of 40 CFR Part 75, that CEMS may be used to meet the requirements of §60.49Da, except that the owner or operator shall also meet the requirements of §60.51Da. Data reported to meet the requirements of §60.51Da shall not include data substituted using the missing data procedures in subpart D of 40 CFR Part 75, nor shall the data have been bias adjusted according to the procedures of 40 CFR Part 75. [40 C.F.R § 60.49Da(c)]
31. The CEMS under paragraphs (b), (c), and (d) of §60.49Da are operated and data recorded during all periods of operation of the affected facility including periods of startup, shutdown, and malfunction, except for CEMS breakdowns, repairs, calibration checks, and zero and span adjustments. [40 C.F.R § 60.49Da(e)]
32. For units that began construction, reconstruction, or modification after February 28, 2005, the owner or operator shall obtain emission data for at least 90 percent of all operating hours for each 30 successive boiler operating days. If this minimum data requirement cannot be met with a CEMS, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in paragraph (h) of §60.49Da. [40 C.F.R § 60.49Da(f)(2)]
33. The 1-hour averages required under paragraph §60.13(h) are expressed in ng/J (lb/MMBtu) heat input and used to calculate the average emission rates under §60.48Da. The 1-hour averages are calculated using the data points required under §60.13(h)(2). [40 C.F.R § 60.49Da(g)]
34. When it becomes necessary to supplement CEMS data to meet the minimum data requirements in paragraph (f) of §60.49Da, the owner or operator shall use the reference methods and procedures as specified in this paragraph. Acceptable alternative methods and procedures are given in paragraph (j) of §60.49Da.
  - a. Method 6 of appendix A of 40 CFR Part 60 shall be used to determine the SO<sub>2</sub> concentration at the same location as the SO<sub>2</sub> monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall

- be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.
- b. Method 7 of appendix A of 40 CFR Part 60 shall be used to determine the NO<sub>x</sub> concentration at the same location as the NO<sub>x</sub> monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.
  - c. The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B of appendix A of 40 CFR Part 60 shall be used to determine the O<sub>2</sub> or CO<sub>2</sub> concentration at the same location as the O<sub>2</sub> or CO<sub>2</sub> monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.
  - d. The procedures in Method 19 of appendix A of 40 CFR Part 60 shall be used to compute each 1-hour average concentration in ng/J (lb/MMBtu) heat input. [40 C.F.R § 60.49Da(h)]
35. The owner or operator shall use methods and procedures in this paragraph to conduct monitoring system performance evaluations under §60.13(c) and calibration checks under §60.13(d). Acceptable alternative methods and procedures are given in paragraph (j) of §60.49Da.
- a. Methods 3B, 6, and 7 of appendix A of 40 CFR Part 60 shall be used to determine O<sub>2</sub>, SO<sub>2</sub>, and NO<sub>x</sub> concentrations, respectively.
  - b. SO<sub>2</sub> or NO<sub>x</sub> (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N<sub>2</sub>, as applicable) under Performance Specification 2 of appendix B of 40 CFR Part 60.
  - c. For affected facilities burning only fossil fuel, the span value for a COMS is between 60 and 80 percent. Span values for a CEMS measuring NO<sub>x</sub> shall be determined using one of the following procedures:
    - i. Except as provided under paragraph (i)(3)(ii) of §60.49Da, NO<sub>x</sub> span values shall be determined as follows:

| Fossil fuel | Span values for NO <sub>x</sub><br>(ppm) |
|-------------|------------------------------------------|
| Gas         | 500.                                     |
| Liquid      | 500.                                     |
| Solid       | 1,000.                                   |
| Combination | 500 (x + y) + 1,000z.                    |

Where:

- x = Fraction of total heat input derived from gaseous fossil fuel,  
 y = Fraction of total heat input derived from liquid fossil fuel, and  
 z = Fraction of total heat input derived from solid fossil fuel.

- ii. As an alternative to meeting the requirements of paragraph (i)(3)(i) of §60.49Da, the owner or operator of an affected facility may elect to use the NO<sub>x</sub> span values determined according to section 2.1.2 in appendix A to 40 CFR Part 75.
    - d. All span values computed under paragraph (i)(3)(i) of §60.49Da for burning combinations of fossil fuels are rounded to the nearest 500 ppm. Span values computed under paragraph (i)(3)(ii) of §60.49Da shall be rounded off according to section 2.1.2 in appendix A to 40 CFR Part 75.
    - e. For affected facilities burning fossil fuel, alone or in combination with non-fossil fuel and determining span values under paragraph (i)(3)(i) of §60.49Da, the span value of the SO<sub>2</sub> CEMS at the inlet to the SO<sub>2</sub> control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the SO<sub>2</sub> control device is 50 percent of maximum estimated hourly potential emissions of the fuel fired. For affected facilities determining span values under paragraph (i)(3)(ii) of §60.49Da, SO<sub>2</sub> span values shall be determined according to section 2.1.1 in appendix A to 40 CFR Part 75. [40 C.F.R § 60.49Da(i)]
36. The owner or operator may use the following as alternatives to the reference methods and procedures specified in §60.49Da:
- a. For Method 6 of appendix A of 40 CFR Part 60, Method 6A or 6B (whenever Methods 6 and 3 or 3B of appendix A of 40 CFR Part 60 data are used) or 6C of appendix A of 40 CFR Part 60 may be used. Each Method 6B of appendix A of 40 CFR Part 60 sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B of appendix A of 40 CFR Part 60 is used under paragraph (i) of §60.49Da, the conditions under §60.48Da(d)(1) apply; these conditions do not apply under paragraph (h) of §60.49Da. [40 C.F.R § 60.49Da(j)]
37. The procedures specified in paragraphs (k)(1) through (3) of §60.49Da shall be used to determine gross energy output for sources demonstrating compliance with an output-based standard.
- a. The owner or operator of an affected facility with electricity generation shall install, calibrate, maintain, and operate a wattmeter; measure gross electrical output in MWh on a continuous basis; and record the output of the monitor.
  - b. The owner or operator of an affected facility with process steam generation shall install, calibrate, maintain, and operate meters for steam flow, temperature, and pressure; measure gross process steam output in joules per hour (or Btu per hour) on a continuous basis; and record the output of the monitor.
  - c. For an affected facility generating process steam in combination with electrical generation, the gross energy output is determined according to the definition of “gross energy output” specified in §60.41Da that is applicable to the affected facility. [40 C.F.R § 60.49Da(k)]

38. The owner or operator of an affected facility demonstrating compliance with an output-based standard shall install, certify, operate, and maintain a continuous flow monitoring system meeting the requirements of Performance Specification 6 of appendix B of 40 CFR Part 60 and the calibration drift (CD) assessment, relative accuracy test audit (RATA), and reporting provisions of procedure 1 of appendix F of 40 CFR Part 60, and record the output of the system, for measuring the volumetric flow rate of exhaust gases discharged to the atmosphere; or [40 C.F.R § 60.49Da(l)]
39. Alternatively, data from a continuous flow monitoring system certified according to the requirements of §75.20(c) and appendix A to 40 CFR Part 75, and continuing to meet the applicable quality control and quality assurance requirements of §75.21 and appendix B to 40 CFR Part 75, may be used. Flow rate data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of 40 CFR Part 75, nor shall the data have been bias adjusted according to the procedures of 40 CFR Part 75. [40 C.F.R § 60.49Da(m)]
40. The owner or operator shall prepare and submit to the Administrator for approval a unit-specific monitoring plan for each monitoring system, at least 45 days before commencing certification testing of the monitoring systems. The owner or operator shall comply with the requirements in your plan. The plan must address the requirements in paragraphs (s)(1) through (6) of §60.49Da.
  - a. Installation of the CEMS sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of the exhaust emissions ( e.g. , on or downstream of the last control device);
  - b. Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems;
  - c. Performance evaluation procedures and acceptance criteria ( e.g., calibrations, relative accuracy test audits (RATA), etc.);
  - d. Ongoing operation and maintenance procedures in accordance with the general requirements of §60.13(d) or 40 CFR Part 75 (as applicable);
  - e. Ongoing data quality assurance procedures in accordance with the general requirements of §60.13 or 40 CFR Part 75 (as applicable); and
  - f. Ongoing recordkeeping and reporting procedures in accordance with the requirements of 40 CFR Part 60, Subpart Da. [40 C.F.R § 60.49Da(s)]
41. The owner or operator using a SO<sub>2</sub>, NO<sub>x</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS to meet the requirements of 40 CFR Part 60, Subpart Da shall install, certify, operate, and maintain the CEMS as specified in paragraphs (w)(1) through (w)(5) of §60.49Da.
  - a. Except as provided for under paragraphs (w)(2), (w)(3), and (w)(4) of §60.49Da, each SO<sub>2</sub>, NO<sub>x</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS required under paragraphs (b) through (d) of

§60.49Da shall be installed, certified, and operated in accordance with the applicable procedures in Performance Specification 2 or 3 in appendix B to 40 CFR Part 60 or according to the procedures in appendices A and B to 40 CFR Part 75. Daily calibration drift assessments and quarterly accuracy determinations shall be done in accordance with Procedure 1 in appendix F to 40 CFR Part 60, and a data assessment report (DAR), prepared according to section 7 of Procedure 1 in appendix F to 40 CFR Part 60, shall be submitted with each compliance report required under §60.51Da.

- b. As an alternative to meeting the requirements of paragraph (w)(1) of §60.49Da, an owner or operator may elect to implement the following alternative data accuracy assessment procedures. For all required CO<sub>2</sub> and O<sub>2</sub> CEMS and for SO<sub>2</sub> and NO<sub>x</sub> CEMS with span values greater than or equal to 100 ppm, the daily calibration error test and calibration adjustment procedures described in sections 2.1.1 and 2.1.3 of appendix B to part 75 of 40 CFR Part 75 may be followed instead of the CD assessment procedures in Procedure 1, section 4.1 of appendix F of 40 CFR Part 60. If this option is selected, the data validation and out-of-control provisions in sections 2.1.4 and 2.1.5 of appendix B to part 75 of 40 CFR Part 75 shall be followed instead of the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to 40 CFR Part 60. For the purposes of data validation under 40 CFR Part 60, Subpart Da, the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to 40 CFR Part 60 shall apply to SO<sub>2</sub> and NO<sub>x</sub> span values less than 100 ppm;
- c. As an alternative to meeting the requirements of paragraph (w)(1) of §60.49Da, an owner or operator may elect to may elect to implement the following alternative data accuracy assessment procedures. For all required CO<sub>2</sub> and O<sub>2</sub> CEMS and for SO<sub>2</sub> and NO<sub>x</sub> CEMS with span values greater than 30 ppm, quarterly linearity checks may be performed in accordance with section 2.2.1 of appendix B to 40 CFR Part 75, instead of performing the cylinder gas audits (CGAs) described in Procedure 1, section 5.1.2 of appendix F to 40 CFR Part 60. If this option is selected: The frequency of the linearity checks shall be as specified in section 2.2.1 of appendix B to 40 CFR Part 75; the applicable linearity specifications in section 3.2 of appendix A to 40 CFR Part 75 shall be met; the data validation and out-of-control criteria in section 2.2.3 of appendix B to 40 CFR Part 75 shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to 40 CFR Part 60; and the grace period provisions in section 2.2.4 of appendix B to 40 CFR Part 75 shall apply. For the purposes of data validation under 40 CFR Part 60, Subpart Da, the cylinder gas audits described in Procedure 1, section 5.1.2 of appendix F to 40 CFR Part 60 shall be performed for SO<sub>2</sub> and NO<sub>x</sub> span values less than or equal to 30 ppm;
- d. As an alternative to meeting the requirements of paragraph (w)(1) of §60.49Da, an owner or operator may elect to may elect to implement the following alternative data accuracy assessment procedures. For SO<sub>2</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS and for NO<sub>x</sub> CEMS, RATAs may be performed in accordance with section 2.3 of appendix B to 40 CFR Part 75 instead of following the procedures described in



Procedure 1, section 5.1.1 of appendix F to 40 CFR Part 60. If this option is selected: The frequency of each RATA shall be as specified in section 2.3.1 of appendix B to 40 CFR Part 75; the applicable relative accuracy specifications shown in Figure 2 in appendix B to 40 CFR Part 75 shall be met; the data validation and out-of-control criteria in section 2.3.2 of appendix B to 40 CFR Part 75 shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to 40 CFR Part 60; and the grace period provisions in section 2.3.3 of appendix B to 40 CFR Part 75 shall apply. For the purposes of data validation under 40 CFR Part 60, Subpart Da, the relative accuracy specification in section 13.2 of Performance Specification 2 in appendix B to 40 CFR Part 60 shall be met on a lb/MMBtu basis for SO<sub>2</sub> (regardless of the SO<sub>2</sub> emission level during the RATA), and for NO<sub>x</sub> when the average NO<sub>x</sub> emission rate measured by the reference method during the RATA is less than 0.100 lb/MMBtu;

- e. If the owner or operator elects to implement the alternative data assessment procedures described in paragraphs (w)(2) through (w)(4) of §60.49Da, each data assessment report shall include a summary of the results of all of the RATAs, linearity checks, CGAs, and calibration error or drift assessments required by paragraphs (w)(2) through (w)(4) of §60.49Da. [40 C.F.R § 60.49Da(w)]
42. In conducting the performance tests required in §60.8, the owner or operator shall use as reference methods and procedures the methods in appendix A of 40 CFR Part 60 or the methods and procedures as specified in §60.50Da, except as provided in §60.8(b). Section 60.8(f) does not apply to §60.50Da for SO<sub>2</sub> and NO<sub>x</sub>. Acceptable alternative methods are given in paragraph (e) of §60.50Da. [40 C.F.R § 60.50Da(a)]
43. In conducting the performance tests to determine compliance with the PM emissions limits in §60.42Da, the owner or operator shall meet the requirements specified in paragraphs (b)(1) through (3) of §60.50Da.
- a. The owner or operator shall measure filterable PM to determine compliance with the applicable PM emissions limit in §60.42Da as specified in paragraphs (b)(1)(i) through (ii) of §60.50Da.
    - i. The dry basis F factor (O<sub>2</sub>) procedures in Method 19 of appendix A of 40 CFR Part 60 shall be used to compute the emission rate of PM.
    - ii. For the PM concentration, Method 5 of appendix A of 40 CFR Part 60 shall be used for an affected facility that does not use a wet FGD. For an affected facility that uses a wet FGD, Method 5B of appendix A of 40 CFR Part 60 shall be used downstream of the wet FGD.
  - 1. The sampling time and sample volume for each run shall be at least 120 minutes and 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an

average gas temperature of no greater than  $160 \pm 14$  °C ( $320 \pm 25$  °F).

2. For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B of appendix A of 40 CFR Part 60 shall be used to determine the O<sub>2</sub> concentration. The O<sub>2</sub> sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O<sub>2</sub> traverse points may be reduced to 12 provided that Method 1 of appendix A of 40 CFR Part 60 is used to locate the 12 O<sub>2</sub> traverse points. If the grab sampling procedure is used, the O<sub>2</sub> concentration for the run shall be the arithmetic mean of the sample O<sub>2</sub> concentrations at all traverse points.
- b. In conjunction with a performance test performed according to the requirements in paragraph (b)(1) of §60.50Da, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after May 3, 2011, shall measure condensable PM using Method 202 of appendix M of 40 CFR Part 51.
  - c. Method 9 of appendix A of 40 CFR Part 60 and the procedures in §60.11 shall be used to determine opacity. [40 C.F.R § 60.50Da(b)]
44. The owner or operator shall determine compliance with the SO<sub>2</sub> standards in §60.43Da as follows:
- a. The percent of potential SO<sub>2</sub> emissions (%Ps) to the atmosphere shall be computed using the following equation:

$$\%P_e = \frac{(100 - \%R_f)(100 - \%R_g)}{100}$$

Where:

%Ps = Percent of potential SO<sub>2</sub> emissions, percent;

%Rf = Percent reduction from fuel pretreatment, percent; and

%Rg = Percent reduction by SO<sub>2</sub> control system, percent.

- b. The procedures in Method 19 of appendix A of 40 CFR Part 60 may be used to determine percent reduction (%Rf) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and fly ash interactions. This determination is optional.
- c. The procedures in Method 19 of appendix A of 40 CFR Part 60 shall be used to determine the percent SO<sub>2</sub> reduction (%Rg) of any SO<sub>2</sub> control system. Alternatively, a combination of an “as fired” fuel monitor and emission rates

- measured after the control system, following the procedures in Method 19 of appendix A of 40 CFR Part 60, may be used if the percent reduction is calculated using the average emission rate from the SO<sub>2</sub> control device and the average SO<sub>2</sub> input rate from the “as fired” fuel analysis for 30 successive boiler operating days.
- d. The appropriate procedures in Method 19 of appendix A of 40 CFR Part 60 shall be used to determine the emission rate.
  - e. The CEMS in §60.49Da(b) and (d) shall be used to determine the concentrations of SO<sub>2</sub> and CO<sub>2</sub> or O<sub>2</sub>. [40 C.F.R § 60.50Da(c)]
45. The owner or operator shall determine compliance with the NO<sub>x</sub> standard in §60.44Da as follows:
- a. The appropriate procedures in Method 19 of appendix A of 40 CFR Part 60 shall be used to determine the emission rate of NO<sub>x</sub>.
  - b. The continuous monitoring system in §60.49Da(c) and (d) shall be used to determine the concentrations of NO<sub>x</sub> and CO<sub>2</sub> or O<sub>2</sub>. [40 C.F.R § 60.50Da(d)]
46. The owner or operator may use the following as alternatives to the reference methods and procedures specified in §60.50Da:
- a. For Method 5 or 5B of appendix A–3 of 40 CFR Part 60, Method 17 of appendix A–6 of 40 CFR Part 60 may be used at facilities with or without wet FGD systems if the stack temperature at the sampling location does not exceed an average temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A–3 of 40 CFR Part 60 may be used in Method 17 of appendix A–6 of 40 CFR Part 60 only if it is used after wet FGD systems. Method 17 of appendix A–6 of 40 CFR Part 60 shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.
  - b. The Fcfactor (CO<sub>2</sub>) procedures in Method 19 of appendix A of 40 CFR Part 60 may be used to compute the emission rate of PM under the stipulations of §60.46(d)(1). The CO<sub>2</sub> shall be determined in the same manner as the O<sub>2</sub> concentration. [40 C.F.R § 60.50Da(e)]
47. For SO<sub>2</sub>, NO<sub>x</sub>, PM, and NO<sub>x</sub> plus CO emissions, the performance test data from the initial and subsequent performance test and from the performance evaluation of the continuous monitors (including the transmissometer) must be reported to the Administrator. [40 C.F.R § 60.51Da(a)]
48. For SO<sub>2</sub> and NO<sub>x</sub> the following information is reported to the Administrator for each 24-hour period.
- a. Calendar date.
  - b. The average SO<sub>2</sub> and NO<sub>x</sub> emission rates (ng/J, lb/MMBtu, or lb/MWh) for each 30 successive boiler operating days, ending with the last 30-day period in the

- quarter; reasons for non-compliance with the emission standards; and, description of corrective actions taken.
- c. For owners or operators of affected facilities complying with the percent reduction requirement, percent reduction of the potential combustion concentration of SO<sub>2</sub> for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.
  - d. Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 75 percent of the hours of operation of the facility; justification for not obtaining sufficient data; and description of corrective actions taken.
  - e. Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, or malfunction.
  - f. Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.
  - g. Identification of times when hourly averages have been obtained based on manual sampling methods.
  - h. Identification of the times when the pollutant concentration exceeded full span of the CEMS.
  - i. Description of any modifications to CEMS which could affect the ability of the CEMS to comply with Performance Specifications 2 or 3. [40 C.F.R § 60.51Da(b)]
49. If the minimum quantity of emission data as required by §60.49Da is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of §60.48Da(h) is reported to the Administrator for that 30-day period:
- a. The number of hourly averages available for outlet emission rates ( $n_o$ ) and inlet emission rates ( $n_i$ ) as applicable.
  - b. The standard deviation of hourly averages for outlet emission rates ( $s_o$ ) and inlet emission rates ( $s_i$ ) as applicable.
  - c. The lower confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the upper confidence limit for the mean inlet emission rate ( $E_i^*$ ) as applicable.
  - d. The applicable potential combustion concentration.
  - e. The ratio of the upper confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the allowable emission rate ( $E_{std}$ ) as applicable. [40 C.F.R § 60.51Da(c)]
50. For any periods for which opacity, SO<sub>2</sub> or NO<sub>x</sub> emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and affected facility during periods of data unavailability are to be compared with operation of the control system and affected facility before and following the period of data unavailability. [40 C.F.R § 60.51Da(f)]

51. The owner or operator of the affected facility shall submit a signed statement indicating whether:
  - a. The required CEMS calibration, span, and drift checks or other periodic audits have or have not been performed as specified.
  - b. The data used to show compliance was or was not obtained in accordance with approved methods and procedures of 40 CFR Part 60 and is representative of plant performance.
  - c. The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.
  - d. Compliance with the standards has or has not been achieved during the reporting period. [40 C.F.R § 60.51Da(h)]
52. For the purposes of the reports required under §60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under §60.42Da(b). Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter. [40 C.F.R § 60.51Da(i)]
53. The owner or operator of an affected facility shall submit the written reports required under §60.51Da and subpart A to the Administrator semiannually for each six-month period. All semiannual reports shall be postmarked by the 30th day following the end of each six-month period. [40 C.F.R § 60.51Da(j)]
54. The owner or operator of an affected facility may submit electronic quarterly reports for SO<sub>2</sub> and/or NO<sub>x</sub> and/or opacity in lieu of submitting the written reports required under paragraphs (b) and (i) of §60.51Da. The format of each quarterly electronic report shall be coordinated with the permitting authority. The electronic report(s) shall be submitted no later than 30 days after the end of the calendar quarter and shall be accompanied by a certification statement from the owner or operator, indicating whether compliance with the applicable emission standards and minimum data requirements of 40 CFR Part 60, Subpart Da was achieved during the reporting period. [40 C.F.R § 60.51Da(k)]
55. The permittee shall install, calibrate, maintain, and operate continuous emission monitoring systems (CEMS) for SN-01 and record the output of the system to measure CO. The CEMS shall comply with the Department's Continuous Emissions Monitoring Systems Conditions. The CEMS data may be used by the Department for enforcement purposes. [Reg.19.702, 40 C.F.R. § 52 Subpart E, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
56. Reserved.
57. Reserved.

58. The permittee must install and continuously operate a bag leak detection system for SN-01. [Reg.19.705 and 40 C.F.R. § 70.6]
- a. The bag leak detection system must be certified by the manufacturer to be capable of continuously detecting and recording particulate matter emissions at concentrations of 1.0 milligrams per actual cubic meter;
  - b. The bag leak detection system shall provide output of relative or absolute particulate matter loadings;
  - c. The bag leak detection system shall be equipped with an alarm system that will sound an audible alarm when an increase in relative particulate loadings is detected over a preset level;
  - d. The bag leak detection system shall be installed and operated in a manner consistent with available written guidance from the U.S. Environmental Protection Agency or, in the absence of such written guidance, the manufacturer's written specifications and recommendations for installation, operation, and adjustment of the system;
  - e. The initial adjustment of the system shall, at a minimum, consist of establishing the baseline output by adjusting the sensitivity (range) and the averaging period of the device, and establishing the alarm set points and the alarm delay time;
  - f. Following initial adjustment, the permittee must not adjust the sensitivity or range, averaging period, alarm set points, or alarm delay time, except as detailed in the operation and maintenance plan required. The permittee must not increase the sensitivity by more than 100 percent or decrease the sensitivity by more than 50 percent over a 365 day period unless such adjustment follows a complete fabric filter inspection which demonstrates the fabric filter is in good operating condition.
59. The permittee shall establish an operating and maintenance plan that specifies the procedures to follow in the case of a bag leak detection system alarm or malfunction. The corrective measures plan must include, at a minimum, the procedures used to determine and record the time and cause of the alarm or bag leak detection system malfunction as well as the corrective measures taken to correct the control device or bag leak detection system malfunction or to minimize emissions. [Reg.19.705 and 40 C.F.R. § 70.6]
- a. The procedures used to determine the cause of the alarm or bag leak detection system malfunction must be initiated within 30 minutes of the time the alarm first sounds; and
  - b. The cause of the alarm or bag leak detection system malfunction must be alleviated by taking the necessary corrective measure(s) which may include, but are not to be limited to, the following:
  - c. Inspecting the fabric filter for air leaks, torn or broken filter elements, or any other malfunction that may cause an increase in emissions;
  - d. Sealing off defective bags or filter media;
  - e. Replacing defective bags or filter media, or otherwise repairing the control device;
  - f. Sealing off a defective fabric filter compartment;

- g. Cleaning the bag leak detection system probe, or otherwise repairing the bag leak detection system; or
  - h. Shutting down the boiler.
60. The permittee shall maintain records of hourly bag leak detector readings. These records shall be updated by the 15<sup>th</sup> day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]
61. The permittee shall not exceed a 24 hour rolling average heat input to SN-01 of 6000 MMBtu. [Reg.19.901, 40 C.F.R. § 70.6, and Ark. Code Ann. § 8-4-203 as referenced by A.C.A. §§ 8-4-304]
62. The permittee shall maintain hourly and 24 hour records of the heat input to SN-01. These records shall be updated by the 15th day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]
63. The permittee shall maintain records of the following averages. These records shall be updated by the 15th day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]

| Pollutant       | Rate                                        | Averaging Period         |
|-----------------|---------------------------------------------|--------------------------|
| SO <sub>2</sub> | lb/MMBtu                                    | 30-day rolling average   |
|                 | lb/hr                                       | 24-hour rolling average  |
| NO <sub>x</sub> | lb/MMBtu for normal operations <sup>1</sup> | 24-hour rolling average  |
|                 | lb/hr                                       | 24 hour rolling average  |
|                 | lb/MMBtu                                    | 12 month rolling average |
| CO              | lb/MMBtu                                    | 30-day rolling average   |

<sup>1</sup>Normal operation is defined as operation at or above 300 MW gross output from the Unit 1 generator

Acid Rain Program

64. The affected unit (SN-01) is subject to and shall comply with applicable provisions of the Acid Rain Program (40 CFR Parts 72, 73, and 75).

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

65. The submission of the NO<sub>x</sub>, SO<sub>2</sub>, and CO<sub>2</sub> monitoring plan is required at least 21 days prior to the initial CEMS certification testing. Notice of CEMS certification testing is required at least 21 days prior to the initial CEMS certification testing. [40 C.F.R. § 75 Subpart A and 40 C.F.R. § 75.62(a)(1) and (2)]
66. The initial NO<sub>x</sub> and CO<sub>2</sub> CEMS certification testing is to occur no later than 180 calendar days after the date the unit commences commercial operation. [40 CFR Part 75 Subpart A and 40 C.F.R. § 75.4(b)(2)]
67. The permittee shall ensure that the continuous emissions monitoring systems are in operation and monitoring all unit emissions at all times, except during periods of calibration, quality assurance, preventative maintenance or repair. [40 C.F.R. § 75.10]

#### MATS Requirements

68. SN-01 is considered an affected source under 40 CFR Part 63, UUUUU - *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units*, and is subject, but not limited to, Specific Conditions 69 through 224. [Reg.19.304 and 40 C.F.R. § 63 Subpart DDDDD]

#### Compliance Dates

69. SN-01 shall comply with all applicable provisions of 40 CFR Part 63, Subpart UUUUU no later than April 16, 2015. [Reg.19.304 and 40 C.F.R. § 63.9984(b)]
70. The permittee must meet the notification requirements in §63.10030 according to the schedule in §63.10030 and in subpart A of 40 CFR Part 63. Some of the notifications must be submitted before you are required to comply with the emission limits and work practice standards in 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.9984(c)]

#### Emission Limitations, Work Practice Standards, and Operating Limits

71. The permittee must meet the requirements in paragraphs (a)(1) and (2) of §63.9991. You must meet these requirements at all times. [Reg.19.304 and 40 C.F.R. § 63.9991(a)]
72. The permittee must meet each applicable emission limit in Table 2 of 40 CFR Part 63, Subpart UUUUU. [Reg.19.304, 40 C.F.R. § 63.9991(a)(1), and 40 C.F.R. § 63 Subpart UUUUU Table 2]



| EGU Subcategory                          | Pollutants                                        | Emission Limitations | Use these requirements, as appropriate (e.g., specified sampling volume or test run duration) and limitations with the test methods in Table 5 |
|------------------------------------------|---------------------------------------------------|----------------------|------------------------------------------------------------------------------------------------------------------------------------------------|
| Coal-fired unit not low rank virgin coal | a. Filterable particulate matter (PM)             | 3.0E-2 lb/MMBtu      | Collect a minimum of 1 dscm per run.                                                                                                           |
|                                          | b. Sulfur dioxide (SO <sub>2</sub> ) <sup>1</sup> | 2.0E-1 lb/MMBtu      | SO <sub>2</sub> CEMS.                                                                                                                          |
|                                          | c. Mercury (Hg)                                   | 1.2E0 lb/TBtu        | Hg CEMS or sorbent trap monitoring system only.                                                                                                |

<sup>1</sup>The permittee may not use the alternate SO<sub>2</sub> limit if its EGU does not have some form of FGD system and SO<sub>2</sub> CEMS installed.

73. The permittee must meet each applicable work practice standard in Table 3 of 40 CFR Part 63, Subpart UUUUU. [Reg.19.304, 40 C.F.R. § 63.9991(a)(1), and 40 C.F.R. § 63 Subpart UUUUU Table 3]

| If your EGU is . . .             | You must meet the following . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
|----------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| An existing EGU                  | Conduct a tune-up of the EGU burner and combustion controls at least each 36 calendar months as specified in §63.10021(e).                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |
| A coal-fired EGU during startup  | You must operate all CMS during startup. Startup means either the first-ever firing of fuel in a boiler for the purpose of producing electricity, or the firing of fuel in a boiler after a shutdown event for any purpose. Startup ends when any of the steam from the boiler is used to generate electricity for sale over the grid or for any other purpose (including on site use). For startup of a unit, you must use clean fuels, either natural gas or distillate oil or a combination of clean fuels for ignition. Once you convert to firing coal, residual oil, or solid oil-derived fuel, you must engage all of the applicable control technologies except dry scrubber and SCR. You must start your dry scrubber and SCR systems, if present, appropriately to comply with relevant standards applicable during normal operation. You must comply with all applicable emissions limits at all times except for periods that meet the definitions of startup and shutdown in 40 CFR Part 63, Subpart UUUUU. You must keep records during periods of startup. You must provide reports concerning activities and periods of startup, as specified in §63.10011(g) and §63.10021(h) and (i). |
| A coal-fired EGU during shutdown | You must operate all CMS during shutdown. Shutdown means the cessation of operation of a boiler for any purpose. Shutdown begins either when none of the steam from the boiler is used to generate electricity for sale over the grid or for any other purpose                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |

| If your EGU is . . . | You must meet the following . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |
|----------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                      | (including on-site use) or at the point of no fuel being fired in the boiler. Shutdown ends when there is both no electricity being generated and no fuel being fired in the boiler. During shutdown, you must operate all applicable control technologies while firing coal, residual oil, or solid oil-derived fuel. You must comply with all applicable emissions limits at all times except for periods that meet the definitions of startup and shutdown in 40 CFR Part 63, Subpart UUUUU. You must keep records during periods of startup. You must provide reports concerning activities and periods of startup, as specified in §63.10011(g) and §63.10021(h) and (i). |

74. The permittee must meet each applicable operating limit in Table 4 of 40 CFR Part 63, Subpart UUUUU. [Reg.19.304, 40 C.F.R. § 63.9991(a)(2), and 40 C.F.R. § 63 Subpart UUUUU Table 4]

| If you demonstrate compliance using . . . | You must meet these operating limits . . .                                                                                                                                                                                           |
|-------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PM CPMS                                   | Maintain the 30-boiler operating day rolling average PM CPMS output at or below the highest 1-hour average measured during the most recent performance test demonstrating compliance with the filterable PM emissions limitation(s). |

#### General Compliance Requirements

75. The permittee must be in compliance with the emission limits and operating limits in 40 CFR Part 63, Subpart UUUUU. These limits apply to you at all times except during periods of startup and shutdown; however, you are required to meet the work practice requirements in Table 3 to 40 CFR Part 63, Subpart UUUUU during periods of startup or shutdown. [Reg.19.304 and 40 C.F.R. § 63.10000(a)]
76. At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. Determination of whether such operation and maintenance procedures are being used will be based on information available to the EPA Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source. [Reg.19.304 and 40 C.F.R. § 63.10000(b)]
77. Initial performance testing is required for all pollutants, to demonstrate compliance with the applicable emission limits. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)]

78. The permittee may conduct the initial performance testing in accordance with §63.10005(h), to determine whether the unit qualifies as a low emitting EGU (LEE) for one or more applicable emissions limits, with two exceptions:
- a. You may not pursue the LEE option if your coal-fired, IGCC, or solid oil-derived fuel-fired EGU is equipped with an acid gas scrubber and has a main stack and bypass stack exhaust configuration, and
  - b. You may not pursue the LEE option for Hg if your coal-fired, solid oil-derived fuel-fired EGU or IGCC EGU is new.

[Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(i)]

79. The permittee must conduct a 30-day performance test using Method 30B at least once every 12 calendar months to demonstrate continued LEE status. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(ii)]
80. The permittee must conduct a performance test at least once every 36 calendar months to demonstrate continued LEE status. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(iii)]
81. The permittee must demonstrate compliance through an initial performance test and you must monitor continuous performance through either use of a particulate matter continuous parametric monitoring system (PM CPMS), a PM CEMS, or compliance performance testing repeated quarterly. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(iv)]
82. If your EGU uses wet or dry flue gas desulfurization technology (this includes limestone injection into a fluidized bed combustion unit), you may apply a second alternative to HCl CEMS by installing and operating a sulfur dioxide (SO<sub>2</sub>) CEMS installed and operated in accordance with part 75 of Chapter I to demonstrate compliance with the applicable SO<sub>2</sub> emissions limit. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(v)]
83. The permittee must demonstrate initial and continuous compliance through use of a Hg CEMS or a sorbent trap monitoring system, in accordance with appendix A to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10000(c)(1)(vi)]
84. If you demonstrate compliance with any applicable emissions limit through use of a continuous monitoring system (CMS), where a CMS includes a continuous parameter monitoring system (CPMS) as well as a continuous emissions monitoring system (CEMS), you must develop a site-specific monitoring plan and submit this site-specific monitoring plan, if requested, at least 60 days before your initial performance evaluation (where applicable) of your CMS. This requirement also applies to you if you petition the Administrator for alternative monitoring parameters under §63.8(f). This requirement to develop and submit a site-specific monitoring plan does not apply to affected sources with existing monitoring plans that apply to CEMS and CPMS prepared under Appendix B to part 60 or part 75 of Chapter I, and that meet the requirements of §63.10010. Using the process described in §63.8(f)(4), you may request approval of monitoring system

quality assurance and quality control procedures alternative to those specified in §63.10000(d)(1) and, if approved, include those in your site-specific monitoring plan. The monitoring plan must address the provisions in paragraphs (d)(2) through (5) of §63.10000. [Reg.19.304 and 40 C.F.R. § 63.10000(d)(1)]

85. The site-specific monitoring plan shall include the information specified in paragraphs (d)(5)(i) through (d)(5)(vii) of §63.10000. Alternatively, the requirements of paragraphs (d)(5)(i) through (d)(5)(vii) are considered to be met for a particular CMS or sorbent trap monitoring system if:
- a. The CMS or sorbent trap monitoring system is installed, certified, maintained, operated, and quality-assured either according to part 75 of Chapter I, or appendix A or B to 40 CFR Part 63, Subpart UUUUU; and
  - b. The recordkeeping and reporting requirements of part 75 of Chapter I, or appendix A or B to 40 CFR Part 63, Subpart UUUUU, that pertain to the CMS are met.

[Reg.19.304 and 40 C.F.R. § 63.10000(d)(2)]

86. If requested by the Administrator, you must submit the monitoring plan (or relevant portion of the plan) at least 60 days before the initial performance evaluation of a particular CMS, except where the CMS has already undergone a performance evaluation that meets the requirements of §63.10010 (e.g., if the CMS was previously certified under another program). [Reg.19.304 and 40 C.F.R. § 63.10000(d)(3)]

87. You must operate and maintain the CMS according to the site-specific monitoring plan. [Reg.19.304 and 40 C.F.R. § 63.10000(d)(4)]

88. The provisions of the site-specific monitoring plan must address the following items: [Reg.19.304 and 40 C.F.R. § 63.10000(d)(5)]
- a. Installation of the CMS or sorbent trap monitoring system sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of control of the exhaust emissions (e.g., on or downstream of the last control device). See §63.10010(a) for further details. For PM CPMS installations, follow the procedures in §63.10010(h).
  - b. Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems.
  - c. Schedule for conducting initial and periodic performance evaluations.
  - d. Performance evaluation procedures and acceptance criteria (e.g., calibrations), including the quality control program in accordance with the general requirements of §63.8(d).
  - e. On-going operation and maintenance procedures, in accordance with the general requirements of §§63.8(c)(1)(ii), (c)(3), and (c)(4)(ii).

- f. Conditions that define a CMS that is out of control consistent with § 63.8(c)(7)(i) and for responding to out of control periods consistent with §§63.8(c)(7)(ii) and (c)(8).
  - g. On-going recordkeeping and reporting procedures, in accordance with the general requirements of §§63.10(c), (e)(1), and (e)(2)(i), or as specifically required under 40 CFR Part 63, Subpart UUUUU.
89. As part of your demonstration of continuous compliance, you must perform periodic tune-ups of your EGU(s), according to §63.10021(e). [Reg.19.304 and 40 C.F.R. § 63.10000(e)]
90. You are subject to the requirements of 40 CFR Part 63, Subpart UUUUU for at least 6 months following the last date you met the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU (e.g., 6 months after a cogeneration unit provided more than one third of its potential electrical output capacity and more than 25 megawatts electrical output to any power distribution system for sale). You may opt to remain subject to the provisions of 40 CFR Part 63, Subpart UUUUU beyond 6 months after the last date you met the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU, unless you are a solid waste incineration unit subject to standards under CAA section 129 (e.g., 40 CFR Part 60, Subpart CCCC (New Source Performance Standards (NSPS) for Commercial and Industrial Solid Waste Incineration Units, or Subpart DDDD (Emissions Guidelines (EG) for Existing Commercial and Industrial Solid Waste Incineration Units). Notwithstanding the provisions of 40 CFR Part 63, Subpart UUUUU, an EGU that starts combusting solid waste is immediately subject to standards under CAA section 129 and the EGU remains subject to those standards until the EGU no longer meets the definition of a solid waste incineration unit consistent with the provisions of the applicable CAA section 129 standards. [Reg.19.304 and 40 C.F.R. § 63.10000(f)]
91. If you no longer meet the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU you must be in compliance with any newly applicable standards on the date you are no longer subject to 40 CFR Part 63, Subpart UUUUU. The date you are no longer subject to 40 CFR Part 63, Subpart UUUUU is a date selected by you, that must be at least 6 months from the date that you last met the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU or the date you begin combusting solid waste, consistent with § 63.9983(d). Your source must remain in compliance with 40 CFR Part 63, Subpart UUUUU until the date you select to cease complying with 40 CFR Part 63, Subpart UUUUU or the date you begin combusting solid waste, whichever is earlier. [Reg.19.304 and 40 C.F.R. § 63.10000(g)]
92. All air pollution control equipment necessary for compliance with any newly applicable emissions limits which apply as a result of the cessation or commencement or recommencement of operations that cause your EGU to meet the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU must be installed and operational as of the date your source ceases to be or becomes subject to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10000(j)]

93. All monitoring systems necessary for compliance with any newly applicable monitoring requirements which apply as a result of the cessation or commencement or recommencement of operations that cause your EGU to meet the definition of an EGU subject to 40 CFR Part 63, Subpart UUUUU must be installed and operational as of the date your source ceases to be or becomes subject to 40 CFR Part 63, Subpart UUUUU. All calibration and drift checks must be performed as of the date your source ceases to be or becomes subject to 40 CFR Part 63, Subpart UUUUU. You must also comply with provisions of §§63.10010, 63.10020, and 63.10021 of 40 CFR Part 63, Subpart UUUUU. Relative accuracy tests must be performed as of the performance test deadline for PM CEMS, if applicable. Relative accuracy testing for other CEMS need not be repeated if that testing was previously performed consistent with CAA section 112 monitoring requirements or monitoring requirements under 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10000(k)]

#### Affirmative Defense

94. The owner or operator of the affected source experiencing an exceedance of its emission limit(s) during a malfunction shall notify the Administrator by telephone or facsimile (FAX) transmission as soon as possible, but no later than two business days after the initial occurrence of the malfunction or, if it is not possible to determine within two business days whether the malfunction caused or contributed to an exceedance, no later than two business days after the owner or operator knew or should have known that the malfunction caused or contributed to an exceedance, but, in no event later than two business days after the end of the averaging period, if it wishes to avail itself of an affirmative defense to civil penalties for that malfunction. The owner or operator seeking to assert an affirmative defense shall also submit a written report to the Administrator within 45 days of the initial occurrence of the exceedance of the standard in §63.9991 to demonstrate, with all necessary supporting documentation, that it has met the requirements set forth in paragraph (a) of §63.10001. The owner or operator may seek an extension of this deadline for up to 30 additional days by submitting a written request to the Administrator before the expiration of the 45 day period. Until a request for an extension has been approved by the Administrator, the owner or operator is subject to the requirement to submit such report within 45 days of the initial occurrence of the exceedance. [Reg.19.304 and 40 C.F.R. § 63.10001(b)]

#### Initial Compliance Requirements

95. The permittee must demonstrate initial compliance with each applicable emissions limit in Table 2 of 40 CFR Part 63, Subpart UUUUU through performance testing. Where two emissions limits are specified for a particular pollutant (e.g., a heat input-based limit in lb/MMBtu and an electrical output-based limit in lb/MWh), you may demonstrate compliance with either emission limit. The permittee has elected to comply with the heat input-based limits. For a particular compliance demonstration, you may be required to conduct one or more of the following activities in conjunction with performance testing:

collection of hourly electrical load data (megawatts); establishment of operating limits according to §63.10011 and Tables 4 and 7 to 40 CFR Part 63, Subpart UUUUU; and CMS performance evaluations. In all cases, you must demonstrate initial compliance no later than the applicable date in paragraph (f) of §63.10005 for tune-up work practices for existing EGUs and in §63.9984 for other requirements for existing EGUs. [Reg.19.304 and 40 C.F.R. § 63.10005(a)]

96. To demonstrate initial compliance with an applicable emissions limit in Table 2 to 40 CFR Part 63, Subpart UUUUU using stack testing, the initial performance test generally consists of three runs at specified process operating conditions using approved methods. If you are required to establish operating limits (see paragraph (d) of §63.10005 and Table 4 to 40 CFR Part 63, Subpart UUUUU), you must collect all applicable parametric data during the performance test period. [Reg.19.304 and 40 C.F.R. § 63.10005(a)(1)]
97. To demonstrate initial compliance using either a CMS that measures HAP concentrations directly (*i.e.*, an Hg, HCl, or HF CEMS, or a sorbent trap monitoring system) or an SO<sub>2</sub> or PM CEMS, the initial performance test consists of 30 boiler operating days of data collected by the initial compliance demonstration date specified in §63.10005 with the certified monitoring system. [Reg.19.304 and 40 C.F.R. § 63.10005(a)(2)]
98. The 30-boiler operating day CMS performance test must demonstrate compliance with the applicable Hg, PM, or SO<sub>2</sub> emissions limit in Table 2 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10005(a)(2)(i)]
99. If you choose to comply with an electrical output-based emission limit, you must collect hourly electrical load data during the performance test period. [Reg.19.304 and 40 C.F.R. § 63.10005(a)(2)(ii)]
100. If you choose to use performance testing to demonstrate initial compliance with the applicable emissions limits in Table 2 to 40 CFR Part 63, Subpart UUUUU for your EGUs, you must conduct the tests according to §63.10007 and Table 5 to 40 CFR Part 63, Subpart UUUUU. For the purposes of the initial compliance demonstration, you may use test data and results from a performance test conducted prior to the date on which compliance is required as specified in §63.9984, provided that the following conditions are fully met: [Reg.19.304 and 40 C.F.R. § 63.10005(b)]
  - a. For a performance test based on stack test data, the test was conducted no more than 12 calendar months prior to the date on which compliance is required as specified in §63.9984;
  - b. For a performance test based on data from a certified CEMS or sorbent trap monitoring system, the test consists of all valid CMS data recorded in the 30 boiler operating days immediately preceding that date;
  - c. The performance test was conducted in accordance with all applicable requirements in §63.10007 and Table 5 to 40 CFR Part 63, Subpart UUUUU;

- d. A record of all parameters needed to convert pollutant concentrations to units of the emission standard (e.g., stack flow rate, diluent gas concentrations, hourly electrical loads) is available for the entire performance test period; and
  - e. For each performance test based on stack test data, you certify, and keep documentation demonstrating, that the EGU configuration, control devices, and fuel(s) have remained consistent with conditions since the prior performance test was conducted.
101. If, for a particular emission or operating limit, you are required to (or elect to) demonstrate initial compliance using a continuous monitoring system, the CMS must pass a performance evaluation prior to the initial compliance demonstration. If a CMS has been previously certified under another state or federal program and is continuing to meet the on-going quality-assurance (QA) requirements of that program, then, provided that the certification and QA provisions of that program meet the applicable requirements of §§63.10010(b) through (h), an additional performance evaluation of the CMS is not required under 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10005(d)]
102. The permittee may demonstrate initial compliance with the applicable SO<sub>2</sub> emissions limit in Table 2 to 40 CFR Part 63, Subpart UUUUU through use of an SO<sub>2</sub> CEMS installed and operated in accordance with part 75 of Chapter I or Appendix B to 40 CFR Part 63, Subpart UUUUU, as applicable. You may also demonstrate compliance with a filterable PM emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU through use of a PM CEMS installed, certified, and operated in accordance with §63.10010(i). Initial compliance is achieved if the arithmetic average of 30-boiler operating days of quality-assured CEMS data, expressed in units of the standard (see §63.10007(e)), meets the applicable SO<sub>2</sub> or PM emissions limit in Table 2 to 40 CFR Part 63, Subpart UUUUU. Use Equation 19–19 of Method 19 in appendix A–7 to part 60 of Chapter I to calculate the 30-boiler operating day average emissions rate. (Note: For this calculation, the term E<sub>hj</sub> in Equation 19–19 must be in the same units of measure as the applicable HCl or HF emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU). [Reg.19.304 and 40 C.F.R. § 63.10005(d)(1)]
103. If you demonstrate compliance with the applicable emission limits for filterable PM listed in Table 2 to 40 CFR Part 63, Subpart UUUUU using initial performance testing and continuous monitoring with PM CPMS:
- a. You must demonstrate initial compliance no later than the applicable date specified in §63.9984(f) for existing EGUs.
  - b. You must demonstrate continuous compliance with the PM CPMS site-specific operating limit that corresponds to the results of the performance test demonstrating compliance with the emission limit with which you choose to comply.



- c. You must repeat the performance test annually for the selected pollutant emissions limit and reassess and adjust the site-specific operating limit in accordance with the results of the performance test.

[Reg.19.304 and 40 C.F.R. § 63.10005(d)(2)]

- 104. For affected EGUs that are either required to or elect to demonstrate initial compliance with the applicable Hg emission limit in Table 2 of 40 CFR Part 63, Subpart UUUUU using Hg CEMS or sorbent trap monitoring systems, initial compliance must be demonstrated no later than the applicable date specified in §63.9984(f) for existing EGUs. Initial compliance is achieved if the arithmetic average of 30-boiler operating days of quality-assured CEMS (or sorbent trap monitoring system) data, expressed in units of the standard (see section 6.2 of appendix A to 40 CFR Part 63, Subpart UUUUU), meets the applicable Hg emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10005(d)(3)]
- 105. All affected EGUs are subject to the work practice standards in Table 3 of 40 CFR Part 63, Subpart UUUUU. As part of your initial compliance demonstration, you must conduct a performance tune-up of your EGU according to §63.10021(e). [Reg.19.304 and 40 C.F.R. § 63.10005(e)]
- 106. For existing affected sources a tune-up may occur prior to April 16, 2012, so that existing sources without neural networks have up to 42 calendar months (3 years from promulgation plus 180 days) after the date that is specified for your source in §63.9984 and according to the applicable provisions in §63.7(a)(2) as cited in Table 9 to 40 CFR Part 63, Subpart UUUUU to demonstrate compliance with this requirement. If a tune-up occurs prior to such date, the source must maintain adequate records to show that the tune-up met the requirements of 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10005(f)]
- 107. The provisions of §63.10005(h) apply to pollutants with emissions limits from new EGUs except Hg and to all pollutants with emissions limits from existing EGUs. You may not pursue this compliance option if your existing EGU is equipped with an acid gas scrubber and has a main stack and bypass stack exhaust configuration. [Reg.19.304 and 40 C.F.R. § 63.10005(h)]
- 108. An EGU may qualify for low emitting EGU (LEE) status for Hg, HCl, HF, filterable PM, total non-Hg HAP metals, or individual non-Hg HAP metals (or total HAP metals or individual HAP metals, for liquid oil-fired EGUs) if you collect performance test data that meet the requirements of §63.10005(h), and if those data demonstrate:
  - a. For all pollutants except Hg, performance test emissions results less than 50 percent of the applicable emissions limits in Table 1 or 2 to 40 CFR Part 63, Subpart UUUUU for all required testing for 3 consecutive years; or
  - b. For Hg emissions from an existing EGU, either:

- i. Average emissions less than 10 percent of the applicable Hg emissions limit in Table 2 to 40 CFR Part 63, Subpart UUUUU (expressed either in units of lb/TBtu or lb/GWh); or
- ii. Potential Hg mass emissions of 29.0 or fewer pounds per year and compliance with the applicable Hg emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU (expressed either in units of lb/TBtu or lb/GWh).

[Reg.19.304 and 40 C.F.R. § 63.10005(h)(1)]

109. For all pollutants except Hg, you must conduct all required performance tests described in §63.10007 to demonstrate that a unit qualifies for LEE status.
- a. When conducting emissions testing to demonstrate LEE status, you must increase the minimum sample volume specified in Table 1 or 2 nominally by a factor of two.
  - b. Follow the instructions in § 63.10007(e) and Table 5 to 40 CFR Part 63, Subpart UUUUU to convert the test data to the units of the applicable standard.

[Reg.19.304 and 40 C.F.R. § 63.10005(h)(2)]

110. For Hg, you must conduct a 30-boiler operating day performance test using Method 30B in appendix A-8 to 40 CFR Part 60 to determine whether a unit qualifies for LEE status. Locate the Method 30B sampling probe tip at a point within the 10 percent centroidal area of the duct at a location that meets Method 1 in appendix A-1 to 40 CFR Part 60 and conduct at least three nominally equal length test runs over the 30-boiler operating day test period. Collect Hg emissions data continuously over the entire test period (except when changing sorbent traps or performing required reference method QA procedures), under all process operating conditions. You may use a pair of sorbent traps to sample the stack gas for no more than 10 days. [Reg.19.304 and 40 C.F.R. § 63.10005(h)(3)]

111. Depending on whether you intend to assess LEE status for Hg in terms of the lb/TBtu or lb/GWh emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU or in terms of the annual Hg mass emissions limit of 29.0 lb/year, you will have to collect some or all of the following data during the 30-boiler operating day test period (see paragraph (h)(3)(iii) of §63.10005):

- a. Diluent gas (CO<sub>2</sub> or O<sub>2</sub>) data, using either Method 3A in appendix A-3 to 40 CFR Part 60 or a diluent gas monitor that has been certified according to 40 CFR Part 75.
- b. Stack gas flow rate data, using either Method 2, 2F, or 2G in appendices A-1 and A-2 to 40 CFR Part 60, or a flow rate monitor that has been certified according to 40 CFR Part 75.
- c. Stack gas moisture content data, using either Method 4 in appendix A-1 to 40 CFR Part 60, or a moisture monitoring system that has been certified according to

40 CFR Part 75. Alternatively, an appropriate fuel-specific default moisture value from §75.11(b) may be used in the calculations or you may petition the Administrator under §75.66 for use of a default moisture value for non-coal-fired units.

- d. Hourly electrical load data (megawatts), from facility records.

[Reg.19.304 and 40 C.F.R. § 63.10005(h)(3)(i)]

112. If you use CEMS to measure CO<sub>2</sub> (or O<sub>2</sub>) concentration, and/or flow rate, and/or moisture, record hourly average values of each parameter throughout the 30-boiler operating day test period. If you opt to use EPA reference methods rather than CEMS for any parameter, you must perform at least one representative test run on each operating day of the test period, using the applicable reference method.

[Reg.19.304 and 40 C.F.R. § 63.10005(h)(3)(ii)]

113. Calculate the average Hg concentration, in µg/m<sup>3</sup> (dry basis), for the 30-boiler operating day performance test, as the arithmetic average of all Method 30B sorbent trap results. Also calculate, as applicable, the average values of CO<sub>2</sub> or O<sub>2</sub> concentration, stack gas flow rate, stack gas moisture content, and electrical load for the test period. Then:

- a. To express the test results in units of lb/TBtu, follow the procedures in §63.10007(e). Use the average Hg concentration and diluent gas values in the calculations.
- b. To express the test results in units of lb/GWh, use Equations A-3 and A-4 in section 6.2.2 of appendix A to 40 CFR Part 63, Subpart UUUUU, replacing the hourly values “C<sub>h</sub>”, “Q<sub>h</sub>”, “B<sub>ws</sub>” and “(MW)<sub>h</sub>” with the average values of these parameters from the performance test.
- c. To calculate pounds of Hg per year, use one of the following methods:
- i. Multiply the average lb/TBtu Hg emission rate (determined according to §63.10005 (h)(3)(iii)(A)) by the maximum potential annual heat input to the unit (TBtu), which is equal to the maximum rated unit heat input (TBtu/hr) times 8,760 hours. If the maximum rated heat input value is expressed in units of MMBtu/hr, multiply it by 10<sup>-6</sup> to convert it to TBtu/hr; or
  - ii. Multiply the average lb/GWh Hg emission rate (determined according to §63.10005 (h)(3)(iii)(B)) by the maximum potential annual electricity generation (GWh), which is equal to the maximum rated electrical output of the unit (GW) times 8,760 hours. If the maximum rated electrical output value is expressed in units of MW, multiply it by 10<sup>-3</sup> to convert it to GW; or
  - iii. If an EGU has a federally-enforceable permit limit on either the annual heat input or the number of annual operating hours, you may modify the calculations in §63.10005(h)(3)(iii)(C)(1) by replacing the maximum

potential annual heat input or 8,760 unit operating hours with the permit limit on annual heat input or operating hours (as applicable).

[Reg.19.304 and 40 C.F.R. § 63.10005(h)(3)(iii)]

114. The permittee must follow the requirements given in Table 3 to 40 CFR Part 63, Subpart UUUUU during startup and shutdown for coal-fired or solid oil derived-fired units. [Reg.19.304 and 40 C.F.R. § 63.10005(j)]
115. You must submit a Notification of Compliance Status summarizing the results of your initial compliance demonstration, as provided in §63.10030. [Reg.19.304 and 40 C.F.R. § 63.10005(k)]

#### Subsequent Performance Tests or Tune-ups

116. If you use PM CPMS to monitor continuous performance with an applicable emission limit as provided for under §63.10000(c), you must conduct all applicable performance tests according to Table 5 to 40 CFR Part 63, Subpart UUUUU and §63.10007 at least every year. [Reg.19.304 and 40 C.F.R. § 63.10006(a)]
117. For affected units meeting the LEE requirements of § 63.10005(h), you must repeat the performance test once every 3 years (once every year for Hg) according to Table 5 and §63.10007. Should subsequent emissions testing results show the unit does not meet the LEE eligibility requirements, LEE status is lost. If this should occur:
- a. For all pollutant emission limits except for Hg, you must conduct emissions testing quarterly, except as otherwise provided in §63.10021(d)(1).
  - b. For Hg, you must install, certify, maintain, and operate a Hg CEMS or a sorbent trap monitoring system in accordance with appendix A to 40 CFR Part 63, Subpart UUUUU, within 6 calendar months of losing LEE eligibility. Until the Hg CEMS or sorbent trap monitoring system is installed, certified, and operating, you must conduct Hg emissions testing quarterly, except as otherwise provided in §63.10021(d)(1). You must have 3 calendar years of testing and CEMS or sorbent trap monitoring system data that satisfy the LEE emissions criteria to reestablish LEE status.

[Reg.19.304 and 40 C.F.R. § 63.10006(b)]

118. Except where paragraph (b) of §63.10006 applies, for solid oil-derived fuel- and coal-fired EGUs that do not use either an HCl CEMS to monitor compliance with the HCl limit or an SO<sub>2</sub> CEMS to monitor compliance with the alternate equivalent SO<sub>2</sub> emission limit, you must conduct all applicable periodic HCl emissions tests according to Table 5 to 40 CFR Part 63, Subpart UUUUU and §63.10007 at least quarterly, except as otherwise provided in §63.10021(d)(1). [Reg.19.304 and 40 C.F.R. § 63.10006(d)]

119. Performance tests required at least every 3 calendar years must be completed within 35 to 37 calendar months after the previous performance test; performance tests required at least every year must be completed within 11 to 13 calendar months after the previous performance test; and performance tests required at least quarterly must be completed within 80 to 100 calendar days after the previous performance test, except as otherwise provided in §63.10021(d)(1). [Reg.19.304 and 40 C.F.R. § 63.10006(f)]
120. If a performance test on a non-mercury LEE shows emissions in excess of 50 percent of the emission limit and if you choose to reapply for LEE status, you must conduct performance tests at the appropriate frequency given in section (c) through (e) of §63.10006 for that pollutant until all performance tests over a consecutive 3-year period show compliance with the LEE criteria. [Reg.19.304 and 40 C.F.R. § 63.10006(h)]
121. If you are required to meet an applicable tune-up work practice standard, you must conduct a performance tune-up according to §63.10021(e). [Reg.19.304 and 40 C.F.R. § 63.10006(i)]
122. Each performance tune-up specified in §63.10021(e) must be no more than 36 calendar months after the previous performance tune-up. [Reg.19.304 and 40 C.F.R. § 63.10006(i)(1)]
123. For EGUs employing neural network combustion optimization systems during normal operation, each performance tune-up specified in §63.10021(e) must be no more than 48 calendar months after the previous performance tune-up. [Reg.19.304 and 40 C.F.R. § 63.10006(i)(2)]
124. You must report the results of performance tests and performance tune-ups within 60 days after the completion of the performance tests and performance tune-ups. The reports for all subsequent performance tests must include all applicable information required in §63.10031. [Reg.19.304 and 40 C.F.R. § 63.10006(j)]

#### Performance Tests Methods and Other Procedures

125. Except as otherwise provided in §63.10007, you must conduct all required performance tests according to §63.7(d), (e), (f), and (h). You must also develop a site-specific test plan according to the requirements in §63.7(c). [Reg.19.304 and 40 C.F.R. § 63.10007(a)]
126. If you use CEMS (Hg, SO<sub>2</sub>, or other) to determine compliance with a 30-boiler operating day rolling average emission limit, you must collect data for all nonexempt unit operating conditions (see §63.10011(g) and Table 3 to 40 CFR Part 63, Subpart UUUUU). [Reg.19.304 and 40 C.F.R. § 63.10007(a)(1)]
127. If you conduct performance testing with test methods in lieu of continuous monitoring, operate the unit at maximum normal operating load conditions during each periodic (e.g.,

quarterly) performance test. Maximum normal operating load will be generally between 90 and 110 percent of design capacity but should be representative of site specific normal operations during each test run. [Reg.19.304 and 40 C.F.R. § 63.10007(a)(2)]

128. For establishing operating limits with particulate matter continuous parametric monitoring system (PM CPMS) to demonstrate compliance with a PM emissions limit, operate the unit at maximum normal operating load conditions during the performance test period. Maximum normal operating load will be generally between 90 and 110 percent of design capacity but should be representative of site specific normal operations during each test run. [Reg.19.304 and 40 C.F.R. § 63.10007(a)(3)]
129. You must conduct each performance test (including traditional 3-run stack tests, 30-boiler operating day tests based on CEMS data (or sorbent trap monitoring system data), and 30-boiler operating day Hg emission tests for LEE qualification) according to the requirements in Table 5 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10007(b)]
130. The permittee must comply with the following requirements for performance testing:<sup>1</sup> [Reg.19.304 and 40 C.F.R. § 63 Subpart UUUUU Table 5]

| To conduct a performance test for the following pollutant . . . | Using . . .       | You must perform the following activities, as applicable to your emission limit ... | Using <sup>2</sup> . . .                                                                                             |
|-----------------------------------------------------------------|-------------------|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------|
| Filterable Particulate matter (PM)                              | Emissions Testing | a. Select sampling ports location and the number of traverse points                 | Method 1 at Appendix A–1 to part 60 of Chapter I.                                                                    |
|                                                                 |                   | b. Determine velocity and volumetric flow-rate of the stack gas                     | Method 2, 2A, 2C, 2F, 2G or 2H at Appendix A–1 or A–2 to part 60 of Chapter I.                                       |
|                                                                 |                   | c. Determine oxygen and carbon dioxide concentrations of the stack gas              | Method 3A or 3B at Appendix A–2 to part 60 of Chapter I, or ANSI/ASME PTC 19.10–1981. <sup>3</sup>                   |
|                                                                 |                   | d. Measure the moisture content of the stack gas                                    | Method 4 at Appendix A–3 to part 60 of Chapter I.                                                                    |
|                                                                 |                   | e. Measure the filterable PM concentration                                          | Method 5 at Appendix A–3 to part 60 of Chapter I.                                                                    |
|                                                                 |                   |                                                                                     | For positive pressure fabric filters, Method 5D at Appendix A–3 to part 60 of Chapter I for filterable PM emissions. |

| To conduct a performance test for the following pollutant . . . | Using . . .       | You must perform the following activities, as applicable to your emission limit ...                            | Using <sup>2</sup> . . .                                                                                                                                      |
|-----------------------------------------------------------------|-------------------|----------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                 |                   |                                                                                                                | Note that the Method 5 front half temperature shall be $160^{\circ} \pm 14^{\circ} \text{C}$ ( $320^{\circ} \pm 25^{\circ} \text{F}$ ).                       |
|                                                                 |                   | f. Convert emissions concentration to lb/MMBtu emissions rates                                                 | Method 19 F-factor methodology at Appendix A-7 to part 60 of Chapter I, or calculate using mass emissions rate and electrical output data (see §63.10007(e)). |
|                                                                 | OR                | OR                                                                                                             |                                                                                                                                                               |
|                                                                 | PM CEMS           | a. Install, certify, operate, and maintain the PM CEMS                                                         | Performance Specification 11 at Appendix B to part 60 of Chapter I and Procedure 2 at Appendix F to Part 60 of Chapter I.                                     |
|                                                                 |                   | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems      | Part 75 of Chapter I and §§ 63.10010(a), (b), (c), and (d).                                                                                                   |
|                                                                 |                   | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/MMBtu emissions rates | Method 19 F-factor methodology at Appendix A-7 to part 60 of Chapter I, or calculate using mass emissions rate and electrical output data (see §63.10007(e)). |
| Hydrogen chloride (HCl)                                         | Emissions Testing | a. Select sampling ports location and the number of traverse points.                                           | Method 1 at appendix A-1 to part 60 of Chapter I.                                                                                                             |
|                                                                 |                   | b. Determine velocity and volumetric flow-rate of the stack gas                                                | Method 2, 2A, 2C, 2F, 2G or 2H at appendix A-1 or A-2 to part 60 of Chapter I.                                                                                |
|                                                                 |                   | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                         | Method 3A or 3B at appendix A-2 to part 60 of Chapter I, or ANSI/ASME PTC 19.10-1981.3                                                                        |
|                                                                 |                   | d. Measure the moisture content of the stack gas                                                               | Method 4 at appendix A-3 to part 60 of Chapter I.                                                                                                             |
|                                                                 |                   | e. Measure the HCl concentrations                                                                              | Method 26 or Method 26A at appendix A-8 to part 60 of Chapter I                                                                                               |

| To conduct a performance test for the following pollutant . . . | Using . . . | You must perform the following activities, as applicable to your emission limit ...                       | Using <sup>2</sup> . . .                                                                                                                                                                                                                                       |
|-----------------------------------------------------------------|-------------|-----------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                 |             |                                                                                                           | or Method 320 at appendix A to part 63 of Chapter I or ASTM 6348-033 with<br>(1) the following conditions when using ASTM D6348-03:<br>(A) The test plan preparation and implementation in the Annexes to ASTM D6348-03, Sections A1 through A8 are mandatory; |
|                                                                 |             |                                                                                                           | (B) For ASTM D6348-03 Annex A5 (Analyte Spiking Technique), the percent (%) R must be determined for each target analyte (see Equation A5.5);                                                                                                                  |
|                                                                 |             |                                                                                                           | (C) For the ASTM D6348-03 test data to be acceptable for a target analyte, %R must be $70\% \geq R \leq 130\%$ ; and                                                                                                                                           |
|                                                                 |             |                                                                                                           | (2) spiking levels nominally no greater than two times the level corresponding to the applicable emission limit. Method 26A must be used if there are entrained water droplets in the exhaust stream.                                                          |
|                                                                 |             | f. Convert emissions concentration to lb/MMBtu or lb/MWh emissions rates                                  | Method 19 F-factor methodology at appendix A-7 to part 60 of Chapter I, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                       |
|                                                                 | OR          | OR                                                                                                        |                                                                                                                                                                                                                                                                |
|                                                                 | HCl CEMS    | a. Install, certify, operate, and maintain the HCl CEMS                                                   | Appendix B of 40 C.F.R. Part 63, Subpart UUUUU.                                                                                                                                                                                                                |
|                                                                 |             | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems | Part 75 of Chapter I and §63.10010(a), (b), (c), and (d).                                                                                                                                                                                                      |



| To conduct a performance test for the following pollutant . . . | Using . . .                    | You must perform the following activities, as applicable to your emission limit ...                                      | Using <sup>2</sup> . . .                                                                                                                                 |
|-----------------------------------------------------------------|--------------------------------|--------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                 |                                | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/MMBtu or lb/MWh emissions rates | Method 19 F-factor methodology at appendix A-7 to part 60 of Chapter I, or calculate using mass emissions rate and gross output data (see §63.10007(e)). |
| Mercury (Hg)                                                    | Hg CEMS                        | a. Install, certify, operate, and maintain the CEMS                                                                      | Sections 3.2.1 and 5.1 of Appendix A of 40 CFR Part 63, Subpart UUUUU.                                                                                   |
|                                                                 |                                | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                | Part 75 of Chapter I and §§63.10010(a), (b), (c), and (d).                                                                                               |
|                                                                 |                                | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/TBtu emissions rates            | Section 6 of Appendix A to 40 CFR Part 63, Subpart UUUUU.                                                                                                |
|                                                                 | OR                             | OR                                                                                                                       |                                                                                                                                                          |
|                                                                 | Sorbent trap monitoring system | a. Install, certify, operate, and maintain the sorbent trap monitoring system                                            | Sections 3.2.2 and 5.2 of Appendix A to 40 CFR Part 63, Subpart UUUUU.                                                                                   |
|                                                                 |                                | b. Install, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                         | Part 75 of Chapter I and §§63.10010(a), (b), (c), and (d).                                                                                               |
|                                                                 |                                | c. Convert emissions concentrations to 30 boiler operating day rolling average lb/TBtu emissions rates                   | Section 6 of Appendix A to 40 CFR Part 63, Subpart UUUUU.                                                                                                |
| Sulfur dioxide (SO <sub>2</sub> )                               | SO <sub>2</sub> CEMS           | a. Install, certify, operate, and maintain the CEMS                                                                      | Part 75 of Chapter I and §§63.10010(a) and (f).                                                                                                          |

| To conduct a performance test for the following pollutant . . . | Using . . . | You must perform the following activities, as applicable to your emission limit ...                            | Using <sup>2</sup> . . .                                                                                                                                      |
|-----------------------------------------------------------------|-------------|----------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                 |             | b. Install, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems               | Part 75 of Chapter I and §§63.10010(a), (b), (c), and (d).                                                                                                    |
|                                                                 |             | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/MMBtu emissions rates | Method 19 F-factor methodology at Appendix A-7 to part 60 of Chapter I, or calculate using mass emissions rate and electrical output data (see §63.10007(e)). |

<sup>1</sup>Regarding emissions data collected during periods of startup or shutdown, see §§63.10020(b) and (c) and §63.10021(h).

<sup>2</sup>See Table 2 to 40 CFR Part 63, Subpart UUUUU for required sample volumes and/or sampling run times.

<sup>3</sup>Incorporated by reference, see §63.14.

131. If you choose the filterable PM method to comply with the PM emission limit and demonstrate continuous performance using a PM CPMS as provided for in §63.10000(c), you must also establish an operating limit according to §63.10011(b), §63.10023, and Tables 4 and 6 to 40 CFR Part 63, Subpart UUUUU. Should you desire to have operating limits that correspond to loads other than maximum normal operating load, you must conduct testing at those other loads to determine the additional operating limits. [Reg.19.304 and 40 C.F.R. § 63.10007(c)]

132. If you choose to comply with the filterable PM emission limit and demonstrate continuous performance using a PM CPMS, you must comply with the following requirements for establishing operating limits: [Reg.19.304 and 40 C.F.R. § 63 Subpart UUUUU Table 6]

| If you have an applicable emission limit for . . . | And you choose to establish PM CPMS operating limits, you must . . . | And . . .                                                | Using . . .                      | According to the following procedures . . .                                       |
|----------------------------------------------------|----------------------------------------------------------------------|----------------------------------------------------------|----------------------------------|-----------------------------------------------------------------------------------|
| Filterable Particulate matter (PM)                 | Install, certify, maintain, and operate a PM CPMS for                | Establish a site-specific operating limit in units of PM | Data from the PM CPMS and the PM | 1. Collect PM CPMS output data during the entire period of the performance tests. |

| If you have an applicable emission limit for . . . | And you choose to establish PM CPMS operating limits, you must . . .           | And . . .                                                         | Using . . .       | According to the following procedures . . .                                                                                                                                                                                                                     |
|----------------------------------------------------|--------------------------------------------------------------------------------|-------------------------------------------------------------------|-------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                    | monitoring emissions discharged to the atmosphere according to §63.10010(h)(1) | CPMS output signal (e.g., milliamps, mg/acm, or other raw signal) | performance tests | 2. Record the average hourly PM CPMS output for each test run in the three run performance test.<br>3. Determine the highest 1-hour average PM CPMS measured during the performance test demonstrating compliance with the filterable PM emissions limitations. |

133. Except for a 30-boiler operating day performance test based on CEMS (or sorbent trap monitoring system) data, where the concept of test runs does not apply, you must conduct a minimum of three separate test runs for each performance test, as specified in §63.7(e)(3). Each test run must comply with the minimum applicable sampling time or volume specified in Table 2 to 40 CFR Part 63, Subpart UUUUU. Sections 63.10005(d) and (h), respectively, provide special instructions for conducting performance tests based on CEMS or sorbent trap monitoring systems. [Reg.19.304 and 40 C.F.R. § 63.10007(d)]

134. To use the results of performance testing to determine compliance with the applicable emission limits in Table 2 to 40 CFR Part 63, Subpart UUUUU, proceed as follows:

- a. Except for a 30-boiler operating day performance test based on CEMS (or sorbent trap monitoring system) data, if measurement results for any pollutant are reported as below the method detection level (e.g., laboratory analytical results for one or more sample components are below the method defined analytical detection level), you must use the method detection level as the measured emissions level for that pollutant in calculating compliance. The measured result for a multiple component analysis (e.g., analytical values for multiple Method 29 fractions both for individual HAP metals and for total HAP metals) may include a combination of method detection level data and analytical data reported above the method detection level.
- b. If the limits are expressed in lb/MMBtu or lb/TBtu, you must use the F-factor methodology and equations in sections 12.2 and 12.3 of EPA Method 19 in appendix A-7 to part 60 of Chapter I. In cases where an appropriate F-factor is not listed in Table 19-2 of Method 19, you may use F-factors from Table 1 in section 3.3.5 of appendix F to part 75 of Chapter I, or F-factors derived using the

procedures in section 3.3.6 of appendix to part 75 of Chapter I. Use the following factors to convert the pollutant concentrations measured during the initial performance tests to units of lb/scf, for use in the applicable Method 19 equations:

- i. Multiply SO<sub>2</sub> ppm by  $1.66 \times 10^{-7}$  ;
  - ii. Multiply HCl ppm by  $9.43 \times 10^{-8}$  ;
  - iii. Multiply HF ppm by  $5.18 \times 10^{-8}$  ;
  - iv. Multiply HAP metals concentrations (mg/dscm) by  $6.24 \times 10^{-8}$  ; and
  - v. Multiply Hg concentrations (µg/scm) by  $6.24 \times 10^{-11}$  .
- c. To determine compliance with emission limits expressed in lb/MWh or lb/GWh, you must first calculate the pollutant mass emission rate during the performance test, in units of lb/h. For Hg, if a CEMS or sorbent trap monitoring system is used, use Equation A-2 or A-3 in appendix A to 40 CFR Part 63, Subpart UUUUU (as applicable). In all other cases, use an equation that has the general form of Equation A-2 or A-3, replacing the value of K with  $1.66 \times 10^{-7}$  lb/scf-ppm for SO<sub>2</sub>,  $9.43 \times 10^{-8}$  lb/scf-ppm for HCl (if an HCl CEMS is used),  $5.18 \times 10^{-8}$  lb/scf-ppm for HF (if an HF CEMS is used), or  $6.24 \times 10^{-8}$  lb-scm/mg-scf for HAP metals and for HCl and HF (when performance stack testing is used), and defining C<sub>h</sub> as the average SO<sub>2</sub>, HCl, or HF concentration in ppm, or the average HAP metals concentration in mg/dscm. This calculation requires stack gas volumetric flow rate (scfh) and (in some cases) moisture content data (see §§ 63.10005(h)(3) and 63.10010). Then, if the applicable emission limit is in units of lb/GWh, use Equation A-4 in appendix A to 40 CFR Part 63, Subpart UUUUU to calculate the pollutant emission rate in lb/GWh. In this calculation, define (M)<sub>h</sub> as the calculated pollutant mass emission rate for the performance test (lb/h), and define (MW)<sub>h</sub> as the average electrical load during the performance test (megawatts). If the applicable emission limit is in lb/MWh rather than lb/GWh, omit the 10<sup>3</sup> term from Equation A-4 to determine the pollutant emission rate in lb/MWh.

[Reg.19.304 and 40 C.F.R. § 63.10007(e)]

135. Upon request, you shall make available to the EPA Administrator such records as may be necessary to determine whether the performance tests have been done according to the requirements of §63.10007. [Reg.19.304 and 40 C.F.R. § 63.10007(f)]

#### Monitoring, Installation, Operation, and Maintenance Requirements

136. For the CEMS, PM CPMS, and sorbent trap monitoring systems used to provide data under 40 CFR Part 63, Subpart UUUUU, the continuous monitoring system installation requirements for these exhaust configurations are as follows:
- a. For an affected unit that exhausts to the atmosphere through a single, dedicated stack, you shall either install the required CEMS, PM CPMS, and sorbent trap

monitoring systems in the stack or at a location in the ductwork downstream of all emissions control devices, where the pollutant and diluents concentrations are representative of the emissions that exit to the atmosphere.

[Reg.19.304 and 40 C.F.R. § 63.10010(a)]

137. If you use an oxygen (O<sub>2</sub>) or carbon dioxide (CO<sub>2</sub>) CEMS to convert measured pollutant concentrations to the units of the applicable emissions limit, the O<sub>2</sub> or CO<sub>2</sub> concentrations shall be monitored at a location that represents emissions to the atmosphere, *i.e.*, at the outlet of the EGU, downstream of all emission control devices. You must install, certify, maintain, and operate the CEMS according to part 75 of Chapter I. Use only quality-assured O<sub>2</sub> or CO<sub>2</sub> data in the emissions calculations; do not use part 75 substitute data values. [Reg.19.304 and 40 C.F.R. § 63.10010(b)]
138. If you are required to use a stack gas flow rate monitor, either for routine operation of a sorbent trap monitoring system or to convert pollutant concentrations to units of an electrical output-based emission standard in Table 2 to 40 CFR Part 63, Subpart UUUUU, you must install, certify, operate, and maintain the monitoring system and conduct on-going quality-assurance testing of the system according to part 75 of Chapter I. Use only unadjusted, quality-assured flow rate data in the emissions calculations. Do not apply bias adjustment factors to the flow rate data and do not use substitute flow rate data in the calculations. [Reg.19.304 and 40 C.F.R. § 63.10010(c)]
139. If you are required to make corrections for stack gas moisture content when converting pollutant concentrations to the units of an emission standard in Table 2 to 40 CFR Part 63, Subpart UUUUU, you must install, certify, operate, and maintain a moisture monitoring system in accordance with part 75 of Chapter I. Alternatively, for coal-fired units, you may use appropriate fuel-specific default moisture values from §75.11(b) of Chapter I to estimate the moisture content of the stack gas or you may petition the Administrator under §75.66 of Chapter I for use of a default moisture value for non-coal-fired units. If you install and operate a moisture monitoring system, do not use substitute moisture data in the emissions calculations. [Reg.19.304 and 40 C.F.R. § 63.10010(d)]
140. If you use an SO<sub>2</sub> CEMS, you must install the monitor at the outlet of the EGU, downstream of all emission control devices, and you must certify, operate, and maintain the CEMS according to part 75 of Chapter I. [Reg.19.304 and 40 C.F.R. § 63.10010(f)(1)]
141. For on-going QA, the SO<sub>2</sub> CEMS must meet the applicable daily, quarterly, and semiannual or annual requirements in sections 2.1 through 2.3 of appendix B to part 75 of Chapter I, with the following addition: You must perform the linearity checks required in section 2.2 of appendix B to part 75 of Chapter I if the SO<sub>2</sub> CEMS has a span value of 30 ppm or less. [Reg.19.304 and 40 C.F.R. § 63.10010(f)(2)]

142. Calculate and record a 30-boiler operating day rolling average SO<sub>2</sub> emission rate in the units of the standard, updated after each new boiler operating day. Each 30-boiler operating day rolling average emission rate is the average of all of the valid SO<sub>2</sub> emission rates in the preceding 30 boiler operating days. [Reg.19.304 and 40 C.F.R. § 63.10010(f)(3)]
143. Use only unadjusted, quality-assured SO<sub>2</sub> concentration values in the emissions calculations; do not apply bias adjustment factors to the part 75 SO<sub>2</sub> data and do not use part 75 substitute data values. [Reg.19.304 and 40 C.F.R. § 63.10010(f)(4)]
144. If you use a Hg CEMS or a sorbent trap monitoring system, you must install, certify, operate, maintain and quality-assure the data from the monitoring system in accordance with appendix A to 40 CFR Part 63, Subpart UUUUU. You must calculate and record a 30-boiler operating day rolling average Hg emission rate, in units of the standard, updated after each new boiler operating day. Each 30-boiler operating day rolling average emission rate, calculated according to section 6.2 of appendix A to 40 CFR Part 63, Subpart UUUUU, is the average of all of the valid hourly Hg emission rates in the preceding 30-boiler operating days. Section 7.1.4.3 of appendix A to 40 CFR Part 63, Subpart UUUUU explains how to reduce sorbent trap monitoring system data to an hourly basis. [Reg.19.304 and 40 C.F.R. § 63.10010(g)]
145. If you use a PM CPMS to demonstrate continuous compliance with an operating limit, you must install, calibrate, maintain, and operate the PM CPMS and record the output of the system as specified in paragraphs (h)(1) through (5) of §63.10010. [Reg.19.304 and 40 C.F.R. § 63.10010(h)]
146. Install, calibrate, operate, and maintain your PM CPMS according to the procedures in your approved site-specific monitoring plan developed in accordance with §63.10000(d), and meet the requirements in paragraphs (h)(1)(i) through (iii) of §63.10010.
  - a. The operating principle of the PM CPMS must be based on in-stack or extractive light scatter, light scintillation, beta attenuation, or mass accumulation detection of the exhaust gas or representative sample. The reportable measurement output from the PM CPMS may be expressed as milliamps, stack concentration, or other raw data signal.
  - b. The PM CPMS must have a cycle time (*i.e.*, period required to complete sampling, measurement, and reporting for each measurement) no longer than 60 minutes.
  - c. The PM CPMS must be capable, at a minimum, of detecting and responding to particulate matter concentrations of 0.5 mg/acm.

[Reg.19.304 and 40 C.F.R. § 63.10010(h)(1)]

147. For an existing unit, complete the initial performance evaluation no later than October 13, 2015. [Reg.19.304 and 40 C.F.R. § 63.10010(h)(2)]

148. Collect PM CPMS hourly average output data for all boiler operating hours except as indicated in paragraph (h)(5) of §63.10010. Express the PM CPMS output as milliamps, PM concentration, or other raw data signal value. [Reg.19.304 and 40 C.F.R. § 63.10010(h)(3)]
149. Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average PM CPMS output collected during all nonexempt boiler operating hours data (e.g., milliamps, PM concentration, raw data signal). [Reg.19.304 and 40 C.F.R. § 63.10010(h)(4)]
150. You must collect data using the PM CPMS at all times the process unit is operating and at the intervals specified in paragraph (h)(1)(ii) of §63.10010, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, required monitoring system quality assurance or quality control activities (including, as applicable, calibration checks and required zero and span adjustments), and any scheduled maintenance as defined in your site-specific monitoring plan. [Reg.19.304 and 40 C.F.R. § 63.10010(h)(5)]
151. You must use all the data collected during all boiler operating hours in assessing the compliance with your operating limit except:
  - a. Any data collected during monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or quality control activities conducted during monitoring system malfunctions are not used in calculations (report any such periods in your annual deviation report);
  - b. Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is out of control, or required monitoring system quality assurance or quality control activities conducted during out-of-control periods are not used in calculations (report emissions or operating levels and report any such periods in your annual deviation report);
  - c. Any data recorded during periods of startup or shutdown.[Reg.19.304 and 40 C.F.R. § 63.10010(h)(6)]
152. You must record and make available upon request results of PM CPMS system performance audits, as well as the dates and duration of periods from when the PM CPMS is out of control until completion of the corrective actions necessary to return the PM CPMS to operation consistent with your site-specific monitoring plan. [Reg.19.304 and 40 C.F.R. § 63.10010(h)(7)]
153. If you choose to comply with the PM filterable emissions limit in lieu of metal HAP limits, you may choose to install, certify, operate, and maintain a PM CEMS and record

the output of the PM CEMS as specified in paragraphs (i)(1) through (5) of §63.10010. The compliance limit will be expressed as a 30-boiler operating day rolling average of the numerical emissions limit value applicable for your unit in Table 2 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10010(i)]

154. Install and certify your PM CEMS according to the procedures and requirements in Performance Specification 11—Specifications and Test Procedures for Particulate Matter Continuous Emission Monitoring Systems at Stationary Sources in Appendix B to part 60 of Chapter I, using Method 5 at Appendix A-3 to part 60 of Chapter I and ensuring that the front half filter temperature shall be  $160^{\circ} \pm 14^{\circ} \text{C}$  ( $320^{\circ} \pm 25^{\circ} \text{F}$ ). The reportable measurement output from the PM CEMS must be expressed in units of the applicable emissions limit (e.g., lb/MMBtu). [Reg.19.304 and 40 C.F.R. § 63.10010(i)(1)]

155. Operate and maintain your PM CEMS according to the procedures and requirements in Procedure 2—Quality Assurance Requirements for Particulate Matter Continuous Emission Monitoring Systems at Stationary Sources in Appendix F to part 60 of Chapter I.

a. You must conduct the relative response audit (RRA) for your PM CEMS at least once annually.

b. You must conduct the relative correlation audit (RCA) for your PM CEMS at least once every 3 years.

[Reg.19.304 and 40 C.F.R. § 63.10010(i)(2)]

156. Collect PM CEMS hourly average output data for all boiler operating hours except as indicated in paragraph (i) of §63.10010. [Reg.19.304 and 40 C.F.R. § 63.10010(i)(3)]

157. Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average PM CEMS output data collected during all nonexempt boiler operating hours. [Reg.19.304 and 40 C.F.R. § 63.10010(i)(4)]

158. You must collect data using the PM CEMS at all times the process unit is operating and at the intervals specified in paragraph (a) of §63.10010, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, and required monitoring system quality assurance or quality control activities. [Reg.19.304 and 40 C.F.R. § 63.10010(i)(5)]

159. You must use all the data collected during all boiler operating hours in assessing the compliance with your operating limit except:

a. Any data collected during monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or control activities conducted during monitoring system malfunctions in calculations and report any such periods in your annual deviation report;



- b. Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is out of control, or required monitoring system quality assurance or control activities conducted during out of control periods in calculations used to report emissions or operating levels and report any such periods in your annual deviation report;
- c. Any data recorded during periods of startup or shutdown.

[Reg.19.304 and 40 C.F.R. § 63.10010(i)(5)(i)]

- 160. You must record and make available upon request results of PM CEMS system performance audits, dates and duration of periods when the PM CEMS is out of control to completion of the corrective actions necessary to return the PM CEMS to operation consistent with your site-specific monitoring plan. [Reg.19.304 and 40 C.F.R. § 63.10010(i)(5)(ii)]
- 161. You may choose to comply with the metal HAP emissions limits using CEMS approved in accordance with §63.7(f) as an alternative to the performance test method specified in this rule. If approved to use a HAP metals CEMS, the compliance limit will be expressed as a 30-boiler operating day rolling average of the numerical emissions limit value applicable for your unit in tables 1 or 2. If approved, you may choose to install, certify, operate, and maintain a HAP metals CEMS and record the output of the HAP metals CEMS as specified in paragraphs (j)(1) through (5) of §63.10010. [Reg.19.304 and 40 C.F.R. § 63.10010(j)]
- 162. Install and certify your HAP metals CEMS according to the procedures and requirements in your approved site-specific test plan as required in §63.7(e). The reportable measurement output from the HAP metals CEMS must be expressed in units of the applicable emissions limit ( e.g., lb/MMBtu, lb/MWh) and in the form of a 30-boiler operating day rolling average. [Reg.19.304 and 40 C.F.R. § 63.10010(j)(1)(i)]
- 163. Operate and maintain your HAP metals CEMS according to the procedures and criteria in your site specific performance evaluation and quality control program plan required in § 63.8(d). [Reg.19.304 and 40 C.F.R. § 63.10010(j)(1)(ii)]
- 164. Collect HAP metals CEMS hourly average output data for all boiler operating hours except as indicated in section (j)(4) of §63.10010. [Reg.19.304 and 40 C.F.R. § 63.10010(j)(2)]
- 165. Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average HAP metals CEMS output data collected during all nonexempt boiler operating hours data. [Reg.19.304 and 40 C.F.R. § 63.10010(j)(3)]
- 166. You must collect data using the HAP metals CEMS at all times the process unit is operating and at the intervals specified in paragraph (a) of §63.10010, except for periods

of monitoring system malfunctions, repairs associated with monitoring system malfunctions, and required monitoring system quality assurance or quality control activities.

- a. You must use all the data collected during all boiler operating hours in assessing the compliance with your emission limit except:
  - i. Any data collected during monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or control activities conducted during monitoring system malfunctions in calculations and report any such periods in your annual deviation report;
  - ii. Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is out of control, or required monitoring system quality assurance or control activities conducted during out of control periods in calculations used to report emissions or operating levels and report any such periods in your annual deviation report;
  - iii. Any data recorded during periods of startup or shutdown.
- b. You must record and make available upon request results of HAP metals CEMS system performance audits, dates and duration of periods when the HAP metals CEMS is out of control to completion of the corrective actions necessary to return the HAP metals CEMS to operation consistent with your site-specific performance evaluation and quality control program plan.

[Reg.19.304 and 40 C.F.R. § 63.10010(j)(4)]

#### Initial Compliance Demonstration

167. You must demonstrate initial compliance with each emissions limit that applies to you by conducting performance testing. [Reg.19.304 and 40 C.F.R. § 63.10011(a)]
168. If you are subject to an operating limit in Table 4 to 40 CFR Part 63, Subpart UUUUU, you demonstrate initial compliance filterable PM emission limit(s) through performance stack tests and you elect to use a PM CPMS to demonstrate continuous performance, you must also establish a site-specific operating limit, in accordance with Table 4 to 40 CFR Part 63, Subpart UUUUU, §63.10007, and Table 6 to 40 CFR Part 63, Subpart UUUUU. You may use only the parametric data recorded during successful performance tests (i.e., tests that demonstrate compliance with the applicable emissions limits) to establish an operating limit. [Reg.19.304 and 40 C.F.R. § 63.10011(b)]
169. If you use CEMS or sorbent trap monitoring systems to measure a HAP (e.g., Hg or HCl) directly, the first 30-boiler operating day rolling average emission rate obtained with

certified CEMS after the applicable date in §63.9984 (or, if applicable, prior to that date, as described in §63.10005(b)(2)), expressed in units of the standard, is the initial performance test. Initial compliance is demonstrated if the results of the performance test meet the applicable emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10011(c)(1)]

170. For a unit that uses a CEMS to measure SO<sub>2</sub> or PM emissions for initial compliance, the first 30 boiler operating day average emission rate obtained with certified CEMS after the applicable date in §63.9984 (or, if applicable, prior to that date, as described in §63.10005(b)(2)), expressed in units of the standard, is the initial performance test. Initial compliance is demonstrated if the results of the performance test meet the applicable SO<sub>2</sub> or filterable PM emission limit in Table 2 to 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10011(c)(2)]
171. For candidate LEE units, use the results of the performance testing described in §63.10005(h) to determine initial compliance with the applicable emission limit(s) in Table 1 or 2 to 40 CFR Part 63, Subpart UUUUU and to determine whether the unit qualifies for LEE status. [Reg.19.304 and 40 C.F.R. § 63.10011(d)]
172. You must submit a Notification of Compliance Status containing the results of the initial compliance demonstration, according to §63.10030(e). [Reg.19.304 and 40 C.F.R. § 63.10011(e)]
173. You must determine the fuel whose combustion produces the least uncontrolled emissions, i.e., the cleanest fuel, either natural gas or distillate oil, that is available on site or accessible nearby for use during periods of startup or shutdown. [Reg.19.304 and 40 C.F.R. § 63.10011(f)(1)]
174. Your cleanest fuel, either natural gas or distillate oil, for use during periods of startup or shutdown determination may take safety considerations into account. [Reg.19.304 and 40 C.F.R. § 63.10011(f)(2)]
175. You must follow the startup or shutdown requirements given in Table 3. [Reg.19.304 and 40 C.F.R. § 63.10011(g)]

#### Continuous Compliance Monitoring and Data Collection

176. You must monitor and collect data according to §63.10020 and the site-specific monitoring plan required by §63.10000(d). [Reg.19.304 and 40 C.F.R. § 63.10020(a)]
177. You must operate the monitoring system and collect data at all required intervals at all times that the affected EGU is operating, except for periods of monitoring system malfunctions or out-of-control periods (see §63.8(c)(7) of 40 CFR Part 63), and required monitoring system quality assurance or quality control activities, including, as applicable, calibration checks and required zero and span adjustments. You are required to affect

monitoring system repairs in response to monitoring system malfunctions and to return the monitoring system to operation as expeditiously as practicable. [Reg.19.304 and 40 C.F.R. § 63.10020(b)]

- 178. You may not use data recorded during EGU startup or shutdown or monitoring system malfunctions or monitoring system out-of-control periods, repairs associated with monitoring system malfunctions or monitoring system out-of-control periods, or required monitoring system quality assurance or control activities in calculations used to report emissions or operating levels. You must use all the data collected during all other periods in assessing the operation of the control device and associated control system. [Reg.19.304 and 40 C.F.R. § 63.10020(c)]
- 179. Except for periods of monitoring system malfunctions or monitoring system out-of-control periods, repairs associated with monitoring system malfunctions or monitoring system out-of-control periods, and required monitoring system quality assurance or quality control activities including, as applicable, calibration checks and required zero and span adjustments), failure to collect required data is a deviation from the monitoring requirements. [Reg.19.304 and 40 C.F.R. § 63.10020(d)]

#### Continuous Compliance Demonstration

- 180. You must demonstrate continuous compliance with each emissions limit, operating limit, and work practice standard in Tables 2 through 4 to 40 CFR Part 63, Subpart UUUUU that applies to you, according to the monitoring specified in Tables 6 and 7 to 40 CFR Part 63, Subpart UUUUU and paragraphs (b) through (g) of §63.10021. [Reg.19.304 and 40 C.F.R. § 63.10021(a)]
- 181. The permittee must show continuous compliance with the emission limitations for affected sources according to the following: [Reg.19.304 and 40 C.F.R. § 63, Subpart UUUUU Table 7]

| If you use one of the following to meet applicable emissions limits, operating limits, or work practice standards . . .   | You demonstrate continuous compliance by . . .                                                                                                                                                                                                                                                                                                                    |
|---------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CEMS to measure filterable PM, SO <sub>2</sub> , or Hg emissions, or using a sorbent trap monitoring system to measure Hg | Calculating the 30-boiler operating day rolling arithmetic average emissions rate in units of the applicable emissions standard basis at the end of each boiler operating day using all of the quality assured hourly average CEMS or sorbent trap data for the previous 30-boiler operating days, excluding data recorded during periods of startup or shutdown. |

|                                                                                                                                |                                                                                                                                                                                                                                                                                                                                      |
|--------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| If you use one of the following to meet applicable emissions limits, operating limits, or work practice standards . . .        | You demonstrate continuous compliance by . . .                                                                                                                                                                                                                                                                                       |
| PM CPMS to measure compliance with a parametric operating limit                                                                | Calculating the 30-boiler operating day rolling arithmetic average of all of the quality assured hourly average PM CPMS output data (e.g., milliamps, PM concentration, raw data signal) collected for all operating hours for the previous 30-boiler operating days, excluding data recorded during periods of startup or shutdown. |
| Quarterly performance testing for coal-fired EGUs to measure compliance with one or more applicable emissions limit in Table 2 | Calculating the results of the testing in units of the applicable emissions standard.                                                                                                                                                                                                                                                |
| Conducting periodic performance tune-ups of your EGU(s)                                                                        | Conducting periodic performance tune-ups of your EGU(s), as specified in §63.10021(e).                                                                                                                                                                                                                                               |
| Work practice standards for coal-fired EGUs during startup                                                                     | Operating in accordance with Table 3 of 40 CFR Part 63, Subpart UUUUU.                                                                                                                                                                                                                                                               |
| Work practice standards for coal-fired EGUs during shutdown                                                                    | Operating in accordance with Table 3 of 40 CFR Part 63, Subpart UUUUU.                                                                                                                                                                                                                                                               |

182. Except as otherwise provided in §63.10020(c), if you use a CEMS to measure SO<sub>2</sub>, PM, or Hg emissions, or using a sorbent trap monitoring system to measure Hg emissions, you must demonstrate continuous compliance by using all quality-assured hourly data recorded by the CEMS (or sorbent trap monitoring system) and the other required monitoring systems (e.g., flow rate, CO<sub>2</sub>, O<sub>2</sub>, or moisture systems) to calculate the arithmetic average emissions rate in units of the standard on a continuous 30-boiler operating day rolling average basis, updated at the end of each new boiler operating day. Use Equation 8 to determine the 30-boiler operating day rolling average.

$$\text{Boiler operating day average} = \frac{\sum_{i=1}^n \text{Her}_i}{n} \quad [\text{Equation 8}]$$

Where:

Her<sub>i</sub> is the hourly emissions rate for hour i and n is the number of hourly emissions rate values collected over 30-boiler operating days.

[Reg.19.304 and 40 C.F.R. § 63.10021(b)]

183. If you use a PM CPMS data to measure compliance with an operating limit in Table 4 to 40 CFR Part 63, Subpart UUUUU, you must record the PM CPMS output data for all periods when the process is operating and the PM CPMS is not out-of-control. You must demonstrate continuous compliance by using all quality-assured hourly average data collected by the PM CPMS for all operating hours to calculate the arithmetic average

operating parameter in units of the operating limit (e.g., milliamps, PM concentration, raw data signal) on a 30 operating day rolling average basis, updated at the end of each new boiler operating day. Use Equation 9 to determine the 30 boiler operating day average.

$$\text{30 boiler operating day average} = \frac{\sum_{i=1}^n \text{Hpv}_i}{n} \quad [\text{Equation 9}]$$

Where:

Hpv<sub>i</sub> is the hourly parameter value for hour i and n is the number of valid hourly parameter values collected over 30 boiler operating days.

[Reg.19.304 and 40 C.F.R. § 63.10021(c)]

184. For any exceedance of the 30-boiler operating day PM CPMS average value from the established operating parameter limit for an EGU subject to the emissions limits in Table 1 to 40 CFR Part 63, Subpart UUUUU, you must: [Reg.19.304 and 40 C.F.R. § 63.10021(c)(1)]
  - a. Within 48 hours of the exceedance, visually inspect the air pollution control device (APCD);
  - b. If the inspection of the APCD identifies the cause of the exceedance, take corrective action as soon as possible, and return the PM CPMS measurement to within the established value; and
  - c. Within 45 days of the exceedance or at the time of the annual compliance test, whichever comes first, conduct a PM emissions compliance test to determine compliance with the PM emissions limit and to verify or re-establish the CPMS operating limit. You are not required to conduct any additional testing for any exceedances that occur between the time of the original exceedance and the PM emissions compliance test required under §63.10021(c)(iii).
185. PM CPMS exceedances of the operating limit for an EGU subject to the emissions limits in Table 1 of 40 CFR Part 63, Subpart UUUUU leading to more than four required performance tests in a 12-month period (rolling monthly) constitute a separate violation of 40 CFR Part 63, Subpart UUUUU. [Reg.19.304 and 40 C.F.R. § 63.10021(c)(2)]
186. If you use quarterly performance testing to demonstrate compliance with one or more applicable emissions limits in Table 2 to 40 CFR Part 63, Subpart UUUUU, you:
  - a. May skip performance testing in those quarters during which less than 168 boiler operating hours occur, except that a performance test must be conducted at least once every calendar year.

- b. Must conduct the performance test as defined in Table 5 to 40 CFR Part 63, Subpart UUUUU and calculate the results of the testing in units of the applicable emissions standard.

[Reg.19.304 and 40 C.F.R. § 63.10021(d)]

187. If you must conduct periodic performance tune-ups of your EGU(s), as specified in paragraphs (e)(1) through (9) of §63.10021, perform the first tune-up as part of your initial compliance demonstration. Notwithstanding this requirement, you may delay the first burner inspection until the next scheduled unit outage provided you meet the requirements of §63.10005. Subsequently, you must perform an inspection of the burner at least once every 36 calendar months.
- a. As applicable, inspect the burner and combustion controls, and clean or replace any components of the burner or combustion controls as necessary upon initiation of the work practice program and at least once every required inspection period. Repair of a burner or combustion control component requiring special order parts may be scheduled as follows:
    - i. Burner or combustion control component parts needing replacement that affect the ability to optimize  $\text{NO}_x$  and CO must be installed within 3 calendar months after the burner inspection,
    - ii. Burner or combustion control component parts that do not affect the ability to optimize  $\text{NO}_x$  and CO may be installed on a schedule determined by the operator;
  - b. As applicable, inspect the flame pattern and make any adjustments to the burner or combustion controls necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available, or in accordance with best combustion engineering practice for that burner type;
  - c. As applicable, observe the damper operations as a function of mill and/or cyclone loadings, cyclone and pulverizer coal feeder loadings, or other pulverizer and coal mill performance parameters, making adjustments and effecting repair to dampers, controls, mills, pulverizers, cyclones, and sensors;
  - d. As applicable, evaluate windbox pressures and air proportions, making adjustments and effecting repair to dampers, actuators, controls, and sensors;
  - e. Inspect the system controlling the air-to-fuel ratio and ensure that it is correctly calibrated and functioning properly. Such inspection may include calibrating excess  $\text{O}_2$  probes and/or sensors, adjusting overfire air systems, changing software parameters, and calibrating associated actuators and dampers to ensure that the systems are operated as designed. Any component out of calibration, in or near failure, or in a state that is likely to negate combustion optimization efforts prior to the next tune-up, should be corrected or repaired as necessary;
  - f. Optimize combustion to minimize generation of CO and  $\text{NO}_x$ . This optimization should be consistent with the manufacturer's specifications, if available, or best

- combustion engineering practice for the applicable burner type. NO<sub>x</sub> optimization includes burners, overfire air controls, concentric firing system improvements, neural network or combustion efficiency software, control systems calibrations, adjusting combustion zone temperature profiles, and add-on controls such as SCR and SNCR; CO optimization includes burners, overfire air controls, concentric firing system improvements, neural network or combustion efficiency software, control systems calibrations, and adjusting combustion zone temperature profiles;
- g. While operating at full load or the predominantly operated load, measure the concentration in the effluent stream of CO and NO<sub>x</sub> in ppm, by volume, and oxygen in volume percent, before and after the tune-up adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). You may use portable CO, NO<sub>x</sub> and O<sub>2</sub> monitors for this measurement.
  - h. Maintain on-site and submit, if requested by the Administrator, an annual report containing the information in paragraphs (e)(1) through (e)(9) of §63.10021 including:
    - i. The concentrations of CO and NO<sub>x</sub> in the effluent stream in ppm by volume, and oxygen in volume percent, measured before and after an adjustment of the EGU combustion systems;
    - ii. A description of any corrective actions taken as a part of the combustion adjustment; and
    - iii. The type(s) and amount(s) of fuel used over the 12 calendar months prior to an adjustment, but only if the unit was physically and legally capable of using more than one type of fuel during that period.
  - i. Report the dates of the initial and subsequent tune-ups as follows:
    - i. If the first required tune-up is performed as part of the initial compliance demonstration, report the date of the tune-up in hard copy (as specified in §63.10030) and electronically (as specified in §63.10031). Report the date of each subsequent tune-up electronically (as specified in §63.10031).
    - ii. If the first tune-up is not conducted as part of the initial compliance demonstration, but is postponed until the next unit outage, report the date of that tune-up and all subsequent tune-ups electronically, in accordance with §63.10031.

[Reg.19.304 and 40 C.F.R. § 63.10021(e)]

188. You must submit the reports required under §63.10031 and, if applicable, the reports required under appendices A and B to 40 CFR Part 63, Subpart UUUUU. The electronic reports required by appendices A and B to 40 CFR Part 63, Subpart UUUUU must be sent to the Administrator electronically in a format prescribed by the Administrator, as provided in §63.10031. CEMS data (except for PM CEMS and any approved alternative monitoring using a HAP metals CEMS) shall be submitted using EPA's Emissions



Collection and Monitoring Plan System (ECMPS) Client Tool. Other data, including PM CEMS data, HAP metals CEMS data, and CEMS performance test detail reports, shall be submitted in the file format generated through use of EPA's Electronic Reporting Tool, the Compliance and Emissions Data Reporting Interface, or alternate electronic file format, all as provided for under §63.10031. [Reg.19.304 and 40 C.F.R. § 63.10021(f)]

189. The permittee must report each instance in which you did not meet an applicable emissions limit or operating limit in Tables 2 through 4 to 40 CFR Part 63, Subpart UUUUU or failed to conduct a required tune-up. These instances are deviations from the requirements of 40 CFR Part 63, Subpart UUUUU. These deviations must be reported according to §63.10031. [Reg.19.304 and 40 C.F.R. § 63.10021(g)]
190. The permittee must keep records as specified in §63.10032 during periods of startup and shutdown. [Reg.19.304 and 40 C.F.R. § 63.10021(h)]
191. The permittee must provide reports as specified in §63.10031 concerning activities and periods of startup and shutdown. [Reg.19.304 and 40 C.F.R. § 63.10021(i)]

#### PM CPMS Operating Limit and Compliance Determination

192. During the initial performance test or any such subsequent performance test that demonstrates compliance with the filterable PM in Table 2, record all hourly average output values (e.g., milliamps, stack concentration, or other raw data signal) from the PM CPMS for the periods corresponding to the test runs (e.g., nine 1-hour average PM CPMS output values for three 3-hour test runs). [Reg.19.304 and 40 C.F.R. § 63.10023(a)]
193. Determine your operating limit as the highest 1-hour average PM CPMS output value recorded during the performance test. You must verify an existing or establish a new operating limit after each repeated performance test. [Reg.19.304 and 40 C.F.R. § 63.10023(b)]
194. The permittee must operate and maintain your process and control equipment such that the 30 operating day average PM CPMS output does not exceed the operating limit determined in paragraphs (a) and (b) of §63.10023. [Reg.19.304 and 40 C.F.R. § 63.10023(c)]

#### Notifications

195. The permittee must submit all of the notifications in §§63.7(b) and (c), 63.8 (e), (f)(4) and (6), and 63.9 (b) through (h) that apply to you by the dates specified. [Reg.19.304 and 40 C.F.R. § 63.10030(a)]
196. As specified in §63.9(b)(2), if you startup your EGU that is an affected source before April 16, 2012, you must submit an Initial Notification not later than 120 days after April 16, 2012. [Reg.19.304 and 40 C.F.R. § 63.10030(b)]

197. As specified in §63.9(b)(4) and (b)(5), if you startup your new or reconstructed EGU that is an affected source on or after April 16, 2012, you must submit an Initial Notification not later than 15 days after the actual date of startup of the EGU that is an affected source. [Reg.19.304 and 40 C.F.R. § 63.10030(c)]
198. When you are required to conduct a performance test, you must submit a Notification of Intent to conduct a performance test at least 30 days before the performance test is scheduled to begin. [Reg.19.304 and 40 C.F.R. § 63.10030(d)]
199. When you are required to conduct an initial compliance demonstration as specified in §63.10011(a), you must submit a Notification of Compliance Status according to §63.9(h)(2)(ii). The Notification of Compliance Status report must contain all the information specified in paragraphs (e)(1) through (7) of §63.10030, as applicable.
  - a. A description of the affected source(s) including identification of which subcategory the source is in, the design capacity of the source, a description of the add-on controls used on the source, description of the fuel(s) burned, including whether the fuel(s) were determined by you or EPA through a petition process to be a non-waste under 40 CFR 241.3, whether the fuel(s) were processed from discarded non-hazardous secondary materials within the meaning of 40 CFR 241.3, and justification for the selection of fuel(s) burned during the performance test.
  - b. Summary of the results of all performance tests and fuel analyses and calculations conducted to demonstrate initial compliance including all established operating limits.
  - c. Identification of whether you plan to demonstrate compliance with each applicable emission limit through performance testing; fuel moisture analyses; performance testing with operating limits (e.g., use of PM CPMS); CEMS; or a sorbent trap monitoring system.
  - d. Identification of whether you plan to demonstrate compliance by emissions averaging.
  - e. A signed certification that you have met all applicable emission limits and work practice standards.
  - f. If you had a deviation from any emission limit, work practice standard, or operating limit, you must also submit a brief description of the deviation, the duration of the deviation, emissions point identification, and the cause of the deviation in the Notification of Compliance Status report.
  - g. In addition to the information required in §63.9(h)(2), your notification of compliance status must include the following:
    - i. A summary of the results of the annual performance tests and documentation of any operating limits that were reestablished during this test, if applicable.

- ii. Certifications of compliance, as applicable, and must be signed by a responsible official stating:
  - 1. “This EGU complies with the requirements in §63.10021(a) to demonstrate continuous compliance.” and
  - 2. “No secondary materials that are solid waste were combusted in any affected unit.”

[Reg.19.304 and 40 C.F.R. § 63.10030(e)]

### Reports

- 200. The permittee must submit each report in Table 8 to 40 CFR Part 63, Subpart UUUUU that applies to you. If you are required to (or elect to) continuously monitor Hg emissions, you must also submit the electronic reports required under appendix A and/or appendix B 40 CFR Part 63, Subpart UUUUU, at the specified frequency. [Reg.19.304 and 40 C.F.R. § 63.10031(a)]
- 201. The permittee must comply with the following requirements for reports: [Reg.19.304, and 40 C.F.R. § 63 Subpart UUUUU Table 8]

| You must submit a . . . | The report must contain . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | You must submit the report . . .                            |
|-------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| Compliance report       | a. Information required in §63.10031(c)(1) through (4); and<br>b. If there are no deviations from any emission limitation (emission limit and operating limit) that applies to you and there are no deviations from the requirements for work practice standards in Table 3 to 40 CFR Part 63, Subpart UUUUU that apply to you, a statement that there were no deviations from the emission limitations and work practice standards during the reporting period. If there were no periods during which the CMSs, including continuous emissions monitoring system, and operating parameter monitoring systems, were out-of-control as specified in §63.8(c)(7), a statement that there were no periods during which the CMSs were out-of-control during the reporting period; and<br>c. If you have a deviation from any emission limitation (emission limit and operating limit) or work practice standard during the reporting period, the report must contain the information in | Semiannually according to the requirements in §63.10031(b). |

| You must submit a . . . | The report must contain . . .                                                                                                                                                                                                                                       | You must submit the report . . . |
|-------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------|
|                         | §63.10031(d). If there were periods during which the CMSs, including continuous emissions monitoring systems and continuous parameter monitoring systems, were out-of-control, as specified in §63.8(c)(7), the report must contain the information in §63.10031(e) |                                  |

202. The permittee must submit each report by the date in Table 8 to 40 CFR Part 63, Subpart UUUUU and according to the requirements in paragraphs (b)(1) through (5) of §63.10031.

- a. The first compliance report must cover the period beginning on the compliance date that is specified for your affected source in §63.9984 and ending on June 30 or December 31, whichever date is the first date that occurs at least 180 days after the compliance date that is specified for your source in §63.9984.
- b. The first compliance report must be postmarked or submitted electronically no later than July 31 or January 31, whichever date is the first date following the end of the first calendar half after the compliance date that is specified for your source in §63.9984.
- c. Each subsequent compliance report must cover the semiannual reporting period from January 1 through June 30 or the semiannual reporting period from July 1 through December 31.
- d. Each subsequent compliance report must be postmarked or submitted electronically no later than July 31 or January 31, whichever date is the first date following the end of the semiannual reporting period.
- e. For each affected source that is subject to permitting regulations pursuant to part 70 or part 71 of Chapter I, and if the permitting authority has established dates for submitting semiannual reports pursuant to 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A), you may submit the first and subsequent compliance reports according to the dates the permitting authority has established instead of according to the dates in paragraphs (b)(1) through (4) of §63.10031.

[Reg.19.304 and 40 C.F.R. § 63.10031(b)]

203. The compliance report must contain the information required in paragraphs (c)(1) through (4) of §63.10031.

- a. The information required by the summary report located in 63.10(e)(3)(vi).
- b. The total fuel use by each affected source subject to an emission limit, for each calendar month within the semiannual reporting period, including, but not limited to, a description of the fuel, whether the fuel has received a non-waste

- determination by EPA or your basis for concluding that the fuel is not a waste, and the total fuel usage amount with units of measure.
- c. Indicate whether you burned new types of fuel during the reporting period. If you did burn new types of fuel you must include the date of the performance test where that fuel was in use.
  - d. Include the date of the most recent tune-up for each unit subject to the requirement to conduct a performance tune-up according to §63.10021(e). Include the date of the most recent burner inspection if it was not done every 36 (or 48) months and was delayed until the next scheduled unit shutdown.

[Reg.19.304 and 40 C.F.R. § 63.10031(c)]

204. For each excess emissions occurring at an affected source where you are using a CMS to comply with that emission limit or operating limit, you must include the information required in §63.10(e)(3)(v) in the compliance report specified in §63.10031(c).  
[Reg.19.304 and 40 C.F.R. § 63.10031(d)]
205. Each affected source that has obtained a Title V operating permit pursuant to part 70 or part 71 of Chapter I must report all deviations as defined in 40 CFR Part 63, Subpart UUUUU in the semiannual monitoring report required by 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A). If an affected source submits a compliance report pursuant to Table 8 to 40 CFR Part 63, Subpart UUUUU along with, or as part of, the semiannual monitoring report required by 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A), and the compliance report includes all required information concerning deviations from any emission limit, operating limit, or work practice requirement in 40 CFR Part 63, Subpart UUUUU, submission of the compliance report satisfies any obligation to report the same deviations in the semiannual monitoring report. Submission of a compliance report does not otherwise affect any obligation the affected source may have to report deviations from permit requirements to the permit authority. [Reg.19.304 and 40 C.F.R. § 63.10031(e)]
206. As of January 1, 2012, and within 60 days after the date of completing each performance test, you must submit the results of the performance tests required by 40 CFR Part 63, Subpart UUUUU to EPA's WebFIRE database by using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). Performance test data must be submitted in the file format generated through use of EPA's Electronic Reporting Tool (ERT) (see <http://www.epa.gov/ttn/chief/ert/index.html>). Only data collected using those test methods on the ERT Web site are subject to this requirement for submitting reports electronically to WebFIRE. Owners or operators who claim that some of the information being submitted for performance tests is confidential business information (CBI) must submit a complete ERT file including information claimed to be CBI on a compact disk or other commonly used electronic storage media (including, but not limited to, flash drives) to EPA. The electronic media must be clearly marked as CBI and mailed to U.S. EPA/OAPQS/CORE CBI Office, Attention: WebFIRE Administrator, MD C404-02,

4930 Old Page Rd., Durham, NC 27703. The same ERT file with the CBI omitted must be submitted to EPA via CDX as described earlier in this condition. At the discretion of the delegated authority, you must also submit these reports, including the confidential business information, to the delegated authority in the format specified by the delegated authority. [Reg.19.304 and 40 C.F.R. § 63.10031(f)]

207. Within 60 days after the date of completing each CEMS (SO<sub>2</sub>, PM, and Hg) performance evaluation test, as defined in §63.2 and required by 40 CFR Part 63, Subpart UUUUU , you must submit the relative accuracy test audit (RATA) data (or, for PM CEMS, RCA and RRA data) required by 40 CFR Part 63, Subpart UUUUU to EPA's WebFIRE database by using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). The RATA data shall be submitted in the file format generated through use of EPA's Electronic Reporting Tool (ERT) (<http://www.epa.gov/ttn/chief/ert/index.html>). Only RATA data compounds listed on the ERT Web site are subject to this requirement. Owners or operators who claim that some of the information being submitted for RATAs is confidential business information (CBI) shall submit a complete ERT file including information claimed to be CBI on a compact disk or other commonly used electronic storage media (including, but not limited to, flash drives) by registered letter to EPA and the same ERT file with the CBI omitted to EPA via CDX as described earlier in this condition. The compact disk or other commonly used electronic storage media shall be clearly marked as CBI and mailed to U.S. EPA/OAPQS/CORE CBI Office, Attention: WebFIRE Administrator, MD C404-02, 4930 Old Page Rd., Durham, NC 27703. At the discretion of the delegated authority, owners or operators shall also submit these RATAs to the delegated authority in the format specified by the delegated authority. Owners or operators shall submit calibration error testing, drift checks, and other information required in the performance evaluation as described in §63.2 and as required in Chapter I. [Reg.19.304 and 40 C.F.R. § 63.10031(f)(1)]
208. For a PM CEMS or PM CPMS within 60 days after the reporting periods ending on March 31st, June 30th, September 30th, and December 31st, you must submit quarterly reports to EPA's WebFIRE database by using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). You must use the appropriate electronic reporting form in CEDRI or provide an alternate electronic file consistent with EPA's reporting form output format. For each reporting period, the quarterly reports must include all of the calculated 30-boiler operating day rolling average values derived from the CEMS and PM CPMS. [Reg.19.304 and 40 C.F.R. § 63.10031(f)(2)]
209. Reports for an SO<sub>2</sub> CEMS, a Hg CEMS or sorbent trap monitoring system, and any supporting monitors for such systems (such as a diluent or moisture monitor) shall be submitted using the ECMPS Client Tool, as provided for in Appendices A and B to 40 CFR Part 63, Subpart UUUUU and §63.10021(f). [Reg.19.304 and 40 C.F.R. § 63.10031(f)(3)]

210. Submit the compliance reports required under paragraphs (c) and (d) of §63.10031 and the notification of compliance status required under §63.10030(e) to EPA's WebFIRE database by using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). You must use the appropriate electronic reporting form in CEDRI or provide an alternate electronic file consistent with EPA's reporting form output format. [Reg.19.304 and 40 C.F.R. § 63.10031(f)(4)]
211. All reports required by 40 CFR Part 63, Subpart UUUUU not subject to the requirements in paragraphs (f)(1) through (4) of §63.10031 must be sent to the Administrator at the appropriate address listed in §63.13. If acceptable to both the Administrator and the owner or operator of a source, these reports may be submitted on electronic media. The Administrator retains the right to require submittal of reports subject to paragraphs (f)(1), (2), and (3) of §63.10031 in paper format. [Reg.19.304 and 40 C.F.R. § 63.10031(f)(5)]
212. If you had a malfunction during the reporting period, the compliance report must include the number, duration, and a brief description for each type of malfunction which occurred during the reporting period and which caused or may have caused any applicable emission limitation to be exceeded. [Reg.19.304 and 40 C.F.R. § 63.10031(g)]

#### Records

213. The permittee must keep records according to paragraphs (a)(1) and (2) of §63.10032. If you are required to (or elect to) continuously monitor Hg emissions, you must also keep the records required under appendix A and/or appendix B to 40 CFR Part 63, Subpart UUUUU.
  - a. A copy of each notification and report that you submitted to comply with 40 CFR Part 63, Subpart UUUUU, including all documentation supporting any Initial Notification or Notification of Compliance Status or semiannual compliance report that you submitted, according to the requirements in §63.10(b)(2)(xiv).
  - b. Records of performance stack tests, fuel analyses, or other compliance demonstrations and performance evaluations, as required in §63.10(b)(2)(viii).[Reg.19.304 and 40 C.F.R. § 63.10032(a)]
214. For each CEMS and CPMS, you must keep records according to paragraphs (b)(1) through (4) of §63.10032.
  - a. Records described in §63.10(b)(2)(vi) through (xi).
  - b. Previous (*i.e.*, superseded) versions of the performance evaluation plan as required in §63.8(d)(3).
  - c. Request for alternatives to relative accuracy test for CEMS as required in §63.8(f)(6)(i).

- d. Records of the date and time that each deviation started and stopped, and whether the deviation occurred during a period of startup, shutdown, or malfunction or during another period.

[Reg.19.304 and 40 C.F.R. § 63.10032(b)]

215. You must keep the records required in Table 7 to 40 CFR Part 63, Subpart UUUUU including records of all monitoring data and calculated averages for applicable PM CPMS operating limits to show continuous compliance with each emission limit and operating limit that applies to you. [Reg.19.304 and 40 C.F.R. § 63.10032(c)]

216. For each EGU subject to an emission limit, you must also keep the records in paragraphs (d)(1) through (3) of §63.10032.

- a. You must keep records of monthly fuel use by each EGU, including the type(s) of fuel and amount(s) used.
- b. If you combust non-hazardous secondary materials that have been determined not to be solid waste pursuant to 40 CFR 241.3(b)(1), you must keep a record which documents how the secondary material meets each of the legitimacy criteria. If you combust a fuel that has been processed from a discarded non-hazardous secondary material pursuant to 40 CFR 241.3(b)(2), you must keep records as to how the operations that produced the fuel satisfies the definition of processing in 40 CFR 241.2. If the fuel received a non-waste determination pursuant to the petition process submitted under 40 CFR 241.3(c), you must keep a record which documents how the fuel satisfies the requirements of the petition process.
- c. For an EGU that qualifies as an LEE under §63.10005(h), you must keep annual records that document that your emissions in the previous stack test(s) continue to qualify the unit for LEE status for an applicable pollutant, and document that there was no change in source operations including fuel composition and operation of air pollution control equipment that would cause emissions of the pollutant to increase within the past year.

[Reg.19.304 and 40 C.F.R. § 63.10032(d)]

217. You must keep records of the occurrence and duration of each startup and/or shutdown. [Reg.19.304 and 40 C.F.R. § 63.10032(f)]

218. You must keep records of the occurrence and duration of each malfunction of an operation (*i.e.*, process equipment) or the air pollution control and monitoring equipment. [Reg.19.304 and 40 C.F.R. § 63.10032(g)]

219. You must keep records of actions taken during periods of malfunction to minimize emissions in accordance with §63.10000(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [Reg.19.304 and 40 C.F.R. § 63.10032(h)]



American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

220. You must keep records of the type(s) and amount(s) of fuel used during each startup or shutdown. [Reg.19.304 and 40 C.F.R. § 63.10032(i)]
221. Your records must be in a form suitable and readily available for expeditious review, according to §63.10(b)(1). [Reg.19.304 and 40 C.F.R. § 63.10033(a)]
222. As specified in §63.10(b)(1), you must keep each record for 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record. [Reg.19.304 and 40 C.F.R. § 63.10033(b)]
223. You must keep each record on site for at least 2 years after the date of each occurrence, measurement, maintenance, corrective action, report, or record, according to §63.10(b)(1). You can keep the records off site for the remaining 3 years. [Reg.19.304 and 40 C.F.R. § 63.10033(c)]

#### Applicable General Provisions

224. Table 9 to 40 CFR Part 63, Subpart UUUUU shows which parts of the General Provisions in §63.1 through §63.15 apply to you. [Reg.19.304 and 40 C.F.R. § 63.10040]

SN-02  
 Auxiliary Boiler

Source Description

A natural gas-fired auxiliary boiler (555 MMBtu/hr) is used during startup, shutdown, and maintenance of the PC boiler.

Specific Conditions

225. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 230, 231, 232, and 234. [Reg.19.304 , Reg.19.901, and 40 C.F.R. § 52 Subpart E]

| Pollutant        | lb/hr    | tpy      |
|------------------|----------|----------|
| PM <sub>10</sub> | 4.3      | 1.1      |
| SO <sub>2</sub>  | 0.4      | 0.1      |
| VOC              | 3.1      | 0.8      |
| CO               | 166.5    | 41.6     |
| NO <sub>x</sub>  | 61.1     | 15.3     |
| Lead*            | 2.72E-04 | 6.80E-05 |

\* Included in PM<sub>10</sub> Emissions

226. The permittee shall not exceed the emission rates set forth in the following tables.
- a. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 230, 232, and 234. [Reg.18.801, Reg. 19.304 , Reg.19.901, 40 C.F.R. § 52 Subpart E, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant | lb/hr | tpy |
|-----------|-------|-----|
| PM        | 4.3   | 1.1 |

- b. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 232 and 234. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant         | lb/hr   | tpy      |
|-------------------|---------|----------|
| Mercury           | 0.00014 | 0.000035 |
| Total Other HAPs* | 1.03    | 0.26     |

\* Included in either PM or VOC emissions

227. The permittee shall not discharge into the atmosphere from SN-02 gases which exhibit an opacity greater than 10% (6-minute average) as measured using EPA Reference Method 9. Compliance shall be demonstrated through compliance with Specific Condition 234. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]
228. The permittee shall not exceed the BACT emission limits set forth in the following table. Compliance shall be demonstrated through compliance with Specific Conditions 230 and 234. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]

| <i>Pollutant</i>    | <i>BACT Limit</i>                                          | <i>Averaging Time</i> |
|---------------------|------------------------------------------------------------|-----------------------|
| PM/PM <sub>10</sub> | 0.0076 lb/MMBtu                                            | 3-hour                |
| SO <sub>2</sub>     | 0.0006 lb/MMBtu                                            | 3-hour                |
| VOC                 | 0.0055 lb/MMBtu                                            | 3-hour                |
| CO                  | 400 ppm <sub>vd</sub><br>at 3% O <sub>2</sub> <sup>a</sup> | 30-day rolling        |
| NO <sub>x</sub>     | 0.11 lb/MMBtu                                              | 30-day rolling        |
| Pb                  | N/A                                                        | N/A                   |

<sup>a</sup> CO rate based on BACT limit of 0.30 lb/MMBtu

229. Reserved.
230. The permittee shall conduct an initial test at SN-02 to determine lb/hr and lb/MMBtu emission rates for PM<sub>10</sub> (total) and CO. This testing shall be performed in accordance with Plantwide Condition 3. Testing shall be performed in accordance with the methods listed in the following table or a Department approved alternative. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.19.702 and 40 C.F.R. § 52 Subpart E]

| Pollutant        | EPA Reference Method |
|------------------|----------------------|
| PM <sub>10</sub> | 5 and 202            |
| CO               | 10                   |

231. The permittee shall conduct an initial test at SN-02 to determine the lb/hr and lb/MMBtu emission rate for NO<sub>x</sub>. If this test demonstrates that the facility is in compliance with the permitted NO<sub>x</sub> emission rate, then the facility shall perform stack testing once every five years. If at any time the facility fails a test, then the facility must conduct two successive annual tests before returning to testing once every five years. The facility shall test within 60 days of any failing test. Testing shall be performed in accordance with Plantwide Condition 3. Testing shall be performed in accordance with EPA Reference Method 7E, or a Department approved alternative. Testing shall be conducted with the source operating at least at 90% of its permitted capacity. Emission testing results shall be extrapolated to correlate with 100% of the permitted capacity to demonstrate compliance. Failure to test within this range shall limit the permittee to operating within 10% above the tested rate. A copy of these test results shall be submitted in accordance with General Provision 7. [Reg.19.702 and 40 C.F.R. § 52 Subpart E]
232. The auxiliary boiler, SN-02, shall not be operated in excess of 272.1 MMscf of natural gas during any consecutive 12 month period. Compliance with this condition will be demonstrated by the operational records maintained pursuant to Specific Condition 233. [Reg.19.901, Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. § 8-4-304, and 40 C.F.R. § 70.6]
233. The permittee shall maintain monthly records of the fuel used in the auxiliary boiler, SN-02. These records shall include the fuel used each month and the fuel used in the previous consecutive 12 month period. These records shall be updated by the 15th day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]
234. The permittee shall only combust natural gas as fuel in the auxiliary boiler, SN-02. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]
235. SN-02 is considered an affected source under 40 CFR Part 60, Subpart Db - *Standards of Performance for Industrial-Commercial-Institutional Steam Generating Units*, and is subject, but not limited to, Specific Conditions 236 through 242. [Reg.19.304 and 40 C.F.R. § 60 Subpart Db]
236. Units firing only very low sulfur oil, gaseous fuel, a mixture of these fuels, or a mixture of these fuels with any other fuels with a potential SO<sub>2</sub> emission rate of 140 ng/J (0.32 lb/MMBtu) heat input or less are exempt from the SO<sub>2</sub> emissions limit in paragraph (k)(1) of §60.42b. [40 C.F.R. § 60.42b(k)(2)]
237. On and after the date on which the initial performance test is completed or is required to be completed under 60.8, whichever date is first, no owner or operator of an affected facility that commenced construction after July 9, 1997 shall cause to be discharged into

- the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the following limits:
- a. 86 ng/J (0.20 lb/MMBtu) heat input if the affected facility combusts coal, oil, or natural gas (or any combination of the three), alone or with any other fuels. The affected facility is not subject to this limit if it is subject to and in compliance with a federally enforceable requirement that limits operation of the facility to an annual capacity factor of 10 percent (0.10) or less for coal, oil, and natural gas (or any combination of the three). [40 C.F.R. § 60.44b(l)]
238. The owner or operator of an affected facility that only combusts very low sulfur oil, natural gas, or a mixture of these fuels with any other fuels not subject to an SO<sub>2</sub> standard is not subject to the compliance and performance testing requirements of §60.45b if the owner or operator obtains fuel receipts as described in §60.49b(r). [40 C.F.R. § 60.45b(j)]
239. The owner or operator of each affected facility shall submit notification of the date of initial startup, as provided by §60.7. This notification shall include:
- a. The design heat input capacity of the affected facility and identification of the fuels to be combusted in the affected facility;
  - b. If applicable, a copy of any federally enforceable requirement that limits the annual capacity factor for any fuel or mixture of fuels under §§60.42b(d)(1), 60.43b(a)(2), (a)(3)(iii), (c)(2)(ii), (d)(2)(iii), 60.44b(c), (d), (e), (i), (j), (k), 60.45b(d), (g), 60.46b(h), or 60.48b(i);
  - c. The annual capacity factor at which the owner or operator anticipates operating the facility based on all fuels fired and based on each individual fuel fired; and
  - d. Notification that an emerging technology will be used for controlling emissions of SO<sub>2</sub>. The Administrator will examine the description of the emerging technology and will determine whether the technology qualifies as an emerging technology. In making this determination, the Administrator may require the owner or operator of the affected facility to submit additional information concerning the control device. The affected facility is subject to the provisions of §60.42b(a) unless and until this determination is made by the Administrator. [40 C.F.R. § 60.49b(a)]
240. As an alternative to meeting the requirements of paragraph (d)(1) of §60.49b, the owner or operator of an affected facility that is subject to a federally enforceable permit restricting fuel use to a single fuel such that the facility is not required to continuously monitor any emissions (excluding opacity) or parameters indicative of emissions may elect to record and maintain records of the amount of each fuel combusted during each calendar month. [40 C.F.R. § 60.49b(d)(2)]
241. All records required under §60.49b shall be maintained by the owner or operator of the affected facility for a period of 2 years following the date of such record. [40 C.F.R. § 60.49b(o)]

242. The owner or operator of an affected facility who elects to use the fuel based compliance alternatives in §60.42b or §60.43b shall either:
- a. The owner or operator of an affected facility who elects to demonstrate that the affected facility combusts only very low sulfur oil, natural gas, wood, a mixture of these fuels, or any of these fuels (or a mixture of these fuels) in combination with other fuels that are known to contain an insignificant amount of sulfur in §60.42b(j) or §60.42b(k) shall obtain and maintain at the affected facility fuel receipts (such as a current, valid purchase contract, tariff sheet, or transportation contract) from the fuel supplier that certify that the oil meets the definition of distillate oil and gaseous fuel meets the definition of natural gas as defined in §60.41b and the applicable sulfur limit. For the purposes of §60.49b, the distillate oil need not meet the fuel nitrogen content specification in the definition of distillate oil. Reports shall be submitted to the Administrator certifying that only very low sulfur oil meeting this definition, natural gas, wood, and/or other fuels that are known to contain insignificant amounts of sulfur were combusted in the affected facility during the reporting period; or
  - b. The owner or operator of an affected facility who elects to demonstrate compliance based on fuel analysis in §60.42b or §60.43b shall develop and submit a site-specific fuel analysis plan to the Administrator for review and approval no later than 60 days before the date you intend to demonstrate compliance. Each fuel analysis plan shall include a minimum initial requirement of weekly testing and each analysis report shall contain, at a minimum, the following information:
    - i. The potential sulfur emissions rate of the representative fuel mixture in ng/J heat input;
    - ii. The method used to determine the potential sulfur emissions rate of each constituent of the mixture. For distillate oil and natural gas a fuel receipt or tariff sheet is acceptable;
    - iii. The ratio of different fuels in the mixture; and
    - iv. The owner or operator can petition the Administrator to approve monthly or quarterly sampling in place of weekly sampling. [40 C.F.R. § 60.49b(r)]

### Boiler MACT Requirements

243. SN-02 is considered an affected source under 40 CFR Part 63, Subpart DDDDD - *National Emission Standards for Hazardous Air Pollutants for Major Sources: Industrial, Commercial, and Institutional Boilers and Process Heaters*, and is subject, but not limited to, Specific Conditions 244 through 250. [Reg.19.304 and 40 C.F.R. § 63 Subpart DDDDD]
244. If you have an existing boiler or process heater, you must comply with 40 CFR Part 63, Subpart DDDDD no later than January 31, 2016, except as provided in §63.6(i). [40 C.F.R. § 63.7495(b)]

245. If you own or operate an existing EGU that becomes subject to this subpart after January 31, 2013, you must be in compliance with the applicable existing source provisions of this subpart on the effective date such unit becomes subject to this subpart. [40 C.F.R. § 63.7495(f)]
246. You must meet the requirements in paragraphs (a)(1) through (3) of §63.7500, except as provided in paragraphs (b), through (e) of §63.7500. You must meet these requirements at all times the affected unit is operating, except as provided in paragraph (f) of §63.7500. [40 C.F.R. § 63.7500(a)]
247. At all times, you must operate and maintain any affected source (as defined in §63.7490), including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source. [40 C.F.R. § 63.7500(a)(3)]
248. Limited-use boilers and process heaters must complete a tune-up every 5 years as specified in §63.7540. They are not subject to the emission limits in Tables 1 and 2 or 11 through 13 to 40 CFR Part 63, Subpart DDDDD, the annual tune-up, or the energy assessment requirements in Table 3 to 40 CFR Part 63, Subpart DDDDD, or the operating limits in Table 4 to 40 CFR Part 63, Subpart DDDDD. [40 C.F.R. § 63.7500(c)]
249. For each unit that meets the definition of limited-use boiler or process heater, you must keep fuel use records for the days the boiler or process heater was operating. [40 C.F.R. § 63.7525(k)]
250. As specified in § 63.9(b)(2), if you startup your affected source before January 31, 2013, you must submit an Initial Notification not later than 120 days after January 31, 2013. [40 C.F.R. § 63.7545(b)]

SN-03  
 Emergency Diesel Generator

Source Description

A 1.352 MWh, 2220 Hp (nameplate) diesel-fired emergency generator is used to supply power during outages.

Specific Conditions

251. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Condition 269. [Reg.19.304, Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| Pollutant        | lb/hr | tpy |
|------------------|-------|-----|
| PM <sub>10</sub> | 0.6   | 0.2 |
| SO <sub>2</sub>  | 0.1   | 0.1 |
| VOC              | 1.2   | 0.3 |
| CO               | 10.5  | 2.7 |
| NO <sub>x</sub>  | 19.1  | 4.8 |

252. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Condition 269. [Reg.18.801, Reg.19.304, Reg.19.901, 40 C.F.R. § 52 Subpart E, 40 C.F.R. § 63.43, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant     | lb/hr | tpy  |
|---------------|-------|------|
| PM            | 0.6   | 0.2  |
| 1,3-Butadiene | 0.01  | 0.01 |
| Acetaldehyde  | 0.01  | 0.01 |
| Acrolein      | 0.01  | 0.01 |
| Benzene       | 0.02  | 0.01 |
| Formaldehyde  | 0.01  | 0.01 |
| POM           | 0.01  | 0.01 |
| Toluene       | 0.01  | 0.01 |
| Xylene        | 0.01  | 0.01 |



253. This source shall not be operated in excess of 500 hours during any consecutive 12 month period. Compliance with this condition shall be demonstrated by the operational records maintained pursuant to Specific Condition 254. [Reg.19.901, Ark. Code Ann. § 8-4-203 as referenced by A.C.A. § 8-4-304, and 40 C.F.R. § 70.6]
254. The permittee shall maintain monthly records of the hours of operation of this source. These records shall include the hours of operation each month and the hours operated in the previous consecutive 12 month period. These records shall be updated by the 15<sup>th</sup> day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]
255. SN-03 is considered an affected source under 40 CFR 63, Subpart ZZZZ - *National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines*, and is subject, but not limited to, Specific Conditions 256 through 258. [Reg.19.304 and 40 C.F.R. § 63 Subpart ZZZZ]
256. An affected source which meets either of the criteria in paragraphs (b)(1)(i) through (ii) of §63.6590 does not have to meet the requirements of 40 CFR Part 63, Subpart ZZZZ and of subpart A of 40 CFR Part 63 except for the initial notification requirements of §63.6645(f).
- a. The stationary RICE is a new or reconstructed emergency stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions. [40 C.F.R. § 63.6590(b)(1)]
257. If you start up your new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions on or after August 16, 2004, you must submit an Initial Notification not later than 120 days after you become subject to 40 CFR Part 63, Subpart ZZZZ. [40 C.F.R. § 63.6645(c)]
258. If you are required to submit an Initial Notification but are otherwise not affected by the requirements of 40 CFR Part 63, Subpart ZZZZ, in accordance with §63.6590(b), your notification should include the information in §63.9(b)(2)(i) through (v), and a statement that your stationary RICE has no additional requirements and explain the basis of the exclusion (for example, that it operates exclusively as an emergency stationary RICE if it has a site rating of more than 500 brake HP located at a major source of HAP emissions). [40 C.F.R. § 63.6645(f)]
259. SN-03 is considered an affected source under 40 CFR 60, Subpart IIII - *Standards of Performance for Stationary Compression Ignition Internal Combustion Engines*, and is subject, but not limited to, Specific Conditions 260 through 268. [Reg.19.304 and 40 C.F.R. § 60 Subpart IIII]

260. Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of §60.4202.
  - a. For engines with a maximum engine power greater than or equal to 37 KW (50 HP), the certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants beginning in model year 2007. [40 C.F.R. § 60.4202(a)(2)]
261. Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in §60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE. [40 C.F.R. § 60.4205(b)]
262. Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §60.4204 and §60.4205 over the entire life of the engine. [40 C.F.R. § 60.4206]
263. Beginning October 1, 2010, owners and operators of stationary CI ICE subject to 40 CFR Part 60, Subpart IIII with a displacement of less than 30 liters per cylinder that use diesel fuel must purchase diesel fuel that meets the requirements of 40 CFR 80.510(b) for nonroad diesel fuel. [40 C.F.R. § 60.4207(b)]
264. If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine. [40 C.F.R. § 60.4209(a)]
265. If you are an owner or operator and must comply with the emission standards specified in 40 CFR Part 60, Subpart IIII, you must do all of the following, except as permitted under paragraph (g) of this §60.4211:
  - a. Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;
  - b. Change only those emission-related settings that are permitted by the manufacturer; and
  - c. Meet the requirements of 40 CFR Parts 89, 94 and/or 1068, as they apply to you. [40 C.F.R. § 60.4211(a)]
266. If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(b) or §60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine

power rating in table 3 to 40 CFR Part 60, Subpart III and must comply with the emission standards specified in §60.4205(c), you must comply by purchasing an engine certified to the emission standards in §60.4204(b), or §60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this §60.4211. [40 C.F.R. § 60.4211(c)]

267. Emergency stationary ICE may be operated for the purpose of maintenance checks and readiness testing, provided that the tests are recommended by Federal, State or local government, the manufacturer, the vendor, or the insurance company associated with the engine. Maintenance checks and readiness testing of such units is limited to 100 hours per year. There is no time limit on the use of emergency stationary ICE in emergency situations. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that Federal, State, or local standards require maintenance and testing of emergency ICE beyond 100 hours per year. Emergency stationary ICE may operate up to 50 hours per year in non-emergency situations, but those 50 hours are counted towards the 100 hours per year provided for maintenance and testing. The 50 hours per year for non-emergency situations cannot be used for peak shaving or to generate income for a facility to supply power to an electric grid or otherwise supply non-emergency power as part of a financial arrangement with another entity. For owners and operators of emergency engines, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as permitted in §60.4211, is prohibited. [40 C.F.R. § 60.4211(f)]
268. If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to 40 CFR Part 60, Subpart III, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time. [40 C.F.R. § 60.4214(b)]
269. The permittee shall comply with the following emission rates for this source. [Reg.19.901, 40 C.F.R. § 52 Subpart E, 40 C.F.R. § 60.4202(a)(2), and 40 C.F.R. §§ 89.112 and 89.113]

| Pollutant | Emission Limit |
|-----------|----------------|
| PM        | 0.20 g/kWh     |
| CO        | 3.5 g/kWh      |

| Pollutant       | Emission Limit                                                                                                      |
|-----------------|---------------------------------------------------------------------------------------------------------------------|
| NO <sub>x</sub> | 6.4 g/kWh                                                                                                           |
| NMHC            | 6.4 g/kWh                                                                                                           |
| Opacity         | 20% in acceleration mode<br>15% in Lugging mode<br>50% during peaks (as measured according to 40 CFR 86, Subpart I) |

270. The permittee shall conduct a onetime visible emissions observation as a method of compliance verification for the opacity limit assigned for this source. This observation shall be conducted by someone trained in EPA Reference Method 9. This observation shall be performed in accordance with Plantwide Condition 3.
- a. If during the observations, visible emissions are detected which appear to be in excess of the permitted opacity limit, the permittee shall:
    - i. Take immediate action to identify the cause of the visible emissions,
    - ii. Implement corrective action, and
    - iii. If excessive visible emissions are still detected, an opacity reading shall be conducted in accordance with EPA Reference Method 9. This reading shall be conducted by a person trained and certified in the reference method. If the opacity reading exceeds the permitted limit, further corrective measures shall be taken.
    - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
  
  - b. The permittee shall maintain records related to all visible emission observations and Method 9 readings. These records shall be updated on an as-performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:
    - i. The time and date of each observation/reading,
    - ii. The results of the observations,
    - iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
    - iv. The name of the person conducting the observation/reading.

[Reg.19.705 and 40 C.F.R. § 52 Subpart E]

SN-04  
 Fire Pump Diesel Engine

Source Description

One small 460 Hp (nameplate) diesel-fired engine is used to pump water needed for fire suppression.

Specific Conditions

271. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 275 and 277. [Reg.19.304 , Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| Pollutant        | lb/hr | tpy |
|------------------|-------|-----|
| PM <sub>10</sub> | 0.2   | 0.1 |
| SO <sub>2</sub>  | 0.1   | 0.1 |
| VOC              | 1.2   | 0.1 |
| CO               | 2.7   | 0.2 |
| NO <sub>x</sub>  | 3.1   | 0.2 |

272. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 275 and 277. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant     | lb/hr | tpy  |
|---------------|-------|------|
| PM            | 0.2   | 0.1  |
| 1,3-Butadiene | 0.01  | 0.01 |
| Acetaldehyde  | 0.01  | 0.01 |
| Acrolein      | 0.01  | 0.01 |
| Benzene       | 0.01  | 0.01 |
| Formaldehyde  | 0.01  | 0.01 |
| POM           | 0.01  | 0.01 |
| Toluene       | 0.01  | 0.01 |
| Xylene        | 0.01  | 0.01 |

273. The permittee shall not operate the fire pump diesel engine (SN-04) for more than 100 hours during any consecutive 12-month period. Compliance shall be demonstrated

- through compliance with Specific Condition 274. [Reg.18.1004, Reg.19.705, 40 C.F.R. § 70.6, and Ark. Code Ann. § 8-4-203 as referenced by §§ 8-4-304 and 8-4-311]
274. The permittee shall maintain monthly records of the hours of operation of SN-04. These records shall include the hours of operation each month and the hours operated in the previous consecutive 12-month period. These records shall be updated by the 15<sup>th</sup> day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]
275. SN-04 is considered an affected source under 40 CFR 63, Subpart ZZZZ - *National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines*, and is subject, but not limited to, Specific Condition 276. [Reg.19.304 and 40 C.F.R. § 63 Subpart ZZZZ]
276. An affected source that meets any of the criteria in paragraphs (c)(1) through (7) of §63.6590 must meet the requirements of this part by meeting the requirements of 40 CFR part 60 subpart IIII, for compression ignition engines or 40 CFR part 60 subpart JJJJ, for spark ignition engines. No further requirements apply for such engines under this part.
- a. A new or reconstructed emergency or limited use stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions. [40 C.F.R. § 63.6590(c)(6)]
277. SN-04 is considered an affected source under 40 CFR 60, Subpart IIII - *Standards of Performance for Stationary Compression Ignition Internal Combustion Engines*, and is subject, but not limited to, Specific Conditions 278 through 286. [Reg.19.304 and 40 C.F.R. § 60 Subpart IIII]
278. Owners and operators of fire pump engines with a displacement of less than 30 liters per cylinder must comply with the emission standards in table 4 to 40 CFR Part 60, Subpart IIII, for all pollutants. [40 C.F.R. § 60.4205(c)]
279. Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §60.4204 and §60.4205 over the entire life of the engine. [40 C.F.R. § 60.4206]
280. Beginning October 1, 2010, owners and operators of stationary CI ICE subject to 40 CFR Part 60, Subpart IIII with a displacement of less than 30 liters per cylinder that use diesel fuel must purchase diesel fuel that meets the requirements of 40 CFR 80.510(b) for nonroad diesel fuel. [40 C.F.R. § 60.4207(b)]

281. If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine. [40 C.F.R. § 60.4209(a)]
282. If you are an owner or operator and must comply with the emission standards specified in 40 CFR Part 60, Subpart IIII, you must do all of the following, except as permitted under paragraph (g) of this §60.4211:
- a. Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;
  - b. Change only those emission-related settings that are permitted by the manufacturer; and
  - c. Meet the requirements of 40 CFR Parts 89, 94 and/or 1068, as they apply to you. [40 C.F.R. § 60.4211(a)]
283. If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(b) or §60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to 40 CFR Part 60, Subpart IIII and must comply with the emission standards specified in §60.4205(c), you must comply by purchasing an engine certified to the emission standards in §60.4204(b), or §60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this §60.4211. [40 C.F.R. § 60.4211(c)]
284. Emergency stationary ICE may be operated for the purpose of maintenance checks and readiness testing, provided that the tests are recommended by Federal, State or local government, the manufacturer, the vendor, or the insurance company associated with the engine. Maintenance checks and readiness testing of such units is limited to 100 hours per year. There is no time limit on the use of emergency stationary ICE in emergency situations. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that Federal, State, or local standards require maintenance and testing of emergency ICE beyond 100 hours per year. Emergency stationary ICE may operate up to 50 hours per year in non-emergency situations, but those 50 hours are counted towards the 100 hours per year provided for maintenance and testing. The 50 hours per year for non-emergency situations cannot be used for peak shaving or to generate income for a facility to supply power to an electric grid or otherwise supply non-emergency power as part of a financial arrangement with another entity. For owners and operators of emergency engines, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as permitted in §60.4211, is prohibited. [40 C.F.R. § 60.4211(f)]

285. If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to 40 CFR Part 60, Subpart IIII, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time. [40 C.F.R. § 60.4214(b)]
286. The permittee shall comply with the following emission rates for this source. [Reg.19.304, 40 C.F.R. § 60.4202(a)(2), and 40 C.F.R. §§ 89.112 and 89.113]

| Pollutant       | Emission Limit |
|-----------------|----------------|
| PM              | 0.20 g/kWh     |
| NO <sub>x</sub> | 4.0 g/kWh      |
| NMHC            | 4.0 g/kWh      |

287. The opacity from this source shall not exceed 20%. Compliance with the opacity standard shall be demonstrated through compliance with Specific Condition 288. [Reg.19.503 and 40 C.F.R. Part 52 Subpart E]
288. The permittee shall conduct a onetime visible emissions observation as a method of compliance verification for the opacity limit assigned for this source. This observation shall be conducted by someone trained in EPA Reference Method 9. This observation shall be performed in accordance with Plantwide Condition 3.
- a. If during the observations, visible emissions are detected which appear to be in excess of the permitted opacity limit, the permittee shall:
    - i. Take immediate action to identify the cause of the visible emissions,
    - ii. Implement corrective action, and
    - iii. If excessive visible emissions are still detected, an opacity reading shall be conducted in accordance with EPA Reference Method 9. This reading shall be conducted by a person trained and certified in the reference method. If the opacity reading exceeds the permitted limit, further corrective measures shall be taken.
    - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
  - b. The permittee shall maintain records related to all visible emission observations and Method 9 readings. These records shall be updated on an as-



American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:

- i. The time and date of each observation/reading,
- ii. The results of the observations,
- iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
- iv. The name of the person conducting the observation/reading.

[Reg.19.705 and 40 C.F.R. § 52 Subpart E]

SN-EP-01 through EP-10, EP-12, TP-16, and TP-20  
 Coal Handling

Source Description

Coal is moved throughout the facility using a series of drops and conveyors.

Specific Conditions

289. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design operating capacity of the equipment. [Reg.19.304 , Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| SN    | Description                                   | Pollutant                      | lb/hr | tpy |
|-------|-----------------------------------------------|--------------------------------|-------|-----|
| EP-01 | Rotary Car Dumper Building                    | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-02 | Coal Dumper Tunnel Exhaust Fan                | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-03 | Head House on Lowering Well 1                 | PM <sub>10</sub>               | 0.1   | 0.5 |
| EP-04 | Head House on Lowering Well 2                 | PM <sub>10</sub>               | 0.1   | 0.5 |
| EP-05 | Reclaim Tunnel Exhaust Fans (x5)              | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-06 | Central Transfer House Exhaust Fans (x2)      | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-07 | Crusher House Exhaust Fans (x2)               | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-08 | Plant Transfer House Exhaust Fans (x2)        | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-09 | Tripper House Exhaust Fans (x2)               | PM <sub>10</sub>               | 0.1   | 0.1 |
| EP-10 | Coal Silo Wet Scrubber                        | PM <sub>10</sub>               | 1.2   | 4.9 |
| EP-12 | Coal Crusher House Surge Bin – Dust Collector | PM <sub>10</sub>               | 0.8   | 3.4 |
| TP-16 | Material Transfer (C-61 to C-71)              | This source vents to SN-EP-08. |       |     |
| TP-20 | Material Transfer (C-7A to storage silos)     | This source vents to SN-EP-10. |       |     |

290. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design operating capacity of the equipment. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by §§ 8-4-304 and 8-4-311]

| SN | Description | Pollutant | lb/hr | tpy |
|----|-------------|-----------|-------|-----|
|----|-------------|-----------|-------|-----|

| SN    | Description                                   | Pollutant                      | lb/hr | tpy |
|-------|-----------------------------------------------|--------------------------------|-------|-----|
| EP-01 | Rotary Car Dumper Building                    | PM                             | 0.1   | 0.2 |
| EP-02 | Coal Dumper Tunnel Exhaust Fan                | PM                             | 0.1   | 0.2 |
| EP-03 | Head House on Lowering Well 1                 | PM                             | 0.3   | 1.0 |
| EP-04 | Head House on Lowering Well 2                 | PM                             | 0.3   | 1.0 |
| EP-05 | Reclaim Tunnel Exhaust Fans (x5)              | PM                             | 0.1   | 0.1 |
| EP-06 | Central Transfer House Exhaust Fans (x2)      | PM                             | 0.1   | 0.2 |
| EP-07 | Crusher House Exhaust Fans (x2)               | PM                             | 0.1   | 0.2 |
| EP-08 | Plant Transfer House Exhaust Fans (x2)        | PM                             | 0.1   | 0.1 |
| EP-09 | Tripper House Exhaust Fans (x2)               | PM                             | 0.1   | 0.1 |
| EP-10 | Coal Silo Wet Scrubber                        | PM                             | 1.2   | 4.9 |
| EP-12 | Coal Crusher House Surge Bin – Dust Collector | PM                             | 0.8   | 3.4 |
| TP-16 | Material Transfer (C-61 to C-71)              | This source vents to SN-EP-08. |       |     |
| TP-20 | Material Transfer (C-7A to storage silos)     | This source vents to SN-EP-10. |       |     |

291. These sources are considered affected sources under 40 CFR Part 60, Subpart Y, *Standards of Performance for Coal Preparation Plants* and shall comply with the following: [Reg.19.304 and 40 C.F.R. § 60 Subpart Y]
- a. On and after the date on which the performance test required to be conducted by §60.8 is completed, an owner or operator subject to the provisions of this subpart shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal, gases which exhibit 20 percent opacity or greater. [Reg.19.304 and 40 C.F.R. § 60.252(c)]
  - b. Method 9 and the procedures in §60.11 shall be used to determine opacity. [Reg.19.304 and 40 C.F.R. § 60.254(b)(2)]
292. The permittee shall use water and surfactant spray systems in the coal handling area to maintain a high coal moisture content in order to minimize uncontrolled dust emissions. [Ark. Code Ann. § 8-4-203 as referenced by A.C.A. §§ 8-4-304 and 8-4-311]

SN-TP-22 and TP-23  
 Material Transfer Points

Source Description

From the storage silos, the fly ash/FGD waste is mixed with water and then drop loaded into open top dump trucks. The dump trucks unload the fly ash/FGD waste to an onsite landfill.

Specific Conditions

293. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design operating capacity of the equipment. [Reg.19.304, Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| SN    | Description                                    | Pollutant        | lb/hr | tpy |
|-------|------------------------------------------------|------------------|-------|-----|
| TP-22 | Material Transfer (Fly Ash/FGD Waste to Truck) | PM <sub>10</sub> | 0.1   | 0.1 |
| TP-23 | Fly Ash Disposal to Landfill                   | PM <sub>10</sub> | 0.1   | 0.1 |

294. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design operating capacity of the equipment. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by §§ 8-4-304 and 8-4-311]

| SN    | Description                                    | Pollutant | lb/hr | tpy |
|-------|------------------------------------------------|-----------|-------|-----|
| TP-22 | Material Transfer (Fly Ash/FGD Waste to Truck) | PM        | 0.1   | 0.2 |
| TP-23 | Fly Ash Disposal to Landfill                   | PM        | 0.1   | 0.2 |

295. The opacity from SN-TP-22 shall not exceed 20%. Compliance with the opacity standard shall be demonstrated through compliance with Specific Condition 296. [Reg.19.503 and 40 C.F.R. § 52 Subpart E]

296. Daily visible emission observations shall be used as a method of compliance verification for the opacity limits assigned for these sources. Daily visible emission observations are only required if the source operates during daylight hours. The daily observations shall be conducted by someone familiar with the facility's visible emissions.

- a. If during the observations, visible emissions are detected which appear to be in excess of the permitted opacity limit, the permittee shall:
  - i. Take immediate action to identify the cause of the visible emissions,
  - ii. Implement corrective action, and

- iii. If excessive visible emissions are still detected, an opacity reading shall be conducted in accordance with EPA Reference Method 9 for point sources and in accordance with EPA Method 22 for non-point sources. This reading shall be conducted by a person trained and certified in the reference method. If the opacity reading exceeds the permitted limit, further corrective measures shall be taken.
    - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
  - b. The permittee shall maintain records related to all visible emission observations and Method 9 readings. These records shall be updated on an as-performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:
    - i. The time and date of each observation/reading,
    - ii. The results of the observations,
    - iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
    - iv. The name of the person conducting the observation/reading.

[Reg. 19.705 and 40 C.F.R. § 52 Subpart E]

SN-EP-15 through EP-24  
 Bin Vent Filters and Exhausters

Source Description

Emissions from lime, coal, activated carbon and fly ash storage bins are controlled by filters.

Specific Conditions

297. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design capacity of the equipment and represent a worst case scenario. Compliance with these emission rates shall be demonstrated through compliance with Plantwide Condition 5. [Reg.19.304 , Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| SN     | Description                                                            | Pollutant        | lb/hr            | tpy              |
|--------|------------------------------------------------------------------------|------------------|------------------|------------------|
| EP-15  | Lime Vacuum Blower (1) Railcar Unloading – Vacuum Exhauster            | PM <sub>10</sub> | 0.2              | 0.9              |
| EP-16  | Lime Vacuum Blower (2) Railcar Unloading – Vacuum Exhauster            | PM <sub>10</sub> | 0.2              | 0.9              |
| EP-17  | Lime Storage Silo - Bin Vent Filter                                    | PM <sub>10</sub> | 0.6              | 2.7              |
| EP-18  | Lime Storage Day Bin (1) – Dust Collector                              | PM <sub>10</sub> | 0.7              | 2.9              |
| EP-19  | Lime Storage Day Bin (2) – Dust Collector                              | PM <sub>10</sub> | 0.7              | 2.9              |
| EP-20  | Activated Carbon Bin Vent Filter                                       | PM <sub>10</sub> | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-20B | Activated Carbon Bin Vent Filter                                       | PM <sub>10</sub> | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-21  | Fly Ash Waste Storage Silo - Bin Vent Filter                           | PM <sub>10</sub> | 1.1              | 4.7              |
| EP-22  | Fly Ash Recycle Storage Silo - Bin Vent Filter                         | PM <sub>10</sub> | 0.9              | 3.8              |
| EP-23  | Fly Ash/FGD (1)<br>(to Ash Transfer Station) –<br>Mechanical Exhauster | PM <sub>10</sub> | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-24  | Fly Ash/FGD (2)<br>(to Ash Transfer Station) –<br>Mechanical Exhauster | PM <sub>10</sub> | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-25  | Fly Ash/Byproduct (to Ash Transfer Station) – Mechanical Exhauster     | PM <sub>10</sub> | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |

- a. Only two (2) of the three (3) fly ash transfer stations (SN-EP-23, SN-EP-24, and SN-EP-25) are able to operate simultaneously.
- b. Only one (1) of the two (2) activated carbon bin vent filters (SN-EP20 and SN-EP20B) are able to operate at any given time.

298. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum design capacity of the equipment and represent a worst case scenario. Compliance with these emission rates shall be demonstrated through compliance with Plantwide Condition 5. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by A.C.A. §§ 8-4-304 and 8-4-311]

| SN     | Description                                                        | Pollutant | lb/hr            | tpy              |
|--------|--------------------------------------------------------------------|-----------|------------------|------------------|
| EP-15  | Lime Vacuum Blower (1) Railcar Unloading – Vacuum Exhauster        | PM        | 0.2              | 0.9              |
| EP-16  | Lime Vacuum Blower (2) Railcar Unloading – Vacuum Exhauster        | PM        | 0.2              | 0.9              |
| EP-17  | Lime Storage Silo - Bin Vent Filter                                | PM        | 0.6              | 2.7              |
| EP-18  | Lime Storage Day Bin (1) – Dust Collector                          | PM        | 0.7              | 2.9              |
| EP-19  | Lime Storage Day Bin (2) – Dust Collector                          | PM        | 0.7              | 2.9              |
| EP-20  | Activated Carbon Bin Vent Filter                                   | PM        | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-20B | Activated Carbon Bin Vent Filter                                   | PM        | 0.2 <sup>b</sup> | 0.5 <sup>b</sup> |
| EP-21  | Fly Ash Waste Storage Silo - Bin Vent Filter                       | PM        | 1.1              | 4.7              |
| EP-22  | Fly Ash Recycle Storage Silo - Bin Vent Filter                     | PM        | 0.9              | 3.8              |
| EP-23  | Fly Ash/FGD (1) (to Ash Transfer Station) – Mechanical Exhauster   | PM        | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-24  | Fly Ash/FGD (2) (to Ash Transfer Station) – Mechanical Exhauster   | PM        | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |
| EP-25  | Fly Ash/Byproduct (to Ash Transfer Station) – Mechanical Exhauster | PM        | 0.5 <sup>a</sup> | 2.1 <sup>a</sup> |

- a. Only two (2) of the three (3) fly ash transfer stations (SN-EP-23, SN-EP-24, and SN-EP-25) are able to operate simultaneously.
- b. Only one (1) of the two (2) activated carbon bin vent filters (SN-EP20 and SN-EP20B) are able to operate at any given time.

299. The opacity from these sources (SN-EP-15 through SN-EP-25) shall not exceed 10%. Compliance with the opacity standard shall be demonstrated through compliance with Specific Condition 300. [Reg.19.503 and 40 C.F.R. § 52 Subpart E]

300. Weekly visible emission observations shall be used as a method of compliance verification for the opacity limits assigned for these sources. Weekly visible emission observations are only required when the source has operated during any part of the week. The weekly observations shall be conducted by someone familiar with the facility's visible emissions.
- a. If during the observations, visible emissions are detected which appear to be in excess of the permitted opacity limit, the permittee shall:
    - i. Take immediate action to identify the cause of the visible emissions,
    - ii. Implement corrective action, and
    - iii. If excessive visible emissions are still detected, an opacity reading shall be conducted in accordance with EPA Reference Method 9. This reading shall be conducted by a person trained and certified in the reference method. If the opacity reading exceeds the permitted limit, further corrective measures shall be taken.
    - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
  - b. The permittee shall maintain records related to all visible emission observations and Method 9 readings. These records shall be updated on an as-performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:
    - i. The time and date of each observation/reading,
    - ii. The results of the observations,
    - iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
    - iv. The name of the person conducting the observation/reading.

[Reg.19.705 and 40 C.F.R. § 52 Subpart E]



SN-F-01 through F-06  
 Coal and Solid Waste Piles

Source Description

Coal is stored in outdoor piles prior to its use in the boiler.

Specific Conditions

301. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with the emissions rates for SN-F-01 through SN-F-03 through compliance with Specific Condition 303. Compliance with the emission rates for SN-F-04 shall be demonstrated through compliance with Specific Conditions 303 and 304. Compliance with the emission rates for SN-F-05 and F-06 shall be demonstrated through compliance with Specific Condition 305. [Reg.19.304, Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| SN   | Description                             | Pollutant        | lb/hr | tpy  |
|------|-----------------------------------------|------------------|-------|------|
| F-01 | Active Coal Pile                        | PM <sub>10</sub> | 0.1   | 0.4  |
| F-02 | Active Coal Pile                        | PM <sub>10</sub> | 0.1   | 0.4  |
| F-03 | Dozing Coal – Active and Inactive Piles | PM <sub>10</sub> | 0.4   | 1.5  |
| F-04 | Inactive Coal Piles                     | PM <sub>10</sub> | 0.6   | 2.4  |
| F-05 | Dozing of Solid Waste Disposal Area     | PM <sub>10</sub> | 3.3   | 14.3 |
| F-06 | Solid Waste Disposal Area               | PM <sub>10</sub> | 1.6   | 6.7  |

302. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with the emissions rates for SN-F-01 through SN-F-03 through compliance with Specific Condition 303. Compliance with the emission rates for SN-F-04 shall be demonstrated through compliance with Specific Conditions 303 and 304. Compliance with the emission rates for SN-F-05 and F-06 shall be demonstrated through compliance with Specific Condition 305. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by A.C.A. §§ 8-4-304 and 8-4-311]

| SN   | Description                             | Pollutant | lb/hr | tpy |
|------|-----------------------------------------|-----------|-------|-----|
| F-01 | Active Coal Pile                        | PM        | 0.2   | 0.8 |
| F-02 | Active Coal Pile                        | PM        | 0.2   | 0.8 |
| F-03 | Dozing Coal – Active and Inactive Piles | PM        | 2.1   | 9.4 |

| SN   | Description                         | Pollutant | lb/hr | tpy  |
|------|-------------------------------------|-----------|-------|------|
| F-04 | Inactive Coal Piles                 | PM        | 1.1   | 4.7  |
| F-05 | Dozing of Solid Waste Disposal Area | PM        | 10.7  | 46.9 |
| F-06 | Solid Waste Disposal Area           | PM        | 4.4   | 19.0 |

303. The permittee shall treat the Active Piles, SN-F-01 and SN-F-02, with water or chemical dust suppressants each day that precipitation is less than 0.1 inches. Water treatment is also not required when the ambient temperature is below 40 degrees F. The permittee shall also maintain a daily log which shows if water was applied to the Active Piles, and the precipitation amounts or temperature on days it was not applied. The permittee shall treat the freshly disturbed areas of the Inactive Pile, SN-F-04, with water or chemical dust suppressant sprays on a daily basis when the inactive pile is disturbed. These treatments of SN-F-01, SN-F-02, and SN-F-04 shall not be required if the ambient temperature is below 40 degrees F or if the precipitation is greater than 0.1 inch. The permittee shall maintain a daily log of the water and dust suppressant treatment to the Inactive Pile. On days where no treatment occurs the log shall document either that no new areas were disturbed, the ambient temperature on that day was below 40 degrees F, or that precipitation on that day was greater than 0.1 inch. [Reg.19.705 and 40 C.F.R. § 52 Subpart E]
304. The permittee shall maintain the area of SN-F-04 at or below 26 acres. Compliance shall be demonstrated by surveying the boundary perimeter of this pile. The permittee shall record the perimeter of this pile with a global positioning system (GPS) instrument. The permittee shall certify that the area does not exceed 26 acres in the semi-annual reports required in General Provision 7. [Reg.19.705, 40 C.F.R. § 70.6, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
305. The maximum area of the solid waste disposal area, SN-F-06, that is operating/exposed shall not exceed 50 acres. The permittee shall certify that the area does not exceed 50 acres in the semi-annual reports required in General Provision 7. [Reg.19.705, Reg.18.1004, 40 C.F.R. 52 Subpart E, and Ark. Code Ann. §§ 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
306. The coal and solid waste piles shall be operated in a manner to prohibit visible emission off site of the facility. The opacity from these sources (SN-F-01 through SN-F-06) shall not exceed 10%. Compliance with the opacity standard shall be demonstrated through compliance with Specific Condition 307. [Reg.19.503 and 40 C.F.R. § 52 Subpart E]

307. Weekly visible emission observations shall be conducted of the coal and solid waste piles.
- a. If during the observations, any visible emissions are detected off-site, the permittee shall:
    - i. Take immediate action to identify the cause of the visible emissions,
    - ii. Implement corrective action,
    - iii. If excessive visible emissions are still detected further corrective measures shall be taken.
    - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
  - b. The permittee shall maintain records related to all visible emission observations. These records shall be updated on an as-performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:
    - i. The time and date of each observation/reading,
    - ii. The results of the observations,
    - iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
    - iv. The name of the person conducting the observation/reading.

[Reg.19.705 and 40 C.F.R. § 52 Subpart E]

SN-CT-01  
Cooling Tower

Source Description

Cooling water used in the steam turbine condenser is provided by a mechanical draft cooling tower.

Specific Conditions

308. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum operating capacity of the equipment. Compliance shall be demonstrated through compliance with Plantwide Condition 5. [Reg.19.304, Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| Pollutant        | lb/hr | tpy  |
|------------------|-------|------|
| PM <sub>10</sub> | 5.2   | 22.8 |

309. The permittee shall not exceed the emission rates set forth in the following table. Emission rates are based on the maximum operating capacity of the equipment. Compliance shall be demonstrated through compliance with Plantwide Condition 5. [Reg.18.801, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant | lb/hr | tpy  |
|-----------|-------|------|
| PM        | 5.2   | 22.8 |

310. This source shall be equipped with high efficiency drift eliminators with a drift rate not greater than 0.0005%. [Reg.19.901 and 40 C.F.R. § 52 Subpart E]
311. The total dissolved solids in the cooling tower recirculated water shall not exceed 7,500 ppm. Compliance with this limit shall be demonstrated by Specific Condition 312. [Reg.19.705, Ark. Code Ann. § 8-4-203 as referenced by §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 52 Subpart E]
312. The permittee shall monitor the total dissolved solids in the cooling tower once per week if the boiler operates during that week. These records shall be updated by the 15<sup>th</sup> day of the month after the month which the records represent, be kept on site, and be made available to Department personnel upon request. Reports of these records shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 70.6]

SN-RD-01  
Unpaved Haul Roads

Source Description

Truck traffic to haul waste to and from the landfill and throughout the plant takes place on unpaved roads.

Specific Conditions

313. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Condition 315. [Reg.19.304 , Reg.19.901, 40 C.F.R. § 52 Subpart E, and 40 C.F.R. § 63.43]

| Pollutant        | lb/hr | tpy |
|------------------|-------|-----|
| PM <sub>10</sub> | 1.1   | 3.3 |

314. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Condition 315. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Pollutant | lb/hr | tpy  |
|-----------|-------|------|
| PM        | 3.8   | 11.9 |

315. The permittee shall develop a haul road maintenance plan to clean or treat unpaved haul roads at this facility. This plan shall be designed to minimize emissions from this source. A copy of this plan shall be kept on site and made available to Department personnel upon request. At a minimum, the plan shall contain the elements listed in a - c below. [Reg.18.1004, Reg.19.705, 40 C.F.R. § 70.6, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
- a. At a minimum, the frequency of application of water or chemical dust suppressant shall occur daily unless otherwise required as a result of inspections required by b) below.
  - b. Daily inspections of unpaved haul roadways shall occur to determine the needed frequencies of application water or chemical dust suppressant. If this daily inspection determines that the unpaved haul roadways are covered with snow and/or ice, or if precipitation has occurred that is sufficient for that day to ensure fugitive dust has been minimized, then the requirements of Specific Condition 315a shall not apply for that day.

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

- c. The facility shall maintain records of these daily inspections including observed conditions and actions taken.

SN-TK-01  
 Gasoline Storage Tank

Source Description

A 4,000 gallon gasoline storage tank is used to fuel equipment at the facility.

Specific Conditions

316. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 318. [Reg.19.501 and 40 C.F.R. § 52 Subpart E]

| SN    | Description                              | Pollutant | lb/hr | tpy |
|-------|------------------------------------------|-----------|-------|-----|
| TK-01 | Gasoline Storage Tank<br>(4,000 gallons) | VOC       | 47.0  | 0.8 |

317. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition through compliance with Specific Conditions 318. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| SN    | Description                              | Pollutant              | lb/hr | tpy  |
|-------|------------------------------------------|------------------------|-------|------|
| TK-01 | Gasoline Storage Tank<br>(4,000 gallons) | Benzene                | 0.68  | 0.02 |
|       |                                          | 1,3-Butadiene          | 0.01  | 0.01 |
|       |                                          | Hexane                 | 0.53  | 0.01 |
|       |                                          | Toluene                | 0.85  | 0.02 |
|       |                                          | 2,2,4-Trimethylpentane | 0.21  | 0.01 |
|       |                                          | Xylene                 | 0.19  | 0.01 |

318. The permittee shall not use in excess of 25,000 gallons of gasoline per rolling 12-month total. The permittee shall demonstrate compliance with this condition through compliance with Specific Condition 319. [Reg.19.705, Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 70.6]

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

319. The permittee shall maintain monthly records of the gasoline received at SN-TK-01. These records shall contain each month's total and a rolling total for the previous 12-months. These records shall be updated by the fifteenth of the month following the month which the records represent, shall be kept on site, and shall be made available to Department personnel upon request. This information shall be submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. 52 Subpart E]



SN-05  
 CPRP Surge Tanks Emergency Diesel Engine

Source Description

This 300 BHP diesel-fired emergency engine is used to support the facility's coal pile runoff pond and associated coal pile runoff surge tanks.

Specific Conditions

320. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition by Specific Conditions 324, 326, and 328. [Reg.19.501 and 40 C.F.R. § 52 Subpart E]

| SN | Description                        | Pollutant        | lb/hr | tpy |
|----|------------------------------------|------------------|-------|-----|
| 05 | 300 BHP Diesel<br>Emergency Engine | PM <sub>10</sub> | 0.2   | 0.1 |
|    |                                    | SO <sub>2</sub>  | 0.1   | 0.1 |
|    |                                    | VOC              | 0.2   | 0.1 |
|    |                                    | CO               | 3.1   | 0.2 |
|    |                                    | NO <sub>x</sub>  | 3.6   | 0.2 |

321. The permittee shall not exceed the emission rates set forth in the following table. The permittee shall demonstrate compliance with this condition by Specific Conditions 324, 326, and 328. [Reg.18.801 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| SN | Description                        | Pollutant     | lb/hr | tpy  |
|----|------------------------------------|---------------|-------|------|
| 05 | 300 BHP Diesel<br>Emergency Engine | PM            | 0.2   | 0.1  |
|    |                                    | Acetaldehyde  | 0.01  | 0.01 |
|    |                                    | Acrolein      | 0.01  | 0.01 |
|    |                                    | Benzene       | 0.01  | 0.01 |
|    |                                    | 1,3-Butadiene | 0.01  | 0.01 |
|    |                                    | Formaldehyde  | 0.01  | 0.01 |
|    |                                    | POM           | 0.01  | 0.01 |
|    |                                    | Toluene       | 0.01  | 0.01 |
|    |                                    | Xylene        | 0.01  | 0.01 |

322. The permittee shall not exceed 20% opacity from SN-05 as measured by EPA Reference Method 9. Compliance with this Specific Condition shall be demonstrated by compliance with Specific Condition 323. [Reg.18.501, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
323. The permittee shall conduct a onetime visible emissions observation as a method of compliance verification for the opacity limit assigned for SN-05. This observation shall be conducted by someone trained in EPA Reference Method 9. This observation shall be performed in accordance with Plantwide Condition 3.
- a. If during the observations, visible emissions are detected which appear to be in excess of the permitted opacity limit, the permittee shall:
- i. Take immediate action to identify the cause of the visible emissions,
  - ii. Implement corrective action, and
  - iii. If excessive visible emissions are still detected, an opacity reading shall be conducted in accordance with EPA Reference Method 9. This reading shall be conducted by a person trained and certified in the reference method. If the opacity reading exceeds the permitted limit, further corrective measures shall be taken.
  - iv. If no excessive visible emissions are detected, the incident shall be noted in the records as described below.
- b. The permittee shall maintain records related to all visible emission observations and Method 9 readings. These records shall be updated on an as-performed basis. These records shall be kept on site and made available to Department personnel upon request. These records shall contain:
- i. The time and date of each observation/reading,
  - ii. The results of the observations,
  - iii. The cause of any observed exceedance of opacity limits, corrective actions taken, results of the reassessment, and
  - iv. The name of the person conducting the observation/reading.

[Reg.19.705 and 40 C.F.R. § 52 Subpart E]

324. The permittee shall not operate the emergency generator SN-05 in excess of 100 total hours (emergency and non-emergency) per calendar year in order to demonstrate compliance with the annual emission rate limits. Emergency operation in excess of these hours may be allowable but shall be reported and will be evaluated in accordance with Reg.19.602 and other applicable regulations. [Reg.19.705, Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 70.6]
325. The permittee shall maintain monthly records to demonstrate compliance with Specific Condition 324. The permittee shall update these records by the fifteenth day of the

month following the month to which the records pertain. The calendar year totals and each individual month's data shall be maintained on-site, made available to Department personnel upon request, and submitted in accordance with General Provision 7. [Reg.19.705 and 40 C.F.R. § 52 Subpart E]

326. SN-05 is considered an affected source under 40 CFR 63, Subpart ZZZZ - *National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines*, and is subject, but not limited to, Specific Condition 327. [Reg.19.304 and 40 C.F.R. § 63 Subpart ZZZZ]
327. An affected source that meets any of the criteria in paragraphs (c)(1) through (7) of §63.6590 must meet the requirements of this part by meeting the requirements of 40 CFR part 60 subpart IIII, for compression ignition engines or 40 CFR part 60 subpart JJJJ, for spark ignition engines. No further requirements apply for such engines under this part.
- a. A new or reconstructed emergency or limited use stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions. [40 C.F.R. § 63.6590(c)(6)]
328. SN-05 is considered an affected source under 40 CFR 60, Subpart IIII - *Standards of Performance for Stationary Compression Ignition Internal Combustion Engines*, and is subject, but not limited to, Specific Conditions 279 through 285, and 329. [Reg.19.304 and 40 C.F.R. § 60 Subpart IIII]
329. The permittee shall comply with the following emission rates for this source. [Reg.19.304, 40 C.F.R. § 60.4202(a)(2), and 40 C.F.R. §§ 89.112 and 89.113]

| Pollutant              | Emission Limit |
|------------------------|----------------|
| PM                     | 0.20 g/kWh     |
| NMHC + NO <sub>x</sub> | 4.0 g/kWh      |
| CO                     | 3.5 g/kWh      |

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)  
Permit #: 2123-AOP-R9  
AFIN: 29-00506

## **SECTION V: COMPLIANCE PLAN AND SCHEDULE**

American Electric Power Service Corporation (John W. Turk Jr. Power Plant) will continue to operate in compliance with those identified regulatory provisions. The facility will examine and analyze future regulations that may apply and determine their applicability with any necessary action taken on a timely basis.

## SECTION VI: PLANTWIDE CONDITIONS

1. The permittee shall notify the Director in writing within thirty (30) days after commencing construction, completing construction, first placing the equipment and/or facility in operation, and reaching the equipment and/or facility target production rate. [Reg.19.704, 40 C.F.R. § 52 Subpart E, and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
2. If the permittee fails to start construction within eighteen months or suspends construction for eighteen months or more, the Director may cancel all or part of this permit. [Reg.19.410(B) and 40 C.F.R. § 52 Subpart E]
3. The permittee must test any equipment scheduled for testing, unless otherwise stated in the Specific Conditions of this permit or by any federally regulated requirements, within the following time frames: (1) new equipment or newly modified equipment within sixty (60) days of achieving the maximum production rate, but no later than 180 days after initial start up of the permitted source or (2) operating equipment according to the time frames set forth by the Department or within 180 days of permit issuance if no date is specified. The permittee must notify the Department of the scheduled date of compliance testing at least fifteen (15) business days in advance of such test. The permittee shall submit the compliance test results to the Department within sixty (60) calendar days after completing the testing. [Reg.19.702 and/or Reg.18.1002 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
4. The permittee must provide:
  - a. Sampling ports adequate for applicable test methods;
  - b. Safe sampling platforms;
  - c. Safe access to sampling platforms; and
  - d. Utilities for sampling and testing equipment.

[Reg.19.702 and/or Reg.18.1002 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
5. The permittee must operate the equipment, control apparatus and emission monitoring equipment within the design limitations. The permittee shall maintain the equipment in good condition at all times. [Reg.19.303 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
6. This permit subsumes and incorporates all previously issued air permits for this facility. [Reg. 26 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
7. The permittee shall comply with all applicable requirements contained in 40 CFR 63, Subpart A. [Regulation 19, §19.304 and 40 CFR 63.43(g)(2)(iv)]

8. The CEMS required by this permit shall be operated in accordance with all applicable conditions of the Department's Continuous Emission Monitoring Systems Conditions as found in Appendix F of this permit. [Regulation 19, §19.703, 40 CFR Part 52, Subpart E, and A.C.A. §8-4-203 as referenced by A.C.A. §8-4-304 and §8-4-311]

#### Title VI Provisions

9. The permittee must comply with the standards for labeling of products using ozone-depleting substances. [40 C.F.R. § 82 Subpart E]
  - a. All containers containing a class I or class II substance stored or transported, all products containing a class I substance, and all products directly manufactured with a class I substance must bear the required warning statement if it is being introduced to interstate commerce pursuant to § 82.106.
  - b. The placement of the required warning statement must comply with the requirements pursuant to § 82.108.
  - c. The form of the label bearing the required warning must comply with the requirements pursuant to § 82.110.
  - d. No person may modify, remove, or interfere with the required warning statement except as described in § 82.112.
10. The permittee must comply with the standards for recycling and emissions reduction, except as provided for MVACs in Subpart B. [40 C.F.R. § 82 Subpart F]
  - a. Persons opening appliances for maintenance, service, repair, or disposal must comply with the required practices pursuant to § 82.156.
  - b. Equipment used during the maintenance, service, repair, or disposal of appliances must comply with the standards for recycling and recovery equipment pursuant to § 82.158.
  - c. Persons performing maintenance, service repair, or disposal of appliances must be certified by an approved technician certification program pursuant to § 82.161.
  - d. Persons disposing of small appliances, MVACs, and MVAC like appliances must comply with record keeping requirements pursuant to § 82.166. (“MVAC like appliance” as defined at § 82.152)
  - e. Persons owning commercial or industrial process refrigeration equipment must comply with leak repair requirements pursuant to § 82.156.
  - f. Owners/operators of appliances normally containing 50 or more pounds of refrigerant must keep records of refrigerant purchased and added to such appliances pursuant to § 82.166.
11. If the permittee manufactures, transforms, destroys, imports, or exports a class I or class II substance, the permittee is subject to all requirements as specified in 40 C.F.R. § 82 Subpart A, Production and Consumption Controls.

12. If the permittee performs a service on motor (fleet) vehicles when this service involves ozone depleting substance refrigerant (or regulated substitute substance) in the motor vehicle air conditioner (MVAC), the permittee is subject to all the applicable requirements as specified in 40 C.F.R. § 82 Subpart B, Servicing of Motor Vehicle Air Conditioners.

The term “motor vehicle” as used in Subpart B does not include a vehicle in which final assembly of the vehicle has not been completed. The term “MVAC” as used in Subpart B does not include the air tight sealed refrigeration system used as refrigerated cargo, or the system used on passenger buses using HCFC 22 refrigerant.

13. The permittee can switch from any ozone depleting substance to any alternative listed in the Significant New Alternatives Program (SNAP) promulgated pursuant to 40 C.F.R. § 82 Subpart G.

#### Acid Rain (Title IV)

14. The Director prohibits the permittee to cause any emissions exceeding any allowances the source lawfully holds under Title IV of the Act or the regulations promulgated under the Act. No permit revision is required for increases in emissions allowed by allowances acquired pursuant to the acid rain program, if such increases do not require a permit revision under any other applicable requirement. This permit establishes no limit on the number of allowances held by the permittee. However, the source may not use allowances as a defense for noncompliance with any other applicable requirement of this permit or the Act. The permittee will account for any such allowance according to the procedures established in regulations promulgated under Title IV of the Act. [Regulation 26, §26.701 and 40 CFR 70.6(a)(4)]

#### Transport Rule (TR) NO<sub>x</sub> Ozone Season Trading Program Requirements

15. The permittee shall comply with the following TR NO<sub>x</sub> Ozone Season Trading Program Requirements. The unit-specific monitoring provisions are attached to this Title V permit. [40 C.F.R. § 97 Subpart BBBBB and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
  - a. Designated representative requirements.

The owners and operators shall comply with the requirement to have a designated representative, and may have an alternate designated representative, in accordance with 40 C.F.R. §§ 97.513 through 97.518.
  - b. Emissions monitoring, reporting, and recordkeeping requirements.
    1. The owners and operators, and the designated representative, of each TR NO<sub>x</sub> Ozone Season source and each TR NO<sub>x</sub> Ozone Season unit at the source shall comply with the monitoring, reporting, and recordkeeping requirements of 40 C.F.R. §§ 97.530 (general requirements, including

installation, certification, and data accounting, compliance deadlines, reporting data, prohibitions, and long-term cold storage), 97.531 (initial monitoring system certification and recertification procedures), 97.532 (monitoring system out-of-control periods), 97.533 (notifications concerning monitoring), 97.534 (recordkeeping and reporting, including monitoring plans, certification applications, quarterly reports, and compliance certification), and 97.535 (petitions for alternatives to monitoring, recordkeeping, or reporting requirements).

2. The emissions data determined in accordance with 40 C.F.R. §§ 97.530 through 97.535 shall be used to calculate allocations of TR NO<sub>x</sub> Ozone Season allowances under 40 C.F.R. §§ 97.511(a)(2) and (b) and 97.512 and to determine compliance with the TR NO<sub>x</sub> Ozone Season emissions limitation and assurance provisions under paragraph (c) below, provided that, for each monitoring location from which mass emissions are reported, the mass emissions amount used in calculating such allocations and determining such compliance shall be the mass emissions amount for the monitoring location determined in accordance with 40 C.F.R. §§ 97.530 through 97.535 and rounded to the nearest ton, with any fraction of a ton less than 0.50 being deemed to be zero.

c. NO<sub>x</sub> emissions requirements.

1. TR NO<sub>x</sub> Ozone Season emissions limitation.

- i. As of the allowance transfer deadline for a control period in a given year, the owners and operators of each TR NO<sub>x</sub> Ozone Season source and each TR NO<sub>x</sub> Ozone Season unit at the source shall hold, in the source's compliance account, TR NO<sub>x</sub> Ozone Season allowances available for deduction for such control period under 40 C.F.R. § 97.524(a) in an amount not less than the tons of total NO<sub>x</sub> emissions for such control period from all TR NO<sub>x</sub> Ozone Season units at the source.
- ii. If total NO<sub>x</sub> emissions during a control period in a given year from the TR NO<sub>x</sub> Ozone Season units at a TR NO<sub>x</sub> Ozone Season source are in excess of the TR NO<sub>x</sub> Ozone Season emissions limitation set forth in paragraph (c)(1)(i) above, then:
  - A. The owners and operators of the source and each TR NO<sub>x</sub> Ozone Season unit at the source shall hold the TR NO<sub>x</sub> Ozone Season allowances required for deduction under 40 C.F.R. § 97.524(d); and
  - B. The owners and operators of the source and each TR NO<sub>x</sub> Ozone Season unit at the source shall pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act, and each



ton of such excess emissions and each day of such control period shall constitute a separate violation of 40 C.F.R. § 97 Subpart BBBBB and the Clean Air Act.

2. TR NO<sub>x</sub> Ozone Season assurance provisions.

- i. If total NO<sub>x</sub> emissions during a control period in a given year from all TR NO<sub>x</sub> Ozone Season units at TR NO<sub>x</sub> Ozone Season sources in the state exceed the state assurance level, then the owners and operators of such sources and units in each group of one or more sources and units having a common designated representative for such control period, where the common designated representative's share of such NO<sub>x</sub> emissions during such control period exceeds the common designated representative's assurance level for the state and such control period, shall hold (in the assurance account established for the owners and operators of such group) TR NO<sub>x</sub> Ozone Season allowances available for deduction for such control period under 40 C.F.R. § 97.525(a) in an amount equal to two times the product (rounded to the nearest whole number), as determined by the Administrator in accordance with 40 C.F.R. § 97.525(b), of multiplying—
  - A. The quotient of the amount by which the common designated representative's share of such NO<sub>x</sub> emissions exceeds the common designated representative's assurance level divided by the sum of the amounts, determined for all common designated representatives for such sources and units in the state for such control period, by which each common designated representative's share of such NO<sub>x</sub> emissions exceeds the respective common designated representative's assurance level; and
  - B. The amount by which total NO<sub>x</sub> emissions from all TR NO<sub>x</sub> Ozone Season units at TR NO<sub>x</sub> Ozone Season sources in the state for such control period exceed the state assurance level.
- ii. The owners and operators shall hold the TR NO<sub>x</sub> Ozone Season allowances required under paragraph (c)(2)(i) above, as of midnight of November 1 (if it is a business day), or midnight of the first business day thereafter (if November 1 is not a business day), immediately after such control period.
- iii. Total NO<sub>x</sub> emissions from all TR NO<sub>x</sub> Ozone Season units at TR NO<sub>x</sub> Ozone Season sources in the state during a control period in a given year exceed the state assurance level if such total NO<sub>x</sub> emissions exceed the sum, for such control period, of the State

NO<sub>x</sub> Ozone Season trading budget under 40 C.F.R. § 97.510(a) and the state's variability limit under 40 C.F.R. § 97.510(b).

- iv. It shall not be a violation of 40 C.F.R. § 97 Subpart BBBBBB or of the Clean Air Act if total NO<sub>x</sub> emissions from all TR NO<sub>x</sub> Ozone Season units at TR NO<sub>x</sub> Ozone Season sources in the state during a control period exceed the state assurance level or if a common designated representative's share of total NO<sub>x</sub> emissions from the TR NO<sub>x</sub> Ozone Season units at TR NO<sub>x</sub> Ozone Season sources in the state during a control period exceeds the common designated representative's assurance level.
- v. To the extent the owners and operators fail to hold TR NO<sub>x</sub> Ozone Season allowances for a control period in a given year in accordance with paragraphs (c)(2)(i) through (iii) above,
  - A. The owners and operators shall pay any fine, penalty, or assessment or comply with any other remedy imposed under the Clean Air Act; and
  - B. Each TR NO<sub>x</sub> Ozone Season allowance that the owners and operators fail to hold for such control period in accordance with paragraphs (c)(2)(i) through (iii) above and each day of such control period shall constitute a separate violation of 40 C.F.R. § 97 Subpart BBBBBB and the Clean Air Act.

### 3. Compliance periods.

- i. A TR NO<sub>x</sub> Ozone Season unit shall be subject to the requirements under paragraph (c)(1) above for the control period starting on the later of May 1, 2015 or the deadline for meeting the unit's monitor certification requirements under 40 C.F.R. § 97.530(b) and for each control period thereafter.
- ii. A TR NO<sub>x</sub> Ozone Season unit shall be subject to the requirements under paragraph (c)(2) above for the control period starting on the later of May 1, 2017 or the deadline for meeting the unit's monitor certification requirements under 40 C.F.R. § 97.530(b) and for each control period thereafter.

### 4. Vintage of allowances held for compliance.

- i. A TR NO<sub>x</sub> Ozone Season allowance held for compliance with the requirements under paragraph (c)(1)(i) above for a control period in a given year must be a TR NO<sub>x</sub> Ozone Season allowance that was allocated for such control period or a control period in a prior year.

- ii. A TR NO<sub>x</sub> Ozone Season allowance held for compliance with the requirements under paragraphs (c)(1)(ii)(A) and (2)(i) through (iii) above for a control period in a given year must be a TR NO<sub>x</sub> Ozone Season allowance that was allocated for a control period in a prior year or the control period in the given year or in the immediately following year.
  5. Allowance Management System requirements. Each TR NO<sub>x</sub> Ozone Season allowance shall be held in, deducted from, or transferred into, out of, or between Allowance Management System accounts in accordance with 40 C.F.R. § 97 Subpart BBBBB.
  6. Limited authorization. A TR NO<sub>x</sub> Ozone Season allowance is a limited authorization to emit one ton of NO<sub>x</sub> during the control period in one year. Such authorization is limited in its use and duration as follows:
    - i. Such authorization shall only be used in accordance with the TR NO<sub>x</sub> Ozone Season Trading Program; and
    - ii. Notwithstanding any other provision of 40 C.F.R. § 97 Subpart BBBBB, the Administrator has the authority to terminate or limit the use and duration of such authorization to the extent the Administrator determines is necessary or appropriate to implement any provision of the Clean Air Act.
  7. Property right. A TR NO<sub>x</sub> Ozone Season allowance does not constitute a property right.
- d. Title V permit revision requirements.
1. No title V permit revision shall be required for any allocation, holding, deduction, or transfer of TR NO<sub>x</sub> Ozone Season allowances in accordance with 40 C.F.R. § 97 Subpart BBBBB.
  2. This permit incorporates the TR emissions monitoring, recordkeeping and reporting requirements pursuant to 40 C.F.R. §§ 97.530 through 97.535, and the requirements for a continuous emission monitoring system (pursuant to 40 C.F.R. § 75 Subparts B and H), an excepted monitoring system (pursuant to 40 C.F.R. § 75, appendices D and E), a low mass emissions excepted monitoring methodology (pursuant to 40 C.F.R. § 75.19), and an alternative monitoring system (pursuant to 40 C.F.R. § 75 Subpart E). Therefore, the Description of TR Monitoring Provisions table for units identified in this permit may be added to, or changed, in this title V permit using minor permit modification procedures in accordance with 40 C.F.R. §§ 97.506(d)(2) and 70.7(e)(2)(i)(B) or 71.7(e)(1)(i)(B).
- e. Additional recordkeeping and reporting requirements.

1. Unless otherwise provided, the owners and operators of each TR NO<sub>x</sub> Ozone Season source and each TR NO<sub>x</sub> Ozone Season unit at the source shall keep on site at the source each of the following documents (in hardcopy or electronic format) for a period of 5 years from the date the document is created. This period may be extended for cause, at any time before the end of 5 years, in writing by the Administrator.
    - i. The certificate of representation under 40 C.F.R. § 97.516 for the designated representative for the source and each TR NO<sub>x</sub> Ozone Season unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such certificate of representation and documents are superseded because of the submission of a new certificate of representation under 40 C.F.R. § 97.516 changing the designated representative.
    - ii. All emissions monitoring information, in accordance with 40 C.F.R. § 97 Subpart BBBBB.
    - iii. Copies of all reports, compliance certifications, and other submissions and all records made or required under, or to demonstrate compliance with the requirements of, the TR NO<sub>x</sub> Ozone Season Trading Program.
  2. The designated representative of a TR NO<sub>x</sub> Ozone Season source and each TR NO<sub>x</sub> Ozone Season unit at the source shall make all submissions required under the TR NO<sub>x</sub> Ozone Season Trading Program, except as provided in 40 C.F.R. § 97.518. This requirement does not change, create an exemption from, or otherwise affect the responsible official submission requirements under a title V operating permit program in 40 C.F.R. §§ 70 and 71.
- f. Liability.
1. Any provision of the TR NO<sub>x</sub> Ozone Season Trading Program that applies to a TR NO<sub>x</sub> Ozone Season source or the designated representative of a TR NO<sub>x</sub> Ozone Season source shall also apply to the owners and operators of such source and of the TR NO<sub>x</sub> Ozone Season units at the source.
  2. Any provision of the TR NO<sub>x</sub> Ozone Season Trading Program that applies to a TR NO<sub>x</sub> Ozone Season unit or the designated representative of a TR NO<sub>x</sub> Ozone Season unit shall also apply to the owners and operators of such unit.
- g. Effect on other authorities.

American Electric Power Service Corporation (John W. Turk Jr. Power Plant)

Permit #: 2123-AOP-R9

AFIN: 29-00506

No provision of the TR NO<sub>x</sub> Ozone Season Trading Program or exemption under 40 C.F.R. § 97.505 shall be construed as exempting or excluding the owners and operators, and the designated representative, of a TR NO<sub>x</sub> Ozone Season source or TR NO<sub>x</sub> Ozone Season unit from compliance with any other provision of the applicable, approved state implementation plan, a federally enforceable permit, or the Clean Air Act.

**SECTION VII: INSIGNIFICANT ACTIVITIES**

The Department deems the following types of activities or emissions as insignificant on the basis of size, emission rate, production rate, or activity in accordance with Group A of the Insignificant Activities list found in Regulation 18 and Regulation 19 Appendix A. Group B insignificant activities may be listed but are not required to be listed in permits. Insignificant activity emission determinations rely upon the information submitted by the permittee in an application dated November 12, 2019. [Reg.26.304 and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]

| Description                                              | Category     |
|----------------------------------------------------------|--------------|
| Diesel or Propane Space Heaters (20 total)               | Group A, #1  |
| 10,000 gal Diesel Storage Tanks (3 total)                | Group A, #3  |
| 700 gal. Diesel Storage Tank                             | Group A, #3  |
| 572 gal Diesel Storage Tank                              | Group A, #3  |
| Boiler Feed Pump Lube Oil Reservoir – 2,906 gal          | Group A, #3  |
| 550 gallon CPRP Diesel Fuel Storage Tank                 | Group A, #3  |
| 10,000 gallon Construction fuel storage tank (diesel)    | Group A, #3  |
| 10,000 gallon Sulfuric Acid Tanks (2 total)              | Group A, #4  |
| 4,800 gallon Sulfuric Acid Tank                          | Group A, #4  |
| 10,000 gallon Sodium Hypochlorite Tank                   | Group A, #4  |
| 5,000 gallon Sodium Hypochlorite Tank                    | Group A, #4  |
| 1,500 gallon Sodium Bromide Tank                         | Group A, #4  |
| 11,100 gallon Coagulant Tank                             | Group A, #4  |
| 1,500 gallon Corrosion Inhibitor/Phosphoric Acid Tank    | Group A, #4  |
| 30,000 gallon Anhydrous Ammonia Tank                     | Group A, #4  |
| Emissions from Laboratory Equipment/Vents                | Group A, #5  |
| Water washing activities of empty 55 gallon drums        | Group A, #6  |
| 5 gallon Gasoline Containers (15 total)                  | Group A, #8  |
| Turbine Lube Oil Storage Tank – 16,800 gal               | Group A, #13 |
| Turbine Lube oil Reservoir and Storage Tank – 11,624 gal | Group A, #13 |

## SECTION VIII: GENERAL PROVISIONS

1. Any terms or conditions included in this permit which specify and reference Arkansas Pollution Control & Ecology Commission Regulation 18 or the Arkansas Water and Air Pollution Control Act (Ark. Code Ann. § 8-4-101 *et seq.*) as the sole origin of and authority for the terms or conditions are not required under the Clean Air Act or any of its applicable requirements, and are not federally enforceable under the Clean Air Act. Arkansas Pollution Control & Ecology Commission Regulation 18 was adopted pursuant to the Arkansas Water and Air Pollution Control Act (Ark. Code Ann. § 8-4-101 *et seq.*). Any terms or conditions included in this permit which specify and reference Arkansas Pollution Control & Ecology Commission Regulation 18 or the Arkansas Water and Air Pollution Control Act (Ark. Code Ann. § 8-4-101 *et seq.*) as the origin of and authority for the terms or conditions are enforceable under this Arkansas statute. [40 C.F.R. § 70.6(b)(2)]
2. This permit shall be valid for a period of five (5) years beginning on the date this permit becomes effective and ending five (5) years later. [40 C.F.R. § 70.6(a)(2) and Reg.26.701(B)]
3. The permittee must submit a complete application for permit renewal at least six (6) months before permit expiration. Permit expiration terminates the permittee's right to operate unless the permittee submitted a complete renewal application at least six (6) months before permit expiration. If the permittee submits a complete application, the existing permit will remain in effect until the Department takes final action on the renewal application. The Department will not necessarily notify the permittee when the permit renewal application is due. [Reg.26.406]
4. Where an applicable requirement of the Clean Air Act, as amended, 42 U.S.C. 7401, *et seq.* (Act) is more stringent than an applicable requirement of regulations promulgated under Title IV of the Act, the permit incorporates both provisions into the permit, and the Director or the Administrator can enforce both provisions. [40 C.F.R. § 70.6(a)(1)(ii) and Reg.26.701(A)(2)]
5. The permittee must maintain the following records of monitoring information as required by this permit.
  - a. The date, place as defined in this permit, and time of sampling or measurements;
  - b. The date(s) analyses performed;
  - c. The company or entity performing the analyses;
  - d. The analytical techniques or methods used;
  - e. The results of such analyses; and
  - f. The operating conditions existing at the time of sampling or measurement.

[40 C.F.R. § 70.6(a)(3)(ii)(A) and Reg.26.701(C)(2)]

6. The permittee must retain the records of all required monitoring data and support information for at least five (5) years from the date of the monitoring sample, measurement, report, or application. Support information includes all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, and copies of all reports required by this permit. [40 C.F.R. § 70.6(a)(3)(ii)(B) and Reg.26.701(C)(2)(b)]
7. The permittee must submit reports of all required monitoring every six (6) months. If the permit establishes no other reporting period, the reporting period shall end on the last day of the month six months after the issuance of the initial Title V permit and every six months thereafter. The report is due on the first day of the second month after the end of the reporting period. The first report due after issuance of the initial Title V permit shall contain six months of data and each report thereafter shall contain 12 months of data. The report shall contain data for all monitoring requirements in effect during the reporting period. If a monitoring requirement is not in effect for the entire reporting period, only those months of data in which the monitoring requirement was in effect are required to be reported. The report must clearly identify all instances of deviations from permit requirements. A responsible official as defined in Reg.26.2 must certify all required reports. The permittee will send the reports to the address below:

Arkansas Department of Environmental Quality  
Office of Air Quality  
ATTN: Compliance Inspector Supervisor  
5301 Northshore Drive  
North Little Rock, AR 72118-5317

[40 C.F.R. § 70.6(a)(3)(iii)(A) and Reg.26.701(C)(3)(a)]

8. The permittee shall report to the Department all deviations from permit requirements, including those attributable to upset conditions as defined in the permit.
  - a. For all upset conditions (as defined in Reg.19.601), the permittee will make an initial report to the Department by the next business day after the discovery of the occurrence. The initial report may be made by telephone and shall include:
    - i. The facility name and location;
    - ii. The process unit or emission source deviating from the permit limit;
    - iii. The permit limit, including the identification of pollutants, from which deviation occurs;
    - iv. The date and time the deviation started;
    - v. The duration of the deviation;
    - vi. The emissions during the deviation;
    - vii. The probable cause of such deviations;
    - viii. Any corrective actions or preventive measures taken or being taken to prevent such deviations in the future; and



ix. The name of the person submitting the report.

The permittee shall make a full report in writing to the Department within five (5) business days of discovery of the occurrence. The report must include, in addition to the information required by the initial report, a schedule of actions taken or planned to eliminate future occurrences and/or to minimize the amount the permit's limits were exceeded and to reduce the length of time the limits were exceeded. The permittee may submit a full report in writing (by facsimile, overnight courier, or other means) by the next business day after discovery of the occurrence, and the report will serve as both the initial report and full report.

- b. For all deviations, the permittee shall report such events in semi-annual reporting and annual certifications required in this permit. This includes all upset conditions reported in 8a above. The semi-annual report must include all the information as required by the initial and full reports required in 8a.

[Reg.19.601, Reg.19.602, Reg.26.701(C)(3)(b), and 40 C.F.R. § 70.6(a)(3)(iii)(B)]

9. If any provision of the permit or the application thereof to any person or circumstance is held invalid, such invalidity will not affect other provisions or applications hereof which can be given effect without the invalid provision or application, and to this end, provisions of this Regulation are declared to be separable and severable. [40 C.F.R. § 70.6(a)(5), Reg.26.701(E), and Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
10. The permittee must comply with all conditions of this Part 70 permit. Any permit noncompliance with applicable requirements as defined in Regulation 26 constitutes a violation of the Clean Air Act, as amended, 42 U.S.C. § 7401, *et seq.* and is grounds for enforcement action; for permit termination, revocation and reissuance, for permit modification; or for denial of a permit renewal application. [40 C.F.R. § 70.6(a)(6)(i) and Reg.26.701(F)(1)]
11. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity to maintain compliance with the conditions of this permit. [40 C.F.R. § 70.6(a)(6)(ii) and Reg.26.701(F)(2)]
12. The Department may modify, revoke, reopen and reissue the permit or terminate the permit for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, termination, or of a notification of planned changes or anticipated noncompliance does not stay any permit condition. [40 C.F.R. § 70.6(a)(6)(iii) and Reg.26.701(F)(3)]
13. This permit does not convey any property rights of any sort, or any exclusive privilege. [40 C.F.R. § 70.6(a)(6)(iv) and Reg.26.701(F)(4)]

14. The permittee must furnish to the Director, within the time specified by the Director, any information that the Director may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit or to determine compliance with the permit. Upon request, the permittee must also furnish to the Director copies of records required by the permit. For information the permittee claims confidentiality, the Department may require the permittee to furnish such records directly to the Director along with a claim of confidentiality. [40 C.F.R. § 70.6(a)(6)(v) and Reg.26.701(F)(5)]
15. The permittee must pay all permit fees in accordance with the procedures established in Regulation 9. [40 C.F.R. § 70.6(a)(7) and Reg.26.701(G)]
16. No permit revision shall be required, under any approved economic incentives, marketable permits, emissions trading and other similar programs or processes for changes provided for elsewhere in this permit. [40 C.F.R. § 70.6(a)(8) and Reg.26.701(H)]
17. If the permit allows different operating scenarios, the permittee shall, contemporaneously with making a change from one operating scenario to another, record in a log at the permitted facility a record of the operational scenario. [40 C.F.R. § 70.6(a)(9)(i) and Reg.26.701(I)(1)]
18. The Administrator and citizens may enforce under the Act all terms and conditions in this permit, including any provisions designed to limit a source's potential to emit, unless the Department specifically designates terms and conditions of the permit as being federally unenforceable under the Act or under any of its applicable requirements. [40 C.F.R. § 70.6(b) and Reg.26.702(A) and (B)]
19. Any document (including reports) required by this permit pursuant to 40 C.F.R. § 70 must contain a certification by a responsible official as defined in Reg.26.2. [40 C.F.R. § 70.6(c)(1) and Reg.26.703(A)]
20. The permittee must allow an authorized representative of the Department, upon presentation of credentials, to perform the following: [40 C.F.R. § 70.6(c)(2) and Reg.26.703(B)]
  - a. Enter upon the permittee's premises where the permitted source is located or emissions related activity is conducted, or where records must be kept under the conditions of this permit;
  - b. Have access to and copy, at reasonable times, any records required under the conditions of this permit;
  - c. Inspect at reasonable times any facilities, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under this permit; and
  - d. As authorized by the Act, sample or monitor at reasonable times substances or parameters for assuring compliance with this permit or applicable requirements.

21. The permittee shall submit a compliance certification with the terms and conditions contained in the permit, including emission limitations, standards, or work practices. The permittee must submit the compliance certification annually. If the permit establishes no other reporting period, the reporting period shall end on the last day of the anniversary month of the initial Title V permit. The report is due on the first day of the second month after the end of the reporting period. The permittee must also submit the compliance certification to the Administrator as well as to the Department. All compliance certifications required by this permit must include the following: [40 C.F.R. § 70.6(c)(5) and Reg.26.703(E)(3)]
  - a. The identification of each term or condition of the permit that is the basis of the certification;
  - b. The compliance status;
  - c. Whether compliance was continuous or intermittent;
  - d. The method(s) used for determining the compliance status of the source, currently and over the reporting period established by the monitoring requirements of this permit; and
  - e. Such other facts as the Department may require elsewhere in this permit or by § 114(a)(3) and § 504(b) of the Act.
22. Nothing in this permit will alter or affect the following: [Reg.26.704(C)]
  - a. The provisions of Section 303 of the Act (emergency orders), including the authority of the Administrator under that section;
  - b. The liability of the permittee for any violation of applicable requirements prior to or at the time of permit issuance;
  - c. The applicable requirements of the acid rain program, consistent with § 408(a) of the Act; or
  - d. The ability of EPA to obtain information from a source pursuant to § 114 of the Act.
23. This permit authorizes only those pollutant emitting activities addressed in this permit. [Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311]
24. The permittee may request in writing and at least 15 days in advance of the deadline, an extension to any testing, compliance or other dates in this permit. No such extensions are authorized until the permittee receives written Department approval. The Department may grant such a request, at its discretion in the following circumstances:
  - a. Such an extension does not violate a federal requirement;
  - b. The permittee demonstrates the need for the extension; and
  - c. The permittee documents that all reasonable measures have been taken to meet the current deadline and documents reasons it cannot be met.

[Reg.18.314(A), Reg.19.416(A), Reg.26.1013(A), Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 52 Subpart E]

25. The permittee may request in writing and at least 30 days in advance, temporary emissions and/or testing that would otherwise exceed an emission rate, throughput requirement, or other limit in this permit. No such activities are authorized until the permittee receives written Department approval. Any such emissions shall be included in the facility's total emissions and reported as such. The Department may grant such a request, at its discretion under the following conditions:

- a. Such a request does not violate a federal requirement;
- b. Such a request is temporary in nature;
- c. Such a request will not result in a condition of air pollution;
- d. The request contains such information necessary for the Department to evaluate the request, including but not limited to, quantification of such emissions and the date/time such emission will occur;
- e. Such a request will result in increased emissions less than five tons of any individual criteria pollutant, one ton of any single HAP and 2.5 tons of total HAPs; and
- f. The permittee maintains records of the dates and results of such temporary emissions/testing.

[Reg.18.314(B), Reg.19.416(B), Reg.26.1013(B), Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 52 Subpart E]

26. The permittee may request in writing and at least 30 days in advance, an alternative to the specified monitoring in this permit. No such alternatives are authorized until the permittee receives written Department approval. The Department may grant such a request, at its discretion under the following conditions:

- a. The request does not violate a federal requirement;
- b. The request provides an equivalent or greater degree of actual monitoring to the current requirements; and
- c. Any such request, if approved, is incorporated in the next permit modification application by the permittee.

[Reg.18.314(C), Reg.19.416(C), Reg.26.1013(C), Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 52 Subpart E]

27. Any credible evidence based on sampling, monitoring, and reporting may be used to determine violations of applicable emission limitations. [Reg.18.1001, Reg.19.701, Ark. Code Ann. § 8-4-203 as referenced by Ark. Code Ann. §§ 8-4-304 and 8-4-311, and 40 C.F.R. § 52 Subpart E]

Appendix A—40 CFR Part 60, Subpart Da

# Electronic Code of Federal Regulations

## e-CFR data is current as of January 31, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 60](#) → Subpart Da

---

[Browse Previous](#) | [Browse Next](#)

Title 40: Protection of Environment

[PART 60—STANDARDS OF PERFORMANCE FOR NEW STATIONARY SOURCES](#)

---

### Subpart Da—Standards of Performance for Electric Utility Steam Generating Units

---

#### Contents

[§60.40Da Applicability and designation of affected facility.](#)

[§60.41Da Definitions.](#)

[§60.42Da Standards for particulate matter \(PM\).](#)

[§60.43Da Standards for sulfur dioxide \(SO<sub>2</sub>\).](#)

[§60.44Da Standards for nitrogen oxides \(NO<sub>2</sub>\).](#)

[§60.45Da Alternative standards for combined nitrogen oxides \(NO<sub>X</sub>\) and carbon monoxide \(CO\).](#)

[§60.46Da \[Reserved\]](#)

[§60.47Da Commercial demonstration permit.](#)

[§60.48Da Compliance provisions.](#)

[§60.49Da Emission monitoring.](#)

[§60.50Da Compliance determination procedures and methods.](#)

[§60.51Da Reporting requirements.](#)

[§60.52Da Recordkeeping requirements.](#)

---

SOURCE: 72 FR 32722, June 13, 2007, unless otherwise noted.

[↑ Back to Top](#)

#### **§60.40Da Applicability and designation of affected facility.**

(a) Except as specified in paragraph (e) of this section, the affected facility to which this subpart applies is each electric utility steam generating unit:

(1) That is capable of combusting more than 73 megawatts (MW) (250 million British thermal units per hour (MMBtu/hr)) heat input of fossil fuel (either alone or in combination with any other fuel); and

(2) For which construction, modification, or reconstruction is commenced after September 18, 1978.

(b) An IGCC electric utility steam generating unit (both the stationary combustion turbine and any associated duct burners) is subject to this part and is not subject to subpart GG or KKKK of this part if both of the conditions specified in paragraphs (b)(1) and (2) of this section are met.

(1) The IGCC electric utility steam generating unit is capable of combusting more than 73 MW (250 MMBtu/h) heat input of fossil fuel (either alone or in combination with any other fuel) in the combustion turbine engine and associated heat recovery steam generator; and

(2) The IGCC electric utility steam generating unit commenced construction, modification, or reconstruction after February 28, 2005.

(c) Any change to an existing fossil-fuel-fired steam generating unit to accommodate the use of combustible materials, other than fossil fuels, shall not bring that unit under the applicability of this subpart.

(d) Any change to an existing steam generating unit originally designed to fire gaseous or liquid fossil fuels, to accommodate the use of any other fuel (fossil or nonfossil) shall not bring that unit under the applicability of this subpart.

(e) Applicability of this subpart to an electric utility combined cycle gas turbine other than an IGCC electric utility steam generating unit is as specified in paragraphs (e)(1) through (3) of this section.

(1) Affected facilities (*i.e.* heat recovery steam generators used with duct burners) associated with a stationary combustion turbine that are capable of combusting more than 73 MW (250 MMBtu/h) heat input of fossil fuel are subject to this subpart except in cases when the affected facility (*i.e.* heat recovery steam generator) meets the applicability requirements of and is subject to subpart KKKK of this part.

(2) For heat recovery steam generators use with duct burners subject to this subpart, only emissions resulting from the combustion of fuels in the steam generating unit (*i.e.* duct burners) are subject to the standards under this subpart. (The emissions resulting from the combustion of fuels in the stationary combustion turbine engine are subject to subpart GG or KKKK, as applicable, of this part.)

(3) Any affected facility that meets the applicability requirements and is subject to subpart Eb or subpart CCCC of this part is not subject to the emission standards under subpart Da.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5078, Jan. 28, 2009; 77 FR 9448, Feb. 16, 2012]

 [Back to Top](#)

#### **§60.41Da Definitions.**

As used in this subpart, all terms not defined herein shall have the meaning given them in the Act and in subpart A of this part.

*Affirmative defense* means, in the context of an enforcement proceeding, a response or defense put forward by a defendant, regarding which the defendant has the burden of proof, and the merits of which are independently and objectively evaluated in a judicial or administrative proceeding.

*Anthracite* means coal that is classified as anthracite according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

*Available system capacity* means the capacity determined by subtracting the system load and the system emergency reserves from the net system capacity.

*Biomass* means plant materials and animal waste.

*Bituminous coal* means coal that is classified as bituminous according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

*Boiler operating day* for units constructed, reconstructed, or modified before March 1, 2005, means a 24-hour period during which fossil fuel is combusted in a steam-generating unit for the entire 24 hours. For units constructed, reconstructed, or modified after February 28, 2005, *boiler operating day* means a 24-hour period between 12 midnight and the following midnight during which any fuel is combusted at any time in the steam-generating unit. It is not necessary for fuel to be combusted the entire 24-hour period.

*Coal* means all solid fuels classified as anthracite, bituminous, subbituminous, or lignite by the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17) and coal refuse. Synthetic fuels derived from coal for the purpose of creating useful heat, including but not limited to solvent-refined coal, gasified coal, coal-oil mixtures, and coal-water mixtures are included in this definition for the purposes of this subpart.

*Coal-fired electric utility steam generating unit* means an electric utility steam generating unit that burns coal, coal refuse, or a synthetic gas derived from coal either exclusively, in any combination together, or in any combination with other fuels in any amount.

*Coal refuse* means waste products of coal mining, physical coal cleaning, and coal preparation operations (e.g. culm, gob, etc.) containing coal, matrix material, clay, and other organic and inorganic material.

*Combined cycle gas turbine* means a stationary turbine combustion system where heat from the turbine exhaust gases is recovered by a steam generating unit.

*Combined heat and power*, also known as “cogeneration,” means a steam-generating unit that simultaneously produces both electric (and mechanical) and useful thermal energy from the same primary energy source.

*Duct burner* means a device that combusts fuel and that is placed in the exhaust duct from another source, such as a stationary gas turbine, internal combustion engine, kiln, etc., to allow the firing of additional fuel to heat the exhaust gases before the exhaust gases enter a heat recovery steam generating unit.

*Electric utility combined cycle gas turbine* means any combined cycle gas turbine used for electric generation that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW net-electrical output to any utility power distribution system for sale. Any steam distribution system that is constructed for the purpose of providing steam to a steam electric generator that would produce electrical power for sale is also considered in determining the electrical energy output capacity of the affected facility.



*Electric utility steam-generating unit* means any steam electric generating unit that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW net-electrical output to any utility power distribution system for sale. Also, any steam supplied to a steam distribution system for the purpose of providing steam to a steam-electric generator that would produce electrical energy for sale is considered in determining the electrical energy output capacity of the affected facility.

*Electrostatic precipitator or ESP* means an add-on air pollution control device used to capture particulate matter (PM) by charging the particles using an electrostatic field, collecting the particles using a grounded collecting surface, and transporting the particles into a hopper.

*Emission limitation* means any emissions limit or operating limit.

*Federally enforceable* means all limitations and conditions that are enforceable by the Administrator, including the requirements of 40 CFR parts 60 and 61, requirements within any applicable State implementation plan, and any permit requirements established under 40 CFR 52.21 or under 40 CFR 51.18 and 51.24.

*Fossil fuel* means natural gas, petroleum, coal, and any form of solid, liquid, or gaseous fuel derived from such material for the purpose of creating useful heat.

*Gaseous fuel* means any fuel that is present as a gas at standard conditions and includes, but is not limited to, natural gas, refinery fuel gas, process gas, coke-oven gas, synthetic gas, and gasified coal.

*Gross energy output* means:

(1) For facilities constructed, reconstructed, (1, or modified before May 4, 2011, the gross electrical or mechanical output from the affected facility plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process);

(2) For facilities constructed, reconstructed, (2, or modified after May 3, 2011, the gross electrical or mechanical output from the affected facility minus any electricity used to power the feedwater pumps and any associated gas compressors (air separation unit main compressor, oxygen compressor, and nitrogen compressor) plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process);

(3) For combined heat and power facilities constructed, reconstructed, or modified after May 3, 2011, the gross electrical or mechanical output from the affected facility divided by 0.95 minus any electricity used to power the feedwater pumps and any associated gas compressors (air separation unit main compressor, oxygen compressor, and nitrogen compressor) plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process);

(4) For a IGCC electric utility generating unit that coproduces chemicals constructed, reconstructed, or modified after May 3, 2011, the gross useful work performed is the gross electrical or mechanical output from the unit minus electricity used to power the feedwater pumps and any associated gas compressors (air separation unit main compressor, oxygen compressor, and nitrogen compressor) that are associated with power production plus 75 percent of the useful

thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process). Auxiliary loads that are associated with power production are determined based on the energy in the coproduced chemicals compared to the energy of the syngas combusted in combustion turbine engine and associated duct burners.

*24-hour period* means the period of time between 12:01 a.m. and 12:00 midnight.

*Integrated gasification combined cycle electric utility steam generating unit* or *IGCC electric utility steam generating unit* means an electric utility combined cycle gas turbine that is designed to burn fuels containing 50 percent (by heat input) or more solid-derived fuel not meeting the definition of natural gas. The Administrator may waive the 50 percent solid-derived fuel requirement during periods of the gasification system construction, startup and commissioning, shutdown, or repair. No solid fuel is directly burned in the unit during operation.

*ISO conditions* means a temperature of 288 Kelvin, a relative humidity of 60 percent, and a pressure of 101.3 kilopascals.

*Lignite* means coal that is classified as lignite A or B according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

*Natural gas* means a fluid mixture of hydrocarbons (e.g., methane, ethane, or propane), composed of at least 70 percent methane by volume or that has a gross calorific value between 35 and 41 megajoules (MJ) per dry standard cubic meter (950 and 1,100 Btu per dry standard cubic foot), that maintains a gaseous state under ISO conditions. In addition, *natural gas* contains 20.0 grains or less of total sulfur per 100 standard cubic feet. Finally, *natural gas* does not include the following gaseous fuels: landfill gas, digester gas, refinery gas, sour gas, blast furnace gas, coal-derived gas, producer gas, coke oven gas, or any gaseous fuel produced in a process which might result in highly variable sulfur content or heating value.

*Neighboring company* means any one of those electric utility companies with one or more electric power interconnections to the principal company and which have geographically adjoining service areas.

*Net-electric output* means the gross electric sales to the utility power distribution system minus purchased power on a calendar year basis.

*Net energy output* means the gross energy output minus the parasitic load associated with power production. Parasitic load includes, but is not limited to, the power required to operate the equipment used for fuel delivery systems, air pollution control systems, wastewater treatment systems, ash handling and disposal systems, and other controls (*i.e.*, pumps, fans, compressors, motors, instrumentation, and other ancillary equipment required to operate the affected facility).

*Noncontinental area* means the State of Hawaii, the Virgin Islands, Guam, American Samoa, the Commonwealth of Puerto Rico, or the Northern Mariana Islands.

*Out-of-control period* means any period beginning with the quadrant corresponding to the completion of a daily calibration error, linearity check, or quality assurance audit that indicates that the instrument is not measuring and recording within the applicable performance specifications and ending with the quadrant corresponding to the completion of an additional calibration error, linearity check, or quality assurance audit following corrective action that demonstrates that the instrument is measuring and recording within the applicable performance specifications.

*Petroleum* for facilities constructed, reconstructed, or modified before May 4, 2011, means crude oil or a fuel derived from crude oil, including, but not limited to, distillate oil, and residual oil. For units constructed, reconstructed, or modified after May 3, 2011, *petroleum* means crude oil or a fuel derived from crude oil, including, but not limited to, distillate oil, residual oil, and petroleum coke.

*Petroleum coke*, also known as “petcoke,” means a carbonization product of high-boiling hydrocarbon fractions obtained in petroleum processing (heavy residues). *Petroleum coke* is typically derived from oil refinery coker units or other cracking processes.

*Potential combustion concentration* means the theoretical emissions (nanograms per joule (ng/J), lb/MMBtu heat input) that would result from combustion of a fuel in an uncleaned state without emission control systems. For sulfur dioxide (SO<sub>2</sub>) the potential combustion concentration is determined under §60.50Da(c).

*Potential electrical output capacity* means 33 percent of the maximum design heat input capacity of the steam generating unit, divided by 3,413 Btu/KWh, divided by 1,000 kWh/MWh, and multiplied by 8,760 hr/yr (e.g., a steam generating unit with a 100 MW (340 MMBtu/hr) fossil-fuel heat input capacity would have a 289,080 MWh 12 month potential electrical output capacity). For electric utility combined cycle gas turbines the potential electrical output capacity is determined on the basis of the fossil-fuel firing capacity of the steam generator exclusive of the heat input and electrical power contribution by the gas turbine.

*Resource recovery unit* means a facility that combusts more than 75 percent non-fossil fuel on a quarterly (calendar) heat input basis.

*Solid-derived fuel* means any solid, liquid, or gaseous fuel derived from solid fuel for the purpose of creating useful heat and includes, but is not limited to, solvent refined coal, liquified coal, synthetic gas, gasified coal, gasified petroleum coke, gasified biomass, and gasified tire derived fuel.

*Steam generating unit* for facilities constructed, reconstructed, or modified before May 4, 2011, means any furnace, boiler, or other device used for combusting fuel for the purpose of producing steam (including fossil-fuel-fired steam generators associated with combined cycle gas turbines; nuclear steam generators are not included). For units constructed, reconstructed, or modified after May 3, 2011, *steam generating unit* means any furnace, boiler, or other device used for combusting fuel for the purpose of producing steam (including fossil-fuel-fired steam generators associated with combined cycle gas turbines; nuclear steam generators are not included) plus any integrated combustion turbines and fuel cells.

*Subbituminous coal* means coal that is classified as subbituminous A, B, or C according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

*Wet flue gas desulfurization technology* or *wet FGD* means a SO<sub>2</sub> control system that is located downstream of the steam generating unit and removes sulfur oxides from the combustion gases of the steam generating unit by contacting the combustion gases with an alkaline slurry or solution and forming a liquid material. This definition applies to devices where the aqueous liquid material product of this contact is subsequently converted to other forms. Alkaline reagents used in wet FGD technology include, but are not limited to, lime, limestone, and sodium.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5079, Jan. 28, 2009; 77 FR 9448, Feb. 16, 2012; 77 FR 23402, Apr. 19, 2012; 78 FR 24082, Apr. 24, 2013]

 [Back to Top](#)

**§60.42Da Standards for particulate matter (PM).**

(a) Except as provided in paragraph (f) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, an owner or operator of an affected facility shall not cause to be discharged into the atmosphere from any affected facility for which construction, reconstruction, or modification commenced before March 1, 2005, any gases that contain PM in excess of 13 ng/J (0.03 lb/MMBtu) heat input.

(b) Except as provided in paragraphs (b)(1) and (b)(2) of this section, on and after the date the initial PM performance test is completed or required to be completed under §60.8, whichever date comes first, an owner or operator of an affected facility shall not cause to be discharged into the atmosphere any gases which exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity.

(1) An owner or operator of an affected facility that elects to install, calibrate, maintain, and operate a continuous emissions monitoring system (CEMS) for measuring PM emissions according to the requirements of this subpart is exempt from the opacity standard specified in this paragraph (b) of this section.

(2) An owner or operator of an affected facility that combusts only natural gas and/or synthetic natural gas that chemically meets the definition of natural gas is exempt from the opacity standard specified in paragraph (b) of this section.

(c) Except as provided in paragraphs (d) and (f) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005, but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of either:

(1) 18 ng/J (0.14 lb/MWh) gross energy output; or

(2) 6.4 ng/J (0.015 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel.

(d) As an alternative to meeting the requirements of paragraph (c) of this section, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, but before May 4, 2011, may elect to meet the requirements of this paragraph. On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of:

(1) 13 ng/J (0.030 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel, and

(2) For an affected facility that commenced construction or reconstruction, 0.1 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.9 percent reduction) when combusting solid, liquid, or gaseous fuel, or

(3) For an affected facility that commenced modification, 0.2 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.8 percent reduction) when combusting solid, liquid, or gaseous fuel.

(e) Except as provided in paragraph (f) of this section, the owner or operator of an affected facility that commenced construction, reconstruction, or modification commenced after May 3, 2011, shall meet the requirements specified in paragraphs (e)(1) and (2) of this section.

(1) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, the owner or operator shall not cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of the applicable emissions limit specified in paragraphs (e)(1)(i) or (ii) of this section.

(i) For an affected facility which commenced construction or reconstruction:

(A) 11 ng/J (0.090 lb/MWh) gross energy output; or

(B) 12 ng/J (0.097 lb/MWh) net energy output.

(ii) For an affected facility which commenced modification, the emission limits specified in paragraphs (c) or (d) of this section.

(2) During startup periods and shutdown periods, owners or operators of facilities subject to subpart UUUUU of part 63 of this chapter shall meet the work practice standards specified in Table 3 to subpart UUUUU of part 63 and use the relevant definitions in §63.10042, and owners or operators of facilities subject to subpart DDDDD of part 63 shall meet the work practice standards specified in Table 3 to subpart DDDDD of part 63 and use the relevant definition used in §63.7575.

(f) An owner or operator of an affected facility that meets the conditions in either paragraphs (f)(1) or (2) of this section is exempt from the PM emissions limits in this section.

(1) The affected facility combusts only gaseous or liquid fuels (excluding residual oil) with potential SO<sub>2</sub> emissions rates of 26 ng/J (0.060 lb/MMBtu) or less, and that does not use a post-combustion technology to reduce emissions of SO<sub>2</sub> or PM.

(2) The affected facility is operated under a PM commercial demonstration permit issued by the Administrator according to the provisions of §60.47Da.

[77 FR 9450, Feb. 16, 2012, as amended at 78 FR 24083, Apr. 24, 2013; 79 FR 68788, Nov. 19, 2014]

 [Back to Top](#)

### **§60.43Da Standards for sulfur dioxide (SO<sub>2</sub>).**

(a) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts solid fuel or solid-derived fuel and for which construction, reconstruction, or modification commenced before or on February 28, 2005, except as provided under paragraphs (c), (d), (f) or (h) of this section, any gases that contain SO<sub>2</sub> in excess of:

(1) 520 ng/J (1.20 lb/MMBtu) heat input and 10 percent of the potential combustion concentration (90 percent reduction);

(2) 30 percent of the potential combustion concentration (70 percent reduction), when emissions are less than 260 ng/J (0.60 lb/MMBtu) heat input;

(3) 180 ng/J (1.4 lb/MWh) gross energy output; or

(4) 65 ng/J (0.15 lb/MMBtu) heat input.

(b) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts liquid or gaseous fuels (except for liquid or gaseous fuels derived from solid fuels and as provided under paragraphs (e) or (h) of this section) and for which construction, reconstruction, or modification commenced before or on February 28, 2005, any gases that contain SO<sub>2</sub> in excess of:

(1) 340 ng/J (0.80 lb/MMBtu) heat input and 10 percent of the potential combustion concentration (90 percent reduction); or

(2) 100 percent of the potential combustion concentration (zero percent reduction) when emissions are less than 86 ng/J (0.20 lb/MMBtu) heat input.

(c) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts solid solvent refined coal (SRC-I) any gases that contain SO<sub>2</sub> in excess of 520 ng/J (1.20 lb/MMBtu) heat input and 15 percent of the potential combustion concentration (85 percent reduction) except as provided under paragraph (f) of this section; compliance with the emission limitation is determined on a 30-day rolling average basis and compliance with the percent reduction requirement is determined on a 24-hour basis.

(d) Sulfur dioxide emissions are limited to 520 ng/J (1.20 lb/MMBtu) heat input from any affected facility which:

(1) Combusts 100 percent anthracite;

(2) Is classified as a resource recovery unit; or

(3) Is located in a noncontinental area and combusts solid fuel or solid-derived fuel.

(e) Sulfur dioxide emissions are limited to 340 ng/J (0.80 lb/MMBtu) heat input from any affected facility which is located in a noncontinental area and combusts liquid or gaseous fuels (excluding solid-derived fuels).

(f) The SO<sub>2</sub> standards under this section do not apply to an owner or operator of an affected facility that is operated under an SO<sub>2</sub> commercial demonstration permit issued by the Administrator in accordance with the provisions of §60.47Da.

(g) Compliance with the emission limitation and percent reduction requirements under this section are both determined on a 30-day rolling average basis except as provided under paragraph (c) of this section.

(h) When different fuels are combusted simultaneously, the applicable standard is determined by proration using the following formula:

(1) If emissions of SO<sub>2</sub> to the atmosphere are greater than 260 ng/J (0.60 lb/MMBtu) heat input

$$E_p = \frac{(340x + 520y)}{100} \quad \text{and} \quad \%P_p = 10$$

[View or download PDF](#)

(2) If emissions of SO<sub>2</sub> to the atmosphere are equal to or less than 260 ng/J (0.60 lb/MMBtu) heat input:

$$E_p = \frac{(340x + 520y)}{100} \quad \text{and} \quad \%P_p = \frac{(10x + 30y)}{100}$$

[View or download PDF](#)

Where:

E<sub>s</sub> = Prorated SO<sub>2</sub> emission limit (ng/J heat input);

%P<sub>s</sub> = Percentage of potential SO<sub>2</sub> emission allowed;

x = Percentage of total heat input derived from the combustion of liquid or gaseous fuels (excluding solid-derived fuels); and

y = Percentage of total heat input derived from the combustion of solid fuel (including solid-derived fuels).

(i) Except as provided in paragraphs (j) and (k) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility, any gases that contain SO<sub>2</sub> in excess of the applicable emissions limit specified in paragraphs (i)(1) through (3) of this section.

(1) For an affected facility which commenced construction, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output; or

(ii) 5 percent of the potential combustion concentration (95 percent reduction).

(2) For an affected facility which commenced reconstruction, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input; or

(iii) 5 percent of the potential combustion concentration (95 percent reduction).

(3) For an affected facility which commenced modification, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input; or

(iii) 10 percent of the potential combustion concentration (90 percent reduction).

(j) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification commenced after February 28, 2005, and that burns 75 percent or more (by heat input) coal refuse on a 12-month rolling average basis, shall caused to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of the applicable emission limitation specified in paragraphs (j)(1) through (3) of this section.

(1) For an affected facility for which construction commenced after February 28, 2005, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis; or

(ii) 6 percent of the potential combustion concentration (94 percent reduction) on a 30-day rolling average basis.

(2) For an affected facility for which reconstruction commenced after February 28, 2005, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or

(iii) 6 percent of the potential combustion concentration (94 percent reduction) on a 30-day rolling average basis.

(3) For an affected facility for which modification commenced after February 28, 2005, any gases that contain SO<sub>2</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or

(iii) 10 percent of the potential combustion concentration (90 percent reduction) on a 30-day rolling average basis.

(k) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility



located in a noncontinental area for which construction, reconstruction, or modification commenced after February 28, 2005, but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of the applicable emissions limit specified in paragraphs (k)(1) and (2) of this section.

(1) For an affected facility that burns solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 520 ng/J (1.2 lb/MMBtu) heat input.

(2) For an affected facility that burns other than solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 230 ng/J (0.54 lb/MMBtu) heat input.

(l) Except as provided in paragraphs (j) and (m) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility for which construction, reconstruction, or modification commenced after May 3, 2011, shall cause to be discharged into the atmosphere from that affected facility, any gases that contain SO<sub>2</sub> in excess of the applicable emissions limit specified in paragraphs (l)(1) and (2) of this section.

(1) For an affected facility which commenced construction or reconstruction, any gases that contain SO<sub>2</sub> in excess of either:

- (i) 130 ng/J (1.0 lb/MWh) gross energy output; or
- (ii) 140 ng/J (1.2 lb/MWh) net energy output; or
- (iii) 3 percent of the potential combustion concentration (97 percent reduction).

(2) For an affected facility which commenced modification, any gases that contain SO<sub>2</sub> in excess of either:

- (i) 180 ng/J (1.4 lb/MWh) gross energy output; or
- (ii) 10 percent of the potential combustion concentration (90 percent reduction).

(m) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility located in a noncontinental area for which construction, reconstruction, or modification commenced after May 3, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of the applicable emissions limit specified in paragraphs (m)(1) and (2) of this section.

(1) For an affected facility that burns solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 520 ng/J (1.2 lb/MMBtu) heat input.

(2) For an affected facility that burns other than solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 230 ng/J (0.54 lb/MMBtu) heat input.

[↑ Back to Top](#)

**§60.44Da Standards for nitrogen oxides (NO<sub>2</sub>).**

(a) Except as provided in paragraph (h) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility for which construction, reconstruction, or modification commenced before July 10, 1997 any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the applicable emissions limit in paragraphs (a)(1) and (2) of this section.

(1) The owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> in excess of the emissions limit listed in the following table as applicable to the fuel type combusted and as determined on a 30-boiler operating day rolling average basis.

| Fuel type                                                                                                                                                                    | Emission limit for heat input |                  |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------|------------------|
|                                                                                                                                                                              | ng/J                          | lb/MMBtu         |
| Gaseous fuels:                                                                                                                                                               |                               |                  |
| Coal-derived fuels                                                                                                                                                           | 210                           | 0.50             |
| All other fuels                                                                                                                                                              | 86                            | 0.20             |
| Liquid fuels:                                                                                                                                                                |                               |                  |
| Coal-derived fuels                                                                                                                                                           | 210                           | 0.50             |
| Shale oil                                                                                                                                                                    | 210                           | 0.50             |
| All other fuels                                                                                                                                                              | 130                           | 0.30             |
| Solid fuels:                                                                                                                                                                 |                               |                  |
| Coal-derived fuels                                                                                                                                                           | 210                           | 0.50             |
| Any fuel containing more than 25%, by weight, coal refuse                                                                                                                    | ( <sup>1</sup> )              | ( <sup>1</sup> ) |
| Any fuel containing more than 25%, by weight, lignite if the lignite is mined in North Dakota, South Dakota, or Montana, and is combusted in a slag tap furnace <sup>2</sup> | 340                           | 0.80             |
| Any fuel containing more than 25%, by weight, lignite not subject to the 340 ng/J heat input emission limit <sup>2</sup>                                                     | 260                           | 0.60             |
| Subbituminous coal                                                                                                                                                           | 210                           | 0.50             |
| Bituminous coal                                                                                                                                                              | 260                           | 0.60             |
| Anthracite coal                                                                                                                                                              | 260                           | 0.60             |

|                 |     |      |
|-----------------|-----|------|
| All other fuels | 260 | 0.60 |
|-----------------|-----|------|

<sup>1</sup>Exempt from NO<sub>x</sub> standards and NO<sub>x</sub> monitoring requirements.

<sup>2</sup>Any fuel containing less than 25%, by weight, lignite is not prorated but its percentage is added to the percentage of the predominant fuel.

(2) When two or more fuels are combusted simultaneously in an affected facility, the applicable emissions limit (E<sub>n</sub>) is determined by proration using the following formula:

$$E_n = \frac{(86w + 130x + 210y + 260z + 340v)}{100}$$

[View or download PDF](#)

Where:

E<sub>n</sub> = Applicable NO<sub>x</sub> emissions limit when multiple fuels are combusted simultaneously (ng/J heat input);

w = Percentage of total heat input derived from the combustion of fuels subject to the 86 ng/J heat input standard;

x = Percentage of total heat input derived from the combustion of fuels subject to the 130 ng/J heat input standard;

y = Percentage of total heat input derived from the combustion of fuels subject to the 210 ng/J heat input standard;

z = Percentage of total heat input derived from the combustion of fuels subject to the 260 ng/J heat input standard;  
and

v = Percentage of total heat input delivered from the combustion of fuels subject to the 340 ng/J heat input standard.

(b)-(c) [Reserved]

(d) Except as provided in paragraph (h) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after July 9, 1997, but before March 1, 2005, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the applicable emissions limit specified in paragraphs (d)(1) and (2) of this section as determined on a 30-boiler operating day rolling average basis.

(1) For an affected facility which commenced construction, any gases that contain NO<sub>x</sub> in excess of 200 ng/J (1.6 lb/MWh) gross energy output.

(2) For an affected facility which commenced reconstruction, any gases that contain NO<sub>x</sub> in excess of 65 ng/J (0.15 lb/MMBtu) heat input.

(e) Except as provided in paragraphs (f) and (h) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005 but before May 4, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the applicable emissions limit specified in paragraphs (e)(1) through (3) of this section as determined on a 30-boiler operating day rolling average basis.

(1) For an affected facility which commenced construction, any gases that contain NO<sub>x</sub> in excess of 130 ng/J (1.0 lb/MWh) gross energy output.

(2) For an affected facility which commenced reconstruction, any gases that contain NO<sub>x</sub> in excess of either:

(i) 130 ng/J (1.0 lb/MWh) gross energy output; or

(ii) 47 ng/J (0.11 lb/MMBtu) heat input.

(3) For an affected facility which commenced modification, any gases that contain NO<sub>x</sub> in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output; or

(ii) 65 ng/J (0.15 lb/MMBtu) heat input.

(f) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, the owner or operator of an IGCC electric utility steam generating unit subject to the provisions of this subpart and for which construction, reconstruction, or modification commenced after February 28, 2005 but before May 4, 2011, shall meet the requirements specified in paragraphs (f)(1) through (3) of this section.

(1) Except as provided for in paragraphs (f)(2) and (3) of this section, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of 130 ng/J (1.0 lb/MWh) gross energy output.

(2) When burning liquid fuel exclusively or in combination with solid-derived fuel such that the liquid fuel contributes 50 percent or more of the total heat input to the combined cycle combustion turbine, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of 190 ng/J (1.5 lb/MWh) gross energy output.

(3) In cases when during a 30-boiler operating day rolling average compliance period liquid fuel is burned in such a manner to meet the conditions in paragraph (f)(2) of this section for only a portion of the clock hours in the 30-day compliance period, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the computed weighted-average emissions limit based on the proportion of gross energy output (in MWh) generated during the compliance period for each of emissions limits in paragraphs (f)(1) and (2) of this section.

(g) Except as provided in paragraphs (h) of this section and §60.45Da, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after May 3, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the applicable emissions limit specified in paragraphs (g)(1) through (3) of this section.

(1) For an affected facility which commenced construction or reconstruction, any gases that contain NO<sub>x</sub> in excess of either:

(i) 88 ng/J (0.70 lb/MWh) gross energy output; or

(ii) 95 ng/J (0.76 lb/MWh) net energy output.

(2) For an affected facility which commenced construction or reconstruction and that burns 75 percent or more coal refuse (by heat input) on a 12-month rolling average basis, any gases that contain NO<sub>x</sub> in excess of either:

(i) 110 ng/J (0.85 lb/MWh) gross energy output; or

(ii) 120 ng/J (0.92 lb/MWh) net energy output.

(3) For an affected facility which commenced modification, any gases that contain NO<sub>x</sub> in excess of 140 ng/J (1.1 lb/MWh) gross energy output.

(h) The NO<sub>x</sub> emissions limits under this section do not apply to an owner or operator of an affected facility which is operating under a commercial demonstration permit issued by the Administrator in accordance with the provisions of §60.47Da.

[77 FR 9451, Feb. 16, 2012]

[↑ Back to Top](#)

**§60.45Da Alternative standards for combined nitrogen oxides (NO<sub>x</sub>) and carbon monoxide (CO).**

(a) The owner or operator of an affected facility that commenced construction, reconstruction, or modification after May 3, 2011 as alternate to meeting the applicable NO<sub>x</sub> emissions limits specified in §60.44Da may elect to meet the applicable standards for combined NO<sub>x</sub> and CO specified in paragraph (b) of this section.

(b) On and after the date on which the initial performance test is completed or required to be completed under §60.8 no owner or operator of an affected facility that commenced construction, reconstruction, or modification after May 3, 2011, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) plus CO in excess of the applicable emissions limit specified in paragraphs (b)(1) through (3) of this section as determined on a 30-boiler operating day rolling average basis.

(1) For an affected facility which commenced construction or reconstruction, any gases that contain NO<sub>x</sub> plus CO in excess of either:

(i) 140 ng/J (1.1 lb/MWh) gross energy output; or

(ii) 150 ng/J (1.2 lb/MWh) net energy output.

(2) For an affected facility which commenced construction or reconstruction and that burns 75 percent or more coal refuse (by heat input) on a 12-month rolling average basis, any gases that contain NO<sub>x</sub> plus CO in excess of either:

(i) 160 ng/J (1.3 lb/MWh) gross energy output; or

(ii) 170 ng/J (1.4 lb/MWh) net energy output.

(3) For an affected facility which commenced modification, any gases that contain NO<sub>x</sub> plus CO in excess of 190 ng/J (1.5 lb/MWh) gross energy output.

[77 FR 9453, Feb. 16, 2012]

[↑ Back to Top](#)

#### **§60.46Da [Reserved]**

[↑ Back to Top](#)

#### **§60.47Da Commercial demonstration permit.**

(a) An owner or operator of an affected facility proposing to demonstrate an emerging technology may apply to the Administrator for a commercial demonstration permit. The Administrator will issue a commercial demonstration permit in accordance with paragraph (e) of this section. Commercial demonstration permits may be issued only by the Administrator, and this authority will not be delegated.

(b) An owner or operator of an affected facility that combusts solid solvent refined coal (SRC-I) and who is issued a commercial demonstration permit by the Administrator is not subject to the SO<sub>2</sub> emission reduction requirements under §60.43Da(c) but must, as a minimum, reduce SO<sub>2</sub> emissions to 20 percent of the potential combustion concentration (80 percent reduction) for each 24-hour period of steam generator operation and to less than 520 ng/J (1.20 lb/MMBtu) heat input on a 30-day rolling average basis.

(c) An owner or operator of an affected facility that uses fluidized bed combustion (atmospheric or pressurized) and who is issued a commercial demonstration permit by the Administrator is not subject to the SO<sub>2</sub> emission reduction requirements under §60.43Da(a) but must, as a minimum, reduce SO<sub>2</sub> emissions to 15 percent of the potential combustion concentration (85 percent reduction) on a 30-day rolling average basis and to less than 520 ng/J (1.20 lb/MMBtu) heat input on a 30-day rolling average basis.

(d) The owner or operator of an affected facility that combusts coal-derived liquid fuel and who is issued a commercial demonstration permit by the Administrator is not subject to the applicable NO<sub>x</sub> emission limitation and percent reduction under §60.44Da(a) but must, as a minimum, reduce emissions to less than 300 ng/J (0.70 lb/MMBtu) heat input on a 30-day rolling average basis.

(e) Commercial demonstration permits may not exceed the following equivalent MW electrical generation capacity for any one technology category, and the total equivalent MW electrical generation capacity for all commercial demonstration plants may not exceed 15,000 MW.

| <b>Technology</b>                      | <b>Pollutant</b> | <b>Equivalent electrical capacity<br/>(MW electrical output)</b> |
|----------------------------------------|------------------|------------------------------------------------------------------|
| Solid solvent refined coal (SCR I)     | SO <sub>2</sub>  | 6,000-10,000                                                     |
| Fluidized bed combustion (atmospheric) | SO <sub>2</sub>  | 400-3,000                                                        |
| Fluidized bed combustion (pressurized) | SO <sub>2</sub>  | 400-1,200                                                        |
| Coal liquification                     | NO <sub>x</sub>  | 750-10,000                                                       |

|                                      |        |
|--------------------------------------|--------|
| Total allowable for all technologies | 15,000 |
|--------------------------------------|--------|

(f) An owner or operator of an affected facility that uses a pressurized fluidized bed or a multi-pollutant emissions controls system who is issued a commercial demonstration permit by the Administrator is not subject to the total PM emission reduction requirements under §60.42Da but must, as a minimum, reduce PM emissions to less than 6.4 ng/J (0.015 lb/MMBtu) heat input.

(g) An owner or operator of an affected facility that uses a pressurized fluidized bed or a multi-pollutant emissions controls system who is issued a commercial demonstration permit by the Administrator is not subject to the SO<sub>2</sub> standards or emission reduction requirements under §60.43Da but must, as a minimum, reduce SO<sub>2</sub> emissions to 5 percent of the potential combustion concentration (95 percent reduction) or to less than 180 ng/J (1.4 lb/MWh) gross energy output on a 30-boiler operating day rolling average basis.

(h) An owner or operator of an affected facility that uses a pressurized fluidized bed or a multi-pollutant emissions control system or advanced combustion controls who is issued a commercial demonstration permit by the Administrator is not subject to the NO<sub>x</sub> standards or emission reduction requirements under §60.44Da but must, as a minimum, reduce NO<sub>x</sub> emissions to less than 130 ng/J (1.0 lb/MWh) or the combined NO<sub>x</sub> plus CO emissions to less than 180 ng/J (1.4 lb/MWh) gross energy output on a 30-boiler operating day rolling average basis.

(i) Commercial demonstration permits may not exceed the following equivalent MW electrical generation capacity for any one technology category listed in the following table.

| Technology                           | Pollutant       | Equivalent electrical capacity (MW electrical output) |
|--------------------------------------|-----------------|-------------------------------------------------------|
| Multi-pollutant Emission Control     | SO <sub>2</sub> | 1,000                                                 |
| Multi-pollutant Emission Control     | NO <sub>x</sub> | 1,000                                                 |
| Multi-pollutant Emission Control     | PM              | 1,000                                                 |
| Pressurized Fluidized Bed Combustion | SO <sub>2</sub> | 1,000                                                 |
| Pressurized Fluidized Bed Combustion | NO <sub>x</sub> | 1,000                                                 |
| Pressurized Fluidized Bed Combustion | PM              | 1,000                                                 |
| Advanced Combustion Controls         | NO <sub>x</sub> | 1,000                                                 |

[72 FR 32722, June 13, 2007, as amended at 77 FR 9450, Feb. 16, 2012]

[↑ Back to Top](#)

#### **§60.48Da Compliance provisions.**

(a) For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, the applicable PM emissions limit and opacity standard under §60.42Da, SO<sub>2</sub> emissions limit under §60.43Da, and NO<sub>x</sub> emissions limit under §60.44Da apply at all times except during periods of startup, shutdown, or malfunction. For affected facilities for which construction, modification, or reconstruction commenced after May 3, 2011, the applicable

SO<sub>2</sub> emissions limit under §60.43Da, NO<sub>x</sub> emissions limit under §60.44Da, and NO<sub>x</sub> plus CO emissions limit under §60.45Da apply at all times. The applicable PM emissions limit and opacity standard under §60.42Da apply at all times except during periods of startup and shutdown.

(b) After the initial performance test required under §60.8, compliance with the applicable SO<sub>2</sub> emissions limit and percentage reduction requirements under §60.43Da, NO<sub>x</sub> emissions limit under §60.44Da, and NO<sub>x</sub> plus CO emissions limit under §60.45Da is based on the average emission rate for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day after the initial performance test, and a new 30-boiler operating day rolling average emission rate for both SO<sub>2</sub>, NO<sub>x</sub> or NO<sub>x</sub> plus CO as applicable, and a new percent reduction for SO<sub>2</sub> are calculated to demonstrate compliance with the standards.

(c) For the initial performance test required under §60.8, compliance with the applicable SO<sub>2</sub> emissions limits and percentage reduction requirements under §60.43Da, the NO<sub>x</sub> emissions limits under §60.44Da, and the NO<sub>x</sub> plus CO emissions limits under §60.45Da is based on the average emission rates for SO<sub>2</sub>, NO<sub>x</sub>, CO, and percent reduction for SO<sub>2</sub> for the first 30 successive boiler operating days. The initial performance test is the only test in which at least 30 days prior notice is required unless otherwise specified by the Administrator. The initial performance test is to be scheduled so that the first boiler operating day of the 30 successive boiler operating days is completed within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of the facility.

(d) For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, compliance with applicable 30-boiler operating day rolling average SO<sub>2</sub> and NO<sub>x</sub> emissions limits is determined by calculating the arithmetic average of all hourly emission rates for SO<sub>2</sub> and NO<sub>x</sub> for the 30 successive boiler operating days, except for data obtained during startup, shutdown, or malfunction. For affected facilities for which construction, modification, or reconstruction commenced after May 3, 2011, compliance with applicable 30-boiler operating day rolling average SO<sub>2</sub> and NO<sub>x</sub> emissions limits is determined by dividing the sum of the SO<sub>2</sub> and NO<sub>x</sub> emissions for the 30 successive boiler operating days by the sum of the gross energy output or net energy output, as applicable, for the 30 successive boiler operating days.

(e) For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, compliance with applicable SO<sub>2</sub> percentage reduction requirements is determined based on the average inlet and outlet SO<sub>2</sub> emission rates for the 30 successive boiler operating days. For affected facilities for which construction, modification, or reconstruction commenced after May 3, 2011, compliance with applicable SO<sub>2</sub> percentage reduction requirements is determined based on the "as fired" total potential emissions and the total outlet SO<sub>2</sub> emissions for the 30 successive boiler operating days.

(f) For affected facilities for which construction, modification, or reconstruction commenced before May 4, 2011, compliance with the applicable daily average PM emissions limit is determined by calculating the arithmetic average of all hourly emission rates each boiler operating day, except for data obtained during startup, shutdown, or malfunction periods. Daily averages are only calculated for boiler operating days that have non-out-of-control data for at least 18 hours of unit operation during which the standard applies. Instead, all of the non-out-of-control hourly emission rates of the operating day(s) not meeting the minimum 18 hours non-out-of-control data daily average requirement are averaged with all of the non-out-of-control hourly emission rates of the next boiler operating day with 18 hours or more of non-out-of-control PM CEMS data to determine compliance. For affected facilities for which construction or reconstruction commenced after May 3, 2011 that elect to demonstrate compliance using PM CEMS, compliance with the applicable PM emissions limit in §60.42Da is determined on a 30-boiler operating day rolling average basis by



calculating the arithmetic average of all hourly PM emission rates for the 30 successive boiler operating days, except for data obtained during periods of startup and shutdown.

(g) For affected facilities for which construction, modification, or reconstruction commenced after May 3, 2011, compliance with applicable 30-boiler operating day rolling average NO<sub>x</sub> plus CO emissions limit is determined by dividing the sum of the NO<sub>x</sub> plus CO emissions for the 30 successive boiler operating days by the sum of the gross energy output or net energy output, as applicable, for the 30 successive boiler operating days.

(h) If an owner or operator has not obtained the minimum quantity of emission data as required under §60.49Da of this subpart, compliance of the affected facility with the emission requirements under §§60.43Da and 60.44Da of this subpart for the day on which the 30-day period ends may be determined by the Administrator by following the applicable procedures in section 7 of Method 19 of appendix A of this part.

(i) *Compliance provisions for sources subject to §60.44Da(d)(1), (e)(1), (e)(2)(i), (e)(3)(i), (f), or (g).* The owner or operator shall calculate NO<sub>x</sub> emissions as  $1.194 \times 10^{-7}$  lb/scf-ppm times the average hourly NO<sub>x</sub> output concentration in ppm (measured according to the provisions of §60.49Da(c)), times the average hourly flow rate (measured in scfh, according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. Alternatively, for oil-fired and gas-fired units, NO<sub>x</sub> emissions may be calculated by multiplying the hourly NO<sub>x</sub> emission rate in lb/MMBtu (measured by the CEMS required under §60.49Da(c) and (d)), by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable.

(j) *Compliance provisions for duct burners subject to §60.44Da(a)(1).* To determine compliance with the emissions limits for NO<sub>x</sub> required by §60.44Da(a) for duct burners used in combined cycle systems, either of the procedures described in paragraph (j)(1) or (2) of this section may be used:

(1) The owner or operator of an affected duct burner shall conduct the performance test required under §60.8 using the appropriate methods in appendix A of this part. Compliance with the emissions limits under §60.44Da(a)(1) is determined on the average of three (nominal 1-hour) runs for the initial and subsequent performance tests. During the performance test, one sampling site shall be located in the exhaust of the turbine prior to the duct burner. A second sampling site shall be located at the outlet from the heat recovery steam generating unit. Measurements shall be taken at both sampling sites during the performance test; or

(2) The owner or operator of an affected duct burner may elect to determine compliance by using the CEMS specified under §60.49Da for measuring NO<sub>x</sub> and oxygen (O<sub>2</sub>) (or carbon dioxide (CO<sub>2</sub>)) and meet the requirements of §60.49Da. Alternatively, data from a NO<sub>x</sub> emission rate (*i.e.*, NO<sub>x</sub>-diluent) CEMS certified according to the provisions of §75.20(c) of this chapter and appendix A to part 75 of this chapter, and meeting the quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, may be used, with the following caveats. Data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter. The sampling site shall be located at the outlet from the steam generating unit. The NO<sub>x</sub> emission rate at the outlet from the steam generating unit shall constitute the NO<sub>x</sub> emission rate from the duct burner of the combined cycle system.

(k) *Compliance provisions for duct burners subject to §60.44Da(d)(1) or (e)(1)*. To determine compliance with the emission limitation for NO<sub>x</sub> required by §60.44Da(d)(1) or (e)(1) for duct burners used in combined cycle systems, either of the procedures described in paragraphs (k)(1) and (2) of this section may be used:

(1) The owner or operator of an affected duct burner used in combined cycle systems shall determine compliance with the applicable NO<sub>x</sub> emission limitation in §60.44Da(d)(1) or (e)(1) as follows:

(i) The emission rate (E) of NO<sub>x</sub> shall be computed using Equation 2 in this section:

$$E = \frac{(C_{sg} \times Q_{sg}) - (C_{te} \times Q_{te})}{(O_{sg} \times h)} \quad (\text{Eq. 2})$$

[View or download PDF](#)

Where:

E = Emission rate of NO<sub>x</sub> from the duct burner, ng/J (lb/MWh) gross energy output;

C<sub>sg</sub> = Average hourly concentration of NO<sub>x</sub> exiting the steam generating unit, ng/dscm (lb/dscf);

C<sub>te</sub> = Average hourly concentration of NO<sub>x</sub> in the turbine exhaust upstream from duct burner, ng/dscm (lb/dscf);

Q<sub>sg</sub> = Average hourly volumetric flow rate of exhaust gas from steam generating unit, dscm/h (dscf/h);

Q<sub>te</sub> = Average hourly volumetric flow rate of exhaust gas from combustion turbine, dscm/h (dscf/h);

O<sub>sg</sub> = Average hourly gross energy output from steam generating unit, J/h (MW); and

h = Average hourly fraction of the total heat input to the steam generating unit derived from the combustion of fuel in the affected duct burner.

(ii) Method 7E of appendix A of this part shall be used to determine the NO<sub>x</sub> concentrations (C<sub>sg</sub> and C<sub>te</sub>). Method 2, 2F or 2G of appendix A of this part, as appropriate, shall be used to determine the volumetric flow rates (Q<sub>sg</sub> and Q<sub>te</sub>) of the exhaust gases. The volumetric flow rate measurements shall be taken at the same time as the concentration measurements.

(iii) The owner or operator shall develop, demonstrate, and provide information satisfactory to the Administrator to determine the average hourly gross energy output from the steam generating unit, and the average hourly percentage of the total heat input to the steam generating unit derived from the combustion of fuel in the affected duct burner.

(iv) Compliance with the applicable NO<sub>x</sub> emission limitation in §60.44Da(d)(1) or (e)(1) is determined by the three-run average (nominal 1-hour runs) for the initial and subsequent performance tests.

(2) The owner or operator of an affected duct burner used in a combined cycle system may elect to determine compliance with the applicable NO<sub>x</sub> emission limitation in §60.44Da(d)(1) or (e)(1) on a 30-day rolling average basis as indicated in paragraphs (k)(2)(i) through (iv) of this section.

(i) The emission rate (E) of NO<sub>x</sub> shall be computed using Equation 3 in this section:

$$E = \frac{(C_{sg} \times Q_{sg})}{O_{cc}} \quad (\text{Eq. 3})$$

[View or download PDF](#)

Where:

E = Emission rate of NO<sub>x</sub> from the duct burner, ng/J (lb/MWh) gross energy output;

C<sub>sg</sub> = Average hourly concentration of NO<sub>x</sub> exiting the steam generating unit, ng/dscm (lb/dscf);

Q<sub>sg</sub> = Average hourly volumetric flow rate of exhaust gas from steam generating unit, dscm/h (dscf/h); and

O<sub>cc</sub> = Average hourly gross energy output from entire combined cycle unit, J/h (MW).

(ii) The CEMS specified under §60.49Da for measuring NO<sub>x</sub> and O<sub>2</sub> (or CO<sub>2</sub>) shall be used to determine the average hourly NO<sub>x</sub> concentrations (C<sub>sg</sub>). The continuous flow monitoring system specified in §60.49Da(l) or §60.49Da(m) shall be used to determine the volumetric flow rate (Q<sub>sg</sub>) of the exhaust gas. If the option to use the flow monitoring system in §60.49Da(m) is selected, the flow rate data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter. The sampling site shall be located at the outlet from the steam generating unit.

(iii) The continuous monitoring system specified under §60.49Da(k) for measuring and determining gross energy output shall be used to determine the average hourly gross energy output from the entire combined cycle unit (O<sub>cc</sub>), which is the combined output from the combustion turbine and the steam generating unit.

(iv) The owner or operator may, in lieu of installing, operating, and recording data from the continuous flow monitoring system specified in §60.49Da(l), determine the mass rate (lb/h) of NO<sub>x</sub> emissions by installing, operating, and maintaining continuous fuel flowmeters following the appropriate measurements procedures specified in appendix D of part 75 of this chapter. If this compliance option is selected, the emission rate (E) of NO<sub>x</sub> shall be computed using Equation 4 in this section:

$$E = \frac{(ER_{sg} \times H_{cc})}{O_{cc}} \quad (\text{Eq. 4})$$

[View or download PDF](#)

Where:

E = Emission rate of NO<sub>x</sub> from the duct burner, ng/J (lb/MWh) gross energy output;

ER<sub>sg</sub> = Average hourly emission rate of NO<sub>x</sub> exiting the steam generating unit heat input calculated using appropriate F factor as described in Method 19 of appendix A of this part, ng/J (lb/MMBtu);

H<sub>cc</sub> = Average hourly heat input rate of entire combined cycle unit, J/h (MMBtu/h); and

O<sub>cc</sub> = Average hourly gross energy output from entire combined cycle unit, J/h (MW).

(3) When an affected duct burner steam generating unit utilizes a common steam turbine with one or more affected duct burner steam generating units, the owner or operator shall either:

(i) Determine compliance with the applicable NO<sub>x</sub> emissions limits by measuring the emissions combined with the emissions from the other unit(s) utilizing the common steam turbine; or

(ii) Develop, demonstrate, and provide information satisfactory to the Administrator on methods for apportioning the combined gross energy output from the steam turbine for each of the affected duct burners. The Administrator may approve such demonstrated substitute methods for apportioning the combined gross energy output measured at the steam turbine whenever the demonstration ensures accurate estimation of emissions regulated under this part.

(l) [Reserved]

(m) Compliance provisions for sources subject to §60.43Da(i)(1)(i), (i)(2)(i), (i)(3)(i), (j)(1)(i), (j)(2)(i), (j)(3)(i), (l)(1)(i), (l)(1)(ii), or (l)(2). The owner or operator shall calculate SO<sub>2</sub> emissions as  $1.660 \times 10^{-7}$  lb/scf-ppm times the average hourly SO<sub>2</sub> output concentration in ppm (measured according to the provisions of §60.49Da(b)), times the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable. Alternatively, for oil-fired and gas-fired units, SO<sub>2</sub> emissions may be calculated by multiplying the hourly SO<sub>2</sub> emission rate (in lb/MMBtu), measured by the CEMS required under §60.49Da, by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable.

(n) Compliance provisions for sources subject to §60.42Da(c)(1) or (e)(1)(i). The owner or operator shall calculate PM emissions by multiplying the average hourly PM output concentration (measured according to the provisions of §60.49Da(t)), by the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), and dividing by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable.

(o) Compliance provisions for sources subject to §60.42Da(c)(2), (d), or (e)(1)(ii). Except as provided for in paragraph (p) of this section, the owner or operator must demonstrate compliance with each applicable emissions limit according to the requirements in paragraphs (o)(1) through (o)(5) of this section.

(1) You must conduct a performance test to demonstrate initial compliance with the applicable PM emissions limit in §60.42Da by the applicable date specified in §60.8(a). Thereafter, you must conduct each subsequent performance test within 12 calendar months following the date the previous performance test was required to be conducted. You must conduct each performance test according to the requirements in §60.8 using the test methods and procedures in §60.50Da. The owner or operator of an affected facility that has not operated for 60 consecutive calendar days prior to the date that the subsequent performance test would have been required had the unit been operating is not required to perform the subsequent performance test until 30 calendar days after the next boiler operating day. Requests for additional 30 day extensions shall be granted by the relevant air division or office director of the appropriate Regional Office of the U.S. EPA.

(2) You must monitor the performance of each electrostatic precipitator or fabric filter (baghouse) operated to comply with the applicable PM emissions limit in §60.42Da using a continuous opacity monitoring system (COMS) according to the requirements in paragraphs (o)(2)(i) through (vi) unless you elect to comply with one of the alternatives provided in paragraphs (o)(3) and (o)(4) of this section, as applicable to your control device.

(i) Each COMS must meet Performance Specification 1 in 40 CFR part 60, appendix B.

(ii) You must comply with the quality assurance requirements in paragraphs (o)(2)(ii)(A) through (E) of this section.

(A) You must automatically (intrinsic to the opacity monitor) check the zero and upscale (span) calibration drifts at least once daily. For a particular COMS, the acceptable range of zero and upscale calibration materials is as defined in the applicable version of Performance Specification 1 in 40 CFR part 60, appendix B.

(B) You must adjust the zero and span whenever the 24-hour zero drift or 24-hour span drift exceeds 4 percent opacity. The COMS must allow for the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified. The optical surfaces exposed to the effluent gases must be cleaned prior to performing the zero and span drift adjustments, except for systems using automatic zero adjustments. For systems using automatic zero adjustments, the optical surfaces must be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(C) You must apply a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. All procedures applied must provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photodetector assembly.

(D) Except during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments, the COMS must be in continuous operation and must complete a minimum of one cycle of sampling and analyzing for each successive 10 second period and one cycle of data recording for each successive 6-minute period.

(E) You must reduce all data from the COMS to 6-minute averages. Six-minute opacity averages must be calculated from 36 or more data points equally spaced over each 6-minute period. Data recorded during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments must not be included in the data averages. An arithmetic or integrated average of all data may be used.

(iii) During each performance test conducted according to paragraph (o)(1) of this section, you must establish an opacity baseline level. The value of the opacity baseline level is determined by averaging all of the 6-minute average opacity values (reported to the nearest 0.1 percent opacity) from the COMS measurements recorded during each of the test run intervals conducted for the performance test, and then adding 2.5 percent opacity to your calculated average opacity value for all of the test runs. If your opacity baseline level is less than 5.0 percent, then the opacity baseline level is set at 5.0 percent.

(iv) You must evaluate the preceding 24-hour average opacity level measured by the COMS each boiler operating day excluding periods of affected facility startup, shutdown, or malfunction. If the measured 24-hour average opacity emission level is greater than the baseline opacity level determined in paragraph (o)(2)(iii) of this section, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of the high opacity incident and take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to reduce the measured 24-hour average opacity to a level below the baseline opacity level. In cases when a wet scrubber is used in combination with another PM control device that serves as the primary PM control device, the wet scrubber must be maintained and operated.

(v) You must record the opacity measurements, calculations performed, and any corrective actions taken. The record of corrective action taken must include the date and time during which the measured 24-hour average opacity was greater than baseline opacity level, and the date, time, and description of the corrective action.

(vi) If the measured 24-hour average opacity for your affected facility remains at a level greater than the opacity baseline level after 7 boiler operating days, then you must conduct a new PM performance test according to paragraph (o)(1) of this section and establish a new opacity baseline value according to paragraph (o)(2) of this section. This new performance test must be conducted within 60 days of the date that the measured 24-hour average opacity was first determined to exceed the baseline opacity level unless a waiver is granted by the permitting authority.

(3) As an alternative to complying with the requirements of paragraph (o)(2) of this section, an owner or operator may elect to monitor the performance of an electrostatic precipitator (ESP) operated to comply with the applicable PM emissions limit in §60.42Da using an ESP predictive model developed in accordance with the requirements in paragraphs (o)(3)(i) through (v) of this section.

(i) You must calibrate the ESP predictive model with each PM control device used to comply with the applicable PM emissions limit in §60.42Da operating under normal conditions. In cases when a wet scrubber is used in combination with an ESP to comply with the PM emissions limit, the wet scrubber must be maintained and operated.

(ii) You must develop a site-specific monitoring plan that includes a description of the ESP predictive model used, the model input parameters, and the procedures and criteria for establishing monitoring parameter baseline levels indicative of compliance with the PM emissions limit. You must submit the site-specific monitoring plan for approval by the permitting authority. For reference purposes in preparing the monitoring plan, see the OAQPS "Compliance Assurance Monitoring (CAM) Protocol for an Electrostatic Precipitator (ESP) Controlling Particulate Matter (PM) Emissions from a Coal-Fired Boiler." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality Planning and Standards; Sector Policies and Programs Division; Measurement Policy Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Continuous Emission Monitoring.

(iii) You must run the ESP predictive model using the applicable input data each boiler operating day and evaluate the model output for the preceding boiler operating day excluding periods of affected facility startup, shutdown, or malfunction. If the values for one or more of the model parameters exceed the applicable baseline levels determined according to your approved site-specific monitoring plan, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of a model parameter deviation and, take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to return the model output to within the applicable baseline levels.

(iv) You must record the ESP predictive model inputs and outputs and any corrective actions taken. The record of corrective action taken must include the date and time during which the model output values exceeded the applicable baseline levels, and the date, time, and description of the corrective action.

(v) If after 7 consecutive days a model parameter continues to exceed the applicable baseline level, then you must conduct a new PM performance test according to paragraph (o)(1) of this section. This new performance test must be conducted within 60 calendar days of the date that the

model parameter was first determined to exceed its baseline level unless a waiver is granted by the permitting authority.

(4) As an alternative to complying with the requirements of paragraph (o)(2) of this section, an owner or operator may elect to monitor the performance of a fabric filter (baghouse) operated to comply with the applicable PM emissions limit in §60.42Da by using a bag leak detection system according to the requirements in paragraphs (o)(4)(i) through (v) of this section.

(i) Each bag leak detection system must meet the specifications and requirements in paragraphs (o)(4)(i)(A) through (H) of this section.

(A) The bag leak detection system must be certified by the manufacturer to be capable of detecting PM emissions at concentrations of 1 milligram per actual cubic meter (0.00044 grains per actual cubic foot) or less.

(B) The bag leak detection system sensor must provide output of relative PM loadings. The owner or operator must continuously record the output from the bag leak detection system using electronic or other means (e.g., using a strip chart recorder or a data logger.)

(C) The bag leak detection system must be equipped with an alarm system that will react when the system detects an increase in relative particulate loading over the alarm set point established according to paragraph (o)(4)(i)(D) of this section, and the alarm must be located such that it can be noticed by the appropriate plant personnel.

(D) In the initial adjustment of the bag leak detection system, you must establish, at a minimum, the baseline output by adjusting the sensitivity (range) and the averaging period of the device, the alarm set points, and the alarm delay time.

(E) Following initial adjustment, you must not adjust the averaging period, alarm set point, or alarm delay time without approval from the permitting authority except as provided in paragraph (d)(1)(vi) of this section.

(F) Once per quarter, you may adjust the sensitivity of the bag leak detection system to account for seasonal effects, including temperature and humidity, according to the procedures identified in the site-specific monitoring plan required by paragraph (o)(4)(ii) of this section.

(G) You must install the bag leak detection sensor downstream of the fabric filter and upstream of any wet scrubber.

(H) Where multiple detectors are required, the system's instrumentation and alarm may be shared among detectors.

(ii) You must develop and submit to the permitting authority for approval a site-specific monitoring plan for each bag leak detection system. You must operate and maintain the bag leak detection system according to the site-specific monitoring plan at all times. Each monitoring plan must describe the items in paragraphs (o)(4)(ii)(A) through (F) of this section.

(A) Installation of the bag leak detection system;

(B) Initial and periodic adjustment of the bag leak detection system, including how the alarm set-point will be established;

(C) Operation of the bag leak detection system, including quality assurance procedures;

(D) How the bag leak detection system will be maintained, including a routine maintenance schedule and spare parts inventory list;

(E) How the bag leak detection system output will be recorded and stored; and

(F) Corrective action procedures as specified in paragraph (o)(4)(iii) of this section. In approving the site-specific monitoring plan, the permitting authority may allow owners and operators more than 3 hours to alleviate a specific condition that causes an alarm if the owner or operator identifies in the monitoring plan this specific condition as one that could lead to an alarm, adequately explains why it is not feasible to alleviate this condition within 3 hours of the time the alarm occurs, and demonstrates that the requested time will ensure alleviation of this condition as expeditiously as practicable.

(iii) For each bag leak detection system, you must initiate procedures to determine the cause of every alarm within 1 hour of the alarm. Except as provided in paragraph (o)(4)(ii)(F) of this section, you must alleviate the cause of the alarm within 3 hours of the alarm by taking whatever corrective action(s) are necessary. Corrective actions may include, but are not limited to the following:

(A) Inspecting the fabric filter for air leaks, torn or broken bags or filter media, or any other condition that may cause an increase in particulate emissions;

(B) Sealing off defective bags or filter media;

(C) Replacing defective bags or filter media or otherwise repairing the control device;

(D) Sealing off a defective fabric filter compartment;

(E) Cleaning the bag leak detection system probe or otherwise repairing the bag leak detection system; or

(F) Shutting down the process producing the particulate emissions.

(iv) You must maintain records of the information specified in paragraphs (o)(4)(iv)(A) through (C) of this section for each bag leak detection system.

(A) Records of the bag leak detection system output;

(B) Records of bag leak detection system adjustments, including the date and time of the adjustment, the initial bag leak detection system settings, and the final bag leak detection system settings; and

(C) The date and time of all bag leak detection system alarms, the time that procedures to determine the cause of the alarm were initiated, if procedures were initiated within 1 hour of the alarm, the cause of the alarm, an explanation of the actions taken, the date and time the cause of the alarm was alleviated, and if the alarm was alleviated within 3 hours of the alarm.

(v) If after any period composed of 30 boiler operating days during which the alarm rate exceeds 5 percent of the process operating time (excluding control device or process startup, shutdown, and malfunction), then you must conduct a new PM performance test according to



paragraph (o)(1) of this section. This new performance test must be conducted within 60 calendar days of the date that the alarm rate was first determined to exceed 5 percent limit unless a waiver is granted by the permitting authority.

(5) An owner or operator of a modified affected facility electing to meet the emission limitations in §60.42Da(d) shall determine the percent reduction in PM by using the emission rate for PM determined by the performance test conducted according to the requirements in paragraph (o)(1) of this section and the ash content on a mass basis of the fuel burned during each performance test run as determined by analysis of the fuel as fired.

(p) As an alternative to meeting the compliance provisions specified in paragraph (o) of this section, an owner or operator may elect to install, evaluate, maintain, and operate a CEMS measuring PM emissions discharged from the affected facility to the atmosphere and record the output of the system as specified in paragraphs (p)(1) through (p)(8) of this section.

(1) The owner or operator shall submit a written notification to the Administrator of intent to demonstrate compliance with this subpart by using a CEMS measuring PM. This notification shall be sent at least 30 calendar days before the initial startup of the monitor for compliance determination purposes. The owner or operator may discontinue operation of the monitor and instead return to demonstration of compliance with this subpart according to the requirements in paragraph (o) of this section by submitting written notification to the Administrator of such intent at least 30 calendar days before shutdown of the monitor for compliance determination purposes.

(2) Each CEMS shall be installed, evaluated, operated, and maintained according to the requirements in §60.49Da(v).

(3) The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the affected facility, as specified under §60.8 of subpart A of this part or within 180 days of the date of notification to the Administrator required under paragraph (p)(1) of this section, whichever is later.

(4) Compliance with the applicable emissions limit shall be determined based on the 24-hour daily (block) average of the hourly arithmetic average emissions concentrations using the continuous monitoring system outlet data. The 24-hour block arithmetic average emission concentration shall be calculated using EPA Reference Method 19 of appendix A of this part, section 4.1.

(5) At a minimum, non-out-of-control CEMS hourly averages shall be obtained for 75 percent of all operating hours on a 30-boiler operating day rolling average basis. Beginning on January 1, 2012, non-out-of-control CEMS hourly averages shall be obtained for 90 percent of all operating hours on a 30-boiler operating day rolling average basis.

(i) At least two data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) [Reserved]

(6) The 1-hour arithmetic averages required shall be expressed in ng/J, MMBtu/hr, or lb/MWh and shall be used to calculate the boiler operating day daily arithmetic average emission concentrations. The 1-hour arithmetic averages shall be calculated using the data points required under §60.13(e)(2) of subpart A of this part.

(7) All non-out-of-control CEMS data shall be used in calculating average emission concentrations even if the minimum CEMS data requirements of paragraph (j)(5) of this section are not met.

(8) When PM emissions data are not obtained because of CEMS breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained by using other monitoring systems as approved by the Administrator or EPA Reference Method 19 of appendix A of this part to provide, as necessary, non-out-of-control emissions data for a minimum of 90 percent (only 75 percent is required prior to January 1, 2012) of all operating hours per 30-boiler operating day rolling average.

(q) *Compliance provisions for sources subject to §60.42Da(b).* An owner or operator of an affected facility subject to the opacity standard in §60.42Da(b) shall monitor the opacity of emissions discharged from the affected facility to the atmosphere according to the requirements in §60.49Da(a), as applicable to the affected facility.

(r) Compliance provisions for sources subject to §60.45Da. To determine compliance with the NO<sub>x</sub> plus CO emissions limit, the owner or operator shall use the procedures specified in paragraphs (r)(1) through (3) of this section.

(1) Calculate NO<sub>x</sub> emissions as  $1.194 \times 10^{-7}$  lb/scf-ppm times the average hourly NO<sub>x</sub> output concentration in ppm (measured according to the provisions of §60.49Da(c)), times the average hourly flow rate (measured in scfh, according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable.

(2) Calculate CO emissions by multiplying the average hourly CO output concentration (measured according to the provisions of §60.49Da(u), by the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), and dividing by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)) or the average hourly net energy output, as applicable.

(3) Calculate NO<sub>x</sub> plus CO emissions by summing the NO<sub>x</sub> emissions results from paragraph (r)(1) of this section plus the CO emissions results from paragraph (r)(2) of this section.

(s) Affirmative defense for exceedance of emissions limit during malfunction. In response to an action to enforce the standards set forth in paragraph §§60.42Da, 60.43Da, 60.44Da, and 60.45Da, you may assert an affirmative defense to a claim for civil penalties for exceedances of such standards that are caused by malfunction, as defined at 40 CFR 60.2. Appropriate penalties may be assessed, however, if you fail to meet your burden of proving all of the requirements in the affirmative defense as specified in paragraphs (s)(1) and (2) of this section. The affirmative defense shall not be available for claims for injunctive relief.

(1) To establish the affirmative defense in any action to enforce such a limit, you must timely meet the notification requirements in paragraph (s)(2) of this section, and must prove by a preponderance of evidence that:

(i) The excess emissions:

(A) Were caused by a sudden, infrequent, and unavoidable failure of air pollution control and monitoring equipment, process equipment, or a process to operate in a normal or usual manner; and

(B) Could not have been prevented through careful planning, proper design, or better operation and maintenance practices; and

(C) Did not stem from any activity or event that could have been foreseen and avoided, or planned for; and

(D) Were not part of a recurring pattern indicative of inadequate design, operation, or maintenance; and

(ii) Repairs were made as expeditiously as possible when the applicable emissions limits were being exceeded. Off-shift and overtime labor were used, to the extent practicable to make these repairs; and

(iii) The frequency, amount, and duration of the excess emissions (including any bypass) were minimized to the maximum extent practicable during periods of such emissions; and

(iv) If the excess emissions resulted from a bypass of control equipment or a process, then the bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; and

(v) All possible steps were taken to minimize the impact of the excess emissions on ambient air quality, the environment, and human health; and

(vi) All emissions monitoring and control systems were kept in operation if at all possible, consistent with safety and good air pollution control practices; and

(vii) All of the actions in response to the excess emissions were documented by properly signed, contemporaneous operating logs; and

(viii) At all times, the facility was operated in a manner consistent with good practices for minimizing emissions; and

(ix) A written root cause analysis has been prepared, the purpose of which is to determine, correct, and eliminate the primary causes of the malfunction and the excess emissions resulting from the malfunction event at issue. The analysis shall also specify, using best monitoring methods and engineering judgment, the amount of excess emissions that were the result of the malfunction.

(2) *Notification.* The owner or operator of the affected source experiencing an exceedance of its emission limit(s) during a malfunction shall notify the Administrator by telephone or facsimile (FAX) transmission as soon as possible, but no later than two business days after the initial occurrence of the malfunction or, if it is not possible to determine within two business days whether the malfunction caused or contributed to an exceedance, no later than two business days after the owner or operator knew or should have known that the malfunction caused or contributed to an exceedance, but, in no event later than two business days after the end of the averaging period, if it wishes to avail itself of an affirmative defense to civil penalties for that malfunction. The owner or operator seeking to assert an affirmative defense shall also submit a written report to the Administrator within 45 days of the initial occurrence of the exceedance of the standard in §63.9991 to demonstrate, with all necessary supporting documentation, that it has met the requirements set forth in paragraph (s)(1) of this section. The owner or operator may seek an extension of this deadline for up to 30 additional days by submitting a written request to the Administrator before the expiration of the 45 day period. Until a request for an extension has been approved by the Administrator, the owner or operator is subject to the requirement to submit such report within 45 days of the initial occurrence of the exceedance.

[↑ Back to Top](#)

#### **§60.49Da Emission monitoring.**

(a) An owner or operator of an affected facility subject to the opacity standard in §60.42Da must monitor the opacity of emissions discharged from the affected facility to the atmosphere according to the applicable requirements in paragraphs (a)(1) through (4) of this section.

(1) Except as provided for in paragraphs (a)(2) and (4) of this section, the owner or operator of an affected facility subject to an opacity standard, shall install, calibrate, maintain, and operate a COMS, and record the output of the system, for measuring the opacity of emissions discharged to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of an FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the SO<sub>2</sub> control system), alternate parameters indicative of the PM control system's performance and/or good combustion are monitored (subject to the approval of the Administrator).

(2) As an alternative to the monitoring requirements in paragraph (a)(1) of this section, an owner or operator of an affected facility that meets the conditions in either paragraph (a)(2)(i), (ii), (iii), or (iv) of this section may elect to monitor opacity as specified in paragraph (a)(3) of this section.

(i) The affected facility uses a fabric filter (baghouse) to meet the standards in §60.42Da and a bag leak detection system is installed and operated according to the requirements in paragraphs §60.48Da(o)(4)(i) through (v);

(ii) The affected facility burns only gaseous or liquid fuels (excluding residual oil) with potential SO<sub>2</sub> emissions rates of 26 ng/J (0.060 lb/MMBtu) or less, and does not use a post-combustion technology to reduce emissions of SO<sub>2</sub> or PM;

(iii) The affected facility meets all of the conditions specified in paragraphs (a)(2)(iii)(A) through (C) of this section.

(A) No post-combustion technology (except a wet scrubber) is used for reducing PM, SO<sub>2</sub>, or CO emissions;

(B) Only natural gas, gaseous fuels, or fuel oils that contain less than or equal to 0.30 weight percent sulfur are burned; and

(C) Emissions of CO discharged to the atmosphere are maintained at levels less than or equal to 1.4 lb/MWh on a boiler operating day average basis as demonstrated by the use of a CEMS measuring CO emissions according to the procedures specified in paragraph (u) of this section; or

(iv) The affected facility uses an ESP and uses an ESP predictive model to monitor the performance of the ESP developed in accordance and operated according to the most current requirements in section §60.48Da of this part.

(3) The owner or operator of an affected facility that meets the conditions in paragraph (a)(2) of this section may, as an alternative to using a COMS, elect to monitor visible emissions using the

applicable procedures specified in paragraphs (a)(3)(i) through (iv) of this section. The opacity performance test requirement in paragraph (a)(3)(i) must be conducted by April 29, 2011, within 45 days after stopping use of an existing COMS, or within 180 days after initial startup of the facility, whichever is later.

(i) The owner or operator shall conduct a performance test using Method 9 of appendix A-4 of this part and the procedures in §60.11. If during the initial 60 minutes of the observation all the 6-minute averages are less than 10 percent and all the individual 15-second observations are less than or equal to 20 percent, then the observation period may be reduced from 3 hours to 60 minutes.

(ii) Except as provided in paragraph (a)(3)(iii) or (iv) of this section, the owner or operator shall conduct subsequent Method 9 of appendix A-4 of this part performance tests using the procedures in paragraph (a)(3)(i) of this section according to the applicable schedule in paragraphs (a)(3)(ii)(A) through (a)(3)(ii)(C) of this section, as determined by the most recent Method 9 of appendix A-4 of this part performance test results.

(A) If the maximum 6-minute average opacity is less than or equal to 5 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 12 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(B) If the maximum 6-minute average opacity is greater than 5 percent but less than or equal to 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 3 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later; or

(C) If the maximum 6-minute average opacity is greater than 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 45 calendar days from the date that the most recent performance test was conducted.

(iii) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 of this part performance tests, elect to perform subsequent monitoring using Method 22 of appendix A-7 of this part according to the procedures specified in paragraphs (a)(3)(iii)(A) and (B) of this section.

(A) The owner or operator shall conduct 10 minute observations (during normal operation) each operating day the affected facility fires fuel for which an opacity standard is applicable using Method 22 of appendix A-7 of this part and demonstrate that the sum of the occurrences of any visible emissions is not in excess of 5 percent of the observation period (*i.e.*, 30 seconds per 10 minute period). If the sum of the occurrence of any visible emissions is greater than 30 seconds during the initial 10 minute observation, immediately conduct a 30 minute observation. If the sum of the occurrence of visible emissions is greater than 5 percent of the observation period (*i.e.*, 90 seconds per 30 minute period), the owner or operator shall either document and adjust the operation of the facility and demonstrate within 24 hours that the sum of the occurrence of visible emissions is equal to or less than 5 percent during a 30 minute observation (*i.e.*, 90 seconds) or conduct a new Method 9 of appendix A-4 of this part performance test using the procedures in paragraph (a)(3)(i) of this section within 45 calendar days according to the requirements in §60.50Da(b)(3).

(B) If no visible emissions are observed for 10 operating days during which an opacity standard is applicable, observations can be reduced to once every 7 operating days during which an opacity standard is applicable. If any visible emissions are observed, daily observations shall be resumed.

(iv) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 performance tests, elect to perform subsequent monitoring using a digital opacity compliance system according to a site-specific monitoring plan approved by the Administrator. The observations must be similar, but not necessarily identical, to the requirements in paragraph (a)(3)(iii) of this section. For reference purposes in preparing the monitoring plan, see OAQPS "Determination of Visible Emission Opacity from Stationary Sources Using Computer-Based Photographic Analysis Systems." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality and Planning Standards; Sector Policies and Programs Division; Measurement Policy Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Preliminary Methods.

(4) An owner or operator of an affected facility that is subject to an opacity standard under §60.42Da is not required to operate a COMS provided that affected facility meets the conditions in either paragraph (a)(4)(i) or (ii) of this section.

(i) The affected facility combusts only gaseous and/or liquid fuels (excluding residue oil) where the potential SO<sub>2</sub> emissions rate of each fuel is no greater than 26 ng/J (0.060 lb/MMBtu), and the unit operates according to a written site-specific monitoring plan approved by the permitting authority. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard. For testing performed as part of this site-specific monitoring plan, the permitting authority may require as an alternative to the notification and reporting requirements specified in §§60.8 and 60.11 that the owner or operator submit any deviations with the excess emissions report required under §60.51Da(d).

(ii) The owner or operator of the affected facility installs, calibrates, operates, and maintains a particulate matter continuous parametric monitoring system (PM CPMS) according to the requirements specified in subpart UUUUU of part 63.

(b) The owner or operator of an affected facility must install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring SO<sub>2</sub> emissions, except where only gaseous and/or liquid fuels (excluding residual oil) where the potential SO<sub>2</sub> emissions rate of each fuel is 26 ng/J (0.060 lb/MMBtu) or less are combusted, as follows:

(1) Sulfur dioxide emissions are monitored at both the inlet and outlet of the SO<sub>2</sub> control device.

(2) For a facility that qualifies under the numerical limit provisions of §60.43Da, SO<sub>2</sub> emissions are only monitored as discharged to the atmosphere.

(3) An "as fired" fuel monitoring system (upstream of coal pulverizers) meeting the requirements of Method 19 of appendix A of this part may be used to determine potential SO<sub>2</sub> emissions in place of a continuous SO<sub>2</sub> emission monitor at the inlet to the SO<sub>2</sub> control device as required under paragraph (b)(1) of this section.

(4) If the owner or operator has installed and certified a SO<sub>2</sub> CEMS according to the requirements of §75.20(c)(1) of this chapter and appendix A to part 75 of this chapter, and is continuing to meet the ongoing quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, that CEMS may be used to meet the requirements of this section, provided that:

(i) A CO<sub>2</sub> or O<sub>2</sub> continuous monitoring system is installed, calibrated, maintained and operated at the same location, according to paragraph (d) of this section; and

(ii) For sources subject to an SO<sub>2</sub> emission limit in lb/MMBtu under §60.43Da:

(A) When relative accuracy testing is conducted, SO<sub>2</sub> concentration data and CO<sub>2</sub> (or O<sub>2</sub>) data are collected simultaneously; and

(B) In addition to meeting the applicable SO<sub>2</sub> and CO<sub>2</sub> (or O<sub>2</sub>) relative accuracy specifications in Figure 2 of appendix B to part 75 of this chapter, the relative accuracy (RA) standard in section 13.2 of Performance Specification 2 in appendix B to this part is met when the RA is calculated on a lb/MMBtu basis; and

(iii) The reporting requirements of §60.51Da are met. The SO<sub>2</sub> and, if required, CO<sub>2</sub> (or O<sub>2</sub>) data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the SO<sub>2</sub> data have been bias adjusted according to the procedures of part 75 of this chapter.

(c)(1) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring NO<sub>x</sub> emissions discharged to the atmosphere; or

(2) If the owner or operator has installed a NO<sub>x</sub> emission rate CEMS to meet the requirements of part 75 of this chapter and is continuing to meet the ongoing requirements of part 75 of this chapter, that CEMS may be used to meet the requirements of this section, except that the owner or operator shall also meet the requirements of §60.51Da. Data reported to meet the requirements of §60.51Da shall not include data substituted using the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(d) The owner or operator of an affected facility not complying with an output based limit shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring the O<sub>2</sub> or carbon dioxide (CO<sub>2</sub>) content of the flue gases at each location where SO<sub>2</sub> or NO<sub>x</sub> emissions are monitored. For affected facilities subject to a lb/MMBtu SO<sub>2</sub> emission limit under §60.43Da, if the owner or operator has installed and certified a CO<sub>2</sub> or O<sub>2</sub> monitoring system according to §75.20(c) of this chapter and appendix A to part 75 of this chapter and the monitoring system continues to meet the applicable quality-assurance provisions of §75.21 of this chapter and appendix B to part 75 of this chapter, that CEMS may be used together with the part 75 SO<sub>2</sub> concentration monitoring system described in paragraph (b) of this section, to determine the SO<sub>2</sub> emission rate in lb/MMBtu. SO<sub>2</sub> data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(e) The CEMS under paragraphs (b), (c), and (d) of this section are operated and data recorded during all periods of operation of the affected facility including periods of startup, shutdown, and malfunction, except for CEMS breakdowns, repairs, calibration checks, and zero and span adjustments.

(f)(1) For units that began construction, reconstruction, or modification on or before February 28, 2005, the owner or operator shall obtain emission data for at least 18 hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement cannot be met with CEMS,

the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in paragraph (h) of this section.

(2) For units that began construction, reconstruction, or modification after February 28, 2005, the owner or operator shall obtain emission data for at least 90 percent of all operating hours for each 30 successive boiler operating days. If this minimum data requirement cannot be met with a CEMS, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in paragraph (h) of this section.

(g) The 1-hour averages required under paragraph §60.13(h) are expressed in ng/J (lb/MMBtu) heat input and used to calculate the average emission rates under §60.48Da. The 1-hour averages are calculated using the data points required under §60.13(h)(2).

(h) When it becomes necessary to supplement CEMS data to meet the minimum data requirements in paragraph (f) of this section, the owner or operator shall use the reference methods and procedures as specified in this paragraph. Acceptable alternative methods and procedures are given in paragraph (j) of this section.

(1) Method 6 of appendix A of this part shall be used to determine the SO<sub>2</sub> concentration at the same location as the SO<sub>2</sub> monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.

(2) Method 7 of appendix A of this part shall be used to determine the NO<sub>x</sub> concentration at the same location as the NO<sub>x</sub> monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.

(3) The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B of appendix A of this part shall be used to determine the O<sub>2</sub> or CO<sub>2</sub> concentration at the same location as the O<sub>2</sub> or CO<sub>2</sub> monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.

(4) The procedures in Method 19 of appendix A of this part shall be used to compute each 1-hour average concentration in ng/J (lb/MMBtu) heat input.

(i) The owner or operator shall use methods and procedures in this paragraph to conduct monitoring system performance evaluations under §60.13(c) and calibration checks under §60.13(d). Acceptable alternative methods and procedures are given in paragraph (j) of this section.

(1) Methods 3B, 6, and 7 of appendix A of this part shall be used to determine O<sub>2</sub>, SO<sub>2</sub>, and NO<sub>x</sub> concentrations, respectively.

(2) SO<sub>2</sub> or NO<sub>x</sub> (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N<sub>2</sub>, as applicable) under Performance Specification 2 of appendix B of this part.

(3) For affected facilities burning only fossil fuel, the span value for a COMS is between 60 and 80 percent. Span values for a CEMS measuring NO<sub>x</sub> shall be determined using one of the following procedures:



(i) Except as provided under paragraph (i)(3)(ii) of this section, NO<sub>x</sub> span values shall be determined as follows:

| <b>Fossil fuel</b> | <b>Span values for NO<sub>x</sub><br/>(ppm)</b> |
|--------------------|-------------------------------------------------|
| Gas                | 500.                                            |
| Liquid             | 500.                                            |
| Solid              | 1,000.                                          |
| Combination        | $500(x + y) + 1,000z.$                          |

Where:

x = Fraction of total heat input derived from gaseous fossil fuel,

y = Fraction of total heat input derived from liquid fossil fuel, and

z = Fraction of total heat input derived from solid fossil fuel.

(ii) As an alternative to meeting the requirements of paragraph (i)(3)(i) of this section, the owner or operator of an affected facility may elect to use the NO<sub>x</sub> span values determined according to section 2.1.2 in appendix A to part 75 of this chapter.

(4) All span values computed under paragraph (i)(3)(i) of this section for burning combinations of fossil fuels are rounded to the nearest 500 ppm. Span values computed under paragraph (i)(3)(ii) of this section shall be rounded off according to section 2.1.2 in appendix A to part 75 of this chapter.

(5) For affected facilities burning fossil fuel, alone or in combination with non-fossil fuel and determining span values under paragraph (i)(3)(i) of this section, the span value of the SO<sub>2</sub> CEMS at the inlet to the SO<sub>2</sub> control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the SO<sub>2</sub> control device is 50 percent of maximum estimated hourly potential emissions of the fuel fired. For affected facilities determining span values under paragraph (i)(3)(ii) of this section, SO<sub>2</sub> span values shall be determined according to section 2.1.1 in appendix A to part 75 of this chapter.

(j) The owner or operator may use the following as alternatives to the reference methods and procedures specified in this section:

(1) For Method 6 of appendix A of this part, Method 6A or 6B (whenever Methods 6 and 3 or 3B of appendix A of this part data are used) or 6C of appendix A of this part may be used. Each Method 6B of appendix A of this part sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B of appendix A of this part is used under paragraph (i) of this section, the conditions under §60.48Da(d)(1) apply; these conditions do not apply under paragraph (h) of this section.

(2) For Method 7 of appendix A of this part, Method 7A, 7C, 7D, or 7E of appendix A of this part may be used. If Method 7C, 7D, or 7E of appendix A of this part is used, the sampling time for each run shall be 1 hour.

(3) For Method 3 of appendix A of this part, Method 3A or 3B of appendix A of this part may be used if the sampling time is 1 hour.

(4) For Method 3B of appendix A of this part, Method 3A of appendix A of this part may be used.

(k) The procedures specified in paragraphs (k)(1) through (3) of this section shall be used to determine gross energy output for sources demonstrating compliance with an output-based standard.

(1) The owner or operator of an affected facility with electricity generation shall install, calibrate, maintain, and operate a wattmeter; measure gross electrical output in MWh on a continuous basis; and record the output of the monitor.

(2) The owner or operator of an affected facility with process steam generation shall install, calibrate, maintain, and operate meters for steam flow, temperature, and pressure; measure gross process steam output in joules per hour (or Btu per hour) on a continuous basis; and record the output of the monitor.

(3) For an affected facility generating process steam in combination with electrical generation, the gross energy output is determined according to the definition of "gross energy output" specified in §60.41Da that is applicable to the affected facility.

(l) The owner or operator of an affected facility demonstrating compliance with an output-based standard shall install, certify, operate, and maintain a continuous flow monitoring system meeting the requirements of Performance Specification 6 of appendix B of this part and the calibration drift (CD) assessment, relative accuracy test audit (RATA), and reporting provisions of procedure 1 of appendix F of this part, and record the output of the system, for measuring the volumetric flow rate of exhaust gases discharged to the atmosphere; or

(m) Alternatively, data from a continuous flow monitoring system certified according to the requirements of §75.20(c) of this chapter and appendix A to part 75 of this chapter, and continuing to meet the applicable quality control and quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, may be used. Flow rate data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(n) Gas-fired and oil-fired units. The owner or operator of an affected unit that qualifies as a gas-fired or oil-fired unit, as defined in 40 CFR 72.2, may use, as an alternative to the requirements specified in either paragraph (l) or (m) of this section, a fuel flow monitoring system certified and operated according to the requirements of appendix D of part 75 of this chapter.

(o) The owner or operator of a duct burner, as described in §60.41Da, which is subject to the NO<sub>x</sub> standards of §60.44Da(a)(1), (d)(1), or (e)(1) is not required to install or operate a CEMS to measure NO<sub>x</sub> emissions; a wattmeter to measure gross electrical output; meters to measure steam flow, temperature, and pressure; and a continuous flow monitoring system to measure the flow of exhaust gases discharged to the atmosphere.

(p)-(r) [Reserved]

(s) The owner or operator shall prepare and submit to the Administrator for approval a unit-specific monitoring plan for each monitoring system, at least 45 days before commencing certification testing of the monitoring systems. The owner or operator shall comply with the

requirements in your plan. The plan must address the requirements in paragraphs (s)(1) through (6) of this section.

(1) Installation of the CEMS sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of the exhaust emissions (e.g., on or downstream of the last control device);

(2) Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems;

(3) Performance evaluation procedures and acceptance criteria (e.g., calibrations, relative accuracy test audits (RATA), etc.);

(4) Ongoing operation and maintenance procedures in accordance with the general requirements of §60.13(d) or part 75 of this chapter (as applicable);

(5) Ongoing data quality assurance procedures in accordance with the general requirements of §60.13 or part 75 of this chapter (as applicable); and

(6) Ongoing recordkeeping and reporting procedures in accordance with the requirements of this subpart.

(t) The owner or operator of an affected facility demonstrating compliance with the output-based emissions limit under §60.42Da must either install, certify, operate, and maintain a CEMS for measuring PM emissions according to the requirements of paragraph (v) of this section or install, calibrate, operate, and maintain a PM CPMS according to the requirements for new facilities specified in subpart UUUUU of part 63 of this chapter. An owner or operator of an affected facility demonstrating compliance with the input-based emissions limit in §60.42Da may install, certify, operate, and maintain a CEMS for measuring PM emissions according to the requirements of paragraph (v) of this section.

(u) The owner or operator of an affected facility using a CEMS measuring CO emissions to meet requirements of this subpart shall meet the requirements specified in paragraphs (u)(1) through (4) of this section.

(1) You must monitor CO emissions using a CEMS according to the procedures specified in paragraphs (u)(1)(i) through (iv) of this section.

(i) The CO CEMS must be installed, certified, maintained, and operated according to the provisions in §60.58b(i)(3) of subpart Eb of this part.

(ii) Each 1-hour CO emissions average is calculated using the data points generated by the CO CEMS expressed in parts per million by volume corrected to 3 percent oxygen (dry basis).

(iii) At a minimum, non-out-of-control 1-hour CO emissions averages must be obtained for at least 90 percent of the operating hours on a 30-boiler operating day rolling average basis. The 1-hour averages are calculated using the data points required in §60.13(h)(2).

(iv) Quarterly accuracy determinations and daily calibration drift tests for the CO CEMS must be performed in accordance with procedure 1 in appendix F of this part.

(2) You must calculate the 1-hour average CO emissions levels for each boiler operating day by multiplying the average hourly CO output concentration measured by the CO CEMS times the corresponding average hourly flue gas flow rate and divided by the corresponding average hourly useful energy output from the affected facility. The 24-hour average CO emission level is determined by calculating the arithmetic average of the hourly CO emission levels computed for each boiler operating day.

(3) You must evaluate the preceding 24-hour average CO emission level each boiler operating day excluding periods of affected facility startup, shutdown, or malfunction. If the 24-hour average CO emission level is greater than 1.4 lb/MWh, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of the high emission incident and, take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to reduce the 24-hour average CO emission level to 1.4 lb/MWh or less.

(4) You must record the CO measurements and calculations performed according to paragraph (u)(3) of this section and any corrective actions taken. The record of corrective action taken must include the date and time during which the 24-hour average CO emission level was greater than 1.4 lb/MWh, and the date, time, and description of the corrective action.

(v) The owner or operator of an affected facility using a CEMS measuring PM emissions to meet requirements of this subpart shall install, certify, operate, and maintain the CEMS as specified in paragraphs (v)(1) through (v)(4) of this section.

(1) The owner or operator shall conduct a performance evaluation of the CEMS according to the applicable requirements of §60.13, Performance Specification 11 in appendix B of this part, and procedure 2 in appendix F of this part.

(2) During each PM correlation testing run of the CEMS required by Performance Specification 11 in appendix B of this part, PM and O<sub>2</sub> (or CO<sub>2</sub>) data shall be collected concurrently (or within a 30- to 60-minute period) by both the CEMS and performance tests conducted using the following test methods.

(i) For PM, Method 5 or 5B of appendix A-3 of this part or Method 17 of appendix A-6 of this part shall be used; and

(ii) For O<sub>2</sub> (or CO<sub>2</sub>), Method 3A or 3B of appendix A-2 of this part, as applicable shall be used.

(3) Quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with procedure 2 in appendix F of this part. Relative Response Audit's must be performed annually and Response Correlation Audits must be performed every 3 years.

(4) As of January 1, 2012, and within 90 days after the date of completing each performance test, as defined in §60.8, conducted to demonstrate compliance with this subpart, you must submit relative accuracy test audit (*i.e.*, reference method) data and performance test (*i.e.*, compliance test) data, except opacity data, electronically to EPA's Central Data Exchange (CDX) by using the Electronic Reporting Tool (ERT) (see [http://www.epa.gov/ttn/chief/ert/ert\\_tool.html/](http://www.epa.gov/ttn/chief/ert/ert_tool.html/)) or other compatible electronic spreadsheet. Only data collected using test methods compatible with ERT are subject to this requirement to be submitted electronically into EPA's WebFire database.

(w) The owner or operator using a SO<sub>2</sub>, NO<sub>x</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS to meet the requirements of this subpart shall install, certify, operate, and maintain the CEMS as specified in paragraphs (w)(1) through (w)(5) of this section.

(1) Except as provided for under paragraphs (w)(2), (w)(3), and (w)(4) of this section, each SO<sub>2</sub>, NO<sub>x</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS required under paragraphs (b) through (d) of this section shall be installed, certified, and operated in accordance with the applicable procedures in Performance Specification 2 or 3 in appendix B to this part or according to the procedures in appendices A and B to part 75 of this chapter. Daily calibration drift assessments and quarterly accuracy determinations shall be done in accordance with Procedure 1 in appendix F to this part, and a data assessment report (DAR), prepared according to section 7 of Procedure 1 in appendix F to this part, shall be submitted with each compliance report required under §60.51Da.

(2) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to implement the following alternative data accuracy assessment procedures. For all required CO<sub>2</sub> and O<sub>2</sub> CEMS and for SO<sub>2</sub> and NO<sub>x</sub> CEMS with span values greater than or equal to 100 ppm, the daily calibration error test and calibration adjustment procedures described in sections 2.1.1 and 2.1.3 of appendix B to part 75 of this chapter may be followed instead of the CD assessment procedures in Procedure 1, section 4.1 of appendix F of this part. If this option is selected, the data validation and out-of-control provisions in sections 2.1.4 and 2.1.5 of appendix B to part 75 of this chapter shall be followed instead of the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to this part. For the purposes of data validation under this subpart, the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to this part shall apply to SO<sub>2</sub> and NO<sub>x</sub> span values less than 100 ppm;

(3) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to implement the following alternative data accuracy assessment procedures. For all required CO<sub>2</sub> and O<sub>2</sub> CEMS and for SO<sub>2</sub> and NO<sub>x</sub> CEMS with span values greater than 30 ppm, quarterly linearity checks may be performed in accordance with section 2.2.1 of appendix B to part 75 of this chapter, instead of performing the cylinder gas audits (CGAs) described in Procedure 1, section 5.1.2 of appendix F to this part. If this option is selected: The frequency of the linearity checks shall be as specified in section 2.2.1 of appendix B to part 75 of this chapter; the applicable linearity specifications in section 3.2 of appendix A to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.2.3 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.2.4 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the cylinder gas audits described in Procedure 1, section 5.1.2 of appendix F to this part shall be performed for SO<sub>2</sub> and NO<sub>x</sub> span values less than or equal to 30 ppm;

(4) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to implement the following alternative data accuracy assessment procedures. For SO<sub>2</sub>, CO<sub>2</sub>, and O<sub>2</sub> CEMS and for NO<sub>x</sub> CEMS, RATAs may be performed in accordance with section 2.3 of appendix B to part 75 of this chapter instead of following the procedures described in Procedure 1, section 5.1.1 of appendix F to this part. If this option is selected: The frequency of each RATA shall be as specified in section 2.3.1 of appendix B to part 75 of this chapter; the applicable relative accuracy specifications shown in Figure 2 in appendix B to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.3.2 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.3.3 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the relative accuracy specification in section 13.2 of Performance Specification 2 in appendix B to this part shall be met on a lb/MMBtu basis for SO<sub>2</sub> (regardless of the SO<sub>2</sub> emission level during the RATA), and for NO<sub>x</sub> when the average NO<sub>x</sub> emission rate measured by the reference method during the RATA is less than 0.100 lb/MMBtu;

(5) If the owner or operator elects to implement the alternative data assessment procedures described in paragraphs (w)(2) through (w)(4) of this section, each data assessment report shall include a summary of the results of all of the RATAs, linearity checks, CGAs, and calibration error or drift assessments required by paragraphs (w)(2) through (w)(4) of this section.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5081, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9456, Feb. 16, 2012; 77 FR 23402, Apr. 19, 2012; 78 FR 24083, Apr. 24, 2013]

[↑ Back to Top](#)

#### **§60.50Da Compliance determination procedures and methods.**

(a) In conducting the performance tests required in §60.8, the owner or operator shall use as reference methods and procedures the methods in appendix A of this part or the methods and procedures as specified in this section, except as provided in §60.8(b). Section 60.8(f) does not apply to this section for SO<sub>2</sub> and NO<sub>x</sub>. Acceptable alternative methods are given in paragraph (e) of this section.

(b) In conducting the performance tests to determine compliance with the PM emissions limits in §60.42Da, the owner or operator shall meet the requirements specified in paragraphs (b)(1) through (3) of this section.

(1) The owner or operator shall measure filterable PM to determine compliance with the applicable PM emissions limit in §60.42Da as specified in paragraphs (b)(1)(i) through (ii) of this section.

(i) The dry basis F factor (O<sub>2</sub>) procedures in Method 19 of appendix A of this part shall be used to compute the emission rate of PM.

(ii) For the PM concentration, Method 5 of appendix A of this part shall be used for an affected facility that does not use a wet FGD. For an affected facility that uses a wet FGD, Method 5B of appendix A of this part shall be used downstream of the wet FGD.

(A) The sampling time and sample volume for each run shall be at least 120 minutes and 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an average gas temperature of no greater than 160 ± 14 °C (320 ± 25 °F).

(B) For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B of appendix A of this part shall be used to determine the O<sub>2</sub> concentration. The O<sub>2</sub> sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O<sub>2</sub> traverse points may be reduced to 12 provided that Method 1 of appendix A of this part is used to locate the 12 O<sub>2</sub> traverse points. If the grab sampling procedure is used, the O<sub>2</sub> concentration for the run shall be the arithmetic mean of the sample O<sub>2</sub> concentrations at all traverse points.

(2) In conjunction with a performance test performed according to the requirements in paragraph (b)(1) of this section, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after May 3, 2011, shall measure condensable PM using Method 202 of appendix M of part 51.

(3) Method 9 of appendix A of this part and the procedures in §60.11 shall be used to determine opacity.

(c) The owner or operator shall determine compliance with the SO<sub>2</sub> standards in §60.43Da as follows:

(1) The percent of potential SO<sub>2</sub> emissions (%Ps) to the atmosphere shall be computed using the following equation:

$$\%P_f = \frac{(100 - \%R_f)(100 - \%R_g)}{100}$$

[View or download PDF](#)

Where:

%Ps = Percent of potential SO<sub>2</sub> emissions, percent;

%Rf = Percent reduction from fuel pretreatment, percent; and

%Rg = Percent reduction by SO<sub>2</sub> control system, percent.

(2) The procedures in Method 19 of appendix A of this part may be used to determine percent reduction (%R<sub>f</sub>) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and fly ash interactions. This determination is optional.

(3) The procedures in Method 19 of appendix A of this part shall be used to determine the percent SO<sub>2</sub> reduction (%R<sub>g</sub>) of any SO<sub>2</sub> control system. Alternatively, a combination of an “as fired” fuel monitor and emission rates measured after the control system, following the procedures in Method 19 of appendix A of this part, may be used if the percent reduction is calculated using the average emission rate from the SO<sub>2</sub> control device and the average SO<sub>2</sub> input rate from the “as fired” fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 of appendix A of this part shall be used to determine the emission rate.

(5) The CEMS in §60.49Da(b) and (d) shall be used to determine the concentrations of SO<sub>2</sub> and CO<sub>2</sub> or O<sub>2</sub>.

(d) The owner or operator shall determine compliance with the NO<sub>x</sub> standard in §60.44Da as follows:

(1) The appropriate procedures in Method 19 of appendix A of this part shall be used to determine the emission rate of NO<sub>x</sub>.

(2) The continuous monitoring system in §60.49Da(c) and (d) shall be used to determine the concentrations of NO<sub>x</sub> and CO<sub>2</sub> or O<sub>2</sub>.

(e) The owner or operator may use the following as alternatives to the reference methods and procedures specified in this section:

(1) For Method 5 or 5B of appendix A-3 of this part, Method 17 of appendix A-6 of this part may be used at facilities with or without wet FGD systems if the stack temperature at the sampling location does not exceed an average temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A-3 of this part may be used in Method 17 of appendix A-6 of this part only if it is used after wet FGD systems. Method 17 of appendix A-6 of this part shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.

(2) The  $F_c$  factor ( $\text{CO}_2$ ) procedures in Method 19 of appendix A of this part may be used to compute the emission rate of PM under the stipulations of §60.46(d)(1). The  $\text{CO}_2$  shall be determined in the same manner as the  $\text{O}_2$  concentration.

(f) The owner or operator of an electric utility combined cycle gas turbine that does not meet the definition of an IGCC must conduct performance tests for PM,  $\text{SO}_2$ , and  $\text{NO}_x$  using the procedures of Method 19 of appendix A-7 of this part. The  $\text{SO}_2$  and  $\text{NO}_x$  emission rates calculations from the gas turbine used in Method 19 of appendix A-7 of this part are determined when the gas turbine is performance tested under subpart GG of this part. The potential uncontrolled PM emission rate from a gas turbine is defined as 17 ng/J (0.04 lb/MMBtu) heat input.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5083, Jan. 28, 2009; 77 FR 9458, Feb. 16, 2012; 78 FR 24084, Apr. 24, 2013]

 [Back to Top](#)

#### **§60.51Da Reporting requirements.**

(a) For  $\text{SO}_2$ ,  $\text{NO}_x$ , PM, and  $\text{NO}_x$  plus CO emissions, the performance test data from the initial and subsequent performance test and from the performance evaluation of the continuous monitors (including the transmissometer) must be reported to the Administrator.

(b) For  $\text{SO}_2$  and  $\text{NO}_x$  the following information is reported to the Administrator for each 24-hour period.

(1) Calendar date.

(2) The average  $\text{SO}_2$  and  $\text{NO}_x$  emission rates (ng/J, lb/MMBtu, or lb/MWh) for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the emission standards; and, description of corrective actions taken.

(3) For owners or operators of affected facilities complying with the percent reduction requirement, percent reduction of the potential combustion concentration of  $\text{SO}_2$  for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.

(4) Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 75 percent of the hours of operation of the facility; justification for not obtaining sufficient data; and description of corrective actions taken.

(5) Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, or malfunction.



(6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.

(7) Identification of times when hourly averages have been obtained based on manual sampling methods.

(8) Identification of the times when the pollutant concentration exceeded full span of the CEMS.

(9) Description of any modifications to CEMS which could affect the ability of the CEMS to comply with Performance Specifications 2 or 3.

(c) If the minimum quantity of emission data as required by §60.49Da is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of §60.48Da(h) is reported to the Administrator for that 30-day period:

(1) The number of hourly averages available for outlet emission rates ( $n_o$ ) and inlet emission rates ( $n_i$ ) as applicable.

(2) The standard deviation of hourly averages for outlet emission rates ( $s_o$ ) and inlet emission rates ( $s_i$ ) as applicable.

(3) The lower confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the upper confidence limit for the mean inlet emission rate ( $E_i^*$ ) as applicable.

(4) The applicable potential combustion concentration.

(5) The ratio of the upper confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the allowable emission rate ( $E_{std}$ ) as applicable.

(d) In addition to the applicable requirements in §60.7, the owner or operator of an affected facility subject to the opacity limits in §60.43c(c) and conducting performance tests using Method 9 of appendix A-4 of this part shall submit excess emission reports for any excess emissions from the affected facility that occur during the reporting period and maintain records according to the requirements specified in paragraph (d)(1) of this section.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (d)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

(iii) Copies of all visible emission observer opacity field data sheets.

(2) [Reserved]

(e) If fuel pretreatment credit toward the SO<sub>2</sub> emission standard under §60.43Da is claimed, the owner or operator of the affected facility shall submit a signed statement:

(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of §60.50Da and Method 19 of appendix A of this part; and

(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

(f) For any periods for which opacity, SO<sub>2</sub> or NO<sub>x</sub> emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and affected facility during periods of data unavailability are to be compared with operation of the control system and affected facility before and following the period of data unavailability.

(g) [Reserved]

(h) The owner or operator of the affected facility shall submit a signed statement indicating whether:

(1) The required CEMS calibration, span, and drift checks or other periodic audits have or have not been performed as specified.

(2) The data used to show compliance was or was not obtained in accordance with approved methods and procedures of this part and is representative of plant performance.

(3) The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.

(4) Compliance with the standards has or has not been achieved during the reporting period.

(i) For the purposes of the reports required under §60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under §60.42Da(b). Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter.

(j) The owner or operator of an affected facility shall submit the written reports required under this section and subpart A to the Administrator semiannually for each six-month period. All semiannual reports shall be postmarked by the 30th day following the end of each six-month period.

(k) The owner or operator of an affected facility may submit electronic quarterly reports for SO<sub>2</sub> and/or NO<sub>x</sub> and/or opacity in lieu of submitting the written reports required under paragraphs (b) and (i) of this section. The format of each quarterly electronic report shall be coordinated with the permitting authority. The electronic report(s) shall be submitted no later than 30 days after the end of the calendar quarter and shall be accompanied by a certification statement from the owner or operator, indicating whether compliance with the applicable emission standards and minimum data requirements of this subpart was achieved during the reporting period.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5083, Jan. 28, 2009; 77 FR 9458, Feb. 16, 2012]

 [Back to Top](#)

## **§60.52Da Recordkeeping requirements.**

(a) [Reserved]

(b) The owner or operator of an affected facility subject to the opacity limits in §60.42Da(b) that elects to monitor emissions according to the requirements in §60.49Da(a)(3) shall maintain records according to the requirements specified in paragraphs (b)(1) through (3) of this section, as applicable to the visible emissions monitoring method used.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (b)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

(iii) Copies of all visible emission observer opacity field data sheets;

(2) For each performance test conducted using Method 22 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (b)(2)(i) through (iv) of this section.

(i) Dates and time intervals of all visible emissions observation periods;

(ii) Name and affiliation for each visible emission observer participating in the performance test;

(iii) Copies of all visible emission observer opacity field data sheets; and

(iv) Documentation of any adjustments made and the time the adjustments were completed to the affected facility operation by the owner or operator to demonstrate compliance with the applicable monitoring requirements.

(3) For each digital opacity compliance system, the owner or operator shall maintain records and submit reports according to the requirements specified in the site-specific monitoring plan approved by the Administrator.

[74 FR 5083, Jan. 28, 2009, as amended at 77 FR 9459, Feb. 16, 2012]

 [Back to Top](#)

[Need assistance?](#)

Appendix B—40 CFR Part 60, Subpart Db

# Electronic Code of Federal Regulations

e-CFR data is current as of January 31, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 60](#) → Subpart Db

---

[Browse Previous](#) | [Browse Next](#)

Title 40: Protection of Environment

[PART 60—STANDARDS OF PERFORMANCE FOR NEW STATIONARY SOURCES](#)

---

## Subpart Db—Standards of Performance for Industrial-Commercial-Institutional Steam Generating Units

---

### Contents

[§60.40b Applicability and delegation of authority.](#)

[§60.41b Definitions.](#)

[§60.42b Standard for sulfur dioxide \(SO<sub>2</sub>\).](#)

[§60.43b Standard for particulate matter \(PM\).](#)

[§60.44b Standard for nitrogen oxides \(NO<sub>2</sub>\).](#)

[§60.45b Compliance and performance test methods and procedures for sulfur dioxide.](#)

[§60.46b Compliance and performance test methods and procedures for particulate matter and nitrogen oxides.](#)

[§60.47b Emission monitoring for sulfur dioxide.](#)

[§60.48b Emission monitoring for particulate matter and nitrogen oxides.](#)

[§60.49b Reporting and recordkeeping requirements.](#)

---

SOURCE: 72 FR 32742, June 13, 2007, unless otherwise noted.

 [Back to Top](#)

### **§60.40b Applicability and delegation of authority.**

(a) The affected facility to which this subpart applies is each steam generating unit that commences construction, modification, or reconstruction after June 19, 1984, and that has a heat input capacity from fuels combusted in the steam generating unit of greater than 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/hr)).

(b) Any affected facility meeting the applicability requirements under paragraph (a) of this section and commencing construction, modification, or reconstruction after June 19, 1984, but on or before June 19, 1986, is subject to the following standards:

(1) Coal-fired affected facilities having a heat input capacity between 29 and 73 MW (100 and 250 MMBtu/hr), inclusive, are subject to the particulate matter (PM) and nitrogen oxides (NO<sub>x</sub>) standards under this subpart.

(2) Coal-fired affected facilities having a heat input capacity greater than 73 MW (250 MMBtu/hr) and meeting the applicability requirements under subpart D (Standards of performance for fossil-fuel-fired steam generators; §60.40) are subject to the PM and NO<sub>x</sub> standards under this subpart and to the sulfur dioxide (SO<sub>2</sub>) standards under subpart D (§60.43).

(3) Oil-fired affected facilities having a heat input capacity between 29 and 73 MW (100 and 250 MMBtu/hr), inclusive, are subject to the NO<sub>x</sub> standards under this subpart.

(4) Oil-fired affected facilities having a heat input capacity greater than 73 MW (250 MMBtu/hr) and meeting the applicability requirements under subpart D (Standards of performance for fossil-fuel-fired steam generators; §60.40) are also subject to the NO<sub>x</sub> standards under this subpart and the PM and SO<sub>2</sub> standards under subpart D (§§60.42 and 60.43).

(c) Affected facilities that also meet the applicability requirements under subpart J or subpart Ja of this part are subject to the PM and NO<sub>x</sub> standards under this subpart and the SO<sub>2</sub> standards under subpart J or subpart Ja of this part, as applicable.

(d) Affected facilities that also meet the applicability requirements under subpart E (Standards of performance for incinerators; §60.50) are subject to the NO<sub>x</sub> and PM standards under this subpart.

(e) Steam generating units meeting the applicability requirements under subpart Da (Standards of performance for electric utility steam generating units; §60.40Da) are not subject to this subpart.

(f) Any change to an existing steam generating unit for the sole purpose of combusting gases containing total reduced sulfur (TRS) as defined under §60.281 is not considered a modification under §60.14 and the steam generating unit is not subject to this subpart.

(g) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, the following authorities shall be retained by the Administrator and not transferred to a State.

(1) Section 60.44b(f).

(2) Section 60.44b(g).

(3) Section 60.49b(a)(4).

(h) Any affected facility that meets the applicability requirements and is subject to subpart Ea, subpart Eb, subpart AAAA, or subpart CCCC of this part is not subject to this subpart.

(i) Affected facilities (*i.e.*, heat recovery steam generators) that are associated with stationary combustion turbines and that meet the applicability requirements of subpart KKKK of this part are not subject to this subpart. This subpart will continue to apply to all other affected facilities (*i.e.* heat recovery steam generators with duct burners) that are capable of combusting more than 29 MW (100 MMBtu/h) heat input of fossil fuel. If the affected facility (*i.e.* heat recovery steam generator) is subject to this subpart, only emissions resulting from combustion of fuels in the steam generating unit are subject to this subpart. (The stationary combustion turbine emissions are subject to subpart GG or KKKK, as applicable, of this part.)

(j) Any affected facility meeting the applicability requirements under paragraph (a) of this section and commencing construction, modification, or reconstruction after June 19, 1986 is not subject to subpart D (Standards of Performance for Fossil-Fuel-Fired Steam Generators, §60.40).

(k) Any affected facility that meets the applicability requirements and is subject to an EPA approved State or Federal section 111(d)/129 plan implementing subpart Cb or subpart BBBB of this part is not covered by this subpart.

(l) Affected facilities that also meet the applicability requirements under subpart BB of this part (Standards of Performance for Kraft Pulp Mills) are subject to the SO<sub>2</sub> and NO<sub>x</sub> standards under this subpart and the PM standards under subpart BB.

(m) Temporary boilers are not subject to this subpart.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5084, Jan. 28, 2009; 77 FR 9459, Feb. 16, 2012]

[↑ Back to Top](#)

#### **§60.41b Definitions.**

As used in this subpart, all terms not defined herein shall have the meaning given them in the Clean Air Act and in subpart A of this part.

*Annual capacity factor* means the ratio between the actual heat input to a steam generating unit from the fuels listed in §60.42b(a), §60.43b(a), or §60.44b(a), as applicable, during a calendar year and the potential heat input to the steam generating unit had it been operated for 8,760 hours during a calendar year at the maximum steady state design heat input capacity. In the case of steam generating units that are rented or leased, the actual heat input shall be determined based on the combined heat input from all operations of the affected facility in a calendar year.

*Byproduct/waste* means any liquid or gaseous substance produced at chemical manufacturing plants, petroleum refineries, or pulp and paper mills (except natural gas, distillate oil, or residual oil) and combusted in a steam generating unit for heat recovery or for disposal. Gaseous substances with carbon dioxide (CO<sub>2</sub>) levels greater than 50 percent or carbon monoxide levels greater than 10 percent are not byproduct/waste for the purpose of this subpart.

*Chemical manufacturing plants* mean industrial plants that are classified by the Department of Commerce under Standard Industrial Classification (SIC) Code 28.

*Coal* means all solid fuels classified as anthracite, bituminous, subbituminous, or lignite by the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17), coal refuse, and petroleum coke. Coal-derived synthetic fuels, including but not limited to solvent refined coal, gasified coal not meeting the definition of natural gas, coal-oil mixtures, coke oven gas, and coal-water mixtures, are also included in this definition for the purposes of this subpart.

*Coal refuse* means any byproduct of coal mining or coal cleaning operations with an ash content greater than 50 percent, by weight, and a heating value less than 13,900 kJ/kg (6,000 Btu/lb) on a dry basis.

*Cogeneration*, also known as combined heat and power, means a facility that simultaneously produces both electric (or mechanical) and useful thermal energy from the same primary energy source.

*Coke oven gas* means the volatile constituents generated in the gaseous exhaust during the carbonization of bituminous coal to form coke.

*Combined cycle system* means a system in which a separate source, such as a gas turbine, internal combustion engine, kiln, etc., provides exhaust gas to a steam generating unit.

*Conventional technology* means wet flue gas desulfurization (FGD) technology, dry FGD technology, atmospheric fluidized bed combustion technology, and oil hydrodesulfurization technology.

*Distillate oil* means fuel oils that contain 0.05 weight percent nitrogen or less and comply with the specifications for fuel oil numbers 1 and 2, as defined by the American Society of Testing and Materials in ASTM D396 (incorporated by reference, see §60.17), diesel fuel oil numbers 1 and 2, as defined by the American Society for Testing and Materials in ASTM D975 (incorporated by reference, see §60.17), kerosine, as defined by the American Society of Testing and Materials in ASTM D3699 (incorporated by reference, see §60.17), biodiesel as defined by the American Society of Testing and Materials in ASTM D6751 (incorporated by reference, see §60.17), or biodiesel blends as defined by the American Society of Testing and Materials in ASTM D7467 (incorporated by reference, see §60.17).

*Dry flue gas desulfurization technology* means a SO<sub>2</sub> control system that is located downstream of the steam generating unit and removes sulfur oxides from the combustion gases of the steam generating unit by contacting the combustion gases with an alkaline reagent and water, whether introduced separately or as a premixed slurry or solution and forming a dry powder material. This definition includes devices where the dry powder material is subsequently converted to another form. Alkaline slurries or solutions used in dry flue gas desulfurization technology include but are not limited to lime and sodium.

*Duct burner* means a device that combusts fuel and that is placed in the exhaust duct from another source, such as a stationary gas turbine, internal combustion engine, kiln, etc., to allow the firing of additional fuel to heat the exhaust gases before the exhaust gases enter a steam generating unit.

*Emerging technology* means any SO<sub>2</sub> control system that is not defined as a conventional technology under this section, and for which the owner or operator of the facility has applied to the Administrator and received approval to operate as an emerging technology under §60.49b(a)(4).

*Federally enforceable* means all limitations and conditions that are enforceable by the Administrator, including the requirements of 40 CFR parts 60 and 61, requirements within any applicable State Implementation Plan, and any permit requirements established under 40 CFR 52.21 or under 40 CFR 51.18 and 51.24.

*Fluidized bed combustion technology* means combustion of fuel in a bed or series of beds (including but not limited to bubbling bed units and circulating bed units) of limestone aggregate (or other sorbent materials) in which these materials are forced upward by the flow of combustion air and the gaseous products of combustion.



*Fuel pretreatment* means a process that removes a portion of the sulfur in a fuel before combustion of the fuel in a steam generating unit.

*Full capacity* means operation of the steam generating unit at 90 percent or more of the maximum steady-state design heat input capacity.

*Gaseous fuel* means any fuel that is a gas at ISO conditions. This includes, but is not limited to, natural gas and gasified coal (including coke oven gas).

*Gross output* means the gross useful work performed by the steam generated. For units generating only electricity, the gross useful work performed is the gross electrical output from the turbine/generator set. For cogeneration units, the gross useful work performed is the gross electrical or mechanical output plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process).

*Heat input* means heat derived from combustion of fuel in a steam generating unit and does not include the heat derived from preheated combustion air, recirculated flue gases, or exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

*Heat release rate* means the steam generating unit design heat input capacity (in MW or Btu/hr) divided by the furnace volume (in cubic meters or cubic feet); the furnace volume is that volume bounded by the front furnace wall where the burner is located, the furnace side waterwall, and extending to the level just below or in front of the first row of convection pass tubes.

*Heat transfer medium* means any material that is used to transfer heat from one point to another point.

*High heat release rate* means a heat release rate greater than 730,000 J/sec-m<sup>3</sup> (70,000 Btu/hr-ft<sup>3</sup>).

*ISO Conditions* means a temperature of 288 Kelvin, a relative humidity of 60 percent, and a pressure of 101.3 kilopascals.

*Lignite* means a type of coal classified as lignite A or lignite B by the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

*Low heat release rate* means a heat release rate of 730,000 J/sec-m<sup>3</sup> (70,000 Btu/hr-ft<sup>3</sup>) or less.

*Mass-feed stoker steam generating unit* means a steam generating unit where solid fuel is introduced directly into a retort or is fed directly onto a grate where it is combusted.

*Maximum heat input capacity* means the ability of a steam generating unit to combust a stated maximum amount of fuel on a steady state basis, as determined by the physical design and characteristics of the steam generating unit.

*Municipal-type solid waste* means refuse, more than 50 percent of which is waste consisting of a mixture of paper, wood, yard wastes, food wastes, plastics, leather, rubber, and other combustible materials, and noncombustible materials such as glass and rock.

*Natural gas* means:

(1) A naturally occurring mixture of hydrocarbon and nonhydrocarbon gases found in geologic formations beneath the earth's surface, of which the principal constituent is methane; or

(2) Liquefied petroleum gas, as defined by the American Society for Testing and Materials in ASTM D1835 (incorporated by reference, see §60.17); or

(3) A mixture of hydrocarbons that maintains a gaseous state at ISO conditions. Additionally, natural gas must either be composed of at least 70 percent methane by volume or have a gross calorific value between 34 and 43 megajoules (MJ) per dry standard cubic meter (910 and 1,150 Btu per dry standard cubic foot).

*Noncontinental area* means the State of Hawaii, the Virgin Islands, Guam, American Samoa, the Commonwealth of Puerto Rico, or the Northern Mariana Islands.

*Oil* means crude oil or petroleum or a liquid fuel derived from crude oil or petroleum, including distillate and residual oil.

*Petroleum refinery* means industrial plants as classified by the Department of Commerce under Standard Industrial Classification (SIC) Code 29.

*Potential sulfur dioxide emission rate* means the theoretical SO<sub>2</sub> emissions (nanograms per joule (ng/J) or lb/MMBtu heat input) that would result from combusting fuel in an uncleaned state and without using emission control systems. For gasified coal or oil that is desulfurized prior to combustion, the *Potential sulfur dioxide emission rate* is the theoretical SO<sub>2</sub> emissions (ng/J or lb/MMBtu heat input) that would result from combusting fuel in a cleaned state without using any post combustion emission control systems.

*Process heater* means a device that is primarily used to heat a material to initiate or promote a chemical reaction in which the material participates as a reactant or catalyst.

*Pulp and paper mills* means industrial plants that are classified by the Department of Commerce under North American Industry Classification System (NAICS) Code 322 or Standard Industrial Classification (SIC) Code 26.

*Pulverized coal-fired steam generating unit* means a steam generating unit in which pulverized coal is introduced into an air stream that carries the coal to the combustion chamber of the steam generating unit where it is fired in suspension. This includes both conventional pulverized coal-fired and micropulverized coal-fired steam generating units. Residual oil means crude oil, fuel oil numbers 1 and 2 that have a nitrogen content greater than 0.05 weight percent, and all fuel oil numbers 4, 5 and 6, as defined by the American Society of Testing and Materials in ASTM D396 (incorporated by reference, see §60.17).

*Spreader stoker steam generating unit* means a steam generating unit in which solid fuel is introduced to the combustion zone by a mechanism that throws the fuel onto a grate from above. Combustion takes place both in suspension and on the grate.

*Steam generating unit* means a device that combusts any fuel or byproduct/waste and produces steam or heats water or heats any heat transfer medium. This term includes any municipal-type solid waste incinerator with a heat recovery steam generating unit or any steam generating unit that combusts fuel and is part of a cogeneration system or a combined cycle system. This term does not include process heaters as they are defined in this subpart.

*Steam generating unit operating day* means a 24-hour period between 12:00 midnight and the following midnight during which any fuel is combusted at any time in the steam generating unit. It is not necessary for fuel to be combusted continuously for the entire 24-hour period.

*Temporary boiler* means any gaseous or liquid fuel-fired steam generating unit that is designed to, and is capable of, being carried or moved from one location to another by means of, for example, wheels, skids, carrying handles, dollies, trailers, or platforms. A steam generating unit is not a temporary boiler if any one of the following conditions exists:

(1) The equipment is attached to a foundation.

(2) The steam generating unit or a replacement remains at a location for more than 180 consecutive days. Any temporary boiler that replaces a temporary boiler at a location and performs the same or similar function will be included in calculating the consecutive time period.

(3) The equipment is located at a seasonal facility and operates during the full annual operating period of the seasonal facility, remains at the facility for at least 2 years, and operates at that facility for at least 3 months each year.

(4) The equipment is moved from one location to another in an attempt to circumvent the residence time requirements of this definition.

*Very low sulfur oil* means for units constructed, reconstructed, or modified on or before February 28, 2005, oil that contains no more than 0.5 weight percent sulfur or that, when combusted without SO<sub>2</sub> emission control, has a SO<sub>2</sub> emission rate equal to or less than 215 ng/J (0.5 lb/MMBtu) heat input. For units constructed, reconstructed, or modified after February 28, 2005 and not located in a noncontinental area, *very low sulfur oil* means oil that contains no more than 0.30 weight percent sulfur or that, when combusted without SO<sub>2</sub> emission control, has a SO<sub>2</sub> emission rate equal to or less than 140 ng/J (0.32 lb/MMBtu) heat input. For units constructed, reconstructed, or modified after February 28, 2005 and located in a noncontinental area, *very low sulfur oil* means oil that contains no more than 0.5 weight percent sulfur or that, when combusted without SO<sub>2</sub> emission control, has a SO<sub>2</sub> emission rate equal to or less than 215 ng/J (0.50 lb/MMBtu) heat input.

*Wet flue gas desulfurization technology* means a SO<sub>2</sub> control system that is located downstream of the steam generating unit and removes sulfur oxides from the combustion gases of the steam generating unit by contacting the combustion gas with an alkaline slurry or solution and forming a liquid material. This definition applies to devices where the aqueous liquid material product of this contact is subsequently converted to other forms. Alkaline reagents used in wet flue gas desulfurization technology include, but are not limited to, lime, limestone, and sodium.

*Wet scrubber system* means any emission control device that mixes an aqueous stream or slurry with the exhaust gases from a steam generating unit to control emissions of PM or SO<sub>2</sub>.

*Wood* means wood, wood residue, bark, or any derivative fuel or residue thereof, in any form, including, but not limited to, sawdust, sanderdust, wood chips, scraps, slabs, millings, shavings, and processed pellets made from wood or other forest residues.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5084, Jan. 28, 2009; 77 FR 9459, Feb. 16, 2012]

 [Back to Top](#)

#### §60.42b Standard for sulfur dioxide (SO<sub>2</sub>).

(a) Except as provided in paragraphs (b), (c), (d), or (j) of this section, on and after the date on which the performance test is completed or required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005, that combusts coal or oil shall cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 87 ng/J (0.20 lb/MMBtu) or 10 percent (0.10) of the potential SO<sub>2</sub> emission rate (90 percent reduction) and the emission limit determined according to the following formula:

$$E_s = \frac{(K_a H_a + K_b H_b)}{(H_a + H_b)}$$

[View or download PDF](#)

Where:

E<sub>s</sub> = SO<sub>2</sub> emission limit, in ng/J or lb/MMBtu heat input;

K<sub>a</sub> = 520 ng/J (or 1.2 lb/MMBtu);

K<sub>b</sub> = 340 ng/J (or 0.80 lb/MMBtu);

H<sub>a</sub> = Heat input from the combustion of coal, in J (MMBtu); and

H<sub>b</sub> = Heat input from the combustion of oil, in J (MMBtu).

For facilities complying with the percent reduction standard, only the heat input supplied to the affected facility from the combustion of coal and oil is counted in this paragraph. No credit is provided for the heat input to the affected facility from the combustion of natural gas, wood, municipal-type solid waste, or other fuels or heat derived from exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

(b) On and after the date on which the performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005, that combusts coal refuse alone in a fluidized bed combustion steam generating unit shall cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 87 ng/J (0.20 lb/MMBtu) or 20 percent (0.20) of the potential SO<sub>2</sub> emission rate (80 percent reduction) and 520 ng/J (1.2 lb/MMBtu) heat input. If coal or oil is fired with coal refuse, the affected facility is subject to paragraph (a) or (d) of this section, as applicable. For facilities complying with the percent reduction standard, only the heat input supplied to the affected facility from the combustion of coal and oil is counted in this paragraph. No credit is provided for the heat input to the affected facility from the combustion of natural gas, wood, municipal-type solid waste, or other fuels or heat derived from exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

(c) On and after the date on which the performance test is completed or is required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that combusts coal or oil, either alone or in combination with any other fuel, and that uses an emerging technology for the control of SO<sub>2</sub> emissions, shall cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 50 percent of the potential SO<sub>2</sub> emission rate (50 percent reduction) and that contain SO<sub>2</sub> in excess of the emission limit determined according to the following formula:

$$E_s = \frac{(K_c H_c + K_o H_o)}{(H_c + H_o)}$$

[View or download PDF](#)

Where:

$E_s$  = SO<sub>2</sub> emission limit, in ng/J or lb/MM Btu heat input;

$K_c$  = 260 ng/J (or 0.60 lb/MMBtu);

$K_o$  = 170 ng/J (or 0.40 lb/MMBtu);

$H_c$  = Heat input from the combustion of coal, in J (MMBtu); and

$H_o$  = Heat input from the combustion of oil, in J (MMBtu).

For facilities complying with the percent reduction standard, only the heat input supplied to the affected facility from the combustion of coal and oil is counted in this paragraph. No credit is provided for the heat input to the affected facility from the combustion of natural gas, wood, municipal-type solid waste, or other fuels, or from the heat input derived from exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

(d) On and after the date on which the performance test is completed or required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005 and listed in paragraphs (d)(1), (2), (3), or (4) of this section shall cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 520 ng/J (1.2 lb/MMBtu) heat input if the affected facility combusts coal, or 215 ng/J (0.5 lb/MMBtu) heat input if the affected facility combusts oil other than very low sulfur oil. Percent reduction requirements are not applicable to affected facilities under paragraphs (d)(1), (2), (3) or (4) of this section. For facilities complying with paragraphs (d)(1), (2), or (3) of this section, only the heat input supplied to the affected facility from the combustion of coal and oil is counted in this paragraph. No credit is provided for the heat input to the affected facility from the combustion of natural gas, wood, municipal-type solid waste, or other fuels or heat derived from exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

(1) Affected facilities that have an annual capacity factor for coal and oil of 30 percent (0.30) or less and are subject to a federally enforceable permit limiting the operation of the affected facility to an annual capacity factor for coal and oil of 30 percent (0.30) or less;

(2) Affected facilities located in a noncontinental area; or

(3) Affected facilities combusting coal or oil, alone or in combination with any fuel, in a duct burner as part of a combined cycle system where 30 percent (0.30) or less of the heat entering the steam generating unit is from combustion of coal and oil in the duct burner and 70 percent (0.70) or more of the heat entering the steam generating unit is from the exhaust gases entering the duct burner; or

(4) The affected facility burns coke oven gas alone or in combination with natural gas or very low sulfur distillate oil.

(e) Except as provided in paragraph (f) of this section, compliance with the emission limits, fuel oil sulfur limits, and/or percent reduction requirements under this section are determined on a 30-day rolling average basis.

(f) Except as provided in paragraph (j)(2) of this section, compliance with the emission limits or fuel oil sulfur limits under this section is determined on a 24-hour average basis for affected facilities that (1) have a federally enforceable permit limiting the annual capacity factor for oil to 10 percent or less, (2) combust only very low sulfur oil, and (3) do not combust any other fuel.

(g) Except as provided in paragraph (i) of this section and §60.45b(a), the SO<sub>2</sub> emission limits and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(h) Reductions in the potential SO<sub>2</sub> emission rate through fuel pretreatment are not credited toward the percent reduction requirement under paragraph (c) of this section unless:

(1) Fuel pretreatment results in a 50 percent or greater reduction in potential SO<sub>2</sub> emissions and

(2) Emissions from the pretreated fuel (without combustion or post-combustion SO<sub>2</sub> control) are equal to or less than the emission limits specified in paragraph (c) of this section.

(i) An affected facility subject to paragraph (a), (b), or (c) of this section may combust very low sulfur oil or natural gas when the SO<sub>2</sub> control system is not being operated because of malfunction or maintenance of the SO<sub>2</sub> control system.

(j) Percent reduction requirements are not applicable to affected facilities combusting only very low sulfur oil. The owner or operator of an affected facility combusting very low sulfur oil shall demonstrate that the oil meets the definition of very low sulfur oil by: (1) Following the performance testing procedures as described in §60.45b(c) or §60.45b(d), and following the monitoring procedures as described in §60.47b(a) or §60.47b(b) to determine SO<sub>2</sub> emission rate or fuel oil sulfur content; or (2) maintaining fuel records as described in §60.49b(r).

(k)(1) Except as provided in paragraphs (k)(2), (k)(3), and (k)(4) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts coal, oil, natural gas, a mixture of these fuels, or a mixture of these fuels with any other fuels shall cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 87 ng/J (0.20 lb/MMBtu) heat input or 8 percent (0.08) of the potential SO<sub>2</sub> emission rate (92 percent reduction) and 520 ng/J (1.2 lb/MMBtu) heat input. For facilities complying with the percent reduction standard and paragraph (k)(3) of this section, only the heat input supplied to the affected facility from the combustion of coal and oil is counted in paragraph (k) of this section. No credit is provided for the heat input to the affected facility from the combustion of natural gas, wood, municipal-type solid waste, or other fuels or heat derived from exhaust gases from other sources, such as gas turbines, internal combustion engines, kilns, etc.

(2) Units firing only very low sulfur oil, gaseous fuel, a mixture of these fuels, or a mixture of these fuels with any other fuels with a potential SO<sub>2</sub> emission rate of 140 ng/J (0.32 lb/MMBtu) heat input or less are exempt from the SO<sub>2</sub> emissions limit in paragraph (k)(1) of this section.

(3) Units that are located in a noncontinental area and that combust coal, oil, or natural gas shall not discharge any gases that contain SO<sub>2</sub> in excess of 520 ng/J (1.2 lb/MMBtu) heat input if the affected facility combusts coal, or 215 ng/J (0.50 lb/MMBtu) heat input if the affected facility combusts oil or natural gas.

(4) As an alternative to meeting the requirements under paragraph (k)(1) of this section, modified facilities that combust coal or a mixture of coal with other fuels shall not cause to be discharged into the atmosphere any gases that contain SO<sub>2</sub> in excess of 87 ng/J (0.20 lb/MMBtu) heat input or 10 percent (0.10) of the potential SO<sub>2</sub> emission rate (90 percent reduction) and 520 ng/J (1.2 lb/MMBtu) heat input.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5084, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011]

 [Back to Top](#)

#### **§60.43b Standard for particulate matter (PM).**

(a) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005 that combusts coal or combusts mixtures of coal with other fuels, shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of the following emission limits:

(1) 22 ng/J (0.051 lb/MMBtu) heat input, (i) If the affected facility combusts only coal, or

(ii) If the affected facility combusts coal and other fuels and has an annual capacity factor for the other fuels of 10 percent (0.10) or less.

(2) 43 ng/J (0.10 lb/MMBtu) heat input if the affected facility combusts coal and other fuels and has an annual capacity factor for the other fuels greater than 10 percent (0.10) and is subject to a federally enforceable requirement limiting operation of the affected facility to an annual capacity factor greater than 10 percent (0.10) for fuels other than coal.

(3) 86 ng/J (0.20 lb/MMBtu) heat input if the affected facility combusts coal or coal and other fuels and

(i) Has an annual capacity factor for coal or coal and other fuels of 30 percent (0.30) or less,

(ii) Has a maximum heat input capacity of 73 MW (250 MMBtu/hr) or less,

(iii) Has a federally enforceable requirement limiting operation of the affected facility to an annual capacity factor of 30 percent (0.30) or less for coal or coal and other solid fuels, and

(iv) Construction of the affected facility commenced after June 19, 1984, and before November 25, 1986.

(4) An affected facility burning coke oven gas alone or in combination with other fuels not subject to a PM standard under §60.43b and not using a post-combustion technology (except a wet scrubber) for reducing PM or SO<sub>2</sub> emissions is not subject to the PM limits under §60.43b(a).

(b) On and after the date on which the performance test is completed or required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005, and that combusts oil (or mixtures of oil with other fuels) and uses a conventional or emerging technology to reduce SO<sub>2</sub> emissions shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 43 ng/J (0.10 lb/MMBtu) heat input.

(c) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification on or before February 28, 2005, and that combusts wood, or wood with other fuels, except coal, shall cause to be discharged from that affected facility any gases that contain PM in excess of the following emission limits:

(1) 43 ng/J (0.10 lb/MMBtu) heat input if the affected facility has an annual capacity factor greater than 30 percent (0.30) for wood.

(2) 86 ng/J (0.20 lb/MMBtu) heat input if (i) The affected facility has an annual capacity factor of 30 percent (0.30) or less for wood;

(ii) Is subject to a federally enforceable requirement limiting operation of the affected facility to an annual capacity factor of 30 percent (0.30) or less for wood; and

(iii) Has a maximum heat input capacity of 73 MW (250 MMBtu/hr) or less.

(d) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that combusts municipal-type solid waste or mixtures of municipal-type solid waste with other fuels, shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of the following emission limits:

(1) 43 ng/J (0.10 lb/MMBtu) heat input;

(i) If the affected facility combusts only municipal-type solid waste; or

(ii) If the affected facility combusts municipal-type solid waste and other fuels and has an annual capacity factor for the other fuels of 10 percent (0.10) or less.

(2) 86 ng/J (0.20 lb/MMBtu) heat input if the affected facility combusts municipal-type solid waste or municipal-type solid waste and other fuels; and

(i) Has an annual capacity factor for municipal-type solid waste and other fuels of 30 percent (0.30) or less;

(ii) Has a maximum heat input capacity of 73 MW (250 MMBtu/hr) or less;

(iii) Has a federally enforceable requirement limiting operation of the affected facility to an annual capacity factor of 30 percent (0.30) or less for municipal-type solid waste, or municipal-type solid waste and other fuels; and

(iv) Construction of the affected facility commenced after June 19, 1984, but on or before November 25, 1986.



(e) For the purposes of this section, the annual capacity factor is determined by dividing the actual heat input to the steam generating unit during the calendar year from the combustion of coal, wood, or municipal-type solid waste, and other fuels, as applicable, by the potential heat input to the steam generating unit if the steam generating unit had been operated for 8,760 hours at the maximum heat input capacity.

(f) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that combusts coal, oil, wood, or mixtures of these fuels with any other fuels shall cause to be discharged into the atmosphere any gases that exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity. An owner or operator of an affected facility that elects to install, calibrate, maintain, and operate a continuous emissions monitoring system (CEMS) for measuring PM emissions according to the requirements of this subpart and is subject to a federally enforceable PM limit of 0.030 lb/MMBtu or less is exempt from the opacity standard specified in this paragraph.

(g) The PM and opacity standards apply at all times, except during periods of startup, shutdown, or malfunction.

(h)(1) Except as provided in paragraphs (h)(2), (h)(3), (h)(4), (h)(5), and (h)(6) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005, and that combusts coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 13 ng/J (0.030 lb/MMBtu) heat input,

(2) As an alternative to meeting the requirements of paragraph (h)(1) of this section, the owner or operator of an affected facility for which modification commenced after February 28, 2005, may elect to meet the requirements of this paragraph. On and after the date on which the initial performance test is completed or required to be completed under §60.8, no owner or operator of an affected facility that commences modification after February 28, 2005 shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of both:

(i) 22 ng/J (0.051 lb/MMBtu) heat input derived from the combustion of coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels; and

(ii) 0.2 percent of the combustion concentration (99.8 percent reduction) when combusting coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels.

(3) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commences modification after February 28, 2005, and that combusts over 30 percent wood (by heat input) on an annual basis and has a maximum heat input capacity of 73 MW (250 MMBtu/h) or less shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 43 ng/J (0.10 lb/MMBtu) heat input.

(4) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commences modification after February 28, 2005, and that combusts over 30 percent wood (by heat input) on an annual basis and has a maximum heat input capacity greater than 73 MW (250

MMBtu/h) shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 37 ng/J (0.085 lb/MMBtu) heat input.

(5) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, an owner or operator of an affected facility not located in a noncontinental area that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.30 weight percent sulfur, coke oven gas, a mixture of these fuels, or either fuel (or a mixture of these fuels) in combination with other fuels not subject to a PM standard in §60.43b and not using a post-combustion technology (except a wet scrubber) to reduce SO<sub>2</sub> or PM emissions is not subject to the PM limits in (h)(1) of this section.

(6) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, an owner or operator of an affected facility located in a noncontinental area that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.5 weight percent sulfur, coke oven gas, a mixture of these fuels, or either fuel (or a mixture of these fuels) in combination with other fuels not subject to a PM standard in §60.43b and not using a post-combustion technology (except a wet scrubber) to reduce SO<sub>2</sub> or PM emissions is not subject to the PM limits in (h)(1) of this section.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5084, Jan. 28, 2009; 77 FR 9459, Feb. 16, 2012]

[↑ Back to Top](#)

**§60.44b Standard for nitrogen oxides (NO<sub>2</sub>).**

(a) Except as provided under paragraphs (k) and (l) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that is subject to the provisions of this section and that combusts only coal, oil, or natural gas shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the following emission limits:

| Fuel/steam generating unit type                 | Nitrogen oxide emission limits<br>(expressed as NO <sub>2</sub> ) heat input |          |
|-------------------------------------------------|------------------------------------------------------------------------------|----------|
|                                                 | ng/J                                                                         | lb/MMBTu |
| (1) Natural gas and distillate oil, except (4): |                                                                              |          |
| (i) Low heat release rate                       | 43                                                                           | 0.10     |
| (ii) High heat release rate                     | 86                                                                           | 0.20     |
| (2) Residual oil:                               |                                                                              |          |
| (i) Low heat release rate                       | 130                                                                          | 0.30     |
| (ii) High heat release rate                     | 170                                                                          | 0.40     |
| (3) Coal:                                       |                                                                              |          |

|                                                                                                 |     |      |
|-------------------------------------------------------------------------------------------------|-----|------|
| (i) Mass-feed stoker                                                                            | 210 | 0.50 |
| (ii) Spreader stoker and fluidized bed combustion                                               | 260 | 0.60 |
| (iii) Pulverized coal                                                                           | 300 | 0.70 |
| (iv) Lignite, except (v)                                                                        | 260 | 0.60 |
| (v) Lignite mined in North Dakota, South Dakota, or Montana and combusted in a slag tap furnace | 340 | 0.80 |
| (vi) Coal-derived synthetic fuels                                                               | 210 | 0.50 |
| (4) Duct burner used in a combined cycle system:                                                |     |      |
| (i) Natural gas and distillate oil                                                              | 86  | 0.20 |
| (ii) Residual oil                                                                               | 170 | 0.40 |

(b) Except as provided under paragraphs (k) and (l) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that simultaneously combusts mixtures of only coal, oil, or natural gas shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> in excess of a limit determined by the use of the following formula:

$$E_n = \frac{(EL_g H_g) + (EL_o H_o) + (EL_c H_c)}{(H_g + H_o + H_c)}$$

[View or download PDF](#)

Where:

E<sub>n</sub> = NO<sub>x</sub> emission limit (expressed as NO<sub>2</sub>), ng/J (lb/MMBtu);

EL<sub>g</sub> = Appropriate emission limit from paragraph (a)(1) for combustion of natural gas or distillate oil, ng/J (lb/MMBtu);

H<sub>g</sub> = Heat input from combustion of natural gas or distillate oil, J (MMBtu);

EL<sub>o</sub> = Appropriate emission limit from paragraph (a)(2) for combustion of residual oil, ng/J (lb/MMBtu);

H<sub>o</sub> = Heat input from combustion of residual oil, J (MMBtu);

EL<sub>c</sub> = Appropriate emission limit from paragraph (a)(3) for combustion of coal, ng/J (lb/MMBtu); and

H<sub>c</sub> = Heat input from combustion of coal, J (MMBtu).

(c) Except as provided under paragraph (d) and (l) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that simultaneously combusts coal or oil, natural gas (or any combination of the three), and wood, or any other fuel shall cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> in excess of the emission limit for the coal, oil, natural gas (or any combination of the three), combusted in the affected facility, as

determined pursuant to paragraph (a) or (b) of this section. This standard does not apply to an affected facility that is subject to and in compliance with a federally enforceable requirement that limits operation of the affected facility to an annual capacity factor of 10 percent (0.10) or less for coal, oil, natural gas (or any combination of the three).

(d) On and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that simultaneously combusts natural gas and/or distillate oil with a potential SO<sub>2</sub> emissions rate of 26 ng/J (0.060 lb/MMBtu) or less with wood, municipal-type solid waste, or other solid fuel, except coal, shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> in excess of 130 ng/J (0.30 lb/MMBtu) heat input unless the affected facility has an annual capacity factor for natural gas, distillate oil, or a mixture of these fuels of 10 percent (0.10) or less and is subject to a federally enforceable requirement that limits operation of the affected facility to an annual capacity factor of 10 percent (0.10) or less for natural gas, distillate oil, or a mixture of these fuels.

(e) Except as provided under paragraph (l) of this section, on and after the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that simultaneously combusts only coal, oil, or natural gas with byproduct/waste shall cause to be discharged into the atmosphere any gases that contain NO<sub>x</sub> in excess of the emission limit determined by the following formula unless the affected facility has an annual capacity factor for coal, oil, and natural gas of 10 percent (0.10) or less and is subject to a federally enforceable requirement that limits operation of the affected facility to an annual capacity factor of 10 percent (0.10) or less:

(f) Any owner or operator of an affected facility that combusts byproduct/waste with either natural gas or oil may petition the Administrator within 180 days of the initial startup of the affected facility to establish a NO<sub>x</sub> emission limit that shall apply specifically to that affected facility when the byproduct/waste is combusted. The petition shall include sufficient and appropriate data, as determined by the Administrator, such as NO<sub>x</sub> emissions from the affected facility, waste composition (including nitrogen content), and combustion conditions to allow the Administrator to confirm that the affected facility is unable to comply with the emission limits in paragraph (e) of this section and to determine the appropriate emission limit for the affected facility.

(1) Any owner or operator of an affected facility petitioning for a facility-specific NO<sub>x</sub> emission limit under this section shall:

(i) Demonstrate compliance with the emission limits for natural gas and distillate oil in paragraph (a)(1) of this section or for residual oil in paragraph (a)(2) or (l)(1) of this section, as appropriate, by conducting a 30-day performance test as provided in §60.46b(e). During the performance test only natural gas, distillate oil, or residual oil shall be combusted in the affected facility; and

(ii) Demonstrate that the affected facility is unable to comply with the emission limits for natural gas and distillate oil in paragraph (a)(1) of this section or for residual oil in paragraph (a)(2) or (l)(1) of this section, as appropriate, when gaseous or liquid byproduct/waste is combusted in the affected facility under the same conditions and using the same technological system of emission reduction applied when demonstrating compliance under paragraph (f)(1)(i) of this section.

(2) The NO<sub>x</sub> emission limits for natural gas or distillate oil in paragraph (a)(1) of this section or for residual oil in paragraph (a)(2) or (l)(1) of this section, as appropriate, shall be applicable to the affected facility until and unless the petition is approved by the Administrator. If the petition is

approved by the Administrator, a facility-specific NO<sub>x</sub> emission limit will be established at the NO<sub>x</sub> emission level achievable when the affected facility is combusting oil or natural gas and byproduct/waste in a manner that the Administrator determines to be consistent with minimizing NO<sub>x</sub> emissions. In lieu of amending this subpart, a letter will be sent to the facility describing the facility-specific NO<sub>x</sub> limit. The facility shall use the compliance procedures detailed in the letter and make the letter available to the public. If the Administrator determines it is appropriate, the conditions and requirements of the letter can be reviewed and changed at any point.

(g) Any owner or operator of an affected facility that combusts hazardous waste (as defined by 40 CFR part 261 or 40 CFR part 761) with natural gas or oil may petition the Administrator within 180 days of the initial startup of the affected facility for a waiver from compliance with the NO<sub>x</sub> emission limit that applies specifically to that affected facility. The petition must include sufficient and appropriate data, as determined by the Administrator, on NO<sub>x</sub> emissions from the affected facility, waste destruction efficiencies, waste composition (including nitrogen content), the quantity of specific wastes to be combusted and combustion conditions to allow the Administrator to determine if the affected facility is able to comply with the NO<sub>x</sub> emission limits required by this section. The owner or operator of the affected facility shall demonstrate that when hazardous waste is combusted in the affected facility, thermal destruction efficiency requirements for hazardous waste specified in an applicable federally enforceable requirement preclude compliance with the NO<sub>x</sub> emission limits of this section. The NO<sub>x</sub> emission limits for natural gas or distillate oil in paragraph (a)(1) of this section or for residual oil in paragraph (a)(2) or (l)(1) of this section, as appropriate, are applicable to the affected facility until and unless the petition is approved by the Administrator. (See 40 CFR 761.70 for regulations applicable to the incineration of materials containing polychlorinated biphenyls (PCB's).) In lieu of amending this subpart, a letter will be sent to the facility describing the facility-specific NO<sub>x</sub> limit. The facility shall use the compliance procedures detailed in the letter and make the letter available to the public. If the Administrator determines it is appropriate, the conditions and requirements of the letter can be reviewed and changed at any point.

(h) For purposes of paragraph (i) of this section, the NO<sub>x</sub> standards under this section apply at all times including periods of startup, shutdown, or malfunction.

(i) Except as provided under paragraph (j) of this section, compliance with the emission limits under this section is determined on a 30-day rolling average basis.

(j) Compliance with the emission limits under this section is determined on a 24-hour average basis for the initial performance test and on a 3-hour average basis for subsequent performance tests for any affected facilities that:

(1) Combust, alone or in combination, only natural gas, distillate oil, or residual oil with a nitrogen content of 0.30 weight percent or less;

(2) Have a combined annual capacity factor of 10 percent or less for natural gas, distillate oil, and residual oil with a nitrogen content of 0.30 weight percent or less; and

(3) Are subject to a federally enforceable requirement limiting operation of the affected facility to the firing of natural gas, distillate oil, and/or residual oil with a nitrogen content of 0.30 weight percent or less and limiting operation of the affected facility to a combined annual capacity factor of 10 percent or less for natural gas, distillate oil, and residual oil with a nitrogen content of 0.30 weight percent or less.

(k) Affected facilities that meet the criteria described in paragraphs (j)(1), (2), and (3) of this section, and that have a heat input capacity of 73 MW (250 MMBtu/hr) or less, are not subject to the NO<sub>x</sub> emission limits under this section.

(l) On and after the date on which the initial performance test is completed or is required to be completed under 60.8, whichever date is first, no owner or operator of an affected facility that commenced construction after July 9, 1997 shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO<sub>x</sub> (expressed as NO<sub>2</sub>) in excess of the following limits:

(1) 86 ng/J (0.20 lb/MMBtu) heat input if the affected facility combusts coal, oil, or natural gas (or any combination of the three), alone or with any other fuels. The affected facility is not subject to this limit if it is subject to and in compliance with a federally enforceable requirement that limits operation of the facility to an annual capacity factor of 10 percent (0.10) or less for coal, oil, and natural gas (or any combination of the three); or

(2) If the affected facility has a low heat release rate and combusts natural gas or distillate oil in excess of 30 percent of the heat input on a 30-day rolling average from the combustion of all fuels, a limit determined by use of the following formula:

$$E_n = \frac{(0.10 \times H_g) + (0.20 \times H_r)}{(H_g + H_r)}$$

[View or download PDF](#)

Where:

E<sub>n</sub> = NO<sub>x</sub> emission limit, (lb/MMBtu);

H<sub>g</sub> = 30-day heat input from combustion of natural gas or distillate oil; and

H<sub>r</sub> = 30-day heat input from combustion of any other fuel.

(3) After February 27, 2006, units where more than 10 percent of total annual output is electrical or mechanical may comply with an optional limit of 270 ng/J (2.1 lb/MWh) gross energy output, based on a 30-day rolling average. Units complying with this output-based limit must demonstrate compliance according to the procedures of §60.48Da(i) of subpart Da of this part, and must monitor emissions according to §60.49Da(c), (k), through (n) of subpart Da of this part.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5086, Jan. 28, 2009; 77 FR 9459, Feb. 16, 2012]

[↑ Back to Top](#)

#### **§60.45b Compliance and performance test methods and procedures for sulfur dioxide.**

(a) The SO<sub>2</sub> emission standards in §60.42b apply at all times. Facilities burning coke oven gas alone or in combination with any other gaseous fuels or distillate oil are allowed to exceed the limit 30 operating days per calendar year for SO<sub>2</sub> control system maintenance.

(b) In conducting the performance tests required under §60.8, the owner or operator shall use the methods and procedures in appendix A (including fuel certification and sampling) of this part or

the methods and procedures as specified in this section, except as provided in §60.8(b). Section 60.8(f) does not apply to this section. The 30-day notice required in §60.8(d) applies only to the initial performance test unless otherwise specified by the Administrator.

(c) The owner or operator of an affected facility shall conduct performance tests to determine compliance with the percent of potential SO<sub>2</sub> emission rate (% P<sub>s</sub>) and the SO<sub>2</sub> emission rate (E<sub>s</sub>) pursuant to §60.42b following the procedures listed below, except as provided under paragraph (d) and (k) of this section.

(1) The initial performance test shall be conducted over 30 consecutive operating days of the steam generating unit. Compliance with the SO<sub>2</sub> standards shall be determined using a 30-day average. The first operating day included in the initial performance test shall be scheduled within 30 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of the facility.

(2) If only coal, only oil, or a mixture of coal and oil is combusted, the following procedures are used:

(i) The procedures in Method 19 of appendix A-7 of this part are used to determine the hourly SO<sub>2</sub> emission rate (E<sub>ho</sub>) and the 30-day average emission rate (E<sub>ao</sub>). The hourly averages used to compute the 30-day averages are obtained from the CEMS of §60.47b(a) or (b).

(ii) The percent of potential SO<sub>2</sub> emission rate (%P<sub>s</sub>) emitted to the atmosphere is computed using the following formula:

$$\%P_s = 100 \left( 1 - \frac{\%R_z}{100} \right) \left( 1 - \frac{\%R_f}{100} \right)$$

[View or download PDF](#)

Where:

%P<sub>s</sub> = Potential SO<sub>2</sub> emission rate, percent;

%R<sub>g</sub> = SO<sub>2</sub> removal efficiency of the control device as determined by Method 19 of appendix A of this part, in percent;  
and

%R<sub>r</sub> = SO<sub>2</sub> removal efficiency of fuel pretreatment as determined by Method 19 of appendix A of this part, in percent.

(3) If coal or oil is combusted with other fuels, the same procedures required in paragraph (c)(2) of this section are used, except as provided in the following:

(i) An adjusted hourly SO<sub>2</sub> emission rate (E<sub>ho</sub><sup>o</sup>) is used in Equation 19-19 of Method 19 of appendix A of this part to compute an adjusted 30-day average emission rate (E<sub>ao</sub><sup>o</sup>). The E<sub>ho</sub><sup>o</sup> is computed using the following formula:

$$E_{ho}^o = \frac{E_{ho} - E_w(1 - X_1)}{X_1}$$

[View or download PDF](#)

Where:

$E_{ho}^{\circ}$  = Adjusted hourly SO<sub>2</sub> emission rate, ng/J (lb/MMBtu);

$E_{ho}$  = Hourly SO<sub>2</sub> emission rate, ng/J (lb/MMBtu);

$E_w$  = SO<sub>2</sub> concentration in fuels other than coal and oil combusted in the affected facility, as determined by the fuel sampling and analysis procedures in Method 19 of appendix A of this part, ng/J (lb/MMBtu). The value  $E_w$  for each fuel lot is used for each hourly average during the time that the lot is being combusted; and

$X_k$  = Fraction of total heat input from fuel combustion derived from coal, oil, or coal and oil, as determined by applicable procedures in Method 19 of appendix A of this part.

(ii) To compute the percent of potential SO<sub>2</sub> emission rate (%P<sub>s</sub>), an adjusted %R<sub>g</sub> (%R<sub>g</sub><sup>°</sup>) is computed from the adjusted  $E_{ao}^{\circ}$  from paragraph (b)(3)(i) of this section and an adjusted average SO<sub>2</sub> inlet rate ( $E_{ai}^{\circ}$ ) using the following formula:

$$\%R_g^{\circ} = 100 \left( 1.0 - \frac{E_{ao}^{\circ}}{E_{ai}^{\circ}} \right)$$

[View or download PDF](#)

To compute  $E_{ai}^{\circ}$ , an adjusted hourly SO<sub>2</sub> inlet rate ( $E_{hi}^{\circ}$ ) is used. The  $E_{hi}^{\circ}$  is computed using the following formula:

$$E_{hi}^{\circ} = \frac{E_{hi} - E_w(1 - X_k)}{X_k}$$

[View or download PDF](#)

Where:

$E_{hi}^{\circ}$  = Adjusted hourly SO<sub>2</sub> inlet rate, ng/J (lb/MMBtu); and

$E_{hi}$  = Hourly SO<sub>2</sub> inlet rate, ng/J (lb/MMBtu).

(4) The owner or operator of an affected facility subject to paragraph (c)(3) of this section does not have to measure parameters  $E_w$  or  $X_k$  if the owner or operator elects to assume that  $X_k = 1.0$ . Owners or operators of affected facilities who assume  $X_k = 1.0$  shall:

(i) Determine %P<sub>s</sub> following the procedures in paragraph (c)(2) of this section; and

(ii) Sulfur dioxide emissions ( $E_s$ ) are considered to be in compliance with SO<sub>2</sub> emission limits under §60.42b.

(5) The owner or operator of an affected facility that qualifies under the provisions of §60.42b(d) does not have to measure parameters  $E_w$  or  $X_k$  in paragraph (c)(3) of this section if the owner or operator of the affected facility elects to measure SO<sub>2</sub> emission rates of the coal or oil following the fuel sampling and analysis procedures in Method 19 of appendix A-7 of this part.

(d) Except as provided in paragraph (j) of this section, the owner or operator of an affected facility that combusts only very low sulfur oil, natural gas, or a mixture of these fuels, has an annual



capacity factor for oil of 10 percent (0.10) or less, and is subject to a federally enforceable requirement limiting operation of the affected facility to an annual capacity factor for oil of 10 percent (0.10) or less shall:

(1) Conduct the initial performance test over 24 consecutive steam generating unit operating hours at full load;

(2) Determine compliance with the standards after the initial performance test based on the arithmetic average of the hourly emissions data during each steam generating unit operating day if a CEMS is used, or based on a daily average if Method 6B of appendix A of this part or fuel sampling and analysis procedures under Method 19 of appendix A of this part are used.

(e) The owner or operator of an affected facility subject to §60.42b(d)(1) shall demonstrate the maximum design capacity of the steam generating unit by operating the facility at maximum capacity for 24 hours. This demonstration will be made during the initial performance test and a subsequent demonstration may be requested at any other time. If the 24-hour average firing rate for the affected facility is less than the maximum design capacity provided by the manufacturer of the affected facility, the 24-hour average firing rate shall be used to determine the capacity utilization rate for the affected facility, otherwise the maximum design capacity provided by the manufacturer is used.

(f) For the initial performance test required under §60.8, compliance with the SO<sub>2</sub> emission limits and percent reduction requirements under §60.42b is based on the average emission rates and the average percent reduction for SO<sub>2</sub> for the first 30 consecutive steam generating unit operating days, except as provided under paragraph (d) of this section. The initial performance test is the only test for which at least 30 days prior notice is required unless otherwise specified by the Administrator. The initial performance test is to be scheduled so that the first steam generating unit operating day of the 30 successive steam generating unit operating days is completed within 30 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of the facility. The boiler load during the 30-day period does not have to be the maximum design load, but must be representative of future operating conditions and include at least one 24-hour period at full load.

(g) After the initial performance test required under §60.8, compliance with the SO<sub>2</sub> emission limits and percent reduction requirements under §60.42b is based on the average emission rates and the average percent reduction for SO<sub>2</sub> for 30 successive steam generating unit operating days, except as provided under paragraph (d). A separate performance test is completed at the end of each steam generating unit operating day after the initial performance test, and a new 30-day average emission rate and percent reduction for SO<sub>2</sub> are calculated to show compliance with the standard.

(h) Except as provided under paragraph (i) of this section, the owner or operator of an affected facility shall use all valid SO<sub>2</sub> emissions data in calculating %P<sub>s</sub> and E<sub>no</sub> under paragraph (c), of this section whether or not the minimum emissions data requirements under §60.46b are achieved. All valid emissions data, including valid SO<sub>2</sub> emission data collected during periods of startup, shutdown and malfunction, shall be used in calculating %P<sub>s</sub> and E<sub>no</sub> pursuant to paragraph (c) of this section.

(i) During periods of malfunction or maintenance of the SO<sub>2</sub> control systems when oil is combusted as provided under §60.42b(i), emission data are not used to calculate %P<sub>s</sub> or E<sub>s</sub> under §60.42b(a), (b) or (c), however, the emissions data are used to determine compliance with the emission limit under §60.42b(i).

(j) The owner or operator of an affected facility that only combusts very low sulfur oil, natural gas, or a mixture of these fuels with any other fuels not subject to an SO<sub>2</sub> standard is not subject to the compliance and performance testing requirements of this section if the owner or operator obtains fuel receipts as described in §60.49b(r).

(k) The owner or operator of an affected facility seeking to demonstrate compliance in §§60.42b(d)(4), 60.42b(j), 60.42b(k)(2), and 60.42b(k)(3) (when not burning coal) shall follow the applicable procedures in §60.49b(r).

[72 FR 32742, June 13, 2007, as amended at 74 FR 5086, Jan. 28, 2009]

 [Back to Top](#)

### **§60.46b Compliance and performance test methods and procedures for particulate matter and nitrogen oxides.**

(a) The PM emission standards and opacity limits under §60.43b apply at all times except during periods of startup, shutdown, or malfunction. The NO<sub>x</sub> emission standards under §60.44b apply at all times.

(b) Compliance with the PM emission standards under §60.43b shall be determined through performance testing as described in paragraph (d) of this section, except as provided in paragraph (i) of this section.

(c) Compliance with the NO<sub>x</sub> emission standards under §60.44b shall be determined through performance testing under paragraph (e) or (f), or under paragraphs (g) and (h) of this section, as applicable.

(d) To determine compliance with the PM emission limits and opacity limits under §60.43b, the owner or operator of an affected facility shall conduct an initial performance test as required under §60.8, and shall conduct subsequent performance tests as requested by the Administrator, using the following procedures and reference methods:

(1) Method 3A or 3B of appendix A-2 of this part is used for gas analysis when applying Method 5 of appendix A-3 of this part or Method 17 of appendix A-6 of this part.

(2) Method 5, 5B, or 17 of appendix A of this part shall be used to measure the concentration of PM as follows:

(i) Method 5 of appendix A of this part shall be used at affected facilities without wet flue gas desulfurization (FGD) systems; and

(ii) Method 17 of appendix A-6 of this part may be used at facilities with or without wet scrubber systems provided the stack gas temperature does not exceed a temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A-3 of this part may be used in Method 17 of appendix A-6 of this part only if it is used after a wet FGD system. Do not use Method 17 of appendix A-6 of this part after wet FGD systems if the effluent is saturated or laden with water droplets.

(iii) Method 5B of appendix A of this part is to be used only after wet FGD systems.

(3) Method 1 of appendix A of this part is used to select the sampling site and the number of traverse sampling points. The sampling time for each run is at least 120 minutes and the minimum sampling volume is 1.7 dscm (60 dscf) except that smaller sampling times or volumes may be approved by the Administrator when necessitated by process variables or other factors.

(4) For Method 5 of appendix A of this part, the temperature of the sample gas in the probe and filter holder is monitored and is maintained at  $160 \pm 14$  °C ( $320 \pm 25$  °F).

(5) For determination of PM emissions, the oxygen (O<sub>2</sub>) or CO<sub>2</sub> sample is obtained simultaneously with each run of Method 5, 5B, or 17 of appendix A of this part by traversing the duct at the same sampling location.

(6) For each run using Method 5, 5B, or 17 of appendix A of this part, the emission rate expressed in ng/J heat input is determined using:

(i) The O<sub>2</sub> or CO<sub>2</sub> measurements and PM measurements obtained under this section;

(ii) The dry basis F factor; and

(iii) The dry basis emission rate calculation procedure contained in Method 19 of appendix A of this part.

(7) Method 9 of appendix A of this part is used for determining the opacity of stack emissions.

(e) To determine compliance with the emission limits for NO<sub>x</sub> required under §60.44b, the owner or operator of an affected facility shall conduct the performance test as required under §60.8 using the continuous system for monitoring NO<sub>x</sub> under §60.48(b).

(1) For the initial compliance test, NO<sub>x</sub> from the steam generating unit are monitored for 30 successive steam generating unit operating days and the 30-day average emission rate is used to determine compliance with the NO<sub>x</sub> emission standards under §60.44b. The 30-day average emission rate is calculated as the average of all hourly emissions data recorded by the monitoring system during the 30-day test period.

(2) Following the date on which the initial performance test is completed or is required to be completed in §60.8, whichever date comes first, the owner or operator of an affected facility which combusts coal (except as specified under §60.46b(e)(4)) or which combusts residual oil having a nitrogen content greater than 0.30 weight percent shall determine compliance with the NO<sub>x</sub> emission standards in §60.44b on a continuous basis through the use of a 30-day rolling average emission rate. A new 30-day rolling average emission rate is calculated for each steam generating unit operating day as the average of all of the hourly NO<sub>x</sub> emission data for the preceding 30 steam generating unit operating days.

(3) Following the date on which the initial performance test is completed or is required to be completed under §60.8, whichever date comes first, the owner or operator of an affected facility that has a heat input capacity greater than 73 MW (250 MMBtu/hr) and that combusts natural gas, distillate oil, or residual oil having a nitrogen content of 0.30 weight percent or less shall determine compliance with the NO<sub>x</sub> standards under §60.44b on a continuous basis through the use of a 30-day rolling average emission rate. A new 30-day rolling average emission rate is calculated each steam generating unit operating day as the average of all of the hourly NO<sub>x</sub> emission data for the preceding 30 steam generating unit operating days.

(4) Following the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, the owner or operator of an affected facility that has a heat input capacity of 73 MW (250 MMBtu/hr) or less and that combusts natural gas, distillate oil, gasified coal, or residual oil having a nitrogen content of 0.30 weight percent or less shall upon request determine compliance with the NO<sub>x</sub> standards in §60.44b through the use of a 30-day performance test. During periods when performance tests are not requested, NO<sub>x</sub> emissions data collected pursuant to §60.48b(g)(1) or §60.48b(g)(2) are used to calculate a 30-day rolling average emission rate on a daily basis and used to prepare excess emission reports, but will not be used to determine compliance with the NO<sub>x</sub> emission standards. A new 30-day rolling average emission rate is calculated each steam generating unit operating day as the average of all of the hourly NO<sub>x</sub> emission data for the preceding 30 steam generating unit operating days.

(5) If the owner or operator of an affected facility that combusts residual oil does not sample and analyze the residual oil for nitrogen content, as specified in §60.49b(e), the requirements of §60.48b(g)(1) apply and the provisions of §60.48b(g)(2) are inapplicable.

(f) To determine compliance with the emissions limits for NO<sub>x</sub> required by §60.44b(a)(4) or §60.44b(l) for duct burners used in combined cycle systems, either of the procedures described in paragraph (f)(1) or (2) of this section may be used:

(1) The owner or operator of an affected facility shall conduct the performance test required under §60.8 as follows:

(i) The emissions rate (E) of NO<sub>x</sub> shall be computed using Equation 1 in this section:

$$E = E_{t,z} + \left( \frac{H_z}{H_b} \right) (E_{t,z} - E_{z,t}) \quad (\text{Eq.1})$$

[View or download PDF](#)

Where:

E = Emissions rate of NO<sub>x</sub> from the duct burner, ng/J (lb/MMBtu) heat input;

E<sub>sg</sub> = Combined effluent emissions rate, in ng/J (lb/MMBtu) heat input using appropriate F factor as described in Method 19 of appendix A of this part;

H<sub>g</sub> = Heat input rate to the combustion turbine, in J/hr (MMBtu/hr);

H<sub>b</sub> = Heat input rate to the duct burner, in J/hr (MMBtu/hr); and

E<sub>g</sub> = Emissions rate from the combustion turbine, in ng/J (lb/MMBtu) heat input calculated using appropriate F factor as described in Method 19 of appendix A of this part.

(ii) Method 7E of appendix A of this part or Method 320 of appendix A of part 63 shall be used to determine the NO<sub>x</sub> concentrations. Method 3A or 3B of appendix A of this part shall be used to determine O<sub>2</sub> concentration.

(iii) The owner or operator shall identify and demonstrate to the Administrator's satisfaction suitable methods to determine the average hourly heat input rate to the combustion turbine and the average hourly heat input rate to the affected duct burner.

(iv) Compliance with the emissions limits under §60.44b(a)(4) or §60.44b(l) is determined by the three-run average (nominal 1-hour runs) for the initial and subsequent performance tests; or

(2) The owner or operator of an affected facility may elect to determine compliance on a 30-day rolling average basis by using the CEMS specified under §60.48b for measuring NO<sub>x</sub> and O<sub>2</sub> and meet the requirements of §60.48b. The sampling site shall be located at the outlet from the steam generating unit. The NO<sub>x</sub> emissions rate at the outlet from the steam generating unit shall constitute the NO<sub>x</sub> emissions rate from the duct burner of the combined cycle system.

(g) The owner or operator of an affected facility described in §60.44b(j) or §60.44b(k) shall demonstrate the maximum heat input capacity of the steam generating unit by operating the facility at maximum capacity for 24 hours. The owner or operator of an affected facility shall determine the maximum heat input capacity using the heat loss method or the heat input method described in sections 5 and 7.3 of the ASME *Power Test Codes* 4.1 (incorporated by reference, see §60.17). This demonstration of maximum heat input capacity shall be made during the initial performance test for affected facilities that meet the criteria of §60.44b(j). It shall be made within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial start-up of each facility, for affected facilities meeting the criteria of §60.44b(k). Subsequent demonstrations may be required by the Administrator at any other time. If this demonstration indicates that the maximum heat input capacity of the affected facility is less than that stated by the manufacturer of the affected facility, the maximum heat input capacity determined during this demonstration shall be used to determine the capacity utilization rate for the affected facility. Otherwise, the maximum heat input capacity provided by the manufacturer is used.

(h) The owner or operator of an affected facility described in §60.44b(j) that has a heat input capacity greater than 73 MW (250 MMBtu/hr) shall:

(1) Conduct an initial performance test as required under §60.8 over a minimum of 24 consecutive steam generating unit operating hours at maximum heat input capacity to demonstrate compliance with the NO<sub>x</sub> emission standards under §60.44b using Method 7, 7A, or 7E of appendix A of this part, Method 320 of appendix A of part 63 of this chapter, or other approved reference methods; and

(2) Conduct subsequent performance tests once per calendar year or every 400 hours of operation (whichever comes first) to demonstrate compliance with the NO<sub>x</sub> emission standards under §60.44b over a minimum of 3 consecutive steam generating unit operating hours at maximum heat input capacity using Method 7, 7A, or 7E of appendix A of this part, Method 320 of appendix A of part 63, or other approved reference methods.

(i) The owner or operator of an affected facility seeking to demonstrate compliance with the PM limit in paragraphs §60.43b(a)(4) or §60.43b(h)(5) shall follow the applicable procedures in §60.49b(r).

(j) In place of PM testing with Method 5 or 5B of appendix A-3 of this part, or Method 17 of appendix A-6 of this part, an owner or operator may elect to install, calibrate, maintain, and operate a CEMS for monitoring PM emissions discharged to the atmosphere and record the output of the system. The owner or operator of an affected facility who elects to continuously monitor PM emissions instead of conducting performance testing using Method 5 or 5B of appendix A-3 of this part or Method 17 of appendix A-6 of this part shall comply with the requirements specified in paragraphs (j)(1) through (j)(14) of this section.

(1) Notify the Administrator one month before starting use of the system.

(2) Notify the Administrator one month before stopping use of the system.

(3) The monitor shall be installed, evaluated, and operated in accordance with §60.13 of subpart A of this part.

(4) The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the affected facility, as specified under §60.8 of subpart A of this part or within 180 days of notification to the Administrator of use of the CEMS if the owner or operator was previously determining compliance by Method 5, 5B, or 17 of appendix A of this part performance tests, whichever is later.

(5) The owner or operator of an affected facility shall conduct an initial performance test for PM emissions as required under §60.8 of subpart A of this part. Compliance with the PM emission limit shall be determined by using the CEMS specified in paragraph (j) of this section to measure PM and calculating a 24-hour block arithmetic average emission concentration using EPA Reference Method 19 of appendix A of this part, section 4.1.

(6) Compliance with the PM emission limit shall be determined based on the 24-hour daily (block) average of the hourly arithmetic average emission concentrations using CEMS outlet data.

(7) At a minimum, valid CEMS hourly averages shall be obtained as specified in paragraphs (j)(7)(i) of this section for 75 percent of the total operating hours per 30-day rolling average.

(i) At least two data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) [Reserved]

(8) The 1-hour arithmetic averages required under paragraph (j)(7) of this section shall be expressed in ng/J or lb/MMBtu heat input and shall be used to calculate the boiler operating day daily arithmetic average emission concentrations. The 1-hour arithmetic averages shall be calculated using the data points required under §60.13(e)(2) of subpart A of this part.

(9) All valid CEMS data shall be used in calculating average emission concentrations even if the minimum CEMS data requirements of paragraph (j)(7) of this section are not met.

(10) The CEMS shall be operated according to Performance Specification 11 in appendix B of this part.

(11) During the correlation testing runs of the CEMS required by Performance Specification 11 in appendix B of this part, PM and O<sub>2</sub> (or CO<sub>2</sub>) data shall be collected concurrently (or within a 30-to 60-minute period) by both the continuous emission monitors and performance tests conducted using the following test methods.

(i) For PM, Method 5 or 5B of appendix A-3 of this part or Method 17 of appendix A-6 of this part shall be used; and

(ii) For O<sub>2</sub> (or CO<sub>2</sub>), Method 3A or 3B of appendix A-2 of this part, as applicable shall be used.

(12) Quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with procedure 2 in appendix F of this part. Relative Response Audit's must be performed annually and Response Correlation Audits must be performed every 3 years.

(13) When PM emissions data are not obtained because of CEMS breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained by using other monitoring systems as approved by the Administrator or EPA Reference Method 19 of appendix A of this part to provide, as necessary, valid emissions data for a minimum of 75 percent of total operating hours per 30-day rolling average.

(14) As of January 1, 2012, and within 90 days after the date of completing each performance test, as defined in §60.8, conducted to demonstrate compliance with this subpart, you must submit relative accuracy test audit (*i.e.*, reference method) data and performance test (*i.e.*, compliance test) data, except opacity data, electronically to EPA's Central Data Exchange (CDX) by using the Electronic Reporting Tool (ERT) (see [http://www.epa.gov/ttn/chief/ert/ert\\_\\_\\_tool.html/](http://www.epa.gov/ttn/chief/ert/ert___tool.html/)) or other compatible electronic spreadsheet. Only data collected using test methods compatible with ERT are subject to this requirement to be submitted electronically into EPA's WebFIRE database.

[72 FR 32742, June 13, 2007, as amended at 74 FR 5086, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9460, Feb. 16, 2012; 79 FR 11249, Feb. 27, 2014]

[↑ Back to Top](#)

#### **§60.47b Emission monitoring for sulfur dioxide.**

(a) Except as provided in paragraphs (b) and (f) of this section, the owner or operator of an affected facility subject to the SO<sub>2</sub> standards in §60.42b shall install, calibrate, maintain, and operate CEMS for measuring SO<sub>2</sub> concentrations and either O<sub>2</sub> or CO<sub>2</sub> concentrations and shall record the output of the systems. For units complying with the percent reduction standard, the SO<sub>2</sub> and either O<sub>2</sub> or CO<sub>2</sub> concentrations shall both be monitored at the inlet and outlet of the SO<sub>2</sub> control device. If the owner or operator has installed and certified SO<sub>2</sub> and O<sub>2</sub> or CO<sub>2</sub> CEMS according to the requirements of §75.20(c)(1) of this chapter and appendix A to part 75 of this chapter, and is continuing to meet the ongoing quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, those CEMS may be used to meet the requirements of this section, provided that:

(1) When relative accuracy testing is conducted, SO<sub>2</sub> concentration data and CO<sub>2</sub> (or O<sub>2</sub>) data are collected simultaneously; and

(2) In addition to meeting the applicable SO<sub>2</sub> and CO<sub>2</sub> (or O<sub>2</sub>) relative accuracy specifications in Figure 2 of appendix B to part 75 of this chapter, the relative accuracy (RA) standard in section 13.2 of Performance Specification 2 in appendix B to this part is met when the RA is calculated on a lb/MMBtu basis; and

(3) The reporting requirements of §60.49b are met. SO<sub>2</sub> and CO<sub>2</sub> (or O<sub>2</sub>) data used to meet the requirements of §60.49b shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the SO<sub>2</sub> data have been bias adjusted according to the procedures of part 75 of this chapter.

(b) As an alternative to operating CEMS as required under paragraph (a) of this section, an owner or operator may elect to determine the average SO<sub>2</sub> emissions and percent reduction by:

(1) Collecting coal or oil samples in an as-fired condition at the inlet to the steam generating unit and analyzing them for sulfur and heat content according to Method 19 of appendix A of this part. Method 19 of appendix A of this part provides procedures for converting these measurements into the format to be used in calculating the average SO<sub>2</sub> input rate, or

(2) Measuring SO<sub>2</sub> according to Method 6B of appendix A of this part at the inlet or outlet to the SO<sub>2</sub> control system. An initial stratification test is required to verify the adequacy of the sampling location for Method 6B of appendix A of this part. The stratification test shall consist of three paired runs of a suitable SO<sub>2</sub> and CO<sub>2</sub> measurement train operated at the candidate location and a second similar train operated according to the procedures in Section 3.2 and the applicable procedures in Section 7 of Performance Specification 2. Method 6B of appendix A of this part, Method 6A of appendix A of this part, or a combination of Methods 6 and 3 or 3B of appendix A of this part or Methods 6C or Method 320 of appendix A of part 63 of this chapter and 3A of appendix A of this part are suitable measurement techniques. If Method 6B of appendix A of this part is used for the second train, sampling time and timer operation may be adjusted for the stratification test as long as an adequate sample volume is collected; however, both sampling trains are to be operated similarly. For the location to be adequate for Method 6B of appendix A of this part, 24-hour tests, the mean of the absolute difference between the three paired runs must be less than 10 percent.

(3) A daily SO<sub>2</sub> emission rate, E<sub>D</sub>, shall be determined using the procedure described in Method 6A of appendix A of this part, section 7.6.2 (Equation 6A-8) and stated in ng/J (lb/MMBtu) heat input.

(4) The mean 30-day emission rate is calculated using the daily measured values in ng/J (lb/MMBtu) for 30 successive steam generating unit operating days using equation 19-20 of Method 19 of appendix A of this part.

(c) The owner or operator of an affected facility shall obtain emission data for at least 75 percent of the operating hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement is not met with a single monitoring system, the owner or operator of the affected facility shall supplement the emission data with data collected with other monitoring systems as approved by the Administrator or the reference methods and procedures as described in paragraph (b) of this section.

(d) The 1-hour average SO<sub>2</sub> emission rates measured by the CEMS required by paragraph (a) of this section and required under §60.13(h) is expressed in ng/J or lb/MMBtu heat input and is used to calculate the average emission rates under §60.42(b). Each 1-hour average SO<sub>2</sub> emission rate must be based on 30 or more minutes of steam generating unit operation. The hourly averages shall be calculated according to §60.13(h)(2). Hourly SO<sub>2</sub> emission rates are not calculated if the affected facility is operated less than 30 minutes in a given clock hour and are not counted toward determination of a steam generating unit operating day.

(e) The procedures under §60.13 shall be followed for installation, evaluation, and operation of the CEMS.

(1) Except as provided for in paragraph (e)(4) of this section, all CEMS shall be operated in accordance with the applicable procedures under Performance Specifications 1, 2, and 3 of appendix B of this part.

(2) Except as provided for in paragraph (e)(4) of this section, quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with Procedure 1 of appendix F of this part.

(3) For affected facilities combusting coal or oil, alone or in combination with other fuels, the span value of the SO<sub>2</sub> CEMS at the inlet to the SO<sub>2</sub> control device is 125 percent of the maximum estimated hourly potential SO<sub>2</sub> emissions of the fuel combusted, and the span value of the CEMS at the outlet to the SO<sub>2</sub> control device is 50 percent of the maximum estimated hourly potential



SO<sub>2</sub> emissions of the fuel combusted. Alternatively, SO<sub>2</sub> span values determined according to section 2.1.1 in appendix A to part 75 of this chapter may be used.

(4) As an alternative to meeting the requirements of paragraphs (e)(1) and (e)(2) of this section, the owner or operator may elect to implement the following alternative data accuracy assessment procedures:

(i) For all required CO<sub>2</sub> and O<sub>2</sub> monitors and for SO<sub>2</sub> and NO<sub>x</sub> monitors with span values greater than or equal to 100 ppm, the daily calibration error test and calibration adjustment procedures described in sections 2.1.1 and 2.1.3 of appendix B to part 75 of this chapter may be followed instead of the CD assessment procedures in Procedure 1, section 4.1 of appendix F to this part.

(ii) For all required CO<sub>2</sub> and O<sub>2</sub> monitors and for SO<sub>2</sub> and NO<sub>x</sub> monitors with span values greater than 30 ppm, quarterly linearity checks may be performed in accordance with section 2.2.1 of appendix B to part 75 of this chapter, instead of performing the cylinder gas audits (CGAs) described in Procedure 1, section 5.1.2 of appendix F to this part. If this option is selected: The frequency of the linearity checks shall be as specified in section 2.2.1 of appendix B to part 75 of this chapter; the applicable linearity specifications in section 3.2 of appendix A to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.2.3 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.2.4 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the cylinder gas audits described in Procedure 1, section 5.1.2 of appendix F to this part shall be performed for SO<sub>2</sub> and NO<sub>x</sub> span values less than or equal to 30 ppm; and

(iii) For SO<sub>2</sub>, CO<sub>2</sub>, and O<sub>2</sub> monitoring systems and for NO<sub>x</sub> emission rate monitoring systems, RATAs may be performed in accordance with section 2.3 of appendix B to part 75 of this chapter instead of following the procedures described in Procedure 1, section 5.1.1 of appendix F to this part. If this option is selected: The frequency of each RATA shall be as specified in section 2.3.1 of appendix B to part 75 of this chapter; the applicable relative accuracy specifications shown in Figure 2 in appendix B to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.3.2 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.3.3 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the relative accuracy specification in section 13.2 of Performance Specification 2 in appendix B to this part shall be met on a lb/MMBtu basis for SO<sub>2</sub> (regardless of the SO<sub>2</sub> emission level during the RATA), and for NO<sub>x</sub> when the average NO<sub>x</sub> emission rate measured by the reference method during the RATA is less than 0.100 lb/MMBtu.

(f) The owner or operator of an affected facility that combusts very low sulfur oil or is demonstrating compliance under §60.45b(k) is not subject to the emission monitoring requirements under paragraph (a) of this section if the owner or operator maintains fuel records as described in §60.49b(r).

[72 FR 32742, June 13, 2007, as amended at 74 FR 5087, Jan. 28, 2009; 79 FR 11249, Feb. 27, 2014]

 [Back to Top](#)

#### **§60.48b Emission monitoring for particulate matter and nitrogen oxides.**

(a) Except as provided in paragraph (j) of this section, the owner or operator of an affected facility subject to the opacity standard under §60.43b shall install, calibrate, maintain, and operate a

continuous opacity monitoring systems (COMS) for measuring the opacity of emissions discharged to the atmosphere and record the output of the system. The owner or operator of an affected facility subject to an opacity standard under §60.43b and meeting the conditions under paragraphs (j)(1), (2), (3), (4), (5), or (6) of this section who elects not to use a COMS shall conduct a performance test using Method 9 of appendix A-4 of this part and the procedures in §60.11 to demonstrate compliance with the applicable limit in §60.43b by April 29, 2011, within 45 days of stopping use of an existing COMS, or within 180 days after initial startup of the facility, whichever is later, and shall comply with either paragraphs (a)(1), (a)(2), or (a)(3) of this section. The observation period for Method 9 of appendix A-4 of this part performance tests may be reduced from 3 hours to 60 minutes if all 6-minute averages are less than 10 percent and all individual 15-second observations are less than or equal to 20 percent during the initial 60 minutes of observation.

(1) Except as provided in paragraph (a)(2) and (a)(3) of this section, the owner or operator shall conduct subsequent Method 9 of appendix A-4 of this part performance tests using the procedures in paragraph (a) of this section according to the applicable schedule in paragraphs (a)(1)(i) through (a)(1)(iv) of this section, as determined by the most recent Method 9 of appendix A-4 of this part performance test results.

(i) If no visible emissions are observed, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 12 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(ii) If visible emissions are observed but the maximum 6-minute average opacity is less than or equal to 5 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 6 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(iii) If the maximum 6-minute average opacity is greater than 5 percent but less than or equal to 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 3 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later; or

(iv) If the maximum 6-minute average opacity is greater than 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 45 calendar days from the date that the most recent performance test was conducted.

(2) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 of this part performance tests, elect to perform subsequent monitoring using Method 22 of appendix A-7 of this part according to the procedures specified in paragraphs (a)(2)(i) and (ii) of this section.

(i) The owner or operator shall conduct 10 minute observations (during normal operation) each operating day the affected facility fires fuel for which an opacity standard is applicable using Method 22 of appendix A-7 of this part and demonstrate that the sum of the occurrences of any visible emissions is not in excess of 5 percent of the observation period (*i.e.*, 30 seconds per 10 minute period). If the sum of the occurrence of any visible emissions is greater than 30 seconds during the initial 10 minute observation, immediately conduct a 30 minute observation. If the sum of the occurrence of visible emissions is greater than 5 percent of the observation period (*i.e.*, 90 seconds per 30 minute period), the owner or operator shall either document and adjust the operation of the

facility and demonstrate within 24 hours that the sum of the occurrence of visible emissions is equal to or less than 5 percent during a 30 minute observation (*i.e.*, 90 seconds) or conduct a new Method 9 of appendix A-4 of this part performance test using the procedures in paragraph (a) of this section within 45 calendar days according to the requirements in §60.46d(d)(7).

(ii) If no visible emissions are observed for 10 operating days during which an opacity standard is applicable, observations can be reduced to once every 7 operating days during which an opacity standard is applicable. If any visible emissions are observed, daily observations shall be resumed.

(3) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 performance tests, elect to perform subsequent monitoring using a digital opacity compliance system according to a site-specific monitoring plan approved by the Administrator. The observations shall be similar, but not necessarily identical, to the requirements in paragraph (a)(2) of this section. For reference purposes in preparing the monitoring plan, see OAQPS "Determination of Visible Emission Opacity from Stationary Sources Using Computer-Based Photographic Analysis Systems." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality and Planning Standards; Sector Policies and Programs Division; Measurement Policy Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Preliminary Methods.

(b) Except as provided under paragraphs (g), (h), and (i) of this section, the owner or operator of an affected facility subject to a NO<sub>x</sub> standard under §60.44b shall comply with either paragraphs (b)(1) or (b)(2) of this section.

(1) Install, calibrate, maintain, and operate CEMS for measuring NO<sub>x</sub> and O<sub>2</sub> (or CO<sub>2</sub>) emissions discharged to the atmosphere, and shall record the output of the system; or

(2) If the owner or operator has installed a NO<sub>x</sub> emission rate CEMS to meet the requirements of part 75 of this chapter and is continuing to meet the ongoing requirements of part 75 of this chapter, that CEMS may be used to meet the requirements of this section, except that the owner or operator shall also meet the requirements of §60.49b. Data reported to meet the requirements of §60.49b shall not include data substituted using the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(c) The CEMS required under paragraph (b) of this section shall be operated and data recorded during all periods of operation of the affected facility except for CEMS breakdowns and repairs. Data is recorded during calibration checks, and zero and span adjustments.

(d) The 1-hour average NO<sub>x</sub> emission rates measured by the continuous NO<sub>x</sub> monitor required by paragraph (b) of this section and required under §60.13(h) shall be expressed in ng/J or lb/MMBtu heat input and shall be used to calculate the average emission rates under §60.44b. The 1-hour averages shall be calculated using the data points required under §60.13(h)(2).

(e) The procedures under §60.13 shall be followed for installation, evaluation, and operation of the continuous monitoring systems.

(1) For affected facilities combusting coal, wood or municipal-type solid waste, the span value for a COMS shall be between 60 and 80 percent.

(2) For affected facilities combusting coal, oil, or natural gas, the span value for NO<sub>x</sub> is determined using one of the following procedures:

(i) Except as provided under paragraph (e)(2)(ii) of this section, NO<sub>x</sub> span values shall be determined as follows:

| <b>Fuel</b> | <b>Span values for NO<sub>x</sub><br/>(ppm)</b> |
|-------------|-------------------------------------------------|
| Natural gas | 500.                                            |
| Oil         | 500.                                            |
| Coal        | 1,000.                                          |
| Mixtures    | $500(x + y) + 1,000z.$                          |

Where:

x = Fraction of total heat input derived from natural gas;

y = Fraction of total heat input derived from oil; and

z = Fraction of total heat input derived from coal.

(ii) As an alternative to meeting the requirements of paragraph (e)(2)(i) of this section, the owner or operator of an affected facility may elect to use the NO<sub>x</sub> span values determined according to section 2.1.2 in appendix A to part 75 of this chapter.

(3) All span values computed under paragraph (e)(2)(i) of this section for combusting mixtures of regulated fuels are rounded to the nearest 500 ppm. Span values computed under paragraph (e)(2)(ii) of this section shall be rounded off according to section 2.1.2 in appendix A to part 75 of this chapter.

(f) When NO<sub>x</sub> emission data are not obtained because of CEMS breakdowns, repairs, calibration checks and zero and span adjustments, emission data will be obtained by using standby monitoring systems, Method 7 of appendix A of this part, Method 7A of appendix A of this part, or other approved reference methods to provide emission data for a minimum of 75 percent of the operating hours in each steam generating unit operating day, in at least 22 out of 30 successive steam generating unit operating days.

(g) The owner or operator of an affected facility that has a heat input capacity of 73 MW (250 MMBtu/hr) or less, and that has an annual capacity factor for residual oil having a nitrogen content of 0.30 weight percent or less, natural gas, distillate oil, gasified coal, or any mixture of these fuels, greater than 10 percent (0.10) shall:

(1) Comply with the provisions of paragraphs (b), (c), (d), (e)(2), (e)(3), and (f) of this section; or

(2) Monitor steam generating unit operating conditions and predict NO<sub>x</sub> emission rates as specified in a plan submitted pursuant to §60.49b(c).

(h) The owner or operator of a duct burner, as described in §60.41b, that is subject to the NO<sub>x</sub> standards in §60.44b(a)(4), §60.44b(e), or §60.44b(l) is not required to install or operate a continuous emissions monitoring system to measure NO<sub>x</sub> emissions.

(i) The owner or operator of an affected facility described in §60.44b(j) or §60.44b(k) is not required to install or operate a CEMS for measuring NO<sub>x</sub> emissions.

(j) The owner or operator of an affected facility that meets the conditions in either paragraph (j)(1), (2), (3), (4), (5), (6), or (7) of this section is not required to install or operate a CEMS if:

(1) The affected facility uses a PM CEMS to monitor PM emissions; or

(2) The affected facility burns only liquid (excluding residual oil) or gaseous fuels with potential SO<sub>2</sub> emissions rates of 26 ng/J (0.060 lb/MMBtu) or less and does not use a post-combustion technology to reduce SO<sub>2</sub> or PM emissions. The owner or operator must maintain fuel records of the sulfur content of the fuels burned, as described under §60.49b(r); or

(3) The affected facility burns coke oven gas alone or in combination with fuels meeting the criteria in paragraph (j)(2) of this section and does not use a post-combustion technology to reduce SO<sub>2</sub> or PM emissions; or

(4) The affected facility does not use post-combustion technology (except a wet scrubber) for reducing PM, SO<sub>2</sub>, or carbon monoxide (CO) emissions, burns only gaseous fuels or fuel oils that contain less than or equal to 0.30 weight percent sulfur, and is operated such that emissions of CO to the atmosphere from the affected facility are maintained at levels less than or equal to 0.15 lb/MMBtu on a steam generating unit operating day average basis. Owners and operators of affected facilities electing to comply with this paragraph must demonstrate compliance according to the procedures specified in paragraphs (j)(4)(i) through (iv) of this section; or

(i) You must monitor CO emissions using a CEMS according to the procedures specified in paragraphs (j)(4)(i)(A) through (D) of this section.

(A) The CO CEMS must be installed, certified, maintained, and operated according to the provisions in §60.58b(i)(3) of subpart Eb of this part.

(B) Each 1-hour CO emissions average is calculated using the data points generated by the CO CEMS expressed in parts per million by volume corrected to 3 percent oxygen (dry basis).

(C) At a minimum, valid 1-hour CO emissions averages must be obtained for at least 90 percent of the operating hours on a 30-day rolling average basis. The 1-hour averages are calculated using the data points required in §60.13(h)(2).

(D) Quarterly accuracy determinations and daily calibration drift tests for the CO CEMS must be performed in accordance with procedure 1 in appendix F of this part.

(ii) You must calculate the 1-hour average CO emissions levels for each steam generating unit operating day by multiplying the average hourly CO output concentration measured by the CO CEMS times the corresponding average hourly flue gas flow rate and divided by the corresponding average hourly heat input to the affected source. The 24-hour average CO emission level is determined by calculating the arithmetic average of the hourly CO emission levels computed for each steam generating unit operating day.

(iii) You must evaluate the preceding 24-hour average CO emission level each steam generating unit operating day excluding periods of affected source startup, shutdown, or malfunction. If the 24-hour average CO emission level is greater than 0.15 lb/MMBtu, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of the high emission incident and, take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to reduce the 24-hour average CO emission level to 0.15 lb/MMBtu or less.

(iv) You must record the CO measurements and calculations performed according to paragraph (j)(4) of this section and any corrective actions taken. The record of corrective action taken must include the date and time during which the 24-hour average CO emission level was greater than 0.15 lb/MMBtu, and the date, time, and description of the corrective action.

(5) The affected facility uses a bag leak detection system to monitor the performance of a fabric filter (baghouse) according to the most current requirements in section §60.48Da of this part; or

(6) The affected facility uses an ESP as the primary PM control device and uses an ESP predictive model to monitor the performance of the ESP developed in accordance and operated according to the most current requirements in section §60.48Da of this part; or

(7) The affected facility burns only gaseous fuels or fuel oils that contain less than or equal to 0.30 weight percent sulfur and operates according to a written site-specific monitoring plan approved by the permitting authority. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard.

(k) Owners or operators complying with the PM emission limit by using a PM CEMS must calibrate, maintain, operate, and record the output of the system for PM emissions discharged to the atmosphere as specified in §60.46b(j). The CEMS specified in paragraph §60.46b(j) shall be operated and data recorded during all periods of operation of the affected facility except for CEMS breakdowns and repairs. Data is recorded during calibration checks, and zero and span adjustments.

(l) An owner or operator of an affected facility that is subject to an opacity standard under §60.43b(f) is not required to operate a COMS provided that the unit burns only gaseous fuels and/or liquid fuels (excluding residue oil) with a potential SO<sub>2</sub> emissions rate no greater than 26 ng/J (0.060 lb/MMBtu), and the unit operates according to a written site-specific monitoring plan approved by the permitting authority is not required to operate a COMS. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard. For testing performed as part of this site-specific monitoring plan, the permitting authority may require as an alternative to the notification and reporting requirements specified in §§60.8 and 60.11 that the owner or operator submit any deviations with the excess emissions report required under §60.49b(h).

[72 FR 32742, June 13, 2007, as amended at 74 FR 5087, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9460, Feb. 16, 2012]

 [Back to Top](#)

#### **§60.49b Reporting and recordkeeping requirements.**

(a) The owner or operator of each affected facility shall submit notification of the date of initial startup, as provided by §60.7. This notification shall include:

(1) The design heat input capacity of the affected facility and identification of the fuels to be combusted in the affected facility;

(2) If applicable, a copy of any federally enforceable requirement that limits the annual capacity factor for any fuel or mixture of fuels under §60.42b(d)(1), §60.43b(a)(2), (a)(3)(iii), (c)(2)(ii), (d)(2)(iii), §60.44b(c), (d), (e), (i), (j), (k), §60.45b(d), (g), §60.46b(h), or §60.48b(i);

(3) The annual capacity factor at which the owner or operator anticipates operating the facility based on all fuels fired and based on each individual fuel fired; and

(4) Notification that an emerging technology will be used for controlling emissions of SO<sub>2</sub>. The Administrator will examine the description of the emerging technology and will determine whether the technology qualifies as an emerging technology. In making this determination, the Administrator may require the owner or operator of the affected facility to submit additional information concerning the control device. The affected facility is subject to the provisions of §60.42b(a) unless and until this determination is made by the Administrator.

(b) The owner or operator of each affected facility subject to the SO<sub>2</sub>, PM, and/or NO<sub>x</sub> emission limits under §§60.42b, 60.43b, and 60.44b shall submit to the Administrator the performance test data from the initial performance test and the performance evaluation of the CEMS using the applicable performance specifications in appendix B of this part. The owner or operator of each affected facility described in §60.44b(j) or §60.44b(k) shall submit to the Administrator the maximum heat input capacity data from the demonstration of the maximum heat input capacity of the affected facility.

(c) The owner or operator of each affected facility subject to the NO<sub>x</sub> standard in §60.44b who seeks to demonstrate compliance with those standards through the monitoring of steam generating unit operating conditions in the provisions of §60.48b(g)(2) shall submit to the Administrator for approval a plan that identifies the operating conditions to be monitored in §60.48b(g)(2) and the records to be maintained in §60.49b(g). This plan shall be submitted to the Administrator for approval within 360 days of the initial startup of the affected facility. An affected facility burning coke oven gas alone or in combination with other gaseous fuels or distillate oil shall submit this plan to the Administrator for approval within 360 days of the initial startup of the affected facility or by November 30, 2009, whichever date comes later. If the plan is approved, the owner or operator shall maintain records of predicted nitrogen oxide emission rates and the monitored operating conditions, including steam generating unit load, identified in the plan. The plan shall:

(1) Identify the specific operating conditions to be monitored and the relationship between these operating conditions and NO<sub>x</sub> emission rates (*i.e.*, ng/J or lbs/MMBtu heat input). Steam generating unit operating conditions include, but are not limited to, the degree of staged combustion (*i.e.*, the ratio of primary air to secondary and/or tertiary air) and the level of excess air (*i.e.*, flue gas O<sub>2</sub> level);

(2) Include the data and information that the owner or operator used to identify the relationship between NO<sub>x</sub> emission rates and these operating conditions; and

(3) Identify how these operating conditions, including steam generating unit load, will be monitored under §60.48b(g) on an hourly basis by the owner or operator during the period of

operation of the affected facility; the quality assurance procedures or practices that will be employed to ensure that the data generated by monitoring these operating conditions will be representative and accurate; and the type and format of the records of these operating conditions, including steam generating unit load, that will be maintained by the owner or operator under §60.49b(g).

(d) Except as provided in paragraph (d)(2) of this section, the owner or operator of an affected facility shall record and maintain records as specified in paragraph (d)(1) of this section.

(1) The owner or operator of an affected facility shall record and maintain records of the amounts of each fuel combusted during each day and calculate the annual capacity factor individually for coal, distillate oil, residual oil, natural gas, wood, and municipal-type solid waste for the reporting period. The annual capacity factor is determined on a 12-month rolling average basis with a new annual capacity factor calculated at the end of each calendar month.

(2) As an alternative to meeting the requirements of paragraph (d)(1) of this section, the owner or operator of an affected facility that is subject to a federally enforceable permit restricting fuel use to a single fuel such that the facility is not required to continuously monitor any emissions (excluding opacity) or parameters indicative of emissions may elect to record and maintain records of the amount of each fuel combusted during each calendar month.

(e) For an affected facility that combusts residual oil and meets the criteria under §60.46b(e)(4), §60.44b(j), or (k), the owner or operator shall maintain records of the nitrogen content of the residual oil combusted in the affected facility and calculate the average fuel nitrogen content for the reporting period. The nitrogen content shall be determined using ASTM Method D4629 (incorporated by reference, see §60.17), or fuel suppliers. If residual oil blends are being combusted, fuel nitrogen specifications may be prorated based on the ratio of residual oils of different nitrogen content in the fuel blend.

(f) For an affected facility subject to the opacity standard in §60.43b, the owner or operator shall maintain records of opacity. In addition, an owner or operator that elects to monitor emissions according to the requirements in §60.48b(a) shall maintain records according to the requirements specified in paragraphs (f)(1) through (3) of this section, as applicable to the visible emissions monitoring method used.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (f)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

(iii) Copies of all visible emission observer opacity field data sheets;

(2) For each performance test conducted using Method 22 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (f)(2)(i) through (iv) of this section.

(i) Dates and time intervals of all visible emissions observation periods;



(ii) Name and affiliation for each visible emission observer participating in the performance test;

(iii) Copies of all visible emission observer opacity field data sheets; and

(iv) Documentation of any adjustments made and the time the adjustments were completed to the affected facility operation by the owner or operator to demonstrate compliance with the applicable monitoring requirements.

(3) For each digital opacity compliance system, the owner or operator shall maintain records and submit reports according to the requirements specified in the site-specific monitoring plan approved by the Administrator.

(g) Except as provided under paragraph (p) of this section, the owner or operator of an affected facility subject to the NO<sub>x</sub> standards under §60.44b shall maintain records of the following information for each steam generating unit operating day:

(1) Calendar date;

(2) The average hourly NO<sub>x</sub> emission rates (expressed as NO<sub>2</sub>) (ng/J or lb/MMBtu heat input) measured or predicted;

(3) The 30-day average NO<sub>x</sub> emission rates (ng/J or lb/MMBtu heat input) calculated at the end of each steam generating unit operating day from the measured or predicted hourly nitrogen oxide emission rates for the preceding 30 steam generating unit operating days;

(4) Identification of the steam generating unit operating days when the calculated 30-day average NO<sub>x</sub> emission rates are in excess of the NO<sub>x</sub> emissions standards under §60.44b, with the reasons for such excess emissions as well as a description of corrective actions taken;

(5) Identification of the steam generating unit operating days for which pollutant data have not been obtained, including reasons for not obtaining sufficient data and a description of corrective actions taken;

(6) Identification of the times when emission data have been excluded from the calculation of average emission rates and the reasons for excluding data;

(7) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted;

(8) Identification of the times when the pollutant concentration exceeded full span of the CEMS;

(9) Description of any modifications to the CEMS that could affect the ability of the CEMS to comply with Performance Specification 2 or 3; and

(10) Results of daily CEMS drift tests and quarterly accuracy assessments as required under appendix F, Procedure 1 of this part.

(h) The owner or operator of any affected facility in any category listed in paragraphs (h)(1) or (2) of this section is required to submit excess emission reports for any excess emissions that occurred during the reporting period.

(1) Any affected facility subject to the opacity standards in §60.43b(f) or to the operating parameter monitoring requirements in §60.13(i)(1).

(2) Any affected facility that is subject to the NO<sub>x</sub> standard of §60.44b, and that:

(i) Combusts natural gas, distillate oil, gasified coal, or residual oil with a nitrogen content of 0.3 weight percent or less; or

(ii) Has a heat input capacity of 73 MW (250 MMBtu/hr) or less and is required to monitor NO<sub>x</sub> emissions on a continuous basis under §60.48b(g)(1) or steam generating unit operating conditions under §60.48b(g)(2).

(3) For the purpose of §60.43b, excess emissions are defined as all 6-minute periods during which the average opacity exceeds the opacity standards under §60.43b(f).

(4) For purposes of §60.48b(g)(1), excess emissions are defined as any calculated 30-day rolling average NO<sub>x</sub> emission rate, as determined under §60.46b(e), that exceeds the applicable emission limits in §60.44b.

(i) The owner or operator of any affected facility subject to the continuous monitoring requirements for NO<sub>x</sub> under §60.48(b) shall submit reports containing the information recorded under paragraph (g) of this section.

(j) The owner or operator of any affected facility subject to the SO<sub>2</sub> standards under §60.42b shall submit reports.

(k) For each affected facility subject to the compliance and performance testing requirements of §60.45b and the reporting requirement in paragraph (j) of this section, the following information shall be reported to the Administrator:

(1) Calendar dates covered in the reporting period;

(2) Each 30-day average SO<sub>2</sub> emission rate (ng/J or lb/MMBtu heat input) measured during the reporting period, ending with the last 30-day period; reasons for noncompliance with the emission standards; and a description of corrective actions taken; For an exceedance due to maintenance of the SO<sub>2</sub> control system covered in paragraph 60.45b(a), the report shall identify the days on which the maintenance was performed and a description of the maintenance;

(3) Each 30-day average percent reduction in SO<sub>2</sub> emissions calculated during the reporting period, ending with the last 30-day period; reasons for noncompliance with the emission standards; and a description of corrective actions taken;

(4) Identification of the steam generating unit operating days that coal or oil was combusted and for which SO<sub>2</sub> or diluent (O<sub>2</sub> or CO<sub>2</sub>) data have not been obtained by an approved method for at least 75 percent of the operating hours in the steam generating unit operating day; justification for not obtaining sufficient data; and description of corrective action taken;

(5) Identification of the times when emissions data have been excluded from the calculation of average emission rates; justification for excluding data; and description of corrective action taken if data have been excluded for periods other than those during which coal or oil were not combusted in the steam generating unit;

(6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted;

(7) Identification of times when hourly averages have been obtained based on manual sampling methods;

(8) Identification of the times when the pollutant concentration exceeded full span of the CEMS;

(9) Description of any modifications to the CEMS that could affect the ability of the CEMS to comply with Performance Specification 2 or 3;

(10) Results of daily CEMS drift tests and quarterly accuracy assessments as required under appendix F, Procedure 1 of this part; and

(11) The annual capacity factor of each fired as provided under paragraph (d) of this section.

(l) For each affected facility subject to the compliance and performance testing requirements of §60.45b(d) and the reporting requirements of paragraph (j) of this section, the following information shall be reported to the Administrator:

(1) Calendar dates when the facility was in operation during the reporting period;

(2) The 24-hour average SO<sub>2</sub> emission rate measured for each steam generating unit operating day during the reporting period that coal or oil was combusted, ending in the last 24-hour period in the quarter; reasons for noncompliance with the emission standards; and a description of corrective actions taken;

(3) Identification of the steam generating unit operating days that coal or oil was combusted for which SO<sub>2</sub> or diluent (O<sub>2</sub> or CO<sub>2</sub>) data have not been obtained by an approved method for at least 75 percent of the operating hours; justification for not obtaining sufficient data; and description of corrective action taken;

(4) Identification of the times when emissions data have been excluded from the calculation of average emission rates; justification for excluding data; and description of corrective action taken if data have been excluded for periods other than those during which coal or oil were not combusted in the steam generating unit;

(5) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted;

(6) Identification of times when hourly averages have been obtained based on manual sampling methods;

(7) Identification of the times when the pollutant concentration exceeded full span of the CEMS;

(8) Description of any modifications to the CEMS that could affect the ability of the CEMS to comply with Performance Specification 2 or 3; and

(9) Results of daily CEMS drift tests and quarterly accuracy assessments as required under Procedure 1 of appendix F 1 of this part. If the owner or operator elects to implement the alternative data assessment procedures described in §§60.47b(e)(4)(i) through (e)(4)(iii), each data

assessment report shall include a summary of the results of all of the RATAs, linearity checks, CGAs, and calibration error or drift assessments required by §§60.47b(e)(4)(i) through (e)(4)(iii).

(m) For each affected facility subject to the SO<sub>2</sub> standards in §60.42(b) for which the minimum amount of data required in §60.47b(c) were not obtained during the reporting period, the following information is reported to the Administrator in addition to that required under paragraph (k) of this section:

(1) The number of hourly averages available for outlet emission rates and inlet emission rates;

(2) The standard deviation of hourly averages for outlet emission rates and inlet emission rates, as determined in Method 19 of appendix A of this part, section 7;

(3) The lower confidence limit for the mean outlet emission rate and the upper confidence limit for the mean inlet emission rate, as calculated in Method 19 of appendix A of this part, section 7; and

(4) The ratio of the lower confidence limit for the mean outlet emission rate and the allowable emission rate, as determined in Method 19 of appendix A of this part, section 7.

(n) If a percent removal efficiency by fuel pretreatment (*i.e.*, %R<sub>t</sub>) is used to determine the overall percent reduction (*i.e.*, %R<sub>o</sub>) under §60.45b, the owner or operator of the affected facility shall submit a signed statement with the report.

(1) Indicating what removal efficiency by fuel pretreatment (*i.e.*, %R<sub>t</sub>) was credited during the reporting period;

(2) Listing the quantity, heat content, and date each pre-treated fuel shipment was received during the reporting period, the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the reporting period;

(3) Documenting the transport of the fuel from the fuel pretreatment facility to the steam generating unit; and

(4) Including a signed statement from the owner or operator of the fuel pretreatment facility certifying that the percent removal efficiency achieved by fuel pretreatment was determined in accordance with the provisions of Method 19 of appendix A of this part and listing the heat content and sulfur content of each fuel before and after fuel pretreatment.

(o) All records required under this section shall be maintained by the owner or operator of the affected facility for a period of 2 years following the date of such record.

(p) The owner or operator of an affected facility described in §60.44b(j) or (k) shall maintain records of the following information for each steam generating unit operating day:

(1) Calendar date;

(2) The number of hours of operation; and

(3) A record of the hourly steam load.

(q) The owner or operator of an affected facility described in §60.44b(j) or §60.44b(k) shall submit to the Administrator a report containing:

(1) The annual capacity factor over the previous 12 months;

(2) The average fuel nitrogen content during the reporting period, if residual oil was fired; and

(3) If the affected facility meets the criteria described in §60.44b(j), the results of any NO<sub>x</sub> emission tests required during the reporting period, the hours of operation during the reporting period, and the hours of operation since the last NO<sub>x</sub> emission test.

(r) The owner or operator of an affected facility who elects to use the fuel based compliance alternatives in §60.42b or §60.43b shall either:

(1) The owner or operator of an affected facility who elects to demonstrate that the affected facility combusts only very low sulfur oil, natural gas, wood, a mixture of these fuels, or any of these fuels (or a mixture of these fuels) in combination with other fuels that are known to contain an insignificant amount of sulfur in §60.42b(j) or §60.42b(k) shall obtain and maintain at the affected facility fuel receipts (such as a current, valid purchase contract, tariff sheet, or transportation contract) from the fuel supplier that certify that the oil meets the definition of distillate oil and gaseous fuel meets the definition of natural gas as defined in §60.41b and the applicable sulfur limit. For the purposes of this section, the distillate oil need not meet the fuel nitrogen content specification in the definition of distillate oil. Reports shall be submitted to the Administrator certifying that only very low sulfur oil meeting this definition, natural gas, wood, and/or other fuels that are known to contain insignificant amounts of sulfur were combusted in the affected facility during the reporting period; or

(2) The owner or operator of an affected facility who elects to demonstrate compliance based on fuel analysis in §60.42b or §60.43b shall develop and submit a site-specific fuel analysis plan to the Administrator for review and approval no later than 60 days before the date you intend to demonstrate compliance. Each fuel analysis plan shall include a minimum initial requirement of weekly testing and each analysis report shall contain, at a minimum, the following information:

(i) The potential sulfur emissions rate of the representative fuel mixture in ng/J heat input;

(ii) The method used to determine the potential sulfur emissions rate of each constituent of the mixture. For distillate oil and natural gas a fuel receipt or tariff sheet is acceptable;

(iii) The ratio of different fuels in the mixture; and

(iv) The owner or operator can petition the Administrator to approve monthly or quarterly sampling in place of weekly sampling.

(s) Facility specific NO<sub>x</sub> standard for Cytex Industries Fortier Plant's C.AOG incinerator located in Westwego, Louisiana:

(1) *Definitions.*

*Oxidation zone* is defined as the portion of the C.AOG incinerator that extends from the inlet of the oxidizing zone combustion air to the outlet gas stack.

*Reducing zone* is defined as the portion of the C.AOG incinerator that extends from the burner section to the inlet of the oxidizing zone combustion air.

*Total inlet air* is defined as the total amount of air introduced into the C.AOG incinerator for combustion of natural gas and chemical by-product waste and is equal to the sum of the air flow into the reducing zone and the air flow into the oxidation zone.

(2) *Standard for nitrogen oxides.* (i) When fossil fuel alone is combusted, the NO<sub>x</sub> emission limit for fossil fuel in §60.44b(a) applies.

(ii) When natural gas and chemical by-product waste are simultaneously combusted, the NO<sub>x</sub> emission limit is 289 ng/J (0.67 lb/MMBtu) and a maximum of 81 percent of the total inlet air provided for combustion shall be provided to the reducing zone of the C.AOG incinerator.

(3) *Emission monitoring.* (i) The percent of total inlet air provided to the reducing zone shall be determined at least every 15 minutes by measuring the air flow of all the air entering the reducing zone and the air flow of all the air entering the oxidation zone, and compliance with the percentage of total inlet air that is provided to the reducing zone shall be determined on a 3-hour average basis.

(ii) The NO<sub>x</sub> emission limit shall be determined by the compliance and performance test methods and procedures for NO<sub>x</sub> in §60.46b(i).

(iii) The monitoring of the NO<sub>x</sub> emission limit shall be performed in accordance with §60.48b.

(4) *Reporting and recordkeeping requirements.* (i) The owner or operator of the C.AOG incinerator shall submit a report on any excursions from the limits required by paragraph (a)(2) of this section to the Administrator with the quarterly report required by paragraph (i) of this section.

(ii) The owner or operator of the C.AOG incinerator shall keep records of the monitoring required by paragraph (a)(3) of this section for a period of 2 years following the date of such record.

(iii) The owner or operator of the C.AOG incinerator shall perform all the applicable reporting and recordkeeping requirements of this section.

(t) Facility-specific NO<sub>x</sub> standard for Rohm and Haas Kentucky Incorporated's Boiler No. 100 located in Louisville, Kentucky:

(1) *Definitions.*

*Air ratio control damper* is defined as the part of the low NO<sub>x</sub> burner that is adjusted to control the split of total combustion air delivered to the reducing and oxidation portions of the combustion flame.

*Flue gas recirculation line* is defined as the part of Boiler No. 100 that recirculates a portion of the boiler flue gas back into the combustion air.

(2) *Standard for nitrogen oxides.* (i) When fossil fuel alone is combusted, the NO<sub>x</sub> emission limit for fossil fuel in §60.44b(a) applies.

(ii) When fossil fuel and chemical by-product waste are simultaneously combusted, the NO<sub>x</sub> emission limit is 473 ng/J (1.1 lb/MMBtu), and the air ratio control damper tee handle shall be at

a minimum of 5 inches (12.7 centimeters) out of the boiler, and the flue gas recirculation line shall be operated at a minimum of 10 percent open as indicated by its valve opening position indicator.

(3) *Emission monitoring for nitrogen oxides.* (i) The air ratio control damper tee handle setting and the flue gas recirculation line valve opening position indicator setting shall be recorded during each 8-hour operating shift.

(ii) The NO<sub>x</sub> emission limit shall be determined by the compliance and performance test methods and procedures for NO<sub>x</sub> in §60.46b.

(iii) The monitoring of the NO<sub>x</sub> emission limit shall be performed in accordance with §60.48b.

(4) *Reporting and recordkeeping requirements.* (i) The owner or operator of Boiler No. 100 shall submit a report on any excursions from the limits required by paragraph (b)(2) of this section to the Administrator with the quarterly report required by §60.49b(i).

(ii) The owner or operator of Boiler No. 100 shall keep records of the monitoring required by paragraph (b)(3) of this section for a period of 2 years following the date of such record.

(iii) The owner or operator of Boiler No. 100 shall perform all the applicable reporting and recordkeeping requirements of §60.49b.

(u) *Site-specific standard for Merck & Co., Inc.'s Stonewall Plant in Elkton, Virginia.* (1) This paragraph (u) applies only to the pharmaceutical manufacturing facility, commonly referred to as the Stonewall Plant, located at Route 340 South, in Elkton, Virginia ("site") and only to the natural gas-fired boilers installed as part of the powerhouse conversion required pursuant to 40 CFR 52.2454(g). The requirements of this paragraph shall apply, and the requirements of §§60.40b through 60.49b(t) shall not apply, to the natural gas-fired boilers installed pursuant to 40 CFR 52.2454(g).

(i) The site shall equip the natural gas-fired boilers with low NO<sub>x</sub> technology.

(ii) The site shall install, calibrate, maintain, and operate a continuous monitoring and recording system for measuring NO<sub>x</sub> emissions discharged to the atmosphere and opacity using a continuous emissions monitoring system or a predictive emissions monitoring system.

(iii) Within 180 days of the completion of the powerhouse conversion, as required by 40 CFR 52.2454, the site shall perform a performance test to quantify criteria pollutant emissions.

(2) [Reserved]

(v) The owner or operator of an affected facility may submit electronic quarterly reports for SO<sub>2</sub> and/or NO<sub>x</sub> and/or opacity in lieu of submitting the written reports required under paragraphs (h), (i), (j), (k) or (l) of this section. The format of each quarterly electronic report shall be coordinated with the permitting authority. The electronic report(s) shall be submitted no later than 30 days after the end of the calendar quarter and shall be accompanied by a certification statement from the owner or operator, indicating whether compliance with the applicable emission standards and minimum data requirements of this subpart was achieved during the reporting period. Before submitting reports in the electronic format, the owner or operator shall coordinate with the permitting authority to obtain their agreement to submit reports in this alternative format.

(w) The reporting period for the reports required under this subpart is each 6 month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period.

(x) Facility-specific NO<sub>x</sub> standard for Weyerhaeuser Company's No. 2 Power Boiler located in New Bern, North Carolina:

(1) *Standard for nitrogen oxides.* (i) When fossil fuel alone is combusted, the NO<sub>x</sub> emission limit for fossil fuel in §60.44b(a) applies.

(ii) When fossil fuel and chemical by-product waste are simultaneously combusted, the NO<sub>x</sub> emission limit is 215 ng/J (0.5 lb/MMBtu).

(2) *Emission monitoring for nitrogen oxides.* (i) The NO<sub>x</sub> emissions shall be determined by the compliance and performance test methods and procedures for NO<sub>x</sub> in §60.46b.

(ii) The monitoring of the NO<sub>x</sub> emissions shall be performed in accordance with §60.48b.

(3) *Reporting and recordkeeping requirements.* (i) The owner or operator of the No. 2 Power Boiler shall submit a report on any excursions from the limits required by paragraph (x)(2) of this section to the Administrator with the quarterly report required by §60.49b(i).

(ii) The owner or operator of the No. 2 Power Boiler shall keep records of the monitoring required by paragraph (x)(3) of this section for a period of 2 years following the date of such record.

(iii) The owner or operator of the No. 2 Power Boiler shall perform all the applicable reporting and recordkeeping requirements of §60.49b.

(y) Facility-specific NO<sub>x</sub> standard for INEOS USA's AOGI located in Lima, Ohio:

(1) *Standard for NO<sub>x</sub>.* (i) When fossil fuel alone is combusted, the NO<sub>x</sub> emission limit for fossil fuel in §60.44b(a) applies.

(ii) When fossil fuel and chemical byproduct/waste are simultaneously combusted, the NO<sub>x</sub> emission limit is 645 ng/J (1.5 lb/MMBtu).

(2) *Emission monitoring for NO<sub>x</sub>.* (i) The NO<sub>x</sub> emissions shall be determined by the compliance and performance test methods and procedures for NO<sub>x</sub> in §60.46b.

(ii) The monitoring of the NO<sub>x</sub> emissions shall be performed in accordance with §60.48b.

(3) *Reporting and recordkeeping requirements.* (i) The owner or operator of the AOGI shall submit a report on any excursions from the limits required by paragraph (y)(2) of this section to the Administrator with the quarterly report required by paragraph (i) of this section.

(ii) The owner or operator of the AOGI shall keep records of the monitoring required by paragraph (y)(3) of this section for a period of 2 years following the date of such record.

(iii) The owner or operator of the AOGI shall perform all the applicable reporting and recordkeeping requirements of this section.



[72 FR 32742, June 13, 2007, as amended at 74 FR 5089, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

 [Back to Top](#)

[Need assistance?](#)

Appendix C—40 CFR Part 60, Subpart Y

# Electronic Code of Federal Regulations

e-CFR data is current as of January 31, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 60](#) → Subpart Y

---

[Browse Previous](#) | [Browse Next](#)

Title 40: Protection of Environment

[PART 60—STANDARDS OF PERFORMANCE FOR NEW STATIONARY SOURCES](#)

---

## Subpart Y—Standards of Performance for Coal Preparation and Processing Plants

---

### Contents

[§60.250 Applicability and designation of affected facility.](#)

[§60.251 Definitions.](#)

[§60.252 Standards for thermal dryers.](#)

[§60.253 Standards for pneumatic coal-cleaning equipment.](#)

[§60.254 Standards for coal processing and conveying equipment, coal storage systems, transfer and loading systems, and open storage piles.](#)

[§60.255 Performance tests and other compliance requirements.](#)

[§60.256 Continuous monitoring requirements.](#)

[§60.257 Test methods and procedures.](#)

[§60.258 Reporting and recordkeeping.](#)

---

SOURCE: 74 FR 51977, Oct. 8, 2009, unless otherwise noted.

[↑ Back to Top](#)

### **§60.250 Applicability and designation of affected facility.**

(a) The provisions of this subpart apply to affected facilities in coal preparation and processing plants that process more than 181 megagrams (Mg) (200 tons) of coal per day.

(b) The provisions in §§60.251, 60.252(a), 60.253(a), 60.254(a), 60.255(a), and 60.256(a) of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after October 27, 1974, and on or before April 28, 2008: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems.

(c) The provisions in §§60.251, 60.252(b)(1) and (c), 60.253(b), 60.254(b), 60.255(b) through (h), 60.256(b) and (c), 60.257, and 60.258 of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after April 28, 2008, and on or before May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables),

coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems.

(d) The provisions in §§60.251, 60.252(b)(1) through (3), and (c), 60.253(b), 60.254(b) and (c), 60.255(b) through (h), 60.256(b) and (c), 60.257, and 60.258 of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), coal storage systems, transfer and loading systems, and open storage piles.

 [Back to Top](#)

### **§60.251 Definitions.**

As used in this subpart, all terms not defined herein have the meaning given them in the Clean Air Act (Act) and in subpart A of this part.

(a) *Anthracite* means coal that is classified as anthracite according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

(b) *Bag leak detection system* means a system that is capable of continuously monitoring relative particulate matter (dust loadings) in the exhaust of a fabric filter to detect bag leaks and other upset conditions. A bag leak detection system includes, but is not limited to, an instrument that operates on triboelectric, light scattering, light transmittance, or other effect to continuously monitor relative particulate matter loadings.

(c) *Bituminous coal* means solid fossil fuel classified as bituminous coal by ASTM D388 (incorporated by reference—see §60.17).

(d) *Coal* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, all solid fossil fuels classified as anthracite, bituminous, subbituminous, or lignite by ASTM D388 (incorporated by reference—see §60.17).

(2) For units constructed, reconstructed, or modified after May 27, 2009, all solid fossil fuels classified as anthracite, bituminous, subbituminous, or lignite by ASTM D388 (incorporated by reference—see §60.17), and coal refuse.

(e) *Coal preparation and processing plant* means any facility (excluding underground mining operations) which prepares coal by one or more of the following processes: breaking, crushing, screening, wet or dry cleaning, and thermal drying.

(f) *Coal processing and conveying equipment* means any machinery used to reduce the size of coal or to separate coal from refuse, and the equipment used to convey coal to or remove coal and refuse from the machinery. This includes, but is not limited to, breakers, crushers, screens, and conveyor belts. Equipment located at the mine face is not considered to be part of the coal preparation and processing plant.

(g) *Coal refuse* means waste products of coal mining, physical coal cleaning, and coal preparation operations (e.g., culm, gob, etc.) containing coal, matrix material, clay, and other organic and inorganic material.

(h) *Coal storage system* means any facility used to store coal except for open storage piles.

(i) *Design controlled potential PM emissions rate* means the theoretical particulate matter (PM) emissions (Mg) that would result from the operation of a control device at its design emissions rate (grams per dry standard cubic meter (g/dscm)), multiplied by the maximum design flow rate (dry standard cubic meter per minute (dscm/min)), multiplied by 60 (minutes per hour (min/hr)), multiplied by 8,760 (hours per year (hr/yr)), divided by 1,000,000 (megagrams per gram (Mg/g)).

(j) *Indirect thermal dryer* means a thermal dryer that reduces the moisture content of coal through indirect heating of the coal through contact with a heat transfer medium. If the source of heat (the source of combustion or furnace) is subject to another subpart of this part, then the furnace and the associated emissions are not part of the affected facility. However, if the source of heat is not subject to another subpart of this part, then the furnace and the associated emissions are part of the affected facility.

(k) *Lignite* means coal that is classified as lignite A or B according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

(l) *Mechanical vent* means any vent that uses a powered mechanical drive (machine) to induce air flow.

(m) *Open storage pile* means any facility, including storage area, that is not enclosed that is used to store coal, including the equipment used in the loading, unloading, and conveying operations of the facility.

(n) *Operating day* means a 24-hour period between 12 midnight and the following midnight during which coal is prepared or processed at any time by the affected facility. It is not necessary that coal be prepared or processed the entire 24-hour period.

(o) *Pneumatic coal-cleaning equipment* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, any facility which classifies bituminous coal by size or separates bituminous coal from refuse by application of air stream(s).

(2) For units constructed, reconstructed, or modified after May 27, 2009, any facility which classifies coal by size or separates coal from refuse by application of air stream(s).

(p) *Potential combustion concentration* means the theoretical emissions (nanograms per joule (ng/J) or pounds per million British thermal units (lb/MMBtu) heat input) that would result from combustion of a fuel in an uncleaned state without emission control systems, as determined using Method 19 of appendix A-7 of this part.

(q) *Subbituminous coal* means coal that is classified as subbituminous A, B, or C according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

(r) *Thermal dryer* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, any facility in which the moisture content of bituminous coal is reduced by contact with a heated gas stream which is exhausted to the atmosphere.

(2) For units constructed, reconstructed, or modified after May 27, 2009, any facility in which the moisture content of coal is reduced by either contact with a heated gas stream which is exhausted to the atmosphere or through indirect heating of the coal through contact with a heated heat transfer medium.

(s) *Transfer and loading system* means any facility used to transfer and load coal for shipment.

[↑ Back to Top](#)

### **§60.252 Standards for thermal dryers.**

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified on or before April 28, 2008, subject to the provisions of this subpart must meet the requirements in paragraphs (a)(1) and (a)(2) of this section.

(1) The owner or operator shall not cause to be discharged into the atmosphere from the thermal dryer any gases which contain PM in excess of 0.070 g/dscm (0.031 grains per dry standard cubic feet (gr/dscf)); and

(2) The owner or operator shall not cause to be discharged into the atmosphere from the thermal dryer any gases which exhibit 20 percent opacity or greater.

(b) Except as provided in paragraph (c) of this section, on and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified after April 28, 2008, subject to the provisions of this subpart must meet the applicable standards for PM and opacity, as specified in paragraph (b)(1) of this section. In addition, and except as provided in paragraph (c) of this section, on and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified after May 29, 2009, subject to the provisions of this subpart must also meet the applicable standards for sulfur dioxide (SO<sub>2</sub>), and combined nitrogen oxides (NO<sub>x</sub>) and carbon monoxide (CO) as specified in paragraphs (b)(2) and (b)(3) of this section.

(1) The owner or operator must meet the requirements for PM emissions in paragraphs (b)(1)(i) through (iii) of this section, as applicable to the affected facility.

(i) For each thermal dryer constructed or reconstructed after April 28, 2008, the owner or operator must meet the requirements of (b)(1)(i)(A) and (b)(1)(i)(B).

(A) The owner or operator must not cause to be discharged into the atmosphere from the thermal dryer any gases that contain PM in excess of 0.023 g/dscm (0.010 grains per dry standard cubic feet (gr/dscf)); and

(B) The owner or operator must not cause to be discharged into the atmosphere from the thermal dryer any gases that exhibit 10 percent opacity or greater.

(ii) For each thermal dryer modified after April 28, 2008, the owner or operator must meet the requirements of paragraphs (b)(1)(ii)(A) and (b)(1)(ii)(B) of this section.

(A) The owner or operator must not cause to be discharged to the atmosphere from the affected facility any gases which contain PM in excess of 0.070 g/dscm (0.031 gr/dscf); and

(B) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which exhibit 20 percent opacity or greater.

(2) Except as provided in paragraph (b)(2)(iii) of this section, for each thermal dryer constructed, reconstructed, or modified after May 27, 2009, the owner or operator must meet the requirements for SO<sub>2</sub> emissions in either paragraph (b)(2)(i) or (b)(2)(ii) of this section.

(i) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases that contain SO<sub>2</sub> in excess of 85 ng/J (0.20 lb/MMBtu) heat input; or

(ii) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases that either contain SO<sub>2</sub> in excess of 520 ng/J (1.20 lb/MMBtu) heat input or contain SO<sub>2</sub> in excess of 10 percent of the potential combustion concentration (*i.e.*, the facility must achieve at least a 90 percent reduction of the potential combustion concentration and may not exceed a maximum emissions rate of 1.2 lb/MMBtu (520 ng/J)).

(iii) Thermal dryers that receive all of their thermal input from a source other than coal or residual oil, that receive all of their thermal input from a source subject to an SO<sub>2</sub> limit under another subpart of this part, or that use waste heat or residual from the combustion of coal or residual oil as their only thermal input are not subject to the SO<sub>2</sub> limits of this section.

(3) Except as provided in paragraph (b)(3)(iii) of this section, the owner or operator must meet the requirements for combined NO<sub>x</sub> and CO emissions in paragraph (b)(3)(i) or (b)(3)(ii) of this section, as applicable to the affected facility.

(i) For each thermal dryer constructed after May 27, 2009, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which contain a combined concentration of NO<sub>x</sub> and CO in excess of 280 ng/J (0.65 lb/MMBtu) heat input.

(ii) For each thermal dryer reconstructed or modified after May 27, 2009, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which contain combined concentration of NO<sub>x</sub> and CO in excess of 430 ng/J (1.0 lb/MMBtu) heat input.

(iii) Thermal dryers that receive all of their thermal input from a source other than coal or residual oil, that receive all of their thermal input from a source subject to a NO<sub>x</sub> limit and/or CO limit under another subpart of this part, or that use waste heat or residual from the combustion of coal or residual oil as their only thermal input, are not subject to the combined NO<sub>x</sub> and CO limits of this section.

(c) Thermal dryers receiving all of their thermal input from an affected facility covered under another 40 CFR Part 60 subpart must meet the applicable requirements in that subpart but are not subject to the requirements in this subpart.

[↑ Back to Top](#)

### **§60.253 Standards for pneumatic coal-cleaning equipment.**

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of pneumatic coal-cleaning equipment constructed, reconstructed, or modified on or before April 28, 2008, must meet the requirements of paragraphs (a)(1) and (a)(2) of this section.

(1) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that contain PM in excess of 0.040 g/dscm (0.017 gr/dscf); and

(2) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that exhibit 10 percent opacity or greater.

(b) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of pneumatic coal-cleaning equipment constructed, reconstructed, or modified after April 28, 2008, must meet the requirements in paragraphs (b)(1) and (b)(2) of this section.

(1) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that contain PM in excess of 0.023 g/dscm (0.010 gr/dscf); and

(2) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that exhibit greater than 5 percent opacity.

[↑ Back to Top](#)

### **§60.254 Standards for coal processing and conveying equipment, coal storage systems, transfer and loading systems, and open storage piles.**

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal constructed, reconstructed, or modified on or before April 28, 2008, gases which exhibit 20 percent opacity or greater.

(b) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal constructed, reconstructed, or modified after April 28, 2008, must meet the requirements in paragraphs (b)(1) through (3) of this section, as applicable to the affected facility.

(1) Except as provided in paragraph (b)(3) of this section, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which exhibit 10 percent opacity or greater.



(2) The owner or operator must not cause to be discharged into the atmosphere from any mechanical vent on an affected facility gases which contain particulate matter in excess of 0.023 g/dscm (0.010 gr/dscf).

(3) Equipment used in the loading, unloading, and conveying operations of open storage piles are not subject to the opacity limitations of paragraph (b)(1) of this section.

(c) The owner or operator of an open storage pile, which includes the equipment used in the loading, unloading, and conveying operations of the affected facility, constructed, reconstructed, or modified after May 27, 2009, must prepare and operate in accordance with a submitted fugitive coal dust emissions control plan that is appropriate for the site conditions as specified in paragraphs (c)(1) through (6) of this section.

(1) The fugitive coal dust emissions control plan must identify and describe the control measures the owner or operator will use to minimize fugitive coal dust emissions from each open storage pile.

(2) For open coal storage piles, the fugitive coal dust emissions control plan must require that one or more of the following control measures be used to minimize to the greatest extent practicable fugitive coal dust: Locating the source inside a partial enclosure, installing and operating a water spray or fogging system, applying appropriate chemical dust suppression agents on the source (when the provisions of paragraph (c)(6) of this section are met), use of a wind barrier, compaction, or use of a vegetative cover. The owner or operator must select, for inclusion in the fugitive coal dust emissions control plan, the control measure or measures listed in this paragraph that are most appropriate for site conditions. The plan must also explain how the measure or measures selected are applicable and appropriate for site conditions. In addition, the plan must be revised as needed to reflect any changing conditions at the source.

(3) Any owner or operator of an affected facility that is required to have a fugitive coal dust emissions control plan may petition the Administrator to approve, for inclusion in the plan for the affected facility, alternative control measures other than those specified in paragraph (c)(2) of this section as specified in paragraphs (c)(3)(i) through (iv) of this section.

(i) The petition must include a description of the alternative control measures, a copy of the fugitive coal dust emissions control plan for the affected facility that includes the alternative control measures, and information sufficient for EPA to evaluate the demonstrations required by paragraph (c)(3)(ii) of this section.

(ii) The owner or operator must either demonstrate that the fugitive coal dust emissions control plan that includes the alternate control measures will provide equivalent overall environmental protection or demonstrate that it is either economically or technically infeasible for the affected facility to use the control measures specifically identified in paragraph (c)(2).

(iii) While the petition is pending, the owner or operator must comply with the fugitive coal dust emissions control plan including the alternative control measures submitted with the petition. Operation in accordance with the plan submitted with the petition shall be deemed to constitute compliance with the requirement to operate in accordance with a fugitive coal dust emissions control plan that contains one of the control measures specifically identified in paragraph (c)(2) of this section while the petition is pending.

(iv) If the petition is approved by the Administrator, the alternative control measures will be approved for inclusion in the fugitive coal dust emissions control plan for the affected facility. In lieu

of amending this subpart, a letter will be sent to the facility describing the specific control measures approved. The facility shall make any such letters and the applicable fugitive coal dust emissions control plan available to the public. If the Administrator determines it is appropriate, the conditions and requirements of the letter can be reviewed and changed at any point.

(4) The owner or operator must submit the fugitive coal dust emissions control plan to the Administrator or delegated authority as specified in paragraphs (c)(4)(i) and (c)(4)(ii) of this section.

(i) The plan must be submitted to the Administrator or delegated authority prior to startup of the new, reconstructed, or modified affected facility, or 30 days after the effective date of this rule, whichever is later.

(ii) The plan must be revised as needed to reflect any changing conditions at the source. Such revisions must be dated and submitted to the Administrator or delegated authority before a source can operate pursuant to these revisions. The Administrator or delegated authority may also object to such revisions as specified in paragraph (c)(5) of this section.

(5) The Administrator or delegated authority may object to the fugitive coal dust emissions control plan as specified in paragraphs (c)(5)(i) and (c)(5)(ii) of this section.

(i) The Administrator or delegated authority may object to any fugitive coal dust emissions control plan that it has determined does not meet the requirements of paragraphs (c)(1) and (c)(2) of this section.

(ii) If an objection is raised, the owner or operator, within 30 days from receipt of the objection, must submit a revised fugitive coal dust emissions control plan to the Administrator or delegated authority. The owner or operator must operate in accordance with the revised fugitive coal dust emissions control plan. The Administrator or delegated authority retain the right, under paragraph (c)(5) of this section, to object to the revised control plan if it determines the plan does not meet the requirements of paragraphs (c)(1) and (c)(2) of this section.

(6) Where appropriate chemical dust suppression agents are selected by the owner or operator as a control measure to minimize fugitive coal dust emissions, (1) only chemical dust suppressants with Occupational Safety and Health Administration (OSHA)-compliant material safety data sheets (MSDS) are to be allowed; (2) the MSDS must be included in the fugitive coal dust emissions control plan; and (3) the owner or operator must consider and document in the fugitive coal dust emissions control plan the site-specific impacts associated with the use of such chemical dust suppressants.

 [Back to Top](#)

#### **§60.255 Performance tests and other compliance requirements.**

(a) An owner or operator of each affected facility that commenced construction, reconstruction, or modification on or before April 28, 2008, must conduct all performance tests required by §60.8 to demonstrate compliance with the applicable emission standards using the methods identified in §60.257.

(b) An owner or operator of each affected facility that commenced construction, reconstruction, or modification after April 28, 2008, must conduct performance tests according to the requirements of §60.8 and the methods identified in §60.257 to demonstrate compliance with the applicable emissions standards in this subpart as specified in paragraphs (b)(1) and (2) of this section.

(1) For each affected facility subject to a PM, SO<sub>2</sub>, or combined NO<sub>x</sub> and CO emissions standard, an initial performance test must be performed. Thereafter, a new performance test must be conducted according to the requirements in paragraphs (b)(1)(i) through (iii) of this section, as applicable.

(i) If the results of the most recent performance test demonstrate that emissions from the affected facility are greater than 50 percent of the applicable emissions standard, a new performance test must be conducted within 12 calendar months of the date that the previous performance test was required to be completed.

(ii) If the results of the most recent performance test demonstrate that emissions from the affected facility are 50 percent or less of the applicable emissions standard, a new performance test must be conducted within 24 calendar months of the date that the previous performance test was required to be completed.

(iii) An owner or operator of an affected facility that has not operated for the 60 calendar days prior to the due date of a performance test is not required to perform the subsequent performance test until 30 calendar days after the next operating day.

(2) For each affected facility subject to an opacity standard, an initial performance test must be performed. Thereafter, a new performance test must be conducted according to the requirements in paragraphs (b)(2)(i) through (iii) of this section, as applicable, except as provided for in paragraphs (e) and (f) of this section. Performance test and other compliance requirements for coal truck dump operations are specified in paragraph (h) of this section.

(i) If any 6-minute average opacity reading in the most recent performance test exceeds half the applicable opacity limit, a new performance test must be conducted within 90 operating days of the date that the previous performance test was required to be completed.

(ii) If all 6-minute average opacity readings in the most recent performance test are equal to or less than half the applicable opacity limit, a new performance test must be conducted within 12 calendar months of the date that the previous performance test was required to be completed.

(iii) An owner or operator of an affected facility continuously monitoring scrubber parameters as specified in §60.256(b)(2) is exempt from the requirements in paragraphs (b)(2)(i) and (ii) if opacity performance tests are conducted concurrently with (or within a 60-minute period of) PM performance tests.

(c) If any affected coal processing and conveying equipment (e.g., breakers, crushers, screens, conveying systems), coal storage systems, or coal transfer and loading systems that commenced construction, reconstruction, or modification after April 28, 2008, are enclosed in a building, and emissions from the building do not exceed any of the standards in §60.254 that apply to the affected facility, then the facility shall be deemed to be in compliance with such standards.

(d) An owner or operator of an affected facility (other than a thermal dryer) that commenced construction, reconstruction, or modification after April 28, 2008, is subject to a PM emission standard and uses a control device with a design controlled potential PM emissions rate of 1.0 Mg (1.1 tons) per year or less is exempted from the requirements of paragraphs (b)(1)(i) and (ii) of this section provided that the owner or operator meets all of the conditions specified in paragraphs (d)(1) through (3) of this section. This exemption does not apply to thermal dryers.

(1) PM emissions, as determined by the most recent performance test, are less than or equal to the applicable limit,

(2) The control device manufacturer's recommended maintenance procedures are followed, and

(3) All 6-minute average opacity readings from the most recent performance test are equal to or less than half the applicable opacity limit or the monitoring requirements in paragraphs (e) or (f) of this section are followed.

(e) For an owner or operator of a group of up to five of the same type of affected facilities that commenced construction, reconstruction, or modification after April 28, 2008, that are subject to PM emissions standards and use identical control devices, the Administrator or delegated authority may allow the owner or operator to use a single PM performance test for one of the affected control devices to demonstrate that the group of affected facilities is in compliance with the applicable emissions standards provided that the owner or operator meets all of the conditions specified in paragraphs (e)(1) through (3) of this section.

(1) PM emissions from the most recent performance test for each individual affected facility are 90 percent or less of the applicable PM standard;

(2) The manufacturer's recommended maintenance procedures are followed for each control device; and

(3) A performance test is conducted on each affected facility at least once every 5 calendar years.

(f) As an alternative to meeting the requirements in paragraph (b)(2) of this section, an owner or operator of an affected facility that commenced construction, reconstruction, or modification after April 28, 2008, may elect to comply with the requirements in paragraph (f)(1) or (f)(2) of this section.

(1) Monitor visible emissions from each affected facility according to the requirements in paragraphs (f)(1)(i) through (iii) of this section.

(i) Conduct one daily 15-second observation each operating day for each affected facility (during normal operation) when the coal preparation and processing plant is in operation. Each observation must be recorded as either visible emissions observed or no visible emissions observed. Each observer determining the presence of visible emissions must meet the training requirements specified in §2.3 of Method 22 of appendix A-7 of this part. If visible emissions are observed during any 15-second observation, the owner or operator must adjust the operation of the affected facility and demonstrate within 24 hours that no visible emissions are observed from the affected facility. If visible emissions are observed, a Method 9, of appendix A-4 of this part, performance test must be conducted within 45 operating days.

(ii) Conduct monthly visual observations of all process and control equipment. If any deficiencies are observed, the necessary maintenance must be performed as expeditiously as possible.

(iii) Conduct a performance test using Method 9 of appendix A-4 of this part at least once every 5 calendar years for each affected facility.

(2) Prepare a written site-specific monitoring plan for a digital opacity compliance system for approval by the Administrator or delegated authority. The plan shall require observations of at least one digital image every 15 seconds for 10-minute periods (during normal operation) every operating day. An approvable monitoring plan must include a demonstration that the occurrences of visible emissions are not in excess of 5 percent of the observation period. For reference purposes in preparing the monitoring plan, see OAQPS "Determination of Visible Emission Opacity from Stationary Sources Using Computer-Based Photographic Analysis Systems." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality and Planning Standards; Sector Policies and Programs Division; Measurement Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Preliminary Methods. The monitoring plan approved by the Administrator or delegated authority shall be implemented by the owner or operator.

(g) As an alternative to meeting the requirements in paragraph (b)(2) of this section, an owner or operator of an affected facility that commenced construction, reconstruction, or modification after April 28, 2008, subject to a visible emissions standard under this subpart may install, operate, and maintain a continuous opacity monitoring system (COMS). Each COMS used to comply with provisions of this subpart must be installed, calibrated, maintained, and continuously operated according to the requirements in paragraphs (g)(1) and (2) of this section.

(1) The COMS must meet Performance Specification 1 in 40 CFR part 60, appendix B.

(2) The COMS must comply with the quality assurance requirements in paragraphs (g)(2)(i) through (v) of this section.

(i) The owner or operator must automatically (intrinsic to the opacity monitor) check the zero and upscale (span) calibration drifts at least once daily. For particular COMS, the acceptable range of zero and upscale calibration materials is as defined in the applicable version of Performance Specification 1 in 40 CFR part 60, appendix B.

(ii) The owner or operator must adjust the zero and span whenever the 24-hour zero drift or 24-hour span drift exceeds 4 percent opacity. The COMS must allow for the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified. The optical surfaces exposed to the effluent gases must be cleaned prior to performing the zero and span drift adjustments, except for systems using automatic zero adjustments. For systems using automatic zero adjustments, the optical surfaces must be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(iii) The owner or operator must apply a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. All procedures applied must provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photodetector assembly.

(iv) Except during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments, the COMS must be in continuous operation and must complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(v) The owner or operator must reduce all data from the COMS to 6-minute averages. Six-minute opacity averages must be calculated from 36 or more data points equally spaced over each 6-minute period. Data recorded during periods of system breakdowns, repairs, calibration checks,

and zero and span adjustments must not be included in the data averages. An arithmetic or integrated average of all data may be used.

(h) The owner or operator of each affected coal truck dump operation that commenced construction, reconstruction, or modification after April 28, 2008, must meet the requirements specified in paragraphs (h)(1) through (3) of this section.

(1) Conduct an initial performance test using Method 9 of appendix A-4 of this part according to the requirements in paragraphs (h)(1)(i) and(ii).

(i) Opacity readings shall be taken during the duration of three separate truck dump events. Each truck dump event commences when the truck bed begins to elevate and concludes when the truck bed returns to a horizontal position.

(ii) Compliance with the applicable opacity limit is determined by averaging all 15-second opacity readings made during the duration of three separate truck dump events.

(2) Conduct monthly visual observations of all process and control equipment. If any deficiencies are observed, the necessary maintenance must be performed as expeditiously as possible.

(3) Conduct a performance test using Method 9 of appendix A-4 of this part at least once every 5 calendar years for each affected facility.

 [Back to Top](#)

#### **§60.256 Continuous monitoring requirements.**

(a) The owner or operator of each affected facility constructed, reconstructed, or modified on or before April 28, 2008, must meet the monitoring requirements specified in paragraphs (a)(1) and (2) of this section, as applicable to the affected facility.

(1) The owner or operator of any thermal dryer shall install, calibrate, maintain, and continuously operate monitoring devices as follows:

(i) A monitoring device for the measurement of the temperature of the gas stream at the exit of the thermal dryer on a continuous basis. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 1.7$  °C ( $\pm 3$  °F).

(ii) For affected facilities that use wet scrubber emission control equipment:

(A) A monitoring device for the continuous measurement of the pressure loss through the venturi constriction of the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 1$  inch water gauge.

(B) A monitoring device for the continuous measurement of the water supply pressure to the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 5$  percent of design water supply pressure. The pressure sensor or tap must be located close to the water discharge point. The Administrator shall have discretion to grant requests for approval of alternative monitoring locations.

(2) All monitoring devices under paragraph (a) of this section are to be recalibrated annually in accordance with procedures under §60.13(b).

(b) The owner or operator of each affected facility constructed, reconstructed, or modified after April 28, 2008, that has one or more mechanical vents must install, calibrate, maintain, and continuously operate the monitoring devices specified in paragraphs (b)(1) through (3) of this section, as applicable to the mechanical vent and any control device installed on the vent.

(1) For mechanical vents with fabric filters (baghouses) with design controlled potential PM emissions rates of 25 Mg (28 tons) per year or more, a bag leak detection system according to the requirements in paragraph (c) of this section.

(2) For mechanical vents with wet scrubbers, monitoring devices according to the requirements in paragraphs (b)(2)(i) through (iv) of this section.

(i) A monitoring device for the continuous measurement of the pressure loss through the venturi constriction of the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 1$  inch water gauge.

(ii) A monitoring device for the continuous measurement of the water supply flow rate to the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 5$  percent of design water supply flow rate.

(iii) A monitoring device for the continuous measurement of the pH of the wet scrubber liquid. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 5$  percent of design pH.

(iv) An average value for each monitoring parameter must be determined during each performance test. Each monitoring parameter must then be maintained within 10 percent of the value established during the most recent performance test on an operating day average basis.

(3) For mechanical vents with control equipment other than wet scrubbers, a monitoring device for the continuous measurement of the reagent injection flow rate to the control equipment, as applicable. The monitoring device is to be certified by the manufacturer to be accurate within  $\pm 5$  percent of design injection flow rate. An average reagent injection flow rate value must be determined during each performance test. The reagent injection flow rate must then be maintained within 10 percent of the value established during the most recent performance test on an operating day average basis.

(c) Each bag leak detection system used to comply with provisions of this subpart must be installed, calibrated, maintained, and continuously operated according to the requirements in paragraphs (c)(1) through (3) of this section.

(1) The bag leak detection system must meet the specifications and requirements in paragraphs (c)(1)(i) through (viii) of this section.

(i) The bag leak detection system must be certified by the manufacturer to be capable of detecting PM emissions at concentrations of 1 milligram per dry standard cubic meter (mg/dscm) (0.00044 grains per actual cubic foot (gr/acf)) or less.

(ii) The bag leak detection system sensor must provide output of relative PM loadings. The owner or operator shall continuously record the output from the bag leak detection system using electronic or other means (e.g., using a strip chart recorder or a data logger).

(iii) The bag leak detection system must be equipped with an alarm system that will sound when the system detects an increase in relative particulate loading over the alarm set point established according to paragraph (c)(1)(iv) of this section, and the alarm must be located such that it can be heard by the appropriate plant personnel.

(iv) In the initial adjustment of the bag leak detection system, the owner or operator must establish, at a minimum, the baseline output by adjusting the sensitivity (range) and the averaging period of the device, the alarm set points, and the alarm delay time.

(v) Following initial adjustment, the owner or operator must not adjust the averaging period, alarm set point, or alarm delay time without approval from the Administrator or delegated authority except as provided in paragraph (c)(2)(vi) of this section.

(vi) Once per quarter, the owner or operator may adjust the sensitivity of the bag leak detection system to account for seasonal effects, including temperature and humidity, according to the procedures identified in the site-specific monitoring plan required by paragraph (c)(2) of this section.

(vii) The owner or operator must install the bag leak detection sensor downstream of the fabric filter.

(viii) Where multiple detectors are required, the system's instrumentation and alarm may be shared among detectors.

(2) The owner or operator must develop and submit to the Administrator or delegated authority for approval a site-specific monitoring plan for each bag leak detection system. This plan must be submitted to the Administrator or delegated authority 30 days prior to startup of the affected facility. The owner or operator must operate and maintain the bag leak detection system according to the site-specific monitoring plan at all times. Each monitoring plan must describe the items in paragraphs (c)(2)(i) through (vi) of this section.

(i) Installation of the bag leak detection system;

(ii) Initial and periodic adjustment of the bag leak detection system, including how the alarm set-point will be established;

(iii) Operation of the bag leak detection system, including quality assurance procedures;

(iv) How the bag leak detection system will be maintained, including a routine maintenance schedule and spare parts inventory list;

(v) How the bag leak detection system output will be recorded and stored; and

(vi) Corrective action procedures as specified in paragraph (c)(3) of this section. In approving the site-specific monitoring plan, the Administrator or delegated authority may allow the owner and operator more than 3 hours to alleviate a specific condition that causes an alarm if the owner or operator identifies in the monitoring plan this specific condition as one that could lead to an alarm, adequately explains why it is not feasible to alleviate this condition within 3 hours of the time the



alarm occurs, and demonstrates that the requested time will ensure alleviation of this condition as expeditiously as practicable.

(3) For each bag leak detection system, the owner or operator must initiate procedures to determine the cause of every alarm within 1 hour of the alarm. Except as provided in paragraph (c)(2)(vi) of this section, the owner or operator must alleviate the cause of the alarm within 3 hours of the alarm by taking whatever corrective action(s) are necessary. Corrective actions may include, but are not limited to the following:

(i) Inspecting the fabric filter for air leaks, torn or broken bags or filter media, or any other condition that may cause an increase in PM emissions;

(ii) Sealing off defective bags or filter media;

(iii) Replacing defective bags or filter media or otherwise repairing the control device;

(iv) Sealing off a defective fabric filter compartment;

(v) Cleaning the bag leak detection system probe or otherwise repairing the bag leak detection system; or

(vi) Shutting down the process producing the PM emissions.

 [Back to Top](#)

#### **§60.257 Test methods and procedures.**

(a) The owner or operator must determine compliance with the applicable opacity standards as specified in paragraphs (a)(1) through (3) of this section.

(1) Method 9 of appendix A-4 of this part and the procedures in §60.11 must be used to determine opacity, with the exceptions specified in paragraphs (a)(1)(i) and (ii).

(i) The duration of the Method 9 of appendix A-4 of this part performance test shall be 1 hour (ten 6-minute averages).

(ii) If, during the initial 30 minutes of the observation of a Method 9 of appendix A-4 of this part performance test, all of the 6-minute average opacity readings are less than or equal to half the applicable opacity limit, then the observation period may be reduced from 1 hour to 30 minutes.

(2) To determine opacity for fugitive coal dust emissions sources, the additional requirements specified in paragraphs (a)(2)(i) through (iii) must be used.

(i) The minimum distance between the observer and the emission source shall be 5.0 meters (16 feet), and the sun shall be oriented in the 140-degree sector of the back.

(ii) The observer shall select a position that minimizes interference from other fugitive coal dust emissions sources and make observations such that the line of vision is approximately perpendicular to the plume and wind direction.

(iii) The observer shall make opacity observations at the point of greatest opacity in that portion of the plume where condensed water vapor is not present. Water vapor is not considered a visible emission.

(3) A visible emissions observer may conduct visible emission observations for up to three fugitive, stack, or vent emission points within a 15-second interval if the following conditions specified in paragraphs (a)(3)(i) through (iii) of this section are met.

(i) No more than three emissions points may be read concurrently.

(ii) All three emissions points must be within a 70 degree viewing sector or angle in front of the observer such that the proper sun position can be maintained for all three points.

(iii) If an opacity reading for any one of the three emissions points is within 5 percent opacity from the applicable standard (excluding readings of zero opacity), then the observer must stop taking readings for the other two points and continue reading just that single point.

(b) The owner or operator must conduct all performance tests required by §60.8 to demonstrate compliance with the applicable emissions standards specified in §60.252 according to the requirements in §60.8 using the applicable test methods and procedures in paragraphs (b)(1) through (8) of this section.

(1) Method 1 or 1A of appendix A-4 of this part shall be used to select sampling port locations and the number of traverse points in each stack or duct. Sampling sites must be located at the outlet of the control device (or at the outlet of the emissions source if no control device is present) prior to any releases to the atmosphere.

(2) Method 2, 2A, 2C, 2D, 2F, or 2G of appendix A-4 of this part shall be used to determine the volumetric flow rate of the stack gas.

(3) Method 3, 3A, or 3B of appendix A-4 of this part shall be used to determine the dry molecular weight of the stack gas. The owner or operator may use ANSI/ASME PTC 19.10-1981, "Flue and Exhaust Gas Analyses (incorporated by reference—see §60.17) as an alternative to Method 3B of appendix A-2 of this part.

(4) Method 4 of appendix A-4 of this part shall be used to determine the moisture content of the stack gas.

(5) Method 5, 5B or 5D of appendix A-4 of this part or Method 17 of appendix A-7 of this part shall be used to determine the PM concentration as follows:

(i) The sampling time and sample volume for each run shall be at least 60 minutes and 0.85 dscm (30 dscf). Sampling shall begin no less than 30 minutes after startup and shall terminate before shutdown procedures begin. A minimum of three valid test runs are needed to comprise a PM performance test.

(ii) Method 5 of appendix A of this part shall be used only to test emissions from affected facilities without wet flue gas desulfurization (FGD) systems.

(iii) Method 5B of appendix A of this part is to be used only after wet FGD systems.

(iv) Method 5D of appendix A-4 of this part shall be used for positive pressure fabric filters and other similar applications (e.g., stub stacks and roof vents).

(v) Method 17 of appendix A-6 of this part may be used at facilities with or without wet scrubber systems provided the stack gas temperature does not exceed a temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A-3 of this part may be used in Method 17 of appendix A-6 of this part only if it is used after a wet FGD system. Do not use Method 17 of appendix A-6 of this part after wet FGD systems if the effluent is saturated or laden with water droplets.

(6) Method 6, 6A, or 6C of appendix A-4 of this part shall be used to determine the SO<sub>2</sub> concentration. A minimum of three valid test runs are needed to comprise an SO<sub>2</sub> performance test.

(7) Method 7 or 7E of appendix A-4 of this part shall be used to determine the NO<sub>x</sub> concentration. A minimum of three valid test runs are needed to comprise an NO<sub>x</sub> performance test.

(8) Method 10 of appendix A-4 of this part shall be used to determine the CO concentration. A minimum of three valid test runs are needed to comprise a CO performance test. CO performance tests are conducted concurrently (or within a 60-minute period) with NO<sub>x</sub> performance tests.

 [Back to Top](#)

#### **§60.258 Reporting and recordkeeping.**

(a) The owner or operator of a coal preparation and processing plant that commenced construction, reconstruction, or modification after April 28, 2008, shall maintain in a logbook (written or electronic) on-site and make it available upon request. The logbook shall record the following:

(1) The manufacturer's recommended maintenance procedures and the date and time of any maintenance and inspection activities and the results of those activities. Any variance from manufacturer recommendation, if any, shall be noted.

(2) The date and time of periodic coal preparation and processing plant visual observations, noting those sources with visible emissions along with corrective actions taken to reduce visible emissions. Results from the actions shall be noted.

(3) The amount and type of coal processed each calendar month.

(4) The amount of chemical stabilizer or water purchased for use in the coal preparation and processing plant.

(5) Monthly certification that the dust suppressant systems were operational when any coal was processed and that manufacturer's recommendations were followed for all control systems. Any variance from the manufacturer's recommendations, if any, shall be noted.

(6) Monthly certification that the fugitive coal dust emissions control plan was implemented as described. Any variance from the plan, if any, shall be noted. A copy of the applicable fugitive coal dust emissions control plan and any letters from the Administrator providing approval of any alternative control measures shall be maintained with the logbook. Any actions, e.g., objections, to

the plan and any actions relative to the alternative control measures, e.g., approvals, shall be noted in the logbook as well.

(7) For each bag leak detection system, the owner or operator must keep the records specified in paragraphs (a)(7)(i) through (iii) of this section.

(i) Records of the bag leak detection system output;

(ii) Records of bag leak detection system adjustments, including the date and time of the adjustment, the initial bag leak detection system settings, and the final bag leak detection settings; and

(iii) The date and time of all bag leak detection system alarms, the time that procedures to determine the cause of the alarm were initiated, the cause of the alarm, an explanation of the actions taken, the date and time the cause of the alarm was alleviated, and whether the cause of the alarm was alleviated within 3 hours of the alarm.

(8) A copy of any applicable monitoring plan for a digital opacity compliance system and monthly certification that the plan was implemented as described. Any variance from plan, if any, shall be noted.

(9) During a performance test of a wet scrubber, and each operating day thereafter, the owner or operator shall record the measurements of the scrubber pressure loss, water supply flow rate, and pH of the wet scrubber liquid.

(10) During a performance test of control equipment other than a wet scrubber, and each operating day thereafter, the owner or operator shall record the measurements of the reagent injection flow rate, as applicable.

(b) For the purpose of reports required under section 60.7(c), any owner operator subject to the provisions of this subpart also shall report semiannually periods of excess emissions as follow:

(1) The owner or operator of an affected facility with a wet scrubber shall submit semiannual reports to the Administrator or delegated authority of occurrences when the measurements of the scrubber pressure loss, water supply flow rate, or pH of the wet scrubber liquid vary by more than 10 percent from the average determined during the most recent performance test.

(2) The owner or operator of an affected facility with control equipment other than a wet scrubber shall submit semiannual reports to the Administrator or delegated authority of occurrences when the measurements of the reagent injection flow rate, as applicable, vary by more than 10 percent from the average determined during the most recent performance test.

(3) All 6-minute average opacities that exceed the applicable standard.

(c) The owner or operator of an affected facility shall submit the results of initial performance tests to the Administrator or delegated authority, consistent with the provisions of section 60.8. The owner or operator who elects to comply with the reduced performance testing provisions of sections 60.255(c) or (d) shall include in the performance test report identification of each affected facility that will be subject to the reduced testing. The owner or operator electing to comply with section 60.255(d) shall also include information which demonstrates that the control devices are identical.

(d) After July 1, 2011, within 60 days after the date of completing each performance evaluation conducted to demonstrate compliance with this subpart, the owner or operator of the affected facility must submit the test data to EPA by successfully entering the data electronically into EPA's WebFIRE data base available at <http://cfpub.epa.gov/oarweb/index.cfm?action=fire.main>. For performance tests that cannot be entered into WebFIRE (*i.e.*, Method 9 of appendix A-4 of this part opacity performance tests) the owner or operator of the affected facility must mail a summary copy to United States Environmental Protection Agency; Energy Strategies Group; 109 TW Alexander DR; mail code: D243-01; RTP, NC 27711.

 [Back to Top](#)

[Need assistance?](#)

Appendix D—40 CFR Part 60, Subpart IIII

# Electronic Code of Federal Regulations

## e-CFR data is current as of January 31, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 60](#) → Subpart III

---

[Browse Previous](#) | [Browse Next](#)

Title 40: Protection of Environment

[PART 60—STANDARDS OF PERFORMANCE FOR NEW STATIONARY SOURCES  
\(CONTINUED\)](#)

---

### **Subpart III—Standards of Performance for Stationary Compression Ignition Internal Combustion Engines**

---

#### **Contents**

##### [WHAT THIS SUBPART COVERS](#)

[§60.4200 Am I subject to this subpart?](#)

##### [EMISSION STANDARDS FOR MANUFACTURERS](#)

[§60.4201 What emission standards must I meet for non-emergency engines if I am a stationary CI internal combustion engine manufacturer?](#)

[§60.4202 What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer?](#)

[§60.4203 How long must my engines meet the emission standards if I am a manufacturer of stationary CI internal combustion engines?](#)

##### [EMISSION STANDARDS FOR OWNERS AND OPERATORS](#)

[§60.4204 What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine?](#)

[§60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?](#)

[§60.4206 How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?](#)

##### [FUEL REQUIREMENTS FOR OWNERS AND OPERATORS](#)

[§60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?](#)

##### [OTHER REQUIREMENTS FOR OWNERS AND OPERATORS](#)

[§60.4208 What is the deadline for importing or installing stationary CI ICE produced in previous model years?](#)

[§60.4209 What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?](#)

#### [COMPLIANCE REQUIREMENTS](#)

[§60.4210 What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer?](#)

[§60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?](#)

#### [TESTING REQUIREMENTS FOR OWNERS AND OPERATORS](#)

[§60.4212 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?](#)

[§60.4213 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?](#)

#### [NOTIFICATION, REPORTS, AND RECORDS FOR OWNERS AND OPERATORS](#)

[§60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?](#)

#### [SPECIAL REQUIREMENTS](#)

[§60.4215 What requirements must I meet for engines used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands?](#)

[§60.4216 What requirements must I meet for engines used in Alaska?](#)

[§60.4217 What emission standards must I meet if I am an owner or operator of a stationary internal combustion engine using special fuels?](#)

#### [GENERAL PROVISIONS](#)

[§60.4218 What parts of the General Provisions apply to me?](#)

#### [DEFINITIONS](#)

[§60.4219 What definitions apply to this subpart?](#)

[Table 1 to Subpart IIII of Part 60—Emission Standards for Stationary Pre-2007 Model Year Engines With a Displacement of <10 Liters per Cylinder and 2007-2010 Model Year Engines >2,237 KW \(3,000 HP\) and With a Displacement of <10 Liters per Cylinder](#)

[Table 2 to Subpart IIII of Part 60—Emission Standards for 2008 Model Year and Later Emergency Stationary CI ICE <37 KW \(50 HP\) With a Displacement of <10 Liters per Cylinder](#)

[Table 3 to Subpart IIII of Part 60—Certification Requirements for Stationary Fire Pump Engines](#)

[Table 4 to Subpart IIII of Part 60—Emission Standards for Stationary Fire Pump Engines](#)

[Table 5 to Subpart IIII of Part 60—Labeling and Recordkeeping Requirements for New Stationary Emergency Engines](#)

[Table 6 to Subpart IIII of Part 60—Optional 3-Mode Test Cycle for Stationary Fire Pump Engines](#)

[Table 7 to Subpart IIII of Part 60—Requirements for Performance Tests for Stationary CI ICE With a](#)



SOURCE: 71 FR 39172, July 11, 2006, unless otherwise noted.

[↑ Back to Top](#)

## WHAT THIS SUBPART COVERS

[↑ Back to Top](#)

### §60.4200 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) Manufacturers of stationary CI ICE with a displacement of less than 30 liters per cylinder where the model year is:

- (i) 2007 or later, for engines that are not fire pump engines;
- (ii) The model year listed in Table 3 to this subpart or later model year, for fire pump engines.

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

- (i) Manufactured after April 1, 2006, and are not fire pump engines, or
- (ii) Manufactured as a certified National Fire Protection Association (NFPA) fire pump engine after July 1, 2006.

(3) Owners and operators of any stationary CI ICE that are modified or reconstructed after July 11, 2005 and any person that modifies or reconstructs any stationary CI ICE after July 11, 2005.

(4) The provisions of §60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

(b) The provisions of this subpart are not applicable to stationary CI ICE being tested at a stationary CI ICE test cell/stand.

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) Stationary CI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C (or the exemptions described in 40 CFR part 89, subpart J and 40 CFR part 94, subpart J, for engines that would need to be certified to standards in those parts), except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

(e) Owners and operators of facilities with CI ICE that are acting as temporary replacement units and that are located at a stationary source for less than 1 year and that have been properly certified as meeting the standards that would be applicable to such engine under the appropriate nonroad engine provisions, are not required to meet any other provisions under this subpart with regard to such engines.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011]

 [Back to Top](#)

## **EMISSION STANDARDS FOR MANUFACTURERS**

 [Back to Top](#)

### **§60.4201 What emission standards must I meet for non-emergency engines if I am a stationary CI internal combustion engine manufacturer?**

(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later non-emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 kilowatt (KW) (3,000 horsepower (HP)) and a displacement of less than 10 liters per cylinder to the certification emission standards for new nonroad CI engines in 40 CFR 89.112, 40 CFR 89.113, 40 CFR 1039.101, 40 CFR 1039.102, 40 CFR 1039.104, 40 CFR 1039.105, 40 CFR 1039.107, and 40 CFR 1039.115, as applicable, for all pollutants, for the same model year and maximum engine power.

(b) Stationary CI internal combustion engine manufacturers must certify their 2007 through 2010 model year non-emergency stationary CI ICE with a maximum engine power greater than 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder to the emission standards in table 1 to this subpart, for all pollutants, for the same maximum engine power.

(c) Stationary CI internal combustion engine manufacturers must certify their 2011 model year and later non-emergency stationary CI ICE with a maximum engine power greater than 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder to the certification emission standards for new nonroad CI engines in 40 CFR 1039.101, 40 CFR 1039.102, 40 CFR 1039.104, 40 CFR 1039.105, 40 CFR 1039.107, and 40 CFR 1039.115, as applicable, for all pollutants, for the same maximum engine power.

(d) Stationary CI internal combustion engine manufacturers must certify the following non-emergency stationary CI ICE to the certification emission standards for new marine CI engines in 40 CFR 94.8, as applicable, for all pollutants, for the same displacement and maximum engine power:

(1) Their 2007 model year through 2012 non-emergency stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder;

(2) Their 2013 model year non-emergency stationary CI ICE with a maximum engine power greater than or equal to 3,700 KW (4,958 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 15 liters per cylinder; and

(3) Their 2013 model year non-emergency stationary CI ICE with a displacement of greater than or equal to 15 liters per cylinder and less than 30 liters per cylinder.

(e) Stationary CI internal combustion engine manufacturers must certify the following non-emergency stationary CI ICE to the certification emission standards and other requirements for new marine CI engines in 40 CFR 1042.101, 40 CFR 1042.107, 40 CFR 1042.110, 40 CFR 1042.115, 40 CFR 1042.120, and 40 CFR 1042.145, as applicable, for all pollutants, for the same displacement and maximum engine power:

(1) Their 2013 model year non-emergency stationary CI ICE with a maximum engine power less than 3,700 KW (4,958 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 15 liters per cylinder; and

(2) Their 2014 model year and later non-emergency stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder.

(f) Notwithstanding the requirements in paragraphs (a) through (c) of this section, stationary non-emergency CI ICE identified in paragraphs (a) and (c) may be certified to the provisions of 40 CFR part 94 or, if Table 1 to 40 CFR 1042.1 identifies 40 CFR part 1042 as being applicable, 40 CFR part 1042, if the engines will be used solely in either or both of the following locations:

(1) Remote areas of Alaska; and

(2) Marine offshore installations.

(g) Notwithstanding the requirements in paragraphs (a) through (f) of this section, stationary CI internal combustion engine manufacturers are not required to certify reconstructed engines; however manufacturers may elect to do so. The reconstructed engine must be certified to the emission standards specified in paragraphs (a) through (e) of this section that are applicable to the model year, maximum engine power, and displacement of the reconstructed stationary CI ICE.

(h) Stationary CI ICE certified to the standards in 40 CFR part 1039 and equipped with auxiliary emission control devices (AECDs) as specified in 40 CFR 1039.665 must meet the Tier 1 certification emission standards for new nonroad CI engines in 40 CFR 89.112 while the AECD is activated during a qualified emergency situation. A qualified emergency situation is defined in 40 CFR 1039.665. When the qualified emergency situation has ended and the AECD is deactivated, the engine must resume meeting the otherwise applicable emission standard specified in this section.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 81 FR 44219, July 7, 2016]

 [Back to Top](#)

### **§60.4202 What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer?**

(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237

KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of this section.

(1) For engines with a maximum engine power less than 37 KW (50 HP):

(i) The certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants for model year 2007 engines, and

(ii) The certification emission standards for new nonroad CI engines in 40 CFR 1039.104, 40 CFR 1039.105, 40 CFR 1039.107, 40 CFR 1039.115, and table 2 to this subpart, for 2008 model year and later engines.

(2) For engines with a maximum engine power greater than or equal to 37 KW (50 HP), the certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants beginning in model year 2007.

(b) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power greater than 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (b)(1) through (2) of this section.

(1) For 2007 through 2010 model years, the emission standards in table 1 to this subpart, for all pollutants, for the same maximum engine power.

(2) For 2011 model year and later, the certification emission standards for new nonroad CI engines for engines of the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants.

(c) [Reserved]

(d) Beginning with the model years in table 3 to this subpart, stationary CI internal combustion engine manufacturers must certify their fire pump stationary CI ICE to the emission standards in table 4 to this subpart, for all pollutants, for the same model year and NFPA nameplate power.

(e) Stationary CI internal combustion engine manufacturers must certify the following emergency stationary CI ICE that are not fire pump engines to the certification emission standards for new marine CI engines in 40 CFR 94.8, as applicable, for all pollutants, for the same displacement and maximum engine power:

(1) Their 2007 model year through 2012 emergency stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder;

(2) Their 2013 model year and later emergency stationary CI ICE with a maximum engine power greater than or equal to 3,700 KW (4,958 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 15 liters per cylinder;

(3) Their 2013 model year emergency stationary CI ICE with a displacement of greater than or equal to 15 liters per cylinder and less than 30 liters per cylinder; and

(4) Their 2014 model year and later emergency stationary CI ICE with a maximum engine power greater than or equal to 2,000 KW (2,682 HP) and a displacement of greater than or equal to 15 liters per cylinder and less than 30 liters per cylinder.

(f) Stationary CI internal combustion engine manufacturers must certify the following emergency stationary CI ICE to the certification emission standards and other requirements applicable to Tier 3 new marine CI engines in 40 CFR 1042.101, 40 CFR 1042.107, 40 CFR 1042.115, 40 CFR 1042.120, and 40 CFR 1042.145, for all pollutants, for the same displacement and maximum engine power:

(1) Their 2013 model year and later emergency stationary CI ICE with a maximum engine power less than 3,700 KW (4,958 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 15 liters per cylinder; and

(2) Their 2014 model year and later emergency stationary CI ICE with a maximum engine power less than 2,000 KW (2,682 HP) and a displacement of greater than or equal to 15 liters per cylinder and less than 30 liters per cylinder.

(g) Notwithstanding the requirements in paragraphs (a) through (d) of this section, stationary emergency CI internal combustion engines identified in paragraphs (a) and (c) may be certified to the provisions of 40 CFR part 94 or, if Table 2 to 40 CFR 1042.101 identifies Tier 3 standards as being applicable, the requirements applicable to Tier 3 engines in 40 CFR part 1042, if the engines will be used solely in either or both of the following locations:

(1) Remote areas of Alaska; and

(2) Marine offshore installations.

(h) Notwithstanding the requirements in paragraphs (a) through (f) of this section, stationary CI internal combustion engine manufacturers are not required to certify reconstructed engines; however manufacturers may elect to do so. The reconstructed engine must be certified to the emission standards specified in paragraphs (a) through (f) of this section that are applicable to the model year, maximum engine power and displacement of the reconstructed emergency stationary CI ICE.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37968, June 28, 2011; 81 FR 44219, July 7, 2016]

 [Back to Top](#)

### **§60.4203 How long must my engines meet the emission standards if I am a manufacturer of stationary CI internal combustion engines?**

Engines manufactured by stationary CI internal combustion engine manufacturers must meet the emission standards as required in §§60.4201 and 60.4202 during the certified emissions life of the engines.

[76 FR 37968, June 28, 2011]

 [Back to Top](#)

## EMISSION STANDARDS FOR OWNERS AND OPERATORS

[↑ Back to Top](#)

### §60.4204 What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(a) Owners and operators of pre-2007 model year non-emergency stationary CI ICE with a displacement of less than 10 liters per cylinder must comply with the emission standards in table 1 to this subpart. Owners and operators of pre-2007 model year non-emergency stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder must comply with the emission standards in 40 CFR 94.8(a)(1).

(b) Owners and operators of 2007 model year and later non-emergency stationary CI ICE with a displacement of less than 30 liters per cylinder must comply with the emission standards for new CI engines in §60.4201 for their 2007 model year and later stationary CI ICE, as applicable.

(c) Owners and operators of non-emergency stationary CI engines with a displacement of greater than or equal to 30 liters per cylinder must meet the following requirements:

(1) For engines installed prior to January 1, 2012, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 17.0 grams per kilowatt-hour (g/KW-hr) (12.7 grams per horsepower-hr (g/HP-hr)) when maximum engine speed is less than 130 revolutions per minute (rpm);

(ii)  $45 \cdot n^{-0.2}$  g/KW-hr ( $34 \cdot n^{-0.2}$  g/HP-hr) when maximum engine speed is 130 or more but less than 2,000 rpm, where n is maximum engine speed; and

(iii) 9.8 g/KW-hr (7.3 g/HP-hr) when maximum engine speed is 2,000 rpm or more.

(2) For engines installed on or after January 1, 2012 and before January 1, 2016, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 14.4 g/KW-hr (10.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $44 \cdot n^{-0.23}$  g/KW-hr ( $33 \cdot n^{-0.23}$  g/HP-hr) when maximum engine speed is greater than or equal to 130 but less than 2,000 rpm and where n is maximum engine speed; and

(iii) 7.7 g/KW-hr (5.7 g/HP-hr) when maximum engine speed is greater than or equal to 2,000 rpm.

(3) For engines installed on or after January 1, 2016, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 3.4 g/KW-hr (2.5 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $9.0 \cdot n^{-0.20}$  g/KW-hr ( $6.7 \cdot n^{-0.20}$  g/HP-hr) where n (maximum engine speed) is 130 or more but less than 2,000 rpm; and

(iii) 2.0 g/KW-hr (1.5 g/HP-hr) where maximum engine speed is greater than or equal to 2,000 rpm.

(4) Reduce particulate matter (PM) emissions by 60 percent or more, or limit the emissions of PM in the stationary CI internal combustion engine exhaust to 0.15 g/KW-hr (0.11 g/HP-hr).

(d) Owners and operators of non-emergency stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests in-use must meet the not-to-exceed (NTE) standards as indicated in §60.4212.

(e) Owners and operators of any modified or reconstructed non-emergency stationary CI ICE subject to this subpart must meet the emission standards applicable to the model year, maximum engine power, and displacement of the modified or reconstructed non-emergency stationary CI ICE that are specified in paragraphs (a) through (d) of this section.

(f) Owners and operators of stationary CI ICE certified to the standards in 40 CFR part 1039 and equipped with AECDs as specified in 40 CFR 1039.665 must meet the Tier 1 certification emission standards for new nonroad CI engines in 40 CFR 89.112 while the AECD is activated during a qualified emergency situation. A qualified emergency situation is defined in 40 CFR 1039.665. When the qualified emergency situation has ended and the AECD is deactivated, the engine must resume meeting the otherwise applicable emission standard specified in this section.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37968, June 28, 2011; 81 FR 44219, July 7, 2016]

 [Back to Top](#)

#### **§60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?**

(a) Owners and operators of pre-2007 model year emergency stationary CI ICE with a displacement of less than 10 liters per cylinder that are not fire pump engines must comply with the emission standards in Table 1 to this subpart. Owners and operators of pre-2007 model year emergency stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards in 40 CFR 94.8(a)(1).

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in §60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

(c) Owners and operators of fire pump engines with a displacement of less than 30 liters per cylinder must comply with the emission standards in table 4 to this subpart, for all pollutants.

(d) Owners and operators of emergency stationary CI engines with a displacement of greater than or equal to 30 liters per cylinder must meet the requirements in this section.

(1) For engines installed prior to January 1, 2012, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 17.0 g/KW-hr (12.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $45 \cdot n^{-0.2}$  g/KW-hr ( $34 \cdot n^{-0.2}$  g/HP-hr) when maximum engine speed is 130 or more but less than 2,000 rpm, where n is maximum engine speed; and

(iii) 9.8 g/kW-hr (7.3 g/HP-hr) when maximum engine speed is 2,000 rpm or more.

(2) For engines installed on or after January 1, 2012, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 14.4 g/KW-hr (10.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $44 \cdot n^{-0.23}$  g/KW-hr ( $33 \cdot n^{-0.23}$  g/HP-hr) when maximum engine speed is greater than or equal to 130 but less than 2,000 rpm and where n is maximum engine speed; and

(iii) 7.7 g/KW-hr (5.7 g/HP-hr) when maximum engine speed is greater than or equal to 2,000 rpm.

(3) Limit the emissions of PM in the stationary CI internal combustion engine exhaust to 0.40 g/KW-hr (0.30 g/HP-hr).

(e) Owners and operators of emergency stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests in-use must meet the NTE standards as indicated in §60.4212.

(f) Owners and operators of any modified or reconstructed emergency stationary CI ICE subject to this subpart must meet the emission standards applicable to the model year, maximum engine power, and displacement of the modified or reconstructed CI ICE that are specified in paragraphs (a) through (e) of this section.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

[↑ Back to Top](#)

### **§60.4206 How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?**

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

[↑ Back to Top](#)

## **FUEL REQUIREMENTS FOR OWNERS AND OPERATORS**

[↑ Back to Top](#)



**§60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?**

(a) Beginning October 1, 2007, owners and operators of stationary CI ICE subject to this subpart that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(a).

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(b) for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

(c) [Reserved]

(d) Beginning June 1, 2012, owners and operators of stationary CI ICE subject to this subpart with a displacement of greater than or equal to 30 liters per cylinder are no longer subject to the requirements of paragraph (a) of this section, and must use fuel that meets a maximum per-gallon sulfur content of 1,000 parts per million (ppm).

(e) Stationary CI ICE that have a national security exemption under §60.4200(d) are also exempt from the fuel requirements in this section.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013]

[↑ Back to Top](#)

**OTHER REQUIREMENTS FOR OWNERS AND OPERATORS**

[↑ Back to Top](#)

**§60.4208 What is the deadline for importing or installing stationary CI ICE produced in previous model years?**

(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

(b) After December 31, 2009, owners and operators may not install stationary CI ICE with a maximum engine power of less than 19 KW (25 HP) (excluding fire pump engines) that do not meet the applicable requirements for 2008 model year engines.

(c) After December 31, 2014, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 19 KW (25 HP) and less than 56 KW (75 HP) that do not meet the applicable requirements for 2013 model year non-emergency engines.

(d) After December 31, 2013, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 56 KW (75 HP) and less than 130 KW (175 HP) that do not meet the applicable requirements for 2012 model year non-emergency engines.

(e) After December 31, 2012, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 130 KW (175 HP), including those above 560 KW (750 HP), that do not meet the applicable requirements for 2011 model year non-emergency engines.

(f) After December 31, 2016, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 560 KW (750 HP) that do not meet the applicable requirements for 2015 model year non-emergency engines.

(g) After December 31, 2018, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power greater than or equal to 600 KW (804 HP) and less than 2,000 KW (2,680 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder that do not meet the applicable requirements for 2017 model year non-emergency engines.

(h) In addition to the requirements specified in §§60.4201, 60.4202, 60.4204, and 60.4205, it is prohibited to import stationary CI ICE with a displacement of less than 30 liters per cylinder that do not meet the applicable requirements specified in paragraphs (a) through (g) of this section after the dates specified in paragraphs (a) through (g) of this section.

(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

 [Back to Top](#)

### **§60.4209 What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?**

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in §60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) If you are an owner or operator of a stationary CI internal combustion engine equipped with a diesel particulate filter to comply with the emission standards in §60.4204, the diesel particulate filter must be installed with a backpressure monitor that notifies the owner or operator when the high backpressure limit of the engine is approached.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

 [Back to Top](#)

## **COMPLIANCE REQUIREMENTS**

 [Back to Top](#)

**§60.4210 What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer?**

(a) Stationary CI internal combustion engine manufacturers must certify their stationary CI ICE with a displacement of less than 10 liters per cylinder to the emission standards specified in §§60.4201(a) through (c) and 60.4202(a), (b) and (d) using the certification procedures required in 40 CFR part 89, subpart B, or 40 CFR part 1039, subpart C, as applicable, and must test their engines as specified in those parts. For the purposes of this subpart, engines certified to the standards in table 1 to this subpart shall be subject to the same requirements as engines certified to the standards in 40 CFR part 89. For the purposes of this subpart, engines certified to the standards in table 4 to this subpart shall be subject to the same requirements as engines certified to the standards in 40 CFR part 89, except that engines with NFPA nameplate power of less than 37 KW (50 HP) certified to model year 2011 or later standards shall be subject to the same requirements as engines certified to the standards in 40 CFR part 1039.

(b) Stationary CI internal combustion engine manufacturers must certify their stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder to the emission standards specified in §§60.4201(d) and (e) and 60.4202(e) and (f) using the certification procedures required in 40 CFR part 94, subpart C, or 40 CFR part 1042, subpart C, as applicable, and must test their engines as specified in 40 CFR part 94 or 1042, as applicable.

(c) Stationary CI internal combustion engine manufacturers must meet the requirements of 40 CFR 1039.120, 1039.125, 1039.130, and 1039.135, and 40 CFR part 1068 for engines that are certified to the emission standards in 40 CFR part 1039. Stationary CI internal combustion engine manufacturers must meet the corresponding provisions of 40 CFR part 89, 40 CFR part 94 or 40 CFR part 1042 for engines that would be covered by that part if they were nonroad (including marine) engines. Labels on such engines must refer to stationary engines, rather than or in addition to nonroad or marine engines, as appropriate. Stationary CI internal combustion engine manufacturers must label their engines according to paragraphs (c)(1) through (3) of this section.

(1) Stationary CI internal combustion engines manufactured from January 1, 2006 to March 31, 2006 (January 1, 2006 to June 30, 2006 for fire pump engines), other than those that are part of certified engine families under the nonroad CI engine regulations, must be labeled according to 40 CFR 1039.20.

(2) Stationary CI internal combustion engines manufactured from April 1, 2006 to December 31, 2006 (or, for fire pump engines, July 1, 2006 to December 31 of the year preceding the year listed in table 3 to this subpart) must be labeled according to paragraphs (c)(2)(i) through (iii) of this section:

(i) Stationary CI internal combustion engines that are part of certified engine families under the nonroad regulations must meet the labeling requirements for nonroad CI engines, but do not have to meet the labeling requirements in 40 CFR 1039.20.

(ii) Stationary CI internal combustion engines that meet Tier 1 requirements (or requirements for fire pumps) under this subpart, but do not meet the requirements applicable to nonroad CI engines must be labeled according to 40 CFR 1039.20. The engine manufacturer may add language to the label clarifying that the engine meets Tier 1 requirements (or requirements for fire pumps) of this subpart.

(iii) Stationary CI internal combustion engines manufactured after April 1, 2006 that do not meet Tier 1 requirements of this subpart, or fire pumps engines manufactured after July 1, 2006 that do not meet the requirements for fire pumps under this subpart, may not be used in the U.S. If any such

engines are manufactured in the U.S. after April 1, 2006 (July 1, 2006 for fire pump engines), they must be exported or must be brought into compliance with the appropriate standards prior to initial operation. The export provisions of 40 CFR 1068.230 would apply to engines for export and the manufacturers must label such engines according to 40 CFR 1068.230.

(3) Stationary CI internal combustion engines manufactured after January 1, 2007 (for fire pump engines, after January 1 of the year listed in table 3 to this subpart, as applicable) must be labeled according to paragraphs (c)(3)(i) through (iii) of this section.

(i) Stationary CI internal combustion engines that meet the requirements of this subpart and the corresponding requirements for nonroad (including marine) engines of the same model year and HP must be labeled according to the provisions in 40 CFR parts 89, 94, 1039 or 1042, as appropriate.

(ii) Stationary CI internal combustion engines that meet the requirements of this subpart, but are not certified to the standards applicable to nonroad (including marine) engines of the same model year and HP must be labeled according to the provisions in 40 CFR parts 89, 94, 1039 or 1042, as appropriate, but the words "stationary" must be included instead of "nonroad" or "marine" on the label. In addition, such engines must be labeled according to 40 CFR 1039.20.

(iii) Stationary CI internal combustion engines that do not meet the requirements of this subpart must be labeled according to 40 CFR 1068.230 and must be exported under the provisions of 40 CFR 1068.230.

(d) An engine manufacturer certifying an engine family or families to standards under this subpart that are identical to standards applicable under 40 CFR parts 89, 94, 1039 or 1042 for that model year may certify any such family that contains both nonroad (including marine) and stationary engines as a single engine family and/or may include any such family containing stationary engines in the averaging, banking and trading provisions applicable for such engines under those parts.

(e) Manufacturers of engine families discussed in paragraph (d) of this section may meet the labeling requirements referred to in paragraph (c) of this section for stationary CI ICE by either adding a separate label containing the information required in paragraph (c) of this section or by adding the words "and stationary" after the word "nonroad" or "marine," as appropriate, to the label.

(f) Starting with the model years shown in table 5 to this subpart, stationary CI internal combustion engine manufacturers must add a permanent label stating that the engine is for stationary emergency use only to each new emergency stationary CI internal combustion engine greater than or equal to 19 KW (25 HP) that meets all the emission standards for emergency engines in §60.4202 but does not meet all the emission standards for non-emergency engines in §60.4201. The label must be added according to the labeling requirements specified in 40 CFR 1039.135(b). Engine manufacturers must specify in the owner's manual that operation of emergency engines is limited to emergency operations and required maintenance and testing.

(g) Manufacturers of fire pump engines may use the test cycle in table 6 to this subpart for testing fire pump engines and may test at the NFPA certified nameplate HP, provided that the engine is labeled as "Fire Pump Applications Only".

(h) Engine manufacturers, including importers, may introduce into commerce uncertified engines or engines certified to earlier standards that were manufactured before the new or changed standards took effect until inventories are depleted, as long as such engines are part of normal inventory. For example, if the engine manufacturers' normal industry practice is to keep on hand a one-month supply of engines based on its projected sales, and a new tier of standards starts to

apply for the 2009 model year, the engine manufacturer may manufacture engines based on the normal inventory requirements late in the 2008 model year, and sell those engines for installation. The engine manufacturer may not circumvent the provisions of §60.4201 or §60.4202 by stockpiling engines that are built before new or changed standards take effect. Stockpiling of such engines beyond normal industry practice is a violation of this subpart.

(i) The replacement engine provisions of 40 CFR 89.1003(b)(7), 40 CFR 94.1103(b)(3), 40 CFR 94.1103(b)(4) and 40 CFR 1068.240 are applicable to stationary CI engines replacing existing equipment that is less than 15 years old.

(j) Stationary CI ICE manufacturers may equip their stationary CI internal combustion engines certified to the emission standards in 40 CFR part 1039 with AECs for qualified emergency situations according to the requirements of 40 CFR 1039.665. Manufacturers of stationary CI ICE equipped with AECs as allowed by 40 CFR 1039.665 must meet all of the requirements in 40 CFR 1039.665 that apply to manufacturers. Manufacturers must document that the engine complies with the Tier 1 standard in 40 CFR 89.112 when the AEC is activated. Manufacturers must provide any relevant testing, engineering analysis, or other information in sufficient detail to support such statement when applying for certification (including amending an existing certificate) of an engine equipped with an AEC as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 81 FR 44219, July 7, 2016]

[↑ Back to Top](#)

### **§60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR parts 89, 94 and/or 1068, as they apply to you.

(b) If you are an owner or operator of a pre-2007 model year stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(a) or §60.4205(a), or if you are an owner or operator of a CI fire pump engine that is manufactured prior to the model years in table 3 to this subpart and must comply with the emission standards specified in §60.4205(c), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) through (5) of this section.

(1) Purchasing an engine certified according to 40 CFR part 89 or 40 CFR part 94, as applicable, for the same model year and maximum engine power. The engine must be installed and configured according to the manufacturer's specifications.

(2) Keeping records of performance test results for each pollutant for a test conducted on a similar engine. The test must have been conducted using the same methods specified in this subpart and these methods must have been followed correctly.

(3) Keeping records of engine manufacturer data indicating compliance with the standards.

(4) Keeping records of control device vendor data indicating compliance with the standards.

(5) Conducting an initial performance test to demonstrate compliance with the emission standards according to the requirements specified in §60.4212, as applicable.

(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(b) or §60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in §60.4205(c), you must comply by purchasing an engine certified to the emission standards in §60.4204(b), or §60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

(d) If you are an owner or operator and must comply with the emission standards specified in §60.4204(c) or §60.4205(d), you must demonstrate compliance according to the requirements specified in paragraphs (d)(1) through (3) of this section.

(1) Conducting an initial performance test to demonstrate initial compliance with the emission standards as specified in §60.4213.

(2) Establishing operating parameters to be monitored continuously to ensure the stationary internal combustion engine continues to meet the emission standards. The owner or operator must petition the Administrator for approval of operating parameters to be monitored continuously. The petition must include the information described in paragraphs (d)(2)(i) through (v) of this section.

(i) Identification of the specific parameters you propose to monitor continuously;

(ii) A discussion of the relationship between these parameters and NO<sub>x</sub> and PM emissions, identifying how the emissions of these pollutants change with changes in these parameters, and how limitations on these parameters will serve to limit NO<sub>x</sub> and PM emissions;

(iii) A discussion of how you will establish the upper and/or lower values for these parameters which will establish the limits on these parameters in the operating limitations;

(iv) A discussion identifying the methods and the instruments you will use to monitor these parameters, as well as the relative accuracy and precision of these methods and instruments; and

(v) A discussion identifying the frequency and methods for recalibrating the instruments you will use for monitoring these parameters.

(3) For non-emergency engines with a displacement of greater than or equal to 30 liters per cylinder, conducting annual performance tests to demonstrate continuous compliance with the emission standards as specified in §60.4213.

(e) If you are an owner or operator of a modified or reconstructed stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(e) or

§60.4205(f), you must demonstrate compliance according to one of the methods specified in paragraphs (e)(1) or (2) of this section.

(1) Purchasing, or otherwise owning or operating, an engine certified to the emission standards in §60.4204(e) or §60.4205(f), as applicable.

(2) Conducting a performance test to demonstrate initial compliance with the emission standards according to the requirements specified in §60.4212 or §60.4213, as appropriate. The test must be conducted within 60 days after the engine commences operation after the modification or reconstruction.

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii) Emergency stationary ICE may be operated for emergency demand response for periods in which the Reliability Coordinator under the North American Electric Reliability Corporation (NERC) Reliability Standard EOP-002-3, Capacity and Energy Emergencies (incorporated by reference, see §60.17), or other authorized entity as determined by the Reliability Coordinator, has declared an Energy Emergency Alert Level 2 as defined in the NERC Reliability Standard EOP-002-3.

(iii) Emergency stationary ICE may be operated for periods where there is a deviation of voltage or frequency of 5 percent or greater below standard voltage or frequency.

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

(ii) [Reserved]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) If you are an owner or operator of a stationary CI internal combustion engine with maximum engine power less than 100 HP, you must keep a maintenance plan and records of conducted maintenance to demonstrate compliance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, if you do not install and configure the engine and control device according to the manufacturer's emission-related written instructions, or you change the emission-related settings in a way that is not permitted by the manufacturer, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of such action.

(2) If you are an owner or operator of a stationary CI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer.

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1



year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECDs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

[↑ Back to Top](#)

## TESTING REQUIREMENTS FOR OWNERS AND OPERATORS

[↑ Back to Top](#)

### **§60.4212 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?**

Owners and operators of stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests pursuant to this subpart must do so according to paragraphs (a) through (e) of this section.

(a) The performance test must be conducted according to the in-use testing procedures in 40 CFR part 1039, subpart F, for stationary CI ICE with a displacement of less than 10 liters per cylinder, and according to 40 CFR part 1042, subpart F, for stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder.

(b) Exhaust emissions from stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR part 1039 must not exceed the not-to-exceed (NTE) standards for the same model year and maximum engine power as required in 40 CFR 1039.101(e) and 40 CFR 1039.102(g)(1), except as specified in 40 CFR 1039.104(d). This requirement starts when NTE requirements take effect for nonroad diesel engines under 40 CFR part 1039.

(c) Exhaust emissions from stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR 89.112 or 40 CFR 94.8, as applicable, must not exceed the NTE numerical requirements, rounded to the same number of decimal places as the applicable standard in 40 CFR 89.112 or 40 CFR 94.8, as applicable, determined from the following equation:

NTE requirement for each pollutant =  $1.25 \times \text{STD}$  (Eq. 1)

[View or download PDF](#)

Where:

STD = The standard specified for that pollutant in 40 CFR 89.112 or 40 CFR 94.8, as applicable.

Alternatively, stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR 89.112 or 40 CFR 94.8 may follow the testing procedures specified in §60.4213 of this subpart, as appropriate.

(d) Exhaust emissions from stationary CI ICE that are complying with the emission standards for pre-2007 model year engines in §60.4204(a), §60.4205(a), or §60.4205(c) must not exceed the NTE numerical requirements, rounded to the same number of decimal places as the applicable standard in §60.4204(a), §60.4205(a), or §60.4205(c), determined from the equation in paragraph (c) of this section.

Where:

STD = The standard specified for that pollutant in §60.4204(a), §60.4205(a), or §60.4205(c).

Alternatively, stationary CI ICE that are complying with the emission standards for pre-2007 model year engines in §60.4204(a), §60.4205(a), or §60.4205(c) may follow the testing procedures specified in §60.4213, as appropriate.

(e) Exhaust emissions from stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR part 1042 must not exceed the NTE standards for the same model year and maximum engine power as required in 40 CFR 1042.101(c).

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

 [Back to Top](#)

### **§60.4213 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?**

Owners and operators of stationary CI ICE with a displacement of greater than or equal to 30 liters per cylinder must conduct performance tests according to paragraphs (a) through (f) of this section.

(a) Each performance test must be conducted according to the requirements in §60.8 and under the specific conditions that this subpart specifies in table 7. The test must be conducted within 10 percent of 100 percent peak (or the highest achievable) load.

(b) You may not conduct performance tests during periods of startup, shutdown, or malfunction, as specified in §60.8(c).

(c) You must conduct three separate test runs for each performance test required in this section, as specified in §60.8(f). Each test run must last at least 1 hour.

(d) To determine compliance with the percent reduction requirement, you must follow the requirements as specified in paragraphs (d)(1) through (3) of this section.

(1) You must use Equation 2 of this section to determine compliance with the percent reduction requirement:

$$C = \frac{C_i - C_o}{100 - R} \quad \text{Eq. 2}$$

[View or download PDF](#)

Where:

$C_i$  = concentration of  $\text{NO}_x$  or PM at the control device inlet,

$C_o$  = concentration of  $\text{NO}_x$  or PM at the control device outlet, and

$R$  = percent reduction of  $\text{NO}_x$  or PM emissions.

(2) You must normalize the  $\text{NO}_x$  or PM concentrations at the inlet and outlet of the control device to a dry basis and to 15 percent oxygen ( $\text{O}_2$ ) using Equation 3 of this section, or an equivalent percent carbon dioxide ( $\text{CO}_2$ ) using the procedures described in paragraph (d)(3) of this section.

$$C_{\text{adj}} = C_d \frac{5.9}{20.9 - \%O_2} \quad \text{Eq. 3}$$

[View or download PDF](#)

Where:

$C_{\text{adj}}$  = Calculated  $\text{NO}_x$  or PM concentration adjusted to 15 percent  $\text{O}_2$ .

$C_d$  = Measured concentration of  $\text{NO}_x$  or PM, uncorrected.

5.9 = 20.9 percent  $\text{O}_2$  - 15 percent  $\text{O}_2$ , the defined  $\text{O}_2$  correction value, percent.

$\%O_2$  = Measured  $\text{O}_2$  concentration, dry basis, percent.

(3) If pollutant concentrations are to be corrected to 15 percent  $\text{O}_2$  and  $\text{CO}_2$  concentration is measured in lieu of  $\text{O}_2$  concentration measurement, a  $\text{CO}_2$  correction factor is needed. Calculate the  $\text{CO}_2$  correction factor as described in paragraphs (d)(3)(i) through (iii) of this section.

(i) Calculate the fuel-specific  $F_o$  value for the fuel burned during the test using values obtained from Method 19, Section 5.2, and the following equation:

$$F_o = \frac{18.218V_d}{F_d} \quad \text{Eq. 4}$$

[View or download PDF](#)

Where:

$F_o$  = Fuel factor based on the ratio of  $\text{O}_2$  volume to the ultimate  $\text{CO}_2$  volume produced by the fuel at zero percent excess air.

0.209 = Fraction of air that is  $\text{O}_2$ , percent/100.

$F_d$  = Ratio of the volume of dry effluent gas to the gross calorific value of the fuel from Method 19,  $\text{dsm}^3/\text{J}$  ( $\text{dscf}/10^6 \text{ Btu}$ ).

$F_c$  = Ratio of the volume of CO<sub>2</sub> produced to the gross calorific value of the fuel from Method 19, dsm<sup>3</sup>/J (dscf/10<sup>6</sup> Btu).

(ii) Calculate the CO<sub>2</sub> correction factor for correcting measurement data to 15 percent O<sub>2</sub>, as follows:

$$X_{CO_2} = \frac{5.9}{F_c} \quad (\text{Eq. 5})$$

[View or download PDF](#)

Where:

$X_{CO_2}$  = CO<sub>2</sub> correction factor, percent.

5.9 = 20.9 percent O<sub>2</sub>–15 percent O<sub>2</sub>, the defined O<sub>2</sub> correction value, percent.

(iii) Calculate the NO<sub>x</sub> and PM gas concentrations adjusted to 15 percent O<sub>2</sub> using CO<sub>2</sub> as follows:

$$C_{adj} = C_d \frac{X_{CO_2}}{\%CO_2} \quad (\text{Eq. 6})$$

[View or download PDF](#)

Where:

$C_{adj}$  = Calculated NO<sub>x</sub> or PM concentration adjusted to 15 percent O<sub>2</sub>.

$C_d$  = Measured concentration of NO<sub>x</sub> or PM, uncorrected.

%CO<sub>2</sub> = Measured CO<sub>2</sub> concentration, dry basis, percent.

(e) To determine compliance with the NO<sub>x</sub> mass per unit output emission limitation, convert the concentration of NO<sub>x</sub> in the engine exhaust using Equation 7 of this section:

$$ER = \frac{C_d \times 1.912 \times 10^{-3} \times Q \times T}{KW\text{-hour}} \quad (\text{Eq. 7})$$

[View or download PDF](#)

Where:

ER = Emission rate in grams per KW-hour.

$C_d$  = Measured NO<sub>x</sub> concentration in ppm.

$1.912 \times 10^{-3}$  = Conversion constant for ppm NO<sub>x</sub> to grams per standard cubic meter at 25 degrees Celsius.

Q = Stack gas volumetric flow rate, in standard cubic meter per hour.

T = Time of test run, in hours.

KW-hour = Brake work of the engine, in KW-hour.

(f) To determine compliance with the PM mass per unit output emission limitation, convert the concentration of PM in the engine exhaust using Equation 8 of this section:

$$ER = \frac{C_{adj} \times Q \times T}{KW\text{-hour}} \quad (\text{Eq 8})$$

[View or download PDF](#)

Where:

ER = Emission rate in grams per KW-hour.

$C_{adj}$  = Calculated PM concentration in grams per standard cubic meter.

Q = Stack gas volumetric flow rate, in standard cubic meter per hour.

T = Time of test run, in hours.

KW-hour = Energy output of the engine, in KW.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

[↑ Back to Top](#)

## NOTIFICATION, REPORTS, AND RECORDS FOR OWNERS AND OPERATORS

[↑ Back to Top](#)

### **§60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) Owners and operators of non-emergency stationary CI ICE that are greater than 2,237 KW (3,000 HP), or have a displacement of greater than or equal to 10 liters per cylinder, or are pre-2007 model year engines that are greater than 130 KW (175 HP) and not certified, must meet the requirements of paragraphs (a)(1) and (2) of this section.

(1) Submit an initial notification as required in §60.7(a)(1). The notification must include the information in paragraphs (a)(1)(i) through (v) of this section.

(i) Name and address of the owner or operator;

(ii) The address of the affected source;

(iii) Engine information including make, model, engine family, serial number, model year, maximum engine power, and engine displacement;

(iv) Emission control equipment; and

(v) Fuel used.

(2) Keep records of the information in paragraphs (a)(2)(i) through (iv) of this section.

(i) All notifications submitted to comply with this subpart and all documentation supporting any notification.

(ii) Maintenance conducted on the engine.

(iii) If the stationary CI internal combustion is a certified engine, documentation from the manufacturer that the engine is certified to meet the emission standards.

(iv) If the stationary CI internal combustion is not a certified engine, documentation that the engine meets the emission standards.

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

(c) If the stationary CI internal combustion engine is equipped with a diesel particulate filter, the owner or operator must keep records of any corrective action taken after the backpressure monitor has notified the owner or operator that the high backpressure limit of the engine is approached.

(d) If you own or operate an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §60.4211(f)(2)(ii) and (iii) or that operates for the purposes specified in §60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (d)(1) through (3) of this section.

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v) Hours operated for the purposes specified in §60.4211(f)(2)(ii) and (iii), including the date, start time, and end time for engine operation for the purposes specified in §60.4211(f)(2)(ii) and (iii).

(vi) Number of hours the engine is contractually obligated to be available for the purposes specified in §60.4211(f)(2)(ii) and (iii).

(vii) Hours spent for operation for the purposes specified in §60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in §60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in §60.4.

(e) Owners or operators of stationary CI ICE equipped with AECDs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECDs as required by 40 CFR 1039.665(e).

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

[↑ Back to Top](#)

## SPECIAL REQUIREMENTS

[↑ Back to Top](#)

### **§60.4215 What requirements must I meet for engines used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands?**

(a) Stationary CI ICE with a displacement of less than 30 liters per cylinder that are used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands are required to meet the applicable emission standards in §§60.4202 and 60.4205.

(b) Stationary CI ICE that are used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands are not required to meet the fuel requirements in §60.4207.

(c) Stationary CI ICE with a displacement of greater than or equal to 30 liters per cylinder that are used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands are required to meet the following emission standards:

(1) For engines installed prior to January 1, 2012, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 17.0 g/KW-hr (12.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $45 \cdot n^{-0.2}$  g/KW-hr ( $34 \cdot n^{-0.2}$  g/HP-hr) when maximum engine speed is 130 or more but less than 2,000 rpm, where n is maximum engine speed; and

(iii) 9.8 g/KW-hr (7.3 g/HP-hr) when maximum engine speed is 2,000 rpm or more.

(2) For engines installed on or after January 1, 2012, limit the emissions of NO<sub>x</sub> in the stationary CI internal combustion engine exhaust to the following:

(i) 14.4 g/KW-hr (10.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii)  $44 \cdot n^{-0.23}$  g/KW-hr ( $33 \cdot n^{-0.23}$  g/HP-hr) when maximum engine speed is greater than or equal to 130 but less than 2,000 rpm and where n is maximum engine speed; and

(iii) 7.7 g/KW-hr (5.7 g/HP-hr) when maximum engine speed is greater than or equal to 2,000 rpm.

(3) Limit the emissions of PM in the stationary CI internal combustion engine exhaust to 0.40 g/KW-hr (0.30 g/HP-hr).

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

[↑ Back to Top](#)

### **§60.4216 What requirements must I meet for engines used in Alaska?**

(a) Prior to December 1, 2010, owners and operators of stationary CI ICE with a displacement of less than 30 liters per cylinder located in areas of Alaska not accessible by the FAHS should refer to 40 CFR part 69 to determine the diesel fuel requirements applicable to such engines.

(b) Except as indicated in paragraph (c) of this section, manufacturers, owners and operators of stationary CI ICE with a displacement of less than 10 liters per cylinder located in remote areas of Alaska may meet the requirements of this subpart by manufacturing and installing engines meeting the requirements of 40 CFR parts 94 or 1042, as appropriate, rather than the otherwise applicable requirements of 40 CFR parts 89 and 1039, as indicated in §§60.4201(f) and 60.4202(g).

(c) Manufacturers, owners, and operators of stationary CI ICE that are located in remote areas of Alaska may choose to meet the applicable emission standards for emergency engines in §§60.4202 and 60.4205, and not those for non-emergency engines in §§60.4201 and 60.4204, except that for 2014 model year and later non-emergency CI ICE, the owner or operator of any such engine must have that engine certified as meeting at least the Tier 3 PM standards in 40 CFR 89.112 or 40 CFR 1042.101.

(d) The provisions of §60.4207 do not apply to owners and operators of pre-2014 model year stationary CI ICE subject to this subpart that are located in remote areas of Alaska.

(e) The provisions of §60.4208(a) do not apply to owners and operators of stationary CI ICE subject to this subpart that are located in areas of Alaska not accessible by the FAHS until after December 31, 2009.

(f) The provisions of this section and §60.4207 do not prevent owners and operators of stationary CI ICE subject to this subpart that are located in remote areas of Alaska from using fuels mixed with used lubricating oil, in volumes of up to 1.75 percent of the total fuel. The sulfur content of the used lubricating oil must be less than 200 parts per million. The used lubricating oil must meet the on-specification levels and properties for used oil in 40 CFR 279.11.

[76 FR 37971, June 28, 2011, as amended at 81 FR 44219, July 7, 2016; 84 FR 61568, Nov. 13, 2019]

[↑ Back to Top](#)



### **§60.4217 What emission standards must I meet if I am an owner or operator of a stationary internal combustion engine using special fuels?**

Owners and operators of stationary CI ICE that do not use diesel fuel may petition the Administrator for approval of alternative emission standards, if they can demonstrate that they use a fuel that is not the fuel on which the manufacturer of the engine certified the engine and that the engine cannot meet the applicable standards required in §60.4204 or §60.4205 using such fuels and that use of such fuel is appropriate and reasonably necessary, considering cost, energy, technical feasibility, human health and environmental, and other factors, for the operation of the engine.

[76 FR 37972, June 28, 2011]

[↑ Back to Top](#)

## **GENERAL PROVISIONS**

[↑ Back to Top](#)

### **§60.4218 What parts of the General Provisions apply to me?**

Table 8 to this subpart shows which parts of the General Provisions in §§60.1 through 60.19 apply to you.

[↑ Back to Top](#)

## **DEFINITIONS**

[↑ Back to Top](#)

### **§60.4219 What definitions apply to this subpart?**

As used in this subpart, all terms not defined herein shall have the meaning given them in the CAA and in subpart A of this part.

*Alaska Railbelt Grid* means the service areas of the six regulated public utilities that extend from Fairbanks to Anchorage and the Kenai Peninsula. These utilities are Golden Valley Electric Association; Chugach Electric Association; Matanuska Electric Association; Homer Electric Association; Anchorage Municipal Light & Power; and the City of Seward Electric System.

*Certified emissions life* means the period during which the engine is designed to properly function in terms of reliability and fuel consumption, without being remanufactured, specified as a number of hours of operation or calendar years, whichever comes first. The values for certified emissions life for stationary CI ICE with a displacement of less than 10 liters per cylinder are given in 40 CFR 1039.101(g). The values for certified emissions life for stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder are given in 40 CFR 94.9(a).

*Combustion turbine* means all equipment, including but not limited to the turbine, the fuel, air, lubrication and exhaust gas systems, control systems (except emissions control equipment), and any ancillary components and sub-components comprising any simple cycle combustion turbine, any

regenerative/recuperative cycle combustion turbine, the combustion turbine portion of any cogeneration cycle combustion system, or the combustion turbine portion of any combined cycle steam/electric generating system.

*Compression ignition* means relating to a type of stationary internal combustion engine that is not a spark ignition engine.

*Date of manufacture* means one of the following things:

(1) For freshly manufactured engines and modified engines, date of manufacture means the date the engine is originally produced.

(2) For reconstructed engines, date of manufacture means the date the engine was originally produced, except as specified in paragraph (3) of this definition.

(3) Reconstructed engines are assigned a new date of manufacture if the fixed capital cost of the new and refurbished components exceeds 75 percent of the fixed capital cost of a comparable entirely new facility. An engine that is produced from a previously used engine block does not retain the date of manufacture of the engine in which the engine block was previously used if the engine is produced using all new components except for the engine block. In these cases, the date of manufacture is the date of reconstruction or the date the new engine is produced.

*Diesel fuel* means any liquid obtained from the distillation of petroleum with a boiling point of approximately 150 to 360 degrees Celsius. One commonly used form is number 2 distillate oil.

*Diesel particulate filter* means an emission control technology that reduces PM emissions by trapping the particles in a flow filter substrate and periodically removes the collected particles by either physical action or by oxidizing (burning off) the particles in a process called regeneration.

*Emergency stationary internal combustion engine* means any stationary reciprocating internal combustion engine that meets all of the criteria in paragraphs (1) through (3) of this definition. All emergency stationary ICE must comply with the requirements specified in §60.4211(f) in order to be considered emergency stationary ICE. If the engine does not comply with the requirements specified in §60.4211(f), then it is not considered to be an emergency stationary ICE under this subpart.

(1) The stationary ICE is operated to provide electrical power or mechanical work during an emergency situation. Examples include stationary ICE used to produce power for critical networks or equipment (including power supplied to portions of a facility) when electric power from the local utility (or the normal power source, if the facility runs on its own power production) is interrupted, or stationary ICE used to pump water in the case of fire or flood, etc.

(2) The stationary ICE is operated under limited circumstances for situations not included in paragraph (1) of this definition, as specified in §60.4211(f).

(3) The stationary ICE operates as part of a financial arrangement with another entity in situations not included in paragraph (1) of this definition only as allowed in §60.4211(f)(2)(ii) or (iii) and §60.4211(f)(3)(i).

*Engine manufacturer* means the manufacturer of the engine. See the definition of "manufacturer" in this section.

*Fire pump engine* means an emergency stationary internal combustion engine certified to NFPA requirements that is used to provide power to pump water for fire suppression or protection.

*Freshly manufactured engine* means an engine that has not been placed into service. An engine becomes freshly manufactured when it is originally produced.

*Installed* means the engine is placed and secured at the location where it is intended to be operated.

*Manufacturer* has the meaning given in section 216(1) of the Act. In general, this term includes any person who manufactures a stationary engine for sale in the United States or otherwise introduces a new stationary engine into commerce in the United States. This includes importers who import stationary engines for sale or resale.

*Maximum engine power* means maximum engine power as defined in 40 CFR 1039.801.

*Model year* means the calendar year in which an engine is manufactured (see “date of manufacture”), except as follows:

(1) Model year means the annual new model production period of the engine manufacturer in which an engine is manufactured (see “date of manufacture”), if the annual new model production period is different than the calendar year and includes January 1 of the calendar year for which the model year is named. It may not begin before January 2 of the previous calendar year and it must end by December 31 of the named calendar year.

(2) For an engine that is converted to a stationary engine after being placed into service as a nonroad or other non-stationary engine, model year means the calendar year or new model production period in which the engine was manufactured (see “date of manufacture”).

*Other internal combustion engine* means any internal combustion engine, except combustion turbines, which is not a reciprocating internal combustion engine or rotary internal combustion engine.

*Reciprocating internal combustion engine* means any internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work.

*Remote areas of Alaska* means areas of Alaska that meet either paragraph (1) or (2) of this definition.

(1) Areas of Alaska that are not accessible by the Federal Aid Highway System (FAHS).

(2) Areas of Alaska that meet all of the following criteria:

(i) The only connection to the FAHS is through the Alaska Marine Highway System, or the stationary CI ICE operation is within an isolated grid in Alaska that is not connected to the statewide electrical grid referred to as the Alaska Railbelt Grid.

(ii) At least 10 percent of the power generated by the stationary CI ICE on an annual basis is used for residential purposes.

(iii) The generating capacity of the source is less than 12 megawatts, or the stationary CI ICE is used exclusively for backup power for renewable energy.

*Rotary internal combustion engine* means any internal combustion engine which uses rotary motion to convert heat energy into mechanical work.

*Spark ignition* means relating to a gasoline, natural gas, or liquefied petroleum gas fueled engine or any other type of engine with a spark plug (or other sparking device) and with operating characteristics significantly similar to the theoretical Otto combustion cycle. Spark ignition engines usually use a throttle to regulate intake air flow to control power during normal operation. Dual-fuel engines in which a liquid fuel (typically diesel fuel) is used for CI and gaseous fuel (typically natural gas) is used as the primary fuel at an annual average ratio of less than 2 parts diesel fuel to 100 parts total fuel on an energy equivalent basis are spark ignition engines.

*Stationary internal combustion engine* means any internal combustion engine, except combustion turbines, that converts heat energy into mechanical work and is not mobile. Stationary ICE differ from mobile ICE in that a stationary internal combustion engine is not a nonroad engine as defined at 40 CFR 1068.30 (excluding paragraph (2)(ii) of that definition), and is not used to propel a motor vehicle, aircraft, or a vehicle used solely for competition. Stationary ICE include reciprocating ICE, rotary ICE, and other ICE, except combustion turbines.

*Subpart* means 40 CFR part 60, subpart IIII.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37972, June 28, 2011; 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

[↑ Back to Top](#)

**Table 1 to Subpart IIII of Part 60—Emission Standards for Stationary Pre-2007 Model Year Engines With a Displacement of <10 Liters per Cylinder and 2007-2010 Model Year Engines >2,237 KW (3,000 HP) and With a Displacement of <10 Liters per Cylinder**

[As stated in §§60.4201(b), 60.4202(b), 60.4204(a), and 60.4205(a), you must comply with the following emission standards]

| Maximum engine power   | Emission standards for stationary pre-2007 model year engines with a displacement of <10 liters per cylinder and 2007-2010 model year engines >2,237 KW (3,000 HP) and with a displacement of <10 liters per cylinder in g/KW-hr (g/HP-hr) |    |                 |           |             |
|------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----|-----------------|-----------|-------------|
|                        | NMHC + NO <sub>x</sub>                                                                                                                                                                                                                     | HC | NO <sub>x</sub> | CO        | PM          |
| KW<8 (HP<11)           | 10.5 (7.8)                                                                                                                                                                                                                                 |    |                 | 8.0 (6.0) | 1.0 (0.75)  |
| 8≤KW<19<br>(11≤HP<25)  | 9.5 (7.1)                                                                                                                                                                                                                                  |    |                 | 6.6 (4.9) | 0.80 (0.60) |
| 19≤KW<37<br>(25≤HP<50) | 9.5 (7.1)                                                                                                                                                                                                                                  |    |                 | 5.5 (4.1) | 0.80 (0.60) |
| 37≤KW<56               |                                                                                                                                                                                                                                            |    | 9.2 (6.9)       |           |             |

|                            |  |           |           |            |             |
|----------------------------|--|-----------|-----------|------------|-------------|
| (50≤HP<75)                 |  |           |           |            |             |
| 56≤KW<75<br>(75≤HP<100)    |  |           | 9.2 (6.9) |            |             |
| 75≤KW<130<br>(100≤HP<175)  |  |           | 9.2 (6.9) |            |             |
| 130≤KW<225<br>(175≤HP<300) |  | 1.3 (1.0) | 9.2 (6.9) | 11.4 (8.5) | 0.54 (0.40) |
| 225≤KW<450<br>(300≤HP<600) |  | 1.3 (1.0) | 9.2 (6.9) | 11.4 (8.5) | 0.54 (0.40) |
| 450≤KW≤560<br>(600≤HP≤750) |  | 1.3 (1.0) | 9.2 (6.9) | 11.4 (8.5) | 0.54 (0.40) |
| KW>560<br>(HP>750)         |  | 1.3 (1.0) | 9.2 (6.9) | 11.4 (8.5) | 0.54 (0.40) |

[↑ Back to Top](#)

**Table 2 to Subpart IIII of Part 60—Emission Standards for 2008 Model Year and Later Emergency Stationary CI ICE <37 KW (50 HP) With a Displacement of <10 Liters per Cylinder**

[As stated in §60.4202(a)(1), you must comply with the following emission standards]

| Engine power           | Emission standards for 2008 model year and later emergency stationary CI ICE <37 KW (50 HP) with a displacement of <10 liters per cylinder in g/KW-hr (g/HP-hr) |                        |           |             |
|------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------|-----------|-------------|
|                        | Model year(s)                                                                                                                                                   | NO <sub>x</sub> + NMHC | CO        | PM          |
| KW<8 (HP<11)           | 2008 +                                                                                                                                                          | 7.5 (5.6)              | 8.0 (6.0) | 0.40 (0.30) |
| 8≤KW<19<br>(11≤HP<25)  | 2008 +                                                                                                                                                          | 7.5 (5.6)              | 6.6 (4.9) | 0.40 (0.30) |
| 19≤KW<37<br>(25≤HP<50) | 2008 +                                                                                                                                                          | 7.5 (5.6)              | 5.5 (4.1) | 0.30 (0.22) |

[↑ Back to Top](#)

**Table 3 to Subpart IIII of Part 60—Certification Requirements for Stationary Fire Pump Engines**

As stated in §60.4202(d), you must certify new stationary fire pump engines beginning with the following model years:

| Engine power | Starting model year engine manufacturers must certify new |
|--------------|-----------------------------------------------------------|
|--------------|-----------------------------------------------------------|

|                            | <b>stationary<br/>fire pump<br/>engines<br/>according to<br/>§60.4202(d)<sup>1</sup></b> |
|----------------------------|------------------------------------------------------------------------------------------|
| KW<75<br>(HP<100)          | 2011                                                                                     |
| 75≤KW<130<br>(100≤HP<175)  | 2010                                                                                     |
| 130≤KW≤560<br>(175≤HP≤750) | 2009                                                                                     |
| KW>560<br>(HP>750)         | 2008                                                                                     |

<sup>1</sup>Manufacturers of fire pump stationary CI ICE with a maximum engine power greater than or equal to 37 kW (50 HP) and less than 450 kW (600 HP) and a rated speed of greater than 2,650 revolutions per minute (rpm) are not required to certify such engines until three model years following the model year indicated in this Table 3 for engines in the applicable engine power category.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37972, June 28, 2011]

[↑ Back to Top](#)

#### **Table 4 to Subpart IIII of Part 60—Emission Standards for Stationary Fire Pump Engines**

[As stated in §§60.4202(d) and 60.4205(c), you must comply with the following emission standards for stationary fire pump engines]

| <b>Maximum engine power</b> | <b>Model year(s)</b> | <b>NMHC + NO<sub>x</sub></b> | <b>CO</b> | <b>PM</b>   |
|-----------------------------|----------------------|------------------------------|-----------|-------------|
| KW<8 (HP<11)                | 2010 and earlier     | 10.5 (7.8)                   | 8.0 (6.0) | 1.0 (0.75)  |
|                             | 2011 +               | 7.5 (5.6)                    |           | 0.40 (0.30) |
| 8≤KW<19 (11≤HP<25)          | 2010 and earlier     | 9.5 (7.1)                    | 6.6 (4.9) | 0.80 (0.60) |
|                             | 2011 +               | 7.5 (5.6)                    |           | 0.40 (0.30) |
| 19≤KW<37 (25≤HP<50)         | 2010 and earlier     | 9.5 (7.1)                    | 5.5 (4.1) | 0.80 (0.60) |
|                             | 2011 +               | 7.5 (5.6)                    |           | 0.30 (0.22) |
| 37≤KW<56 (50≤HP<75)         | 2010 and earlier     | 10.5 (7.8)                   | 5.0 (3.7) | 0.80 (0.60) |
|                             | 2011 + <sup>1</sup>  | 4.7 (3.5)                    |           | 0.40 (0.30) |
| 56≤KW<75 (75≤HP<100)        | 2010 and earlier     | 10.5 (7.8)                   | 5.0 (3.7) | 0.80 (0.60) |

|                         |                     |            |           |             |
|-------------------------|---------------------|------------|-----------|-------------|
|                         | 2011 + <sup>1</sup> | 4.7 (3.5)  |           | 0.40 (0.30) |
| 75≤KW<130 (100≤HP<175)  | 2009 and earlier    | 10.5 (7.8) | 5.0 (3.7) | 0.80 (0.60) |
|                         | 2010 + <sup>2</sup> | 4.0 (3.0)  |           | 0.30 (0.22) |
| 130≤KW<225 (175≤HP<300) | 2008 and earlier    | 10.5 (7.8) | 3.5 (2.6) | 0.54 (0.40) |
|                         | 2009 + <sup>3</sup> | 4.0 (3.0)  |           | 0.20 (0.15) |
| 225≤KW<450 (300≤HP<600) | 2008 and earlier    | 10.5 (7.8) | 3.5 (2.6) | 0.54 (0.40) |
|                         | 2009 + <sup>3</sup> | 4.0 (3.0)  |           | 0.20 (0.15) |
| 450≤KW≤560 (600≤HP≤750) | 2008 and earlier    | 10.5 (7.8) | 3.5 (2.6) | 0.54 (0.40) |
|                         | 2009 +              | 4.0 (3.0)  |           | 0.20 (0.15) |
| KW>560 (HP>750)         | 2007 and earlier    | 10.5 (7.8) | 3.5 (2.6) | 0.54 (0.40) |
|                         | 2008 +              | 6.4 (4.8)  |           | 0.20 (0.15) |

<sup>1</sup>For model years 2011-2013, manufacturers, owners and operators of fire pump stationary CI ICE in this engine power category with a rated speed of greater than 2,650 revolutions per minute (rpm) may comply with the emission limitations for 2010 model year engines.

<sup>2</sup>For model years 2010-2012, manufacturers, owners and operators of fire pump stationary CI ICE in this engine power category with a rated speed of greater than 2,650 rpm may comply with the emission limitations for 2009 model year engines.

<sup>3</sup>In model years 2009-2011, manufacturers of fire pump stationary CI ICE in this engine power category with a rated speed of greater than 2,650 rpm may comply with the emission limitations for 2008 model year engines.

[↑ Back to Top](#)

#### **Table 5 to Subpart IIII of Part 60—Labeling and Recordkeeping Requirements for New Stationary Emergency Engines**

[You must comply with the labeling requirements in §60.4210(f) and the recordkeeping requirements in §60.4214(b) for new emergency stationary CI ICE beginning in the following model years:]

| <b>Engine power</b>   | <b>Starting model year</b> |
|-----------------------|----------------------------|
| 19≤KW<56 (25≤HP<75)   | 2013                       |
| 56≤KW<130 (75≤HP<175) | 2012                       |
| KW≥130 (HP≥175)       | 2011                       |

[↑ Back to Top](#)

**Table 6 to Subpart IIII of Part 60—Optional 3-Mode Test Cycle for Stationary Fire Pump Engines**

[As stated in §60.4210(g), manufacturers of fire pump engines may use the following test cycle for testing fire pump engines:]

| Mode No. | Engine speed <sup>1</sup> | Torque (percent) <sup>2</sup> | Weighting factors |
|----------|---------------------------|-------------------------------|-------------------|
| 1        | Rated                     | 100                           | 0.30              |
| 2        | Rated                     | 75                            | 0.50              |
| 3        | Rated                     | 50                            | 0.20              |

<sup>1</sup>Engine speed: ±2 percent of point.

<sup>2</sup>Torque: NFPA certified nameplate HP for 100 percent point. All points should be ±2 percent of engine percent load value.

[↑ Back to Top](#)

**Table 7 to Subpart IIII of Part 60—Requirements for Performance Tests for Stationary CI ICE With a Displacement of ≥30 Liters per Cylinder**

As stated in §60.4213, you must comply with the following requirements for performance tests for stationary CI ICE with a displacement of ≥30 liters per cylinder:

| Each                                                                                        | Complying with the requirement to                          | You must                                                                                                                   | Using | According to the following requirements                                                                                                                                                                                                                                                                                                                                                                                                |
|---------------------------------------------------------------------------------------------|------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------|-------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. Stationary CI internal combustion engine with a displacement of ≥ 30 liters per cylinder | a. Reduce NO <sub>x</sub> emissions by 90 percent or more; | i. Select the sampling port location and number/location of traverse points at the inlet and outlet of the control device; |       | (a) For NO <sub>x</sub> , O <sub>2</sub> , and moisture measurement, ducts ≤6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and ≤12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter <i>and</i> the sampling port location meets the two and half-diameter |



|  |                                                                                              |                                                                                                          |                                                                                                                                                           |                                                                                                                                                                                                                                                                                   |
|--|----------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |                                                                                              |                                                                                                          |                                                                                                                                                           | <p>criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, appendix A-1, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, appendix A-4.</p> |
|  |                                                                                              | <p>ii. Measure O<sub>2</sub> at the inlet and outlet of the control device;</p>                          | <p>(1) Method 3, 3A, or 3B of 40 CFR part 60, appendix A-2</p>                                                                                            | <p>(b) Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for NO<sub>x</sub> concentration.</p>                                                                                                                              |
|  |                                                                                              | <p>iii. If necessary, measure moisture content at the inlet and outlet of the control device; and</p>    | <p>(2) Method 4 of 40 CFR part 60, appendix A-3, Method 320 of 40 CFR part 63, appendix A, or ASTM D 6348-03 (incorporated by reference, see §60.17)</p>  | <p>(c) Measurements to determine moisture content must be made at the same time as the measurements for NO<sub>x</sub> concentration.</p>                                                                                                                                         |
|  |                                                                                              | <p>iv. Measure NO<sub>x</sub> at the inlet and outlet of the control device.</p>                         | <p>(3) Method 7E of 40 CFR part 60, appendix A-4, Method 320 of 40 CFR part 63, appendix A, or ASTM D 6348-03 (incorporated by reference, see §60.17)</p> | <p>(d) NO<sub>x</sub> concentration must be at 15 percent O<sub>2</sub>, dry basis. Results of this test consist of the average of the three 1-hour or longer runs.</p>                                                                                                           |
|  | <p>b. Limit the concentration of NO<sub>x</sub> in the stationary CI internal combustion</p> | <p>i. Select the sampling port location and number/location of traverse points at the exhaust of the</p> |                                                                                                                                                           | <p>(a) For NO<sub>x</sub>, O<sub>2</sub>, and moisture measurement, ducts ≤6 inches in diameter may be sampled at a single point located at the duct centroid and ducts</p>                                                                                                       |

|  |                 |                                                                                                                                     |                                                                                                                                                   |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
|--|-----------------|-------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | engine exhaust. | stationary internal combustion engine;                                                                                              |                                                                                                                                                   | >6 and ≤12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter <i>and</i> the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, appendix A-1, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, appendix A-4. |
|  |                 | ii. Determine the O <sub>2</sub> concentration of the stationary internal combustion engine exhaust at the sampling port location;  | (1) Method 3, 3A, or 3B of 40 CFR part 60, appendix A-2                                                                                           | (b) Measurements to determine O <sub>2</sub> concentration must be made at the same time as the measurement for NO <sub>x</sub> concentration.                                                                                                                                                                                                                                                                                                                                                                                           |
|  |                 | iii. If necessary, measure moisture content of the stationary internal combustion engine exhaust at the sampling port location; and | (2) Method 4 of 40 CFR part 60, appendix A-3, Method 320 of 40 CFR part 63, appendix A, or ASTM D 6348-03 (incorporated by reference, see §60.17) | (c) Measurements to determine moisture content must be made at the same time as the measurement for NO <sub>x</sub> concentration.                                                                                                                                                                                                                                                                                                                                                                                                       |
|  |                 | iv. Measure NO <sub>x</sub> at the exhaust of the stationary internal combustion engine; if using a control device, the             | (3) Method 7E of 40 CFR part 60, appendix A-4, Method 320 of 40 CFR part 63, appendix A,                                                          | (d) NO <sub>x</sub> concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs.                                                                                                                                                                                                                                                                                                                                                                      |

|  |                                                                                          |                                                                                                                                    |                                                           |                                                                                                                                                        |
|--|------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |                                                                                          | sampling site must be located at the outlet of the control device.                                                                 | or ASTM D 6348-03 (incorporated by reference, see §60.17) |                                                                                                                                                        |
|  | c. Reduce PM emissions by 60 percent or more                                             | i. Select the sampling port location and the number of traverse points;                                                            | (1) Method 1 or 1A of 40 CFR part 60, appendix A-1        | (a) Sampling sites must be located at the inlet and outlet of the control device.                                                                      |
|  |                                                                                          | ii. Measure O <sub>2</sub> at the inlet and outlet of the control device;                                                          | (2) Method 3, 3A, or 3B of 40 CFR part 60, appendix A-2   | (b) Measurements to determine O <sub>2</sub> concentration must be made at the same time as the measurements for PM concentration.                     |
|  |                                                                                          | iii. If necessary, measure moisture content at the inlet and outlet of the control device; and                                     | (3) Method 4 of 40 CFR part 60, appendix A-3              | (c) Measurements to determine and moisture content must be made at the same time as the measurements for PM concentration.                             |
|  |                                                                                          | iv. Measure PM at the inlet and outlet of the control device.                                                                      | (4) Method 5 of 40 CFR part 60, appendix A-3              | (d) PM concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs. |
|  | d. Limit the concentration of PM in the stationary CI internal combustion engine exhaust | i. Select the sampling port location and the number of traverse points;                                                            | (1) Method 1 or 1A of 40 CFR part 60, appendix A-1        | (a) If using a control device, the sampling site must be located at the outlet of the control device.                                                  |
|  |                                                                                          | ii. Determine the O <sub>2</sub> concentration of the stationary internal combustion engine exhaust at the sampling port location; | (2) Method 3, 3A, or 3B of 40 CFR part 60, appendix A-2   | (b) Measurements to determine O <sub>2</sub> concentration must be made at the same time as the measurements for PM concentration.                     |

|  |  |                                                                                                                                     |                                              |                                                                                                                                                        |
|--|--|-------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |  | iii. If necessary, measure moisture content of the stationary internal combustion engine exhaust at the sampling port location; and | (3) Method 4 of 40 CFR part 60, appendix A-3 | (c) Measurements to determine moisture content must be made at the same time as the measurements for PM concentration.                                 |
|  |  | iv. Measure PM at the exhaust of the stationary internal combustion engine.                                                         | (4) Method 5 of 40 CFR part 60, appendix A-3 | (d) PM concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs. |

[79 FR 11251, Feb. 27, 2014]

[↑ Back to Top](#)

**Table 8 to Subpart IIII of Part 60—Applicability of General Provisions to Subpart IIII**

[As stated in §60.4218, you must comply with the following applicable General Provisions:]

| <b>General Provisions citation</b> | <b>Subject of citation</b>                      | <b>Applies to subpart</b> | <b>Explanation</b>                                                                                                                      |
|------------------------------------|-------------------------------------------------|---------------------------|-----------------------------------------------------------------------------------------------------------------------------------------|
| §60.1                              | General applicability of the General Provisions | Yes                       |                                                                                                                                         |
| §60.2                              | Definitions                                     | Yes                       | Additional terms defined in §60.4219.                                                                                                   |
| §60.3                              | Units and abbreviations                         | Yes                       |                                                                                                                                         |
| §60.4                              | Address                                         | Yes                       |                                                                                                                                         |
| §60.5                              | Determination of construction or modification   | Yes                       |                                                                                                                                         |
| §60.6                              | Review of plans                                 | Yes                       |                                                                                                                                         |
| §60.7                              | Notification and Recordkeeping                  | Yes                       | Except that §60.7 only applies as specified in §60.4214(a).                                                                             |
| §60.8                              | Performance tests                               | Yes                       | Except that §60.8 only applies to stationary CI ICE with a displacement of (≥30 liters per cylinder and engines that are not certified. |
| §60.9                              | Availability of information                     | Yes                       |                                                                                                                                         |

|        |                                                        |     |                                                                                                               |
|--------|--------------------------------------------------------|-----|---------------------------------------------------------------------------------------------------------------|
| §60.10 | State Authority                                        | Yes |                                                                                                               |
| §60.11 | Compliance with standards and maintenance requirements | No  | Requirements are specified in subpart III.                                                                    |
| §60.12 | Circumvention                                          | Yes |                                                                                                               |
| §60.13 | Monitoring requirements                                | Yes | Except that §60.13 only applies to stationary CI ICE with a displacement of ( $\geq$ 30 liters per cylinder). |
| §60.14 | Modification                                           | Yes |                                                                                                               |
| §60.15 | Reconstruction                                         | Yes |                                                                                                               |
| §60.16 | Priority list                                          | Yes |                                                                                                               |
| §60.17 | Incorporations by reference                            | Yes |                                                                                                               |
| §60.18 | General control device requirements                    | No  |                                                                                                               |
| §60.19 | General notification and reporting requirements        | Yes |                                                                                                               |

[↑ Back to Top](#)

[Need assistance?](#)

Appendix E—40 CFR Part 63, Subpart ZZZZ

# Electronic Code of Federal Regulations

e-CFR data is current as of January 31, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 63](#) → Subpart ZZZZ

---

[Browse Next](#)

Title 40: Protection of Environment

[PART 63—NATIONAL EMISSION STANDARDS FOR HAZARDOUS AIR POLLUTANTS FOR SOURCE CATEGORIES \(CONTINUED\)](#)

---

## **Subpart ZZZZ—National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

---

### **Contents**

#### [WHAT THIS SUBPART COVERS](#)

[§63.6580](#) [What is the purpose of subpart ZZZZ?](#)

[§63.6585](#) [Am I subject to this subpart?](#)

[§63.6590](#) [What parts of my plant does this subpart cover?](#)

[§63.6595](#) [When do I have to comply with this subpart?](#)

#### [EMISSION AND OPERATING LIMITATIONS](#)

[§63.6600](#) [What emission limitations and operating limitations must I meet if I own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions?](#)

[§63.6601](#) [What emission limitations must I meet if I own or operate a new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 brake HP and less than or equal to 500 brake HP located at a major source of HAP emissions?](#)

[§63.6602](#) [What emission limitations and other requirements must I meet if I own or operate an existing stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions?](#)

[§63.6603](#) [What emission limitations, operating limitations, and other requirements must I meet if I own or operate an existing stationary RICE located at an area source of HAP emissions?](#)

[§63.6604](#) [What fuel requirements must I meet if I own or operate a stationary CI RICE?](#)

#### [GENERAL COMPLIANCE REQUIREMENTS](#)

[§63.6605](#) [What are my general requirements for complying with this subpart?](#)

#### [TESTING AND INITIAL COMPLIANCE REQUIREMENTS](#)

[§63.6610 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions?](#)

[§63.6611 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate a new or reconstructed 4SLB SI stationary RICE with a site rating of greater than or equal to 250 and less than or equal to 500 brake HP located at a major source of HAP emissions?](#)

[§63.6612 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate an existing stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing stationary RICE located at an area source of HAP emissions?](#)

[§63.6615 When must I conduct subsequent performance tests?](#)

[§63.6620 What performance tests and other procedures must I use?](#)

[§63.6625 What are my monitoring, installation, collection, operation, and maintenance requirements?](#)

[§63.6630 How do I demonstrate initial compliance with the emission limitations, operating limitations, and other requirements?](#)

#### CONTINUOUS COMPLIANCE REQUIREMENTS

[§63.6635 How do I monitor and collect data to demonstrate continuous compliance?](#)

[§63.6640 How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?](#)

#### NOTIFICATIONS, REPORTS, AND RECORDS

[§63.6645 What notifications must I submit and when?](#)

[§63.6650 What reports must I submit and when?](#)

[§63.6655 What records must I keep?](#)

[§63.6660 In what form and how long must I keep my records?](#)

#### OTHER REQUIREMENTS AND INFORMATION

[§63.6665 What parts of the General Provisions apply to me?](#)

[§63.6670 Who implements and enforces this subpart?](#)

[§63.6675 What definitions apply to this subpart?](#)

[Table 1a to Subpart ZZZZ of Part 63—Emission Limitations for Existing, New, and Reconstructed Spark Ignition, 4SRB Stationary RICE >500 HP Located at a Major Source of HAP Emissions](#)

[Table 1b to Subpart ZZZZ of Part 63—Operating Limitations for Existing, New, and Reconstructed SI 4SRB Stationary RICE >500 HP Located at a Major Source of HAP Emissions](#)

[Table 2a to Subpart ZZZZ of Part 63—Emission Limitations for New and Reconstructed 2SLB and Compression Ignition Stationary RICE >500 HP and New and Reconstructed 4SLB Stationary RICE  \$\geq\$ 250 HP Located at a Major Source of HAP Emissions](#)

[Table 2b to Subpart ZZZZ of Part 63—Operating Limitations for New and Reconstructed 2SLB and CI Stationary RICE >500 HP Located at a Major Source of HAP Emissions, New and Reconstructed 4SLB Stationary RICE  \$\geq\$ 250 HP Located at a Major Source of HAP Emissions, Existing CI Stationary RICE >500 HP](#)

[Table 2c to Subpart ZZZZ of Part 63—Requirements for Existing Compression Ignition Stationary RICE Located at a Major Source of HAP Emissions and Existing Spark Ignition Stationary RICE  \$\leq\$ 500 HP Located at a Major Source of HAP Emissions](#)

[Table 2d to Subpart ZZZZ of Part 63—Requirements for Existing Stationary RICE Located at Area Sources of HAP Emissions](#)



[Table 3 to Subpart ZZZZ of Part 63—Subsequent Performance Tests](#)  
[Table 4 to Subpart ZZZZ of Part 63—Requirements for Performance Tests](#)  
[Table 5 to Subpart ZZZZ of Part 63—Initial Compliance With Emission Limitations, Operating Limitations, and Other Requirements](#)  
[Table 6 to Subpart ZZZZ of Part 63—Continuous Compliance With Emission Limitations, and Other Requirements](#)  
[Table 7 to Subpart ZZZZ of Part 63—Requirements for Reports](#)  
[Table 8 to Subpart ZZZZ of Part 63—Applicability of General Provisions to Subpart ZZZZ.](#)  
[Appendix A to Subpart ZZZZ of Part 63—Protocol for Using an Electrochemical Analyzer to Determine Oxygen and Carbon Monoxide Concentrations From Certain Engines](#)

---

SOURCE: 69 FR 33506, June 15, 2004, unless otherwise noted.

[↑ Back to Top](#)

## WHAT THIS SUBPART COVERS

[↑ Back to Top](#)

### §63.6580 What is the purpose of subpart ZZZZ?

Subpart ZZZZ establishes national emission limitations and operating limitations for hazardous air pollutants (HAP) emitted from stationary reciprocating internal combustion engines (RICE) located at major and area sources of HAP emissions. This subpart also establishes requirements to demonstrate initial and continuous compliance with the emission limitations and operating limitations.

[73 FR 3603, Jan. 18, 2008]

[↑ Back to Top](#)

### §63.6585 Am I subject to this subpart?

You are subject to this subpart if you own or operate a stationary RICE at a major or area source of HAP emissions, except if the stationary RICE is being tested at a stationary RICE test cell/stand.

(a) A stationary RICE is any internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work and which is not mobile. Stationary RICE differ from mobile RICE in that a stationary RICE is not a non-road engine as defined at 40 CFR 1068.30, and is not used to propel a motor vehicle or a vehicle used solely for competition.

(b) A major source of HAP emissions is a plant site that emits or has the potential to emit any single HAP at a rate of 10 tons (9.07 megagrams) or more per year or any combination of HAP at a rate of 25 tons (22.68 megagrams) or more per year, except that for oil and gas production facilities, a major source of HAP emissions is determined for each surface site.

(c) An area source of HAP emissions is a source that is not a major source.

(d) If you are an owner or operator of an area source subject to this subpart, your status as an entity subject to a standard or other requirements under this subpart does not subject you to the obligation to obtain a permit under 40 CFR part 70 or 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart as applicable.

(e) If you are an owner or operator of a stationary RICE used for national security purposes, you may be eligible to request an exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C.

(f) The emergency stationary RICE listed in paragraphs (f)(1) through (3) of this section are not subject to this subpart. The stationary RICE must meet the definition of an emergency stationary RICE in §63.6675, which includes operating according to the provisions specified in §63.6640(f).

(1) Existing residential emergency stationary RICE located at an area source of HAP emissions that do not operate or are not contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii) and that do not operate for the purpose specified in §63.6640(f)(4)(ii).

(2) Existing commercial emergency stationary RICE located at an area source of HAP emissions that do not operate or are not contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii) and that do not operate for the purpose specified in §63.6640(f)(4)(ii).

(3) Existing institutional emergency stationary RICE located at an area source of HAP emissions that do not operate or are not contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii) and that do not operate for the purpose specified in §63.6640(f)(4)(ii).

[69 FR 33506, June 15, 2004, as amended at 73 FR 3603, Jan. 18, 2008; 78 FR 6700, Jan. 30, 2013]

 [Back to Top](#)

### **§63.6590 What parts of my plant does this subpart cover?**

This subpart applies to each affected source.

(a) *Affected source.* An affected source is any existing, new, or reconstructed stationary RICE located at a major or area source of HAP emissions, excluding stationary RICE being tested at a stationary RICE test cell/stand.

(1) *Existing stationary RICE.*

(i) For stationary RICE with a site rating of more than 500 brake horsepower (HP) located at a major source of HAP emissions, a stationary RICE is existing if you commenced construction or reconstruction of the stationary RICE before December 19, 2002.

(ii) For stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, a stationary RICE is existing if you commenced construction or reconstruction of the stationary RICE before June 12, 2006.

(iii) For stationary RICE located at an area source of HAP emissions, a stationary RICE is existing if you commenced construction or reconstruction of the stationary RICE before June 12, 2006.

(iv) A change in ownership of an existing stationary RICE does not make that stationary RICE a new or reconstructed stationary RICE.

(2) *New stationary RICE.* (i) A stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions is new if you commenced construction of the stationary RICE on or after December 19, 2002.

(ii) A stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions is new if you commenced construction of the stationary RICE on or after June 12, 2006.

(iii) A stationary RICE located at an area source of HAP emissions is new if you commenced construction of the stationary RICE on or after June 12, 2006.

(3) *Reconstructed stationary RICE.* (i) A stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions is reconstructed if you meet the definition of reconstruction in §63.2 and reconstruction is commenced on or after December 19, 2002.

(ii) A stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions is reconstructed if you meet the definition of reconstruction in §63.2 and reconstruction is commenced on or after June 12, 2006.

(iii) A stationary RICE located at an area source of HAP emissions is reconstructed if you meet the definition of reconstruction in §63.2 and reconstruction is commenced on or after June 12, 2006.

(b) *Stationary RICE subject to limited requirements.* (1) An affected source which meets either of the criteria in paragraphs (b)(1)(i) through (ii) of this section does not have to meet the requirements of this subpart and of subpart A of this part except for the initial notification requirements of §63.6645(f).

(i) The stationary RICE is a new or reconstructed emergency stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions that does not operate or is not contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii).

(ii) The stationary RICE is a new or reconstructed limited use stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions.

(2) A new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis must meet the initial notification requirements of §63.6645(f) and the requirements of §§63.6625(c), 63.6650(g), and 63.6655(c). These stationary RICE do not have to meet the emission limitations and operating limitations of this subpart.

(3) The following stationary RICE do not have to meet the requirements of this subpart and of subpart A of this part, including initial notification requirements:

(i) Existing spark ignition 2 stroke lean burn (2SLB) stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions;

(ii) Existing spark ignition 4 stroke lean burn (4SLB) stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions;

(iii) Existing emergency stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions that does not operate or is not contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii).

(iv) Existing limited use stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions;

(v) Existing stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis;

(c) *Stationary RICE subject to Regulations under 40 CFR Part 60.* An affected source that meets any of the criteria in paragraphs (c)(1) through (7) of this section must meet the requirements of this part by meeting the requirements of 40 CFR part 60 subpart IIII, for compression ignition engines or 40 CFR part 60 subpart JJJJ, for spark ignition engines. No further requirements apply for such engines under this part.

(1) A new or reconstructed stationary RICE located at an area source;

(2) A new or reconstructed 2SLB stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions;

(3) A new or reconstructed 4SLB stationary RICE with a site rating of less than 250 brake HP located at a major source of HAP emissions;

(4) A new or reconstructed spark ignition 4 stroke rich burn (4SRB) stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions;

(5) A new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis;

(6) A new or reconstructed emergency or limited use stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions;

(7) A new or reconstructed compression ignition (CI) stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9674, Mar. 3, 2010; 75 FR 37733, June 30, 2010; 75 FR 51588, Aug. 20, 2010; 78 FR 6700, Jan. 30, 2013]

 [Back to Top](#)

### **§63.6595 When do I have to comply with this subpart?**

(a) *Affected sources.* (1) If you have an existing stationary RICE, excluding existing non-emergency CI stationary RICE, with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must comply with the applicable emission limitations, operating limitations and other requirements no later than June 15, 2007. If you have an existing non-emergency CI stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, an existing stationary CI RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, or an existing stationary CI RICE located at an area source of HAP emissions, you must comply with the applicable emission limitations, operating limitations, and other requirements no later than May 3, 2013. If you have an existing stationary SI RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, or an existing stationary SI RICE located at an area source of HAP emissions, you must comply with the applicable emission limitations, operating limitations, and other requirements no later than October 19, 2013.

(2) If you start up your new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions before August 16, 2004, you must comply with the applicable emission limitations and operating limitations in this subpart no later than August 16, 2004.

(3) If you start up your new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions after August 16, 2004, you must comply with the applicable emission limitations and operating limitations in this subpart upon startup of your affected source.

(4) If you start up your new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions before January 18, 2008, you must comply with the applicable emission limitations and operating limitations in this subpart no later than January 18, 2008.

(5) If you start up your new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions after January 18, 2008, you must comply with the applicable emission limitations and operating limitations in this subpart upon startup of your affected source.

(6) If you start up your new or reconstructed stationary RICE located at an area source of HAP emissions before January 18, 2008, you must comply with the applicable emission limitations and operating limitations in this subpart no later than January 18, 2008.

(7) If you start up your new or reconstructed stationary RICE located at an area source of HAP emissions after January 18, 2008, you must comply with the applicable emission limitations and operating limitations in this subpart upon startup of your affected source.

(b) *Area sources that become major sources.* If you have an area source that increases its emissions or its potential to emit such that it becomes a major source of HAP, the compliance dates in paragraphs (b)(1) and (2) of this section apply to you.

(1) Any stationary RICE for which construction or reconstruction is commenced after the date when your area source becomes a major source of HAP must be in compliance with this subpart upon startup of your affected source.

(2) Any stationary RICE for which construction or reconstruction is commenced before your area source becomes a major source of HAP must be in compliance with the provisions of this subpart that are applicable to RICE located at major sources within 3 years after your area source becomes a major source of HAP.

(c) If you own or operate an affected source, you must meet the applicable notification requirements in §63.6645 and in 40 CFR part 63, subpart A.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9675, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010; 78 FR 6701, Jan. 30, 2013]

[↑ Back to Top](#)

## EMISSION AND OPERATING LIMITATIONS

[↑ Back to Top](#)

### **§63.6600 What emission limitations and operating limitations must I meet if I own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions?**

Compliance with the numerical emission limitations established in this subpart is based on the results of testing the average of three 1-hour runs using the testing requirements and procedures in §63.6620 and Table 4 to this subpart.

(a) If you own or operate an existing, new, or reconstructed spark ignition 4SRB stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must comply with the emission limitations in Table 1a to this subpart and the operating limitations in Table 1b to this subpart which apply to you.

(b) If you own or operate a new or reconstructed 2SLB stationary RICE with a site rating of more than 500 brake HP located at major source of HAP emissions, a new or reconstructed 4SLB stationary RICE with a site rating of more than 500 brake HP located at major source of HAP emissions, or a new or reconstructed CI stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must comply with the emission limitations in Table 2a to this subpart and the operating limitations in Table 2b to this subpart which apply to you.

(c) If you own or operate any of the following stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the emission limitations in Tables 1a, 2a, 2c, and 2d to this subpart or operating limitations in Tables 1b and 2b to this subpart: an existing 2SLB stationary RICE; an existing 4SLB stationary RICE; a stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis; an emergency stationary RICE; or a limited use stationary RICE.

(d) If you own or operate an existing non-emergency stationary CI RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must comply with the emission limitations in Table 2c to this subpart and the operating limitations in Table 2b to this subpart which apply to you.

[73 FR 3605, Jan. 18, 2008, as amended at 75 FR 9675, Mar. 3, 2010]

[↑ Back to Top](#)

**§63.6601 What emission limitations must I meet if I own or operate a new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 brake HP and less than or equal to 500 brake HP located at a major source of HAP emissions?**

Compliance with the numerical emission limitations established in this subpart is based on the results of testing the average of three 1-hour runs using the testing requirements and procedures in §63.6620 and Table 4 to this subpart. If you own or operate a new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 and less than or equal to 500 brake HP located at major source of HAP emissions manufactured on or after January 1, 2008, you must comply with the emission limitations in Table 2a to this subpart and the operating limitations in Table 2b to this subpart which apply to you.

[73 FR 3605, Jan. 18, 2008, as amended at 75 FR 9675, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010]

[↑ Back to Top](#)

**§63.6602 What emission limitations and other requirements must I meet if I own or operate an existing stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions?**

If you own or operate an existing stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions, you must comply with the emission limitations and other requirements in Table 2c to this subpart which apply to you. Compliance with the numerical emission limitations established in this subpart is based on the results of testing the average of three 1-hour runs using the testing requirements and procedures in §63.6620 and Table 4 to this subpart.

[78 FR 6701, Jan. 30, 2013]

[↑ Back to Top](#)

**§63.6603 What emission limitations, operating limitations, and other requirements must I meet if I own or operate an existing stationary RICE located at an area source of HAP emissions?**

Compliance with the numerical emission limitations established in this subpart is based on the results of testing the average of three 1-hour runs using the testing requirements and procedures in §63.6620 and Table 4 to this subpart.

(a) If you own or operate an existing stationary RICE located at an area source of HAP emissions, you must comply with the requirements in Table 2d to this subpart and the operating limitations in Table 2b to this subpart that apply to you.

(b) If you own or operate an existing stationary non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP that meets either paragraph (b)(1) or (2) of this section, you do not have to meet the numerical CO emission limitations specified in Table 2d of this subpart. Existing stationary non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP that meet either paragraph (b)(1) or (2) of this section must meet the

management practices that are shown for stationary non-emergency CI RICE with a site rating of less than or equal to 300 HP in Table 2d of this subpart.

(1) The area source is located in an area of Alaska that is not accessible by the Federal Aid Highway System (FAHS).

(2) The stationary RICE is located at an area source that meets paragraphs (b)(2)(i), (ii), and (iii) of this section.

(i) The only connection to the FAHS is through the Alaska Marine Highway System (AMHS), or the stationary RICE operation is within an isolated grid in Alaska that is not connected to the statewide electrical grid referred to as the Alaska Railbelt Grid.

(ii) At least 10 percent of the power generated by the stationary RICE on an annual basis is used for residential purposes.

(iii) The generating capacity of the area source is less than 12 megawatts, or the stationary RICE is used exclusively for backup power for renewable energy.

(c) If you own or operate an existing stationary non-emergency CI RICE with a site rating of more than 300 HP located on an offshore vessel that is an area source of HAP and is a nonroad vehicle that is an Outer Continental Shelf (OCS) source as defined in 40 CFR 55.2, you do not have to meet the numerical CO emission limitations specified in Table 2d of this subpart. You must meet all of the following management practices:

(1) Change oil every 1,000 hours of operation or annually, whichever comes first. Sources have the option to utilize an oil analysis program as described in §63.6625(i) in order to extend the specified oil change requirement.

(2) Inspect and clean air filters every 750 hours of operation or annually, whichever comes first, and replace as necessary.

(3) Inspect fuel filters and belts, if installed, every 750 hours of operation or annually, whichever comes first, and replace as necessary.

(4) Inspect all flexible hoses every 1,000 hours of operation or annually, whichever comes first, and replace as necessary.

(d) If you own or operate an existing non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP emissions that is certified to the Tier 1 or Tier 2 emission standards in Table 1 of 40 CFR 89.112 and that is subject to an enforceable state or local standard that requires the engine to be replaced no later than June 1, 2018, you may until January 1, 2015, or 12 years after the installation date of the engine (whichever is later), but not later than June 1, 2018, choose to comply with the management practices that are shown for stationary non-emergency CI RICE with a site rating of less than or equal to 300 HP in Table 2d of this subpart instead of the applicable emission limitations in Table 2d, operating limitations in Table 2b, and crankcase ventilation system requirements in §63.6625(g). You must comply with the emission limitations in Table 2d and operating limitations in Table 2b that apply for non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP emissions by January 1, 2015, or 12 years after the installation date of the engine (whichever is later), but not later than June 1, 2018. You must also comply with the crankcase ventilation system requirements in §63.6625(g) by



January 1, 2015, or 12 years after the installation date of the engine (whichever is later), but not later than June 1, 2018.

(e) If you own or operate an existing non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP emissions that is certified to the Tier 3 (Tier 2 for engines above 560 kilowatt (kW)) emission standards in Table 1 of 40 CFR 89.112, you may comply with the requirements under this part by meeting the requirements for Tier 3 engines (Tier 2 for engines above 560 kW) in 40 CFR part 60 subpart IIII instead of the emission limitations and other requirements that would otherwise apply under this part for existing non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP emissions.

(f) An existing non-emergency SI 4SLB and 4SRB stationary RICE with a site rating of more than 500 HP located at area sources of HAP must meet the definition of remote stationary RICE in §63.6675 on the initial compliance date for the engine, October 19, 2013, in order to be considered a remote stationary RICE under this subpart. Owners and operators of existing non-emergency SI 4SLB and 4SRB stationary RICE with a site rating of more than 500 HP located at area sources of HAP that meet the definition of remote stationary RICE in §63.6675 of this subpart as of October 19, 2013 must evaluate the status of their stationary RICE every 12 months. Owners and operators must keep records of the initial and annual evaluation of the status of the engine. If the evaluation indicates that the stationary RICE no longer meets the definition of remote stationary RICE in §63.6675 of this subpart, the owner or operator must comply with all of the requirements for existing non-emergency SI 4SLB and 4SRB stationary RICE with a site rating of more than 500 HP located at area sources of HAP that are not remote stationary RICE within 1 year of the evaluation.

[75 FR 9675, Mar. 3, 2010, as amended at 75 FR 51589, Aug. 20, 2010; 76 FR 12866, Mar. 9, 2011; 78 FR 6701, Jan. 30, 2013]

 [Back to Top](#)

#### **§63.6604 What fuel requirements must I meet if I own or operate a stationary CI RICE?**

(a) If you own or operate an existing non-emergency, non-black start CI stationary RICE with a site rating of more than 300 brake HP with a displacement of less than 30 liters per cylinder that uses diesel fuel, you must use diesel fuel that meets the requirements in 40 CFR 80.510(b) for nonroad diesel fuel.

(b) Beginning January 1, 2015, if you own or operate an existing emergency CI stationary RICE with a site rating of more than 100 brake HP and a displacement of less than 30 liters per cylinder that uses diesel fuel and operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii) or that operates for the purpose specified in §63.6640(f)(4)(ii), you must use diesel fuel that meets the requirements in 40 CFR 80.510(b) for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to January 1, 2015, may be used until depleted.

(c) Beginning January 1, 2015, if you own or operate a new emergency CI stationary RICE with a site rating of more than 500 brake HP and a displacement of less than 30 liters per cylinder located at a major source of HAP that uses diesel fuel and operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii), you must use diesel fuel that meets the requirements in 40 CFR 80.510(b) for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to January 1, 2015, may be used until depleted.

(d) Existing CI stationary RICE located in Guam, American Samoa, the Commonwealth of the Northern Mariana Islands, at area sources in areas of Alaska that meet either §63.6603(b)(1) or §63.6603(b)(2), or are on offshore vessels that meet §63.6603(c) are exempt from the requirements of this section.

[78 FR 6702, Jan. 30, 2013]

[↑ Back to Top](#)

## GENERAL COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### **§63.6605 What are my general requirements for complying with this subpart?**

(a) You must be in compliance with the emission limitations, operating limitations, and other requirements in this subpart that apply to you at all times.

(b) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

[75 FR 9675, Mar. 3, 2010, as amended at 78 FR 6702, Jan. 30, 2013]

[↑ Back to Top](#)

## TESTING AND INITIAL COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### **§63.6610 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions?**

If you own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions you are subject to the requirements of this section.

(a) You must conduct the initial performance test or other initial compliance demonstrations in Table 4 to this subpart that apply to you within 180 days after the compliance date that is specified for your stationary RICE in §63.6595 and according to the provisions in §63.7(a)(2).

(b) If you commenced construction or reconstruction between December 19, 2002 and June 15, 2004 and own or operate stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must demonstrate initial compliance with either the proposed

emission limitations or the promulgated emission limitations no later than February 10, 2005 or no later than 180 days after startup of the source, whichever is later, according to §63.7(a)(2)(ix).

(c) If you commenced construction or reconstruction between December 19, 2002 and June 15, 2004 and own or operate stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, and you chose to comply with the proposed emission limitations when demonstrating initial compliance, you must conduct a second performance test to demonstrate compliance with the promulgated emission limitations by December 13, 2007 or after startup of the source, whichever is later, according to §63.7(a)(2)(ix).

(d) An owner or operator is not required to conduct an initial performance test on units for which a performance test has been previously conducted, but the test must meet all of the conditions described in paragraphs (d)(1) through (5) of this section.

(1) The test must have been conducted using the same methods specified in this subpart, and these methods must have been followed correctly.

(2) The test must not be older than 2 years.

(3) The test must be reviewed and accepted by the Administrator.

(4) Either no process or equipment changes must have been made since the test was performed, or the owner or operator must be able to demonstrate that the results of the performance test, with or without adjustments, reliably demonstrate compliance despite process or equipment changes.

(5) The test must be conducted at any load condition within plus or minus 10 percent of 100 percent load.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3605, Jan. 18, 2008]

 [Back to Top](#)

**§63.6611 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate a new or reconstructed 4SLB SI stationary RICE with a site rating of greater than or equal to 250 and less than or equal to 500 brake HP located at a major source of HAP emissions?**

If you own or operate a new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 and less than or equal to 500 brake HP located at a major source of HAP emissions, you must conduct an initial performance test within 240 days after the compliance date that is specified for your stationary RICE in §63.6595 and according to the provisions specified in Table 4 to this subpart, as appropriate.

[73 FR 3605, Jan. 18, 2008, as amended at 75 FR 51589, Aug. 20, 2010]

 [Back to Top](#)

**§63.6612 By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate an existing stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing stationary RICE located at an area source of HAP emissions?**

If you own or operate an existing stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing stationary RICE located at an area source of HAP emissions you are subject to the requirements of this section.

(a) You must conduct any initial performance test or other initial compliance demonstration according to Tables 4 and 5 to this subpart that apply to you within 180 days after the compliance date that is specified for your stationary RICE in §63.6595 and according to the provisions in §63.7(a)(2).

(b) An owner or operator is not required to conduct an initial performance test on a unit for which a performance test has been previously conducted, but the test must meet all of the conditions described in paragraphs (b)(1) through (4) of this section.

(1) The test must have been conducted using the same methods specified in this subpart, and these methods must have been followed correctly.

(2) The test must not be older than 2 years.

(3) The test must be reviewed and accepted by the Administrator.

(4) Either no process or equipment changes must have been made since the test was performed, or the owner or operator must be able to demonstrate that the results of the performance test, with or without adjustments, reliably demonstrate compliance despite process or equipment changes.

[75 FR 9676, Mar. 3, 2010, as amended at 75 FR 51589, Aug. 20, 2010]

 [Back to Top](#)

**§63.6615 When must I conduct subsequent performance tests?**

If you must comply with the emission limitations and operating limitations, you must conduct subsequent performance tests as specified in Table 3 of this subpart.

 [Back to Top](#)

**§63.6620 What performance tests and other procedures must I use?**

(a) You must conduct each performance test in Tables 3 and 4 of this subpart that applies to you.

(b) Each performance test must be conducted according to the requirements that this subpart specifies in Table 4 to this subpart. If you own or operate a non-operational stationary RICE that is subject to performance testing, you do not need to start up the engine solely to conduct the performance test. Owners and operators of a non-operational engine can conduct the performance test when the engine is started up again. The test must be conducted at any load condition within

plus or minus 10 percent of 100 percent load for the stationary RICE listed in paragraphs (b)(1) through (4) of this section.

(1) Non-emergency 4SRB stationary RICE with a site rating of greater than 500 brake HP located at a major source of HAP emissions.

(2) New non-emergency 4SLB stationary RICE with a site rating of greater than or equal to 250 brake HP located at a major source of HAP emissions.

(3) New non-emergency 2SLB stationary RICE with a site rating of greater than 500 brake HP located at a major source of HAP emissions.

(4) New non-emergency CI stationary RICE with a site rating of greater than 500 brake HP located at a major source of HAP emissions.

(c) [Reserved]

(d) You must conduct three separate test runs for each performance test required in this section, as specified in §63.7(e)(3). Each test run must last at least 1 hour, unless otherwise specified in this subpart.

(e)(1) You must use Equation 1 of this section to determine compliance with the percent reduction requirement:

$$\frac{C_i - C_o}{C_i} \times 100 = R \quad (\text{Eq. 1})$$

[View or download PDF](#)

Where:

$C_i$  = concentration of carbon monoxide (CO), total hydrocarbons (THC), or formaldehyde at the control device inlet,

$C_o$  = concentration of CO, THC, or formaldehyde at the control device outlet, and

R = percent reduction of CO, THC, or formaldehyde emissions.

(2) You must normalize the CO, THC, or formaldehyde concentrations at the inlet and outlet of the control device to a dry basis and to 15 percent oxygen, or an equivalent percent carbon dioxide ( $\text{CO}_2$ ). If pollutant concentrations are to be corrected to 15 percent oxygen and  $\text{CO}_2$  concentration is measured in lieu of oxygen concentration measurement, a  $\text{CO}_2$  correction factor is needed. Calculate the  $\text{CO}_2$  correction factor as described in paragraphs (e)(2)(i) through (iii) of this section.

(i) Calculate the fuel-specific  $F_o$  value for the fuel burned during the test using values obtained from Method 19, Section 5.2, and the following equation:

$$F_o = \frac{0.209 F_d}{F_c} \quad (\text{Eq. 2})$$

[View or download PDF](#)

Where:

$F_o$  = Fuel factor based on the ratio of oxygen volume to the ultimate  $CO_2$  volume produced by the fuel at zero percent excess air.

0.209 = Fraction of air that is oxygen, percent/100.

$F_d$  = Ratio of the volume of dry effluent gas to the gross calorific value of the fuel from Method 19,  $dsf/10^6$  Btu).

$F_c$  = Ratio of the volume of  $CO_2$  produced to the gross calorific value of the fuel from Method 19,  $dsf/10^6$  Btu)

(ii) Calculate the  $CO_2$  correction factor for correcting measurement data to 15 percent  $O_2$ , as follows:

$$X_{CO_2} = \frac{5.9}{F_o} \quad (\text{Eq. 3})$$

[View or download PDF](#)

Where:

$X_{CO_2}$  =  $CO_2$  correction factor, percent.

5.9 = 20.9 percent  $O_2$ —15 percent  $O_2$ , the defined  $O_2$  correction value, percent.

(iii) Calculate the CO, THC, and formaldehyde gas concentrations adjusted to 15 percent  $O_2$  using  $CO_2$  as follows:

$$C_{adj} = C_d \frac{X_{CO_2}}{\%CO_2} \quad (\text{Eq. 4})$$

[View or download PDF](#)

Where:

$C_{adj}$  = Calculated concentration of CO, THC, or formaldehyde adjusted to 15 percent  $O_2$ .

$C_d$  = Measured concentration of CO, THC, or formaldehyde, uncorrected.

$X_{CO_2}$  =  $CO_2$  correction factor, percent.

$\%CO_2$  = Measured  $CO_2$  concentration measured, dry basis, percent.

(f) If you comply with the emission limitation to reduce CO and you are not using an oxidation catalyst, if you comply with the emission limitation to reduce formaldehyde and you are not using NSCR, or if you comply with the emission limitation to limit the concentration of formaldehyde in the stationary RICE exhaust and you are not using an oxidation catalyst or NSCR, you must petition the Administrator for operating limitations to be established during the initial performance test and continuously monitored thereafter; or for approval of no operating limitations. You must not conduct the initial performance test until after the petition has been approved by the Administrator.

(g) If you petition the Administrator for approval of operating limitations, your petition must include the information described in paragraphs (g)(1) through (5) of this section.

(1) Identification of the specific parameters you propose to use as operating limitations;

(2) A discussion of the relationship between these parameters and HAP emissions, identifying how HAP emissions change with changes in these parameters, and how limitations on these parameters will serve to limit HAP emissions;

(3) A discussion of how you will establish the upper and/or lower values for these parameters which will establish the limits on these parameters in the operating limitations;

(4) A discussion identifying the methods you will use to measure and the instruments you will use to monitor these parameters, as well as the relative accuracy and precision of these methods and instruments; and

(5) A discussion identifying the frequency and methods for recalibrating the instruments you will use for monitoring these parameters.

(h) If you petition the Administrator for approval of no operating limitations, your petition must include the information described in paragraphs (h)(1) through (7) of this section.

(1) Identification of the parameters associated with operation of the stationary RICE and any emission control device which could change intentionally (*e.g.*, operator adjustment, automatic controller adjustment, etc.) or unintentionally (*e.g.*, wear and tear, error, etc.) on a routine basis or over time;

(2) A discussion of the relationship, if any, between changes in the parameters and changes in HAP emissions;

(3) For the parameters which could change in such a way as to increase HAP emissions, a discussion of whether establishing limitations on the parameters would serve to limit HAP emissions;

(4) For the parameters which could change in such a way as to increase HAP emissions, a discussion of how you could establish upper and/or lower values for the parameters which would establish limits on the parameters in operating limitations;

(5) For the parameters, a discussion identifying the methods you could use to measure them and the instruments you could use to monitor them, as well as the relative accuracy and precision of the methods and instruments;

(6) For the parameters, a discussion identifying the frequency and methods for recalibrating the instruments you could use to monitor them; and

(7) A discussion of why, from your point of view, it is infeasible or unreasonable to adopt the parameters as operating limitations.

(i) The engine percent load during a performance test must be determined by documenting the calculations, assumptions, and measurement devices used to measure or estimate the percent load in a specific application. A written report of the average percent load determination must be included in the notification of compliance status. The following information must be included in the written report: the engine model number, the engine manufacturer, the year of purchase, the manufacturer's site-rated brake horsepower, the ambient temperature, pressure, and humidity during the performance test, and all assumptions that were made to estimate or calculate percent load during the performance test must be clearly explained. If measurement devices such as flow meters,

kilowatt meters, beta analyzers, stain gauges, etc. are used, the model number of the measurement device, and an estimate of its accurate in percentage of true value must be provided.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9676, Mar. 3, 2010; 78 FR 6702, Jan. 30, 2013]

[↑ Back to Top](#)

### **§63.6625 What are my monitoring, installation, collection, operation, and maintenance requirements?**

(a) If you elect to install a CEMS as specified in Table 5 of this subpart, you must install, operate, and maintain a CEMS to monitor CO and either O<sub>2</sub> or CO<sub>2</sub> according to the requirements in paragraphs (a)(1) through (4) of this section. If you are meeting a requirement to reduce CO emissions, the CEMS must be installed at both the inlet and outlet of the control device. If you are meeting a requirement to limit the concentration of CO, the CEMS must be installed at the outlet of the control device.

(1) Each CEMS must be installed, operated, and maintained according to the applicable performance specifications of 40 CFR part 60, appendix B.

(2) You must conduct an initial performance evaluation and an annual relative accuracy test audit (RATA) of each CEMS according to the requirements in §63.8 and according to the applicable performance specifications of 40 CFR part 60, appendix B as well as daily and periodic data quality checks in accordance with 40 CFR part 60, appendix F, procedure 1.

(3) As specified in §63.8(c)(4)(ii), each CEMS must complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period. You must have at least two data points, with each representing a different 15-minute period, to have a valid hour of data.

(4) The CEMS data must be reduced as specified in §63.8(g)(2) and recorded in parts per million or parts per billion (as appropriate for the applicable limitation) at 15 percent oxygen or the equivalent CO<sub>2</sub> concentration.

(b) If you are required to install a continuous parameter monitoring system (CPMS) as specified in Table 5 of this subpart, you must install, operate, and maintain each CPMS according to the requirements in paragraphs (b)(1) through (6) of this section. For an affected source that is complying with the emission limitations and operating limitations on March 9, 2011, the requirements in paragraph (b) of this section are applicable September 6, 2011.

(1) You must prepare a site-specific monitoring plan that addresses the monitoring system design, data collection, and the quality assurance and quality control elements outlined in paragraphs (b)(1)(i) through (v) of this section and in §63.8(d). As specified in §63.8(f)(4), you may request approval of monitoring system quality assurance and quality control procedures alternative to those specified in paragraphs (b)(1) through (5) of this section in your site-specific monitoring plan.

(i) The performance criteria and design specifications for the monitoring system equipment, including the sample interface, detector signal analyzer, and data acquisition and calculations;



(ii) Sampling interface (e.g., thermocouple) location such that the monitoring system will provide representative measurements;

(iii) Equipment performance evaluations, system accuracy audits, or other audit procedures;

(iv) Ongoing operation and maintenance procedures in accordance with provisions in §63.8(c)(1)(ii) and (c)(3); and

(v) Ongoing reporting and recordkeeping procedures in accordance with provisions in §63.10(c), (e)(1), and (e)(2)(i).

(2) You must install, operate, and maintain each CPMS in continuous operation according to the procedures in your site-specific monitoring plan.

(3) The CPMS must collect data at least once every 15 minutes (see also §63.6635).

(4) For a CPMS for measuring temperature range, the temperature sensor must have a minimum tolerance of 2.8 degrees Celsius (5 degrees Fahrenheit) or 1 percent of the measurement range, whichever is larger.

(5) You must conduct the CPMS equipment performance evaluation, system accuracy audits, or other audit procedures specified in your site-specific monitoring plan at least annually.

(6) You must conduct a performance evaluation of each CPMS in accordance with your site-specific monitoring plan.

(c) If you are operating a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must monitor and record your fuel usage daily with separate fuel meters to measure the volumetric flow rate of each fuel. In addition, you must operate your stationary RICE in a manner which reasonably minimizes HAP emissions.

(d) If you are operating a new or reconstructed emergency 4SLB stationary RICE with a site rating of greater than or equal to 250 and less than or equal to 500 brake HP located at a major source of HAP emissions, you must install a non-resettable hour meter prior to the startup of the engine.

(e) If you own or operate any of the following stationary RICE, you must operate and maintain the stationary RICE and after-treatment control device (if any) according to the manufacturer's emission-related written instructions or develop your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions:

(1) An existing stationary RICE with a site rating of less than 100 HP located at a major source of HAP emissions;

(2) An existing emergency or black start stationary RICE with a site rating of less than or equal to 500 HP located at a major source of HAP emissions;

(3) An existing emergency or black start stationary RICE located at an area source of HAP emissions;

(4) An existing non-emergency, non-black start stationary CI RICE with a site rating less than or equal to 300 HP located at an area source of HAP emissions;

(5) An existing non-emergency, non-black start 2SLB stationary RICE located at an area source of HAP emissions;

(6) An existing non-emergency, non-black start stationary RICE located at an area source of HAP emissions which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis.

(7) An existing non-emergency, non-black start 4SLB stationary RICE with a site rating less than or equal to 500 HP located at an area source of HAP emissions;

(8) An existing non-emergency, non-black start 4SRB stationary RICE with a site rating less than or equal to 500 HP located at an area source of HAP emissions;

(9) An existing, non-emergency, non-black start 4SLB stationary RICE with a site rating greater than 500 HP located at an area source of HAP emissions that is operated 24 hours or less per calendar year; and

(10) An existing, non-emergency, non-black start 4SRB stationary RICE with a site rating greater than 500 HP located at an area source of HAP emissions that is operated 24 hours or less per calendar year.

(f) If you own or operate an existing emergency stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing emergency stationary RICE located at an area source of HAP emissions, you must install a non-resettable hour meter if one is not already installed.

(g) If you own or operate an existing non-emergency, non-black start CI engine greater than or equal to 300 HP that is not equipped with a closed crankcase ventilation system, you must comply with either paragraph (g)(1) or paragraph (2) of this section. Owners and operators must follow the manufacturer's specified maintenance requirements for operating and maintaining the open or closed crankcase ventilation systems and replacing the crankcase filters, or can request the Administrator to approve different maintenance requirements that are as protective as manufacturer requirements. Existing CI engines located at area sources in areas of Alaska that meet either §63.6603(b)(1) or §63.6603(b)(2) do not have to meet the requirements of this paragraph (g). Existing CI engines located on offshore vessels that meet §63.6603(c) do not have to meet the requirements of this paragraph (g).

(1) Install a closed crankcase ventilation system that prevents crankcase emissions from being emitted to the atmosphere, or

(2) Install an open crankcase filtration emission control system that reduces emissions from the crankcase by filtering the exhaust stream to remove oil mist, particulates and metals.

(h) If you operate a new, reconstructed, or existing stationary engine, you must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the emission standards applicable to all times other than startup in Tables 1a, 2a, 2c, and 2d to this subpart apply.

(i) If you own or operate a stationary CI engine that is subject to the work, operation or management practices in items 1 or 2 of Table 2c to this subpart or in items 1 or 4 of Table 2d to this subpart, you have the option of utilizing an oil analysis program in order to extend the specified oil change requirement in Tables 2c and 2d to this subpart. The oil analysis must be performed at the same frequency specified for changing the oil in Table 2c or 2d to this subpart. The analysis program must at a minimum analyze the following three parameters: Total Base Number, viscosity, and percent water content. The condemning limits for these parameters are as follows: Total Base Number is less than 30 percent of the Total Base Number of the oil when new; viscosity of the oil has changed by more than 20 percent from the viscosity of the oil when new; or percent water content (by volume) is greater than 0.5. If all of these condemning limits are not exceeded, the engine owner or operator is not required to change the oil. If any of the limits are exceeded, the engine owner or operator must change the oil within 2 business days of receiving the results of the analysis; if the engine is not in operation when the results of the analysis are received, the engine owner or operator must change the oil within 2 business days or before commencing operation, whichever is later. The owner or operator must keep records of the parameters that are analyzed as part of the program, the results of the analysis, and the oil changes for the engine. The analysis program must be part of the maintenance plan for the engine.

(j) If you own or operate a stationary SI engine that is subject to the work, operation or management practices in items 6, 7, or 8 of Table 2c to this subpart or in items 5, 6, 7, 9, or 11 of Table 2d to this subpart, you have the option of utilizing an oil analysis program in order to extend the specified oil change requirement in Tables 2c and 2d to this subpart. The oil analysis must be performed at the same frequency specified for changing the oil in Table 2c or 2d to this subpart. The analysis program must at a minimum analyze the following three parameters: Total Acid Number, viscosity, and percent water content. The condemning limits for these parameters are as follows: Total Acid Number increases by more than 3.0 milligrams of potassium hydroxide (KOH) per gram from Total Acid Number of the oil when new; viscosity of the oil has changed by more than 20 percent from the viscosity of the oil when new; or percent water content (by volume) is greater than 0.5. If all of these condemning limits are not exceeded, the engine owner or operator is not required to change the oil. If any of the limits are exceeded, the engine owner or operator must change the oil within 2 business days of receiving the results of the analysis; if the engine is not in operation when the results of the analysis are received, the engine owner or operator must change the oil within 2 business days or before commencing operation, whichever is later. The owner or operator must keep records of the parameters that are analyzed as part of the program, the results of the analysis, and the oil changes for the engine. The analysis program must be part of the maintenance plan for the engine.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010; 76 FR 12866, Mar. 9, 2011; 78 FR 6703, Jan. 30, 2013]

 [Back to Top](#)

### **§63.6630 How do I demonstrate initial compliance with the emission limitations, operating limitations, and other requirements?**

(a) You must demonstrate initial compliance with each emission limitation, operating limitation, and other requirement that applies to you according to Table 5 of this subpart.

(b) During the initial performance test, you must establish each operating limitation in Tables 1b and 2b of this subpart that applies to you.

(c) You must submit the Notification of Compliance Status containing the results of the initial compliance demonstration according to the requirements in §63.6645.

(d) Non-emergency 4SRB stationary RICE complying with the requirement to reduce formaldehyde emissions by 76 percent or more can demonstrate initial compliance with the formaldehyde emission limit by testing for THC instead of formaldehyde. The testing must be conducted according to the requirements in Table 4 of this subpart. The average reduction of emissions of THC determined from the performance test must be equal to or greater than 30 percent.

(e) The initial compliance demonstration required for existing non-emergency 4SLB and 4SRB stationary RICE with a site rating of more than 500 HP located at an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year must be conducted according to the following requirements:

(1) The compliance demonstration must consist of at least three test runs.

(2) Each test run must be of at least 15 minute duration, except that each test conducted using the method in appendix A to this subpart must consist of at least one measurement cycle and include at least 2 minutes of test data phase measurement.

(3) If you are demonstrating compliance with the CO concentration or CO percent reduction requirement, you must measure CO emissions using one of the CO measurement methods specified in Table 4 of this subpart, or using appendix A to this subpart.

(4) If you are demonstrating compliance with the THC percent reduction requirement, you must measure THC emissions using Method 25A, reported as propane, of 40 CFR part 60, appendix A.

(5) You must measure O<sub>2</sub> using one of the O<sub>2</sub> measurement methods specified in Table 4 of this subpart. Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for CO or THC concentration.

(6) If you are demonstrating compliance with the CO or THC percent reduction requirement, you must measure CO or THC emissions and O<sub>2</sub> emissions simultaneously at the inlet and outlet of the control device.

[69 FR 33506, June 15, 2004, as amended at 78 FR 6704, Jan. 30, 2013]

[↑ Back to Top](#)

## CONTINUOUS COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### **§63.6635 How do I monitor and collect data to demonstrate continuous compliance?**

(a) If you must comply with emission and operating limitations, you must monitor and collect data according to this section.

(b) Except for monitor malfunctions, associated repairs, required performance evaluations, and required quality assurance or control activities, you must monitor continuously at all times that the

stationary RICE is operating. A monitoring malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring to provide valid data. Monitoring failures that are caused in part by poor maintenance or careless operation are not malfunctions.

(c) You may not use data recorded during monitoring malfunctions, associated repairs, and required quality assurance or control activities in data averages and calculations used to report emission or operating levels. You must, however, use all the valid data collected during all other periods.

[69 FR 33506, June 15, 2004, as amended at 76 FR 12867, Mar. 9, 2011]

 [Back to Top](#)

### **§63.6640 How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?**

(a) You must demonstrate continuous compliance with each emission limitation, operating limitation, and other requirements in Tables 1a and 1b, Tables 2a and 2b, Table 2c, and Table 2d to this subpart that apply to you according to methods specified in Table 6 to this subpart.

(b) You must report each instance in which you did not meet each emission limitation or operating limitation in Tables 1a and 1b, Tables 2a and 2b, Table 2c, and Table 2d to this subpart that apply to you. These instances are deviations from the emission and operating limitations in this subpart. These deviations must be reported according to the requirements in §63.6650. If you change your catalyst, you must reestablish the values of the operating parameters measured during the initial performance test. When you reestablish the values of your operating parameters, you must also conduct a performance test to demonstrate that you are meeting the required emission limitation applicable to your stationary RICE.

(c) The annual compliance demonstration required for existing non-emergency 4SLB and 4SRB stationary RICE with a site rating of more than 500 HP located at an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year must be conducted according to the following requirements:

(1) The compliance demonstration must consist of at least one test run.

(2) Each test run must be of at least 15 minute duration, except that each test conducted using the method in appendix A to this subpart must consist of at least one measurement cycle and include at least 2 minutes of test data phase measurement.

(3) If you are demonstrating compliance with the CO concentration or CO percent reduction requirement, you must measure CO emissions using one of the CO measurement methods specified in Table 4 of this subpart, or using appendix A to this subpart.

(4) If you are demonstrating compliance with the THC percent reduction requirement, you must measure THC emissions using Method 25A, reported as propane, of 40 CFR part 60, appendix A.

(5) You must measure O<sub>2</sub> using one of the O<sub>2</sub> measurement methods specified in Table 4 of this subpart. Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for CO or THC concentration.

(6) If you are demonstrating compliance with the CO or THC percent reduction requirement, you must measure CO or THC emissions and O<sub>2</sub> emissions simultaneously at the inlet and outlet of the control device.

(7) If the results of the annual compliance demonstration show that the emissions exceed the levels specified in Table 6 of this subpart, the stationary RICE must be shut down as soon as safely possible, and appropriate corrective action must be taken (e.g., repairs, catalyst cleaning, catalyst replacement). The stationary RICE must be retested within 7 days of being restarted and the emissions must meet the levels specified in Table 6 of this subpart. If the retest shows that the emissions continue to exceed the specified levels, the stationary RICE must again be shut down as soon as safely possible, and the stationary RICE may not operate, except for purposes of startup and testing, until the owner/operator demonstrates through testing that the emissions do not exceed the levels specified in Table 6 of this subpart.

(d) For new, reconstructed, and rebuilt stationary RICE, deviations from the emission or operating limitations that occur during the first 200 hours of operation from engine startup (engine burn-in period) are not violations. Rebuilt stationary RICE means a stationary RICE that has been rebuilt as that term is defined in 40 CFR 94.11(a).

(e) You must also report each instance in which you did not meet the requirements in Table 8 to this subpart that apply to you. If you own or operate a new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions (except new or reconstructed 4SLB engines greater than or equal to 250 and less than or equal to 500 brake HP), a new or reconstructed stationary RICE located at an area source of HAP emissions, or any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in Table 8 to this subpart: An existing 2SLB stationary RICE, an existing 4SLB stationary RICE, an existing emergency stationary RICE, an existing limited use stationary RICE, or an existing stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis. If you own or operate any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in Table 8 to this subpart, except for the initial notification requirements: a new or reconstructed stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, a new or reconstructed emergency stationary RICE, or a new or reconstructed limited use stationary RICE.

(f) If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

(2) You may operate your emergency stationary RICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

(ii) Emergency stationary RICE may be operated for emergency demand response for periods in which the Reliability Coordinator under the North American Electric Reliability Corporation (NERC) Reliability Standard EOP-002-3, Capacity and Energy Emergencies (incorporated by reference, see §63.14), or other authorized entity as determined by the Reliability Coordinator, has declared an Energy Emergency Alert Level 2 as defined in the NERC Reliability Standard EOP-002-3.

(iii) Emergency stationary RICE may be operated for periods where there is a deviation of voltage or frequency of 5 percent or greater below standard voltage or frequency.

(3) Emergency stationary RICE located at major sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. The 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to supply power to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) Prior to May 3, 2014, the 50 hours per year for non-emergency situations can be used for peak shaving or non-emergency demand response to generate income for a facility, or to otherwise supply power as part of a financial arrangement with another entity if the engine is operated as part of a peak shaving (load management program) with the local distribution system operator and the power is provided only to the facility itself or to support the local distribution system.

(ii) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator.

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6704, Jan. 30, 2013]

[↑ Back to Top](#)

## NOTIFICATIONS, REPORTS, AND RECORDS

[↑ Back to Top](#)

### **§63.6645 What notifications must I submit and when?**

(a) You must submit all of the notifications in §§63.7(b) and (c), 63.8(e), (f)(4) and (f)(6), 63.9(b) through (e), and (g) and (h) that apply to you by the dates specified if you own or operate any of the following;

(1) An existing stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions.

(2) An existing stationary RICE located at an area source of HAP emissions.

(3) A stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions.

(4) A new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 HP located at a major source of HAP emissions.

(5) This requirement does not apply if you own or operate an existing stationary RICE less than 100 HP, an existing stationary emergency RICE, or an existing stationary RICE that is not subject to any numerical emission standards.

(b) As specified in §63.9(b)(2), if you start up your stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions before the effective date of this subpart, you must submit an Initial Notification not later than December 13, 2004.

(c) If you start up your new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions on or after August 16, 2004, you must submit an Initial Notification not later than 120 days after you become subject to this subpart.

(d) As specified in §63.9(b)(2), if you start up your stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions before the effective date of



this subpart and you are required to submit an initial notification, you must submit an Initial Notification not later than July 16, 2008.

(e) If you start up your new or reconstructed stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions on or after March 18, 2008 and you are required to submit an initial notification, you must submit an Initial Notification not later than 120 days after you become subject to this subpart.

(f) If you are required to submit an Initial Notification but are otherwise not affected by the requirements of this subpart, in accordance with §63.6590(b), your notification should include the information in §63.9(b)(2)(i) through (v), and a statement that your stationary RICE has no additional requirements and explain the basis of the exclusion (for example, that it operates exclusively as an emergency stationary RICE if it has a site rating of more than 500 brake HP located at a major source of HAP emissions).

(g) If you are required to conduct a performance test, you must submit a Notification of Intent to conduct a performance test at least 60 days before the performance test is scheduled to begin as required in §63.7(b)(1).

(h) If you are required to conduct a performance test or other initial compliance demonstration as specified in Tables 4 and 5 to this subpart, you must submit a Notification of Compliance Status according to §63.9(h)(2)(ii).

(1) For each initial compliance demonstration required in Table 5 to this subpart that does not include a performance test, you must submit the Notification of Compliance Status before the close of business on the 30th day following the completion of the initial compliance demonstration.

(2) For each initial compliance demonstration required in Table 5 to this subpart that includes a performance test conducted according to the requirements in Table 3 to this subpart, you must submit the Notification of Compliance Status, including the performance test results, before the close of business on the 60th day following the completion of the performance test according to §63.10(d)(2).

(i) If you own or operate an existing non-emergency CI RICE with a site rating of more than 300 HP located at an area source of HAP emissions that is certified to the Tier 1 or Tier 2 emission standards in Table 1 of 40 CFR 89.112 and subject to an enforceable state or local standard requiring engine replacement and you intend to meet management practices rather than emission limits, as specified in §63.6603(d), you must submit a notification by March 3, 2013, stating that you intend to use the provision in §63.6603(d) and identifying the state or local regulation that the engine is subject to.

[73 FR 3606, Jan. 18, 2008, as amended at 75 FR 9677, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6705, Jan. 30, 2013]

 [Back to Top](#)

### **§63.6650 What reports must I submit and when?**

(a) You must submit each report in Table 7 of this subpart that applies to you.

(b) Unless the Administrator has approved a different schedule for submission of reports under §63.10(a), you must submit each report by the date in Table 7 of this subpart and according to the requirements in paragraphs (b)(1) through (b)(9) of this section.

(1) For semiannual Compliance reports, the first Compliance report must cover the period beginning on the compliance date that is specified for your affected source in §63.6595 and ending on June 30 or December 31, whichever date is the first date following the end of the first calendar half after the compliance date that is specified for your source in §63.6595.

(2) For semiannual Compliance reports, the first Compliance report must be postmarked or delivered no later than July 31 or January 31, whichever date follows the end of the first calendar half after the compliance date that is specified for your affected source in §63.6595.

(3) For semiannual Compliance reports, each subsequent Compliance report must cover the semiannual reporting period from January 1 through June 30 or the semiannual reporting period from July 1 through December 31.

(4) For semiannual Compliance reports, each subsequent Compliance report must be postmarked or delivered no later than July 31 or January 31, whichever date is the first date following the end of the semiannual reporting period.

(5) For each stationary RICE that is subject to permitting regulations pursuant to 40 CFR part 70 or 71, and if the permitting authority has established dates for submitting semiannual reports pursuant to 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6 (a)(3)(iii)(A), you may submit the first and subsequent Compliance reports according to the dates the permitting authority has established instead of according to the dates in paragraphs (b)(1) through (b)(4) of this section.

(6) For annual Compliance reports, the first Compliance report must cover the period beginning on the compliance date that is specified for your affected source in §63.6595 and ending on December 31.

(7) For annual Compliance reports, the first Compliance report must be postmarked or delivered no later than January 31 following the end of the first calendar year after the compliance date that is specified for your affected source in §63.6595.

(8) For annual Compliance reports, each subsequent Compliance report must cover the annual reporting period from January 1 through December 31.

(9) For annual Compliance reports, each subsequent Compliance report must be postmarked or delivered no later than January 31.

(c) The Compliance report must contain the information in paragraphs (c)(1) through (6) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with that official's name, title, and signature, certifying the accuracy of the content of the report.

(3) Date of report and beginning and ending dates of the reporting period.

(4) If you had a malfunction during the reporting period, the compliance report must include the number, duration, and a brief description for each type of malfunction which occurred during the reporting period and which caused or may have caused any applicable emission limitation to be exceeded. The report must also include a description of actions taken by an owner or operator during a malfunction of an affected source to minimize emissions in accordance with §63.6605(b), including actions taken to correct a malfunction.

(5) If there are no deviations from any emission or operating limitations that apply to you, a statement that there were no deviations from the emission or operating limitations during the reporting period.

(6) If there were no periods during which the continuous monitoring system (CMS), including CEMS and CPMS, was out-of-control, as specified in §63.8(c)(7), a statement that there were no periods during which the CMS was out-of-control during the reporting period.

(d) For each deviation from an emission or operating limitation that occurs for a stationary RICE where you are not using a CMS to comply with the emission or operating limitations in this subpart, the Compliance report must contain the information in paragraphs (c)(1) through (4) of this section and the information in paragraphs (d)(1) and (2) of this section.

(1) The total operating time of the stationary RICE at which the deviation occurred during the reporting period.

(2) Information on the number, duration, and cause of deviations (including unknown cause, if applicable), as applicable, and the corrective action taken.

(e) For each deviation from an emission or operating limitation occurring for a stationary RICE where you are using a CMS to comply with the emission and operating limitations in this subpart, you must include information in paragraphs (c)(1) through (4) and (e)(1) through (12) of this section.

(1) The date and time that each malfunction started and stopped.

(2) The date, time, and duration that each CMS was inoperative, except for zero (low-level) and high-level checks.

(3) The date, time, and duration that each CMS was out-of-control, including the information in §63.8(c)(8).

(4) The date and time that each deviation started and stopped, and whether each deviation occurred during a period of malfunction or during another period.

(5) A summary of the total duration of the deviation during the reporting period, and the total duration as a percent of the total source operating time during that reporting period.

(6) A breakdown of the total duration of the deviations during the reporting period into those that are due to control equipment problems, process problems, other known causes, and other unknown causes.

(7) A summary of the total duration of CMS downtime during the reporting period, and the total duration of CMS downtime as a percent of the total operating time of the stationary RICE at which the CMS downtime occurred during that reporting period.

(8) An identification of each parameter and pollutant (CO or formaldehyde) that was monitored at the stationary RICE.

(9) A brief description of the stationary RICE.

(10) A brief description of the CMS.

(11) The date of the latest CMS certification or audit.

(12) A description of any changes in CMS, processes, or controls since the last reporting period.

(f) Each affected source that has obtained a title V operating permit pursuant to 40 CFR part 70 or 71 must report all deviations as defined in this subpart in the semiannual monitoring report required by 40 CFR 70.6 (a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A). If an affected source submits a Compliance report pursuant to Table 7 of this subpart along with, or as part of, the semiannual monitoring report required by 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A), and the Compliance report includes all required information concerning deviations from any emission or operating limitation in this subpart, submission of the Compliance report shall be deemed to satisfy any obligation to report the same deviations in the semiannual monitoring report. However, submission of a Compliance report shall not otherwise affect any obligation the affected source may have to report deviations from permit requirements to the permit authority.

(g) If you are operating as a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must submit an annual report according to Table 7 of this subpart by the date specified unless the Administrator has approved a different schedule, according to the information described in paragraphs (b)(1) through (b)(5) of this section. You must report the data specified in (g)(1) through (g)(3) of this section.

(1) Fuel flow rate of each fuel and the heating values that were used in your calculations. You must also demonstrate that the percentage of heat input provided by landfill gas or digester gas is equivalent to 10 percent or more of the total fuel consumption on an annual basis.

(2) The operating limits provided in your federally enforceable permit, and any deviations from these limits.

(3) Any problems or errors suspected with the meters.

(h) If you own or operate an emergency stationary RICE with a site rating of more than 100 brake HP that operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §63.6640(f)(2)(ii) and (iii) or that operates for the purpose specified in §63.6640(f)(4)(ii), you must submit an annual report according to the requirements in paragraphs (h)(1) through (3) of this section.

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v) Hours operated for the purposes specified in §63.6640(f)(2)(ii) and (iii), including the date, start time, and end time for engine operation for the purposes specified in §63.6640(f)(2)(ii) and (iii).

(vi) Number of hours the engine is contractually obligated to be available for the purposes specified in §63.6640(f)(2)(ii) and (iii).

(vii) Hours spent for operation for the purpose specified in §63.6640(f)(4)(ii), including the date, start time, and end time for engine operation for the purposes specified in §63.6640(f)(4)(ii). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(viii) If there were no deviations from the fuel requirements in §63.6604 that apply to the engine (if any), a statement that there were no deviations from the fuel requirements during the reporting period.

(ix) If there were deviations from the fuel requirements in §63.6604 that apply to the engine (if any), information on the number, duration, and cause of deviations, and the corrective action taken.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in §63.13.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9677, Mar. 3, 2010; 78 FR 6705, Jan. 30, 2013]

[↑ Back to Top](#)

### **§63.6655 What records must I keep?**

(a) If you must comply with the emission and operating limitations, you must keep the records described in paragraphs (a)(1) through (a)(5), (b)(1) through (b)(3) and (c) of this section.

(1) A copy of each notification and report that you submitted to comply with this subpart, including all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted, according to the requirement in §63.10(b)(2)(xiv).

(2) Records of the occurrence and duration of each malfunction of operation (*i.e.*, process equipment) or the air pollution control and monitoring equipment.

(3) Records of performance tests and performance evaluations as required in §63.10(b)(2)(viii).

(4) Records of all required maintenance performed on the air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation.

(b) For each CEMS or CPMS, you must keep the records listed in paragraphs (b)(1) through (3) of this section.

(1) Records described in §63.10(b)(2)(vi) through (xi).

(2) Previous (*i.e.*, superseded) versions of the performance evaluation plan as required in §63.8(d)(3).

(3) Requests for alternatives to the relative accuracy test for CEMS or CPMS as required in §63.8(f)(6)(i), if applicable.

(c) If you are operating a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must keep the records of your daily fuel usage monitors.

(d) You must keep the records required in Table 6 of this subpart to show continuous compliance with each emission or operating limitation that applies to you.

(e) You must keep records of the maintenance conducted on the stationary RICE in order to demonstrate that you operated and maintained the stationary RICE and after-treatment control device (if any) according to your own maintenance plan if you own or operate any of the following stationary RICE;

(1) An existing stationary RICE with a site rating of less than 100 brake HP located at a major source of HAP emissions.

(2) An existing stationary emergency RICE.

(3) An existing stationary RICE located at an area source of HAP emissions subject to management practices as shown in Table 2d to this subpart.

(f) If you own or operate any of the stationary RICE in paragraphs (f)(1) through (2) of this section, you must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. The owner or operator must document how many hours are spent for emergency operation, including what classified the operation as emergency and how many hours are spent for non-emergency operation. If the engine is used for the purposes specified in §63.6640(f)(2)(ii) or (iii) or §63.6640(f)(4)(ii), the owner or operator must keep records of the notification of the emergency situation, and the date, start time, and end time of engine operation for these purposes.

(1) An existing emergency stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions that does not meet the standards applicable to non-emergency engines.

(2) An existing emergency stationary RICE located at an area source of HAP emissions that does not meet the standards applicable to non-emergency engines.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 78 FR 6706, Jan. 30, 2013]

 [Back to Top](#)

### **§63.6660 In what form and how long must I keep my records?**

(a) Your records must be in a form suitable and readily available for expeditious review according to §63.10(b)(1).

(b) As specified in §63.10(b)(1), you must keep each record for 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record.

(c) You must keep each record readily accessible in hard copy or electronic form for at least 5 years after the date of each occurrence, measurement, maintenance, corrective action, report, or record, according to §63.10(b)(1).

[69 FR 33506, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010]

 [Back to Top](#)

## **OTHER REQUIREMENTS AND INFORMATION**

 [Back to Top](#)

### **§63.6665 What parts of the General Provisions apply to me?**

Table 8 to this subpart shows which parts of the General Provisions in §§63.1 through 63.15 apply to you. If you own or operate a new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions (except new or reconstructed 4SLB engines greater than or equal to 250 and less than or equal to 500 brake HP), a new or reconstructed stationary RICE located at an area source of HAP emissions, or any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with any of the requirements of the General Provisions specified in Table 8: An existing 2SLB stationary RICE, an existing 4SLB stationary RICE, an existing stationary RICE that combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, an existing emergency stationary RICE, or an existing limited use stationary RICE. If you own or operate any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in the General Provisions specified in Table 8 except for the initial notification requirements: A new stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, a new emergency stationary RICE, or a new limited use stationary RICE.

[75 FR 9678, Mar. 3, 2010]

 [Back to Top](#)

### **§63.6670 Who implements and enforces this subpart?**

(a) This subpart is implemented and enforced by the U.S. EPA, or a delegated authority such as your State, local, or tribal agency. If the U.S. EPA Administrator has delegated authority to your State, local, or tribal agency, then that agency (as well as the U.S. EPA) has the authority to implement and enforce this subpart. You should contact your U.S. EPA Regional Office to find out whether this subpart is delegated to your State, local, or tribal agency.

(b) In delegating implementation and enforcement authority of this subpart to a State, local, or tribal agency under 40 CFR part 63, subpart E, the authorities contained in paragraph (c) of this section are retained by the Administrator of the U.S. EPA and are not transferred to the State, local, or tribal agency.

(c) The authorities that will not be delegated to State, local, or tribal agencies are:

(1) Approval of alternatives to the non-opacity emission limitations and operating limitations in §63.6600 under §63.6(g).

(2) Approval of major alternatives to test methods under §63.7(e)(2)(ii) and (f) and as defined in §63.90.

(3) Approval of major alternatives to monitoring under §63.8(f) and as defined in §63.90.

(4) Approval of major alternatives to recordkeeping and reporting under §63.10(f) and as defined in §63.90.

(5) Approval of a performance test which was conducted prior to the effective date of the rule, as specified in §63.6610(b).

[↑ Back to Top](#)

### **§63.6675 What definitions apply to this subpart?**

Terms used in this subpart are defined in the Clean Air Act (CAA); in 40 CFR 63.2, the General Provisions of this part; and in this section as follows:

*Alaska Railbelt Grid* means the service areas of the six regulated public utilities that extend from Fairbanks to Anchorage and the Kenai Peninsula. These utilities are Golden Valley Electric Association; Chugach Electric Association; Matanuska Electric Association; Homer Electric Association; Anchorage Municipal Light & Power; and the City of Seward Electric System.

*Area source* means any stationary source of HAP that is not a major source as defined in part 63.

*Associated equipment* as used in this subpart and as referred to in section 112(n)(4) of the CAA, means equipment associated with an oil or natural gas exploration or production well, and includes all equipment from the well bore to the point of custody transfer, except glycol dehydration units, storage vessels with potential for flash emissions, combustion turbines, and stationary RICE.



*Backup power for renewable energy* means an engine that provides backup power to a facility that generates electricity from renewable energy resources, as that term is defined in Alaska Statute 42.45.045(l)(5) (incorporated by reference, see §63.14).

*Black start engine* means an engine whose only purpose is to start up a combustion turbine.

*CAA* means the Clean Air Act (42 U.S.C. 7401 *et seq.*, as amended by Public Law 101-549, 104 Stat. 2399).

*Commercial emergency stationary RICE* means an emergency stationary RICE used in commercial establishments such as office buildings, hotels, stores, telecommunications facilities, restaurants, financial institutions such as banks, doctor's offices, and sports and performing arts facilities.

*Compression ignition* means relating to a type of stationary internal combustion engine that is not a spark ignition engine.

*Custody transfer* means the transfer of hydrocarbon liquids or natural gas: After processing and/or treatment in the producing operations, or from storage vessels or automatic transfer facilities or other such equipment, including product loading racks, to pipelines or any other forms of transportation. For the purposes of this subpart, the point at which such liquids or natural gas enters a natural gas processing plant is a point of custody transfer.

*Deviation* means any instance in which an affected source subject to this subpart, or an owner or operator of such a source:

(1) Fails to meet any requirement or obligation established by this subpart, including but not limited to any emission limitation or operating limitation;

(2) Fails to meet any term or condition that is adopted to implement an applicable requirement in this subpart and that is included in the operating permit for any affected source required to obtain such a permit; or

(3) Fails to meet any emission limitation or operating limitation in this subpart during malfunction, regardless of whether or not such failure is permitted by this subpart.

(4) Fails to satisfy the general duty to minimize emissions established by §63.6(e)(1)(i).

*Diesel engine* means any stationary RICE in which a high boiling point liquid fuel injected into the combustion chamber ignites when the air charge has been compressed to a temperature sufficiently high for auto-ignition. This process is also known as compression ignition.

*Diesel fuel* means any liquid obtained from the distillation of petroleum with a boiling point of approximately 150 to 360 degrees Celsius. One commonly used form is fuel oil number 2. Diesel fuel also includes any non-distillate fuel with comparable physical and chemical properties (e.g. biodiesel) that is suitable for use in compression ignition engines.

*Digester gas* means any gaseous by-product of wastewater treatment typically formed through the anaerobic decomposition of organic waste materials and composed principally of methane and CO<sub>2</sub>.

*Dual-fuel engine* means any stationary RICE in which a liquid fuel (typically diesel fuel) is used for compression ignition and gaseous fuel (typically natural gas) is used as the primary fuel.

*Emergency stationary RICE* means any stationary reciprocating internal combustion engine that meets all of the criteria in paragraphs (1) through (3) of this definition. All emergency stationary RICE must comply with the requirements specified in §63.6640(f) in order to be considered emergency stationary RICE. If the engine does not comply with the requirements specified in §63.6640(f), then it is not considered to be an emergency stationary RICE under this subpart.

(1) The stationary RICE is operated to provide electrical power or mechanical work during an emergency situation. Examples include stationary RICE used to produce power for critical networks or equipment (including power supplied to portions of a facility) when electric power from the local utility (or the normal power source, if the facility runs on its own power production) is interrupted, or stationary RICE used to pump water in the case of fire or flood, etc.

(2) The stationary RICE is operated under limited circumstances for situations not included in paragraph (1) of this definition, as specified in §63.6640(f).

(3) The stationary RICE operates as part of a financial arrangement with another entity in situations not included in paragraph (1) of this definition only as allowed in §63.6640(f)(2)(ii) or (iii) and §63.6640(f)(4)(i) or (ii).

*Engine startup* means the time from initial start until applied load and engine and associated equipment reaches steady state or normal operation. For stationary engine with catalytic controls, engine startup means the time from initial start until applied load and engine and associated equipment, including the catalyst, reaches steady state or normal operation.

*Four-stroke engine* means any type of engine which completes the power cycle in two crankshaft revolutions, with intake and compression strokes in the first revolution and power and exhaust strokes in the second revolution.

*Gaseous fuel* means a material used for combustion which is in the gaseous state at standard atmospheric temperature and pressure conditions.

*Gasoline* means any fuel sold in any State for use in motor vehicles and motor vehicle engines, or nonroad or stationary engines, and commonly or commercially known or sold as gasoline.

*Glycol dehydration unit* means a device in which a liquid glycol (including, but not limited to, ethylene glycol, diethylene glycol, or triethylene glycol) absorbent directly contacts a natural gas stream and absorbs water in a contact tower or absorption column (absorber). The glycol contacts and absorbs water vapor and other gas stream constituents from the natural gas and becomes "rich" glycol. This glycol is then regenerated in the glycol dehydration unit reboiler. The "lean" glycol is then recycled.

*Hazardous air pollutants (HAP)* means any air pollutants listed in or pursuant to section 112(b) of the CAA.

*Institutional emergency stationary RICE* means an emergency stationary RICE used in institutional establishments such as medical centers, nursing homes, research centers, institutions of higher education, correctional facilities, elementary and secondary schools, libraries, religious establishments, police stations, and fire stations.

*ISO standard day conditions* means 288 degrees Kelvin (15 degrees Celsius), 60 percent relative humidity and 101.3 kilopascals pressure.

*Landfill gas* means a gaseous by-product of the land application of municipal refuse typically formed through the anaerobic decomposition of waste materials and composed principally of methane and CO<sub>2</sub>.

*Lean burn engine* means any two-stroke or four-stroke spark ignited engine that does not meet the definition of a rich burn engine.

*Limited use stationary RICE* means any stationary RICE that operates less than 100 hours per year.

*Liquefied petroleum gas* means any liquefied hydrocarbon gas obtained as a by-product in petroleum refining or natural gas production.

*Liquid fuel* means any fuel in liquid form at standard temperature and pressure, including but not limited to diesel, residual/crude oil, kerosene/naphtha (jet fuel), and gasoline.

*Major Source*, as used in this subpart, shall have the same meaning as in §63.2, except that:

(1) Emissions from any oil or gas exploration or production well (with its associated equipment (as defined in this section)) and emissions from any pipeline compressor station or pump station shall not be aggregated with emissions from other similar units, to determine whether such emission points or stations are major sources, even when emission points are in a contiguous area or under common control;

(2) For oil and gas production facilities, emissions from processes, operations, or equipment that are not part of the same oil and gas production facility, as defined in §63.1271 of subpart HHH of this part, shall not be aggregated;

(3) For production field facilities, only HAP emissions from glycol dehydration units, storage vessel with the potential for flash emissions, combustion turbines and reciprocating internal combustion engines shall be aggregated for a major source determination; and

(4) Emissions from processes, operations, and equipment that are not part of the same natural gas transmission and storage facility, as defined in §63.1271 of subpart HHH of this part, shall not be aggregated.

*Malfunction* means any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner which causes, or has the potential to cause, the emission limitations in an applicable standard to be exceeded. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.

*Natural gas* means a naturally occurring mixture of hydrocarbon and non-hydrocarbon gases found in geologic formations beneath the Earth's surface, of which the principal constituent is methane. Natural gas may be field or pipeline quality.

*Non-selective catalytic reduction (NSCR)* means an add-on catalytic nitrogen oxides (NO<sub>x</sub>) control device for rich burn engines that, in a two-step reaction, promotes the conversion of excess oxygen, NO<sub>x</sub>, CO, and volatile organic compounds (VOC) into CO<sub>2</sub>, nitrogen, and water.

*Oil and gas production facility* as used in this subpart means any grouping of equipment where hydrocarbon liquids are processed, upgraded (*i.e.*, remove impurities or other constituents to meet contract specifications), or stored prior to the point of custody transfer; or where natural gas is processed, upgraded, or stored prior to entering the natural gas transmission and storage source category. For purposes of a major source determination, facility (including a building, structure, or installation) means oil and natural gas production and processing equipment that is located within the boundaries of an individual surface site as defined in this section. Equipment that is part of a facility will typically be located within close proximity to other equipment located at the same facility. Pieces of production equipment or groupings of equipment located on different oil and gas leases, mineral fee tracts, lease tracts, subsurface or surface unit areas, surface fee tracts, surface lease tracts, or separate surface sites, whether or not connected by a road, waterway, power line or pipeline, shall not be considered part of the same facility. Examples of facilities in the oil and natural gas production source category include, but are not limited to, well sites, satellite tank batteries, central tank batteries, a compressor station that transports natural gas to a natural gas processing plant, and natural gas processing plants.

*Oxidation catalyst* means an add-on catalytic control device that controls CO and VOC by oxidation.

*Peaking unit or engine* means any standby engine intended for use during periods of high demand that are not emergencies.

*Percent load* means the fractional power of an engine compared to its maximum manufacturer's design capacity at engine site conditions. Percent load may range between 0 percent to above 100 percent.

*Potential to emit* means the maximum capacity of a stationary source to emit a pollutant under its physical and operational design. Any physical or operational limitation on the capacity of the stationary source to emit a pollutant, including air pollution control equipment and restrictions on hours of operation or on the type or amount of material combusted, stored, or processed, shall be treated as part of its design if the limitation or the effect it would have on emissions is federally enforceable. For oil and natural gas production facilities subject to subpart HH of this part, the potential to emit provisions in §63.760(a) may be used. For natural gas transmission and storage facilities subject to subpart HHH of this part, the maximum annual facility gas throughput for storage facilities may be determined according to §63.1270(a)(1) and the maximum annual throughput for transmission facilities may be determined according to §63.1270(a)(2).

*Production field facility* means those oil and gas production facilities located prior to the point of custody transfer.

*Production well* means any hole drilled in the earth from which crude oil, condensate, or field natural gas is extracted.

*Propane* means a colorless gas derived from petroleum and natural gas, with the molecular structure C<sub>3</sub>H<sub>8</sub>.

*Remote stationary RICE* means stationary RICE meeting any of the following criteria:

(1) Stationary RICE located in an offshore area that is beyond the line of ordinary low water along that portion of the coast of the United States that is in direct contact with the open seas and beyond the line marking the seaward limit of inland waters.

(2) Stationary RICE located on a pipeline segment that meets both of the criteria in paragraphs (2)(i) and (ii) of this definition.

(i) A pipeline segment with 10 or fewer buildings intended for human occupancy and no buildings with four or more stories within 220 yards (200 meters) on either side of the centerline of any continuous 1-mile (1.6 kilometers) length of pipeline. Each separate dwelling unit in a multiple dwelling unit building is counted as a separate building intended for human occupancy.

(ii) The pipeline segment does not lie within 100 yards (91 meters) of either a building or a small, well-defined outside area (such as a playground, recreation area, outdoor theater, or other place of public assembly) that is occupied by 20 or more persons on at least 5 days a week for 10 weeks in any 12-month period. The days and weeks need not be consecutive. The building or area is considered occupied for a full day if it is occupied for any portion of the day.

(iii) For purposes of this paragraph (2), the term pipeline segment means all parts of those physical facilities through which gas moves in transportation, including but not limited to pipe, valves, and other appurtenance attached to pipe, compressor units, metering stations, regulator stations, delivery stations, holders, and fabricated assemblies. Stationary RICE located within 50 yards (46 meters) of the pipeline segment providing power for equipment on a pipeline segment are part of the pipeline segment. Transportation of gas means the gathering, transmission, or distribution of gas by pipeline, or the storage of gas. A building is intended for human occupancy if its primary use is for a purpose involving the presence of humans.

(3) Stationary RICE that are not located on gas pipelines and that have 5 or fewer buildings intended for human occupancy and no buildings with four or more stories within a 0.25 mile radius around the engine. A building is intended for human occupancy if its primary use is for a purpose involving the presence of humans.

*Residential emergency stationary RICE* means an emergency stationary RICE used in residential establishments such as homes or apartment buildings.

*Responsible official* means responsible official as defined in 40 CFR 70.2.

*Rich burn engine* means any four-stroke spark ignited engine where the manufacturer's recommended operating air/fuel ratio divided by the stoichiometric air/fuel ratio at full load conditions is less than or equal to 1.1. Engines originally manufactured as rich burn engines, but modified prior to December 19, 2002 with passive emission control technology for NO<sub>x</sub> (such as pre-combustion chambers) will be considered lean burn engines. Also, existing engines where there are no manufacturer's recommendations regarding air/fuel ratio will be considered a rich burn engine if the excess oxygen content of the exhaust at full load conditions is less than or equal to 2 percent.

*Site-rated HP* means the maximum manufacturer's design capacity at engine site conditions.

*Spark ignition* means relating to either: A gasoline-fueled engine; or any other type of engine with a spark plug (or other sparking device) and with operating characteristics significantly similar to the theoretical Otto combustion cycle. Spark ignition engines usually use a throttle to regulate intake air flow to control power during normal operation. Dual-fuel engines in which a liquid fuel (typically diesel fuel) is used for CI and gaseous fuel (typically natural gas) is used as the primary fuel at an

annual average ratio of less than 2 parts diesel fuel to 100 parts total fuel on an energy equivalent basis are spark ignition engines.

*Stationary reciprocating internal combustion engine (RICE)* means any reciprocating internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work and which is not mobile. Stationary RICE differ from mobile RICE in that a stationary RICE is not a non-road engine as defined at 40 CFR 1068.30, and is not used to propel a motor vehicle or a vehicle used solely for competition.

*Stationary RICE test cell/stand* means an engine test cell/stand, as defined in subpart P P P P P of this part, that tests stationary RICE.

*Stoichiometric* means the theoretical air-to-fuel ratio required for complete combustion.

*Storage vessel with the potential for flash emissions* means any storage vessel that contains a hydrocarbon liquid with a stock tank gas-to-oil ratio equal to or greater than 0.31 cubic meters per liter and an American Petroleum Institute gravity equal to or greater than 40 degrees and an actual annual average hydrocarbon liquid throughput equal to or greater than 79,500 liters per day. Flash emissions occur when dissolved hydrocarbons in the fluid evolve from solution when the fluid pressure is reduced.

*Subpart* means 40 CFR part 63, subpart Z Z Z Z.

*Surface site* means any combination of one or more graded pad sites, gravel pad sites, foundations, platforms, or the immediate physical location upon which equipment is physically affixed.

*Two-stroke engine* means a type of engine which completes the power cycle in single crankshaft revolution by combining the intake and compression operations into one stroke and the power and exhaust operations into a second stroke. This system requires auxiliary scavenging and inherently runs lean of stoichiometric.

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3607, Jan. 18, 2008; 75 FR 9679, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 76 FR 12867, Mar. 9, 2011; 78 FR 6706, Jan. 30, 2013]

 [Back to Top](#)

**Table 1a to Subpart Z Z Z Z of Part 63—Emission Limitations for Existing, New, and Reconstructed Spark Ignition, 4SRB Stationary RICE >500 HP Located at a Major Source of HAP Emissions**

As stated in §§63.6600 and 63.6640, you must comply with the following emission limitations at 100 percent load plus or minus 10 percent for existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions:

| For each . . . | You must meet the following emission limitation, except during periods of startup . . . | During periods of startup you must . . . |
|----------------|-----------------------------------------------------------------------------------------|------------------------------------------|
| 1. 4SRB        | a. Reduce formaldehyde emissions by 76                                                  | Minimize the engine's time spent at idle |

|                 |                                                                                                                                                                                                  |                                                                                                                                                                                                                          |
|-----------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| stationary RICE | percent or more. If you commenced construction or reconstruction between December 19, 2002 and June 15, 2004, you may reduce formaldehyde emissions by 75 percent or more until June 15, 2007 or | and minimize the engine's startup time at startup to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the non-startup emission limitations apply. <sup>1</sup> |
|                 | b. Limit the concentration of formaldehyde in the stationary RICE exhaust to 350 ppbvd or less at 15 percent O <sub>2</sub>                                                                      |                                                                                                                                                                                                                          |

<sup>1</sup> Sources can petition the Administrator pursuant to the requirements of 40 CFR 63.6(g) for alternative work practices.

[75 FR 9679, Mar. 3, 2010, as amended at 75 FR 51592, Aug. 20, 2010]

[↑ Back to Top](#)

**Table 1b to Subpart ZZZZ of Part 63—Operating Limitations for Existing, New, and Reconstructed SI 4SRB Stationary RICE >500 HP Located at a Major Source of HAP Emissions**

As stated in §§63.6600, 63.6603, 63.6630 and 63.6640, you must comply with the following operating limitations for existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions:

| For each . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   | You must meet the following operating limitation, except during periods of startup . . .                                                                                                                                                                                                                                                                                                                                                                  |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions complying with the requirement to reduce formaldehyde emissions by 76 percent or more (or by 75 percent or more, if applicable) and using NSCR; or existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions complying with the requirement to limit the concentration of formaldehyde in the stationary RICE exhaust to 350 ppbvd or less at 15 percent O <sub>2</sub> and using NSCR; | a. maintain your catalyst so that the pressure drop across the catalyst does not change by more than 2 inches of water at 100 percent load plus or minus 10 percent from the pressure drop across the catalyst measured during the initial performance test; and<br>b. maintain the temperature of your stationary RICE exhaust so that the catalyst inlet temperature is greater than or equal to 750 °F and less than or equal to 1250 °F. <sup>1</sup> |
| 2. existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions complying with the requirement to reduce formaldehyde emissions by 76 percent or more (or by 75 percent or more,                                                                                                                                                                                                                                                                                                                      | Comply with any operating limitations approved by the Administrator.                                                                                                                                                                                                                                                                                                                                                                                      |

|                                                                                                                                                                                                                                                                                        |  |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| if applicable) and not using NSCR; or                                                                                                                                                                                                                                                  |  |
| existing, new and reconstructed 4SRB stationary RICE >500 HP located at a major source of HAP emissions complying with the requirement to limit the concentration of formaldehyde in the stationary RICE exhaust to 350 ppbvd or less at 15 percent O <sub>2</sub> and not using NSCR. |  |

<sup>1</sup>Sources can petition the Administrator pursuant to the requirements of 40 CFR 63.8(f) for a different temperature range.

[78 FR 6706, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 2a to Subpart ZZZZ of Part 63—Emission Limitations for New and Reconstructed 2SLB and Compression Ignition Stationary RICE >500 HP and New and Reconstructed 4SLB Stationary RICE ≥250 HP Located at a Major Source of HAP Emissions**

As stated in §§63.6600 and 63.6640, you must comply with the following emission limitations for new and reconstructed lean burn and new and reconstructed compression ignition stationary RICE at 100 percent load plus or minus 10 percent:

| <b>For each . . .</b>   | <b>You must meet the following emission limitation, except during periods of startup . . .</b>                                                                                                                                                                                                                                                                                             | <b>During periods of startup you must . . .</b>                                                                                                                                                                                                                   |
|-------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. 2SLB stationary RICE | a. Reduce CO emissions by 58 percent or more; or<br>b. Limit concentration of formaldehyde in the stationary RICE exhaust to 12 ppmvd or less at 15 percent O <sub>2</sub> . If you commenced construction or reconstruction between December 19, 2002 and June 15, 2004, you may limit concentration of formaldehyde to 17 ppmvd or less at 15 percent O <sub>2</sub> until June 15, 2007 | Minimize the engine's time spent at idle and minimize the engine's startup time at startup to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the non-startup emission limitations apply. <sup>1</sup> |
| 2. 4SLB stationary RICE | a. Reduce CO emissions by 93 percent or more; or<br>b. Limit concentration of formaldehyde in the stationary RICE exhaust to 14 ppmvd or less at 15 percent O <sub>2</sub>                                                                                                                                                                                                                 |                                                                                                                                                                                                                                                                   |
| 3. CI stationary RICE   | a. Reduce CO emissions by 70 percent or more; or                                                                                                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                   |



|  |                                                                                                                         |  |
|--|-------------------------------------------------------------------------------------------------------------------------|--|
|  | b. Limit concentration of formaldehyde in the stationary RICE exhaust to 580 ppbvd or less at 15 percent O <sub>2</sub> |  |
|--|-------------------------------------------------------------------------------------------------------------------------|--|

<sup>1</sup>Sources can petition the Administrator pursuant to the requirements of 40 CFR 63.6(g) for alternative work practices.

[75 FR 9680, Mar. 3, 2010]

[↑ Back to Top](#)

**Table 2b to Subpart ZZZZ of Part 63—Operating Limitations for New and Reconstructed 2SLB and CI Stationary RICE >500 HP Located at a Major Source of HAP Emissions, New and Reconstructed 4SLB Stationary RICE ≥250 HP Located at a Major Source of HAP Emissions, Existing CI Stationary RICE >500 HP**

As stated in §§63.6600, 63.6601, 63.6603, 63.6630, and 63.6640, you must comply with the following operating limitations for new and reconstructed 2SLB and CI stationary RICE >500 HP located at a major source of HAP emissions; new and reconstructed 4SLB stationary RICE ≥250 HP located at a major source of HAP emissions; and existing CI stationary RICE >500 HP:

| <b>For each . . .</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | <b>You must meet the following operating limitation, except during periods of startup . . .</b>                                                                                                                                                                                                                                                                                                                                                                    |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. New and reconstructed 2SLB and CI stationary RICE >500 HP located at a major source of HAP emissions and new and reconstructed 4SLB stationary RICE ≥250 HP located at a major source of HAP emissions complying with the requirement to reduce CO emissions and using an oxidation catalyst; and<br>New and reconstructed 2SLB and CI stationary RICE >500 HP located at a major source of HAP emissions and new and reconstructed 4SLB stationary RICE ≥250 HP located at a major source of HAP emissions complying with the requirement to limit the concentration of formaldehyde in the stationary RICE exhaust and using an oxidation catalyst. | a. maintain your catalyst so that the pressure drop across the catalyst does not change by more than 2 inches of water at 100 percent load plus or minus 10 percent from the pressure drop across the catalyst that was measured during the initial performance test; and<br>b. maintain the temperature of your stationary RICE exhaust so that the catalyst inlet temperature is greater than or equal to 450 °F and less than or equal to 1350 °F. <sup>1</sup> |
| 2. Existing CI stationary RICE >500 HP complying with the requirement to limit or reduce the concentration of CO in the stationary RICE exhaust and using an oxidation catalyst                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | a. maintain your catalyst so that the pressure drop across the catalyst does not change by more than 2 inches of water from the pressure drop across the catalyst that was measured during the initial performance test; and                                                                                                                                                                                                                                       |

|                                                                                                                                                                                                                                                                                                                                                          |                                                                                                                                                                                       |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                                                                                                                                                                                                                          | b. maintain the temperature of your stationary RICE exhaust so that the catalyst inlet temperature is greater than or equal to 450 °F and less than or equal to 1350 °F. <sup>1</sup> |
| 3. New and reconstructed 2SLB and CI stationary RICE >500 HP located at a major source of HAP emissions and new and reconstructed 4SLB stationary RICE ≥250 HP located at a major source of HAP emissions complying with the requirement to reduce CO emissions and not using an oxidation catalyst; and                                                 | Comply with any operating limitations approved by the Administrator.                                                                                                                  |
| New and reconstructed 2SLB and CI stationary RICE >500 HP located at a major source of HAP emissions and new and reconstructed 4SLB stationary RICE ≥250 HP located at a major source of HAP emissions complying with the requirement to limit the concentration of formaldehyde in the stationary RICE exhaust and not using an oxidation catalyst; and |                                                                                                                                                                                       |
| existing CI stationary RICE >500 HP complying with the requirement to limit or reduce the concentration of CO in the stationary RICE exhaust and not using an oxidation catalyst.                                                                                                                                                                        |                                                                                                                                                                                       |

<sup>1</sup>Sources can petition the Administrator pursuant to the requirements of 40 CFR 63.8(f) for a different temperature range.

[78 FR 6707, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 2c to Subpart ZZZZ of Part 63—Requirements for Existing Compression Ignition Stationary RICE Located at a Major Source of HAP Emissions and Existing Spark Ignition Stationary RICE ≤500 HP Located at a Major Source of HAP Emissions**

As stated in §§63.6600, 63.6602, and 63.6640, you must comply with the following requirements for existing compression ignition stationary RICE located at a major source of HAP emissions and existing spark ignition stationary RICE ≤500 HP located at a major source of HAP emissions:

|                       |                                                                                        |                                                 |
|-----------------------|----------------------------------------------------------------------------------------|-------------------------------------------------|
| <b>For each . . .</b> | <b>You must meet the following requirement, except during periods of startup . . .</b> | <b>During periods of startup you must . . .</b> |
|-----------------------|----------------------------------------------------------------------------------------|-------------------------------------------------|

|                                                                                       |                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                                                                                                                                                         |
|---------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>1. Emergency stationary CI RICE and black start stationary CI RICE<sup>1</sup></p> | <p>a. Change oil and filter every 500 hours of operation or annually, whichever comes first.<sup>2</sup><br/> b. Inspect air cleaner every 1,000 hours of operation or annually, whichever comes first, and replace as necessary;<br/> c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary.<sup>3</sup></p>   | <p>Minimize the engine's time spent at idle and minimize the engine's startup time at startup to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the non-startup emission limitations apply.<sup>3</sup></p> |
| <p>2. Non-Emergency, non-black start stationary CI RICE &lt;100 HP</p>                | <p>a. Change oil and filter every 1,000 hours of operation or annually, whichever comes first.<sup>2</sup><br/> b. Inspect air cleaner every 1,000 hours of operation or annually, whichever comes first, and replace as necessary;<br/> c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary.<sup>3</sup></p> |                                                                                                                                                                                                                                                                         |
| <p>3. Non-Emergency, non-black start CI stationary RICE<br/> 100≤HP≤300 HP</p>        | <p>Limit concentration of CO in the stationary RICE exhaust to 230 ppmvd or less at 15 percent O<sub>2</sub>.</p>                                                                                                                                                                                                                                                                  |                                                                                                                                                                                                                                                                         |
| <p>4. Non-Emergency, non-black start CI stationary RICE<br/> 300&lt;HP≤500</p>        | <p>a. Limit concentration of CO in the stationary RICE exhaust to 49 ppmvd or less at 15 percent O<sub>2</sub>; or<br/> b. Reduce CO emissions by 70 percent or more.</p>                                                                                                                                                                                                          |                                                                                                                                                                                                                                                                         |
| <p>5. Non-Emergency, non-black start stationary CI RICE &gt;500 HP</p>                | <p>a. Limit concentration of CO in the stationary RICE exhaust to 23 ppmvd or less at 15</p>                                                                                                                                                                                                                                                                                       |                                                                                                                                                                                                                                                                         |

|                                                                                                |                                                                                                                                                                                                                                                                                                                                                                         |  |
|------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
|                                                                                                | percent O <sub>2</sub> ; or<br>b. Reduce CO emissions by 70 percent or more.                                                                                                                                                                                                                                                                                            |  |
| 6. Emergency stationary SI RICE and black start stationary SI RICE. <sup>1</sup>               | a. Change oil and filter every 500 hours of operation or annually, whichever comes first; <sup>2</sup><br>b. Inspect spark plugs every 1,000 hours of operation or annually, whichever comes first, and replace as necessary;<br>c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary. <sup>3</sup> |  |
| 7. Non-Emergency, non-black start stationary SI RICE <100 HP that are not 2SLB stationary RICE | a. Change oil and filter every 1,440 hours of operation or annually, whichever comes first; <sup>2</sup><br>b. Inspect spark plugs every 1,440 hours of operation or annually, whichever comes first, and replace as necessary;                                                                                                                                         |  |
|                                                                                                | c. Inspect all hoses and belts every 1,440 hours of operation or annually, whichever comes first, and replace as necessary. <sup>3</sup>                                                                                                                                                                                                                                |  |
| 8. Non-Emergency, non-black start 2SLB stationary SI RICE <100 HP                              | a. Change oil and filter every 4,320 hours of operation or annually, whichever comes first; <sup>2</sup><br>b. Inspect spark plugs every 4,320 hours of operation or annually, whichever comes first, and replace as necessary;                                                                                                                                         |  |
|                                                                                                | c. Inspect all hoses and belts every 4,320 hours of operation or annually,                                                                                                                                                                                                                                                                                              |  |

|                                                                                                                                                                                      |                                                                                                                         |  |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------|--|
|                                                                                                                                                                                      | whichever comes first, and replace as necessary. <sup>3</sup>                                                           |  |
| 9. Non-emergency, non-black start 2SLB stationary RICE<br>100≤HP≤500                                                                                                                 | Limit concentration of CO in the stationary RICE exhaust to 225 ppmvd or less at 15 percent O <sub>2</sub> .            |  |
| 10. Non-emergency, non-black start 4SLB stationary RICE<br>100≤HP≤500                                                                                                                | Limit concentration of CO in the stationary RICE exhaust to 47 ppmvd or less at 15 percent O <sub>2</sub> .             |  |
| 11. Non-emergency, non-black start 4SRB stationary RICE<br>100≤HP≤500                                                                                                                | Limit concentration of formaldehyde in the stationary RICE exhaust to 10.3 ppmvd or less at 15 percent O <sub>2</sub> . |  |
| 12. Non-emergency, non-black start stationary RICE<br>100≤HP≤500 which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis | Limit concentration of CO in the stationary RICE exhaust to 177 ppmvd or less at 15 percent O <sub>2</sub> .            |  |

<sup>1</sup>If an emergency engine is operating during an emergency and it is not possible to shut down the engine in order to perform the work practice requirements on the schedule required in Table 2c of this subpart, or if performing the work practice on the required schedule would otherwise pose an unacceptable risk under federal, state, or local law, the work practice can be delayed until the emergency is over or the unacceptable risk under federal, state, or local law has abated. The work practice should be performed as soon as practicable after the emergency has ended or the unacceptable risk under federal, state, or local law has abated. Sources must report any failure to perform the work practice on the schedule required and the federal, state or local law under which the risk was deemed unacceptable.

<sup>2</sup>Sources have the option to utilize an oil analysis program as described in §63.6625(i) or (j) in order to extend the specified oil change requirement in Table 2c of this subpart.

<sup>3</sup>Sources can petition the Administrator pursuant to the requirements of 40 CFR 63.6(g) for alternative work practices.

[78 FR 6708, Jan. 30, 2013, as amended at 78 FR 14457, Mar. 6, 2013]

 [Back to Top](#)

**Table 2d to Subpart ZZZZ of Part 63—Requirements for Existing Stationary RICE Located at Area Sources of HAP Emissions**

As stated in §§63.6603 and 63.6640, you must comply with the following requirements for existing stationary RICE located at area sources of HAP emissions:

| <b>For each . . .</b>                                                           | <b>You must meet the following requirement, except during periods of startup . . .</b>                                                                                                                                                                                                                                                                       | <b>During periods of startup you must . . .</b>                                                                                                                                                                                                      |
|---------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. Non-Emergency, non-black start CI stationary RICE $\leq 300$ HP              | a. Change oil and filter every 1,000 hours of operation or annually, whichever comes first; <sup>1</sup><br>b. Inspect air cleaner every 1,000 hours of operation or annually, whichever comes first, and replace as necessary;<br>c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary. | Minimize the engine's time spent at idle and minimize the engine's startup time at startup to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the non-startup emission limitations apply. |
| 2. Non-Emergency, non-black start CI stationary RICE $300 < \text{HP} \leq 500$ | a. Limit concentration of CO in the stationary RICE exhaust to 49 ppmvd at 15 percent O <sub>2</sub> ; or                                                                                                                                                                                                                                                    |                                                                                                                                                                                                                                                      |
|                                                                                 | b. Reduce CO emissions by 70 percent or more.                                                                                                                                                                                                                                                                                                                |                                                                                                                                                                                                                                                      |
| 3. Non-Emergency, non-black start CI stationary RICE $> 500$ HP                 | a. Limit concentration of CO in the stationary RICE exhaust to 23 ppmvd at 15 percent O <sub>2</sub> ; or                                                                                                                                                                                                                                                    |                                                                                                                                                                                                                                                      |
|                                                                                 | b. Reduce CO emissions by 70 percent or more.                                                                                                                                                                                                                                                                                                                |                                                                                                                                                                                                                                                      |

|                                                                                                                                                                                                                                                                                                         |                                                                                                                                                                                                                                                                                                                                                                  |  |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| 4. Emergency stationary CI RICE and black start stationary CI RICE. <sup>2</sup>                                                                                                                                                                                                                        | a. Change oil and filter every 500 hours of operation or annually, whichever comes first; <sup>1</sup>                                                                                                                                                                                                                                                           |  |
|                                                                                                                                                                                                                                                                                                         | b. Inspect air cleaner every 1,000 hours of operation or annually, whichever comes first, and replace as necessary; and                                                                                                                                                                                                                                          |  |
|                                                                                                                                                                                                                                                                                                         | c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary.                                                                                                                                                                                                                                        |  |
| 5. Emergency stationary SI RICE; black start stationary SI RICE; non-emergency, non-black start 4SLB stationary RICE >500 HP that operate 24 hours or less per calendar year; non-emergency, non-black start 4SRB stationary RICE >500 HP that operate 24 hours or less per calendar year. <sup>2</sup> | a. Change oil and filter every 500 hours of operation or annually, whichever comes first; <sup>1</sup> ;<br>b. Inspect spark plugs every 1,000 hours of operation or annually, whichever comes first, and replace as necessary; and<br>c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 6. Non-emergency, non-black start 2SLB stationary RICE                                                                                                                                                                                                                                                  | a. Change oil and filter every 4,320 hours of operation or annually, whichever comes first; <sup>1</sup>                                                                                                                                                                                                                                                         |  |
|                                                                                                                                                                                                                                                                                                         | b. Inspect spark plugs every 4,320 hours of operation or annually, whichever comes first, and replace as necessary; and                                                                                                                                                                                                                                          |  |

|                                                                                                                                            |                                                                                                                             |  |
|--------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|--|
|                                                                                                                                            | c. Inspect all hoses and belts every 4,320 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 7. Non-emergency, non-black start 4SLB stationary RICE $\leq$ 500 HP                                                                       | a. Change oil and filter every 1,440 hours of operation or annually, whichever comes first; <sup>1</sup>                    |  |
|                                                                                                                                            | b. Inspect spark plugs every 1,440 hours of operation or annually, whichever comes first, and replace as necessary; and     |  |
|                                                                                                                                            | c. Inspect all hoses and belts every 1,440 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 8. Non-emergency, non-black start 4SLB remote stationary RICE >500 HP                                                                      | a. Change oil and filter every 2,160 hours of operation or annually, whichever comes first; <sup>1</sup>                    |  |
|                                                                                                                                            | b. Inspect spark plugs every 2,160 hours of operation or annually, whichever comes first, and replace as necessary; and     |  |
|                                                                                                                                            | c. Inspect all hoses and belts every 2,160 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 9. Non-emergency, non-black start 4SLB stationary RICE >500 HP that are not remote stationary RICE and that operate more than 24 hours per | Install an oxidation catalyst to reduce HAP emissions from the stationary RICE.                                             |  |



|                                                                                                                                                           |                                                                                                                             |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|--|
| calendar year                                                                                                                                             |                                                                                                                             |  |
| 10. Non-emergency, non-black start 4SRB stationary RICE $\leq$ 500 HP                                                                                     | a. Change oil and filter every 1,440 hours of operation or annually, whichever comes first; <sup>1</sup>                    |  |
|                                                                                                                                                           | b. Inspect spark plugs every 1,440 hours of operation or annually, whichever comes first, and replace as necessary; and     |  |
|                                                                                                                                                           | c. Inspect all hoses and belts every 1,440 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 11. Non-emergency, non-black start 4SRB remote stationary RICE >500 HP                                                                                    | a. Change oil and filter every 2,160 hours of operation or annually, whichever comes first; <sup>1</sup>                    |  |
|                                                                                                                                                           | b. Inspect spark plugs every 2,160 hours of operation or annually, whichever comes first, and replace as necessary; and     |  |
|                                                                                                                                                           | c. Inspect all hoses and belts every 2,160 hours of operation or annually, whichever comes first, and replace as necessary. |  |
| 12. Non-emergency, non-black start 4SRB stationary RICE >500 HP that are not remote stationary RICE and that operate more than 24 hours per calendar year | Install NSCR to reduce HAP emissions from the stationary RICE.                                                              |  |
| 13. Non-emergency, non-black start stationary RICE which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input       | a. Change oil and filter every 1,440 hours of operation or annually, whichever comes first; <sup>1</sup>                    |  |

|                    |                                                                                                                             |  |
|--------------------|-----------------------------------------------------------------------------------------------------------------------------|--|
| on an annual basis | b. Inspect spark plugs every 1,440 hours of operation or annually, whichever comes first, and replace as necessary; and     |  |
|                    | c. Inspect all hoses and belts every 1,440 hours of operation or annually, whichever comes first, and replace as necessary. |  |

<sup>1</sup>Sources have the option to utilize an oil analysis program as described in §63.6625(i) or (j) in order to extend the specified oil change requirement in Table 2d of this subpart.

<sup>2</sup>If an emergency engine is operating during an emergency and it is not possible to shut down the engine in order to perform the management practice requirements on the schedule required in Table 2d of this subpart, or if performing the management practice on the required schedule would otherwise pose an unacceptable risk under federal, state, or local law, the management practice can be delayed until the emergency is over or the unacceptable risk under federal, state, or local law has abated. The management practice should be performed as soon as practicable after the emergency has ended or the unacceptable risk under federal, state, or local law has abated. Sources must report any failure to perform the management practice on the schedule required and the federal, state or local law under which the risk was deemed unacceptable.

[78 FR 6709, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 3 to Subpart ZZZZ of Part 63—Subsequent Performance Tests**

As stated in §§63.6615 and 63.6620, you must comply with the following subsequent performance test requirements:

| <b>For each . . .</b>                                                                                                                                                                                                                   | <b>Complying with the requirement to . . .</b> | <b>You must . . .</b>                                           |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------|-----------------------------------------------------------------|
| 1. New or reconstructed 2SLB stationary RICE >500 HP located at major sources; new or reconstructed 4SLB stationary RICE ≥250 HP located at major sources; and new or reconstructed CI stationary RICE >500 HP located at major sources | Reduce CO emissions and not using a CEMS       | Conduct subsequent performance tests semiannually. <sup>1</sup> |
| 2. 4SRB stationary RICE ≥5,000 HP located at major sources                                                                                                                                                                              | Reduce formaldehyde emissions                  | Conduct subsequent performance tests semiannually. <sup>1</sup> |

|                                                                                                                                       |                                                                        |                                                                                           |
|---------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------|-------------------------------------------------------------------------------------------|
| 3. Stationary RICE >500 HP located at major sources and new or reconstructed 4SLB stationary RICE 250≤HP≤500 located at major sources | Limit the concentration of formaldehyde in the stationary RICE exhaust | Conduct subsequent performance tests semiannually. <sup>1</sup>                           |
| 4. Existing non-emergency, non-black start CI stationary RICE >500 HP that are not limited use stationary RICE                        | Limit or reduce CO emissions and not using a CEMS                      | Conduct subsequent performance tests every 8,760 hours or 3 years, whichever comes first. |
| 5. Existing non-emergency, non-black start CI stationary RICE >500 HP that are limited use stationary RICE                            | Limit or reduce CO emissions and not using a CEMS                      | Conduct subsequent performance tests every 8,760 hours or 5 years, whichever comes first. |

<sup>1</sup>After you have demonstrated compliance for two consecutive tests, you may reduce the frequency of subsequent performance tests to annually. If the results of any subsequent annual performance test indicate the stationary RICE is not in compliance with the CO or formaldehyde emission limitation, or you deviate from any of your operating limitations, you must resume semiannual performance tests.

[78 FR 6711, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 4 to Subpart ZZZZ of Part 63—Requirements for Performance Tests**

As stated in §§63.6610, 63.6611, 63.6620, and 63.6640, you must comply with the following requirements for performance tests for stationary RICE:

| <b>For each . . .</b>                 | <b>Complying with the requirement to . . .</b> | <b>You must . . .</b>                                                                                                              | <b>Using . . .</b> | <b>According to the following requirements . . .</b>                                                                                                                                                                                                                                                    |
|---------------------------------------|------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|--------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. 2SLB, 4SLB, and CI stationary RICE | a. reduce CO emissions                         | i. Select the sampling port location and the number/location of traverse points at the inlet and outlet of the control device; and |                    | (a) For CO and O <sub>2</sub> measurement, ducts ≤6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and ≤12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the |

|                         |                                  |                                                                                                                                    |                                                                                                                                                               |                                                                                                                                                                                                                                                                                                                                                                                 |
|-------------------------|----------------------------------|------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                         |                                  |                                                                                                                                    |                                                                                                                                                               | duct is >12 inches in diameter <i>and</i> the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, appendix A-1, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, appendix A-4. |
|                         |                                  | ii. Measure the O <sub>2</sub> at the inlet and outlet of the control device; and                                                  | (1) Method 3 or 3A or 3B of 40 CFR part 60, appendix A-2, or ASTM Method D6522-00 (Reapproved 2005) <sup>a</sup><br><sup>c</sup> (heated probe not necessary) | (b) Measurements to determine O <sub>2</sub> must be made at the same time as the measurements for CO concentration.                                                                                                                                                                                                                                                            |
|                         |                                  | iii. Measure the CO at the inlet and the outlet of the control device                                                              | (1) ASTM D6522-00 (Reapproved 2005) <sup>a</sup><br><sup>b c</sup> (heated probe not necessary) or Method 10 of 40 CFR part 60, appendix A-4                  | (c) The CO concentration must be at 15 percent O <sub>2</sub> , dry basis.                                                                                                                                                                                                                                                                                                      |
| 2. 4SRB stationary RICE | a. reduce formaldehyde emissions | i. Select the sampling port location and the number/location of traverse points at the inlet and outlet of the control device; and |                                                                                                                                                               | (a) For formaldehyde, O <sub>2</sub> , and moisture measurement, ducts ≤6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and ≤12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in                             |

|  |  |                                                                                                                                                             |                                                                                                                                                                                                                                      |                                                                                                                                                                                                                                                                                                                                                       |
|--|--|-------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |  |                                                                                                                                                             |                                                                                                                                                                                                                                      | diameter <i>and</i> the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, appendix A, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, appendix A. |
|  |  | ii. Measure O <sub>2</sub> at the inlet and outlet of the control device; and                                                                               | (1) Method 3 or 3A or 3B of 40 CFR part 60, appendix A-2, or ASTM Method D6522-00 (Reapproved 2005) <sup>a</sup> (heated probe not necessary)                                                                                        | (a) Measurements to determine O <sub>2</sub> concentration must be made at the same time as the measurements for formaldehyde or THC concentration.                                                                                                                                                                                                   |
|  |  | iii. Measure moisture content at the inlet and outlet of the control device; and                                                                            | (1) Method 4 of 40 CFR part 60, appendix A-3, or Method 320 of 40 CFR part 63, appendix A, or ASTM D 6348-03 <sup>a</sup>                                                                                                            | (a) Measurements to determine moisture content must be made at the same time and location as the measurements for formaldehyde or THC concentration.                                                                                                                                                                                                  |
|  |  | iv. If demonstrating compliance with the formaldehyde percent reduction requirement, measure formaldehyde at the inlet and the outlet of the control device | (1) Method 320 or 323 of 40 CFR part 63, appendix A; or ASTM D6348-03 <sup>a</sup> , provided in ASTM D6348-03 Annex A5 (Analyte Spiking Technique), the percent R must be greater than or equal to 70 and less than or equal to 130 | (a) Formaldehyde concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs.                                                                                                                                                                                      |
|  |  | v. If demonstrating compliance with the THC percent                                                                                                         | (1) Method 25A, reported as propane, of 40 CFR part 60,                                                                                                                                                                              | (a) THC concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this                                                                                                                                                                                                                                                               |

|                    |                                                                                 |                                                                                                                            |                                                                                                                                               |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
|--------------------|---------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                    |                                                                                 | reduction requirement, measure THC at the inlet and the outlet of the control device                                       | appendix A-7                                                                                                                                  | test consist of the average of the three 1-hour or longer runs.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| 3. Stationary RICE | a. limit the concentration of formaldehyde or CO in the stationary RICE exhaust | i. Select the sampling port location and the number/location of traverse points at the exhaust of the stationary RICE; and |                                                                                                                                               | (a) For formaldehyde, CO, O <sub>2</sub> , and moisture measurement, ducts ≤6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and ≤12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter <i>and</i> the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, appendix A, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, appendix A. If using a control device, the sampling site must be located at the outlet of the control device. |
|                    |                                                                                 | ii. Determine the O <sub>2</sub> concentration of the stationary RICE exhaust at the sampling port location; and           | (1) Method 3 or 3A or 3B of 40 CFR part 60, appendix A-2, or ASTM Method D6522-00 (Reapproved 2005) <sup>a</sup> (heated probe not necessary) | (a) Measurements to determine O <sub>2</sub> concentration must be made at the same time and location as the measurements for formaldehyde or CO concentration.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |

|  |  |                                                                                                  |                                                                                                                                                                                                                                      |                                                                                                                                                                  |
|--|--|--------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |  | iii. Measure moisture content of the station-ary RICE exhaust at the sampling port location; and | (1) Method 4 of 40 CFR part 60, appendix A-3, or Method 320 of 40 CFR part 63, appendix A, or ASTM D 6348-03 <sup>a</sup>                                                                                                            | (a) Measurements to determine moisture content must be made at the same time and location as the measurements for formaldehyde or CO concentration.              |
|  |  | iv. Measure formalde-hyde at the exhaust of the station-ary RICE; or                             | (1) Method 320 or 323 of 40 CFR part 63, appendix A; or ASTM D6348-03 <sup>a</sup> , provided in ASTM D6348-03 Annex A5 (Analyte Spiking Technique), the percent R must be greater than or equal to 70 and less than or equal to 130 | (a) Formaldehyde concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs. |
|  |  | v. measure CO at the exhaust of the station-ary RICE                                             | (1) Method 10 of 40 CFR part 60, appendix A-4, ASTM Method D6522-00 (2005) <sup>a,c</sup> , Method 320 of 40 CFR part 63, appendix A, or ASTM D6348-03 <sup>a</sup>                                                                  | (a) CO concentration must be at 15 percent O <sub>2</sub> , dry basis. Results of this test consist of the average of the three 1-hour or longer runs.           |

<sup>a</sup>You may also use Methods 3A and 10 as options to ASTM-D6522-00 (2005). You may obtain a copy of ASTM-D6522-00 (2005) from at least one of the following addresses: American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959, or University Microfilms International, 300 North Zeeb Road, Ann Arbor, MI 48106.

<sup>b</sup>You may obtain a copy of ASTM-D6348-03 from at least one of the following addresses: American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959, or University Microfilms International, 300 North Zeeb Road, Ann Arbor, MI 48106.

[79 FR 11290, Feb. 27, 2014]

 [Back to Top](#)

**Table 5 to Subpart ZZZZ of Part 63—Initial Compliance With Emission Limitations, Operating Limitations, and Other Requirements**

As stated in §§63.6612, 63.6625 and 63.6630, you must initially comply with the emission and operating limitations as required by the following:

| For each . . .                                                                                                                                                                                                                                                                                                                                                           | Complying with the requirement to . . .                                      | You have demonstrated initial compliance if . . .                                                                                                                                                                                                                                                                                                                                                       |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. New or reconstructed non-emergency 2SLB stationary RICE >500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP | a. Reduce CO emissions and using oxidation catalyst, and using a CPMS        | i. The average reduction of emissions of CO determined from the initial performance test achieves the required CO percent reduction; and<br>ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b); and<br>iii. You have recorded the catalyst pressure drop and catalyst inlet temperature during the initial performance test. |
| 2. Non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP                                                                                                                                                                                                     | a. Limit the concentration of CO, using oxidation catalyst, and using a CPMS | i. The average CO concentration determined from the initial performance test is less than or equal to the CO emission limitation; and                                                                                                                                                                                                                                                                   |
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                              | ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b); and                                                                                                                                                                                                                                                                      |
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                              | iii. You have recorded the catalyst pressure drop and catalyst inlet temperature during the initial performance test.                                                                                                                                                                                                                                                                                   |
| 3. New or reconstructed non-emergency 2SLB stationary RICE >500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP | a. Reduce CO emissions and not using oxidation catalyst                      | i. The average reduction of emissions of CO determined from the initial performance test achieves the required CO percent reduction; and<br>ii. You have installed a CPMS to continuously monitor operating parameters approved by the Administrator (if any) according to the requirements in §63.6625(b); and<br>iii. You have recorded the approved operating parameters (if any) during             |



|                                                                                                                                                                                                                                                                                                                                                                          |                                                                    |                                                                                                                                                                                                                                                                                                                                    |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                    | the initial performance test.                                                                                                                                                                                                                                                                                                      |
| 4. Non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP                                                                                                                                                                                                     | a. Limit the concentration of CO, and not using oxidation catalyst | i. The average CO concentration determined from the initial performance test is less than or equal to the CO emission limitation; and<br>ii. You have installed a CPMS to continuously monitor operating parameters approved by the Administrator (if any) according to the requirements in §63.6625(b); and                       |
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                    | iii. You have recorded the approved operating parameters (if any) during the initial performance test.                                                                                                                                                                                                                             |
| 5. New or reconstructed non-emergency 2SLB stationary RICE >500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP | a. Reduce CO emissions, and using a CEMS                           | i. You have installed a CEMS to continuously monitor CO and either O <sub>2</sub> or CO <sub>2</sub> at both the inlet and outlet of the oxidation catalyst according to the requirements in §63.6625(a); and<br>ii. You have conducted a performance evaluation of your CEMS using PS 3 and 4A of 40 CFR part 60, appendix B; and |
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                    | iii. The average reduction of CO calculated using §63.6620 equals or exceeds the required percent reduction. The initial test comprises the first 4-hour period after successful validation of the CEMS. Compliance is based on the average percent reduction achieved during the 4-hour period.                                   |
| 6. Non-emergency stationary CI RICE >500 HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP located at an area source of HAP                                                                                                                                                                                                     | a. Limit the concentration of CO, and using a CEMS                 | i. You have installed a CEMS to continuously monitor CO and either O <sub>2</sub> or CO <sub>2</sub> at the outlet of the oxidation catalyst according to the requirements in §63.6625(a); and                                                                                                                                     |
|                                                                                                                                                                                                                                                                                                                                                                          |                                                                    | ii. You have conducted a performance evaluation of your CEMS using PS 3 and 4A of 40 CFR part 60, appendix B; and                                                                                                                                                                                                                  |

|                                                                                |                                                     |                                                                                                                                                                                                                                                                                                                          |
|--------------------------------------------------------------------------------|-----------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                |                                                     | <p>iii. The average concentration of CO calculated using §63.6620 is less than or equal to the CO emission limitation. The initial test comprises the first 4-hour period after successful validation of the CEMS. Compliance is based on the average concentration measured during the 4-hour period.</p>               |
| 7. Non-emergency 4SRB stationary RICE >500 HP located at a major source of HAP | a. Reduce formaldehyde emissions and using NSCR     | <p>i. The average reduction of emissions of formaldehyde determined from the initial performance test is equal to or greater than the required formaldehyde percent reduction, or the average reduction of emissions of THC determined from the initial performance test is equal to or greater than 30 percent; and</p> |
|                                                                                |                                                     | <p>ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b); and</p>                                                                                                                                                                                |
|                                                                                |                                                     | <p>iii. You have recorded the catalyst pressure drop and catalyst inlet temperature during the initial performance test.</p>                                                                                                                                                                                             |
| 8. Non-emergency 4SRB stationary RICE >500 HP located at a major source of HAP | a. Reduce formaldehyde emissions and not using NSCR | <p>i. The average reduction of emissions of formaldehyde determined from the initial performance test is equal to or greater than the required formaldehyde percent reduction or the average reduction of emissions of THC determined from the initial performance test is equal to or greater than 30 percent; and</p>  |
|                                                                                |                                                     | <p>ii. You have installed a CPMS to continuously monitor operating parameters approved by the Administrator (if any) according to the requirements in §63.6625(b); and</p>                                                                                                                                               |
|                                                                                |                                                     | <p>iii. You have recorded the approved operating parameters (if any) during the initial performance test.</p>                                                                                                                                                                                                            |

|                                                                                                                                                                                                                                                                                                                                    |                                                                                                                           |                                                                                                                                                                                                                                                                                                                                                                         |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>9. New or reconstructed non-emergency stationary RICE &gt;500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE <math>250 \leq HP \leq 500</math> located at a major source of HAP, and existing non-emergency 4SRB stationary RICE &gt;500 HP located at a major source of HAP</p>  | <p>a. Limit the concentration of formaldehyde in the stationary RICE exhaust and using oxidation catalyst or NSCR</p>     | <p>i. The average formaldehyde concentration, corrected to 15 percent O<sub>2</sub>, dry basis, from the three test runs is less than or equal to the formaldehyde emission limitation; and<br/>ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b); and</p>                                  |
|                                                                                                                                                                                                                                                                                                                                    |                                                                                                                           | <p>iii. You have recorded the catalyst pressure drop and catalyst inlet temperature during the initial performance test.</p>                                                                                                                                                                                                                                            |
| <p>10. New or reconstructed non-emergency stationary RICE &gt;500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE <math>250 \leq HP \leq 500</math> located at a major source of HAP, and existing non-emergency 4SRB stationary RICE &gt;500 HP located at a major source of HAP</p> | <p>a. Limit the concentration of formaldehyde in the stationary RICE exhaust and not using oxidation catalyst or NSCR</p> | <p>i. The average formaldehyde concentration, corrected to 15 percent O<sub>2</sub>, dry basis, from the three test runs is less than or equal to the formaldehyde emission limitation; and<br/>ii. You have installed a CPMS to continuously monitor operating parameters approved by the Administrator (if any) according to the requirements in §63.6625(b); and</p> |
|                                                                                                                                                                                                                                                                                                                                    |                                                                                                                           | <p>iii. You have recorded the approved operating parameters (if any) during the initial performance test.</p>                                                                                                                                                                                                                                                           |
| <p>11. Existing non-emergency stationary RICE <math>100 \leq HP \leq 500</math> located at a major source of HAP, and existing non-emergency stationary CI RICE <math>300 &lt; HP \leq 500</math> located at an area source of HAP</p>                                                                                             | <p>a. Reduce CO emissions</p>                                                                                             | <p>i. The average reduction of emissions of CO or formaldehyde, as applicable determined from the initial performance test is equal to or greater than the required CO or formaldehyde, as applicable, percent reduction.</p>                                                                                                                                           |
| <p>12. Existing non-emergency stationary RICE <math>100 \leq HP \leq 500</math> located at a major source of HAP, and existing non-emergency stationary CI RICE <math>300 &lt; HP \leq 500</math> located at an area source of HAP</p>                                                                                             | <p>a. Limit the concentration of formaldehyde or CO in the stationary RICE exhaust</p>                                    | <p>i. The average formaldehyde or CO concentration, as applicable, corrected to 15 percent O<sub>2</sub>, dry basis, from the three test runs is less than or equal to the formaldehyde or CO emission limitation, as applicable.</p>                                                                                                                                   |
| <p>13. Existing non-emergency 4SLB stationary RICE &gt;500 HP located at</p>                                                                                                                                                                                                                                                       | <p>a. Install an oxidation catalyst</p>                                                                                   | <p>i. You have conducted an initial compliance demonstration as</p>                                                                                                                                                                                                                                                                                                     |

|                                                                                                                                                                                         |                 |                                                                                                                                                                                                                                                                                                                                       |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year                                                                    |                 | specified in §63.6630(e) to show that the average reduction of emissions of CO is 93 percent or more, or the average CO concentration is less than or equal to 47 ppmvd at 15 percent O <sub>2</sub> ;                                                                                                                                |
|                                                                                                                                                                                         |                 | ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b), or you have installed equipment to automatically shut down the engine if the catalyst inlet temperature exceeds 1350 °F.                                                                               |
| 14. Existing non-emergency 4SRB stationary RICE >500 HP located at an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year | a. Install NSCR | i. You have conducted an initial compliance demonstration as specified in §63.6630(e) to show that the average reduction of emissions of CO is 75 percent or more, the average CO concentration is less than or equal to 270 ppmvd at 15 percent O <sub>2</sub> , or the average reduction of emissions of THC is 30 percent or more; |
|                                                                                                                                                                                         |                 | ii. You have installed a CPMS to continuously monitor catalyst inlet temperature according to the requirements in §63.6625(b), or you have installed equipment to automatically shut down the engine if the catalyst inlet temperature exceeds 1250 °F.                                                                               |

[78 FR 6712, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 6 to Subpart ZZZZ of Part 63—Continuous Compliance With Emission Limitations, and Other Requirements**

As stated in §63.6640, you must continuously comply with the emissions and operating limitations and work or management practices as required by the following:

| For each . . . | Complying with the requirement to . . . | You must demonstrate continuous compliance by . . . |
|----------------|-----------------------------------------|-----------------------------------------------------|
|----------------|-----------------------------------------|-----------------------------------------------------|

|                                                                                                                                                                                                                                                                                                                        |                                                                                                                 |                                                                                                                                                                                                                                                                                                            |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>1. New or reconstructed non-emergency 2SLB stationary RICE &gt;500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, and new or reconstructed non-emergency CI stationary RICE &gt;500 HP located at a major source of HAP</p> | <p>a. Reduce CO emissions and using an oxidation catalyst, and using a CPMS</p>                                 | <p>i. Conducting semiannual performance tests for CO to demonstrate that the required CO percent reduction is achieved<sup>a</sup>; and<br/> ii. Collecting the catalyst inlet temperature data according to §63.6625(b); and<br/> iii. Reducing these data to 4-hour rolling averages; and</p>            |
|                                                                                                                                                                                                                                                                                                                        |                                                                                                                 | <p>iv. Maintaining the 4-hour rolling averages within the operating limitations for the catalyst inlet temperature; and</p>                                                                                                                                                                                |
|                                                                                                                                                                                                                                                                                                                        |                                                                                                                 | <p>v. Measuring the pressure drop across the catalyst once per month and demonstrating that the pressure drop across the catalyst is within the operating limitation established during the performance test.</p>                                                                                          |
| <p>2. New or reconstructed non-emergency 2SLB stationary RICE &gt;500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, and new or reconstructed non-emergency CI stationary RICE &gt;500 HP located at a major source of HAP</p> | <p>a. Reduce CO emissions and not using an oxidation catalyst, and using a CPMS</p>                             | <p>i. Conducting semiannual performance tests for CO to demonstrate that the required CO percent reduction is achieved<sup>a</sup>; and<br/> ii. Collecting the approved operating parameter (if any) data according to §63.6625(b); and<br/> iii. Reducing these data to 4-hour rolling averages; and</p> |
|                                                                                                                                                                                                                                                                                                                        |                                                                                                                 | <p>iv. Maintaining the 4-hour rolling averages within the operating limitations for the operating parameters established during the performance test.</p>                                                                                                                                                  |
| <p>3. New or reconstructed non-emergency 2SLB stationary RICE &gt;500 HP located at a major source of HAP, new or reconstructed non-emergency 4SLB stationary RICE ≥250 HP located at a major source of HAP, new or reconstructed non-emergency stationary CI RICE &gt;500</p>                                         | <p>a. Reduce CO emissions or limit the concentration of CO in the stationary RICE exhaust, and using a CEMS</p> | <p>i. Collecting the monitoring data according to §63.6625(a), reducing the measurements to 1-hour averages, calculating the percent reduction or concentration of CO emissions according to §63.6620; and<br/> ii. Demonstrating that the catalyst</p>                                                    |

|                                                                                               |                                                     |                                                                                                                                                                                                             |
|-----------------------------------------------------------------------------------------------|-----------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| HP located at a major source of HAP, and existing non-emergency stationary CI RICE >500 HP    |                                                     | achieves the required percent reduction of CO emissions over the 4-hour averaging period, or that the emission remain at or below the CO concentration limit; and                                           |
|                                                                                               |                                                     | iii. Conducting an annual RATA of your CEMS using PS 3 and 4A of 40 CFR part 60, appendix B, as well as daily and periodic data quality checks in accordance with 40 CFR part 60, appendix F, procedure 1.  |
| 4. Non-emergency 4SRB stationary RICE >500 HP located at a major source of HAP                | a. Reduce formaldehyde emissions and using NSCR     | i. Collecting the catalyst inlet temperature data according to §63.6625(b); and                                                                                                                             |
|                                                                                               |                                                     | ii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                     |
|                                                                                               |                                                     | iii. Maintaining the 4-hour rolling averages within the operating limitations for the catalyst inlet temperature; and                                                                                       |
|                                                                                               |                                                     | iv. Measuring the pressure drop across the catalyst once per month and demonstrating that the pressure drop across the catalyst is within the operating limitation established during the performance test. |
| 5. Non-emergency 4SRB stationary RICE >500 HP located at a major source of HAP                | a. Reduce formaldehyde emissions and not using NSCR | i. Collecting the approved operating parameter (if any) data according to §63.6625(b); and                                                                                                                  |
|                                                                                               |                                                     | ii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                     |
|                                                                                               |                                                     | iii. Maintaining the 4-hour rolling averages within the operating limitations for the operating parameters established during the performance test.                                                         |
| 6. Non-emergency 4SRB stationary RICE with a brake HP ≥5,000 located at a major source of HAP | a. Reduce formaldehyde emissions                    | Conducting semiannual performance tests for formaldehyde to demonstrate that the required                                                                                                                   |

|                                                                                                                                                                                                                           |                                                                                                                    |                                                                                                                                                                                                                                                                          |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                                                                                           |                                                                                                                    | formaldehyde percent reduction is achieved, or to demonstrate that the average reduction of emissions of THC determined from the performance test is equal to or greater than 30 percent. <sup>a</sup>                                                                   |
| 7. New or reconstructed non-emergency stationary RICE >500 HP located at a major source of HAP and new or reconstructed non-emergency 4SLB stationary RICE $250 \leq \text{HP} \leq 500$ located at a major source of HAP | a. Limit the concentration of formaldehyde in the stationary RICE exhaust and using oxidation catalyst or NSCR     | i. Conducting semiannual performance tests for formaldehyde to demonstrate that your emissions remain at or below the formaldehyde concentration limit <sup>a</sup> ; and<br>ii. Collecting the catalyst inlet temperature data according to §63.6625(b); and            |
|                                                                                                                                                                                                                           |                                                                                                                    | iii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                                                                                 |
|                                                                                                                                                                                                                           |                                                                                                                    | iv. Maintaining the 4-hour rolling averages within the operating limitations for the catalyst inlet temperature; and                                                                                                                                                     |
|                                                                                                                                                                                                                           |                                                                                                                    | v. Measuring the pressure drop across the catalyst once per month and demonstrating that the pressure drop across the catalyst is within the operating limitation established during the performance test.                                                               |
| 8. New or reconstructed non-emergency stationary RICE >500 HP located at a major source of HAP and new or reconstructed non-emergency 4SLB stationary RICE $250 \leq \text{HP} \leq 500$ located at a major source of HAP | a. Limit the concentration of formaldehyde in the stationary RICE exhaust and not using oxidation catalyst or NSCR | i. Conducting semiannual performance tests for formaldehyde to demonstrate that your emissions remain at or below the formaldehyde concentration limit <sup>a</sup> ; and<br>ii. Collecting the approved operating parameter (if any) data according to §63.6625(b); and |
|                                                                                                                                                                                                                           |                                                                                                                    | iii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                                                                                 |
|                                                                                                                                                                                                                           |                                                                                                                    | iv. Maintaining the 4-hour rolling averages within the operating limitations for the operating parameters established during the performance test.                                                                                                                       |
| 9. Existing emergency and black                                                                                                                                                                                           | a. Work or                                                                                                         | i. Operating and maintaining the                                                                                                                                                                                                                                         |

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                                                                              |                                                                                                                                                                                                                                                                                                                                                                 |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>start stationary RICE <math>\leq 500</math> HP located at a major source of HAP, existing non-emergency stationary RICE <math>&lt; 100</math> HP located at a major source of HAP, existing emergency and black start stationary RICE located at an area source of HAP, existing non-emergency stationary CI RICE <math>\leq 300</math> HP located at an area source of HAP, existing non-emergency 2SLB stationary RICE located at an area source of HAP, existing non-emergency stationary SI RICE located at an area source of HAP which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, existing non-emergency 4SLB and 4SRB stationary RICE <math>\leq 500</math> HP located at an area source of HAP, existing non-emergency 4SLB and 4SRB stationary RICE <math>&gt; 500</math> HP located at an area source of HAP that operate 24 hours or less per calendar year, and existing non-emergency 4SLB and 4SRB stationary RICE <math>&gt; 500</math> HP located at an area source of HAP that are remote stationary RICE</p> | <p>Management practices</p>                                                                                                  | <p>stationary RICE according to the manufacturer's emission-related operation and maintenance instructions; or<br/> ii. Develop and follow your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions.</p> |
| <p>10. Existing stationary CI RICE <math>&gt; 500</math> HP that are not limited use stationary RICE</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             | <p>a. Reduce CO emissions, or limit the concentration of CO in the stationary RICE exhaust, and using oxidation catalyst</p> | <p>i. Conducting performance tests every 8,760 hours or 3 years, whichever comes first, for CO or formaldehyde, as appropriate, to demonstrate that the required CO or formaldehyde, as appropriate, percent reduction is achieved or that your emissions remain at or below the CO or formaldehyde concentration limit; and</p>                                |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                                                                              | <p>ii. Collecting the catalyst inlet temperature data according to §63.6625(b); and</p>                                                                                                                                                                                                                                                                         |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                                                                              | <p>iii. Reducing these data to 4-hour rolling averages; and</p>                                                                                                                                                                                                                                                                                                 |



|                                                                                  |                                                                                                                           |                                                                                                                                                                                                                                                                                                                           |
|----------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                  |                                                                                                                           | iv. Maintaining the 4-hour rolling averages within the operating limitations for the catalyst inlet temperature; and                                                                                                                                                                                                      |
|                                                                                  |                                                                                                                           | v. Measuring the pressure drop across the catalyst once per month and demonstrating that the pressure drop across the catalyst is within the operating limitation established during the performance test.                                                                                                                |
| 11. Existing stationary CI RICE >500 HP that are not limited use stationary RICE | a. Reduce CO emissions, or limit the concentration of CO in the stationary RICE exhaust, and not using oxidation catalyst | i. Conducting performance tests every 8,760 hours or 3 years, whichever comes first, for CO or formaldehyde, as appropriate, to demonstrate that the required CO or formaldehyde, as appropriate, percent reduction is achieved or that your emissions remain at or below the CO or formaldehyde concentration limit; and |
|                                                                                  |                                                                                                                           | ii. Collecting the approved operating parameter (if any) data according to §63.6625(b); and                                                                                                                                                                                                                               |
|                                                                                  |                                                                                                                           | iii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                                                                                                                                  |
|                                                                                  |                                                                                                                           | iv. Maintaining the 4-hour rolling averages within the operating limitations for the operating parameters established during the performance test.                                                                                                                                                                        |
| 12. Existing limited use CI stationary RICE >500 HP                              | a. Reduce CO emissions or limit the concentration of CO in the stationary RICE exhaust, and using an oxidation catalyst   | i. Conducting performance tests every 8,760 hours or 5 years, whichever comes first, for CO or formaldehyde, as appropriate, to demonstrate that the required CO or formaldehyde, as appropriate, percent reduction is achieved or that your emissions remain at or below the CO or formaldehyde concentration limit; and |
|                                                                                  |                                                                                                                           | ii. Collecting the catalyst inlet temperature data according to                                                                                                                                                                                                                                                           |

|                                                                                                                                                                                         |                                                                                                                             |                                                                                                                                                                                                                                                                                                                           |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                                                         |                                                                                                                             | §63.6625(b); and                                                                                                                                                                                                                                                                                                          |
|                                                                                                                                                                                         |                                                                                                                             | iii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                                                                                                                                  |
|                                                                                                                                                                                         |                                                                                                                             | iv. Maintaining the 4-hour rolling averages within the operating limitations for the catalyst inlet temperature; and                                                                                                                                                                                                      |
|                                                                                                                                                                                         |                                                                                                                             | v. Measuring the pressure drop across the catalyst once per month and demonstrating that the pressure drop across the catalyst is within the operating limitation established during the performance test.                                                                                                                |
| 13. Existing limited use CI stationary RICE >500 HP                                                                                                                                     | a. Reduce CO emissions or limit the concentration of CO in the stationary RICE exhaust, and not using an oxidation catalyst | i. Conducting performance tests every 8,760 hours or 5 years, whichever comes first, for CO or formaldehyde, as appropriate, to demonstrate that the required CO or formaldehyde, as appropriate, percent reduction is achieved or that your emissions remain at or below the CO or formaldehyde concentration limit; and |
|                                                                                                                                                                                         |                                                                                                                             | ii. Collecting the approved operating parameter (if any) data according to §63.6625(b); and                                                                                                                                                                                                                               |
|                                                                                                                                                                                         |                                                                                                                             | iii. Reducing these data to 4-hour rolling averages; and                                                                                                                                                                                                                                                                  |
|                                                                                                                                                                                         |                                                                                                                             | iv. Maintaining the 4-hour rolling averages within the operating limitations for the operating parameters established during the performance test.                                                                                                                                                                        |
| 14. Existing non-emergency 4SLB stationary RICE >500 HP located at an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year | a. Install an oxidation catalyst                                                                                            | i. Conducting annual compliance demonstrations as specified in §63.6640(c) to show that the average reduction of emissions of CO is 93 percent or more, or the average CO concentration is less than or equal to 47 ppmvd at 15 percent O <sub>2</sub> ; and either<br>ii. Collecting the catalyst inlet                  |

|                                                                                                                                                                                                   |                        |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                                                                   |                        | <p>temperature data according to §63.6625(b), reducing these data to 4-hour rolling averages; and maintaining the 4-hour rolling averages within the limitation of greater than 450 °F and less than or equal to 1350 °F for the catalyst inlet temperature; or</p> <p>iii. Immediately shutting down the engine if the catalyst inlet temperature exceeds 1350 °F.</p>                                                                                                                                                                                                                                                                                                                                                                                          |
| <p>15. Existing non-emergency 4SRB stationary RICE &gt;500 HP located at an area source of HAP that are not remote stationary RICE and that are operated more than 24 hours per calendar year</p> | <p>a. Install NSCR</p> | <p>i. Conducting annual compliance demonstrations as specified in §63.6640(c) to show that the average reduction of emissions of CO is 75 percent or more, the average CO concentration is less than or equal to 270 ppmvd at 15 percent O<sub>2</sub>, or the average reduction of emissions of THC is 30 percent or more; and either</p> <p>ii. Collecting the catalyst inlet temperature data according to §63.6625(b), reducing these data to 4-hour rolling averages; and maintaining the 4-hour rolling averages within the limitation of greater than or equal to 750 °F and less than or equal to 1250 °F for the catalyst inlet temperature; or</p> <p>iii. Immediately shutting down the engine if the catalyst inlet temperature exceeds 1250 °F.</p> |

<sup>a</sup>After you have demonstrated compliance for two consecutive tests, you may reduce the frequency of subsequent performance tests to annually. If the results of any subsequent annual performance test indicate the stationary RICE is not in compliance with the CO or formaldehyde emission limitation, or you deviate from any of your operating limitations, you must resume semiannual performance tests.

[78 FR 6715, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 7 to Subpart ZZZZ of Part 63—Requirements for Reports**

As stated in §63.6650, you must comply with the following requirements for reports:

| For each . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  | You must submit a . . .  | The report must contain . . .                                                                                                                                                                                                                                                                                                                                                                                                                                                         | You must submit the report . . .                                                                                                                                                                                                                                                                                                                |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>1. Existing non-emergency, non-black start stationary RICE <math>100 \leq \text{HP} \leq 500</math> located at a major source of HAP; existing non-emergency, non-black start stationary CI RICE <math>&gt;500</math> HP located at a major source of HAP; existing non-emergency 4SRB stationary RICE <math>&gt;500</math> HP located at a major source of HAP; existing non-emergency, non-black start stationary CI RICE <math>&gt;300</math> HP located at an area source of HAP; new or reconstructed non-emergency stationary RICE <math>&gt;500</math> HP located at a major source of HAP; and new or reconstructed non-emergency 4SLB stationary RICE <math>250 \leq \text{HP} \leq 500</math> located at a major source of HAP</p> | <p>Compliance report</p> | <p>a. If there are no deviations from any emission limitations or operating limitations that apply to you, a statement that there were no deviations from the emission limitations or operating limitations during the reporting period. If there were no periods during which the CMS, including CEMS and CPMS, was out-of-control, as specified in §63.8(c)(7), a statement that there were not periods during which the CMS was out-of-control during the reporting period; or</p> | <p>i. Semiannually according to the requirements in §63.6650(b)(1)-(5) for engines that are not limited use stationary RICE subject to numerical emission limitations; and<br/>ii. Annually according to the requirements in §63.6650(b)(6)-(9) for engines that are limited use stationary RICE subject to numerical emission limitations.</p> |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                          | <p>b. If you had a deviation from any emission limitation or operating limitation during the reporting period, the information in §63.6650(d). If there were periods during which the CMS, including CEMS and CPMS, was out-of-control, as specified in §63.8(c)(7), the information in §63.6650(e); or</p>                                                                                                                                                                           | <p>i. Semiannually according to the requirements in §63.6650(b).</p>                                                                                                                                                                                                                                                                            |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                          | <p>c. If you had a malfunction during the reporting period, the information in</p>                                                                                                                                                                                                                                                                                                                                                                                                    | <p>i. Semiannually according to the requirements in</p>                                                                                                                                                                                                                                                                                         |

|                                                                                                                                                                                                                                                      |                   |                                                                                                                                                                                                                                                                                         |                                                                      |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------|
|                                                                                                                                                                                                                                                      |                   | §63.6650(c)(4).                                                                                                                                                                                                                                                                         | §63.6650(b).                                                         |
| 2. New or reconstructed non-emergency stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis                                                                         | Report            | a. The fuel flow rate of each fuel and the heating values that were used in your calculations, and you must demonstrate that the percentage of heat input provided by landfill gas or digester gas, is equivalent to 10 percent or more of the gross heat input on an annual basis; and | i. Annually, according to the requirements in §63.6650.              |
|                                                                                                                                                                                                                                                      |                   | b. The operating limits provided in your federally enforceable permit, and any deviations from these limits; and                                                                                                                                                                        | i. See item 2.a.i.                                                   |
|                                                                                                                                                                                                                                                      |                   | c. Any problems or errors suspected with the meters.                                                                                                                                                                                                                                    | i. See item 2.a.i.                                                   |
| 3. Existing non-emergency, non-black start 4SLB and 4SRB stationary RICE >500 HP located at an area source of HAP that are not remote stationary RICE and that operate more than 24 hours per calendar year                                          | Compliance report | a. The results of the annual compliance demonstration, if conducted during the reporting period.                                                                                                                                                                                        | i. Semiannually according to the requirements in §63.6650(b)(1)-(5). |
| 4. Emergency stationary RICE that operate or are contractually obligated to be available for more than 15 hours per year for the purposes specified in §63.6640(f)(2)(ii) and (iii) or that operate for the purposes specified in §63.6640(f)(4)(ii) | Report            | a. The information in §63.6650(h)(1)                                                                                                                                                                                                                                                    | i. annually according to the requirements in §63.6650(h)(2)-(3).     |

[78 FR 6719, Jan. 30, 2013]

[↑ Back to Top](#)

**Table 8 to Subpart ZZZZ of Part 63—Applicability of General Provisions to Subpart ZZZZ.**

As stated in §63.6665, you must comply with the following applicable general provisions.

| <b>General provisions citation</b> | <b>Subject of citation</b>                                                        | <b>Applies to subpart</b> | <b>Explanation</b>                               |
|------------------------------------|-----------------------------------------------------------------------------------|---------------------------|--------------------------------------------------|
| §63.1                              | General applicability of the General Provisions                                   | Yes.                      |                                                  |
| §63.2                              | Definitions                                                                       | Yes                       | Additional terms defined in §63.6675.            |
| §63.3                              | Units and abbreviations                                                           | Yes.                      |                                                  |
| §63.4                              | Prohibited activities and circumvention                                           | Yes.                      |                                                  |
| §63.5                              | Construction and reconstruction                                                   | Yes.                      |                                                  |
| §63.6(a)                           | Applicability                                                                     | Yes.                      |                                                  |
| §63.6(b)(1)-(4)                    | Compliance dates for new and reconstructed sources                                | Yes.                      |                                                  |
| §63.6(b)(5)                        | Notification                                                                      | Yes.                      |                                                  |
| §63.6(b)(6)                        | [Reserved]                                                                        |                           |                                                  |
| §63.6(b)(7)                        | Compliance dates for new and reconstructed area sources that become major sources | Yes.                      |                                                  |
| §63.6(c)(1)-(2)                    | Compliance dates for existing sources                                             | Yes.                      |                                                  |
| §63.6(c)(3)-(4)                    | [Reserved]                                                                        |                           |                                                  |
| §63.6(c)(5)                        | Compliance dates for existing area sources that become major sources              | Yes.                      |                                                  |
| §63.6(d)                           | [Reserved]                                                                        |                           |                                                  |
| §63.6(e)                           | Operation and maintenance                                                         | No.                       |                                                  |
| §63.6(f)(1)                        | Applicability of standards                                                        | No.                       |                                                  |
| §63.6(f)(2)                        | Methods for determining compliance                                                | Yes.                      |                                                  |
| §63.6(f)(3)                        | Finding of compliance                                                             | Yes.                      |                                                  |
| §63.6(g)(1)-(3)                    | Use of alternate standard                                                         | Yes.                      |                                                  |
| §63.6(h)                           | Opacity and visible emission standards                                            | No                        | Subpart ZZZZ does not contain opacity or visible |

|                 |                                                                      |      |                                                                                  |
|-----------------|----------------------------------------------------------------------|------|----------------------------------------------------------------------------------|
|                 |                                                                      |      | emission standards.                                                              |
| §63.6(i)        | Compliance extension procedures and criteria                         | Yes. |                                                                                  |
| §63.6(j)        | Presidential compliance exemption                                    | Yes. |                                                                                  |
| §63.7(a)(1)-(2) | Performance test dates                                               | Yes  | Subpart ZZZZ contains performance test dates at §§63.6610, 63.6611, and 63.6612. |
| §63.7(a)(3)     | CAA section 114 authority                                            | Yes. |                                                                                  |
| §63.7(b)(1)     | Notification of performance test                                     | Yes  | Except that §63.7(b)(1) only applies as specified in §63.6645.                   |
| §63.7(b)(2)     | Notification of rescheduling                                         | Yes  | Except that §63.7(b)(2) only applies as specified in §63.6645.                   |
| §63.7(c)        | Quality assurance/test plan                                          | Yes  | Except that §63.7(c) only applies as specified in §63.6645.                      |
| §63.7(d)        | Testing facilities                                                   | Yes. |                                                                                  |
| §63.7(e)(1)     | Conditions for conducting performance tests                          | No.  | Subpart ZZZZ specifies conditions for conducting performance tests at §63.6620.  |
| §63.7(e)(2)     | Conduct of performance tests and reduction of data                   | Yes  | Subpart ZZZZ specifies test methods at §63.6620.                                 |
| §63.7(e)(3)     | Test run duration                                                    | Yes. |                                                                                  |
| §63.7(e)(4)     | Administrator may require other testing under section 114 of the CAA | Yes. |                                                                                  |
| §63.7(f)        | Alternative test method provisions                                   | Yes. |                                                                                  |
| §63.7(g)        | Performance test data analysis, recordkeeping, and reporting         | Yes. |                                                                                  |
| §63.7(h)        | Waiver of tests                                                      | Yes. |                                                                                  |
| §63.8(a)(1)     | Applicability of monitoring requirements                             | Yes  | Subpart ZZZZ contains specific requirements for                                  |

|                  |                                                        |                                                             |                                                                                        |
|------------------|--------------------------------------------------------|-------------------------------------------------------------|----------------------------------------------------------------------------------------|
|                  |                                                        |                                                             | monitoring at §63.6625.                                                                |
| §63.8(a)(2)      | Performance specifications                             | Yes.                                                        |                                                                                        |
| §63.8(a)(3)      | [Reserved]                                             |                                                             |                                                                                        |
| §63.8(a)(4)      | Monitoring for control devices                         | No.                                                         |                                                                                        |
| §63.8(b)(1)      | Monitoring                                             | Yes.                                                        |                                                                                        |
| §63.8(b)(2)-(3)  | Multiple effluents and multiple monitoring systems     | Yes.                                                        |                                                                                        |
| §63.8(c)(1)      | Monitoring system operation and maintenance            | Yes.                                                        |                                                                                        |
| §63.8(c)(1)(i)   | Routine and predictable SSM                            | No                                                          |                                                                                        |
| §63.8(c)(1)(ii)  | SSM not in Startup Shutdown Malfunction Plan           | Yes.                                                        |                                                                                        |
| §63.8(c)(1)(iii) | Compliance with operation and maintenance requirements | No                                                          |                                                                                        |
| §63.8(c)(2)-(3)  | Monitoring system installation                         | Yes.                                                        |                                                                                        |
| §63.8(c)(4)      | Continuous monitoring system (CMS) requirements        | Yes                                                         | Except that subpart ZZZZ does not require Continuous Opacity Monitoring System (COMS). |
| §63.8(c)(5)      | COMS minimum procedures                                | No                                                          | Subpart ZZZZ does not require COMS.                                                    |
| §63.8(c)(6)-(8)  | CMS requirements                                       | Yes                                                         | Except that subpart ZZZZ does not require COMS.                                        |
| §63.8(d)         | CMS quality control                                    | Yes.                                                        |                                                                                        |
| §63.8(e)         | CMS performance evaluation                             | Yes                                                         | Except for §63.8(e)(5)(ii), which applies to COMS.                                     |
|                  |                                                        | Except that §63.8(e) only applies as specified in §63.6645. |                                                                                        |
| §63.8(f)(1)-(5)  | Alternative monitoring method                          | Yes                                                         | Except that §63.8(f)(4) only applies as specified in §63.6645.                         |
| §63.8(f)(6)      | Alternative to relative accuracy test                  | Yes                                                         | Except that §63.8(f)(6) only applies as specified in                                   |



|                 |                                                                 |                                                             |                                                                                                                                            |
|-----------------|-----------------------------------------------------------------|-------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------|
|                 |                                                                 |                                                             | §63.6645.                                                                                                                                  |
| §63.8(g)        | Data reduction                                                  | Yes                                                         | Except that provisions for COMS are not applicable. Averaging periods for demonstrating compliance are specified at §§63.6635 and 63.6640. |
| §63.9(a)        | Applicability and State delegation of notification requirements | Yes.                                                        |                                                                                                                                            |
| §63.9(b)(1)-(5) | Initial notifications                                           | Yes                                                         | Except that §63.9(b)(3) is reserved.                                                                                                       |
|                 |                                                                 | Except that §63.9(b) only applies as specified in §63.6645. |                                                                                                                                            |
| §63.9(c)        | Request for compliance extension                                | Yes                                                         | Except that §63.9(c) only applies as specified in §63.6645.                                                                                |
| §63.9(d)        | Notification of special compliance requirements for new sources | Yes                                                         | Except that §63.9(d) only applies as specified in §63.6645.                                                                                |
| §63.9(e)        | Notification of performance test                                | Yes                                                         | Except that §63.9(e) only applies as specified in §63.6645.                                                                                |
| §63.9(f)        | Notification of visible emission (VE)/opacity test              | No                                                          | Subpart ZZZZ does not contain opacity or VE standards.                                                                                     |
| §63.9(g)(1)     | Notification of performance evaluation                          | Yes                                                         | Except that §63.9(g) only applies as specified in §63.6645.                                                                                |
| §63.9(g)(2)     | Notification of use of COMS data                                | No                                                          | Subpart ZZZZ does not contain opacity or VE standards.                                                                                     |
| §63.9(g)(3)     | Notification that criterion for alternative to RATA is exceeded | Yes                                                         | If alternative is in use.                                                                                                                  |
|                 |                                                                 | Except that                                                 |                                                                                                                                            |

|                       |                                                       |                                                 |                                                                                                                                          |
|-----------------------|-------------------------------------------------------|-------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------|
|                       |                                                       | §63.9(g) only applies as specified in §63.6645. |                                                                                                                                          |
| §63.9(h)(1)-(6)       | Notification of compliance status                     | Yes                                             | Except that notifications for sources using a CEMS are due 30 days after completion of performance evaluations. §63.9(h)(4) is reserved. |
|                       |                                                       |                                                 | Except that §63.9(h) only applies as specified in §63.6645.                                                                              |
| §63.9(i)              | Adjustment of submittal deadlines                     | Yes.                                            |                                                                                                                                          |
| §63.9(j)              | Change in previous information                        | Yes.                                            |                                                                                                                                          |
| §63.10(a)             | Administrative provisions for recordkeeping/reporting | Yes.                                            |                                                                                                                                          |
| §63.10(b)(1)          | Record retention                                      | Yes                                             | Except that the most recent 2 years of data do not have to be retained on site.                                                          |
| §63.10(b)(2)(i)-(v)   | Records related to SSM                                | No.                                             |                                                                                                                                          |
| §63.10(b)(2)(vi)-(xi) | Records                                               | Yes.                                            |                                                                                                                                          |
| §63.10(b)(2)(xii)     | Record when under waiver                              | Yes.                                            |                                                                                                                                          |
| §63.10(b)(2)(xiii)    | Records when using alternative to RATA                | Yes                                             | For CO standard if using RATA alternative.                                                                                               |
| §63.10(b)(2)(xiv)     | Records of supporting documentation                   | Yes.                                            |                                                                                                                                          |
| §63.10(b)(3)          | Records of applicability determination                | Yes.                                            |                                                                                                                                          |
| §63.10(c)             | Additional records for sources using CEMS             | Yes                                             | Except that §63.10(c)(2)-(4) and (9) are reserved.                                                                                       |
| §63.10(d)(1)          | General reporting requirements                        | Yes.                                            |                                                                                                                                          |
| §63.10(d)(2)          | Report of performance test results                    | Yes.                                            |                                                                                                                                          |
| §63.10(d)(3)          | Reporting opacity or VE                               | No                                              | Subpart ZZZZ does not                                                                                                                    |

|                         |                                                   |      |                                             |
|-------------------------|---------------------------------------------------|------|---------------------------------------------|
|                         | observations                                      |      | contain opacity or VE standards.            |
| §63.10(d)(4)            | Progress reports                                  | Yes. |                                             |
| §63.10(d)(5)            | Startup, shutdown, and malfunction reports        | No.  |                                             |
| §63.10(e)(1) and (2)(i) | Additional CMS Reports                            | Yes. |                                             |
| §63.10(e)(2)(ii)        | COMS-related report                               | No   | Subpart ZZZZ does not require COMS.         |
| §63.10(e)(3)            | Excess emission and parameter exceedances reports | Yes. | Except that §63.10(e)(3)(i)(C) is reserved. |
| §63.10(e)(4)            | Reporting COMS data                               | No   | Subpart ZZZZ does not require COMS.         |
| §63.10(f)               | Waiver for recordkeeping/reporting                | Yes. |                                             |
| §63.11                  | Flares                                            | No.  |                                             |
| §63.12                  | State authority and delegations                   | Yes. |                                             |
| §63.13                  | Addresses                                         | Yes. |                                             |
| §63.14                  | Incorporation by reference                        | Yes. |                                             |
| §63.15                  | Availability of information                       | Yes. |                                             |

[75 FR 9688, Mar. 3, 2010, as amended at 78 FR 6720, Jan. 30, 2013]

[↑ Back to Top](#)

## Appendix A to Subpart ZZZZ of Part 63—Protocol for Using an Electrochemical Analyzer to Determine Oxygen and Carbon Monoxide Concentrations From Certain Engines

### 1.0 SCOPE AND APPLICATION. WHAT IS THIS PROTOCOL?

This protocol is a procedure for using portable electrochemical (EC) cells for measuring carbon monoxide (CO) and oxygen (O<sub>2</sub>) concentrations in controlled and uncontrolled emissions from existing stationary 4-stroke lean burn and 4-stroke rich burn reciprocating internal combustion engines as specified in the applicable rule.

#### 1.1 Analytes. What does this protocol determine?

This protocol measures the engine exhaust gas concentrations of carbon monoxide (CO) and oxygen (O<sub>2</sub>).

| Analyte | CAS | Sensitivity |
|---------|-----|-------------|
|---------|-----|-------------|

|                          | No.       |                                                                                                            |
|--------------------------|-----------|------------------------------------------------------------------------------------------------------------|
| Carbon monoxide (CO)     | 630-08-0  | Minimum detectable limit should be 2 percent of the nominal range or 1 ppm, whichever is less restrictive. |
| Oxygen (O <sub>2</sub> ) | 7782-44-7 |                                                                                                            |

*1.2 Applicability. When is this protocol acceptable?*

This protocol is applicable to 40 CFR part 63, subpart ZZZZ. Because of inherent cross sensitivities of EC cells, you must not apply this protocol to other emissions sources without specific instruction to that effect.

*1.3 Data Quality Objectives. How good must my collected data be?*

Refer to Section 13 to verify and document acceptable analyzer performance.

*1.4 Range. What is the targeted analytical range for this protocol?*

The measurement system and EC cell design(s) conforming to this protocol will determine the analytical range for each gas component. The nominal ranges are defined by choosing up-scale calibration gas concentrations near the maximum anticipated flue gas concentrations for CO and O<sub>2</sub>, or no more than twice the permitted CO level.

*1.5 Sensitivity. What minimum detectable limit will this protocol yield for a particular gas component?*

The minimum detectable limit depends on the nominal range and resolution of the specific EC cell used, and the signal to noise ratio of the measurement system. The minimum detectable limit should be 2 percent of the nominal range or 1 ppm, whichever is less restrictive.

## 2.0 SUMMARY OF PROTOCOL

In this protocol, a gas sample is extracted from an engine exhaust system and then conveyed to a portable EC analyzer for measurement of CO and O<sub>2</sub> gas concentrations. This method provides measurement system performance specifications and sampling protocols to ensure reliable data. You may use additions to, or modifications of vendor supplied measurement systems (e.g., heated or unheated sample lines, thermocouples, flow meters, selective gas scrubbers, etc.) to meet the design specifications of this protocol. Do not make changes to the measurement system from the as-verified configuration (Section 3.12).

## 3.0 DEFINITIONS

*3.1 Measurement System.* The total equipment required for the measurement of CO and O<sub>2</sub> concentrations. The measurement system consists of the following major subsystems:

*3.1.1 Data Recorder.* A strip chart recorder, computer or digital recorder for logging measurement data from the analyzer output. You may record measurement data from the digital data display manually or electronically.

**3.1.2 Electrochemical (EC) Cell.** A device, similar to a fuel cell, used to sense the presence of a specific analyte and generate an electrical current output proportional to the analyte concentration.

**3.1.3 Interference Gas Scrubber.** A device used to remove or neutralize chemical compounds that may interfere with the selective operation of an EC cell.

**3.1.4 Moisture Removal System.** Any device used to reduce the concentration of moisture in the sample stream so as to protect the EC cells from the damaging effects of condensation and to minimize errors in measurements caused by the scrubbing of soluble gases.

**3.1.5 Sample Interface.** The portion of the system used for one or more of the following: sample acquisition; sample transport; sample conditioning or protection of the EC cell from any degrading effects of the engine exhaust effluent; removal of particulate matter and condensed moisture.

**3.2 Nominal Range.** The range of analyte concentrations over which each EC cell is operated (normally 25 percent to 150 percent of up-scale calibration gas value). Several nominal ranges can be used for any given cell so long as the calibration and repeatability checks for that range remain within specifications.

**3.3 Calibration Gas.** A vendor certified concentration of a specific analyte in an appropriate balance gas.

**3.4 Zero Calibration Error.** The analyte concentration output exhibited by the EC cell in response to zero-level calibration gas.

**3.5 Up-Scale Calibration Error.** The mean of the difference between the analyte concentration exhibited by the EC cell and the certified concentration of the up-scale calibration gas.

**3.6 Interference Check.** A procedure for quantifying analytical interference from components in the engine exhaust gas other than the targeted analytes.

**3.7 Repeatability Check.** A protocol for demonstrating that an EC cell operated over a given nominal analyte concentration range provides a stable and consistent response and is not significantly affected by repeated exposure to that gas.

**3.8 Sample Flow Rate.** The flow rate of the gas sample as it passes through the EC cell. In some situations, EC cells can experience drift with changes in flow rate. The flow rate must be monitored and documented during all phases of a sampling run.

**3.9 Sampling Run.** A timed three-phase event whereby an EC cell's response rises and plateaus in a sample conditioning phase, remains relatively constant during a measurement data phase, then declines during a refresh phase. The sample conditioning phase exposes the EC cell to the gas sample for a length of time sufficient to reach a constant response. The measurement data phase is the time interval during which gas sample measurements can be made that meet the acceptance criteria of this protocol. The refresh phase then purges the EC cells with CO-free air. The refresh phase replenishes requisite O<sub>2</sub> and moisture in the electrolyte reserve and provides a mechanism to de-gas or desorb any interference gas scrubbers or filters so as to enable a stable CO EC cell response. There are four primary types of sampling runs: pre-sampling calibrations; stack gas sampling; post-sampling calibration checks; and measurement system repeatability checks. Stack gas sampling runs can be chained together for extended evaluations, providing all other procedural specifications are met.

**3.10 Sampling Day.** A time not to exceed twelve hours from the time of the pre-sampling calibration to the post-sampling calibration check. During this time, stack gas sampling runs can be repeated without repeated recalibrations, providing all other sampling specifications have been met.

**3.11 Pre-Sampling Calibration/Post-Sampling Calibration Check.** The protocols executed at the beginning and end of each sampling day to bracket measurement readings with controlled performance checks.

**3.12 Performance-Established Configuration.** The EC cell and sampling system configuration that existed at the time that it initially met the performance requirements of this protocol.

#### 4.0 INTERFERENCES.

When present in sufficient concentrations, NO and NO<sub>2</sub> are two gas species that have been reported to interfere with CO concentration measurements. In the likelihood of this occurrence, it is the protocol user's responsibility to employ and properly maintain an appropriate CO EC cell filter or scrubber for removal of these gases, as described in Section 6.2.12.

#### 5.0 SAFETY. [RESERVED]

#### 6.0 EQUIPMENT AND SUPPLIES.

##### *6.1 What equipment do I need for the measurement system?*

The system must maintain the gas sample at conditions that will prevent moisture condensation in the sample transport lines, both before and as the sample gas contacts the EC cells. The essential components of the measurement system are described below.

##### *6.2 Measurement System Components.*

**6.2.1 Sample Probe.** A single extraction-point probe constructed of glass, stainless steel or other non-reactive material, and of length sufficient to reach any designated sampling point. The sample probe must be designed to prevent plugging due to condensation or particulate matter.

**6.2.2 Sample Line.** Non-reactive tubing to transport the effluent from the sample probe to the EC cell.

**6.2.3 Calibration Assembly (optional).** A three-way valve assembly or equivalent to introduce calibration gases at ambient pressure at the exit end of the sample probe during calibration checks. The assembly must be designed such that only stack gas or calibration gas flows in the sample line and all gases flow through any gas path filters.

**6.2.4 Particulate Filter (optional).** Filters before the inlet of the EC cell to prevent accumulation of particulate material in the measurement system and extend the useful life of the components. All filters must be fabricated of materials that are non-reactive to the gas mixtures being sampled.

**6.2.5 Sample Pump.** A leak-free pump to provide undiluted sample gas to the system at a flow rate sufficient to minimize the response time of the measurement system. If located upstream of the EC cells, the pump must be constructed of a material that is non-reactive to the gas mixtures being sampled.

**6.2.8 Sample Flow Rate Monitoring.** An adjustable rotameter or equivalent device used to adjust and maintain the sample flow rate through the analyzer as prescribed.

**6.2.9 Sample Gas Manifold (optional).** A manifold to divert a portion of the sample gas stream to the analyzer and the remainder to a by-pass discharge vent. The sample gas manifold may also include provisions for introducing calibration gases directly to the analyzer. The manifold must be constructed of a material that is non-reactive to the gas mixtures being sampled.

**6.2.10 EC cell.** A device containing one or more EC cells to determine the CO and O<sub>2</sub> concentrations in the sample gas stream. The EC cell(s) must meet the applicable performance specifications of Section 13 of this protocol.

**6.2.11 Data Recorder.** A strip chart recorder, computer or digital recorder to make a record of analyzer output data. The data recorder resolution (i.e., readability) must be no greater than 1 ppm for CO; 0.1 percent for O<sub>2</sub>; and one degree (either °C or °F) for temperature. Alternatively, you may use a digital or analog meter having the same resolution to observe and manually record the analyzer responses.

**6.2.12 Interference Gas Filter or Scrubber.** A device to remove interfering compounds upstream of the CO EC cell. Specific interference gas filters or scrubbers used in the performance-established configuration of the analyzer must continue to be used. Such a filter or scrubber must have a means to determine when the removal agent is exhausted. Periodically replace or replenish it in accordance with the manufacturer's recommendations.

## 7.0 REAGENTS AND STANDARDS. WHAT CALIBRATION GASES ARE NEEDED?

**7.1 Calibration Gases.** CO calibration gases for the EC cell must be CO in nitrogen or CO in a mixture of nitrogen and O<sub>2</sub>. Use CO calibration gases with labeled concentration values certified by the manufacturer to be within ±5 percent of the label value. Dry ambient air (20.9 percent O<sub>2</sub>) is acceptable for calibration of the O<sub>2</sub> cell. If needed, any lower percentage O<sub>2</sub> calibration gas must be a mixture of O<sub>2</sub> in nitrogen.

**7.1.1 Up-Scale CO Calibration Gas Concentration.** Choose one or more up-scale gas concentrations such that the average of the stack gas measurements for each stack gas sampling run are between 25 and 150 percent of those concentrations. Alternatively, choose an up-scale gas that does not exceed twice the concentration of the applicable outlet standard. If a measured gas value exceeds 150 percent of the up-scale CO calibration gas value at any time during the stack gas sampling run, the run must be discarded and repeated.

### **7.1.2 Up-Scale O<sub>2</sub> Calibration Gas Concentration.**

Select an O<sub>2</sub> gas concentration such that the difference between the gas concentration and the average stack gas measurement or reading for each sample run is less than 15 percent O<sub>2</sub>. When the average exhaust gas O<sub>2</sub> readings are above 6 percent, you may use dry ambient air (20.9 percent O<sub>2</sub>) for the up-scale O<sub>2</sub> calibration gas.

**7.1.3 Zero Gas.** Use an inert gas that contains less than 0.25 percent of the up-scale CO calibration gas concentration. You may use dry air that is free from ambient CO and other combustion gas products (e.g., CO<sub>2</sub>).

## 8.0 SAMPLE COLLECTION AND ANALYSIS

### 8.1 Selection of Sampling Sites.

**8.1.1 Control Device Inlet.** Select a sampling site sufficiently downstream of the engine so that the combustion gases should be well mixed. Use a single sampling extraction point near the center of the duct (e.g., within the 10 percent centroidal area), unless instructed otherwise.

**8.1.2 Exhaust Gas Outlet.** Select a sampling site located at least two stack diameters downstream of any disturbance (e.g., turbocharger exhaust, crossover junction or recirculation take-off) and at least one-half stack diameter upstream of the gas discharge to the atmosphere. Use a single sampling extraction point near the center of the duct (e.g., within the 10 percent centroidal area), unless instructed otherwise.

**8.2 Stack Gas Collection and Analysis.** Prior to the first stack gas sampling run, conduct that the pre-sampling calibration in accordance with Section 10.1. Use Figure 1 to record all data. Zero the analyzer with zero gas. Confirm and record that the scrubber media color is correct and not exhausted. Then position the probe at the sampling point and begin the sampling run at the same flow rate used during the up-scale calibration. Record the start time. Record all EC cell output responses and the flow rate during the "sample conditioning phase" once per minute until constant readings are obtained. Then begin the "measurement data phase" and record readings every 15 seconds for at least two minutes (or eight readings), or as otherwise required to achieve two continuous minutes of data that meet the specification given in Section 13.1. Finally, perform the "refresh phase" by introducing dry air, free from CO and other combustion gases, until several minute-to-minute readings of consistent value have been obtained. For each run use the "measurement data phase" readings to calculate the average stack gas CO and O<sub>2</sub> concentrations.

**8.3 EC Cell Rate.** Maintain the EC cell sample flow rate so that it does not vary by more than  $\pm 10$  percent throughout the pre-sampling calibration, stack gas sampling and post-sampling calibration check. Alternatively, the EC cell sample flow rate can be maintained within a tolerance range that does not affect the gas concentration readings by more than  $\pm 3$  percent, as instructed by the EC cell manufacturer.

## 9.0 QUALITY CONTROL (RESERVED)

## 10.0 CALIBRATION AND STANDARDIZATION

**10.1 Pre-Sampling Calibration.** Conduct the following protocol once for each nominal range to be used on each EC cell before performing a stack gas sampling run on each field sampling day. Repeat the calibration if you replace an EC cell before completing all of the sampling runs. There is no prescribed order for calibration of the EC cells; however, each cell must complete the measurement data phase during calibration. Assemble the measurement system by following the manufacturer's recommended protocols including for preparing and preconditioning the EC cell. Assure the measurement system has no leaks and verify the gas scrubbing agent is not depleted. Use Figure 1 to record all data.

**10.1.1 Zero Calibration.** For both the O<sub>2</sub> and CO cells, introduce zero gas to the measurement system (e.g., at the calibration assembly) and record the concentration reading every minute until readings are constant for at least two consecutive minutes. Include the time and sample flow rate. Repeat the steps in this section at least once to verify the zero calibration for each component gas.



**10.1.2 Zero Calibration Tolerance.** For each zero gas introduction, the zero level output must be less than or equal to  $\pm 3$  percent of the up-scale gas value or  $\pm 1$  ppm, whichever is less restrictive, for the CO channel and less than or equal to  $\pm 0.3$  percent O<sub>2</sub> for the O<sub>2</sub> channel.

**10.1.3 Up-Scale Calibration.** Individually introduce each calibration gas to the measurement system (e.g., at the calibration assembly) and record the start time. Record all EC cell output responses and the flow rate during this “sample conditioning phase” once per minute until readings are constant for at least two minutes. Then begin the “measurement data phase” and record readings every 15 seconds for a total of two minutes, or as otherwise required. Finally, perform the “refresh phase” by introducing dry air, free from CO and other combustion gases, until readings are constant for at least two consecutive minutes. Then repeat the steps in this section at least once to verify the calibration for each component gas. Introduce all gases to flow through the entire sample handling system (i.e., at the exit end of the sampling probe or the calibration assembly).

**10.1.4 Up-Scale Calibration Error.** The mean of the difference of the “measurement data phase” readings from the reported standard gas value must be less than or equal to  $\pm 5$  percent or  $\pm 1$  ppm for CO or  $\pm 0.5$  percent O<sub>2</sub>, whichever is less restrictive, respectively. The maximum allowable deviation from the mean measured value of any single “measurement data phase” reading must be less than or equal to  $\pm 2$  percent or  $\pm 1$  ppm for CO or  $\pm 0.5$  percent O<sub>2</sub>, whichever is less restrictive, respectively.

**10.2 Post-Sampling Calibration Check.** Conduct a stack gas post-sampling calibration check after the stack gas sampling run or set of runs and within 12 hours of the initial calibration. Conduct up-scale and zero calibration checks using the protocol in Section 10.1. Make no changes to the sampling system or EC cell calibration until all post-sampling calibration checks have been recorded. If either the zero or up-scale calibration error exceeds the respective specification in Sections 10.1.2 and 10.1.4 then all measurement data collected since the previous successful calibrations are invalid and re-calibration and re-sampling are required. If the sampling system is disassembled or the EC cell calibration is adjusted, repeat the calibration check before conducting the next analyzer sampling run.

## 11.0 ANALYTICAL PROCEDURE

The analytical procedure is fully discussed in Section 8.

## 12.0 CALCULATIONS AND DATA ANALYSIS

Determine the CO and O<sub>2</sub> concentrations for each stack gas sampling run by calculating the mean gas concentrations of the data recorded during the “measurement data phase”.

## 13.0 PROTOCOL PERFORMANCE

Use the following protocols to verify consistent analyzer performance during each field sampling day.

**13.1 Measurement Data Phase Performance Check.** Calculate the mean of the readings from the “measurement data phase”. The maximum allowable deviation from the mean for each of the individual readings is  $\pm 2$  percent, or  $\pm 1$  ppm, whichever is less restrictive. Record the mean value and maximum deviation for each gas monitored. Data must conform to Section 10.1.4. The EC cell flow rate must conform to the specification in Section 8.3.

*Example:* A measurement data phase is invalid if the maximum deviation of any single reading comprising that mean is greater than  $\pm 2$  percent or  $\pm 1$  ppm (the default criteria). For example, if the mean = 30 ppm, single readings of below 29 ppm and above 31 ppm are disallowed).

**13.2 Interference Check.** Before the initial use of the EC cell and interference gas scrubber in the field, and semi-annually thereafter, challenge the interference gas scrubber with NO and NO<sub>2</sub> gas standards that are generally recognized as representative of diesel-fueled engine NO and NO<sub>2</sub> emission values. Record the responses displayed by the CO EC cell and other pertinent data on Figure 1 or a similar form.

**13.2.1 Interference Response.** The combined NO and NO<sub>2</sub> interference response should be less than or equal to  $\pm 5$  percent of the up-scale CO calibration gas concentration.

**13.3 Repeatability Check.** Conduct the following check once for each nominal range that is to be used on the CO EC cell within 5 days prior to each field sampling program. If a field sampling program lasts longer than 5 days, repeat this check every 5 days. Immediately repeat the check if the EC cell is replaced or if the EC cell is exposed to gas concentrations greater than 150 percent of the highest up-scale gas concentration.

**13.3.1 Repeatability Check Procedure.** Perform a complete EC cell sampling run (all three phases) by introducing the CO calibration gas to the measurement system and record the response. Follow Section 10.1.3. Use Figure 1 to record all data. Repeat the run three times for a total of four complete runs. During the four repeatability check runs, do not adjust the system except where necessary to achieve the correct calibration gas flow rate at the analyzer.

**13.3.2 Repeatability Check Calculations.** Determine the highest and lowest average "measurement data phase" CO concentrations from the four repeatability check runs and record the results on Figure 1 or a similar form. The absolute value of the difference between the maximum and minimum average values recorded must not vary more than  $\pm 3$  percent or  $\pm 1$  ppm of the up-scale gas value, whichever is less restrictive.

14.0 POLLUTION PREVENTION (RESERVED)

15.0 WASTE MANAGEMENT (RESERVED)

16.0 ALTERNATIVE PROCEDURES (RESERVED)

17.0 REFERENCES

(1) "Development of an Electrochemical Cell Emission Analyzer Test Protocol", Topical Report, Phil Juneau, Emission Monitoring, Inc., July 1997.

(2) "Determination of Nitrogen Oxides, Carbon Monoxide, and Oxygen Emissions from Natural Gas-Fired Engines, Boilers, and Process Heaters Using Portable Analyzers", EMC Conditional Test Protocol 30 (CTM-30), Gas Research Institute Protocol GRI-96/0008, Revision 7, October 13, 1997.

(3) "ICAC Test Protocol for Periodic Monitoring", EMC Conditional Test Protocol 34 (CTM-034), The Institute of Clean Air Companies, September 8, 1999.

(4) "Code of Federal Regulations", Protection of Environment, 40 CFR, Part 60, Appendix A, Methods 1-4; 10.



|                  |  |  |  |  |  |  |  |  |  |  |  |
|------------------|--|--|--|--|--|--|--|--|--|--|--|
| Mean             |  |  |  |  |  |  |  |  |  |  |  |
| Refresh<br>Phase |  |  |  |  |  |  |  |  |  |  |  |
| "                |  |  |  |  |  |  |  |  |  |  |  |
| "                |  |  |  |  |  |  |  |  |  |  |  |
| "                |  |  |  |  |  |  |  |  |  |  |  |
| "                |  |  |  |  |  |  |  |  |  |  |  |

[78 FR 6721, Jan. 30, 2013]

[↑ Back to Top](#)

[Need assistance?](#)

## Appendix F—Acid Rain Permit Application

Appendix G—Cross-State Air Pollution Rule (CSAPR) Monitoring Provisions form

## Appendix H—Arkansas Continuous Emission Monitoring Systems Conditions

# Arkansas Department of Environmental Quality



## CONTINUOUS EMISSION MONITORING SYSTEMS CONDITIONS

Revised September 2013



## PREAMBLE

These conditions are intended to outline the requirements for facilities required to operate Continuous Emission Monitoring Systems/Continuous Opacity Monitoring Systems (CEMS/COMS). Generally there are three types of sources required to operate CEMS/COMS:

1. CEMS/COMS required by 40 CFR Part 60 or 63,
2. CEMS required by 40 CFR Part 75,
3. CEMS/COMS required by ADEQ permit for reasons other than Part 60, 63 or 75.

These CEMS/COMS conditions are not intended to supercede Part 60, 63 or 75 requirements.

- Only CEMS/COMS in the third category (those required by ADEQ permit for reasons other than Part 60, 63, or 75) shall comply with SECTION II, MONITORING REQUIREMENTS and SECTION IV, QUALITY ASSURANCE/QUALITY CONTROL.
- All CEMS/COMS shall comply with Section III, NOTIFICATION AND RECORDKEEPING.

## SECTION I

### DEFINITIONS

**Continuous Emission Monitoring System (CEMS)** - The total equipment required for the determination of a gas concentration and/or emission rate so as to include sampling, analysis and recording of emission data.

**Continuous Opacity Monitoring System (COMS)** - The total equipment required for the determination of opacity as to include sampling, analysis and recording of emission data.

**Calibration Drift (CD)** - The difference in the CEMS output reading from the established reference value after a stated period of operation during which no unscheduled maintenance, repair, or adjustments took place.

**Back-up CEMS (Secondary CEMS)** - A CEMS with the ability to sample, analyze and record stack pollutant to determine gas concentration and/or emission rate. This CEMS is to serve as a back-up to the primary CEMS to minimize monitor downtime.

**Excess Emissions** - Any period in which the emissions exceed the permit limits.

**Monitor Downtime** - Any period during which the CEMS/COMS is unable to sample, analyze and record a minimum of four evenly spaced data points over an hour, except during one daily zero-span check during which two data points per hour are sufficient.

**Out-of-Control Period** - Begins with the time corresponding to the completion of the fifth, consecutive, daily CD check with a CD in excess of two times the allowable limit, or the time corresponding to the completion of the daily CD check preceding the daily CD check that results in a CD in excess of four times the allowable limit and the time corresponding to the completion of the sampling for the Relative Accuracy Test Audit (RATA), Relative Accuracy Audit (RAA), or Cylinder Gas Audit (CGA) which exceeds the limits outlined in Section IV. Out-of-Control Period ends with the time corresponding to the completion of the CD check following corrective action with the results being within the allowable CD limit or the completion of the sampling of the subsequent successful RATA, RAA, or CGA.

**Primary CEMS** - The main reporting CEMS with the ability to sample, analyze, and record stack pollutant to determine gas concentration and/or emission rate.

**Relative Accuracy (RA)** - The absolute mean difference between the gas concentration or emission rate determined by the CEMS and the value determined by the reference method plus the 2.5 percent error confidence coefficient of a series of tests divided by the mean of the reference method tests of the applicable emission limit.

**Span Value** – The upper limit of a gas concentration measurement range.

## SECTION II

### MONITORING REQUIREMENTS

\*\* Only CEMS/COMS required by ADEQ permit for reasons other than Part 60, 63 or 75 shall comply with this section.

- A. For new sources, the installation date for the CEMS/COMS shall be no later than thirty (30) days from the date of start-up of the source.
- B. For existing sources, the installation date for the CEMS/COMS shall be no later than sixty (60) days from the issuance of the permit unless the permit requires a specific date.
- C. Within sixty (60) days of installation of a CEMS/COMS, a performance specification test (PST) must be completed. PST's are defined in 40 CFR, Part 60, Appendix B, PS 1-9. The Department may accept alternate PST's for pollutants not covered by Appendix B on a case-by-case basis. Alternate PST's shall be approved, in writing, by the ADEQ CEM Coordinator prior to testing.
- D. Each CEMS/COMS shall have, as a minimum, a daily zero-span check. The zero-span shall be adjusted whenever the 24-hour zero or 24-hour span drift exceeds two times the limits in the applicable performance specification in 40 CFR, Part 60, Appendix B. Before any adjustments are made to either the zero or span drifts measured at the 24-hour interval, the excess zero and span drifts measured must be quantified and recorded.
- E. All CEMS/COMS shall be in continuous operation and shall meet minimum frequency of operation requirements of 95% up-time for each quarter for each pollutant measured. Percent of monitor down-time is calculated by dividing the total minutes the monitor is not in operation by the total time in the calendar quarter and multiplying by one hundred. Failure to maintain operation time shall constitute a violation of the CEMS conditions.
- F. Percent of excess emissions are calculated by dividing the total minutes of excess emissions by the total time the source operated and multiplying by one hundred. Failure to maintain compliance may constitute a violation of the CEMS conditions.
- G. All CEMS measuring emissions shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive fifteen minute period unless more cycles are required by the permit. For each CEMS, one-hour averages shall be computed from four or more data points equally spaced over each one hour period unless more data points are required by the permit.
- H. All COMS shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.
- I. When the pollutant from a single affected facility is released through more than one point, a CEMS/COMS shall be installed on each point unless installation of fewer systems is approved, in writing, by the ADEQ CEM Coordinator. When more than one CEM/COM is used to monitor

emissions from one affected facility the owner or operator shall report the results as required from each CEMS/COMS.

### SECTION III

#### NOTIFICATION AND RECORD KEEPING

\*\* All CEMS/COMS shall comply with this section.

- A. When requested to do so by an owner or operator, the ADEQ CEM Coordinator will review plans for installation or modification for the purpose of providing technical advice to the owner or operator.
- B. Each facility which operates a CEMS/COMS shall notify the ADEQ CEM Coordinator of the date for which the demonstration of the CEMS/COMS performance will commence (i.e. PST, RATA, RAA, CGA). Notification shall be received in writing no less than 15 business days prior to testing. Performance test results shall be submitted to the Department within thirty days after completion of testing.
- C. Each facility which operates a CEMS/COMS shall maintain records of the occurrence and duration of start up/shut down, cleaning/soot blowing, process problems, fuel problems, or other malfunction in the operation of the affected facility which causes excess emissions. This includes any malfunction of the air pollution control equipment or any period during which a continuous monitoring device/system is inoperative.
- D. Each facility required to install a CEMS/COMS shall submit an excess emission and monitoring system performance report to the Department (Attention: Air Division, CEM Coordinator) at least quarterly, unless more frequent submittals are warranted to assess the compliance status of the facility. Quarterly reports shall be postmarked no later than the 30th day of the month following the end of each calendar quarter.
- E. All excess emissions shall be reported in terms of the applicable standard. Each report shall be submitted on ADEQ Quarterly Excess Emission Report Forms. Alternate forms may be used with prior written approval from the Department.
- F. Each facility which operates a CEMS/COMS must maintain on site a file of CEMS/COMS data including all raw data, corrected and adjusted, repair logs, calibration checks, adjustments, and test audits. This file must be retained for a period of at least five years, and is required to be maintained in such a condition that it can easily be audited by an inspector.
- G. Quarterly reports shall be used by the Department to determine compliance with the permit.

## SECTION IV

### QUALITY ASSURANCE/QUALITY CONTROL

\*\* Only CEMS/COMS required by ADEQ permit for reasons other than Part 60, 63 or 75 shall comply with this section.

- A. For each CEMS/COMS a Quality Assurance/Quality Control (QA/QC) plan shall be submitted to the Department (Attn.: Air Division, CEM Coordinator). CEMS quality assurance procedures are defined in 40 CFR, Part 60, Appendix F. This plan shall be submitted within 180 days of the CEMS/COMS installation. A QA/QC plan shall consist of procedure and practices which assures acceptable level of monitor data accuracy, precision, representativeness, and availability.
- B. The submitted QA/QC plan for each CEMS/COMS shall not be considered as accepted until the facility receives a written notification of acceptance from the Department.
- C. Facilities responsible for one, or more, CEMS/COMS used for compliance monitoring shall meet these minimum requirements and are encouraged to develop and implement a more extensive QA/QC program, or to continue such programs where they already exist. Each QA/QC program must include written procedures which should describe in detail, complete, step-by-step procedures and operations for each of the following activities:
  - 1. Calibration of CEMS/COMS
    - a. Daily calibrations (including the approximate time(s) that the daily zero and span drifts will be checked and the time required to perform these checks and return to stable operation)
  - 2. Calibration drift determination and adjustment of CEMS/COMS
    - a. Out-of-control period determination
    - b. Steps of corrective action
  - 3. Preventive maintenance of CEMS/COMS
    - a. CEMS/COMS information
      - 1) Manufacture
      - 2) Model number
      - 3) Serial number
    - b. Scheduled activities (check list)
    - c. Spare part inventory
  - 4. Data recording, calculations, and reporting
  - 5. Accuracy audit procedures including sampling and analysis methods
  - 6. Program of corrective action for malfunctioning CEMS/COMS
- D. A Relative Accuracy Test Audit (RATA), shall be conducted at least once every four calendar quarters. A Relative Accuracy Audit (RAA), or a Cylinder Gas Audit (CGA), may be conducted in the other three quarters but in no more than three quarters in

succession. The RATA should be conducted in accordance with the applicable test procedure in 40 CFR Part 60 Appendix A and calculated in accordance with the applicable performance specification in 40 CFR Part 60 Appendix B. CGA's and RAA's should be conducted and the data calculated in accordance with the procedures outlined on 40 CFR Part 60 Appendix F.

If alternative testing procedures or methods of calculation are to be used in the RATA, RAA or CGA audits prior authorization must be obtained from the ADEQ CEM Coordinator.

E. Criteria for excessive audit inaccuracy.

**RATA**

|                                             |                                           |
|---------------------------------------------|-------------------------------------------|
| All Pollutants except Carbon Monoxide       | > 20% Relative Accuracy                   |
| Carbon Monoxide                             | > 10% Relative Accuracy                   |
| All Pollutants except Carbon Monoxide       | > 10% of the Applicable Standard          |
| Carbon Monoxide                             | > 5% of the Applicable Standard           |
| Diluent (O <sub>2</sub> & CO <sub>2</sub> ) | > 1.0 % O <sub>2</sub> or CO <sub>2</sub> |
| Flow                                        | > 20% Relative Accuracy                   |

**CGA**

|                                             |                                                  |
|---------------------------------------------|--------------------------------------------------|
| Pollutant                                   | > 15% of average audit value or 5 ppm difference |
| Diluent (O <sub>2</sub> & CO <sub>2</sub> ) | > 15% of average audit value or 5 ppm difference |

**RAA**

|                                             |                                                                      |
|---------------------------------------------|----------------------------------------------------------------------|
| Pollutant                                   | > 15% of the three run average or > 7.5 % of the applicable standard |
| Diluent (O <sub>2</sub> & CO <sub>2</sub> ) | > 15% of the three run average or > 7.5 % of the applicable standard |

- F. If either the zero or span drift results exceed two times the applicable drift specification in 40 CFR, Part 60, Appendix B for five consecutive, daily periods, the CEMS is out-of-control. If either the zero or span drift results exceed four times the applicable drift specification in Appendix B during a calibration drift check, the CEMS is out-of-control. If the CEMS exceeds the audit inaccuracies listed above, the CEMS is out-of-control. If a CEMS is out-of-control, the data from that out-of-control period is not counted towards meeting the minimum data availability as required and described in the applicable subpart. The end of the out-of-control period is the time corresponding to the completion of the successful daily zero or span drift or completion of the successful CGA, RAA or RATA.
- G. A back-up monitor may be placed on an emission source to minimize monitor downtime. This back-up CEMS is subject to the same QA/QC procedure and practices as the primary CEMS. The back-up CEMS shall be certified by a PST. Daily zero-span checks must be performed and recorded in accordance with standard practices. When the primary CEMS goes down, the back-up CEMS may then be engaged to sample, analyze and record the emission source pollutant until repairs are made and the primary unit is placed back in service. Records must be maintained on site when the back-up CEMS is placed in service, these records shall include at a minimum the reason the primary CEMS is out of service, the date and time the primary CEMS was out of service and the date and time the primary CEMS was placed back in service.



Appendix I—40 CFR Part 63, Subpart UUUUU

# Electronic Code of Federal Regulations

## e-CFR data is current as of February 3, 2020

[Title 40](#) → [Chapter I](#) → [Subchapter C](#) → [Part 63](#) → Subpart UUUUU

---

[Browse Previous](#) | [Browse Next](#)

Title 40: Protection of Environment

[PART 63—NATIONAL EMISSION STANDARDS FOR HAZARDOUS AIR POLLUTANTS FOR SOURCE CATEGORIES \(CONTINUED\)](#)

---

### **Subpart UUUUU—National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units**

---

#### **Contents**

##### [WHAT THIS SUBPART COVERS](#)

[§63.9980](#) [What is the purpose of this subpart?](#)

[§63.9981](#) [Am I subject to this subpart?](#)

[§63.9982](#) [What is the affected source of this subpart?](#)

[§63.9983](#) [Are any fossil fuel-fired electric generating units not subject to this subpart?](#)

[§63.9984](#) [When do I have to comply with this subpart?](#)

[§63.9985](#) [What is a new EGU?](#)

##### [EMISSION LIMITATIONS AND WORK PRACTICE STANDARDS](#)

[§63.9990](#) [What are the subcategories of EGUs?](#)

[§63.9991](#) [What emission limitations, work practice standards, and operating limits must I meet?](#)

##### [GENERAL COMPLIANCE REQUIREMENTS](#)

[§63.10000](#) [What are my general requirements for complying with this subpart?](#)

[§63.10001](#) [\[Reserved\]](#)

##### [TESTING AND INITIAL COMPLIANCE REQUIREMENTS](#)

[§63.10005](#) [What are my initial compliance requirements and by what date must I conduct them?](#)

[§63.10006](#) [When must I conduct subsequent performance tests or tune-ups?](#)

[§63.10007](#) [What methods and other procedures must I use for the performance tests?](#)

[§63.10008](#) [\[Reserved\]](#)

[§63.10009](#) [May I use emissions averaging to comply with this subpart?](#)

[§63.10010](#) [What are my monitoring, installation, operation, and maintenance requirements?](#)

[§63.10011](#) [How do I demonstrate initial compliance with the emissions limits and work practice](#)

[standards?](#)

#### CONTINUOUS COMPLIANCE REQUIREMENTS

[§63.10020 How do I monitor and collect data to demonstrate continuous compliance?](#)

[§63.10021 How do I demonstrate continuous compliance with the emission limitations, operating limits, and work practice standards?](#)

[§63.10022 How do I demonstrate continuous compliance under the emissions averaging provision?](#)

[§63.10023 How do I establish my PM CPMS operating limit and determine compliance with it?](#)

#### NOTIFICATION, REPORTS, AND RECORDS

[§63.10030 What notifications must I submit and when?](#)

[§63.10031 What reports must I submit and when?](#)

[§63.10032 What records must I keep?](#)

[§63.10033 In what form and how long must I keep my records?](#)

#### OTHER REQUIREMENTS AND INFORMATION

[§63.10040 What parts of the General Provisions apply to me?](#)

[§63.10041 Who implements and enforces this subpart?](#)

[§63.10042 What definitions apply to this subpart?](#)

[Table 1 to Subpart UUUUU of Part 63—Emission Limits for New or Reconstructed EGUs](#)

[Table 2 to Subpart UUUUU of Part 63—Emission Limits for Existing EGUs](#)

[Table 3 to Subpart UUUUU of Part 63—Work Practice Standards](#)

[Table 4 to Subpart UUUUU of Part 63—Operating Limits for EGUs](#)

[Table 5 to Subpart UUUUU of Part 63—Performance Testing Requirements](#)

[Table 6 to Subpart UUUUU of Part 63—Establishing PM CPMS Operating Limits](#)

[Table 7 to Subpart UUUUU of Part 63—Demonstrating Continuous Compliance](#)

[Table 8 to Subpart UUUUU of Part 63—Reporting Requirements](#)

[Table 9 to Subpart UUUUU of Part 63—Applicability of General Provisions to Subpart UUUUU](#)

[Appendix A to Subpart UUUUU of Part 63—Hg Monitoring Provisions](#)

[Appendix B to Subpart UUUUU of Part 63—HCl and HF Monitoring Provisions](#)

---

SOURCE: 77 FR 9464, Feb. 16, 2012, unless otherwise noted.

[↑ Back to Top](#)

## **WHAT THIS SUBPART COVERS**

[↑ Back to Top](#)

### **§63.9980 What is the purpose of this subpart?**

This subpart establishes national emission limitations and work practice standards for hazardous air pollutants (HAP) emitted from coal- and oil-fired electric utility steam generating units (EGUs) as defined in §63.10042 of this subpart. This subpart also establishes requirements to demonstrate initial and continuous compliance with the emission limitations.

[↑ Back to Top](#)

### **§63.9981 Am I subject to this subpart?**

You are subject to this subpart if you own or operate a coal-fired EGU or an oil-fired EGU as defined in §63.10042 of this subpart.

 [Back to Top](#)

### **§63.9982 What is the affected source of this subpart?**

(a) This subpart applies to each individual or group of two or more new, reconstructed, or existing affected source(s) as described in paragraphs (a)(1) and (2) of this section within a contiguous area and under common control.

(1) The affected source of this subpart is the collection of all existing coal- or oil-fired EGUs, as defined in §63.10042, within a subcategory.

(2) The affected source of this subpart is each new or reconstructed coal- or oil-fired EGU as defined in §63.10042.

(b) An EGU is new if you commence construction of the coal- or oil-fired EGU after May 3, 2011.

(c) An EGU is reconstructed if you meet the reconstruction criteria as defined in §63.2, and if you commence reconstruction after May 3, 2011.

(d) An EGU is existing if it is not new or reconstructed. An existing electric steam generating unit that meets the applicability requirements after the effective date of this final rule due to a change in process (e.g., fuel or utilization) is considered to be an existing source under this subpart.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23402, Apr. 19, 2012; 78 FR 24084, Apr. 24, 2013]

 [Back to Top](#)

### **§63.9983 Are any fossil fuel-fired electric generating units not subject to this subpart?**

The types of electric steam generating units listed in paragraphs (a) through (d) of this section are not subject to this subpart.

(a) Any unit designated as a major source stationary combustion turbine subject to subpart YYYY of this part and any unit designated as an area source stationary combustion turbine, other than an integrated gasification combined cycle (IGCC) unit.

(b) Any electric utility steam generating unit that is not a coal- or oil-fired EGU and that meets the definition of a natural gas-fired EGU in §63.10042.

(c) Any electric utility steam generating unit that has the capability of combusting more than 25 MW of coal or oil but does not meet the definition of a coal- or oil-fired EGU because it did not fire sufficient coal or oil to satisfy the average annual heat input requirement set forth in the definitions for coal-fired and oil-fired EGUs in §63.10042. Heat input means heat derived from combustion of fuel in an EGU and does not include the heat derived from preheated combustion air, recirculated

flue gases or exhaust gases from other sources (such as stationary gas turbines, internal combustion engines, and industrial boilers).

(d) Any electric steam generating unit combusting solid waste is a solid waste incineration unit subject to standards established under sections 129 and 111 of the Clean Air Act.

(e) Any electric utility steam generating unit that meets the definition of a natural gas-fired EGU under this subpart and that fires at least 10 percent biomass is an industrial boiler subject to standards established under subpart DDDDD of this part, if it otherwise meets the applicability provisions in that rule.

[77 FR 9464, Feb. 16, 2012, as amended at 81 FR 20180, Apr. 6, 2016]

[↑ Back to Top](#)

### **§63.9984 When do I have to comply with this subpart?**

(a) If you have a new or reconstructed EGU, you must comply with this subpart by April 16, 2012 or upon startup of your EGU, whichever is later, and as further provided for in §63.10005(g).

(b) If you have an existing EGU, you must comply with this subpart no later than April 16, 2015.

(c) You must meet the notification requirements in §63.10030 according to the schedule in §63.10030 and in subpart A of this part. Some of the notifications must be submitted before you are required to comply with the emission limits and work practice standards in this subpart.

(d) An electric steam generating unit that does not meet the definition of an EGU subject to this subpart on April 16, 2012 for new sources or April 16, 2015 for existing sources must comply with the applicable existing source provisions of this subpart on the date such unit meets the definition of an EGU subject to this subpart.

(e) If you own or operate an electric steam generating unit that is exempted from this subpart under §63.9983(d), if the manner of operating the unit changes such that the combustion of waste is discontinued and the unit becomes a coal-fired or oil-fired EGU (as defined in §63.10042), you must be in compliance with this subpart on April 16, 2015 or on the effective date of the switch from waste combustion to coal or oil combustion, whichever is later.

(f) You must demonstrate that compliance has been achieved, by conducting the required performance tests and other activities, no later than 180 days after the applicable date in paragraph (a), (b), (c), (d), or (e) of this section.

[↑ Back to Top](#)

### **§63.9985 What is a new EGU?**

(a) A new EGU is an EGU that meets any of the criteria specified in paragraph (a)(1) through (a)(2) of this section.

(1) An EGU that commenced construction after May 3, 2011.

(2) An EGU that commenced reconstruction after May 3, 2011.

(b) [Reserved]

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23402, Apr. 19, 2012]

[↑ Back to Top](#)

## **EMISSION LIMITATIONS AND WORK PRACTICE STANDARDS**

[↑ Back to Top](#)

### **§63.9990 What are the subcategories of EGUs?**

(a) Coal-fired EGUs are subcategorized as defined in paragraphs (a)(1) through (a)(2) of this section and as defined in §63.10042.

(1) EGUs designed for coal with a heating value greater than or equal to 8,300 Btu/lb, and

(2) EGUs designed for low rank virgin coal.

(b) Oil-fired EGUs are subcategorized as noted in paragraphs (b)(1) through (b)(4) of this section and as defined in §63.10042.

(1) Continental liquid oil-fired EGUs

(2) Non-continental liquid oil-fired EGUs,

(3) Limited-use liquid oil-fired EGUs, and

(4) EGUs designed to burn solid oil-derived fuel.

(c) IGCC units combusting either gasified coal or gasified solid oil-derived fuel. For purposes of compliance, monitoring, recordkeeping, and reporting requirements in this subpart, IGCC units are subject in the same manner as coal-fired units and solid oil-derived fuel-fired units, unless otherwise indicated.

[↑ Back to Top](#)

### **§63.9991 What emission limitations, work practice standards, and operating limits must I meet?**

(a) You must meet the requirements in paragraphs (a)(1) and (2) of this section. You must meet these requirements at all times.

(1) You must meet each emission limit and work practice standard in Table 1 through 3 to this subpart that applies to your EGU, for each EGU at your source, except as provided under §63.10009.

(2) You must meet each operating limit in Table 4 to this subpart that applies to your EGU.

(b) As provided in §63.6(g), the Administrator may approve use of an alternative to the work practice standards in this section.

(c) You may use the alternate SO<sub>2</sub> limit in Tables 1 and 2 to this subpart only if your EGU:

(1) Has a system using wet or dry flue gas desulfurization technology and an SO<sub>2</sub> continuous emissions monitoring system (CEMS) installed on the EGU; and

(2) At all times, you operate the wet or dry flue gas desulfurization technology and the SO<sub>2</sub> CEMS installed on the EGU consistent with §63.10000(b).

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23402, Apr. 19, 2012; 81 FR 20180, Apr. 6, 2016]

[↑ Back to Top](#)

## GENERAL COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### **§63.10000 What are my general requirements for complying with this subpart?**

(a) You must be in compliance with the emission limits and operating limits in this subpart. These limits apply to you at all times except during periods of startup and shutdown; however, for coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGUs, you are required to meet the work practice requirements, items 3 and 4, in Table 3 to this subpart during periods of startup or shutdown.

(b) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. Determination of whether such operation and maintenance procedures are being used will be based on information available to the EPA Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(c)(1) For coal-fired units, IGCC units, and solid oil-derived fuel-fired units, initial performance testing is required for all pollutants, to demonstrate compliance with the applicable emission limits.

(i) For a coal-fired or solid oil-derived fuel-fired EGU or IGCC EGU, you may conduct initial performance testing in accordance with §63.10005(h), to determine whether the EGU qualifies as a low emitting EGU (LEE) for one or more applicable emission limits, except as otherwise provided in paragraphs (c)(1)(i)(A) and (B) of this section:

(A) Except as provided in paragraph (c)(1)(i)(C) of this section, you may not pursue the LEE option if your coal-fired, IGCC, or solid oil-derived fuel-fired EGU is equipped with a main stack and a bypass stack or bypass duct configuration that allows the effluent to bypass any pollutant control device.

(B) You may not pursue the LEE option for Hg if your coal-fired, solid oil-derived fuel-fired EGU or IGCC EGU is new.

(C) You may pursue the LEE option provided that:

(1) Your EGU's control device bypass emissions are measured in the bypass stack or duct or your control device bypass exhaust is routed through the EGU main stack so that emissions are measured during the bypass event; or

(2) Except for hours during which only clean fuel is combusted, you bypass your EGU control device only during emergency periods for no more than a total of 2 percent of your EGU's annual operating hours; you use clean fuels to the maximum extent possible during an emergency period; and you prepare and submit a report describing the emergency event, its cause, corrective action taken, and estimates of emissions released during the emergency event. You must include these emergency emissions along with performance test results in assessing whether your EGU maintains LEE status.

(ii) For a qualifying LEE for Hg emissions limits, you must conduct a 30-day performance test using Method 30B at least once every 12 calendar months to demonstrate continued LEE status.

(iii) For a qualifying LEE of any other applicable emissions limits, you must conduct a performance test at least once every 36 calendar months to demonstrate continued LEE status.

(iv) If your coal-fired or solid oil derived fuel-fired EGU or IGCC EGU does not qualify as a LEE for total non-mercury HAP metals, individual non-mercury HAP metals, or filterable particulate matter (PM), you must demonstrate compliance through an initial performance test and you must monitor continuous performance through either use of a particulate matter continuous parametric monitoring system (PM CPMS), a PM CEMS, or, for an existing EGU, compliance performance testing repeated quarterly.

(v) If your coal-fired or solid oil-derived fuel-fired EGU does not qualify as a LEE for hydrogen chloride (HCl), you may demonstrate initial and continuous compliance through use of an HCl CEMS, installed and operated in accordance with Appendix B to this subpart. As an alternative to HCl CEMS, you may demonstrate initial and continuous compliance by conducting an initial and periodic quarterly performance stack test for HCl. If your EGU uses wet or dry flue gas desulfurization technology (this includes limestone injection into a fluidized bed combustion unit), you may apply a second alternative to HCl CEMS by installing and operating a sulfur dioxide (SO<sub>2</sub>) CEMS installed and operated in accordance with part 75 of this chapter to demonstrate compliance with the applicable SO<sub>2</sub> emissions limit.

(vi) If your coal-fired or solid oil-derived fuel-fired EGU does not qualify as a LEE for Hg, you must demonstrate initial and continuous compliance through use of a Hg CEMS or a sorbent trap monitoring system, in accordance with appendix A to this subpart.

(A) You may choose to use separate sorbent trap monitoring systems to comply with this subpart: One sorbent trap monitoring system to demonstrate compliance with the numeric mercury emissions limit during periods other than startup or shutdown and the other sorbent trap monitoring system to report average mercury concentration during startup periods or shutdown periods.

(B) You may choose to use one sorbent trap monitoring system to demonstrate compliance with the mercury emissions limit at all times (including startup periods and shutdown periods) and to report average mercury concentration. You must follow the startup or shutdown requirements that follow and as given in Table 3 to this subpart for each coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGU.



(2) For liquid oil-fired EGUs, except limited use liquid oil-fired EGUs, initial performance testing is required for all pollutants, to demonstrate compliance with the applicable emission limits.

(i) For an existing liquid oil-fired unit, you may conduct the performance testing in accordance with §63.10005(h), to determine whether the unit qualifies as a LEE for one or more pollutants. For a qualifying LEE for Hg emissions limits, you must conduct a 30-day performance test using Method 30B at least once every 12 calendar months to demonstrate continued LEE status. For a qualifying LEE of any other applicable emissions limits, you must conduct a performance test at least once every 36 calendar months to demonstrate continued LEE status.

(ii) If your liquid oil-fired unit does not qualify as a LEE for total HAP metals (including mercury), individual metals (including mercury), or filterable PM you must demonstrate compliance through an initial performance test and you must monitor continuous performance through either use of a PM CPMS, a PM CEMS, or, for an existing EGU, performance testing conducted quarterly.

(iii) If your existing liquid oil-fired unit does not qualify as a LEE for hydrogen chloride (HCl) or for hydrogen fluoride (HF), you may demonstrate initial and continuous compliance through use of an HCl CEMS, an HF CEMS, or an HCl and HF CEMS, installed and operated in accordance with Appendix B to this rule. As an alternative to HCl CEMS, HF CEMS, or HCl and HF CEMS, you may demonstrate initial and continuous compliance through quarterly performance testing and parametric monitoring for HCl and HF. If you choose to use quarterly testing and parametric monitoring, then you must also develop a site-specific monitoring plan that identifies the CMS you will use to ensure that the operations of the EGU remains consistent with those during the performance test. As another alternative, you may measure or obtain, and keep records of, fuel moisture content; as long as fuel moisture does not exceed 1.0 percent by weight, you need not conduct other HCl or HF monitoring or testing.

(iv) If your unit qualifies as a limited-use liquid oil-fired as defined in §63.10042, then you are not subject to the emission limits in Tables 1 and 2, but you must comply with the performance tune-up work practice requirements in Table 3.

(d)(1) If you demonstrate compliance with any applicable emissions limit through use of a continuous monitoring system (CMS), where a CMS includes a continuous parameter monitoring system (CPMS) as well as a continuous emissions monitoring system (CEMS), you must develop a site-specific monitoring plan and submit this site-specific monitoring plan, if requested, at least 60 days before your initial performance evaluation (where applicable) of your CMS. This requirement also applies to you if you petition the Administrator for alternative monitoring parameters under §63.8(f). This requirement to develop and submit a site-specific monitoring plan does not apply to affected sources with existing monitoring plans that apply to CEMS and CPMS prepared under appendix B to part 60 or part 75 of this chapter, and that meet the requirements of §63.10010. Using the process described in §63.8(f)(4), you may request approval of monitoring system quality assurance and quality control procedures alternative to those specified in this paragraph of this section and, if approved, include those in your site-specific monitoring plan. The monitoring plan must address the provisions in paragraphs (d)(2) through (5) of this section.

(2) The site-specific monitoring plan shall include the information specified in paragraphs (d)(5)(i) through (d)(5)(vii) of this section. Alternatively, the requirements of paragraphs (d)(5)(i) through (d)(5)(vii) are considered to be met for a particular CMS or sorbent trap monitoring system if:

(i) The CMS or sorbent trap monitoring system is installed, certified, maintained, operated, and quality-assured either according to part 75 of this chapter, or appendix A or B to this subpart; and

(ii) The recordkeeping and reporting requirements of part 75 of this chapter, or appendix A or B to this subpart, that pertain to the CMS are met.

(3) If requested by the Administrator, you must submit the monitoring plan (or relevant portion of the plan) at least 60 days before the initial performance evaluation of a particular CMS, except where the CMS has already undergone a performance evaluation that meets the requirements of §63.10010 (e.g., if the CMS was previously certified under another program).

(4) You must operate and maintain the CMS according to the site-specific monitoring plan.

(5) The provisions of the site-specific monitoring plan must address the following items:

(i) Installation of the CMS or sorbent trap monitoring system sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of control of the exhaust emissions (e.g., on or downstream of the last control device). See §63.10010(a) for further details. For PM CPMS installations, follow the procedures in §63.10010(h).

(ii) Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems.

(iii) Schedule for conducting initial and periodic performance evaluations.

(iv) Performance evaluation procedures and acceptance criteria (e.g., calibrations), including the quality control program in accordance with the general requirements of §63.8(d).

(v) On-going operation and maintenance procedures, in accordance with the general requirements of §§63.8(c)(1)(ii), (c)(3), and (c)(4)(ii).

(vi) Conditions that define a CMS that is out of control consistent with §63.8(c)(7)(i) and for responding to out of control periods consistent with §§63.8(c)(7)(ii) and (c)(8).

(vii) On-going recordkeeping and reporting procedures, in accordance with the general requirements of §§63.10(c), (e)(1), and (e)(2)(i), or as specifically required under this subpart.

(e) As part of your demonstration of continuous compliance, you must perform periodic tune-ups of your EGU(s), according to §63.10021(e).

(f) Except as provided under paragraph (n) of this section, you are subject to the requirements of this subpart for at least 6 months following the last date you met the definition of an EGU subject to this subpart (e.g., 6 months after a cogeneration unit provided more than one third of its potential electrical output capacity and more than 25 megawatts electrical output to any power distributions system for sale). You may opt to remain subject to the provisions of this subpart beyond 6 months after the last date you met the definition of an EGU subject to this subpart, unless your unit is a solid waste incineration unit subject to standards under CAA section 129 (e.g., 40 CFR part 60, subpart CCCC (New Source Performance Standards (NSPS) for Commercial and Industrial Solid Waste Incineration Units, or subpart DDDD (Emissions Guidelines (EG) for Existing Commercial and Industrial Solid Waste Incineration Units). Notwithstanding the provisions of this subpart, an EGU that starts combusting solid waste is immediately subject to standards under CAA section 129 and the EGU remains subject to those standards until the EGU no longer meets the definition of a solid waste incineration unit consistent with the provisions of the applicable CAA section 129 standards.

(g) Except as provided under paragraph (n) of this section, if your unit no longer meets the definition of an EGU subject to this subpart you must be in compliance with any newly applicable standards on the date you are no longer subject to this subpart. The date you are no longer subject to this subpart is a date selected by you, that must be at least 6 months from the date that your unit last met the definition of an EGU subject to this subpart or the date you begin combusting solid waste, consistent with §63.9983(d). Your source must remain in compliance with this subpart until the date you select to cease complying with this subpart or the date you begin combusting solid waste, whichever is earlier.

(h)(1) If you own or operate an EGU that does not meet the definition of an EGU subject to this subpart on April 16, 2015, and you commence or recommence operations that cause you to meet the definition of an EGU subject to this subpart, you are subject to the provisions of this subpart, including, but not limited to, the emission limitations and the monitoring requirements, as of the first day you meet the definition of an EGU subject to this subpart. You must complete all initial compliance demonstrations for this subpart applicable to your EGU within 180 days after you commence or recommence operations that cause you to meet the definition of an EGU subject to this subpart.

(2) You must provide 30 days prior notice of the date you intend to commence or recommence operations that cause you to meet the definition of an EGU subject to this subpart. The notification must identify:

(i) The name of the owner or operator of the EGU, the location of the facility, the unit(s) that will commence or recommence operations that will cause the unit(s) to meet the definition of an EGU subject to this subpart, and the date of the notice;

(ii) The 40 CFR part 60, part 62, or part 63 subpart and subcategory currently applicable to your unit(s), and the subcategory of this subpart that will be applicable after you commence or recommence operation that will cause the unit(s) to meet the definition of an EGU subject to this subpart;

(iii) The date on which you became subject to the currently applicable emission limits;

(iv) The date upon which you will commence or recommence operations that will cause your unit to meet the definition of an EGU subject to this subpart, consistent with paragraph (f) of this section.

(i)(1) If you own or operate an EGU subject to this subpart and cease to operate in a manner that causes your unit to meet the definition of an EGU subject to this subpart, you must be in compliance with any newly applicable section 112 or 129 standards on the date you selected consistent with paragraphs (g) and (n) of this section.

(2) You must provide 30 days prior notice of the date your EGU will cease complying with this subpart. The notification must identify:

(i) The name of the owner or operator of the EGU(s), the location of the facility, the EGU(s) that will cease complying with this subpart, and the date of the notice;

(ii) The currently applicable subcategory under this subpart, and any 40 CFR part 60, part 62, or part 63 subpart and subcategory that will be applicable after you cease complying with this subpart;

(iii) The date on which you became subject to this subpart;

(iv) The date upon which you will cease complying with this subpart, consistent with paragraph (g) of this section.

(j) All air pollution control equipment necessary for compliance with any newly applicable emissions limits which apply as a result of the cessation or commencement or recommencement of operations that cause your EGU to meet the definition of an EGU subject to this subpart must be installed and operational as of the date your source ceases to be or becomes subject to this subpart.

(k) All monitoring systems necessary for compliance with any newly applicable monitoring requirements which apply as a result of the cessation or commencement or recommencement of operations that cause your EGU to meet the definition of an EGU subject to this subpart must be installed and operational as of the date your source ceases to be or becomes subject to this subpart. All calibration and drift checks must be performed as of the date your source ceases to be or becomes subject to this subpart. You must also comply with provisions of §§63.10010, 63.10020, and 63.10021 of this subpart. Relative accuracy tests must be performed as of the performance test deadline for PM CEMS, if applicable. Relative accuracy testing for other CEMS need not be repeated if that testing was previously performed consistent with CAA section 112 monitoring requirements or monitoring requirements under this subpart.

(l) On or before the date an EGU is subject to this subpart, you must install, certify, operate, maintain, and quality assure each monitoring system necessary for demonstrating compliance with the work practice standards for PM or non-mercury HAP metals during startup periods and shutdown periods. You must collect, record, report, and maintain data obtained from these monitoring systems during startup periods and shutdown periods.

(m) Should you choose to rely on paragraph (2) of the definition of "startup" in §63.10042 for your EGU, on or before the date your EGU is subject to this subpart, you must install, verify, operate, maintain, and quality assure each monitoring system necessary for demonstrating compliance with the work practice standards for PM or non-mercury HAP metals controls during startup periods and shutdown periods required to comply with §63.10020(e).

(1) You may rely on monitoring system specifications or instructions or manufacturer's specifications when installing, verifying, operating, maintaining, and quality assuring each monitoring system.

(2) You must collect, record, report, and maintain data obtained from these monitoring systems during startup periods and shutdown periods.

(n) If you have permanently converted your EGU from coal or oil to natural gas or biomass after your compliance date (or, if applicable, after your approved extended compliance date), as demonstrated by being subject to a permit provision or physical limitation (including retirement) that prevents you from operating in a manner that would subject you to this subpart, you are no longer subject to this subpart, notwithstanding the coal or oil usage in the previous calendar years. The date on which you are no longer subject to this subpart is the date on which you converted to natural gas or biomass firing; it is also the date on which you must be in compliance with any newly applicable standards.

[↑ Back to Top](#)

## §63.10001 [Reserved]

[↑ Back to Top](#)

## TESTING AND INITIAL COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### §63.10005 What are my initial compliance requirements and by what date must I conduct them?

(a) *General requirements.* For each of your affected EGUs, you must demonstrate initial compliance with each applicable emissions limit in Table 1 or 2 of this subpart through performance testing. Where two emissions limits are specified for a particular pollutant (e.g., a heat input-based limit in lb/MMBtu and a gross output-based limit in lb/MWh), you may demonstrate compliance with either emission limit. For a particular compliance demonstration, you may be required to conduct one or more of the following activities in conjunction with performance testing: collection of data, e.g., hourly gross output data (megawatts); establishment of operating limits according to §63.10011 and Tables 4 and 7 to this subpart; and CMS performance evaluations. In all cases, you must demonstrate initial compliance no later than the date in paragraph (f) of this section for tune-up work practices for existing EGUs; the date that compliance must be demonstrated, as given in §63.9984 for other requirements for existing EGUs; and in paragraph (g) of this section for all requirements for new EGUs.

(1) To demonstrate initial compliance with an applicable emissions limit in Table 1 or 2 to this subpart using stack testing, the initial performance test generally consists of three runs at specified process operating conditions using approved methods. If you are required to establish operating limits (see paragraph (d) of this section and Table 4 to this subpart), you must collect all applicable parametric data during the performance test period. Also, if you choose to comply with an electrical output-based emission limit, you must collect hourly electrical load data during the test period.

(2) To demonstrate initial compliance using either a CMS that measures HAP concentrations directly (i.e., an Hg, HCl, or HF CEMS, or a sorbent trap monitoring system) or an SO<sub>2</sub> or PM CEMS, the initial performance test shall consist of 30- or, for certain coal-fired existing EGUs that use emissions averaging for Hg, 90-boiler operating days. If the CMS is certified prior to the compliance date (or, if applicable, the approved extended compliance date), the test shall begin with the first operating day on or after that date, except as otherwise provided in paragraph (b) of this section. If the CMS is not certified prior to the compliance date, the test shall begin with the first operating day after certification testing is successfully completed. In all cases, the initial 30- or 90- operating day averaging period must be completed on or before the date that compliance must be demonstrated (i.e., 180 days after the applicable compliance date).

(i) The CMS performance test must demonstrate compliance with the applicable Hg, HCl, HF, PM, or SO<sub>2</sub> emissions limit in Table 1 or 2 to this subpart.

(ii) You must collect hourly data from auxiliary monitoring systems (i.e., stack gas flow rate, CO<sub>2</sub>, O<sub>2</sub>, or moisture, as applicable) during the performance test period, in order to convert the pollutant concentrations to units of the standard. If you choose to comply with a gross output-based emission limit, you must also collect hourly gross output data during the performance test period.

(iii) For a group of affected units that are in the same subcategory, are subject to the same emission standards, and share a common stack, if you elect to demonstrate compliance by monitoring emissions at the common stack, startup and shutdown emissions (if any) that occur during the 30-(or, if applicable, 90-) boiler operating day performance test must either be excluded from or included in the compliance demonstration as follows:

(A) If one of the units that shares the stack either starts up or shuts down at a time when none of the other units is operating, you must exclude all pollutant emission rates measured during the startup or shutdown period, unless you are using a sorbent trap monitoring system to measure Hg emissions and have elected to include startup and shutdown emissions in the compliance demonstrations;

(B) If all units that are currently operating are in the startup or shutdown mode, you must exclude all pollutant emission rates measured during the startup or shutdown period, unless you are using a sorbent trap monitoring system to measure Hg emissions and have elected to include startup and shutdown emissions in the compliance demonstrations; or

(C) If any unit starts up or shuts down at a time when another unit is operating, and the other unit is not in the startup or shutdown mode, you must include all pollutant emission rates measured during the startup or shutdown period in the compliance demonstrations.

(b) *Performance testing requirements.* If you choose to use performance testing to demonstrate initial compliance with the applicable emissions limits in Tables 1 and 2 to this subpart for your EGUs, you must conduct the tests according to §63.10007 and Table 5 to this subpart. For the purposes of the initial compliance demonstration, you may use test data and results from a performance test conducted prior to the date on which compliance is required as specified in §63.9984, provided that the following conditions are fully met:

(1) For a performance test based on stack test data, the test was conducted no more than 12 calendar months prior to the date on which compliance is required as specified in §63.9984;

(2) For a performance test based on data from a certified CEMS or sorbent trap monitoring system, the test consists of all valid CMS data recorded in the 30 boiler operating days immediately preceding that date;

(3) The performance test was conducted in accordance with all applicable requirements in §63.10007 and Table 5 to this subpart;

(4) A record of all parameters needed to convert pollutant concentrations to units of the emission standard (e.g., stack flow rate, diluent gas concentrations, hourly gross outputs) is available for the entire performance test period; and

(5) For each performance test based on stack test data, you certify, and keep documentation demonstrating, that the EGU configuration, control devices, and fuel(s) have remained consistent with conditions since the prior performance test was conducted.

(6) For performance stack test data that are collected prior to the date that compliance must be demonstrated and are used to demonstrate initial compliance with applicable emissions limits, the interval for subsequent stack tests begins on the date that compliance must be demonstrated.

(c) *Operating limits.* In accordance with §63.10010 and Table 4 to this subpart, you may be required to establish operating limits using PM CPMS and using site-specific monitoring for certain liquid oil-fired units as part of your initial compliance demonstration.

(d) *CMS requirements.* If, for a particular emission or operating limit, you are required to (or elect to) demonstrate initial compliance using a continuous monitoring system, the CMS must pass a performance evaluation prior to the initial compliance demonstration. If a CMS has been previously certified under another state or federal program and is continuing to meet the on-going quality-assurance (QA) requirements of that program, then, provided that the certification and QA provisions of that program meet the applicable requirements of §§63.10010(b) through (h), an additional performance evaluation of the CMS is not required under this subpart.

(1) For an affected coal-fired, solid oil-derived fuel-fired, or liquid oil-fired EGU, you may demonstrate initial compliance with the applicable SO<sub>2</sub>, HCl, or HF emissions limit in Table 1 or 2 to this subpart through use of an SO<sub>2</sub>, HCl, or HF CEMS installed and operated in accordance with part 75 of this chapter or appendix B to this subpart, as applicable. You may also demonstrate compliance with a filterable PM emission limit in Table 1 or 2 to this subpart through use of a PM CEMS installed, certified, and operated in accordance with §63.10010(i). Initial compliance is achieved if the arithmetic average of 30-boiler operating days of quality-assured CEMS data, expressed in units of the standard (see §63.10007(e)), meets the applicable SO<sub>2</sub>, PM, HCl, or HF emissions limit in Table 1 or 2 to this subpart. Use Equation 19-19 of Method 19 in appendix A-7 to part 60 of this chapter to calculate the 30-boiler operating day average emissions rate. (NOTE: For this calculation, the term E<sub>ij</sub> in Equation 19-19 must be in the same units of measure as the applicable HCl or HF emission limit in Table 1 or 2 to this subpart).

(2) For affected coal-fired or solid oil-derived fuel-fired EGUs that demonstrate compliance with the applicable emission limits for total non-mercury HAP metals, individual non-mercury HAP metals, total HAP metals, individual HAP metals, or filterable PM listed in Table 1 or 2 to this subpart using initial performance testing and continuous monitoring with PM CPMS:

(i) You must demonstrate initial compliance no later than the applicable date specified in §63.9984(f) for existing EGUs and in paragraph (g) of this section for new EGUs.

(ii) You must demonstrate continuous compliance with the PM CPMS site-specific operating limit that corresponds to the results of the performance test demonstrating compliance with the emission limit with which you choose to comply.

(iii) You must repeat the performance test annually for the selected pollutant emissions limit and reassess and adjust the site-specific operating limit in accordance with the results of the performance test.

(3) For affected EGUs that are either required to or elect to demonstrate initial compliance with the applicable Hg emission limit in Table 1 or 2 of this subpart using Hg CEMS or sorbent trap monitoring systems, initial compliance must be demonstrated no later than the applicable date specified in §63.9984(f) for existing EGUs and in paragraph (g) of this section for new EGUs. Initial compliance is achieved if the arithmetic average of 30- (or 90-) boiler operating days of quality-assured CEMS (or sorbent trap monitoring system) data, expressed in units of the standard (see section 6.2 of appendix A to this subpart), meets the applicable Hg emission limit in Table 1 or 2 to this subpart.

(4) For affected liquid oil-fired EGUs that demonstrate compliance with the applicable emission limits for HCl or HF listed in Table 1 or 2 to this subpart using quarterly testing and continuous monitoring with a CMS:

(i) You must demonstrate initial compliance no later than the applicable date specified in §63.9984(f) for existing EGUs and in paragraph (g) of this section for new EGUs.

(ii) You must demonstrate continuous compliance with the CMS site-specific operating limit that corresponds to the results of the performance test demonstrating compliance with the HCl or HF emissions limit.

(iii) You must repeat the performance test annually for the HCl or HF emissions limit and reassess and adjust the site-specific operating limit in accordance with the results of the performance test.

(e) *Tune-ups*. All affected EGUs are subject to the work practice standards in Table 3 of this subpart. As part of your initial compliance demonstration, you must conduct a performance tune-up of your EGU according to §63.10021(e).

(f) For an existing EGU without a neural network, a tune-up, following the procedures in §63.10021(e), must occur within 6 months (180 days) after April 16, 2015. For an existing EGU with a neural network, a tune-up must occur within 18 months (545 days) after April 16, 2016. If a tune-up occurs prior to April 16, 2015, you must keep records showing that the tune-up met all rule requirements.

(g) If your new or reconstructed affected source commenced construction or reconstruction between May 3, 2011, and July 2, 2011, you must demonstrate initial compliance with either the proposed emission limits or the promulgated emission limits no later than 180 days after April 16, 2012 or within 180 days after startup of the source, whichever is later, according to §63.7(a)(2)(ix).

(1) For the new or reconstructed affected source described in this paragraph (g), if you choose to comply with the proposed emission limits when demonstrating initial compliance, you must conduct a second compliance demonstration for the promulgated emission limits within 3 years after April 16, 2012 or within 3 years after startup of the affected source, whichever is later.

(2) If your new or reconstructed affected source commences construction or reconstruction after April 16, 2012, you must demonstrate initial compliance with the promulgated emission limits no later than 180 days after startup of the source.

(h) *Low emitting EGUs*. The provisions of this paragraph (h) apply to pollutants with emissions limits from new EGUs except Hg and to all pollutants with emissions limits from existing EGUs. You may pursue this compliance option unless prohibited pursuant to §63.10000(c)(1)(i).

(1) An EGU may qualify for low emitting EGU (LEE) status for Hg, HCl, HF, filterable PM, total non-Hg HAP metals, or individual non-Hg HAP metals (or total HAP metals or individual HAP metals, for liquid oil-fired EGUs) if you collect performance test data that meet the requirements of this paragraph (h), and if those data demonstrate:

(i) For all pollutants except Hg, performance test emissions results less than 50 percent of the applicable emissions limits in Table 1 or 2 to this subpart for all required testing for 3 consecutive years; or



(ii) For Hg emissions from an existing EGU, either:

(A) Average emissions less than 10 percent of the applicable Hg emissions limit in Table 2 to this subpart (expressed either in units of lb/TBtu or lb/GWh); or

(B) Potential Hg mass emissions of 29.0 or fewer pounds per year and compliance with the applicable Hg emission limit in Table 2 to this subpart (expressed either in units of lb/TBtu or lb/GWh).

(2) For all pollutants except Hg, you must conduct all required performance tests described in §63.10007 to demonstrate that a unit qualifies for LEE status.

(i) When conducting emissions testing to demonstrate LEE status, you must increase the minimum sample volume specified in Table 1 or 2 nominally by a factor of two.

(ii) Follow the instructions in §63.10007(e) and Table 5 to this subpart to convert the test data to the units of the applicable standard.

(3) For Hg, you must conduct a 30- (or 90-) boiler operating day performance test using Method 30B in appendix A-8 to part 60 of this chapter to determine whether a unit qualifies for LEE status. Locate the Method 30B sampling probe tip at a point within 10 percent of the duct area centered about the duct's centroid at a location that meets Method 1 in appendix A-1 to part 60 of this chapter and conduct at least three nominally equal length test runs over the 30- (or 90-) boiler operating day test period. You may use a pair of sorbent traps to sample the stack gas for a period consistent with that given in section 5.2.1 of appendix A to this subpart. Collect Hg emissions data continuously over the entire test period (except when changing sorbent traps or performing required reference method QA procedures). As an alternative to constant rate sampling per Method 30B, you may use proportional sampling per section 8.2.2 of Performance Specification 12 B in appendix B to part 60 of this chapter.

(i) Depending on whether you intend to assess LEE status for Hg in terms of the lb/TBtu or lb/GWh emission limit in Table 2 to this subpart or in terms of the annual Hg mass emissions limit of 29.0 lb/year, you will have to collect some or all of the following data during the 30-boiler operating day test period (see paragraph (h)(3)(iii) of this section):

(A) Diluent gas (CO<sub>2</sub> or O<sub>2</sub>) data, using either Method 3A in appendix A-3 to part 60 of this chapter or a diluent gas monitor that has been certified according to part 75 of this chapter.

(B) Stack gas flow rate data, using either Method 2, 2F, or 2G in appendices A-1 and A-2 to part 60 of this chapter, or a flow rate monitor that has been certified according to part 75 of this chapter.

(C) Stack gas moisture content data, using either Method 4 in appendix A-1 to part 60 of this chapter, or a moisture monitoring system that has been certified according to part 75 of this chapter. Alternatively, an appropriate fuel-specific default moisture value from §75.11(b) of this chapter may be used in the calculations or you may petition the Administrator under §75.66 of this chapter for use of a default moisture value for non-coal-fired units.

(D) Hourly gross output data (megawatts), from facility records.

(ii) If you use CEMS to measure CO<sub>2</sub> (or O<sub>2</sub>) concentration, and/or flow rate, and/or moisture, record hourly average values of each parameter throughout the 30-boiler operating day test period. If you opt to use EPA reference methods rather than CEMS for any parameter, you must perform at least one representative test run on each operating day of the test period, using the applicable reference method.

(iii) Calculate the average Hg concentration, in µg/m<sup>3</sup> (dry basis), for the 30- (or 90-) boiler operating day performance test, as the arithmetic average of all Method 30B sorbent trap results. Also calculate, as applicable, the average values of CO<sub>2</sub> or O<sub>2</sub> concentration, stack gas flow rate, stack gas moisture content, and gross output for the test period. Then:

(A) To express the test results in units of lb/TBtu, follow the procedures in §63.10007(e). Use the average Hg concentration and diluent gas values in the calculations.

(B) To express the test results in units of lb/GWh, use Equations A-3 and A-4 in section 6.2.2 of appendix A to this subpart, replacing the hourly values “C<sub>h</sub>”, “Q<sub>h</sub>”, “B<sub>ws</sub>” and “(MW)<sub>h</sub>” with the average values of these parameters from the performance test.

(C) To calculate pounds of Hg per year, use one of the following methods:

(1) Multiply the average lb/TBtu Hg emission rate (determined according to paragraph (h)(3)(iii)(A) of this section) by the maximum potential annual heat input to the unit (TBtu), which is equal to the maximum rated unit heat input (TBtu/hr) times 8,760 hours. If the maximum rated heat input value is expressed in units of MMBtu/hr, multiply it by 10<sup>-6</sup> to convert it to TBtu/hr; or

(2) Multiply the average lb/GWh Hg emission rate (determined according to paragraph (h)(3)(iii)(B) of this section) by the maximum potential annual electricity generation (GWh), which is equal to the maximum rated electrical output of the unit (GW) times 8,760 hours. If the maximum rated electrical output value is expressed in units of MW, multiply it by 10<sup>-3</sup> to convert it to GW; or

(3) If an EGU has a federally-enforceable permit limit on either the annual heat input or the number of annual operating hours, you may modify the calculations in paragraph (h)(3)(iii)(C)(1) of this section by replacing the maximum potential annual heat input or 8,760 unit operating hours with the permit limit on annual heat input or operating hours (as applicable).

(4) For a group of affected units that vent to a common stack, you may either assess LEE status for the units individually by performing a separate emission test of each unit in the duct leading from the unit to the common stack, or you may perform a single emission test in the common stack. If you choose the common stack testing option, the units in the configuration qualify for LEE status if:

(i) The emission rate measured at the common stack is less than 50 percent (10 percent for Hg) of the applicable emission limit in Table 1 or 2 to this subpart; or

(ii) For Hg from an existing EGU, the applicable Hg emission limit in Table 2 to this subpart is met and the potential annual mass emissions, calculated according to paragraph (h)(3)(iii) of this section (with some modifications), are less than or equal to 29.0 pounds times the number of units sharing the common stack. Base your calculations on the combined heat input capacity of all units sharing the stack (*i.e.*, either the combined maximum rated value or, if applicable, a lower combined value restricted by permit conditions or operating hours).

(5) For an affected unit with a multiple stack or duct configuration in which the exhaust stacks or ducts are downstream of all emission control devices, you must perform a separate emission test in each stack or duct. The unit qualifies for LEE status if:

(i) The emission rate, based on all test runs performed at all of the stacks or ducts, is less than 50 percent (10 percent for Hg) of the applicable emission limit in Table 1 or 2 to this subpart; or

(ii) For Hg from an existing EGU, the applicable Hg emission limit in Table 2 to this subpart is met and the potential annual mass emissions, calculated according to paragraph (h)(3)(iii) of this section, are less than or equal to 29.0 pounds. Use the average Hg emission rate from paragraph (h)(5)(i) of this section in your calculations.

(i) *Liquid-oil fuel moisture measurement.* If your EGU combusts liquid fuels, if your fuel moisture content is no greater than 1.0 percent by weight, and if you would like to demonstrate initial and ongoing compliance with HCl and HF emissions limits, you must meet the requirements of paragraphs (i)(1) through (5) of this section.

(1) Measure fuel moisture content of each shipment of fuel if your fuel arrives on a batch basis; or

(2) Measure fuel moisture content daily if your fuel arrives on a continuous basis; or

(3) Obtain and maintain a fuel moisture certification from your fuel supplier.

(4) Use one of the following methods to determine fuel moisture content:

(i) ASTM D95-05 (Reapproved 2010), "Standard Test Method for Water in Petroleum Products and Bituminous Materials by Distillation," or

(ii) ASTM D4006-11, "Standard Test Method for Water in Crude Oil by Distillation," including Annex A1 and Appendix A1.

(5) Use one of the following methods to obtain fuel moisture samples:

(i) ASTM D4177-95 (Reapproved 2010), "Standard Practice for Automatic Sampling of Petroleum and Petroleum Products," including Annexes A1 through A6 and Appendices X1 and X2, or

(ii) ASTM D4057-06 (Reapproved 2011), "Standard Practice for Manual Sampling of Petroleum and Petroleum Products," including Annex A1.

(6) Should the moisture in your liquid fuel be more than 1.0 percent by weight, you must

(i) Conduct HCl and HF emissions testing quarterly (and monitor site-specific operating parameters as provided in §63.10000(c)(2)(iii) or

(ii) Use an HCl CEMS and/or HF CEMS.

(j) Startup and shutdown for coal-fired or solid oil derived-fired units. You must follow the requirements given in Table 3 to this subpart.

(k) You must submit a Notification of Compliance Status summarizing the results of your initial compliance demonstration, as provided in §63.10030.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23403, Apr. 19, 2012; 78 FR 24084, Apr. 24, 2013; 79 FR 68789, Nov. 19, 2014; 81 FR 20181, Apr. 6, 2016]

[↑ Back to Top](#)

### **§63.10006 When must I conduct subsequent performance tests or tune-ups?**

(a) For liquid oil-fired, solid oil-derived fuel-fired and coal-fired EGUs and IGCC units using PM CPMS to monitor continuous performance with an applicable emission limit as provided for under §63.10000(c), you must conduct all applicable performance tests according to Table 5 to this subpart and §63.10007 at least every year.

(b) For affected units meeting the LEE requirements of §63.10005(h), you must repeat the performance test once every 3 years (once every year for Hg) according to Table 5 and §63.10007. Should subsequent emissions testing results show the unit does not meet the LEE eligibility requirements, LEE status is lost. If this should occur:

(1) For all pollutant emission limits except for Hg, you must conduct emissions testing quarterly, except as otherwise provided in §63.10021(d)(1).

(2) For Hg, you must install, certify, maintain, and operate a Hg CEMS or a sorbent trap monitoring system in accordance with appendix A to this subpart, within 6 calendar months of losing LEE eligibility. Until the Hg CEMS or sorbent trap monitoring system is installed, certified, and operating, you must conduct Hg emissions testing quarterly, except as otherwise provided in §63.10021(d)(1). You must have 3 calendar years of testing and CEMS or sorbent trap monitoring system data that satisfy the LEE emissions criteria to reestablish LEE status.

(c) Except where paragraphs (a) or (b) of this section apply, or where you install, certify, and operate a PM CEMS to demonstrate compliance with a filterable PM emissions limit, for liquid oil-, solid oil-derived fuel-, coal-fired and IGCC EGUs, you must conduct all applicable periodic emissions tests for filterable PM, individual, or total HAP metals emissions according to Table 5 to this subpart, §63.10007, and §63.10000(c), except as otherwise provided in §63.10021(d)(1).

(d) Except where paragraph (b) of this section applies, for solid oil-derived fuel- and coal-fired EGUs that do not use either an HCl CEMS to monitor compliance with the HCl limit or an SO<sub>2</sub> CEMS to monitor compliance with the alternate equivalent SO<sub>2</sub> emission limit, you must conduct all applicable periodic HCl emissions tests according to Table 5 to this subpart and §63.10007 at least quarterly, except as otherwise provided in §63.10021(d)(1).

(e) Except where paragraph (b) of this section applies, for liquid oil-fired EGUs without HCl CEMS, HF CEMS, or HCl and HF CEMS, you must conduct all applicable emissions tests for HCl, HF, or HCl and HF emissions according to Table 5 to this subpart and §63.10007 at least quarterly, except as otherwise provided in §63.10021(d)(1), and conduct site-specific monitoring under a plan as provided for in §63.10000(c)(2)(iii).

(f) *Time between performance tests.* (1) Notwithstanding the provisions of §63.10021(d)(1), the requirements listed in paragraphs (g) and (h) of this section, and the requirements of paragraph (f)(3) of this section, you must complete performance tests for your EGU as follows:

(i) At least 45 calendar days, measured from the test's end date, must separate performance tests conducted every quarter;

(ii) For annual testing:

(A) At least 320 calendar days, measured from the test's end date, must separate performance tests;

(B) At least 320 calendar days, measured from the test's end date, must separate annual sorbent trap mercury testing for 30-boiler operating day LEE tests;

(C) At least 230 calendar days, measured from the test's end date, must separate annual sorbent trap mercury testing for 90-boiler operating day LEE tests; and

(iii) At least 1,050 calendar days, measured from the test's end date, must separate performance tests conducted every 3 years.

(2) For units demonstrating compliance through quarterly emission testing, you must conduct a performance test in the 4th quarter of a calendar year if your EGU has skipped performance tests in the first 3 quarters of the calendar year.

(3) If your EGU misses a performance test deadline due to being inoperative and if 168 or more boiler operating hours occur in the next test period, you must complete an additional performance test in that period as follows:

(i) At least 15 calendar days must separate two performance tests conducted in the same quarter.

(ii) At least 107 calendar days must separate two performance tests conducted in the same calendar year.

(iii) At least 350 calendar days must separate two performance tests conducted in the same 3 year period.

(g) If you elect to demonstrate compliance using emissions averaging under §63.10009, you must continue to conduct performance stack tests at the appropriate frequency given in section (c) through (f) of this section.

(h) If a performance test on a non-mercury LEE shows emissions in excess of 50 percent of the emission limit and if you choose to reapply for LEE status, you must conduct performance tests at the appropriate frequency given in section (c) through (e) of this section for that pollutant until all performance tests over a consecutive 3-year period show compliance with the LEE criteria.

(i) If you are required to meet an applicable tune-up work practice standard, you must conduct a performance tune-up according to §63.10021(e).

(1) For EGUs not employing neural network combustion optimization during normal operation, each performance tune-up specified in §63.10021(e) must be no more than 36 calendar months after the previous performance tune-up.

(2) For EGUs employing neural network combustion optimization systems during normal operation, each performance tune-up specified in §63.10021(e) must be no more than 48 calendar months after the previous performance tune-up.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23403, Apr. 19, 2012; 78 FR 24085, Apr. 24, 2013; 81 FR 20182, Apr. 6, 2016]

[↑ Back to Top](#)

### **§63.10007 What methods and other procedures must I use for the performance tests?**

(a) Except as otherwise provided in this section, you must conduct all required performance tests according to §63.7(d), (e), (f), and (h). You must also develop a site-specific test plan according to the requirements in §63.7(c).

(1) If you use CEMS (Hg, HCl, SO<sub>2</sub>, or other) to determine compliance with a 30- (or, if applicable, 90-) boiler operating day rolling average emission limit, you must collect quality- assured CEMS data for all unit operating conditions, including startup and shutdown (see §63.10011(g) and Table 3 to this subpart), except as otherwise provided in §63.10020(b). Emission rates determined during startup periods and shutdown periods (as defined in §63.10042) are not to be included in the compliance determinations, except as otherwise provided in §§63.10000(c)(1)(vi)(B) and 63.10005(a)(2)(iii).

(2) If you conduct performance testing with test methods in lieu of continuous monitoring, operate the unit at maximum normal operating load conditions during each periodic (e.g., quarterly) performance test. Maximum normal operating load will be generally between 90 and 110 percent of design capacity but should be representative of site specific normal operations during each test run.

(3) For establishing operating limits with particulate matter continuous parametric monitoring system (PM CPMS) to demonstrate compliance with a PM or non Hg metals emissions limit, operate the unit at maximum normal operating load conditions during the performance test period. Maximum normal operating load will be generally between 90 and 110 percent of design capacity but should be representative of site specific normal operations during each test run.

(b) You must conduct each performance test (including traditional 3-run stack tests, 30-boiler operating day tests based on CEMS data (or sorbent trap monitoring system data), and 30-boiler operating day Hg emission tests for LEE qualification) according to the requirements in Table 5 to this subpart.

(c) If you choose the filterable PM method to comply with the PM emission limit and demonstrate continuous performance using a PM CPMS as provided for in §63.10000(c), you must also establish an operating limit according to §63.10011(b), §63.10023, and Tables 4 and 6 to this subpart. Should you desire to have operating limits that correspond to loads other than maximum normal operating load, you must conduct testing at those other loads to determine the additional operating limits.

(d) Except for a 30-boiler operating day performance test based on CEMS (or sorbent trap monitoring system) data, where the concept of test runs does not apply, you must conduct a minimum of three separate test runs for each performance test, as specified in §63.7(e)(3). Each test run must comply with the minimum applicable sampling time or volume specified in Table 1 or 2 to this subpart. Sections 63.10005(d) and (h), respectively, provide special instructions for conducting

performance tests based on CEMS or sorbent trap monitoring systems, and for conducting emission tests for LEE qualification.

(e) To use the results of performance testing to determine compliance with the applicable emission limits in Table 1 or 2 to this subpart, proceed as follows:

(1) Except for a 30-boiler operating day performance test based on CEMS (or sorbent trap monitoring system) data, if measurement results for any pollutant are reported as below the method detection level (e.g., laboratory analytical results for one or more sample components are below the method defined analytical detection level), you must use the method detection level as the measured emissions level for that pollutant in calculating compliance. The measured result for a multiple component analysis (e.g., analytical values for multiple Method 29 fractions both for individual HAP metals and for total HAP metals) may include a combination of method detection level data and analytical data reported above the method detection level.

(2) If the limits are expressed in lb/MMBtu or lb/TBtu, you must use the F-factor methodology and equations in sections 12.2 and 12.3 of EPA Method 19 in appendix A-7 to part 60 of this chapter. In cases where an appropriate F-factor is not listed in Table 19-2 of Method 19, you may use F-factors from Table 1 in section 3.3.5 of appendix F to part 75 of this chapter, or F-factors derived using the procedures in section 3.3.6 of appendix to part 75 of this chapter. Use the following factors to convert the pollutant concentrations measured during the initial performance tests to units of lb/scf, for use in the applicable Method 19 equations:

- (i) Multiply SO<sub>2</sub> ppm by  $1.66 \times 10^{-7}$ ;
- (ii) Multiply HCl ppm by  $9.43 \times 10^{-8}$ ;
- (iii) Multiply HF ppm by  $5.18 \times 10^{-8}$ ;
- (iv) Multiply HAP metals concentrations (mg/dscm) by  $6.24 \times 10^{-8}$ ; and
- (v) Multiply Hg concentrations (µg/scm) by  $6.24 \times 10^{-11}$ .

(3) To determine compliance with emission limits expressed in lb/MWh or lb/GWh, you must first calculate the pollutant mass emission rate during the performance test, in units of lb/h. For Hg, if a CEMS or sorbent trap monitoring system is used, use Equation A-2 or A-3 in appendix A to this subpart (as applicable). In all other cases, use an equation that has the general form of Equation A-2 or A-3, replacing the value of K with  $1.66 \times 10^{-7}$  lb/scf-ppm for SO<sub>2</sub>,  $9.43 \times 10^{-8}$  lb/scf-ppm for HCl (if an HCl CEMS is used),  $5.18 \times 10^{-8}$  lb/scf-ppm for HF (if an HF CEMS is used), or  $6.24 \times 10^{-8}$  lb-sc/mg-scf for HAP metals and for HCl and HF (when performance stack testing is used), and defining C<sub>n</sub> as the average SO<sub>2</sub>, HCl, or HF concentration in ppm, or the average HAP metals concentration in mg/dscm. This calculation requires stack gas volumetric flow rate (scfh) and (in some cases) moisture content data (see §§63.10005(h)(3) and 63.10010). Then, if the applicable emission limit is in units of lb/GWh, use Equation A-4 in appendix A to this subpart to calculate the pollutant emission rate in lb/GWh. In this calculation, define (M)<sub>n</sub> as the calculated pollutant mass emission rate for the performance test (lb/h), and define (MW)<sub>n</sub> as the average electrical load during the performance test (megawatts). If the applicable emission limit is in lb/MWh rather than lb/GWh, omit the 10<sup>3</sup> term from Equation A-4 to determine the pollutant emission rate in lb/MWh.

(f) If you elect to (or are required to) use CEMS to continuously monitor Hg, HCl, HF, SO<sub>2</sub>, or PM emissions (or, if applicable, sorbent trap monitoring systems to continuously collect Hg emissions data), the following default values are available for use in the emission rate calculations

during startup periods or shutdown periods (as defined in §63.10042). For the purposes of this subpart, these default values are not considered to be substitute data.

(1) *Diluent cap values.* If you use CEMS (or, if applicable, sorbent trap monitoring systems) to comply with a heat input-based emission rate limit, you may use the following diluent cap values for a startup or shutdown hour in which the measured CO<sub>2</sub> concentration is below the cap value or the measured O<sub>2</sub> concentration is above the cap value:

(i) For an IGCC EGU, you may use 1% for CO<sub>2</sub> or 19% for O<sub>2</sub>.

(ii) For all other EGUs, you may use 5% for CO<sub>2</sub> or 14% for O<sub>2</sub>.

(2) *Default gross output.* If you use CEMS to continuously monitor Hg, HCl, HF, SO<sub>2</sub>, or PM emissions (or, if applicable, sorbent trap monitoring systems to continuously collect Hg emissions data), the following default value is available for use in the emission rate calculations during startup periods or shutdown periods (as defined in §63.10042). For the purposes of this subpart, this default value is not considered to be substitute data. For a startup or shutdown hour in which there is heat input to an affected EGU but zero gross output, you must calculate the pollutant emission rate using a value equivalent to 5% of the maximum sustainable gross output, expressed in megawatts, as defined in section 6.5.2.1(a)(1) of appendix A to part 75 of this chapter. This default gross output is either the nameplate capacity of the EGU or the highest gross output observed in at least four representative quarters of EGU operation. For a monitored common stack, the default gross output is used only when all EGUs are operating (*i.e.*, combusting fuel) are in startup or shutdown mode, and have zero electrical generation. Under those conditions, a default gross output equal to 5% of the combined maximum sustainable gross output of the EGUs that are operating but have a total of zero gross output must be used to calculate the hourly gross output-based pollutant emissions rate.

(g) Upon request, you shall make available to the EPA Administrator such records as may be necessary to determine whether the performance tests have been done according to the requirements of this section.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23403, Apr. 19, 2012; 78 FR 24085, Apr. 24, 2013; 79 FR 68789, Nov. 19, 2014; 81 FR 20182, Apr. 6, 2016]

[↑ Back to Top](#)

#### **§63.10008 [Reserved]**

[↑ Back to Top](#)

#### **§63.10009 May I use emissions averaging to comply with this subpart?**

(a) *General eligibility.* (1) You may use emissions averaging as described in paragraph (a)(2) of this section as an alternative to meeting the requirements of §63.9991 for filterable PM, SO<sub>2</sub>, HF, HCl, non-Hg HAP metals, or Hg on an EGU-specific basis if:

(i) You have more than one existing EGU in the same subcategory located at one or more contiguous properties, belonging to a single major industrial grouping, which are under common control of the same person (or persons under common control); and



(ii) You use CEMS (or sorbent trap monitoring systems for determining Hg emissions) or quarterly emissions testing for demonstrating compliance.

(2) You may demonstrate compliance by emissions averaging among the existing EGUs in the same subcategory, if your averaged Hg emissions for EGUs in the “unit designed for coal  $\geq 8,300$  Btu/lb” subcategory are equal to or less than 1.2 lb/TBtu or 1.3E-2 lb/GWh on a 30-boiler operating day basis or if your averaged emissions of individual, other pollutants from other subcategories of such EGUs are equal to or less than the applicable emissions limit in Table 2 to this subpart, according to the procedures in this section. Note that except for the alternate Hg emissions limit from EGUs in the “unit designed for coal  $\geq 8,300$  Btu/lb” subcategory, the averaging time for emissions averaging for pollutants is 30 days (rolling daily) using data from CEMS or a combination of data from CEMS and manual performance (LEE) testing. The averaging time for emissions averaging for the alternate Hg limit (equal to or less than 1.0 lb/TBtu or 1.1E-2 lb/GWh) from EGUs in the “unit designed for coal  $\geq 8,300$  Btu/lb” subcategory is 90-boiler operating days (rolling daily) using data from CEMS, sorbent trap monitoring, or a combination of monitoring data and data from manual performance (LEE) testing. For the purposes of this paragraph, 30- (or 90-) group boiler operating days is defined as a period during which at least one unit in the emissions averaging group operates on each of the 30 or 90 days. You must calculate the weighted average emissions rate for the group in accordance with the procedures in this paragraph using the data from all units in the group including any that operate fewer than 30 (or 90) days during the preceding 30 (or 90) group boiler days.

(i) You may choose to have your EGU emissions averaging group meet either the heat input basis (MMBtu or TBtu, as appropriate for the pollutant) or gross output basis (MWh or GWh, as appropriate for the pollutant).

(ii) You may not mix bases within your EGU emissions averaging group.

(iii) You may use emissions averaging for affected units in different subcategories if the units vent to the atmosphere through a common stack (see paragraph (m) of this section).

(b) *Equations.* Use the following equations when performing calculations for your EGU emissions averaging group:

(1) *Group eligibility equations.*

$$WAER_m = \frac{[\sum_{j=1}^p Herm_j \times Rmm_j] + \sum_{k=1}^m Ter_k \times Rmt_k}{(\sum_{j=1}^p Rmm_j) + \sum_{k=1}^m Rmt_k} \quad (Eq. 1a)$$

[View or download PDF](#)

Where:

WAER<sub>m</sub> = Maximum Weighted Average Emission Rate in terms of lb/heat input or lb/gross output,

Herm<sub>j</sub> = hourly emission rate (e.g., lb/MMBtu, lb/MWh) from CEMS or sorbent trap monitoring as determined during the initial compliance determination from EGU j,

Rmm<sub>j</sub> = Maximum rated heat input, MMBtu/h, or maximum rated gross output, MWh/h, for EGU j,

p = number of EGUs in emissions averaging group that rely on CEMS,

Ter<sub>k</sub> = Emissions rate (lb/MMBTU or lb/MWh) as determined during the initial compliance determination of EGU k,

$Rmt_k$  = Maximum rated heat input, MMBtu/h, or maximum rated gross output, MWh/h, for EGU k, and

m = number of EGUs in emissions averaging group that rely on emissions testing.

$$WAER_m = \frac{\sum \left[ \left( \sum_{j=1}^p Herm_{i,j} \right) \times Smm_j \times Cfm_j \right] + \sum_{k=1}^m Ter_k \times Smt_k \times Cft_k}{\sum \left[ \sum_{j=1}^p Smm_j \times Cfm_j \right] + \sum_{k=1}^m Smt_k \times Cft_k} \quad (Eq. 1b)$$

[View or download PDF](#)

Where:

Variables with the similar names share the descriptions for Equation 1a of this section,

$Smm_j$  = maximum steam generation, lb<sub>steam</sub>/h or lb/gross output, for EGU j,

$Cfm_j$  = conversion factor, calculated from the most recent compliance test results, in terms units of heat output or gross output per pound of steam generated (MMBtu/lb<sub>steam</sub> or MWh/lb<sub>steam</sub>) from EGU j,

$Smt_k$  = maximum steam generation, lb<sub>steam</sub>/h or lb/gross output, for EGU k, and

$Cfm_k$  = conversion factor, calculated from the most recent compliance test results, in terms units of heat output or gross output per pound of steam generated (MMBtu/lb<sub>steam</sub> or MWh/lb<sub>steam</sub>) from EGU k.

(2) Weighted 30-boiler operating day rolling average emissions rate equations for pollutants other than Hg. Use Equation 2a or 2b of this section to calculate the 30 day rolling average emissions daily.

$$WAER = \frac{\sum_{i=1}^p \left[ \sum_{t=1}^n (Her_t \times Rm_t) \right]_p + \sum_{i=1}^m (Ter_i \times Rt_i)}{\sum_{i=1}^p \left[ \sum_{t=1}^n (Rm_t) \right]_p + \sum_{i=1}^m Rt_i} \quad (Eq. 2a)$$

[View or download PDF](#)

Where:

$Her_i$  = hourly emission rate (e.g., lb/MMBtu, lb/MWh) from unit i's CEMS for the preceding 30-group boiler operating days,

$Rm_i$  = hourly heat input or gross output from unit i for the preceding 30-group boiler operating days,

p = number of EGUs in emissions averaging group that rely on CEMS or sorbent trap monitoring,

n = number of hours that hourly rates are collected over 30-group boiler operating days,

$Ter_i$  = Emissions rate from most recent emissions test of unit i in terms of lb/heat input or lb/gross output,

$Rt_i$  = Total heat input or gross output of unit i for the preceding 30-boiler operating days, and

m = number of EGUs in emissions averaging group that rely on emissions testing.

$$WAER = \frac{\sum_{i=1}^p \left[ \sum_{t=1}^n (Her_t \times Sm_t \times Cfm_t) \right]_p + \sum_{i=1}^m (Ter_i \times St_i \times Cft_i)}{\sum_{i=1}^p \left[ \sum_{t=1}^n (Sm_t \times Cfm_t) \right]_p + \sum_{i=1}^m St_i \times Cft_i} \quad (Eq. 2b)$$

[View or download PDF](#)

Where:

variables with similar names share the descriptions for Equation 2a of this section,

$Sm_i$  = steam generation in units of pounds from unit i that uses CEMS for the preceding 30-group boiler operating days,

$Cfm_i$  = conversion factor, calculated from the most recent compliance test results, in units of heat input per pound of steam generated or gross output per pound of steam generated, from unit i that uses CEMS from the preceding 30 group boiler operating days,

$St_i$  = steam generation in units of pounds from unit i that uses emissions testing, and

$Cft_i$  = conversion factor, calculated from the most recent compliance test results, in units of heat input per pound of steam generated or gross output per pound of steam generated, from unit i that uses emissions testing.

(3) Weighted 90-boiler operating day rolling average emissions rate equations for Hg emissions from EGUs in the “coal-fired unit not low rank virgin coal” subcategory. Use Equation 3a or 3b of this section to calculate the 90-day rolling average emissions daily.

$$WAER = \frac{\sum_{i=1}^p [\sum_{j=1}^n (Her_j \times Rm_j)]_p + \sum_{i=1}^m (Cer_i \times Rt_i)}{\sum_{i=1}^p [\sum_{j=1}^n (Rm_j)]_p + \sum_{i=1}^m Rt_i} \quad (Eq. 3a)$$

[View or download PDF](#)

Where:

$Her_i$  = hourly emission rate from unit i's CEMS or Hg sorbent trap monitoring system for the preceding 90-group boiler operating days,

$Rm_i$  = hourly heat input or gross output from unit i for the preceding 90-group boiler operating days,

$p$  = number of EGUs in emissions averaging group that rely on CEMS,

$n$  = number of hours that hourly rates are collected over the 90-group boiler operating days,

$Ter_i$  = Emissions rate from most recent emissions test of unit i in terms of lb/heat input or lb/gross output,

$Rt_i$  = Total heat input or gross output of unit i for the preceding 90-boiler operating days, and

$m$  = number of EGUs in emissions averaging group that rely on emissions testing.

$$WAER = \frac{\sum_{i=1}^p [\sum_{j=1}^n (Her_j \times Sm_j \times Cfm_j)]_p + \sum_{i=1}^m (Cer_i \times St_i \times Cft_i)}{\sum_{i=1}^p [\sum_{j=1}^n (Sm_j \times Cfm_j)]_p + \sum_{i=1}^m St_i \times Cft_i} \quad (Eq. 3b)$$

[View or download PDF](#)

Where:

variables with similar names share the descriptions for Equation 2a of this section,

$Sm_i$  = steam generation in units of pounds from unit i that uses CEMS or a Hg sorbent trap monitoring for the preceding 90-group boiler operating days,

$Cfm_i$  = conversion factor, calculated from the most recent compliance test results, in units of heat input per pound of steam generated or gross output per pound of steam generated, from unit i that uses CEMS or sorbent trap monitoring from the preceding 90-group boiler operating days,

$St_i$  = steam generation in units of pounds from unit i that uses emissions testing, and

$Cft_i$  = conversion factor, calculated from the most recent emissions test results, in units of heat input per pound of steam generated or gross output per pound of steam generated, from unit i that uses emissions testing.

(c) *Separate stack requirements.* For a group of two or more existing EGUs in the same subcategory that each vent to a separate stack, you may average filterable PM, SO<sub>2</sub>, HF, HCl, non-Hg HAP metals, or Hg emissions to demonstrate compliance with the limits in Table 2 to this subpart if you satisfy the requirements in paragraphs (d) through (j) of this section.

(d) For each existing EGU in the averaging group:

(1) The emissions rate achieved during the initial performance test for the HAP being averaged must not exceed the emissions level that was being achieved 180 days after April 16, 2015, or the date on which emissions testing done to support your emissions averaging plan is complete (if the Administrator does not require submission and approval of your emissions averaging plan), or the date that you begin emissions averaging, whichever is earlier; or

(2) The control technology employed during the initial performance test must not be less than the design efficiency of the emissions control technology employed 180 days after April 16, 2015 or the date that you begin emissions averaging, whichever is earlier.

(e) The weighted-average emissions rate from the existing EGUs participating in the emissions averaging option must be in compliance with the limits in Table 2 to this subpart at all times following the date that you begin emissions averaging.

(f) Emissions averaging group eligibility demonstration. You must demonstrate the ability for the EGUs included in the emissions averaging group to demonstrate initial compliance according to paragraph (f)(1) or (2) of this section using the maximum rated heat input or gross output over a 30- (or 90-) boiler operating day period of each EGU and the results of the initial performance tests. For this demonstration and prior to preparing your emissions averaging plan, you must conduct required emissions monitoring for 30- (or 90-) days of boiler operation and any required manual performance testing to calculate maximum weighted average emissions rate in accordance with this section. If, before the start of your initial compliance demonstration, the Administrator becomes aware that you intend to use emissions averaging for that demonstration, or if your initial Notification of Compliance Status (NOCS) indicates that you intend to implement emissions averaging at a future date, the Administrator may require you to submit your proposed emissions averaging plan and supporting data for approval. If the Administrator requires approval of your plan, you may not begin using emissions averaging until the Administrator approves your plan.

(1) You must use Equation 1a in paragraph (b) of this section to demonstrate that the maximum weighted average emissions rates of filterable PM, HF, SO<sub>2</sub>, HCl, non-Hg HAP metals, or Hg emissions from the existing units participating in the emissions averaging option do not exceed the emissions limits in Table 2 to this subpart.

(2) If you are not capable of monitoring heat input or gross output, and the EGU generates steam for purposes other than generating electricity, you may use Equation 1b of paragraph (b) of this section as an alternative to using Equation 1a of paragraph (b) of this section to demonstrate that the maximum weighted average emissions rates of filterable PM, HF, SO<sub>2</sub>, HCl, non-Hg HAP metals, or Hg emissions from the existing units participating in the emissions averaging group do not exceed the emission limits in Table 2 to this subpart.

(g) You must determine the weighted average emissions rate in units of the applicable emissions limit on a 30 group boiler operating day rolling average basis (or, if applicable, on a 90 group boiler operating day rolling average basis for Hg) according to paragraphs (g)(1) and (2) of this section. The first averaging period ends on the 30th (or, if applicable, 90th for the alternate Hg emission limit) group boiler operating day after the date that you begin emissions averaging.

(1) You must use Equation 2a or 3a of paragraph (b) of this section to calculate the weighted average emissions rate using the actual heat input or gross output for each existing unit participating in the emissions averaging option.

(2) If you are not capable of monitoring heat input or gross output, you may use Equation 2b or 3b of paragraph (b) of this section as an alternative to using Equation 2a of paragraph (b) of this section to calculate the average weighted emission rate using the actual steam generation from the units participating in the emissions averaging option.

(h) *CEMS (or sorbent trap monitoring) use.* If an EGU in your emissions averaging group uses CEMS (or a sorbent trap monitor for Hg emissions) to demonstrate compliance, you must use those data to determine the 30 (or 90) group boiler operating day rolling average emissions rate.

(i) *Emissions testing.* If you use manual emissions testing to demonstrate compliance for one or more EGUs in your emissions averaging group, you must use the results from the most recent performance test to determine the 30 (or 90) day rolling average. You may use CEMS or sorbent trap data in combination with data from the most recent manual performance test in calculating the 30 (or 90) group boiler operating day rolling average emissions rate.

(j) *Emissions averaging plan.* You must develop an implementation plan for emissions averaging according to the following procedures and requirements in paragraphs (j)(1) and (2) of this section.

(1) You must include the information contained in paragraphs (j)(1)(i) through (v) of this section in your implementation plan for all the emissions units included in an emissions averaging:

(i) The identification of all existing EGUs in the emissions averaging group, including for each either the applicable HAP emission level or the control technology installed as of 180 days after February 16, 2015, or the date on which you complete the emissions measurements used to support your emissions averaging plan (if the Administrator does not require submission and approval of your emissions averaging plan), or the date that you begin emissions averaging, whichever is earlier; and the date on which you are requesting emissions averaging to commence;

(ii) The process weighting parameter (heat input, gross output, or steam generated) that will be monitored for each averaging group;

(iii) The specific control technology or pollution prevention measure to be used for each emission EGU in the averaging group and the date of its installation or application. If the pollution prevention measure reduces or eliminates emissions from multiple EGUs, you must identify each EGU;

(iv) The means of measurement (e.g., CEMS, sorbent trap monitoring, manual performance test) of filterable PM, SO<sub>2</sub>, HF, HCl, individual or total non-Hg HAP metals, or Hg emissions in accordance with the requirements in §63.10007 and to be used in the emissions averaging calculations; and

(v) A demonstration that emissions averaging can produce compliance with each of the applicable emission limit(s) in accordance with paragraph (b)(1) of this section.

(2) If, as described in paragraph (f) of this section, the Administrator requests you to submit the averaging plan for review and approval, you must receive approval before initiating emissions averaging.

(i) The Administrator shall use following criteria in reviewing and approving or disapproving the plan:

(A) Whether the content of the plan includes all of the information specified in paragraph (j)(1) of this section; and

(B) Whether the plan presents information sufficient to determine that compliance will be achieved and maintained.

(ii) The Administrator shall not approve an emissions averaging implementation plan containing any of the following provisions:

(A) Any averaging between emissions of different pollutants or between units located at different facilities; or

(B) The inclusion of any emissions unit other than an existing unit in the same subcategory.

(k) *Common stack requirements.* For a group of two or more existing affected units, each of which vents through a single common stack, you may average emissions to demonstrate compliance with the limits in Table 2 to this subpart if you satisfy the requirements in paragraph (l) or (m) of this section.

(l) For a group of two or more existing units in the same subcategory and which vent through a common emissions control system to a common stack that does not receive emissions from units in other subcategories or categories, you may treat such averaging group as a single existing unit for purposes of this subpart and comply with the requirements of this subpart as if the group were a single unit.

(m) For all other groups of units subject to paragraph (k) of this section, you may elect to conduct manual performance tests according to procedures specified in §63.10007 in the common stack. If emissions from affected units included in the emissions averaging and from other units not included in the emissions averaging (e.g., in a different subcategory) or other nonaffected units all vent to the common stack, you must shut down the units not included in the emissions averaging and the nonaffected units or vent their emissions to a different stack during the performance test. Alternatively, you may conduct a performance test of the combined emissions in the common stack with all units operating and show that the combined emissions meet the most stringent emissions limit. You may also use a CEMS or sorbent trap monitoring to apply this latter alternative to demonstrate that the combined emissions comply with the most stringent emissions limit on a continuous basis.

(n) *Combination requirements.* The common stack of a group of two or more existing EGUs in the same subcategory subject to paragraph (k) of this section may be treated as a single stack for purposes of paragraph (c) of this section and included in an emissions averaging group subject to paragraph (c) of this section.

### **§63.10010 What are my monitoring, installation, operation, and maintenance requirements?**

(a) Flue gases from the affected units under this subpart exhaust to the atmosphere through a variety of different configurations, including but not limited to individual stacks, a common stack configuration or a main stack plus a bypass stack. For the CEMS, PM CPMS, and sorbent trap monitoring systems used to provide data under this subpart, the continuous monitoring system installation requirements for these exhaust configurations are as follows:

(1) *Single unit-single stack configurations.* For an affected unit that exhausts to the atmosphere through a single, dedicated stack, you shall either install the required CEMS, PM CPMS, and sorbent trap monitoring systems in the stack or at a location in the ductwork downstream of all emissions control devices, where the pollutant and diluents concentrations are representative of the emissions that exit to the atmosphere.

(2) *Unit utilizing common stack with other affected unit(s).* When an affected unit utilizes a common stack with one or more other affected units, but no non-affected units, you shall either:

(i) Install the required CEMS, PM CPMS, and sorbent trap monitoring systems in the duct leading to the common stack from each unit; or

(ii) Install the required CEMS, PM CPMS, and sorbent trap monitoring systems in the common stack.

(3) *Unit(s) utilizing common stack with non-affected unit(s).* (i) When one or more affected units shares a common stack with one or more non-affected units, you shall either:

(A) Install the required CEMS, PM CPMS, and sorbent trap monitoring systems in the ducts leading to the common stack from each affected unit; or

(B) Install the required CEMS, PM CPMS, and sorbent trap monitoring systems described in this section in the common stack and attribute all of the emissions measured at the common stack to the affected unit(s).

(ii) If you choose the common stack monitoring option:

(A) For each hour in which valid data are obtained for all parameters, you must calculate the pollutant emission rate and

(B) You must assign the calculated pollutant emission rate to each unit that shares the common stack.

(4) *Unit with a main stack and a bypass stack that exhausts to the atmosphere independent of the main stack.* If the exhaust configuration of an affected unit consists of a main stack and a bypass stack, you shall install CEMS on both the main stack and the bypass stack. If it is not feasible to certify and quality-assure the data from a monitoring system on the bypass stack, you shall:

(i) Route the exhaust from the bypass through the main stack and its monitoring so that bypass emissions are measured; or

(ii) Install a CEMS only on the main stack and count hours that the bypass stack is in use as hours of deviation from the monitoring requirements.

(5) *Unit with a common control device with multiple stack or duct configuration.* If the flue gases from an affected unit, which is configured such that emissions are controlled with a common control device or series of control devices, are discharged to the atmosphere through more than one stack or are fed into a single stack through two or more ducts, you may:

(i) Install required CEMS, PM CPMS, and sorbent trap monitoring systems in each of the multiple stacks;

(ii) Install required CEMS, PM CPMS, and sorbent trap monitoring systems in each of the ducts that feed into the stack;

(iii) Install required CEMS, PM CPMS, and sorbent trap monitoring systems in one of the multiple stacks or ducts and monitor the flows and dilution rates in all multiple stacks or ducts in order to determine total exhaust gas flow rate and pollutant mass emissions rate in accordance with the applicable limit; or

(iv) In the case of multiple ducts feeding into a single stack, install CEMS, PM CPMS, and sorbent trap monitoring systems in the single stack as described in paragraph (a)(1) of this section.

(6) *Unit with multiple parallel control devices with multiple stacks.* If the flue gases from an affected unit, which is configured such that emissions are controlled with multiple parallel control devices or multiple series of control devices are discharged to the atmosphere through more than one stack, you shall install the required CEMS, PM CPMS, and sorbent trap monitoring systems described in each of the multiple stacks. You shall calculate hourly flow-weighted average pollutant emission rates for the unit as follows:

(i) Calculate the pollutant emission rate at each stack or duct for each hour in which valid data are obtained for all parameters;

(ii) Multiply each calculated hourly pollutant emission rate at each stack or duct by the corresponding hourly stack gas flow rate at that stack or duct;

(iii) Sum the products determined under paragraph (a)(6)(ii) of this section; and

(iv) Divide the result obtained in paragraph (a)(6)(iii) of this section by the total hourly stack gas flow rate for the unit, summed across all of the stacks or ducts.

(b) If you use an oxygen (O<sub>2</sub>) or carbon dioxide (CO<sub>2</sub>) CEMS to convert measured pollutant concentrations to the units of the applicable emissions limit, the O<sub>2</sub> or CO<sub>2</sub> concentrations shall be monitored at a location that represents emissions to the atmosphere, *i.e.*, at the outlet of the EGU, downstream of all emission control devices. You must install, certify, maintain, and operate the CEMS according to part 75 of this chapter. Use only quality-assured O<sub>2</sub> or CO<sub>2</sub> data in the emissions calculations; do not use part 75 substitute data values.

(c) If you are required to use a stack gas flow rate monitor, either for routine operation of a sorbent trap monitoring system or to convert pollutant concentrations to units of an electrical output-based emission standard in Table 1 or 2 to this subpart, you must install, certify, operate, and maintain the monitoring system and conduct on-going quality-assurance testing of the system



according to part 75 of this chapter. Use only unadjusted, quality-assured flow rate data in the emissions calculations. Do not apply bias adjustment factors to the flow rate data and do not use substitute flow rate data in the calculations.

(d) If you are required to make corrections for stack gas moisture content when converting pollutant concentrations to the units of an emission standard in Table 1 of 2 to this subpart, you must install, certify, operate, and maintain a moisture monitoring system in accordance with part 75 of this chapter. Alternatively, for coal-fired units, you may use appropriate fuel-specific default moisture values from §75.11(b) of this chapter to estimate the moisture content of the stack gas or you may petition the Administrator under §75.66 of this chapter for use of a default moisture value for non-coal-fired units. If you install and operate a moisture monitoring system, do not use substitute moisture data in the emissions calculations.

(e) If you use an HCl and/or HF CEMS, you must install, certify, operate, maintain, and quality-assure the data from the monitoring system in accordance with appendix B to this subpart. Calculate and record a 30-boiler operating day rolling average HCl or HF emission rate in the units of the standard, updated after each new boiler operating day. Each 30-boiler operating day rolling average emission rate is the average of all the valid hourly HCl or HF emission rates in the preceding 30 boiler operating days (see section 9.4 of appendix B to this subpart).

(f)(1) If you use an SO<sub>2</sub> CEMS, you must install the monitor at the outlet of the EGU, downstream of all emission control devices, and you must certify, operate, and maintain the CEMS according to part 75 of this chapter.

(2) For on-going QA, the SO<sub>2</sub> CEMS must meet the applicable daily, quarterly, and semiannual or annual requirements in sections 2.1 through 2.3 of appendix B to part 75 of this chapter, with the following addition: You must perform the linearity checks required in section 2.2 of appendix B to part 75 of this chapter if the SO<sub>2</sub> CEMS has a span value of 30 ppm or less.

(3) Calculate and record a 30-boiler operating day rolling average SO<sub>2</sub> emission rate in the units of the standard, updated after each new boiler operating day. Each 30-boiler operating day rolling average emission rate is the average of all of the valid hourly SO<sub>2</sub> emission rates in the 30 boiler operating day period.

(4) Use only unadjusted, quality-assured SO<sub>2</sub> concentration values in the emissions calculations; do not apply bias adjustment factors to the part 75 SO<sub>2</sub> data and do not use part 75 substitute data values. For startup or shutdown hours (as defined in §63.10042) the default gross output and the diluent cap are available for use in the hourly SO<sub>2</sub> emission rate calculations, as described in §63.10007(f). Use a flag to identify each startup or shutdown hour and report a special code if the diluent cap or default gross output is used to calculate the SO<sub>2</sub> emission rate for any of these hours.

(g) If you use a Hg CEMS or a sorbent trap monitoring system, you must install, certify, operate, maintain and quality-assure the data from the monitoring system in accordance with appendix A to this subpart. You must calculate and record a 30- (or, if alternate emissions averaging is used, 90-) boiler operating day rolling average Hg emission rate, in units of the standard, updated after each new boiler operating day. Each 30- (or, if alternate emissions averaging is used, 90-) boiler operating day rolling average emission rate, calculated according to section 6.2 of appendix A to the subpart, is the average of all of the valid hourly Hg emission rates in the preceding 30- (or, if alternate emissions averaging is used, a 90-) boiler operating days. Section 7.1.4.3 of appendix A to this subpart explains how to reduce sorbent trap monitoring system data to an hourly basis.

(h) If you use a PM CPMS to demonstrate continuous compliance with an operating limit, you must install, calibrate, maintain, and operate the PM CPMS and record the output of the system as specified in paragraphs (h)(1) through (5) of this section.

(1) Install, calibrate, operate, and maintain your PM CPMS according to the procedures in your approved site-specific monitoring plan developed in accordance with §63.10000(d), and meet the requirements in paragraphs (h)(1)(i) through (iii) of this section.

(i) The operating principle of the PM CPMS must be based on in-stack or extractive light scatter, light scintillation, beta attenuation, or mass accumulation detection of the exhaust gas or representative sample. The reportable measurement output from the PM CPMS may be expressed as milliamps, stack concentration, or other raw data signal.

(ii) The PM CPMS must have a cycle time (*i.e.*, period required to complete sampling, measurement, and reporting for each measurement) no longer than 60 minutes.

(iii) The PM CPMS must be capable, at a minimum, of detecting and responding to particulate matter concentrations of 0.5 mg/acm.

(2) For a new unit, complete the initial PM CPMS performance evaluation no later than October 13, 2012 or 180 days after the date of initial startup, whichever is later. For an existing unit, complete the initial performance evaluation no later than October 13, 2015.

(3) Collect PM CPMS hourly average output data for all boiler operating hours except as indicated in paragraph (h)(5) of this section. Express the PM CPMS output as milliamps, PM concentration, or other raw data signal value.

(4) Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average PM CPMS output collected during all nonexempt boiler operating hours data (e.g., milliamps, PM concentration, raw data signal).

(5) You must collect data using the PM CPMS at all times the process unit is operating and at the intervals specified in paragraph (h)(1)(ii) of this section, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, required monitoring system quality assurance or quality control activities (including, as applicable, calibration checks and required zero and span adjustments), and any scheduled maintenance as defined in your site-specific monitoring plan.

(6) You must use all the data collected during all boiler operating hours in assessing the compliance with your operating limit except:

(i) Any data collected during periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or quality control activities that temporarily interrupt the measurement of output data from the PM CPMS. You must report any monitoring system malfunctions or out of control periods in your annual deviation reports. You must report any monitoring system quality assurance or quality control activities per the requirements of §63.10031(b);

(ii) Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is

out of control, or required monitoring system quality assurance or quality control activities conducted during out-of-control periods. You must report any such periods in your annual deviation report;

(iii) Any data recorded during periods of startup or shutdown.

(7) You must record and make available upon request results of PM CPMS system performance audits, as well as the dates and duration of periods from when the PM CPMS is out of control until completion of the corrective actions necessary to return the PM CPMS to operation consistent with your site-specific monitoring plan.

(i) If you choose to comply with the PM filterable emissions limit in lieu of metal HAP limits, you may choose to install, certify, operate, and maintain a PM CEMS and record the output of the PM CEMS as specified in paragraphs (i)(1) through (5) of this section. The compliance limit will be expressed as a 30-boiler operating day rolling average of the numerical emissions limit value applicable for your unit in tables 1 or 2 to this subpart.

(1) Install and certify your PM CEMS according to the procedures and requirements in Performance Specification 11—Specifications and Test Procedures for Particulate Matter Continuous Emission Monitoring Systems at Stationary Sources in Appendix B to part 60 of this chapter, using Method 5 at Appendix A-3 to part 60 of this chapter and ensuring that the front half filter temperature shall be  $160^{\circ} \pm 14^{\circ} \text{C}$  ( $320^{\circ} \pm 25^{\circ} \text{F}$ ). The reportable measurement output from the PM CEMS must be expressed in units of the applicable emissions limit (e.g., lb/MMBtu, lb/MWh).

(2) Operate and maintain your PM CEMS according to the procedures and requirements in Procedure 2—Quality Assurance Requirements for Particulate Matter Continuous Emission Monitoring Systems at Stationary Sources in Appendix F to part 60 of this chapter.

(i) You must conduct the relative response audit (RRA) for your PM CEMS at least once annually.

(ii) You must conduct the relative correlation audit (RCA) for your PM CEMS at least once every 3 years.

(3) Collect PM CEMS hourly average output data for all boiler operating hours except as indicated in paragraph (i) of this section.

(4) Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average PM CEMS output data collected during all nonexempt boiler operating hours.

(5) You must collect data using the PM CEMS at all times the process unit is operating and at the intervals specified in paragraph (a) of this section, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, and required monitoring system quality assurance or quality control activities.

(i) You must use all the data collected during all boiler operating hours in assessing the compliance with your operating limit except:

(A) Any data collected during periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or quality control activities that temporarily interrupt the measurement of emissions (e.g., calibrations, certain audits). You must report any monitoring system malfunctions or out of control periods in your annual

deviation reports. You must report any monitoring system quality assurance or quality control activities per the requirements of §63.10031(b);

(B) Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is out of control, or required monitoring system quality assurance or quality control activities conducted during out-of-control periods. You must report any such periods in your annual deviation report;

(C) Any data recorded during periods of startup or shutdown.

(ii) You must record and make available upon request results of PM CEMS system performance audits, dates and duration of periods when the PM CEMS is out of control to completion of the corrective actions necessary to return the PM CEMS to operation consistent with your site-specific monitoring plan.

(j) You may choose to comply with the metal HAP emissions limits using CEMS approved in accordance with §63.7(f) as an alternative to the performance test method specified in this rule. If approved to use a HAP metals CEMS, the compliance limit will be expressed as a 30-boiler operating day rolling average of the numerical emissions limit value applicable for your unit in tables 1 or 2. If approved, you may choose to install, certify, operate, and maintain a HAP metals CEMS and record the output of the HAP metals CEMS as specified in paragraphs (j)(1) through (5) of this section.

(1)(i) Install, calibrate, operate, and maintain your HAP metals CEMS according to your CMS quality control program, as described in §63.8(d)(2). The reportable measurement output from the HAP metals CEMS must be expressed in units of the applicable emissions limit (e.g., lb/MMBtu, lb/MWh) and in the form of a 30-boiler operating day rolling average.

(ii) Operate and maintain your HAP metals CEMS according to the procedures and criteria in your site specific performance evaluation and quality control program plan required in §63.8(d).

(2) Collect HAP metals CEMS hourly average output data for all boiler operating hours except as indicated in section (j)(4) of this section.

(3) Calculate the arithmetic 30-boiler operating day rolling average of all of the hourly average HAP metals CEMS output data collected during all nonexempt boiler operating hours data.

(4) You must collect data using the HAP metals CEMS at all times the process unit is operating and at the intervals specified in paragraph (a) of this section, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, and required monitoring system quality assurance or quality control activities.

(i) You must use all the data collected during all boiler operating hours in assessing the compliance with your emission limit except:

(A) Any data collected during periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, or required monitoring system quality assurance or quality control activities that temporarily interrupt the measurement of emissions (e.g., calibrations, certain audits). You must report any monitoring system malfunctions or out of control periods in your annual deviation reports. You must report any monitoring system quality assurance or quality control activities per the requirements of §63.10031(b);

(B) Any data collected during periods when the monitoring system is out of control as specified in your site-specific monitoring plan, repairs associated with periods when the monitoring system is out of control, or required monitoring system quality assurance or quality control activities conducted during out-of-control periods. You must report any monitoring system malfunctions or out of control periods in your annual deviation reports. You must report any monitoring system quality assurance or quality control activities per the requirements of §63.10031(b);

(C) Any data recorded during periods of startup or shutdown.

(ii) You must record and make available upon request results of HAP metals CEMS system performance audits, dates and duration of periods when the HAP metals CEMS is out of control to completion of the corrective actions necessary to return the HAP metals CEMS to operation consistent with your site-specific performance evaluation and quality control program plan.

(k) If you demonstrate compliance with the HCl and HF emission limits for a liquid oil-fired EGU by conducting quarterly testing, you must also develop a site-specific monitoring plan as provided for in §63.10000(c)(2)(iii) and Table 7 to this subpart.

(l) Should you choose to rely on paragraph (2) of the definition of “startup” in §63.10042 for your EGU, you must install, verify, operate, maintain, and quality assure each monitoring system necessary for demonstrating compliance with the PM or non-mercury metals work practice standards required to comply with §63.10020(e).

(1) You shall develop a site-specific monitoring plan for PM or non-mercury metals work practice monitoring during startup periods.

(2) You shall submit the site-specific monitoring plan upon request by the Administrator.

(3) The provisions of the monitoring plan must address the following items:

(i) Monitoring system installation;

(ii) Performance and equipment specifications;

(iii) Schedule for initial and periodic performance evaluations;

(iv) Performance evaluation procedures and acceptance criteria;

(v) On-going operation and maintenance procedures; and

(vi) On-going recordkeeping and reporting procedures.

(4) You may rely on monitoring system specifications or instructions or manufacturer's specifications to address paragraphs (l)(3)(i) through (vi) of this section.

(5) You must operate and maintain the monitoring system according to the site-specific monitoring plan.

### **§63.10011 How do I demonstrate initial compliance with the emissions limits and work practice standards?**

(a) You must demonstrate initial compliance with each emissions limit that applies to you by conducting performance testing.

(b) If you are subject to an operating limit in Table 4 to this subpart, you demonstrate initial compliance with HAP metals or filterable PM emission limit(s) through performance stack tests and you elect to use a PM CPMS to demonstrate continuous performance, or if, for a liquid oil-fired EGU, and you use quarterly stack testing for HCl and HF plus site-specific parameter monitoring to demonstrate continuous performance, you must also establish a site-specific operating limit, in accordance with §63.10007 and Table 6 to this subpart. You may use only the parametric data recorded during successful performance tests (*i.e.*, tests that demonstrate compliance with the applicable emissions limits) to establish an operating limit.

(c)(1) If you use CEMS or sorbent trap monitoring systems to measure a HAP (*e.g.*, Hg or HCl) directly, the initial performance test, shall consist of a 30-boiler operating day (or, for certain coal-fired, existing EGUs that use emissions averaging for Hg, a 90-boiler operating day) rolling average emissions rate obtained with a certified CEMS or sorbent trap system, expressed in units of the standard. If the monitoring system is certified prior to the applicable compliance date, the initial averaging period shall either begin with: The first boiler operating day on or after the compliance date; or 30 (or, if applicable, 90) boiler operating days prior to that date, as described in §63.10005(b). In all cases, the initial 30- or 90-boiler operating day averaging period must be completed on or before the date that compliance must be demonstrated, in accordance with §63.9984(f). Initial compliance is demonstrated if the results of the performance test meet the applicable emission limit in Table 1 or 2 to this subpart.

(2) For an EGU that uses a CEMS to measure SO<sub>2</sub> or PM emissions for initial compliance, the initial performance test shall consist of a 30-boiler operating day average emission rate obtained with certified CEMS, expressed in units of the standard. If the monitoring system is certified prior to the applicable compliance date, the initial averaging period shall either begin with: The first boiler operating day on or after the compliance date; or 30 boiler operating days prior to that date, as described in §63.10005(b). In all cases, the initial 30- boiler operating day averaging period must be completed on or before the date that compliance must be demonstrated, in accordance with §63.9984(f). Initial compliance is demonstrated if the results of the performance test meet the applicable SO<sub>2</sub> or PM emission limit in Table 1 or 2 to this subpart.

(d) For candidate LEE units, use the results of the performance testing described in §63.10005(h) to determine initial compliance with the applicable emission limit(s) in Table 1 or 2 to this subpart and to determine whether the unit qualifies for LEE status.

(e) You must submit a Notification of Compliance Status containing the results of the initial compliance demonstration, in accordance with §63.10030(e).

(f)(1) You must determine the fuel whose combustion produces the least uncontrolled emissions, *i.e.*, the cleanest fuel, either natural gas or distillate oil, that is available on site or accessible nearby for use during periods of startup or shutdown.

(2) Your cleanest fuel, either natural gas or distillate oil, for use during periods of startup or shutdown determination may take safety considerations into account.

(g) You must follow the startup or shutdown requirements as established in Table 3 to this subpart for each coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGU.

(1) You may use the diluent cap and default gross output values, as described in §63.10007(f), during startup periods or shutdown periods.

(2) You must operate all CMS, collect data, calculate pollutant emission rates, and record data during startup periods or shutdown periods.

(3) You must report the information as required in §63.10031.

(4) If you choose to use paragraph (2) of the definition of “startup” in §63.10042 and you find that you are unable to safely engage and operate your particulate matter (PM) control(s) within 1 hour of first firing of coal, residual oil, or solid oil-derived fuel, you may choose to rely on paragraph (1) of definition of “startup” in §63.10042 or you may submit a request to use an alternative non-opacity emissions standard, as described below.

(i) As mentioned in §63.6(g)(1), your request will be published in the FEDERAL REGISTER for notice and comment rulemaking. Until promulgation in the FEDERAL REGISTER of the final alternative non-opacity emission standard, you shall comply with paragraph (1) of the definition of “startup” in §63.10042. You shall not implement the alternative non-opacity emissions standard until promulgation in the FEDERAL REGISTER of the final alternative non-opacity emission standard.

(ii) Your request need not address the items contained in §63.6(g)(2).

(iii) Your request shall provide evidence of a documented manufacturer-identified safety issue.

(iv) Your request shall provide information to document that the PM control device is adequately designed and sized to meet the PM emission limit applicable to the EGU.

(v) In addition, your request shall contain documentation that:

(A) Your EGU is using clean fuels to the maximum extent possible, taking into account considerations such as not compromising boiler or control device integrity, to bring your EGU and PM control device up to the temperature necessary to alleviate or prevent the identified safety issues prior to the combustion of primary fuel in your EGU;

(B) You have followed explicitly your EGU manufacturer's procedures to alleviate or prevent the identified safety issue; and

(C) You have identified with specificity the details of your EGU manufacturer's statement of concern.

(vi) Your request shall specify the other work practice standards you will take to limit HAP emissions during startup periods and shutdown periods to ensure a control level consistent with the work practice standards of the final rule.

(vii) You must comply with all other work practice requirements, including but not limited to data collection, recordkeeping, and reporting requirements.

[↑ Back to Top](#)

## CONTINUOUS COMPLIANCE REQUIREMENTS

[↑ Back to Top](#)

### **§63.10020 How do I monitor and collect data to demonstrate continuous compliance?**

(a) You must monitor and collect data according to this section and the site-specific monitoring plan required by §63.10000(d).

(b) You must operate the monitoring system and collect data at all required intervals at all times that the affected EGU is operating, except for periods of monitoring system malfunctions or out-of-control periods (see §63.8(c)(7) of this part), and required monitoring system quality assurance or quality control activities, including, as applicable, calibration checks and required zero and span adjustments. You are required to affect monitoring system repairs in response to monitoring system malfunctions and to return the monitoring system to operation as expeditiously as practicable.

(c) You may not use data recorded during EGU startup or shutdown in calculations used to report emissions, except as otherwise provided in §§63.10000(c)(1)(vi)(B) and 63.10005(a)(2)(iii). In addition, data recorded during monitoring system malfunctions or monitoring system out-of-control periods, repairs associated with monitoring system malfunctions or monitoring system out-of-control periods, or required monitoring system quality assurance or control activities may not be used in calculations used to report emissions or operating levels. You must use all of the quality-assured data collected during all other periods in assessing the operation of the control device and associated control system.

(d) Except for periods of monitoring system malfunctions or monitoring system out-of-control periods, repairs associated with monitoring system malfunctions or monitoring system out-of-control periods, and required monitoring system quality assurance or quality control activities including, as applicable, calibration checks and required zero and span adjustments), failure to collect required data is a deviation from the monitoring requirements.

(e) Additional requirements during startup periods or shutdown periods if you choose to rely on paragraph (2) of the definition of “startup” in §63.10042 for your EGU.

(1) During each period of startup, you must record for each EGU:

(i) The date and time that clean fuels being combusted for the purpose of startup begins;

(ii) The quantity and heat input of clean fuel for each hour of startup;

(iii) The gross output for each hour of startup;

(iv) The date and time that non-clean fuel combustion begins; and

(v) The date and time that clean fuels being combusted for the purpose of startup ends.



(2) During each period of shutdown, you must record for each EGU:

(i) The date and time that clean fuels being combusted for the purpose of shutdown begins;

(ii) The quantity and heat input of clean fuel for each hour of shutdown;

(iii) The gross output for each hour of shutdown;

(iv) The date and time that non-clean fuel combustion ends; and

(v) The date and time that clean fuels being combusted for the purpose of shutdown ends.

(3) For PM or non-mercury HAP metals work practice monitoring during startup periods, you must monitor and collect data according to this section and the site-specific monitoring plan required by §63.10010(l).

(i) Except for an EGU that uses PM CEMS or PM CPMS to demonstrate compliance with the PM emissions limit, or that has LEE status for filterable PM or total non-Hg HAP metals for non-liquid oil-fired EGUs (or HAP metals emissions for liquid oil-fired EGUs), or individual non-mercury metals CEMS, you must:

(A) Record temperature and combustion air flow or calculated flow as determined from combustion equations of post-combustion (exhaust) gas, as well as amperage of forced draft fan(s), upstream of the filterable PM control devices during each hour of startup.

(B) Record temperature and flow of exhaust gas, as well as amperage of any induced draft fan(s), downstream of the filterable PM control devices during each hour of startup.

(C) For an EGU with an electrostatic precipitator, record the number of fields in service, as well as each field's secondary voltage and secondary current during each hour of startup.

(D) For an EGU with a fabric filter, record the number of compartments in service, as well as the differential pressure across the baghouse during each hour of startup.

(E) For an EGU with a wet scrubber needed for filterable PM control, record the scrubber liquid to flue gas ratio and the pressure drop across the scrubber during each hour of startup.

(ii) [Reserved]

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23404, Apr. 19, 2012; 79 FR 68790, Nov. 19, 2014; 81 FR 20187, Apr. 6, 2016]

 [Back to Top](#)

### **§63.10021 How do I demonstrate continuous compliance with the emission limitations, operating limits, and work practice standards?**

(a) You must demonstrate continuous compliance with each emissions limit, operating limit, and work practice standard in Tables 1 through 4 to this subpart that applies to you, according to the monitoring specified in Tables 6 and 7 to this subpart and paragraphs (b) through (g) of this section.

(b) Except as otherwise provided in §63.10020(c), if you use a CEMS to measure SO<sub>2</sub>, PM, HCl, HF, or Hg emissions, or using a sorbent trap monitoring system to measure Hg emissions, you must demonstrate continuous compliance by using all quality-assured hourly data recorded by the CEMS (or sorbent trap monitoring system) and the other required monitoring systems (e.g., flow rate, CO<sub>2</sub>, O<sub>2</sub>, or moisture systems) to calculate the arithmetic average emissions rate in units of the standard on a continuous 30-boiler operating day (or, if alternate emissions averaging is used for Hg, 90-boiler operating day) rolling average basis, updated at the end of each new boiler operating day. Use Equation 8 to determine the 30- (or, if applicable, 90-) boiler operating day rolling average.

$$\text{Boiler operating day average} = \frac{\sum_{i=1}^n Her_i}{n} \text{ (Eq. 8)}$$

[View or download PDF](#)

Where:

Her<sub>i</sub> is the hourly emissions rate for hour i and n is the number of hourly emissions rate values collected over 30- (or, if applicable, 90-) boiler operating days.

(c) If you use a PM CPMS data to measure compliance with an operating limit in Table 4 to this subpart, you must record the PM CPMS output data for all periods when the process is operating and the PM CPMS is not out-of-control. You must demonstrate continuous compliance by using all quality-assured hourly average data collected by the PM CPMS for all operating hours to calculate the arithmetic average operating parameter in units of the operating limit (e.g., milliamps, PM concentration, raw data signal) on a 30 operating day rolling average basis, updated at the end of each new boiler operating day. Use Equation 9 to determine the 30 boiler operating day average.

$$30 \text{ boiler operating day average} = \frac{\sum_{i=1}^n Hpv_i}{n} \text{ (Eq. 9)}$$

[View or download PDF](#)

Where:

Hpv<sub>i</sub> is the hourly parameter value for hour i and n is the number of valid hourly parameter values collected over 30 boiler operating days.

(1) For any exceedance of the 30-boiler (1) operating day PM CPMS average value from the established operating parameter limit for an EGU subject to the emissions limits in Table 1 to this subpart, you must:

- (i) Within 48 hours of the exceedance, visually inspect the air pollution control device (APCD);
- (ii) If the inspection of the APCD identifies the cause of the exceedance, take corrective action as soon as possible, and return the PM CPMS measurement to within the established value; and
- (iii) Within 45 days of the exceedance or at the time of the annual compliance test, whichever comes first, conduct a PM emissions compliance test to determine compliance with the PM emissions limit and to verify or re-establish the CPMS operating limit. You are not required to conduct any additional testing for any exceedances that occur between the time of the original exceedance and the PM emissions compliance test required under this paragraph.

(2) PM CPMS exceedances of the operating limit for an EGU subject to the emissions limits in Table 1 of this subpart leading to more than four required performance tests in a 12-month period (rolling monthly) constitute a separate violation of this subpart.

(d) If you use quarterly performance testing to demonstrate compliance with one or more applicable emissions limits in Table 1 or 2 to this subpart, you

(1) May skip performance testing in those quarters during which less than 168 boiler operating hours occur, except that a performance test must be conducted at least once every calendar year.

(2) Must conduct the performance test as defined in Table 5 to this subpart and calculate the results of the testing in units of the applicable emissions standard; and

(3) Must conduct site-specific monitoring using CMS to demonstrate compliance with the site-specific monitoring requirements in Table 7 to this subpart pertaining to HCl and HF emissions from a liquid oil-fired EGU to ensure compliance with the HCl and HF emission limits in Tables 1 and 2 to this subpart, in accordance with the requirements of §63.10000(c)(2)(iii). The monitoring must meet the general operating requirements provided in §63.10020.

(e) Conduct periodic performance tune-ups of your EGU(s), as specified in paragraphs (e)(1) through (9) of this section. For your first tune-up, you may perform the burner inspection any time prior to the tune-up or you may delay the first burner inspection until the next scheduled EGU outage provided you meet the requirements of §63.10005. Subsequently, you must perform an inspection of the burner at least once every 36 calendar months unless your EGU employs neural network combustion optimization during normal operations in which case you must perform an inspection of the burner and combustion controls at least once every 48 calendar months. If your EGU is offline when a deadline to perform the tune-up passes, you shall perform the tune-up work practice requirements within 30 days after the re-start of the affected unit.

(1) As applicable, inspect the burner and combustion controls, and clean or replace any components of the burner or combustion controls as necessary upon initiation of the work practice program and at least once every required inspection period. Repair of a burner or combustion control component requiring special order parts may be scheduled as follows:

(i) Burner or combustion control component parts needing replacement that affect the ability to optimize NO<sub>x</sub> and CO must be installed within 3 calendar months after the burner inspection,

(ii) Burner or combustion control component parts that do not affect the ability to optimize NO<sub>x</sub> and CO may be installed on a schedule determined by the operator;

(2) As applicable, inspect the flame pattern and make any adjustments to the burner or combustion controls necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available, or in accordance with best combustion engineering practice for that burner type;

(3) As applicable, observe the damper operations as a function of mill and/or cyclone loadings, cyclone and pulverizer coal feeder loadings, or other pulverizer and coal mill performance parameters, making adjustments and effecting repair to dampers, controls, mills, pulverizers, cyclones, and sensors;

(4) As applicable, evaluate windbox pressures and air proportions, making adjustments and effecting repair to dampers, actuators, controls, and sensors;

(5) Inspect the system controlling the air-to-fuel ratio and ensure that it is correctly calibrated and functioning properly. Such inspection may include calibrating excess O<sub>2</sub> probes and/or sensors, adjusting overfire air systems, changing software parameters, and calibrating associated actuators and dampers to ensure that the systems are operated as designed. Any component out of calibration, in or near failure, or in a state that is likely to negate combustion optimization efforts prior to the next tune-up, should be corrected or repaired as necessary;

(6) Optimize combustion to minimize generation of CO and NO<sub>x</sub>. This optimization should be consistent with the manufacturer's specifications, if available, or best combustion engineering practice for the applicable burner type. NO<sub>x</sub> optimization includes burners, overfire air controls, concentric firing system improvements, neural network or combustion efficiency software, control systems calibrations, adjusting combustion zone temperature profiles, and add-on controls such as SCR and SNCR; CO optimization includes burners, overfire air controls, concentric firing system improvements, neural network or combustion efficiency software, control systems calibrations, and adjusting combustion zone temperature profiles;

(7) While operating at full load or the predominantly operated load, measure the concentration in the effluent stream of CO and NO<sub>x</sub> in ppm, by volume, and oxygen in volume percent, before and after the tune-up adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). You may use portable CO, NO<sub>x</sub> and O<sub>2</sub> monitors for this measurement. EGU's employing neural network optimization systems need only provide a single pre- and post-tune-up value rather than continual values before and after each optimization adjustment made by the system;

(8) Maintain on-site and submit, if requested by the Administrator, an annual report containing the information in paragraphs (e)(1) through (e)(9) of this section including:

(i) The concentrations of CO and NO<sub>x</sub> in the effluent stream in ppm by volume, and oxygen in volume percent, measured before and after an adjustment of the EGU combustion systems;

(ii) A description of any corrective actions taken as a part of the combustion adjustment; and

(iii) The type(s) and amount(s) of fuel used over the 12 calendar months prior to an adjustment, but only if the unit was physically and legally capable of using more than one type of fuel during that period; and

(9) Report the dates of the initial and subsequent tune-ups in hard copy, as specified in §63.10031(f)(5), through June 30, 2020. On or after July 1, 2020, report the date of all tune-ups electronically, in accordance with §63.10031(f). The tune-up report date is the date when tune-up requirements in paragraphs (e)(6) and (7) of this section are completed.

(f) You must submit the reports required under §63.10031 and, if applicable, the reports required under appendices A and B to this subpart. The electronic reports required by appendices A and B to this subpart must be sent to the Administrator electronically in a format prescribed by the Administrator, as provided in §63.10031. CEMS data (except for PM CEMS and any approved alternative monitoring using a HAP metals CEMS) shall be submitted using EPA's Emissions Collection and Monitoring Plan System (ECMPS) Client Tool. Other data, including PM CEMS data, HAP metals CEMS data, and CEMS performance test detail reports, shall be submitted in the file

format generated through use of EPA's Electronic Reporting Tool, the Compliance and Emissions Data Reporting Interface, or alternate electronic file format, all as provided for under §63.10031.

(g) You must report each instance in which you did not meet an applicable emissions limit or operating limit in Tables 1 through 4 to this subpart or failed to conduct a required tune-up. These instances are deviations from the requirements of this subpart. These deviations must be reported according to §63.10031.

(h) You must follow the startup or shutdown requirements as given in Table 3 to this subpart for each coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGU.

(1) You may use the diluent cap and default gross output values, as described in §63.10007(f), during startup periods or shutdown periods.

(2) You must operate all CMS, collect data, calculate pollutant emission rates, and record data during startup periods or shutdown periods.

(3) You must report the information as required in §63.10031.

(4) You may choose to submit an alternative non-opacity emission standard, in accordance with the requirements contained in §63.10011(g)(4). Until promulgation in the FEDERAL REGISTER of the final alternative non-opacity emission standard, you shall comply with paragraph (1) of the definition of "startup" in §63.10042.

(i) You must provide reports as specified in §63.10031 concerning activities and periods of startup and shutdown.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23404, Apr. 19, 2012; 78 FR 24086, Apr. 24, 2013; 79 FR 68791, Nov. 19, 2014; 81 FR 20187, Apr. 6, 2016; 82 FR 16739, Apr. 6, 2017; 83 FR 30883, July 2, 2018]

 [Back to Top](#)

### **§63.10022 How do I demonstrate continuous compliance under the emissions averaging provision?**

(a) Following the compliance date, the owner or operator must demonstrate compliance with this subpart on a continuous basis by meeting the requirements of paragraphs (a)(1) through (4) of this section.

(1) For each 30- (or 90-) day rolling average period, demonstrate compliance with the average weighted emissions limit for the existing units participating in the emissions averaging option as determined in §63.10009(f) and (g);

(2) For each existing unit participating in the emissions averaging option that is equipped with PM CPMS, maintain the average parameter value at or below the operating limit established during the most recent performance test;

(3) For each existing unit participating in the emissions averaging option venting to a common stack configuration containing affected units from other subcategories, maintain the appropriate operating limit for each unit as specified in Table 4 to this subpart that applies.

(4) For each existing EGU participating in the emissions averaging option, operate in accordance with the startup or shutdown work practice requirements given in Table 3 to this subpart.

(b) Any instance where the owner or operator fails to comply with the continuous monitoring requirements in paragraphs (a)(1) through (3) of this section is a deviation.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23404, Apr. 19, 2012; 79 FR 68791, Nov. 19, 2014]

 [Back to Top](#)

### **§63.10023 How do I establish my PM CPMS operating limit and determine compliance with it?**

(a) During the initial performance test or any such subsequent performance test that demonstrates compliance with the filterable PM, individual non-mercury HAP metals, or total non-mercury HAP metals limit (or for liquid oil-fired units, individual HAP metals or total HAP metals limit, including Hg) in Table 1 or 2, record all hourly average output values (e.g., milliamps, stack concentration, or other raw data signal) from the PM CPMS for the periods corresponding to the test runs (e.g., nine 1-hour average PM CPMS output values for three 3-hour test runs).

(b) Determine your operating limit as provided in paragraph (b)(1) or (b)(2) of this section. You must verify an existing or establish a new operating limit after each repeated performance test.

(1) [Reserved]

(2) Determine your operating limit as follows:

(i) If your PM performance test demonstrates your PM emissions do not exceed 75 percent of your emissions limit, you will use the average PM CPMS value recorded during the PM compliance test, the milliamp equivalent of zero output from your PM CPMS, and the average PM result of your compliance test to establish your operating limit. Calculate the operating limit by establishing a relationship of PM CPMS signal to PM concentration using the PM CPMS instrument zero, the average PM CPMS values corresponding to the three compliance test runs, and the average PM concentration from the Method 5 compliance test with the procedures in (b)(2)(i)(A) through (D) of this section.

(A) Determine your PM CPMS instrument zero output with one of the following procedures.

(1) Zero point data for in-situ instruments should be obtained by removing the instrument from the stack and monitoring ambient air on a test bench.

(2) Zero point data for extractive instruments should be obtained by removing the extractive probe from the stack and drawing in clean ambient air.

(3) The zero point can also be obtained by performing manual reference method measurements when the flue gas is free of PM emissions or contains very low PM concentrations (e.g., when your process is not operating, but the fans are operating or your source is combusting only natural gas) and plotting these with the compliance data to find the zero intercept.

(4) If none of the steps in paragraphs (A)(1) through (3) of this section are possible, you must use a zero output value provided by the manufacturer.

(B) Determine your PM CPMS instrument average ( $x$ ) in milliamps, and the average of your corresponding three PM compliance test runs ( $y$ ), using equation 10.

$$\bar{x} = \frac{1}{n} \sum_{i=1}^n X_i, \bar{y} = \frac{1}{n} \sum_{i=1}^n Y_i \quad (\text{Eq. 10})$$

[View or download PDF](#)

Where:

$X_i$  = the PM CPMS data points for run  $i$  of the performance test,

$Y_i$  = the PM emissions value (in lb/MWh) for run  $i$  of the performance test, and

$n$  = the number of data points.

(C) With your PM CPMS instrument zero expressed in milliamps, your three run average PM CPMS milliamp value, and your three run average PM emissions value (in lb/MWh) from your compliance runs, determine a relationship of PM lb/MWh per milliamp with equation 11.

$$R = \frac{y}{(x - z)} \quad (\text{Eq. 11})$$

[View or download PDF](#)

Where:

$R$  = the relative PM lb/MWh per milliamp for your PM CPMS,

$\bar{y}$  = the three run average PM lb/MWh,

$\bar{x}$  = the three run average milliamp output from your PM CPMS, and

$z$  = the milliamp equivalent of your instrument zero determined from (b)(2)(i)(A) of this section.

(D) Determine your source specific 30-day rolling average operating limit using the PM lb/MWh per milliamp value from equation 11 in equation 12, below. This sets your operating limit at the PM CPMS output value corresponding to 75 percent of your emission limit.

$$O_L = z + \frac{(0.75 \times L)}{R} \quad (\text{Eq. 12})$$

[View or download PDF](#)

Where:

$O_L$  = the operating limit for your PM CPMS on a 30-day rolling average, in milliamps,

$L$  = your source PM emissions limit in lb/MWh,

$z$  = your instrument zero in milliamps, determined from (b)(2)(i)(A) of this section, and

$R$  = the relative PM lb/MWh per milliamp for your PM CPMS, from equation 11.

(ii) If your PM compliance test demonstrates your PM emissions exceed 75 percent of your emissions limit, you will use the average PM CPMS value recorded during the PM compliance test demonstrating compliance with the PM limit to establish your operating limit.

(A) Determine your operating limit by averaging the PM CPMS milliamp output corresponding to your three PM performance test runs that demonstrate compliance with the emission limit using equation 13.

$$O_s = \frac{1}{n} \sum_{i=1}^n X_i \quad (\text{Eq. 13})$$

[View or download PDF](#)

Where:

$X_i$  = the PM CPMS data points for all runs  $i$ ,

$n$  = the number of data points, and

$O_s$  = your site specific operating limit, in milliamps.

(iii) Your PM CPMS must provide a 4-20 milliamp output and the establishment of its relationship to manual reference method measurements must be determined in units of milliamps.

(iv) Your PM CPMS operating range must be capable of reading PM concentrations from zero to a level equivalent to two times your allowable emission limit. If your PM CPMS is an auto-ranging instrument capable of multiple scales, the primary range of the instrument must be capable of reading PM concentration from zero to a level equivalent to two times your allowable emission limit.

(v) During the initial performance test or any such subsequent performance test that demonstrates compliance with the PM limit, record and average all milliamp output values from the PM CPMS for the periods corresponding to the compliance test runs.

(vi) For PM performance test reports used to set a PM CPMS operating limit, the electronic submission of the test report must also include the make and model of the PM CPMS instrument, serial number of the instrument, analytical principle of the instrument (e.g. beta attenuation), span of the instruments primary analytical range, milliamp value equivalent to the instrument zero output, technique by which this zero value was determined, and the average milliamp signal corresponding to each PM compliance test run.

(c) You must operate and maintain your process and control equipment such that the 30 operating day average PM CPMS output does not exceed the operating limit determined in paragraphs (a) and (b) of this section.

[77 FR 9464, Feb. 16, 2012, as amended at 78 FR 24086, Apr. 24, 2013; 81 FR 20187, Apr. 6, 2016]

[↑ Back to Top](#)

## NOTIFICATION, REPORTS, AND RECORDS

[↑ Back to Top](#)



### **§63.10030 What notifications must I submit and when?**

(a) You must submit all of the notifications in §§63.7(b) and (c), 63.8 (e), (f)(4) and (6), and 63.9 (b) through (h) that apply to you by the dates specified.

(b) As specified in §63.9(b)(2), if you startup your EGU that is an affected source before April 16, 2012, you must submit an Initial Notification not later than 120 days after April 16, 2012.

(c) As specified in §63.9(b)(4) and (b)(5), if you startup your new or reconstructed EGU that is an affected source on or after April 16, 2012, you must submit an Initial Notification not later than 15 days after the actual date of startup of the EGU that is an affected source.

(d) When you are required to conduct a performance test, you must submit a Notification of Intent to conduct a performance test at least 30 days before the performance test is scheduled to begin.

(e) When you are required to conduct an initial compliance demonstration as specified in §63.10011(a), you must submit a Notification of Compliance Status according to §63.9(h)(2)(ii). The Notification of Compliance Status report must contain all the information specified in paragraphs (e)(1) through (8) of this section, as applicable.

(1) A description of the affected source(s), including identification of the subcategory of the source, the design capacity of the source, a description of the add-on controls used on the source, description of the fuel(s) burned, including whether the fuel(s) were determined by you or EPA through a petition process to be a non-waste under 40 CFR 241.3, whether the fuel(s) were processed from discarded non-hazardous secondary materials within the meaning of 40 CFR 241.3, and justification for the selection of fuel(s) burned during the performance test.

(2) Summary of the results of all performance tests and fuel analyses and calculations conducted to demonstrate initial compliance including all established operating limits.

(3) Identification of whether you plan to demonstrate compliance with each applicable emission limit through performance testing; fuel moisture analyses; performance testing with operating limits (e.g., use of PM CPMS); CEMS; or a sorbent trap monitoring system.

(4) Identification of whether you plan to demonstrate compliance by emissions averaging.

(5) A signed certification that you have met all applicable emission limits and work practice standards.

(6) If you had a deviation from any emission limit, work practice standard, or operating limit, you must also submit a brief description of the deviation, the duration of the deviation, emissions point identification, and the cause of the deviation in the Notification of Compliance Status report.

(7) In addition to the information required in §63.9(h)(2), your notification of compliance status must include the following:

(i) A summary of the results of the annual performance tests and documentation of any operating limits that were reestablished during this test, if applicable. If you are conducting stack tests once every 3 years consistent with §63.10005(h)(1)(i), the date of each stack test conducted during the previous 3 years, a comparison of emission level you achieved in each stack test

conducted during the previous 3 years to the 50 percent emission limit threshold required in §63.10006(i), and a statement as to whether there have been any operational changes since the last stack test that could increase emissions.

(ii) Certifications of compliance, as applicable, and must be signed by a responsible official stating:

(A) "This EGU complies with the requirements in §63.10021(a) to demonstrate continuous compliance." and

(B) "No secondary materials that are solid waste were combusted in any affected unit."

(iii) For each of your existing EGUs, identification of each emissions limit as specified in Table 2 to this subpart with which you plan to comply.

(A) You may switch from a mass per heat input to a mass per gross output limit (or vice-versa), provided that:

(1) You submit a request that identifies for each EGU or EGU emissions averaging group involved in the proposed switch both the current and proposed emission limit;

(2) Your request arrives to the Administrator at least 30 calendar days prior to the date that the switch is proposed to occur;

(3) Your request demonstrates through performance stack test results completed within 30 days prior to your submission, compliance for each EGU or EGU emissions averaging group with both the mass per heat input and mass per gross output limits;

(4) You revise and submit all other applicable plans, *e.g.*, monitoring and emissions averaging, with your request; and

(5) You maintain records of all information regarding your choice of emission limits.

(B) You begin to use the revised emission limits starting in the next reporting period, after receipt of written acknowledgement from the Administrator of the switch.

(C) From submission of your request until start of the next reporting period after receipt of written acknowledgement from the Administrator of the switch, you demonstrate compliance with both the mass per heat input and mass per gross output emission limits for each pollutant for each EGU or EGU emissions averaging group.

(8) Identification of whether you plan to rely on paragraph (1) or (2) of the definition of "startup" in §63.10042.

(i) Should you choose to rely on paragraph (2) of the definition of "startup" in §63.10042 for your EGU, you shall include a report that identifies:

(A) The original EGU installation date;

(B) The original EGU design characteristics, including, but not limited to, fuel mix and PM controls;

(C) Each design PM control device efficiency established during performance testing or while operating in periods other than startup and shutdown periods;

(D) The design PM emission rate from the EGU in terms of pounds PM per MMBtu and pounds PM per hour established during performance testing or while operating in periods other than startup and shutdown periods;

(E) The design time from start of fuel combustion to necessary conditions for each PM control device startup;

(F) Each design PM control device efficiency upon startup of the PM control device, if different from the efficiency provided in paragraph (e)(8)(i)(C) of this section;

(G) Current EGU PM producing characteristics, including, but not limited to, fuel mix and PM controls, if different from the characteristics provided in paragraph (e)(8)(i)(B) of this section;

(H) Current PM control device efficiency from each PM control device, if different from the efficiency provided in paragraph (e)(8)(i)(C) of this section;

(I) Current PM emission rate from the EGU in terms of pounds PM per MMBtu and pounds per hour, if different from the rate provided in paragraph (e)(8)(i)(D) of this section;

(J) Current time from start of fuel combustion to conditions necessary for each PM control device startup, if different from the time provided in paragraph (e)(8)(i)(E) of this section; and

(K) Current PM control device efficiency upon startup of each PM control device, if different from the efficiency provided in paragraph (e)(8)(i)(H) of this section.

(ii) The report shall be prepared, signed, and sealed by a professional engineer licensed in the state where your EGU is located.

(iii) You may switch from paragraph (1) of the definition of "startup" in §63.10042 to paragraph (2) of the definition of "startup" (or vice-versa), provided that:

(A) You submit a request that identifies for each EGU or EGU emissions averaging group involved in the proposed switch both the current definition of "startup" relied on and the proposed definition you plan to rely on;

(B) Your request arrives to the Administrator at least 30 calendar days prior to the date that the switch is proposed to occur;

(C) You revise and submit all other applicable plans, e.g., monitoring and emissions averaging, with your submission;

(D) You maintain records of all information regarding your choice of the definition of "startup"; and

(E) You begin to use the revised definition of "startup" in the next reporting period after receipt of written acknowledgement from the Administrator of the switch.

(f) You must submit the notifications in §63.10000(h)(2) and (i)(2) that may apply to you by the dates specified.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23404, Apr. 19, 2012; 78 FR 24087, Apr. 24, 2013; 79 FR 68791, Nov. 19, 2014; 81 FR 20187, Apr. 6, 2016]

 [Back to Top](#)

### **§63.10031 What reports must I submit and when?**

(a) You must submit each report in Table 8 to this subpart that applies to you. If you are required to (or elect to) continuously monitor Hg and/or HCl and/or HF emissions, you must also submit the electronic reports required under appendix A and/or appendix B to the subpart, at the specified frequency.

(b) Unless the Administrator has approved a different schedule for submission of reports under §63.10(a), you must submit each report by the date in Table 8 to this subpart and according to the requirements in paragraphs (b)(1) through (5) of this section.

(1) The first compliance report must cover the period beginning on the compliance date that is specified for your affected source in §63.9984 and ending on June 30 or December 31, whichever date is the first date that occurs at least 180 days after the compliance date that is specified for your source in §63.9984.

(2) The first compliance report must be postmarked or submitted electronically no later than July 31 or January 31, whichever date is the first date following the end of the first calendar half after the compliance date that is specified for your source in §63.9984.

(3) Each subsequent compliance report must cover the semiannual reporting period from January 1 through June 30 or the semiannual reporting period from July 1 through December 31.

(4) Each subsequent compliance report must be postmarked or submitted electronically no later than July 31 or January 31, whichever date is the first date following the end of the semiannual reporting period.

(5) For each affected source that is subject to permitting regulations pursuant to part 70 or part 71 of this chapter, and if the permitting authority has established dates for submitting semiannual reports pursuant to 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A), you may submit the first and subsequent compliance reports according to the dates the permitting authority has established instead of according to the dates in paragraphs (b)(1) through (4) of this section.

(c) The compliance report must contain the information required in paragraphs (c)(1) through (9) of this section.

(1) The information required by the summary report located in 63.10(e)(3)(vi).

(2) The total fuel use by each affected source subject to an emission limit, for each calendar month within the semiannual reporting period, including, but not limited to, a description of the fuel, whether the fuel has received a non-waste determination by EPA or your basis for concluding that the fuel is not a waste, and the total fuel usage amount with units of measure.

(3) Indicate whether you burned new types of fuel during the reporting period. If you did burn new types of fuel you must include the date of the performance test where that fuel was in use.

(4) Include the date of the most recent tune-up for each EGU. The date of the tune-up is the date the tune-up provisions specified in §63.10021(e)(6) and (7) were completed.

(5) Should you choose to rely on paragraph (2) of the definition of “startup” in §63.10042 for your EGU, for each instance of startup or shutdown you shall:

(i) Include the maximum clean fuel storage capacity and the maximum hourly heat input that can be provided for each clean fuel determined according to the requirements of §63.10032(f).

(ii) Include the information required to be monitored, collected, or recorded according to the requirements of §63.10020(e).

(iii) If you choose to use CEMS to demonstrate compliance with numerical limits, include hourly average CEMS values and hourly average flow values during startup periods or shutdown periods. Use units of milligrams per cubic meter for PM CEMS values, micrograms per cubic meter for Hg CEMS values, and ppmv for HCl, HF, or SO<sub>2</sub> CEMS values. Use units of standard cubic meters per hour on a wet basis for flow values.

(iv) If you choose to use a separate sorbent trap measurement system for startup or shutdown reporting periods, include hourly average mercury concentration values in terms of micrograms per cubic meter.

(v) If you choose to use a PM CPMS, include hourly average operating parameter values in terms of the operating limit, as well as the operating parameter to PM correlation equation.

(6) You must report emergency bypass information annually from EGUs with LEE status.

(7) A summary of the results of the annual performance tests and documentation of any operating limits that were reestablished during the test, if applicable. If you are conducting stack tests once every 3 years to maintain LEE status, consistent with §63.10006(b), the date of each stack test conducted during the previous 3 years, a comparison of emission level you achieved in each stack test conducted during the previous 3 years to the 50 percent emission limit threshold required in §63.10005(h)(1)(i), and a statement as to whether there have been any operational changes since the last stack test that could increase emissions.

(8) A certification.

(9) If you have a deviation from any emission limit, work practice standard, or operating limit, you must also submit a brief description of the deviation, the duration of the deviation, emissions point identification, and the cause of the deviation.

(d) For each excess emissions occurring at an affected source where you are using a CMS to comply with that emission limit or operating limit, you must include the information required in §63.10(e)(3)(v) in the compliance report specified in section (c).

(e) Each affected source that has obtained a Title V operating permit pursuant to part 70 or part 71 of this chapter must report all deviations as defined in this subpart in the semiannual monitoring report required by 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A). If an affected source submits

a compliance report pursuant to Table 8 to this subpart along with, or as part of, the semiannual monitoring report required by 40 CFR 70.6(a)(3)(iii)(A) or 40 CFR 71.6(a)(3)(iii)(A), and the compliance report includes all required information concerning deviations from any emission limit, operating limit, or work practice requirement in this subpart, submission of the compliance report satisfies any obligation to report the same deviations in the semiannual monitoring report. Submission of a compliance report does not otherwise affect any obligation the affected source may have to report deviations from permit requirements to the permit authority.

(f) On or after July 1, 2020, within 60 days after the date of completing each performance test, you must submit the performance test reports required by this subpart to the EPA's WebFIRE database by using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov>). Performance test data must be submitted in the file format generated through use of EPA's Electronic Reporting Tool (ERT) (see <https://www.epa.gov/ttn/chief/ert/index.html>). Only data collected using those test methods on the ERT website are subject to this requirement for submitting reports electronically to WebFIRE. Owners or operators who claim that some of the information being submitted for performance tests is confidential business information (CBI) must submit a complete ERT file including information claimed to be CBI on a compact disk or other commonly used electronic storage media (including, but not limited to, flash drives) to EPA. The electronic media must be clearly marked as CBI and mailed to U.S. EPA/OAPQS/CORE CBI Office, Attention: WebFIRE Administrator, MD C404-02, 4930 Old Page Rd., Durham, NC 27703. The same ERT file with the CBI omitted must be submitted to EPA via CDX as described earlier in this paragraph. At the discretion of the delegated authority, you must also submit these reports, including the confidential business information, to the delegated authority in the format specified by the delegated authority.

(1) On or after July 1, 2020, within 60 days after the date of completing each CEMS (SO<sub>2</sub>, PM, HCl, HF, and Hg) performance evaluation test, as defined in §63.2 and required by this subpart, you must submit the relative accuracy test audit (RATA) data (or, for PM CEMS, RCA and RRA data) required by this subpart to EPA's WebFIRE database by using CEDRI that is accessed through EPA's CDX (<https://cdx.epa.gov>). The RATA data shall be submitted in the file format generated through use of EPA's Electronic Reporting Tool (ERT) (<https://www.epa.gov/ttn/chief/ert/index.html>). Only RATA data compounds listed on the ERT website are subject to this requirement. Owners or operators who claim that some of the information being submitted for RATAs is confidential business information (CBI) shall submit a complete ERT file including information claimed to be CBI on a compact disk or other commonly used electronic storage media (including, but not limited to, flash drives) by registered letter to EPA and the same ERT file with the CBI omitted to EPA via CDX as described earlier in this paragraph. The compact disk or other commonly used electronic storage media shall be clearly marked as CBI and mailed to U.S. EPA/OAPQS/CORE CBI Office, Attention: WebFIRE Administrator, MD C404-02, 4930 Old Page Rd., Durham, NC 27703. At the discretion of the delegated authority, owners or operators shall also submit these RATAs to the delegated authority in the format specified by the delegated authority. Owners or operators shall submit calibration error testing, drift checks, and other information required in the performance evaluation as described in §63.2 and as required in this chapter.

(2) On or after July 1, 2020, for a PM CEMS, PM CPMS, or approved alternative monitoring using a HAP metals CEMS, within 60 days after the reporting periods ending on March 31st, June 30th, September 30th, and December 31st, you must submit quarterly reports to the EPA's WebFIRE database by using the CEDRI that is accessed through the EPA's CDX (<https://cdx.epa.gov>). You must use the appropriate electronic reporting form in CEDRI or provide an alternate electronic file consistent with EPA's reporting form output format. For each reporting period, the quarterly reports must include all of the calculated 30-boiler operating day rolling average values derived from the CEMS and PM CPMS.

(3) Reports for an SO<sub>2</sub> CEMS, a Hg CEMS or sorbent trap monitoring system, an HCl or HF CEMS, and any supporting monitors for such systems (such as a diluent or moisture monitor) shall be submitted using the ECMPS Client Tool, as provided for in Appendices A and B to this subpart and §63.10021(f).

(4) On or after July 1, 2020, submit the compliance reports required under paragraphs (c) and (d) of this section and the notification of compliance status required under §63.10030(e) to the EPA's WebFIRE database by using the CEDRI that is accessed through the EPA's CDX (<https://cdx.epa.gov>). You must use the appropriate electronic reporting form in CEDRI or provide an alternate electronic file consistent with EPA's reporting form output format.

(5) All reports required by this subpart not subject to the requirements in paragraphs (f) introductory text and (f)(1) through (4) of this section must be sent to the Administrator at the appropriate address listed in §63.13. If acceptable to both the Administrator and the owner or operator of an EGU, these reports may be submitted on electronic media. The Administrator retains the right to require submittal of reports subject to paragraphs (f) introductory text and (f)(1) through (4) of this section in paper format.

(6) Prior to July 1, 2020, all reports subject to electronic submittal in paragraphs (f) introductory text, (f)(1), (2), and (4) of this section shall be submitted to the EPA at the frequency specified in those paragraphs in electronic portable document format (PDF) using the ECMPS Client Tool. Each PDF version of a submitted report must include sufficient information to assess compliance and to demonstrate that the testing was done properly. The following data elements must be entered into the ECMPS Client Tool at the time of submission of each PDF file:

(i) The facility name, physical address, mailing address (if different from the physical address), and county;

(ii) The ORIS code (or equivalent ID number assigned by EPA's Clean Air Markets Division (CAMD)) and the Facility Registry System (FRS) ID;

(iii) The EGU (or EGUs) to which the report applies. Report the EGU IDs as they appear in the CAMD Business System;

(iv) If any of the EGUs in paragraph (f)(6)(iii) of this section share a common stack, indicate which EGUs share the stack. If emissions data are monitored and reported at the common stack according to part 75 of this chapter, report the ID number of the common stack as it is represented in the electronic monitoring plan required under §75.53 of this chapter;

(v) If any of the EGUs described in paragraph (f)(6)(iii) of this section are in an averaging plan under §63.10009, indicate which EGUs are in the plan and whether it is a 30- or 90-day averaging plan;

(vi) The identification of each emission point to which the report applies. An "emission point" is a point at which source effluent is released to the atmosphere, and is either a dedicated stack that serves one of the EGUs identified in paragraph (f)(6)(iii) of this section or a common stack that serves two or more of those EGUs. To identify an emission point, associate it with the EGU or stack ID in the CAMD Business system or the electronic monitoring plan (e.g., "Unit 2 stack," "common stack CS001," or "multiple stack MS001");

(vii) The rule citation (e.g., §63.10031(f)(1), §63.10031(f)(2), etc.) for which the report is showing compliance;

- (viii) The pollutant(s) being addressed in the report;
- (ix) The reporting period being covered by the report (if applicable);
- (x) The relevant test method that was performed for a performance test (if applicable);
- (xi) The date the performance test was conducted (if applicable); and
- (xii) The responsible official's name, title, and phone number.

(g) If you had a malfunction during the reporting period, the compliance report must include the number, duration, and a brief description for each type of malfunction which occurred during the reporting period and which caused or may have caused any applicable emission limitation to be exceeded.

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23404, Apr. 19, 2012; 79 FR 68791, Nov. 19, 2014; 79 FR 68799, Nov. 19, 2014; 80 FR 15514, Mar. 24, 2015; 81 FR 20188, Apr. 6, 2016; 82 FR 16739, Apr. 6, 2017; 83 FR 30883, July 2, 2018]

 [Back to Top](#)

### **§63.10032 What records must I keep?**

(a) You must keep records according to paragraphs (a)(1) and (2) of this section. If you are required to (or elect to) continuously monitor Hg and/or HCl and/or HF emissions, you must also keep the records required under appendix A and/or appendix B to this subpart.

(1) A copy of each notification and report that you submitted to comply with this subpart, including all documentation supporting any Initial Notification or Notification of Compliance Status or semiannual compliance report that you submitted, according to the requirements in §63.10(b)(2)(xiv).

(2) Records of performance stack tests, fuel analyses, or other compliance demonstrations and performance evaluations, as required in §63.10(b)(2)(viii).

(b) For each CEMS and CPMS, you must keep records according to paragraphs (b)(1) through (4) of this section.

(1) Records described in §63.10(b)(2)(vi) through (xi).

(2) Previous (*i.e.*, superseded) versions of the performance evaluation plan as required in §63.8(d)(3).

(3) Request for alternatives to relative accuracy test for CEMS as required in §63.8(f)(6)(i).

(4) Records of the date and time that each deviation started and stopped, and whether the deviation occurred during a period of startup, shutdown, or malfunction or during another period.

(c) You must keep the records required in Table 7 to this subpart including records of all monitoring data and calculated averages for applicable PM CPMS operating limits to show continuous compliance with each emission limit and operating limit that applies to you.



(d) For each EGU subject to an emission limit, you must also keep the records in paragraphs (d)(1) through (3) of this section.

(1) You must keep records of monthly fuel use by each EGU, including the type(s) of fuel and amount(s) used.

(2) If you combust non-hazardous secondary materials that have been determined not to be solid waste pursuant to 40 CFR 241.3(b)(1), you must keep a record which documents how the secondary material meets each of the legitimacy criteria. If you combust a fuel that has been processed from a discarded non-hazardous secondary material pursuant to 40 CFR 241.3(b)(2), you must keep records as to how the operations that produced the fuel satisfies the definition of processing in 40 CFR 241.2. If the fuel received a non-waste determination pursuant to the petition process submitted under 40 CFR 241.3(c), you must keep a record which documents how the fuel satisfies the requirements of the petition process.

(3) For an EGU that qualifies as an LEE under §63.10005(h), you must keep annual records that document that your emissions in the previous stack test(s) continue to qualify the unit for LEE status for an applicable pollutant, and document that there was no change in source operations including fuel composition and operation of air pollution control equipment that would cause emissions of the pollutant to increase within the past year.

(e) If you elect to average emissions consistent with §63.10009, you must additionally keep a copy of the emissions averaging implementation plan required in §63.10009(g), all calculations required under §63.10009, including daily records of heat input or steam generation, as applicable, and monitoring records consistent with §63.10022.

(f) Regarding startup periods or shutdown periods:

(1) Should you choose to rely on paragraph (1) of the definition of “startup” in §63.10042 for your EGU, you must keep records of the occurrence and duration of each startup or shutdown.

(2) Should you choose to rely on paragraph (2) of the definition of “startup” in §63.10042 for your EGU, you must keep records of:

(i) The determination of the maximum possible clean fuel capacity for each EGU;

(ii) The determination of the maximum possible hourly clean fuel heat input and of the hourly clean fuel heat input for each EGU; and

(iii) The information required in §63.10020(e).

(g) You must keep records of the occurrence and duration of each malfunction of an operation (*i.e.*, process equipment) or the air pollution control and monitoring equipment.

(h) You must keep records of actions taken during periods of malfunction to minimize emissions in accordance with §63.10000(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation.

(i) You must keep records of the type(s) and amount(s) of fuel used during each startup or shutdown.

(j) If you elect to establish that an EGU qualifies as a limited-use liquid oil-fired EGU, you must keep records of the type(s) and amount(s) of fuel use in each calendar quarter to document that the capacity factor limitation for that subcategory is met.

[77 FR 9464, Feb. 16, 2012, as amended at 79 FR 68792, Nov. 19, 2014; 81 FR 20189, Apr. 6, 2016]

[↑ Back to Top](#)

### **§63.10033 In what form and how long must I keep my records?**

(a) Your records must be in a form suitable and readily available for expeditious review, according to §63.10(b)(1).

(b) As specified in §63.10(b)(1), you must keep each record for 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record.

(c) You must keep each record on site for at least 2 years after the date of each occurrence, measurement, maintenance, corrective action, report, or record, according to §63.10(b)(1). You can keep the records off site for the remaining 3 years.

[↑ Back to Top](#)

## **OTHER REQUIREMENTS AND INFORMATION**

[↑ Back to Top](#)

### **§63.10040 What parts of the General Provisions apply to me?**

Table 9 to this subpart shows which parts of the General Provisions in §§63.1 through 63.15 apply to you.

[↑ Back to Top](#)

### **§63.10041 Who implements and enforces this subpart?**

(a) This subpart can be implemented and enforced by U.S. EPA, or a delegated authority such as your state, local, or tribal agency. If the EPA Administrator has delegated authority to your state, local, or tribal agency, then that agency (as well as the U.S. EPA) has the authority to implement and enforce this subpart. You should contact your EPA Regional Office to find out if this subpart is delegated to your state, local, or tribal agency.

(b) In delegating implementation and enforcement authority of this subpart to a state, local, or tribal agency under 40 CFR part 63, subpart E, the authorities listed in paragraphs (b)(1) through (4) of this section are retained by the EPA Administrator and are not transferred to the state, local, or tribal agency; moreover, the U.S. EPA retains oversight of this subpart and can take enforcement actions, as appropriate, with respect to any failure by any person to comply with any provision of this subpart.

(1) Approval of alternatives to the non-opacity emission limits and work practice standards in §63.9991(a) and (b) under §63.6(g).

(2) Approval of major change to test methods in Table 5 to this subpart under §63.7(e)(2)(ii) and (f) and as defined in §63.90, approval of minor and intermediate changes to monitoring performance specifications/procedures in Table 5 where the monitoring serves as the performance test method (see definition of “test method” in §63.2.

(3) Approval of major changes to monitoring under §63.8(f) and as defined in §63.90.

(4) Approval of major change to recordkeeping and reporting under §63.10(e) and as defined in §63.90.

[↑ Back to Top](#)

### **§63.10042 What definitions apply to this subpart?**

Terms used in this subpart are defined in the Clean Air Act (CAA), in §63.2 (the General Provisions), and in this section as follows:

*Affirmative defense* means, in the context of an enforcement proceeding, a response or defense put forward by a defendant, regarding which the defendant has the burden of proof, and the merits of which are independently and objectively evaluated in a judicial or administrative proceeding.

*Anthracite coal* means solid fossil fuel classified as anthracite coal by American Society of Testing and Materials (ASTM) Method D388-05, “Standard Classification of Coals by Rank” (incorporated by reference, see §63.14).

*Bituminous coal* means coal that is classified as bituminous according to ASTM Method D388-05, “Standard Classification of Coals by Rank” (incorporated by reference, see §63.14).

*Boiler operating day* means a 24-hour period that begins at midnight and ends the following midnight during which any fuel is combusted at any time in the EGU, excluding startup periods or shutdown periods. It is not necessary for the fuel to be combusted the entire 24-hour period.

*Capacity factor* for a liquid oil-fired EGU means the total annual heat input from oil divided by the product of maximum hourly heat input for the EGU, regardless of fuel, multiplied by 8,760 hours.

*Clean fuel* means natural gas, synthetic natural gas that meets the specification necessary for that gas to be transported on a Federal Energy Regulatory Commission (FERC) regulated pipeline, propane, distillate oil, synthesis gas that has been processed through a gas clean-up train such that it could be used in a system's combustion turbine, or ultra-low-sulfur diesel (ULSD) oil, including those fuels meeting the requirements of 40 CFR part 80, subpart I (“Subpart I—Motor Vehicle Diesel Fuel; Nonroad, Locomotive, and Marine Diesel Fuel; and ECA Marine Fuel”).

*Coal* means all solid fuels classifiable as anthracite, bituminous, sub-bituminous, or lignite by ASTM Method D388-05, “Standard Classification of Coals by Rank” (incorporated by reference, see §63.14), and coal refuse. Synthetic fuels derived from coal for the purpose of creating useful heat including but not limited to, coal derived gases (not meeting the definition of natural gas), solvent-refined coal, coal-oil mixtures, and coal-water mixtures, are considered “coal” for the purposes of this subpart.

*Coal-fired electric utility steam generating unit* means an electric utility steam generating unit meeting the definition of “fossil fuel-fired” that burns coal for more than 10.0 percent of the average annual heat input during the 3 previous calendar years after the compliance date for your facility in §63.9984 or for more than 15.0 percent of the annual heat input during any one of those calendar years. EGU owners and operators must estimate coal, oil, and natural gas usage for the first 3 calendar years after the applicable compliance date and they are solely responsible for assuring compliance with this final rule or other applicable standard based on their fuel usage projections. After the first 3 years of compliance, EGUs are required to evaluate applicability based on coal or oil usage from the three previous calendar years on an annual rolling basis.

*Coal refuse* means waste products of coal mining, physical coal cleaning, and coal preparation operations (e.g. culm, gob, etc.) containing coal, matrix material, clay, and other organic and inorganic material.

*Cogeneration* means a steam-generating unit that simultaneously produces both electrical and useful thermal (or mechanical) energy from the same primary energy source.

*Cogeneration unit* means a stationary, fossil fuel-fired EGU meeting the definition of “fossil fuel-fired” or stationary, integrated gasification combined cycle:

(1) Having equipment used to produce electricity and useful thermal energy for industrial, commercial, heating, or cooling purposes through the sequential use of energy; and

(2) Producing during the 12-month period starting on the date the unit first produces electricity and during any calendar year after which the unit first produces electricity:

(i) For a topping-cycle cogeneration unit,

(A) Useful thermal energy not less than 5 percent of total energy output; and

(B) Useful power that, when added to one-half of useful thermal energy produced, is not less than 42.5 percent of total energy input, if useful thermal energy produced is 15 percent or more of total energy output, or not less than 45 percent of total energy input, if useful thermal energy produced is less than 15 percent of total energy output.

(ii) For a bottoming-cycle cogeneration unit, useful power not less than 45 percent of total energy input.

(3) Provided that the total energy input under paragraphs (2)(i)(B) and (2)(ii) of this definition shall equal the unit's total energy input from all fuel except biomass if the unit is a boiler.

*Combined-cycle gas stationary combustion turbine* means a stationary combustion turbine system where heat from the turbine exhaust gases is recovered by a waste heat boiler.

*Common stack* means the exhaust of emissions from two or more affected units through a single flue.

*Continental liquid oil-fired subcategory* means any oil-fired electric utility steam generating unit that burns liquid oil and is located in the continental United States.

*Default electrical load* means an electrical load equal to 5 percent of the maximum sustainable electrical output (megawatts), as defined in section 6.5.2.1(a)(1) of Appendix A to part 75 of this chapter, of an affected EGU that is in startup or shutdown mode. For monitored common stack configurations, the default electrical load is 5 percent of the combined maximum sustainable electrical load of the EGUs that are in startup or shutdown mode during an hour in which the electrical load for all operating EGUs is zero. The default electrical load is used to calculate the electrical output-based emission rate (lb/MWh or lb/GWh, as applicable) for any startup or shutdown hour in which the actual electrical load is zero. The default electrical load is not used for EGUs required to make heat input-based emission rate (lb/MMBtu or lb/TBtu, as applicable) calculations. For the purposes of this subpart, the default electrical load is not considered to be a substitute data value.

*Deviation.* (1) *Deviation* means any instance in which an affected source subject to this subpart, or an owner or operator of such a source:

(i) Fails to meet any requirement or obligation established by this subpart including, but not limited to, any emission limit, operating limit, work practice standard, or monitoring requirement; or

(ii) Fails to meet any term or condition that is adopted to implement an applicable requirement in this subpart and that is included in the operating permit for any affected source required to obtain such a permit.

(2) A deviation is not always a violation. The determination of whether a deviation constitutes a violation of the standard is up to the discretion of the entity responsible for enforcement of the standards.

*Diluent cap* means a default CO<sub>2</sub> or O<sub>2</sub> concentration that may be used to calculate the Hg, HCl, HF, or SO<sub>2</sub> emission rate (lb/MMBtu or lb/TBtu, as applicable) during a startup or shutdown hour in which the measured CO<sub>2</sub> concentration is below the cap value or the measured O<sub>2</sub> concentration is above the cap value. The appropriate diluent cap values for EGUs are presented in §63.10007(f) and in section 6.2.1.2 of Appendix A to this subpart. For the purposes of this subpart, the diluent cap is not considered to be a substitute data value.

*Distillate oil* means fuel oils, including recycled oils, that comply with the specifications for fuel oil numbers 1 and 2, as defined by ASTM Method D396-10, "Standard Specification for Fuel Oils" (incorporated by reference, see §63.14).

*Dry flue gas desulfurization technology, or dry FGD, or spray dryer absorber (SDA), or spray dryer, or dry scrubber* means an add-on air pollution control system located downstream of the steam generating unit that injects a dry alkaline sorbent (dry sorbent injection) or sprays an alkaline sorbent slurry (spray dryer) to react with and neutralize acid gases such as SO<sub>2</sub> and HCl in the exhaust stream forming a dry powder material. Alkaline sorbent injection systems in fluidized bed combustors (FBC) or circulating fluidized bed (CFB) boilers are included in this definition.

*Dry sorbent injection (DSI)* means an add-on air pollution control system in which sorbent (e.g., conventional activated carbon, brominated activated carbon, Trona, hydrated lime, sodium carbonate, etc.) is injected into the flue gas stream upstream of a PM control device to react with and neutralize acid gases (such as SO<sub>2</sub> and HCl) or Hg in the exhaust stream forming a dry powder material that may be removed in a primary or secondary PM control device.

*Electric Steam generating unit* means any furnace, boiler, or other device used for combusting fuel for the purpose of producing steam (including fossil-fuel-fired steam generators associated with

integrated gasification combined cycle gas turbines; nuclear steam generators are not included) for the purpose of powering a generator to produce electricity or electricity and other thermal energy.

*Electric utility steam generating unit (EGU)* means a fossil fuel-fired combustion unit of more than 25 megawatts electric (MWe) that serves a generator that produces electricity for sale. A fossil fuel-fired unit that cogenerates steam and electricity and supplies more than one-third of its potential electric output capacity and more than 25 MWe output to any utility power distribution system for sale is considered an electric utility steam generating unit.

*Emission limitation* means any emissions limit, work practice standard, or operating limit.

*Excess emissions* means, with respect to this subpart, results of any required measurements outside the applicable range (e.g., emissions limitations, parametric operating limits) that is permitted by this subpart. The values of measurements will be in the same units and averaging time as the values specified in this subpart for the limitations.

*Federally enforceable* means all limitations and conditions that are enforceable by the Administrator, including the requirements of 40 CFR parts 60, 61, and 63; requirements within any applicable state implementation plan; and any permit requirements established under 40 CFR 52.21 or under 40 CFR 51.18 and 40 CFR 51.24.

*Flue gas desulfurization system* means any add-on air pollution control system located downstream of the steam generating unit whose purpose or effect is to remove at least 50 percent of the SO<sub>2</sub> in the exhaust gas stream.

*Fossil fuel* means natural gas, oil, coal, and any form of solid, liquid, or gaseous fuel derived from such material.

*Fossil fuel-fired* means an electric utility steam generating unit (EGU) that is capable of producing more than 25 MW of electrical output from the combustion of fossil fuels. To be "capable of combusting" fossil fuels, an EGU would need to have these fuels allowed in its operating permit and have the appropriate fuel handling facilities on-site or otherwise available (e.g., coal handling equipment, including coal storage area, belts and conveyers, pulverizers, etc.; oil storage facilities). In addition, fossil fuel-fired means any EGU that fired fossil fuels for more than 10.0 percent of the average annual heat input during the 3 previous calendar years after the compliance date for your facility in §63.9984 or for more than 15.0 percent of the annual heat input during any one of those calendar years. EGU owners and operators must estimate coal, oil, and natural gas usage for the first 3 calendar years after the applicable compliance date and they are solely responsible for assuring compliance with this final rule or other applicable standard based on their fuel usage projections. After the first 3 years of compliance, EGUs are required to evaluate applicability based on coal or oil usage from the three previous calendar years on an annual rolling basis.

*Fuel type* means each category of fuels that share a common name or classification. Examples include, but are not limited to, bituminous coal, subbituminous coal, lignite, anthracite, biomass, and residual oil. Individual fuel types received from different suppliers are not considered new fuel types.

*Fluidized bed boiler, or fluidized bed combustor, or circulating fluidized boiler, or CFB* means a boiler utilizing a fluidized bed combustion process.

*Fluidized bed combustion* means a process where a fuel is burned in a bed of granulated particles which are maintained in a mobile suspension by the upward flow of air and combustion products.

*Gaseous fuel* includes, but is not limited to, natural gas, process gas, landfill gas, coal derived gas, solid oil-derived gas, refinery gas, and biogas.

*Generator* means a device that produces electricity.

*Gross output* means the gross useful work performed by the steam generated and, for an IGCC electric utility steam generating unit, the work performed by the stationary combustion turbines. For a unit generating only electricity, the gross useful work performed is the gross electrical output from the unit's turbine/generator sets. For a cogeneration unit, the gross useful work performed is the gross electrical output, including any such electricity used in the power production process (which process includes, but is not limited to, any on-site processing or treatment of fuel combusted at the unit and any on-site emission controls), or mechanical output plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (*i.e.*, steam delivered to an industrial process).

*Heat input* means heat derived from combustion of fuel in an EGU (synthetic gas for an IGCC) and does not include the heat input from preheated combustion air, recirculated flue gases, or exhaust gases from other sources such as gas turbines, internal combustion engines, etc.

*Integrated gasification combined cycle electric utility steam generating unit or IGCC* means an electric utility steam generating unit meeting the definition of "fossil fuel-fired" that burns a synthetic gas derived from coal and/or solid oil-derived fuel for more than 10.0 percent of the average annual heat input during the 3 previous calendar years after the compliance date for your facility in §63.9984 or for more than 15.0 percent of the annual heat input during any one of those calendar years in a combined-cycle gas turbine. EGU owners and operators must estimate coal, oil, and natural gas usage for the first 3 calendar years after the applicable compliance date and they are solely responsible for assuring compliance with this final rule or other applicable standard based on their fuel usage projections. No solid coal or solid oil-derived fuel is directly burned in the unit during operation. After the first 3 years of compliance, EGUs are required to evaluate applicability based on coal or oil usage from the three previous calendar years on an annual rolling basis.

*ISO conditions* means a temperature of 288 Kelvin, a relative humidity of 60 percent, and a pressure of 101.3 kilopascals.

*Lignite coal* means coal that is classified as lignite A or B according to ASTM Method D388-05, "Standard Classification of Coals by Rank" (incorporated by reference, see §63.14).

*Limited-use liquid oil-fired subcategory* means an oil-fired electric utility steam generating unit with an annual capacity factor when burning oil of less than 8 percent of its maximum or nameplate heat input, whichever is greater, averaged over a 24-month block contiguous period commencing on the first of the month following the compliance date specified in §63.9984.

*Liquid fuel* includes, but is not limited to, distillate oil and residual oil.

*Monitoring system malfunction or out of control period* means any sudden, infrequent, not reasonably preventable failure of the monitoring system to provide valid data. Monitoring system failures that are caused in part by poor maintenance or careless operation are not malfunctions.

*Natural gas* means a naturally occurring fluid mixture of hydrocarbons (e.g., methane, ethane, or propane) produced in geological formations beneath the Earth's surface that maintains a gaseous state at standard atmospheric temperature and pressure under ordinary conditions. Natural gas

contains 20.0 grains or less of total sulfur per 100 standard cubic feet. Additionally, natural gas must either be composed of at least 70 percent methane by volume or have a gross calorific value between 950 and 1,100 Btu per standard cubic foot. Natural gas does not include the following gaseous fuels: landfill gas, digester gas, refinery gas, sour gas, blast furnace gas, coal-derived gas, producer gas, coke oven gas, or any gaseous fuel produced in a process which might result in highly variable sulfur content or heating value.

*Natural gas-fired electric utility steam generating unit* means an electric utility steam generating unit meeting the definition of “fossil fuel-fired” that is not a coal-fired, oil-fired, or IGCC electric utility steam generating unit and that burns natural gas for more than 10.0 percent of the average annual heat input during the 3 previous calendar years after the compliance date for your facility in §63.9984 or for more than 15.0 percent of the annual heat input during any one of those calendar years. EGU owners and operators must estimate coal, oil, and natural gas usage for the first 3 calendar years after the applicable compliance date and they are solely responsible for assuring compliance with this final rule or other applicable standard based on their fuel usage projections.

*Net-electric output* means the gross electric sales to the utility power distribution system minus purchased power on a calendar year basis.

*Neural network* or *neural net* for purposes of this rule means an automated boiler optimization system. A neural network typically has the ability to process data from many inputs to develop, remember, update, and enable algorithms for efficient boiler operation.

*Non-continental area* means the State of Hawaii, the Virgin Islands, Guam, American Samoa, the Commonwealth of Puerto Rico, or the Northern Mariana Islands.

*Non-continental liquid oil-fired subcategory* means any oil-fired electric utility steam generating unit that burns liquid oil and is located outside the continental United States.

*Non-mercury (Hg) HAP metals* means Antimony (Sb), Arsenic (As), Beryllium (Be), Cadmium (Cd), Chromium (Cr), Cobalt (Co), Lead (Pb), Manganese (Mn), Nickel (Ni), and Selenium (Se).

*Oil* means crude oil or petroleum or a fuel derived from crude oil or petroleum, including distillate and residual oil, solid oil-derived fuel (e.g., petroleum coke) and gases derived from solid oil-derived fuels (not meeting the definition of natural gas).

*Oil-fired electric utility steam generating unit* means an electric utility steam generating unit meeting the definition of “fossil fuel-fired” that is not a coal-fired electric utility steam generating unit and that burns oil for more than 10.0 percent of the average annual heat input during the 3 previous calendar years after the compliance date for your facility in §63.9984 or for more than 15.0 percent of the annual heat input during any one of those calendar years. EGU owners and operators must estimate coal, oil, and natural gas usage for the first 3 calendar years after the applicable compliance date and they are solely responsible for assuring compliance with this final rule or other applicable standard based on their fuel usage projections. After the first 3 years of compliance, EGUs are required to evaluate applicability based on coal or oil usage from the three previous calendar years on an annual rolling basis.

*Particulate matter* or *PM* means any finely divided solid material as measured by the test methods specified under this subpart, or an alternative method.

*Pulverized coal (PC) boiler* means an EGU in which pulverized coal is introduced into an air stream that carries the coal to the combustion chamber of the EGU where it is fired in suspension.



*Residual oil* means crude oil, and all fuel oil numbers 4, 5 and 6, as defined by ASTM Method D396-10, "Standard Specification for Fuel Oils" (incorporated by reference, see §63.14).

*Responsible official* means responsible official as defined in 40 CFR 70.2.

*Shutdown* means the period in which cessation of operation of an EGU is initiated for any purpose. Shutdown begins when the EGU no longer generates electricity or makes useful thermal energy (such as heat or steam) for industrial, commercial, heating, or cooling purposes or when no coal, liquid oil, syngas, or solid oil-derived fuel is being fired in the EGU, whichever is earlier. Shutdown ends when the EGU no longer generates electricity or makes useful thermal energy (such as steam or heat) for industrial, commercial, heating, or cooling purposes, and no fuel is being fired in the EGU. Any fraction of an hour in which shutdown occurs constitutes a full hour of shutdown.

*Startup* means:

(1) Either the first-ever firing of fuel in a boiler for the purpose of producing electricity, or the firing of fuel in a boiler after a shutdown event for any purpose. Startup ends when any of the steam from the boiler is used to generate electricity for sale over the grid or for any other purpose (including on-site use). Any fraction of an hour in which startup occurs constitutes a full hour of startup; or

(2) The period in which operation of an EGU is initiated for any purpose. Startup begins with either the firing of any fuel in an EGU for the purpose of producing electricity or useful thermal energy (such as heat or steam) for industrial, commercial, heating, or cooling purposes (other than the first-ever firing of fuel in a boiler following construction of the boiler) or for any other purpose after a shutdown event. Startup ends 4 hours after the EGU generates electricity that is sold or used for any other purpose (including on site use), or 4 hours after the EGU makes useful thermal energy (such as heat or steam) for industrial, commercial, heating, or cooling purposes (16 U.S.C. 796(18)(A) and 18 CFR 292.202(c)), whichever is earlier. Any fraction of an hour in which startup occurs constitutes a full hour of startup.

*Stationary combustion turbine* means all equipment, including but not limited to the turbine, the fuel, air, lubrication and exhaust gas systems, control systems (except emissions control equipment), and any ancillary components and sub-components comprising any simple cycle stationary combustion turbine, any regenerative/recuperative cycle stationary combustion turbine, the combustion turbine portion of any stationary cogeneration cycle combustion system, or the combustion turbine portion of any stationary combined cycle steam/electric generating system. Stationary means that the combustion turbine is not self propelled or intended to be propelled while performing its function. Stationary combustion turbines do not include turbines located at a research or laboratory facility, if research is conducted on the turbine itself and the turbine is not being used to power other applications at the research or laboratory facility.

*Steam generating unit* means any furnace, boiler, or other device used for combusting fuel for the purpose of producing steam (including fossil-fuel-fired steam generators associated with integrated gasification combined cycle gas turbines; nuclear steam generators are not included).

*Stoker* means a unit consisting of a mechanically operated fuel feeding mechanism, a stationary or moving grate to support the burning of fuel and admit undergrate air to the fuel, an overfire air system to complete combustion, and an ash discharge system. There are two general types of stokers: underfeed and overfeed. Overfeed stokers include mass feed and spreader stokers.

*Subbituminous coal* means coal that is classified as subbituminous A, B, or C according to ASTM Method D388-05, “Standard Classification of Coals by Rank” (incorporated by reference, see §63.14).

*Unit designed for coal  $\geq 8,300$  Btu/lb subcategory* means any coal-fired EGU that is not a coal-fired EGU in the “unit designed for low rank virgin coal” subcategory.

*Unit designed for low rank virgin coal subcategory* means any coal-fired EGU that is designed to burn and that is burning nonagglomerating virgin coal having a calorific value (moist, mineral matter-free basis) of less than 19,305 kJ/kg (8,300 Btu/lb) that is constructed and operates at or near the mine that produces such coal.

*Unit designed to burn solid oil-derived fuel subcategory* means any oil-fired EGU that burns solid oil-derived fuel.

*Voluntary consensus standards or VCS* mean technical standards (e.g., materials specifications, test methods, sampling procedures, business practices) developed or adopted by one or more voluntary consensus bodies. The EPA/OAQPS has by precedent only used VCS that are written in English. Examples of VCS bodies are: American Society of Testing and Materials (ASTM), American Society of Mechanical Engineers (ASME), International Standards Organization (ISO), Standards Australia (AS), British Standards (BS), Canadian Standards (CSA), European Standard (EN or CEN) and German Engineering Standards (VDI). The types of standards that are not considered VCS are standards developed by: the U.S. states, e.g., California (CARB) and Texas (TCEQ); industry groups, such as American Petroleum Institute (API), Gas Processors Association (GPA), and Gas Research Institute (GRI); and other branches of the U.S. government, e.g., Department of Defense (DOD) and Department of Transportation (DOT). This does not preclude EPA from using standards developed by groups that are not VCS bodies within an EPA rule. When this occurs, EPA has done searches and reviews for VCS equivalent to these non-VCS methods.

*Wet flue gas desulfurization technology, or wet FGD, or wet scrubber* means any add-on air pollution control device that is located downstream of the steam generating unit that mixes an aqueous stream or slurry with the exhaust gases from an EGU to control emissions of PM and/or to absorb and neutralize acid gases, such as SO<sub>2</sub> and HCl.

*Work practice standard* means any design, equipment, work practice, or operational standard, or combination thereof, which is promulgated pursuant to CAA section 112(h).

[77 FR 9464, Feb. 16, 2012, as amended at 77 FR 23405, Apr. 19, 2012; 78 FR 24087, Apr. 24, 2013; 79 FR 68792, Nov. 19, 2014; 81 FR 20189, Apr. 6, 2016]

 [Back to Top](#)

**Table 1 to Subpart UUUUU of Part 63—Emission Limits for New or Reconstructed EGUs**

As stated in §63.9991, you must comply with the following applicable emission limits:

| If your EGU is in this subcategory . . . | For the following pollutants . . . | You must meet the following emission limits and work | Using these requirements, as appropriate (e.g., specified sampling volume or test run duration) and limitations with the |
|------------------------------------------|------------------------------------|------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|
|------------------------------------------|------------------------------------|------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|

|                                                |                                                   | practice standards<br>. . . | test<br>methods in Table 5 to this<br>Subpart . . .                                                                                                                                                                                      |
|------------------------------------------------|---------------------------------------------------|-----------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. Coal-fired unit not<br>low rank virgin coal | a. Filterable<br>particulate matter<br>(PM)       | 9.0E-2 lb/MWh <sup>1</sup>  | Collect a minimum of 4 dscm per<br>run.                                                                                                                                                                                                  |
|                                                | OR                                                | OR                          |                                                                                                                                                                                                                                          |
|                                                | Total non-Hg<br>HAP metals                        | 6.0E-2 lb/GWh               | Collect a minimum of 4 dscm per<br>run.                                                                                                                                                                                                  |
|                                                | OR                                                | OR                          |                                                                                                                                                                                                                                          |
|                                                | Individual HAP<br>metals:                         |                             | Collect a minimum of 3 dscm per<br>run.                                                                                                                                                                                                  |
|                                                | Antimony (Sb)                                     | 8.0E-3 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Arsenic (As)                                      | 3.0E-3 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Beryllium (Be)                                    | 6.0E-4 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Cadmium (Cd)                                      | 4.0E-4 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Chromium (Cr)                                     | 7.0E-3 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Cobalt (Co)                                       | 2.0E-3 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Lead (Pb)                                         | 2.0E-2 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Manganese (Mn)                                    | 4.0E-3 lb/GWh               |                                                                                                                                                                                                                                          |
|                                                | Nickel (Ni)                                       | 4.0E-2 lb/GWh               |                                                                                                                                                                                                                                          |
| Selenium (Se)                                  | 5.0E-2 lb/GWh                                     |                             |                                                                                                                                                                                                                                          |
|                                                | b. Hydrogen<br>chloride (HCl)                     | 1.0E-2 lb/MWh               | For Method 26A at appendix A-8 to<br>part 60 of this chapter, collect a<br>minimum of 3 dscm per run. For<br>ASTM D6348-03 <sup>2</sup> or Method 320 at<br>appendix A to part 63 of this<br>chapter, sample for a minimum of 1<br>hour. |
|                                                | OR                                                |                             |                                                                                                                                                                                                                                          |
|                                                | Sulfur dioxide<br>(SO <sub>2</sub> ) <sup>3</sup> | 1.0 lb/MWh                  | SO <sub>2</sub> CEMS.                                                                                                                                                                                                                    |
|                                                | c. Mercury (Hg)                                   | 3.0E-3 lb/GWh               | Hg CEMS or sorbent trap<br>monitoring system only.                                                                                                                                                                                       |
| 2. Coal-fired units                            | a. Filterable                                     | 9.0E-2 lb/MWh <sup>1</sup>  | Collect a minimum of 4 dscm per                                                                                                                                                                                                          |

|                      |                                                |                                                       |                                                                                                                                   |
|----------------------|------------------------------------------------|-------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------|
| low rank virgin coal | particulate matter (PM)                        |                                                       | run.                                                                                                                              |
|                      | OR                                             | OR                                                    |                                                                                                                                   |
|                      | Total non-Hg HAP metals                        | 6.0E-2 lb/GWh                                         | Collect a minimum of 4 dscm per run.                                                                                              |
|                      | OR                                             | OR                                                    |                                                                                                                                   |
|                      | Individual HAP metals:                         |                                                       | Collect a minimum of 3 dscm per run.                                                                                              |
|                      | Antimony (Sb)                                  | 8.0E-3 lb/GWh                                         |                                                                                                                                   |
|                      | Arsenic (As)                                   | 3.0E-3 lb/GWh                                         |                                                                                                                                   |
|                      | Beryllium (Be)                                 | 6.0E-4 lb/GWh                                         |                                                                                                                                   |
|                      | Cadmium (Cd)                                   | 4.0E-4 lb/GWh                                         |                                                                                                                                   |
|                      | Chromium (Cr)                                  | 7.0E-3 lb/GWh                                         |                                                                                                                                   |
|                      | Cobalt (Co)                                    | 2.0E-3 lb/GWh                                         |                                                                                                                                   |
|                      | Lead (Pb)                                      | 2.0E-2 lb/GWh                                         |                                                                                                                                   |
|                      | Manganese (Mn)                                 | 4.0E-3 lb/GWh                                         |                                                                                                                                   |
|                      | Nickel (Ni)                                    | 4.0E-2 lb/GWh                                         |                                                                                                                                   |
|                      | Selenium (Se)                                  | 5.0E-2 lb/GWh                                         |                                                                                                                                   |
|                      | b. Hydrogen chloride (HCl)                     | 1.0E-2 lb/MWh                                         | For Method 26A, collect a minimum of 3 dscm per run For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour. |
|                      | OR                                             |                                                       |                                                                                                                                   |
|                      | Sulfur dioxide (SO <sub>2</sub> ) <sup>3</sup> | 1.0 lb/MWh                                            | SO <sub>2</sub> CEMS.                                                                                                             |
|                      | c. Mercury (Hg)                                | 4.0E-2 lb/GWh                                         | Hg CEMS or sorbent trap monitoring system only.                                                                                   |
| 3. IGCC unit         | a. Filterable particulate matter (PM)          | 7.0E-2 lb/MWh <sup>4</sup> 9.0E-2 lb/MWh <sup>5</sup> | Collect a minimum of 1 dscm per run.                                                                                              |
|                      | OR                                             | OR                                                    |                                                                                                                                   |
|                      | Total non-Hg HAP metals                        | 4.0E-1 lb/GWh                                         | Collect a minimum of 1 dscm per run.                                                                                              |
|                      | OR                                             | OR                                                    |                                                                                                                                   |

|                                                                                                 |                                                |                            |                                                                                                                                                                                                                                       |
|-------------------------------------------------------------------------------------------------|------------------------------------------------|----------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                 | Individual HAP metals:                         |                            | Collect a minimum of 2 dscm per run.                                                                                                                                                                                                  |
|                                                                                                 | Antimony (Sb)                                  | 2.0E-2 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Arsenic (As)                                   | 2.0E-2 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Beryllium (Be)                                 | 1.0E-3 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Cadmium (Cd)                                   | 2.0E-3 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Chromium (Cr)                                  | 4.0E-2 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Cobalt (Co)                                    | 4.0E-3 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Lead (Pb)                                      | 9.0E-3 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Manganese (Mn)                                 | 2.0E-2 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Nickel (Ni)                                    | 7.0E-2 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | Selenium (Se)                                  | 3.0E-1 lb/GWh              |                                                                                                                                                                                                                                       |
|                                                                                                 | b. Hydrogen chloride (HCl)                     | 2.0E-3 lb/MWh              | For Method 26A, collect a minimum of 1 dscm per run; for Method 26 at appendix A-8 to part 60 of this chapter, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour. |
|                                                                                                 | OR                                             |                            |                                                                                                                                                                                                                                       |
|                                                                                                 | Sulfur dioxide (SO <sub>2</sub> ) <sup>3</sup> | 4.0E-1 lb/MWh              | SO <sub>2</sub> CEMS.                                                                                                                                                                                                                 |
|                                                                                                 | c. Mercury (Hg)                                | 3.0E-3 lb/GWh              | Hg CEMS or sorbent trap monitoring system only.                                                                                                                                                                                       |
| 4. Liquid oil-fired unit—continental (excluding limited-use liquid oil-fired subcategory units) | a. Filterable particulate matter (PM)          | 3.0E-1 lb/MWh <sup>1</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                                                                  |
|                                                                                                 | OR                                             | OR                         |                                                                                                                                                                                                                                       |
|                                                                                                 | Total HAP metals                               | 2.0E-4 lb/MWh              | Collect a minimum of 2 dscm per run.                                                                                                                                                                                                  |
|                                                                                                 | OR                                             | OR                         |                                                                                                                                                                                                                                       |
|                                                                                                 | Individual HAP metals:                         |                            | Collect a minimum of 2 dscm per run.                                                                                                                                                                                                  |

|                                                                                                     |                                       |                            |                                                                                                                                                                                         |
|-----------------------------------------------------------------------------------------------------|---------------------------------------|----------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                     | Antimony (Sb)                         | 1.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Arsenic (As)                          | 3.0E-3 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Beryllium (Be)                        | 5.0E-4 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Cadmium (Cd)                          | 2.0E-4 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Chromium (Cr)                         | 2.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Cobalt (Co)                           | 3.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Lead (Pb)                             | 8.0E-3 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Manganese (Mn)                        | 2.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Nickel (Ni)                           | 9.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Selenium (Se)                         | 2.0E-2 lb/GWh              |                                                                                                                                                                                         |
|                                                                                                     | Mercury (Hg)                          | 1.0E-4 lb/GWh              | For Method 30B at appendix A-8 to part 60 of this chapter sample volume determination (Section 8.2.4), the estimated Hg concentration should nominally be $< \frac{1}{2}$ the standard. |
|                                                                                                     | b. Hydrogen chloride (HCl)            | 4.0E-4 lb/MWh              | For Method 26A, collect a minimum of 3 dscm per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour.                                                      |
|                                                                                                     | c. Hydrogen fluoride (HF)             | 4.0E-4 lb/MWh              | For Method 26A, collect a minimum of 3 dscm per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour.                                                      |
| 5. Liquid oil-fired unit—non-continental (excluding limited-use liquid oil-fired subcategory units) | a. Filterable particulate matter (PM) | 2.0E-1 lb/MWh <sup>1</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                    |
|                                                                                                     | OR                                    | OR                         |                                                                                                                                                                                         |
|                                                                                                     | Total HAP metals                      | 7.0E-3 lb/MWh              | Collect a minimum of 1 dscm per run.                                                                                                                                                    |
|                                                                                                     | OR                                    | OR                         |                                                                                                                                                                                         |
|                                                                                                     | Individual HAP metals:                |                            | Collect a minimum of 3 dscm per run.                                                                                                                                                    |

|                                      |                                       |                            |                                                                                                                                                                                            |
|--------------------------------------|---------------------------------------|----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                      | Antimony (Sb)                         | 8.0E-3 lb/GWh              |                                                                                                                                                                                            |
|                                      | Arsenic (As)                          | 6.0E-2 lb/GWh              |                                                                                                                                                                                            |
|                                      | Beryllium (Be)                        | 2.0E-3 lb/GWh              |                                                                                                                                                                                            |
|                                      | Cadmium (Cd)                          | 2.0E-3 lb/GWh              |                                                                                                                                                                                            |
|                                      | Chromium (Cr)                         | 2.0E-2 lb/GWh              |                                                                                                                                                                                            |
|                                      | Cobalt (Co)                           | 3.0E-1 lb/GWh              |                                                                                                                                                                                            |
|                                      | Lead (Pb)                             | 3.0E-2 lb/GWh              |                                                                                                                                                                                            |
|                                      | Manganese (Mn)                        | 1.0E-1 lb/GWh              |                                                                                                                                                                                            |
|                                      | Nickel (Ni)                           | 4.1E0 lb/GWh               |                                                                                                                                                                                            |
|                                      | Selenium (Se)                         | 2.0E-2 lb/GWh              |                                                                                                                                                                                            |
|                                      | Mercury (Hg)                          | 4.0E-4 lb/GWh              | For Method 30B sample volume determination (Section 8.2.4), the estimated Hg concentration should nominally be $< \frac{1}{2}$ the standard.                                               |
|                                      | b. Hydrogen chloride (HCl)            | 2.0E-3 lb/MWh              | For Method 26A, collect a minimum of 1 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour. |
|                                      | c. Hydrogen fluoride (HF)             | 5.0E-4 lb/MWh              | For Method 26A, collect a minimum of 3 dscm per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour.                                                         |
| 6. Solid oil-derived fuel-fired unit | a. Filterable particulate matter (PM) | 3.0E-2 lb/MWh <sup>1</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                       |
|                                      | OR                                    | OR                         |                                                                                                                                                                                            |
|                                      | Total non-Hg HAP metals               | 6.0E-1 lb/GWh              | Collect a minimum of 1 dscm per run.                                                                                                                                                       |
|                                      | OR                                    | OR                         |                                                                                                                                                                                            |
|                                      | Individual HAP metals:                |                            | Collect a minimum of 3 dscm per run.                                                                                                                                                       |
|                                      | Antimony (Sb)                         | 8.0E-3 lb/GWh              |                                                                                                                                                                                            |
|                                      | Arsenic (As)                          | 3.0E-3 lb/GWh              |                                                                                                                                                                                            |

|  |                                                |               |                                                                                                                                    |
|--|------------------------------------------------|---------------|------------------------------------------------------------------------------------------------------------------------------------|
|  | Beryllium (Be)                                 | 6.0E-4 lb/GWh |                                                                                                                                    |
|  | Cadmium (Cd)                                   | 7.0E-4 lb/GWh |                                                                                                                                    |
|  | Chromium (Cr)                                  | 6.0E-3 lb/GWh |                                                                                                                                    |
|  | Cobalt (Co)                                    | 2.0E-3 lb/GWh |                                                                                                                                    |
|  | Lead (Pb)                                      | 2.0E-2 lb/GWh |                                                                                                                                    |
|  | Manganese (Mn)                                 | 7.0E-3 lb/GWh |                                                                                                                                    |
|  | Nickel (Ni)                                    | 4.0E-2 lb/GWh |                                                                                                                                    |
|  | Selenium (Se)                                  | 6.0E-3 lb/GWh |                                                                                                                                    |
|  | b. Hydrogen chloride (HCl)                     | 4.0E-4 lb/MWh | For Method 26A, collect a minimum of 3 dscm per run. For ASTM D6348-03 <sup>2</sup> or Method 320, sample for a minimum of 1 hour. |
|  | OR                                             |               |                                                                                                                                    |
|  | Sulfur dioxide (SO <sub>2</sub> ) <sup>3</sup> | 1.0 lb/MWh    | SO <sub>2</sub> CEMS.                                                                                                              |
|  | c. Mercury (Hg)                                | 2.0E-3 lb/GWh | Hg CEMS or Sorbent trap monitoring system only.                                                                                    |

<sup>1</sup> Gross output.

<sup>2</sup> Incorporated by reference, see §63.14.

<sup>3</sup> You may not use the alternate SO<sub>2</sub> limit if your EGU does not have some form of FGD system (or, in the case of IGCC EGUs, some other acid gas removal system either upstream or downstream of the combined cycle block) and SO<sub>2</sub> CEMS installed.

<sup>4</sup> Duct burners on syngas; gross output.

<sup>5</sup> Duct burners on natural gas; gross output.

[81 FR 20190, Apr. 6, 2016]

[↑ Back to Top](#)

### Table 2 to Subpart UUUUU of Part 63—Emission Limits for Existing EGUs

As stated in §63.9991, you must comply with the following applicable emission limits:<sup>1</sup>

| If your EGU is in this subcategory . . . | For the following pollutants | You must meet the following emission limits | Using these requirements, as appropriate (e.g., specified sampling volume or test run duration) and |
|------------------------------------------|------------------------------|---------------------------------------------|-----------------------------------------------------------------------------------------------------|
|------------------------------------------|------------------------------|---------------------------------------------|-----------------------------------------------------------------------------------------------------|



|                                             | . . .                                 | and work practice standards . . .             | limitations with the test methods in Table 5 to this Subpart . . .                                                                                                                                         |
|---------------------------------------------|---------------------------------------|-----------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. Coal-fired unit not low rank virgin coal | a. Filterable particulate matter (PM) | 3.0E-2 lb/MMBtu or 3.0E-1 lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                                       |
|                                             | OR                                    | OR                                            |                                                                                                                                                                                                            |
|                                             | Total non-Hg HAP metals               | 5.0E-5 lb/MMBtu or 5.0E-1 lb/GWh              | Collect a minimum of 1 dscm per run.                                                                                                                                                                       |
|                                             | OR                                    | OR                                            |                                                                                                                                                                                                            |
|                                             | Individual HAP metals:                |                                               | Collect a minimum of 3 dscm per run.                                                                                                                                                                       |
|                                             | Antimony (Sb)                         | 8.0E-1 lb/TBtu or 8.0E-3 lb/GWh               |                                                                                                                                                                                                            |
|                                             | Arsenic (As)                          | 1.1E0 lb/TBtu or 2.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | Beryllium (Be)                        | 2.0E-1 lb/TBtu or 2.0E-3 lb/GWh               |                                                                                                                                                                                                            |
|                                             | Cadmium (Cd)                          | 3.0E-1 lb/TBtu or 3.0E-3 lb/GWh               |                                                                                                                                                                                                            |
|                                             | Chromium (Cr)                         | 2.8E0 lb/TBtu or 3.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | Cobalt (Co)                           | 8.0E-1 lb/TBtu or 8.0E-3 lb/GWh               |                                                                                                                                                                                                            |
|                                             | Lead (Pb)                             | 1.2E0 lb/TBtu or 2.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | Manganese (Mn)                        | 4.0E0 lb/TBtu or 5.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | Nickel (Ni)                           | 3.5E0 lb/TBtu or 4.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | Selenium (Se)                         | 5.0E0 lb/TBtu or 6.0E-2 lb/GWh                |                                                                                                                                                                                                            |
|                                             | b. Hydrogen chloride (HCl)            | 2.0E-3 lb/MMBtu or 2.0E-2 lb/MWh              | For Method 26A at appendix A-8 to part 60 of this chapter, collect a minimum of 0.75 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320 at |

|                                         |                                                |                                               |                                                                                                                                                                                                                                           |
|-----------------------------------------|------------------------------------------------|-----------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                         |                                                |                                               | appendix A to part 63 of this chapter, sample for a minimum of 1 hour.                                                                                                                                                                    |
|                                         | OR                                             |                                               |                                                                                                                                                                                                                                           |
|                                         | Sulfur dioxide (SO <sub>2</sub> ) <sup>4</sup> | 2.0E-1 lb/MMBtu or 1.5E0 lb/MWh               | SO <sub>2</sub> CEMS.                                                                                                                                                                                                                     |
|                                         | c. Mercury (Hg)                                | 1.2E0 lb/TBtu or 1.3E-2 lb/GWh                | LEE Testing for 30 days with a sampling period consistent with that given in section 5.2.1 of appendix A to this subpart per Method 30B at appendix A-8 to part 60 of this chapter run or Hg CEMS or sorbent trap monitoring system only. |
|                                         |                                                | OR                                            |                                                                                                                                                                                                                                           |
|                                         |                                                | 1.0E0 lb/TBtu or 1.1E-2 lb/GWh                | LEE Testing for 90 days with a sampling period consistent with that given in section 5.2.1 of appendix A to this subpart per Method 30B run or Hg CEMS or sorbent trap monitoring system only.                                            |
| 2. Coal-fired unit low rank virgin coal | a. Filterable particulate matter (PM)          | 3.0E-2 lb/MMBtu or 3.0E-1 lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                                                                      |
|                                         | OR                                             | OR                                            |                                                                                                                                                                                                                                           |
|                                         | Total non-Hg HAP metals                        | 5.0E-5 lb/MMBtu or 5.0E-1 lb/GWh              | Collect a minimum of 1 dscm per run.                                                                                                                                                                                                      |
|                                         | OR                                             | OR                                            |                                                                                                                                                                                                                                           |
|                                         | Individual HAP metals:                         |                                               | Collect a minimum of 3 dscm per run.                                                                                                                                                                                                      |
|                                         | Antimony (Sb)                                  | 8.0E-1 lb/TBtu or 8.0E-3 lb/GWh               |                                                                                                                                                                                                                                           |
|                                         | Arsenic (As)                                   | 1.1E0 lb/TBtu or 2.0E-2 lb/GWh                |                                                                                                                                                                                                                                           |
|                                         | Beryllium (Be)                                 | 2.0E-1 lb/TBtu or 2.0E-3 lb/GWh               |                                                                                                                                                                                                                                           |
|                                         | Cadmium (Cd)                                   | 3.0E-1 lb/TBtu or 3.0E-3 lb/GWh               |                                                                                                                                                                                                                                           |
|                                         | Chromium (Cr)                                  | 2.8E0 lb/TBtu or 3.0E-2 lb/GWh                |                                                                                                                                                                                                                                           |

|              |                                                      |                                                     |                                                                                                                                                                                                                                                         |
|--------------|------------------------------------------------------|-----------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|              | Cobalt (Co)                                          | 8.0E-1 lb/TBtu or<br>8.0E-3 lb/GWh                  |                                                                                                                                                                                                                                                         |
|              | Lead (Pb)                                            | 1.2E0 lb/TBtu or<br>2.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |
|              | Manganese<br>(Mn)                                    | 4.0E0 lb/TBtu or<br>5.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |
|              | Nickel (Ni)                                          | 3.5E0 lb/TBtu or<br>4.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |
|              | Selenium<br>(Se)                                     | 5.0E0 lb/TBtu or<br>6.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |
|              | b. Hydrogen<br>chloride<br>(HCl)                     | 2.0E-3 lb/MMBtu<br>or 2.0E-2<br>lb/MWh              | For Method 26A, collect a minimum of<br>0.75 dscm per run; for Method 26 at<br>appendix A-8 to part 60 of this chapter,<br>collect a minimum of 120 liters per run.<br>For ASTM D6348-03 <sup>3</sup> or Method 320,<br>sample for a minimum of 1 hour. |
|              | OR                                                   |                                                     |                                                                                                                                                                                                                                                         |
|              | Sulfur<br>dioxide<br>(SO <sub>2</sub> ) <sup>4</sup> | 2.0E-1 lb/MMBtu<br>or 1.5E0 lb/MWh                  | SO <sub>2</sub> CEMS.                                                                                                                                                                                                                                   |
|              | c. Mercury<br>(Hg)                                   | 4.0E0 lb/TBtu or<br>4.0E-2 lb/GWh                   | LEE Testing for 30 days with a sampling<br>period consistent with that given in<br>section 5.2.1 of appendix A to this<br>subpart per Method 30B run or Hg CEMS<br>or sorbent trap monitoring system only.                                              |
| 3. IGCC unit | a. Filterable<br>particulate<br>matter (PM)          | 4.0E-2 lb/MMBtu<br>or 4.0E-1<br>lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                                                                                    |
|              | OR                                                   | OR                                                  |                                                                                                                                                                                                                                                         |
|              | Total non-Hg<br>HAP metals                           | 6.0E-5 lb/MMBtu<br>or 5.0E-1 lb/GWh                 | Collect a minimum of 1 dscm per run.                                                                                                                                                                                                                    |
|              | OR                                                   | OR                                                  |                                                                                                                                                                                                                                                         |
|              | Individual<br>HAP metals:                            |                                                     | Collect a minimum of 2 dscm per run.                                                                                                                                                                                                                    |
|              | Antimony<br>(Sb)                                     | 1.4E0 lb/TBtu or<br>2.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |
|              | Arsenic (As)                                         | 1.5E0 lb/TBtu or<br>2.0E-2 lb/GWh                   |                                                                                                                                                                                                                                                         |

|                                                                                                 |                                       |                                                     |                                                                                                                                                                                                |
|-------------------------------------------------------------------------------------------------|---------------------------------------|-----------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                 | Beryllium (Be)                        | 1.0E-1 lb/TBtu or<br>1.0E-3 lb/GWh                  |                                                                                                                                                                                                |
|                                                                                                 | Cadmium (Cd)                          | 1.5E-1 lb/TBtu or<br>2.0E-3 lb/GWh                  |                                                                                                                                                                                                |
|                                                                                                 | Chromium (Cr)                         | 2.9E0 lb/TBtu or<br>3.0E-2 lb/GWh                   |                                                                                                                                                                                                |
|                                                                                                 | Cobalt (Co)                           | 1.2E0 lb/TBtu or<br>2.0E-2 lb/GWh                   |                                                                                                                                                                                                |
|                                                                                                 | Lead (Pb)                             | 1.9E+2 lb/TBtu or<br>1.8E0 lb/GWh                   |                                                                                                                                                                                                |
|                                                                                                 | Manganese (Mn)                        | 2.5E0 lb/TBtu or<br>3.0E-2 lb/GWh                   |                                                                                                                                                                                                |
|                                                                                                 | Nickel (Ni)                           | 6.5E0 lb/TBtu or<br>7.0E-2 lb/GWh                   |                                                                                                                                                                                                |
|                                                                                                 | Selenium (Se)                         | 2.2E+1 lb/TBtu or<br>3.0E-1 lb/GWh                  |                                                                                                                                                                                                |
|                                                                                                 | b. Hydrogen chloride (HCl)            | 5.0E-4 lb/MMBtu<br>or 5.0E-3<br>lb/MWh              | For Method 26A, collect a minimum of 1 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320, sample for a minimum of 1 hour.     |
|                                                                                                 | c. Mercury (Hg)                       | 2.5E0 lb/TBtu or<br>3.0E-2 lb/GWh                   | LEE Testing for 30 days with a sampling period consistent with that given in section 5.2.1 of appendix A to this subpart per Method 30B run or Hg CEMS or sorbent trap monitoring system only. |
| 4. Liquid oil-fired unit—continental (excluding limited-use liquid oil-fired subcategory units) | a. Filterable particulate matter (PM) | 3.0E-2 lb/MMBtu<br>or 3.0E-1<br>lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                           |
|                                                                                                 | OR                                    | OR                                                  |                                                                                                                                                                                                |
|                                                                                                 | Total HAP metals                      | 8.0E-4 lb/MMBtu<br>or 8.0E-3<br>lb/MWh              | Collect a minimum of 1 dscm per run.                                                                                                                                                           |
|                                                                                                 | OR                                    | OR                                                  |                                                                                                                                                                                                |
|                                                                                                 | Individual HAP metals:                |                                                     | Collect a minimum of 1 dscm per run.                                                                                                                                                           |

|                                                                                  |                                       |                                                     |                                                                                                                                                                                            |
|----------------------------------------------------------------------------------|---------------------------------------|-----------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                  | Antimony (Sb)                         | 1.3E+1 lb/TBtu or<br>2.0E-1 lb/GWh                  |                                                                                                                                                                                            |
|                                                                                  | Arsenic (As)                          | 2.8E0 lb/TBtu or<br>3.0E-2 lb/GWh                   |                                                                                                                                                                                            |
|                                                                                  | Beryllium (Be)                        | 2.0E-1 lb/TBtu or<br>2.0E-3 lb/GWh                  |                                                                                                                                                                                            |
|                                                                                  | Cadmium (Cd)                          | 3.0E-1 lb/TBtu or<br>2.0E-3 lb/GWh                  |                                                                                                                                                                                            |
|                                                                                  | Chromium (Cr)                         | 5.5E0 lb/TBtu or<br>6.0E-2 lb/GWh                   |                                                                                                                                                                                            |
|                                                                                  | Cobalt (Co)                           | 2.1E+1 lb/TBtu or<br>3.0E-1 lb/GWh                  |                                                                                                                                                                                            |
|                                                                                  | Lead (Pb)                             | 8.1E0 lb/TBtu or<br>8.0E-2 lb/GWh                   |                                                                                                                                                                                            |
|                                                                                  | Manganese (Mn)                        | 2.2E+1 lb/TBtu or<br>3.0E-1 lb/GWh                  |                                                                                                                                                                                            |
|                                                                                  | Nickel (Ni)                           | 1.1E+2 lb/TBtu or<br>1.1E0 lb/GWh                   |                                                                                                                                                                                            |
|                                                                                  | Selenium (Se)                         | 3.3E0 lb/TBtu or<br>4.0E-2 lb/GWh                   |                                                                                                                                                                                            |
|                                                                                  | Mercury (Hg)                          | 2.0E-1 lb/TBtu or<br>2.0E-3 lb/GWh                  | For Method 30B sample volume determination (Section 8.2.4), the estimated Hg concentration should nominally be $< \frac{1}{2}$ the standard.                                               |
|                                                                                  | b. Hydrogen chloride (HCl)            | 2.0E-3 lb/MMBtu<br>or 1.0E-2<br>lb/MWh              | For Method 26A, collect a minimum of 1 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320, sample for a minimum of 1 hour. |
|                                                                                  | c. Hydrogen fluoride (HF)             | 4.0E-4 lb/MMBtu<br>or 4.0E-3<br>lb/MWh              | For Method 26A, collect a minimum of 1 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320, sample for a minimum of 1 hour. |
| 5. Liquid oil-fired unit—non-continental (excluding limited-use liquid oil-fired | a. Filterable particulate matter (PM) | 3.0E-2 lb/MMBtu<br>or 3.0E-1<br>lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                                                       |

|                    |                            |                                  |                                                                                                                                                                                             |
|--------------------|----------------------------|----------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| subcategory units) |                            |                                  |                                                                                                                                                                                             |
|                    | OR                         | OR                               |                                                                                                                                                                                             |
|                    | Total HAP metals           | 6.0E-4 lb/MMBtu or 7.0E-3 lb/MWh | Collect a minimum of 1 dscm per run.                                                                                                                                                        |
|                    | OR                         | OR                               |                                                                                                                                                                                             |
|                    | Individual HAP metals:     |                                  | Collect a minimum of 2 dscm per run.                                                                                                                                                        |
|                    | Antimony (Sb)              | 2.2E0 lb/TBtu or 2.0E-2 lb/GWh   |                                                                                                                                                                                             |
|                    | Arsenic (As)               | 4.3E0 lb/TBtu or 8.0E-2 lb/GWh   |                                                                                                                                                                                             |
|                    | Beryllium (Be)             | 6.0E-1 lb/TBtu or 3.0E-3 lb/GWh  |                                                                                                                                                                                             |
|                    | Cadmium (Cd)               | 3.0E-1 lb/TBtu or 3.0E-3 lb/GWh  |                                                                                                                                                                                             |
|                    | Chromium (Cr)              | 3.1E+1 lb/TBtu or 3.0E-1 lb/GWh  |                                                                                                                                                                                             |
|                    | Cobalt (Co)                | 1.1E+2 lb/TBtu or 1.4E0 lb/GWh   |                                                                                                                                                                                             |
|                    | Lead (Pb)                  | 4.9E0 lb/TBtu or 8.0E-2 lb/GWh   |                                                                                                                                                                                             |
|                    | Manganese (Mn)             | 2.0E+1 lb/TBtu or 3.0E-1 lb/GWh  |                                                                                                                                                                                             |
|                    | Nickel (Ni)                | 4.7E+2 lb/TBtu or 4.1E0 lb/GWh   |                                                                                                                                                                                             |
|                    | Selenium (Se)              | 9.8E0 lb/TBtu or 2.0E-1 lb/GWh   |                                                                                                                                                                                             |
|                    | Mercury (Hg)               | 4.0E-2 lb/TBtu or 4.0E-4 lb/GWh  | For Method 30B sample volume determination (Section 8.2.4), the estimated Hg concentration should nominally be $< \frac{1}{2}$ the standard.                                                |
|                    | b. Hydrogen chloride (HCl) | 2.0E-4 lb/MMBtu or 2.0E-3 lb/MWh | For Method 26A, collect a minimum of 1 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320, sample for a minimum of 2 hours. |

|                                      |                                       |                                               |                                                                                                                                                               |
|--------------------------------------|---------------------------------------|-----------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                      | c. Hydrogen fluoride (HF)             | 6.0E-5 lb/MMBtu or 5.0E-4 lb/MWh              | For Method 26A, collect a minimum of 3 dscm per run. For ASTM D6348-03 <sup>3</sup> or Method 320, sample for a minimum of 2 hours.                           |
| 6. Solid oil-derived fuel-fired unit | a. Filterable particulate matter (PM) | 8.0E-3 lb/MMBtu or 9.0E-2 lb/MWh <sup>2</sup> | Collect a minimum of 1 dscm per run.                                                                                                                          |
|                                      | OR                                    | OR                                            |                                                                                                                                                               |
|                                      | Total non-Hg HAP metals               | 4.0E-5 lb/MMBtu or 6.0E-1 lb/GWh              | Collect a minimum of 1 dscm per run.                                                                                                                          |
|                                      | OR                                    | OR                                            |                                                                                                                                                               |
|                                      | Individual HAP metals:                |                                               | Collect a minimum of 3 dscm per run.                                                                                                                          |
|                                      | Antimony (Sb)                         | 8.0E-1 lb/TBtu or 7.0E-3 lb/GWh               |                                                                                                                                                               |
|                                      | Arsenic (As)                          | 3.0E-1 lb/TBtu or 5.0E-3 lb/GWh               |                                                                                                                                                               |
|                                      | Beryllium (Be)                        | 6.0E-2 lb/TBtu or 5.0E-4 lb/GWh               |                                                                                                                                                               |
|                                      | Cadmium (Cd)                          | 3.0E-1 lb/TBtu or 4.0E-3 lb/GWh               |                                                                                                                                                               |
|                                      | Chromium (Cr)                         | 8.0E-1 lb/TBtu or 2.0E-2 lb/GWh               |                                                                                                                                                               |
|                                      | Cobalt (Co)                           | 1.1E0 lb/TBtu or 2.0E-2 lb/GWh                |                                                                                                                                                               |
|                                      | Lead (Pb)                             | 8.0E-1 lb/TBtu or 2.0E-2 lb/GWh               |                                                                                                                                                               |
|                                      | Manganese (Mn)                        | 2.3E0 lb/TBtu or 4.0E-2 lb/GWh                |                                                                                                                                                               |
|                                      | Nickel (Ni)                           | 9.0E0 lb/TBtu or 2.0E-1 lb/GWh                |                                                                                                                                                               |
|                                      | Selenium (Se)                         | 1.2E0 lb/Tbtu or 2.0E-2 lb/GWh                |                                                                                                                                                               |
|                                      | b. Hydrogen chloride (HCl)            | 5.0E-3 lb/MMBtu or 8.0E-2 lb/MWh              | For Method 26A, collect a minimum of 0.75 dscm per run; for Method 26, collect a minimum of 120 liters per run. For ASTM D6348-03 <sup>3</sup> or Method 320, |

|  |                                                |                                 |                                                                                                                                                                                                |
|--|------------------------------------------------|---------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |                                                |                                 | sample for a minimum of 1 hour.                                                                                                                                                                |
|  | OR                                             |                                 |                                                                                                                                                                                                |
|  | Sulfur dioxide (SO <sub>2</sub> ) <sup>4</sup> | 3.0E-1 lb/MMBtu or 2.0E0 lb/MWh | SO <sub>2</sub> CEMS.                                                                                                                                                                          |
|  | c. Mercury (Hg)                                | 2.0E-1 lb/TBtu or 2.0E-3 lb/GWh | LEE Testing for 30 days with a sampling period consistent with that given in section 5.2.1 of appendix A to this subpart per Method 30B run or Hg CEMS or sorbent trap monitoring system only. |

<sup>1</sup>For LEE emissions testing for total PM, total HAP metals, individual HAP metals, HCl, and HF, the required minimum sampling volume must be increased nominally by a factor of two.

<sup>2</sup>Gross output.

<sup>3</sup>Incorporated by reference, see §63.14.

<sup>4</sup>You may not use the alternate SO<sub>2</sub> limit if your EGU does not have some form of FGD system and SO<sub>2</sub> CEMS installed.

[81 FR 20192, Apr. 6, 2016]

[↑ Back to Top](#)

### Table 3 to Subpart UUUUU of Part 63—Work Practice Standards

As stated in §§63.9991, you must comply with the following applicable work practice standards:

| <b>If your EGU is . . .</b>                                                                                                                      | <b>You must meet the following . . .</b>                                                                                                                                                                                                                                                    |
|--------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. An existing EGU                                                                                                                               | Conduct a tune-up of the EGU burner and combustion controls at least each 36 calendar months, or each 48 calendar months if neural network combustion optimization software is employed, as specified in §63.10021(e).                                                                      |
| 2. A new or reconstructed EGU                                                                                                                    | Conduct a tune-up of the EGU burner and combustion controls at least each 36 calendar months, or each 48 calendar months if neural network combustion optimization software is employed, as specified in §63.10021(e).                                                                      |
| 3. A coal-fired, liquid oil-fired (excluding limited-use liquid oil-fired subcategory units), or solid oil-derived fuel-fired EGU during startup | a. You have the option of complying using either of the following work practice standards:<br>(1) If you choose to comply using paragraph (1) of the definition of “startup” in §63.10042, you must operate all CMS during startup. Startup means either the first-ever firing of fuel in a |



|  |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
|--|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | <p>boiler for the purpose of producing electricity, or the firing of fuel in a boiler after a shutdown event for any purpose. Startup ends when any of the steam from the boiler is used to generate electricity for sale over the grid or for any other purpose (including on site use). For startup of a unit, you must use clean fuels as defined in §63.10042 for ignition. Once you convert to firing coal, residual oil, or solid oil-derived fuel, you must engage all of the applicable control technologies except dry scrubber and SCR. You must start your dry scrubber and SCR systems, if present, appropriately to comply with relevant standards applicable during normal operation. You must comply with all applicable emissions limits at all times except for periods that meet the applicable definitions of startup and shutdown in this subpart. You must keep records during startup periods. You must provide reports concerning activities and startup periods, as specified in §63.10011(g) and §63.10021(h) and (i).</p> |
|  | <p>(2) If you choose to comply using paragraph (2) of the definition of “startup” in §63.10042, you must operate all CMS during startup. You must also collect appropriate data, and you must calculate the pollutant emission rate for each hour of startup.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
|  | <p>For startup of an EGU, you must use one or a combination of the clean fuels defined in §63.10042 to the maximum extent possible, taking into account considerations such as boiler or control device integrity, throughout the startup period. You must have sufficient clean fuel capacity to engage and operate your PM control device within one hour of adding coal, residual oil, or solid oil-derived fuel to the unit. You must meet the startup period work practice requirements as identified in §63.10020(e).</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
|  | <p>Once you start firing coal, residual oil, or solid oil-derived fuel, you must vent emissions to the main stack(s). You must comply with the applicable emission limits beginning with the hour after startup ends. You must engage and operate your particulate matter control(s) within 1 hour of first firing of coal, residual oil, or solid oil-derived fuel.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|  | <p>You must start all other applicable control devices as expeditiously as possible, considering safety and manufacturer/supplier recommendations, but, in any case, when necessary to comply with other standards made applicable to the EGU by a permit limit or a rule other than this Subpart that require operation of the control devices.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|  | <p>b. Relative to the syngas not fired in the combustion turbine of an IGCC EGU during startup, you must either: (1) Flare the syngas, or (2) route the syngas to duct burners, which may need to be</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |

|                                                                                                                                                   |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
|---------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                                                                                                                   | installed, and route the flue gas from the duct burners to the heat recovery steam generator.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|                                                                                                                                                   | c. If you choose to use just one set of sorbent traps to demonstrate compliance with the applicable Hg emission limit, you must comply with the limit at all times; otherwise, you must comply with the applicable emission limit at all times except for startup and shutdown periods.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|                                                                                                                                                   | d. You must collect monitoring data during startup periods, as specified in §63.10020(a) and (e). You must keep records during startup periods, as provided in §§63.10032 and 63.10021(h). You must provide reports concerning activities and startup periods, as specified in §§63.10011(g), 63.10021(i), and 63.10031.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| 4. A coal-fired, liquid oil-fired (excluding limited-use liquid oil-fired subcategory units), or solid oil-derived fuel-fired EGU during shutdown | <p>You must operate all CMS during shutdown. You must also collect appropriate data, and you must calculate the pollutant emission rate for each hour of shutdown for those pollutants for which a CMS is used.</p> <p>While firing coal, residual oil, or solid oil-derived fuel during shutdown, you must vent emissions to the main stack(s) and operate all applicable control devices and continue to operate those control devices after the cessation of coal, residual oil, or solid oil-derived fuel being fed into the EGU and for as long as possible thereafter considering operational and safety concerns. In any case, you must operate your controls when necessary to comply with other standards made applicable to the EGU by a permit limit or a rule other than this Subpart and that require operation of the control devices.</p> |
|                                                                                                                                                   | If, in addition to the fuel used prior to initiation of shutdown, another fuel must be used to support the shutdown process, that additional fuel must be one or a combination of the clean fuels defined in §63.10042 and must be used to the maximum extent possible, taking into account considerations such as not compromising boiler or control device integrity.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|                                                                                                                                                   | Relative to the syngas not fired in the combustion turbine of an IGCC EGU during shutdown, you must either: (1) Flare the syngas, or (2) route the syngas to duct burners, which may need to be installed, and route the flue gas from the duct burners to the heat recovery steam generator.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|                                                                                                                                                   | You must comply with all applicable emission limits at all times except during startup periods and shutdown periods at which time you must meet this work practice. You must collect monitoring data during shutdown periods, as specified in §63.10020(a). You must keep records during shutdown periods, as provided in §§63.10032 and 63.10021(h). Any fraction of an                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |

|  |                                                                                                                                                                                                   |
|--|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | hour in which shutdown occurs constitutes a full hour of shutdown. You must provide reports concerning activities and shutdown periods, as specified in §§63.10011(g), 63.10021(i), and 63.10031. |
|--|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

[81 FR 20196, Apr. 6, 2016]

[↑ Back to Top](#)

**Table 4 to Subpart UUUUU of Part 63—Operating Limits for EGUs**

As stated in §63.9991, you must comply with the applicable operating limits:

| If you demonstrate compliance using . . . | You must meet these operating limits . . .                                                                                                                                                                                                                                                                                                                                                                                                                  |
|-------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PM CPMS                                   | Maintain the 30-boiler operating day rolling average PM CPMS output determined in accordance with the requirements of §63.10023(b)(2) and obtained during the most recent performance test run demonstrating compliance with the filterable PM, total non-mercury HAP metals (total HAP metals, for liquid oil-fired units), or individual non-mercury HAP metals (individual HAP metals including Hg, for liquid oil-fired units) emissions limitation(s). |

[81 FR 20197, Apr. 6, 2016]

[↑ Back to Top](#)

**Table 5 to Subpart UUUUU of Part 63—Performance Testing Requirements**

As stated in §63.10007, you must comply with the following requirements for performance testing for existing, new or reconstructed affected sources:<sup>1</sup>

<sup>1</sup>Regarding emissions data collected during periods of startup or shutdown, see §§63.10020(b) and (c) and 63.10021(h).

| To conduct a performance test for the following pollutant . . . | Using . . .       | You must perform the following activities, as applicable to your input- or output-based emission limit . . . | Using . . . <sup>2</sup>                             |
|-----------------------------------------------------------------|-------------------|--------------------------------------------------------------------------------------------------------------|------------------------------------------------------|
| 1. Filterable Particulate matter (PM)                           | Emissions Testing | a. Select sampling ports location and the number of traverse points                                          | Method 1 at appendix A-1 to part 60 of this chapter. |

|                                          |                   |                                                                                                                          |                                                                                                                                                                                                                                                                                    |
|------------------------------------------|-------------------|--------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                          |                   | b. Determine velocity and volumetric flow-rate of the stack gas                                                          | Method 2, 2A, 2C, 2F, 2G or 2H at appendix A-1 or A-2 to part 60 of this chapter.                                                                                                                                                                                                  |
|                                          |                   | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                                   | Method 3A or 3B at appendix A-2 to part 60 of this chapter, or ANSI/ASME PTC 19.10-1981. <sup>3</sup>                                                                                                                                                                              |
|                                          |                   | d. Measure the moisture content of the stack gas                                                                         | Method 4 at appendix A-3 to part 60 of this chapter.                                                                                                                                                                                                                               |
|                                          |                   | e. Measure the filterable PM concentration                                                                               | Methods 5 and 5I at appendix A-3 to part 60 of this chapter.<br>For positive pressure fabric filters, Method 5D at appendix A-3 to part 60 of this chapter for filterable PM emissions.<br>Note that the Method 5 or 5I front half temperature shall be 160° ±14 °C (320° ±25 °F). |
|                                          |                   | f. Convert emissions concentration to lb/MMBtu or lb/MWh emissions rates                                                 | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                                        |
|                                          | OR                | OR                                                                                                                       |                                                                                                                                                                                                                                                                                    |
|                                          | PM CEMS           | a. Install, certify, operate, and maintain the PM CEMS                                                                   | Performance Specification 11 at appendix B to part 60 of this chapter and Procedure 2 at appendix F to part 60 of this chapter.                                                                                                                                                    |
|                                          |                   | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                | Part 75 of this chapter and §63.10010(a), (b), (c), and (d).                                                                                                                                                                                                                       |
|                                          |                   | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/MMBtu or lb/MWh emissions rates | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                                        |
| 2. Total or individual non-Hg HAP metals | Emissions Testing | a. Select sampling ports location and the number of traverse points                                                      | Method 1 at appendix A-1 to part 60 of this chapter.                                                                                                                                                                                                                               |
|                                          |                   | b. Determine velocity and                                                                                                | Method 2, 2A, 2C, 2F, 2G or 2H at                                                                                                                                                                                                                                                  |

|                                                       |                   |                                                                                                                                                                                                                                      |                                                                                                                                                                                                                                                                                                                                                        |
|-------------------------------------------------------|-------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                                       |                   | volumetric flow-rate of the stack gas                                                                                                                                                                                                | appendix A-1 or A-2 to part 60 of this chapter.                                                                                                                                                                                                                                                                                                        |
|                                                       |                   | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                                                                                                                                               | Method 3A or 3B at appendix A-2 to part 60 of this chapter, or ANSI/ASME PTC 19.10-1981. <sup>3</sup>                                                                                                                                                                                                                                                  |
|                                                       |                   | d. Measure the moisture content of the stack gas                                                                                                                                                                                     | Method 4 at appendix A-3 to part 60 of this chapter.                                                                                                                                                                                                                                                                                                   |
|                                                       |                   | e. Measure the HAP metals emissions concentrations and determine each individual HAP metals emissions concentration, as well as the total filterable HAP metals emissions concentration and total HAP metals emissions concentration | Method 29 at appendix A-8 to part 60 of this chapter. For liquid oil-fired units, Hg is included in HAP metals and you may use Method 29, Method 30B at appendix A-8 to part 60 of this chapter; for Method 29, you must report the front half and back half results separately. When using Method 29, report metals matrix spike and recovery levels. |
|                                                       |                   | f. Convert emissions concentrations (individual HAP metals, total filterable HAP metals, and total HAP metals) to lb/MMBtu or lb/MWh emissions rates                                                                                 | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                                                                                                            |
| 3. Hydrogen chloride (HCl) and hydrogen fluoride (HF) | Emissions Testing | a. Select sampling ports location and the number of traverse points                                                                                                                                                                  | Method 1 at appendix A-1 to part 60 of this chapter.                                                                                                                                                                                                                                                                                                   |
|                                                       |                   | b. Determine velocity and volumetric flow-rate of the stack gas                                                                                                                                                                      | Method 2, 2A, 2C, 2F, 2G or 2H at appendix A-1 or A-2 to part 60 of this chapter.                                                                                                                                                                                                                                                                      |
|                                                       |                   | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                                                                                                                                               | Method 3A or 3B at appendix A-2 to part 60 of this chapter, or ANSI/ASME PTC 19.10-1981. <sup>3</sup>                                                                                                                                                                                                                                                  |
|                                                       |                   | d. Measure the moisture content of the stack gas                                                                                                                                                                                     | Method 4 at appendix A-3 to part 60 of this chapter.                                                                                                                                                                                                                                                                                                   |
|                                                       |                   | e. Measure the HCl and HF emissions concentrations                                                                                                                                                                                   | Method 26 or Method 26A at appendix A-8 to part 60 of this chapter or Method 320 at appendix A to part 63 of this chapter or                                                                                                                                                                                                                           |

|  |  |  |                                                                                                                                               |
|--|--|--|-----------------------------------------------------------------------------------------------------------------------------------------------|
|  |  |  | ASTM D6348-03 <sup>3</sup> with                                                                                                               |
|  |  |  | (1) the following conditions when using ASTM D6348-03:                                                                                        |
|  |  |  | (A) The test plan preparation and implementation in the Annexes to ASTM D6348-03, Sections A1 through A8 are mandatory;                       |
|  |  |  | (B) For ASTM D6348-03 Annex A5 (Analyte Spiking Technique), the percent (%) R must be determined for each target analyte (see Equation A5.5); |
|  |  |  | (C) For the ASTM D6348-03 test data to be acceptable for a target analyte, %R must be $70\% \geq R \leq 130\%$ ; and                          |

3.e.1(D) The %R value for each compound must be reported in the test report and all field measurements corrected with the calculated %R value for that compound using the following equation:

$$\text{Reported Result} = \frac{(\text{Measured Concentration in Stack})}{\%R} \times 100$$

[View or download PDF](#)

and

| <b>To conduct a performance test for the following pollutant . . . (cont'd)</b> | <b>Using . . . (cont'd)</b> | <b>You must perform the following activities, as applicable to your input- or output-based emission limit . . . (cont'd)</b> | <b>Using . . .<sup>2</sup> (cont'd)</b>                                                                          |
|---------------------------------------------------------------------------------|-----------------------------|------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------|
|                                                                                 |                             |                                                                                                                              | (2) spiking levels nominally no greater than two times the level corresponding to the applicable emission limit. |
|                                                                                 |                             |                                                                                                                              | Method 26A must be used if there are entrained water droplets in the exhaust stream.                             |
|                                                                                 |                             | f. Convert emissions concentration to                                                                                        | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter,                                       |

|                 |                    |                                                                                                                          |                                                                                                                                                                                                                          |
|-----------------|--------------------|--------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                 |                    | lb/MMBtu or lb/MWh emissions rates                                                                                       | or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                                                         |
|                 | OR                 | OR                                                                                                                       |                                                                                                                                                                                                                          |
|                 | HCl and/or HF CEMS | a. Install, certify, operate, and maintain the HCl or HF CEMS                                                            | Appendix B of this subpart.                                                                                                                                                                                              |
|                 |                    | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                | Part 75 of this chapter and §63.10010(a), (b), (c), and (d).                                                                                                                                                             |
|                 |                    | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/MMBtu or lb/MWh emissions rates | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                              |
| 4. Mercury (Hg) | Emissions Testing  | a. Select sampling ports location and the number of traverse points                                                      | Method 1 at appendix A-1 to part 60 of this chapter or Method 30B at Appendix A-8 for Method 30B point selection.                                                                                                        |
|                 |                    | b. Determine velocity and volumetric flow-rate of the stack gas                                                          | Method 2, 2A, 2C, 2F, 2G or 2H at appendix A-1 or A-2 to part 60 of this chapter.                                                                                                                                        |
|                 |                    | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                                   | Method 3A or 3B at appendix A-1 to part 60 of this chapter, or ANSI/ASME PTC 19.10-1981. <sup>3</sup>                                                                                                                    |
|                 |                    | d. Measure the moisture content of the stack gas                                                                         | Method 4 at appendix A-3 to part 60 of this chapter.                                                                                                                                                                     |
|                 |                    | e. Measure the Hg emission concentration                                                                                 | Method 30B at appendix A-8 to part 60 of this chapter, ASTM D6784, <sup>3</sup> or Method 29 at appendix A-8 to part 60 of this chapter; for Method 29, you must report the front half and back half results separately. |
|                 |                    | f. Convert emissions concentration to                                                                                    | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter,                                                                                                                                               |

|  |                                |                                                                                                                         |                                                                                                                                                                                     |
|--|--------------------------------|-------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |                                | lb/TBtu or lb/GWh emission rates                                                                                        | or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                    |
|  | OR                             | OR                                                                                                                      |                                                                                                                                                                                     |
|  | Hg CEMS                        | a. Install, certify, operate, and maintain the CEMS                                                                     | Sections 3.2.1 and 5.1 of appendix A of this subpart.                                                                                                                               |
|  |                                | b. Install, certify, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems               | Part 75 of this chapter and §63.10010(a), (b), (c), and (d).                                                                                                                        |
|  |                                | c. Convert hourly emissions concentrations to 30 boiler operating day rolling average lb/TBtu or lb/GWh emissions rates | Section 6 of appendix A to this subpart.                                                                                                                                            |
|  | OR                             | OR                                                                                                                      |                                                                                                                                                                                     |
|  | Sorbent trap monitoring system | a. Install, certify, operate, and maintain the sorbent trap monitoring system                                           | Sections 3.2.2 and 5.2 of appendix A to this subpart.                                                                                                                               |
|  |                                | b. Install, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                        | Part 75 of this chapter and §63.10010(a), (b), (c), and (d).                                                                                                                        |
|  |                                | c. Convert emissions concentrations to 30 boiler operating day rolling average lb/TBtu or lb/GWh emissions rates        | Section 6 of appendix A to this subpart.                                                                                                                                            |
|  | OR                             | OR                                                                                                                      |                                                                                                                                                                                     |
|  | LEE testing                    | a. Select sampling ports location and the number of traverse points                                                     | Single point located at the 10% centroidal area of the duct at a port location per Method 1 at appendix A-1 to part 60 of this chapter or Method 30B at Appendix A-8 for Method 30B |



|                                      |                      |                                                                                                                            |                                                                                                                                                                                                                                                                       |
|--------------------------------------|----------------------|----------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                      |                      |                                                                                                                            | point selection.                                                                                                                                                                                                                                                      |
|                                      |                      | b. Determine velocity and volumetric flow-rate of the stack gas                                                            | Method 2, 2A, 2C, 2F, 2G, or 2H at appendix A-1 or A-2 to part 60 of this chapter or flow monitoring system certified per appendix A of this subpart.                                                                                                                 |
|                                      |                      | c. Determine oxygen and carbon dioxide concentrations of the stack gas                                                     | Method 3A or 3B at appendix A-1 to part 60 of this chapter, or ANSI/ASME PTC 19.10-1981, <sup>3</sup> or diluent gas monitoring systems certified according to part 75 of this chapter.                                                                               |
|                                      |                      | d. Measure the moisture content of the stack gas                                                                           | Method 4 at appendix A-3 to part 60 of this chapter, or moisture monitoring systems certified according to part 75 of this chapter.                                                                                                                                   |
|                                      |                      | e. Measure the Hg emission concentration                                                                                   | Method 30B at appendix A-8 to part 60 of this chapter; perform a 30 operating day test, with a maximum of 10 operating days per run ( <i>i.e.</i> , per pair of sorbent traps) or sorbent trap monitoring system or Hg CEMS certified per appendix A of this subpart. |
|                                      |                      | f. Convert emissions concentrations from the LEE test to lb/TBtu or lb/GWh emissions rates                                 | Method 19 F-factor methodology at appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)).                                                                                                           |
|                                      |                      | g. Convert average lb/TBtu or lb/GWh Hg emission rate to lb/year, if you are attempting to meet the 29.0 lb/year threshold | Potential maximum annual heat input in TBtu or potential maximum electricity generated in GWh.                                                                                                                                                                        |
| 5. Sulfur dioxide (SO <sub>2</sub> ) | SO <sub>2</sub> CEMS | a. Install, certify, operate, and maintain the CEMS                                                                        | Part 75 of this chapter and §63.10010(a) and (f).                                                                                                                                                                                                                     |
|                                      |                      | b. Install, operate, and maintain the diluent gas, flow rate, and/or moisture monitoring systems                           | Part 75 of this chapter and §63.10010(a), (b), (c), and (d).                                                                                                                                                                                                          |
|                                      |                      | c. Convert hourly                                                                                                          | Method 19 F-factor methodology at                                                                                                                                                                                                                                     |

|  |  |                                                                                                        |                                                                                                                           |
|--|--|--------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------|
|  |  | emissions concentrations to 30 boiler operating day rolling average lb/MMBtu or lb/MWh emissions rates | appendix A-7 to part 60 of this chapter, or calculate using mass emissions rate and gross output data (see §63.10007(e)). |
|--|--|--------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------|

<sup>2</sup>See Tables 1 and 2 to this subpart for required sample volumes and/or sampling run times.

<sup>3</sup>Incorporated by reference, see §63.14.

[83 FR 56727, Nov. 14, 2018]

[↑ Back to Top](#)

**Table 6 to Subpart UUUUU of Part 63—Establishing PM CPMS Operating Limits**

As stated in §63.10007, you must comply with the following requirements for establishing operating limits:

| <b>If you have an applicable emission limit for . . .</b>                                                                                                  | <b>And you choose to establish PM CPMS operating limits, you must . . .</b>                                                          | <b>And . . .</b>                                                                                                           | <b>Using . . .</b>                                               | <b>According to the following procedures . . .</b>                                                                                                                                                                                                                                                                                                                                                                                                                               |
|------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Filterable Particulate matter (PM), total non-mercury HAP metals, individual non-mercury HAP metals, total HAP metals, or individual HAP metals for an EGU | Install, certify, maintain, and operate a PM CPMS for monitoring emissions discharged to the atmosphere according to §63.10010(h)(1) | Establish a site-specific operating limit in units of PM CPMS output signal (e.g., milliamps, mg/acm, or other raw signal) | Data from the PM CPMS and the PM or HAP metals performance tests | <ol style="list-style-type: none"> <li>1. Collect PM CPMS output data during the entire period of the performance tests.</li> <li>2. Record the average hourly PM CPMS output for each test run in the performance test.</li> <li>3. Determine the PM CPMS operating limit in accordance with the requirements of §63.10023(b)(2) from data obtained during the performance test demonstrating compliance with the filterable PM or HAP metals emissions limitations.</li> </ol> |

[↑ Back to Top](#)

**Table 7 to Subpart UUUUU of Part 63—Demonstrating Continuous Compliance**

As stated in §63.10021, you must show continuous compliance with the emission limitations for affected sources according to the following:

| <p><b>If you use one of the following to meet applicable emissions limits, operating limits, or work practice standards . . .</b></p>                                                                                                                                                                                     | <p><b>You demonstrate continuous compliance by . . .</b></p>                                                                                                                                                                                                                                                                                                                                 |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>1. CEMS to measure filterable PM, SO<sub>2</sub>, HCl, HF, or Hg emissions, or using a sorbent trap monitoring system to measure Hg</p>                                                                                                                                                                                | <p>Calculating the 30- (or 90-) boiler operating day rolling arithmetic average emissions rate in units of the applicable emissions standard basis at the end of each boiler operating day using all of the quality assured hourly average CEMS or sorbent trap data for the previous 30- (or 90-) boiler operating days, excluding data recorded during periods of startup or shutdown.</p> |
| <p>2. PM CPMS to measure compliance with a parametric operating limit</p>                                                                                                                                                                                                                                                 | <p>Calculating the 30- (or 90-) boiler operating day rolling arithmetic average of all of the quality assured hourly average PM CPMS output data (e.g., milliamps, PM concentration, raw data signal) collected for all operating hours for the previous 30- (or 90-) boiler operating days, excluding data recorded during periods of startup or shutdown.</p>                              |
| <p>3. Site-specific monitoring using CMS for liquid oil-fired EGUs for HCl and HF emission limit monitoring</p>                                                                                                                                                                                                           | <p>If applicable, by conducting the monitoring in accordance with an approved site-specific monitoring plan.</p>                                                                                                                                                                                                                                                                             |
| <p>4. Quarterly performance testing for coal-fired, solid oil derived fired, or liquid oil-fired EGUs to measure compliance with one or more non-PM (or its alternative emission limits) applicable emissions limit in Table 1 or 2, or PM (or its alternative emission limits) applicable emissions limit in Table 2</p> | <p>Calculating the results of the testing in units of the applicable emissions standard.</p>                                                                                                                                                                                                                                                                                                 |
| <p>5. Conducting periodic performance tune-ups of your EGU(s)</p>                                                                                                                                                                                                                                                         | <p>Conducting periodic performance tune-ups of your EGU(s), as specified in §63.10021(e).</p>                                                                                                                                                                                                                                                                                                |
| <p>6. Work practice standards for coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGUs during startup</p>                                                                                                                                                                                                   | <p>Operating in accordance with Table 3.</p>                                                                                                                                                                                                                                                                                                                                                 |

|                                                                                                                   |                                       |
|-------------------------------------------------------------------------------------------------------------------|---------------------------------------|
| 7. Work practice standards for coal-fired, liquid oil-fired, or solid oil-derived fuel-fired EGUs during shutdown | Operating in accordance with Table 3. |
|-------------------------------------------------------------------------------------------------------------------|---------------------------------------|

[78 FR 24092, Apr. 24, 2013]

[↑ Back to Top](#)

**Table 8 to Subpart UUUUU of Part 63—Reporting Requirements**

As stated in §63.10031, you must comply with the following requirements for reports:

| <b>You must submit a</b> | <b>The report must contain . . .</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              | <b>You must submit the report . . .</b>                     |
|--------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| 1. Compliance report     | a. Information required in §63.10031(c)(1) through (9); and                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | Semiannually according to the requirements in §63.10031(b). |
|                          | b. If there are no deviations from any emission limitation (emission limit and operating limit) that applies to you and there are no deviations from the requirements for work practice standards in Table 3 to this subpart that apply to you, a statement that there were no deviations from the emission limitations and work practice standards during the reporting period. If there were no periods during which the CMSs, including continuous emissions monitoring system, and operating parameter monitoring systems, were out-of-control as specified in §63.8(c)(7), a statement that there were no periods during which the CMSs were out-of-control during the reporting period; and |                                                             |
|                          | c. If you have a deviation from any emission limitation (emission limit and operating limit) or work practice standard during the reporting period, the report must contain the information in §63.10031(d). If there were periods during which the CMSs, including continuous emissions monitoring systems and continuous parameter monitoring systems, were out-of-control, as specified in §63.8(c)(7), the report must contain the information in §63.10031(e).                                                                                                                                                                                                                               |                                                             |

[81 FR 20201, Apr. 6, 2016]

[↑ Back to Top](#)

**Table 9 to Subpart UUUUU of Part 63—Applicability of General Provisions to Subpart UUUUU**

As stated in §63.10040, you must comply with the applicable General Provisions according to the following:

| Citation                                                                                | Subject                                                                                                     | Applies to subpart UUUUU                                                  |
|-----------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------|
| §63.1                                                                                   | Applicability                                                                                               | Yes.                                                                      |
| §63.2                                                                                   | Definitions                                                                                                 | Yes. Additional terms defined in §63.10042.                               |
| §63.3                                                                                   | Units and Abbreviations                                                                                     | Yes.                                                                      |
| §63.4                                                                                   | Prohibited Activities and Circumvention                                                                     | Yes.                                                                      |
| §63.5                                                                                   | Preconstruction Review and Notification Requirements                                                        | Yes.                                                                      |
| §63.6(a), (b)(1) through (5), (b)(7), (c), (f)(2) and (3), (h)(2) through (9), (i), (j) | Compliance with Standards and Maintenance Requirements                                                      | Yes.                                                                      |
| §63.6(e)(1)(i)                                                                          | General Duty to minimize emissions                                                                          | No. See §63.10000(b) for general duty requirement.                        |
| §63.6(e)(1)(ii)                                                                         | Requirement to correct malfunctions ASAP                                                                    | No.                                                                       |
| §63.6(e)(3)                                                                             | SSM Plan requirements                                                                                       | No.                                                                       |
| §63.6(f)(1)                                                                             | SSM exemption                                                                                               | No.                                                                       |
| §63.6(h)(1)                                                                             | SSM exemption                                                                                               | No.                                                                       |
| §63.6(g)                                                                                | Compliance with Standards and Maintenance Requirements, Use of an alternative non-opacity emission standard | Yes. See §§63.10011(g)(4) and 63.10021(h)(4) for additional requirements. |
| §63.7(e)(1)                                                                             | Performance testing                                                                                         | No. See §63.10007.                                                        |
| §63.8                                                                                   | Monitoring Requirements                                                                                     | Yes.                                                                      |

|                                                      |                                                                    |                                                                                                                                                                                                                                                                                                                                                                                                    |
|------------------------------------------------------|--------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| §63.8(c)(1)(i)                                       | General duty to minimize emissions and CMS operation               | No. See §63.10000(b) for general duty requirement.                                                                                                                                                                                                                                                                                                                                                 |
| §63.8(c)(1)(iii)                                     | Requirement to develop SSM Plan for CMS                            | No.                                                                                                                                                                                                                                                                                                                                                                                                |
| §63.8(d)(3)                                          | Written procedures for CMS                                         | Yes, except for last sentence, which refers to an SSM plan. SSM plans are not required.                                                                                                                                                                                                                                                                                                            |
| §63.9                                                | Notification Requirements                                          | Yes, except (1) for the 60-day notification prior to conducting a performance test in §63.9(e); instead use a 30-day notification period per §63.10030(d), (2) the notification of the CMS performance evaluation in §63.9(g)(1) is limited to RATAs, and (3) the information required per §63.9(h)(2)(i); instead provide the information required per §63.10030(e)(1) through (e)(6) and (e)(8). |
| §63.10(a), (b)(1), (c), (d)(1) and (2), (e), and (f) | Recordkeeping and Reporting Requirements                           | Yes, except for the requirements to submit written reports under §63.10(e)(3)(v).                                                                                                                                                                                                                                                                                                                  |
| §63.10(b)(2)(i)                                      | Recordkeeping of occurrence and duration of startups and shutdowns | No.                                                                                                                                                                                                                                                                                                                                                                                                |
| §63.10(b)(2)(ii)                                     | Recordkeeping of malfunctions                                      | No. See §63.10001 for recordkeeping of (1) occurrence and duration and (2) actions taken during malfunction.                                                                                                                                                                                                                                                                                       |
| §63.10(b)(2)(iii)                                    | Maintenance records                                                | Yes.                                                                                                                                                                                                                                                                                                                                                                                               |
| §63.10(b)(2)(iv)                                     | Actions taken to minimize emissions during SSM                     | No.                                                                                                                                                                                                                                                                                                                                                                                                |
| §63.10(b)(2)(v)                                      | Actions taken to minimize emissions during SSM                     | No.                                                                                                                                                                                                                                                                                                                                                                                                |
| §63.10(b)(2)(vi)                                     | Recordkeeping for CMS malfunctions                                 | Yes.                                                                                                                                                                                                                                                                                                                                                                                               |
| §63.10(b)(2)(vii) through (ix)                       | Other CMS                                                          | Yes.                                                                                                                                                                                                                                                                                                                                                                                               |

|                                                                                                                                                    |                                                                                                  |                                                                           |
|----------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------|
|                                                                                                                                                    | requirements                                                                                     |                                                                           |
| §63.10(b)(3) and (d)(3) through (5)                                                                                                                |                                                                                                  | No.                                                                       |
| §63.10(c)(7)                                                                                                                                       | Additional recordkeeping requirements for CMS—identifying exceedances and excess emissions       | Yes.                                                                      |
| §63.10(c)(8)                                                                                                                                       | Additional recordkeeping requirements for CMS—identifying exceedances and excess emissions       | Yes.                                                                      |
| §63.10(c)(10)                                                                                                                                      | Recording nature and cause of malfunctions                                                       | No. See §63.10032(g) and (h) for malfunctions recordkeeping requirements. |
| §63.10(c)(11)                                                                                                                                      | Recording corrective actions                                                                     | No. See §63.10032(g) and (h) for malfunctions recordkeeping requirements. |
| §63.10(c)(15)                                                                                                                                      | Use of SSM Plan                                                                                  | No.                                                                       |
| §63.10(d)(5)                                                                                                                                       | SSM reports                                                                                      | No. See §63.10021(h) and (i) for malfunction reporting requirements.      |
| §63.11                                                                                                                                             | Control Device Requirements                                                                      | No.                                                                       |
| §63.12                                                                                                                                             | State Authority and Delegation                                                                   | Yes.                                                                      |
| §§63.13 through 63.16                                                                                                                              | Addresses, Incorporation by Reference, Availability of Information, Performance Track Provisions | Yes.                                                                      |
| §§63.1(a)(5),(a)(7) through (9), (b)(2), (c)(3) and (4), (d), 63.6(b)(6), (c)(3) and (4), (d), (e)(2), (e)(3)(ii), (h)(3), (h)(5)(iv), 63.8(a)(3), | Reserved                                                                                         | No.                                                                       |

|                                                      |  |  |
|------------------------------------------------------|--|--|
| 63.9(b)(3), (h)(4), 63.10(c)(2) through (4), (c)(9). |  |  |
|------------------------------------------------------|--|--|

[81 FR 20202, Apr. 6, 2016]

[↑ Back to Top](#)

## Appendix A to Subpart UUUUU of Part 63—Hg Monitoring Provisions

### 1. GENERAL PROVISIONS

1.1 *Applicability.* These monitoring provisions apply to the measurement of total vapor phase mercury (Hg) in emissions from electric utility steam generating units, using either a mercury continuous emission monitoring system (Hg CEMS) or a sorbent trap monitoring system. The Hg CEMS or sorbent trap monitoring system must be capable of measuring the total vapor phase mercury in units of the applicable emissions standard (e.g., lb/TBtu or lb/GWh), regardless of speciation.

1.2 *Initial Certification and Recertification Procedures.* The owner or operator of an affected unit that uses a Hg CEMS or a sorbent trap monitoring system together with other necessary monitoring components to account for Hg emissions in units of the applicable emissions standard shall comply with the initial certification and recertification procedures in section 4 of this appendix.

1.3 *Quality Assurance and Quality Control Requirements.* The owner or operator of an affected unit that uses a Hg CEMS or a sorbent trap monitoring system together with other necessary monitoring components to account for Hg emissions in units of the applicable emissions standard shall meet the applicable quality assurance requirements in section 5 of this appendix.

1.4 *Missing Data Procedures.* The owner or operator of an affected unit is not required to substitute for missing data from Hg CEMS or sorbent trap monitoring systems. Any process operating hour for which quality-assured Hg concentration data are not obtained is counted as an hour of monitoring system downtime.

### 2. MONITORING OF HG EMISSIONS

2.1 *Monitoring System Installation Requirements.* Flue gases from the affected units under this subpart vent to the atmosphere through a variety of exhaust configurations including single stacks, common stack configurations, and multiple stack configurations. For each of these configurations, §63.10010(a) specifies the appropriate location(s) at which to install continuous monitoring systems (CMS). These CMS installation provisions apply to the Hg CEMS, sorbent trap monitoring systems, and other continuous monitoring systems that provide data for the Hg emissions calculations in section 6.2 of this appendix.

2.2 *Primary and Backup Monitoring Systems.* In the electronic monitoring plan described in section 7.1.1.2.1 of this appendix, you must designate a primary Hg CEMS or sorbent trap monitoring system. The primary system must be used to report hourly Hg concentration values when the system is able to provide quality-assured data, *i.e.*, when the system is “in control”. However, to increase data availability in the event of a primary monitoring system outage, you may install, operate, maintain, and calibrate backup monitoring systems, as follows:



2.2.1 *Redundant Backup Systems.* A redundant backup monitoring system may be either a separate Hg CEMS with its own probe, sample interface, and analyzer, or a separate sorbent trap monitoring system. A redundant backup system is one that is permanently installed at the unit or stack location, and is kept on “hot standby” in case the primary monitoring system is unable to provide quality-assured data. A redundant backup system must be represented as a unique monitoring system in the electronic monitoring plan. Each redundant backup monitoring system must be certified according to the applicable provisions in section 4 of this appendix and must meet the applicable on-going QA requirements in section 5 of this appendix.

2.2.2 *Non-redundant Backup Monitoring Systems.* A non-redundant backup monitoring system is a separate Hg CEMS or sorbent trap system that has been certified at a particular unit or stack location, but is not permanently installed at that location. Rather, the system is kept on “cold standby” and may be reinstalled in the event of a primary monitoring system outage. A non-redundant backup monitoring system must be represented as a unique monitoring system in the electronic monitoring plan. Non-redundant backup Hg CEMS must complete the same certification tests as the primary monitoring system, with one exception. The 7-day calibration error test is not required for a non-redundant backup Hg CEMS. Except as otherwise provided in section 2.2.4.5 of this appendix, a non-redundant backup monitoring system may only be used for 720 hours per year at a particular unit or stack location.

2.2.3 *Temporary Like-kind Replacement Analyzers.* When a primary Hg analyzer needs repair or maintenance, you may temporarily install a like-kind replacement analyzer, to minimize data loss. Except as otherwise provided in section 2.2.4.5 of this appendix, a temporary like-kind replacement analyzer may only be used for 720 hours per year at a particular unit or stack location. The analyzer must be represented as a component of the primary Hg CEMS, and must be assigned a 3-character component ID number, beginning with the prefix “LK”.

2.2.4 *Quality Assurance Requirements for Non-redundant Backup Monitoring Systems and Temporary Like-kind Replacement Analyzers.* To quality-assure the data from non-redundant backup Hg monitoring systems and temporary like-kind replacement Hg analyzers, the following provisions apply:

2.2.4.1 When a certified non-redundant backup sorbent trap monitoring system is brought into service, you must follow the procedures for routine day-to-day operation of the system, in accordance with Performance Specification (PS) 12B in appendix B to part 60 of this chapter.

2.2.4.2 When a certified non-redundant backup Hg CEMS or a temporary like-kind replacement Hg analyzer is brought into service, a calibration error test and a linearity check must be performed and passed. A single point system integrity check is also required, unless a NIST-traceable source of oxidized Hg was used for the calibration error test.

2.2.4.3 Each non-redundant backup Hg CEMS or temporary like-kind replacement Hg analyzer shall comply with all required daily, weekly, and quarterly quality-assurance test requirements in section 5 of this appendix, for as long as the system or analyzer remains in service.

2.2.4.4 For the routine, on-going quality-assurance of a non-redundant backup Hg monitoring system, a relative accuracy test audit (RATA) must be performed and passed at least once every 8 calendar quarters at the unit or stack location(s) where the system will be used.

2.2.4.5 To use a non-redundant backup Hg monitoring system or a temporary like-kind replacement analyzer for more than 720 hours per year at a particular unit or stack location, a RATA must first be performed and passed at that location.

### 3. MERCURY EMISSIONS MEASUREMENT METHODS

The following definitions, equipment specifications, procedures, and performance criteria are applicable to the measurement of vapor-phase Hg emissions from electric utility steam generating units, under relatively low-dust conditions (*i.e.*, sampling in the stack or duct after all pollution control devices). The analyte measured by these procedures and specifications is total vapor-phase Hg in the flue gas, which represents the sum of elemental Hg (Hg<sup>0</sup>, CAS Number 7439-97-6) and oxidized forms of Hg.

#### 3.1 Definitions.

3.1.1 *Mercury Continuous Emission Monitoring System or Hg CEMS* means all of the equipment used to continuously determine the total vapor phase Hg concentration. The measurement system may include the following major subsystems: sample acquisition, Hg<sup>+2</sup> to Hg<sup>0</sup> converter, sample transport, sample conditioning, flow control/gas manifold, gas analyzer, and data acquisition and handling system (DAHS). Hg CEMS may be nominally real-time or time-integrated, batch sampling systems that sample the gas on an intermittent basis and concentrate on a collection medium before intermittent analysis and reporting.

3.1.2 *Sorbent Trap Monitoring System* means the equipment required to monitor Hg emissions continuously by using paired sorbent traps containing iodated charcoal (IC) or other suitable sorbent medium. The monitoring system consists of a probe, paired sorbent traps, an umbilical line, moisture removal components, an airtight sample pump, a gas flow meter, and an automated data acquisition and handling system. The system samples the stack gas at a constant proportional rate relative to the stack gas volumetric flow rate. The sampling is a batch process. The average Hg concentration in the stack gas for the sampling period is determined, in units of micrograms per dry standard cubic meter (µg/dscm), based on the sample volume measured by the gas flow meter and the mass of Hg collected in the sorbent traps.

3.1.3 *NIST* means the National Institute of Standards and Technology, located in Gaithersburg, Maryland.

3.1.4 *NIST-Traceable Elemental Hg Standards* means either: compressed gas cylinders having known concentrations of elemental Hg, which have been prepared according to the “EPA Traceability Protocol for Assay and Certification of Gaseous Calibration Standards”; or calibration gases having known concentrations of elemental Hg, produced by a generator that meets the performance requirements of the “EPA Traceability Protocol for Qualification and Certification of Elemental Mercury Gas Generators” or an interim version of that protocol.

3.1.5 *NIST-Traceable Source of Oxidized Hg* means a generator that is capable of providing known concentrations of vapor phase mercuric chloride (HgCl<sub>2</sub>), and that meets the performance requirements of the “EPA Traceability Protocol for Qualification and Certification of Mercuric Chloride Gas Generators” or an interim version of that protocol.

3.1.6 *Calibration Gas* means a NIST-traceable gas standard containing a known concentration of elemental or oxidized Hg that is produced and certified in accordance with an EPA traceability protocol.

3.1.7 *Span Value* means a conservatively high estimate of the Hg concentrations to be measured by a CEMS. The span value of a Hg CEMS should be set to approximately twice the concentration corresponding to the emission standard, rounded off as appropriate (see section 3.2.1.4.2 of this appendix).

3.1.8 *Zero-Level Gas* means calibration gas containing a Hg concentration that is below the level detectable by the Hg gas analyzer in use.

3.1.9 *Low-Level Gas* means calibration gas with a concentration that is 20 to 30 percent of the span value.

3.1.10 *Mid-Level Gas* means calibration gas with a concentration that is 50 to 60 percent of the span value.

3.1.11 *High-Level Gas* means calibration gas with a concentration that is 80 to 100 percent of the span value.

3.1.12 *Calibration Error Test* means a test designed to assess the ability of a Hg CEMS to measure the concentrations of calibration gases accurately. A zero-level gas and an upscale gas are required for this test. For the upscale gas, either a mid-level gas or a high-level gas may be used, and the gas may either be an elemental or oxidized Hg standard.

3.1.13 *Linearity Check* means a test designed to determine whether the response of a Hg analyzer is linear across its measurement range. Three elemental Hg calibration gas standards (*i.e.*, low, mid, and high-level gases) are required for this test.

3.1.14 *System Integrity Check* means a test designed to assess the transport and measurement of oxidized Hg by a Hg CEMS. Oxidized Hg standards are used for this test. For a three-level system integrity check, low, mid, and high-level calibration gases are required. For a single-level check, either a mid-level gas or a high-level gas may be used.

3.1.15 *Cycle Time Test* means a test designed to measure the amount of time it takes for a Hg CEMS, while operating normally, to respond to a known step change in gas concentration. For this test, a zero gas and a high-level gas are required. The high-level gas may be either an elemental or an oxidized Hg standard.

3.1.16 *Relative Accuracy Test Audit or RATA* means a series of nine or more test runs, directly comparing readings from a Hg CEMS or sorbent trap monitoring system to measurements made with a reference stack test method. The relative accuracy (RA) of the monitoring system is expressed as the absolute mean difference between the monitoring system and reference method measurements plus the absolute value of the 2.5 percent error confidence coefficient, divided by the mean value of the reference method measurements.

3.1.17 *Unit Operating Hour* means a clock hour in which a unit combusts any fuel, either for part of the hour or for the entire hour.

3.1.18 *Stack Operating Hour* means a clock hour in which gases flow through a particular monitored stack or duct (either for part of the hour or for the entire hour), while the associated unit(s) are combusting fuel.

3.1.19 *Operating Day* means a calendar day in which a source combusts any fuel.

3.1.20 *Quality Assurance (QA) Operating Quarter* means a calendar quarter in which there are at least 168 unit or stack operating hours (as defined in this section).

3.1.21 *Grace Period* means a specified number of unit or stack operating hours after the deadline for a required quality-assurance test of a continuous monitor has passed, in which the test may be performed and passed without loss of data.

### 3.2 *Continuous Monitoring Methods.*

3.2.1 *Hg CEMS.* A typical Hg CEMS is shown in Figure A-1. The CEMS in Figure A-1 is a dilution extractive system, which measures Hg concentration on a wet basis, and is the most commonly-used type of Hg CEMS. Other system designs may be used, provided that the CEMS meets the performance specifications in section 4.1.1 of this appendix.

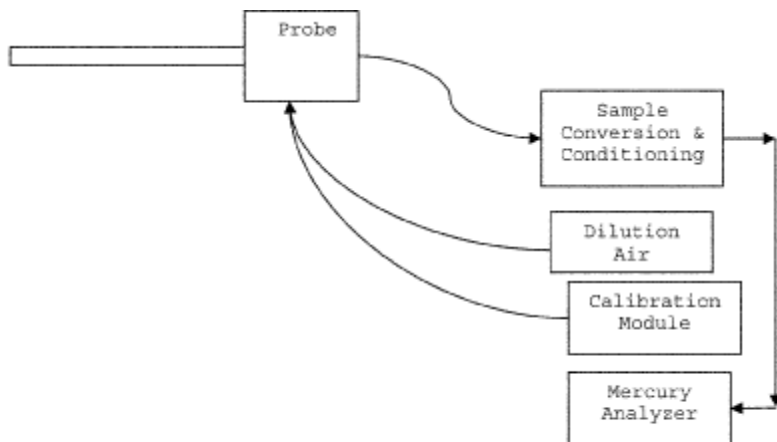


FIGURE A-1. TYPICAL MERCURY CEMS

[View or download PDF](#)

#### 3.2.1.1 *Equipment Specifications.*

3.2.1.1.1 *Materials of Construction.* All wetted sampling system components, including probe components prior to the point at which the calibration gas is introduced, must be chemically inert to all Hg species. Materials such as perfluoroalkoxy (PFA) Teflon™, quartz, and treated stainless steel (SS) are examples of such materials.

3.2.1.1.2 *Temperature Considerations.* All system components prior to the Hg<sup>+2</sup> to Hg<sup>0</sup> converter must be maintained at a sample temperature above the acid gas dew point.

#### 3.2.1.1.3 *Measurement System Components.*

3.2.1.1.3.1 *Sample Probe.* The probe must be made of the appropriate materials as noted in paragraph 3.2.1.1.1 of this section, heated when necessary, as described in paragraph 3.2.1.1.3.4 of this section, and configured with ports for introduction of calibration gases.

3.2.1.1.3.2 *Filter or Other Particulate Removal Device.* The filter or other particulate removal device is part of the measurement system, must be made of appropriate materials, as noted in paragraph 3.2.1.1.1 of this section, and must be included in all system tests.

3.2.1.1.3.3 *Sample Line.* The sample line that connects the probe to the converter, conditioning system, and analyzer must be made of appropriate materials, as noted in paragraph 3.2.1.1.1 of this section.

3.2.1.1.3.4 *Conditioning Equipment.* For wet basis systems, such as the one shown in Figure A-1, the sample must be kept above its dew point either by: heating the sample line and all sample transport components up to the inlet of the analyzer (and, for hot-wet extractive systems, also heating the analyzer); or diluting the sample prior to analysis using a dilution probe system. The components required for these operations are considered to be conditioning equipment. For dry basis measurements, a condenser, dryer or other suitable device is required to remove moisture continuously from the sample gas, and any equipment needed to heat the probe or sample line to avoid condensation prior to the moisture removal component is also required.

3.2.1.1.3.5 *Sampling Pump.* A pump is needed to push or pull the sample gas through the system at a flow rate sufficient to minimize the response time of the measurement system. If a mechanical sample pump is used and its surfaces are in contact with the sample gas prior to detection, the pump must be leak free and must be constructed of a material that is non-reactive to the gas being sampled (see paragraph 3.2.1.1.1 of this section). For dilution-type measurement systems, such as the system shown in Figure A-1, an ejector pump (eductor) may be used to create a sufficient vacuum that sample gas will be drawn through a critical orifice at a constant rate. The ejector pump must be constructed of any material that is non-reactive to the gas being sampled.

3.2.1.1.3.6 *Calibration Gas System(s).* Design and equip each Hg CEMS to permit the introduction of known concentrations of elemental Hg and HgCl<sub>2</sub> separately, at a point preceding the sample extraction filtration system, such that the entire measurement system can be checked. The calibration gas system(s) must be designed so that the flow rate exceeds the sampling system flow requirements and that the gas is delivered to the CEMS at atmospheric pressure.

3.2.1.1.3.7 *Sample Gas Delivery.* The sample line may feed directly to either a converter, a by-pass valve (for Hg speciating systems), or a sample manifold. All valve and/or manifold components must be made of material that is non-reactive to the gas sampled and the calibration gas, and must be configured to safely discharge any excess gas.

3.2.1.1.3.8 *Hg Analyzer.* An instrument is required that continuously measures the total vapor phase Hg concentration in the gas stream. The analyzer may also be capable of measuring elemental and oxidized Hg separately.

3.2.1.1.3.9 *Data Recorder.* A recorder, such as a computerized data acquisition and handling system (DAHS), digital recorder, or data logger, is required for recording measurement data.

### 3.2.1.2 *Reagents and Standards.*

3.2.1.2.1 *NIST Traceability.* Only NIST-certified or NIST-traceable calibration gas standards and reagents (as defined in paragraphs 3.1.4 and 3.1.5 of this appendix), and including, but not limited to, Hg gas generators and Hg gas cylinders, shall be used for the tests and procedures required under this subpart. Calibration gases with known concentrations of Hg<sup>0</sup> and HgCl<sub>2</sub> are required. Special reagents and equipment may be needed to prepare the Hg<sup>0</sup> and HgCl<sub>2</sub> gas standards (e.g., NIST-traceable solutions of HgCl<sub>2</sub> and gas generators equipped with mass flow controllers).

### 3.2.1.2.2 *Required Calibration Gas Concentrations.*

3.2.1.2.2.1 *Zero-Level Gas*. A zero-level calibration gas with a Hg concentration below the level detectable by the Hg analyzer is required for calibration error tests and cycle time tests of the CEMS.

3.2.1.2.2.2 *Low-Level Gas*. A low-level calibration gas with a Hg concentration of 20 to 30 percent of the span value is required for linearity checks and 3-level system integrity checks of the CEMS. Elemental Hg standards are required for the linearity checks and oxidized Hg standards are required for the system integrity checks.

3.2.1.2.2.3 *Mid-Level Gas*. A mid-level calibration gas with a Hg concentration of 50 to 60 percent of the span value is required for linearity checks and for 3-level system integrity checks of the CEMS, and is optional for calibration error tests and single-level system integrity checks. Elemental Hg standards are required for the linearity checks, oxidized Hg standards are required for the system integrity checks, and either elemental or oxidized Hg standards may be used for the calibration error tests.

3.2.1.2.2.4 *High-Level Gas*. A high-level calibration gas with a Hg concentration of 80 to 100 percent of the span value is required for linearity checks, 3-level system integrity checks, and cycle time tests of the CEMS, and is optional for calibration error tests and single-level system integrity checks. Elemental Hg standards are required for the linearity checks, oxidized Hg standards are required for the system integrity checks, and either elemental or oxidized Hg standards may be used for the calibration error and cycle time tests.

3.2.1.3 *Installation and Measurement Location*. For the Hg CEMS and any additional monitoring system(s) needed to convert Hg concentrations to the desired units of measure (*i.e.*, a flow monitor, CO<sub>2</sub> or O<sub>2</sub> monitor, and/or moisture monitor, as applicable), install each monitoring system at a location: that is consistent with 63.10010(a); that represents the emissions exiting to the atmosphere; and where it is likely that the CEMS can pass the relative accuracy test.

3.2.1.4 *Monitor Span and Range Requirements*. Determine the appropriate span and range value(s) for the Hg CEMS as described in paragraphs 3.2.1.4.1 through 3.2.1.4.3 of this section.

3.2.1.4.1 *Maximum Potential Concentration*. There are three options for determining the maximum potential Hg concentration (MPC). Option 1 applies to coal combustion. You may use a default value of 10 µg/scm for all coal ranks (including coal refuse) except for lignite; for lignite, use 16 µg/scm. If different coals are blended as part of normal operation, use the highest MPC for any fuel in the blend. Option 2 is to base the MPC on the results of site-specific Hg emission testing. This option may be used only if the unit does not have add-on Hg emission controls or a flue gas desulfurization system, or if testing is performed upstream of all emission control devices. If Option 2 is selected, perform at least three test runs at the normal operating load, and the highest Hg concentration obtained in any of the tests shall be the MPC. Option 3 is to use fuel sampling and analysis to estimate the MPC. To make this estimate, use the average Hg content (*i.e.*, the weight percentage) from at least three representative fuel samples, together with other available information, including, but not limited to the maximum fuel feed rate, the heating value of the fuel, and an appropriate F-factor. Assume that all of the Hg in the fuel is emitted to the atmosphere as vapor-phase Hg.

3.2.1.4.2 *Span Value*. To determine the span value of the Hg CEMS, multiply the Hg concentration corresponding to the applicable emissions standard by two. If the result of this calculation is an exact multiple of 10 µg/scm, use the result as the span value. Otherwise, round off the result to either: the next highest integer; the next highest multiple of 5 µg/scm; or the next highest multiple of 10 µg/scm.

3.2.1.4.3 *Analyzer Range.* The Hg analyzer must be capable of reading Hg concentration as high as the MPC.

3.2.2 *Sorbent Trap Monitoring System.* A sorbent trap monitoring system (as defined in paragraph 3.1.2 of this section) may be used as an alternative to a Hg CEMS. If this option is selected, the monitoring system shall be installed, maintained, and operated in accordance with Performance Specification (PS) 12B in Appendix B to part 60 of this chapter. The system shall be certified in accordance with the provisions of section 4.1.2 of this appendix.

3.2.3 *Other Necessary Data Collection.* To convert measured hourly Hg concentrations to the units of the applicable emissions standard (*i.e.*, lb/TBtu or lb/GWh), additional data must be collected, as described in paragraphs 3.2.3.1 through 3.2.3.3 of this section. Any additional monitoring systems needed for this purpose must be certified, operated, maintained, and quality-assured according to the applicable provisions of part 75 of this chapter (see §§63.10010(b) through (d)). The calculation methods for the types of emission limits described in paragraphs 3.2.3.1 and 3.2.3.2 of this section are presented in section 6.2 of this appendix.

3.2.3.1 *Heat Input-Based Emission Limits.* For a heat input-based Hg emission limit (*i.e.*, in lb/TBtu), data from a certified CO<sub>2</sub> or O<sub>2</sub> monitor are needed, along with a fuel-specific F-factor and a conversion constant to convert measured Hg concentration values to the units of the standard. In some cases, the stack gas moisture content must also be considered in making these conversions.

3.2.3.2 *Electrical Output-Based Emission Rates.* If the applicable Hg limit is electrical output-based (*i.e.*, lb/GWh), hourly electrical load data and unit operating times are required in addition to hourly data from a certified stack gas flow rate monitor and (if applicable) moisture data.

3.2.3.3 *Sorbent Trap Monitoring System Operation.* Routine operation of a sorbent trap monitoring system requires the use of a certified stack gas flow rate monitor, to maintain an established ratio of stack gas flow rate to sample flow rate.

#### 4. CERTIFICATION AND RECERTIFICATION REQUIREMENTS

4.1 *Certification Requirements.* All Hg CEMS and sorbent trap monitoring systems and the additional monitoring systems used to continuously measure Hg emissions in units of the applicable emissions standard in accordance with this appendix must be certified in a timely manner, such that the initial compliance demonstration is completed no later than the applicable date in §63.9984(f).

4.1.1 *Hg CEMS.* Table A-1, below, summarizes the certification test requirements and performance specifications for a Hg CEMS. The CEMS may not be used to report quality-assured data until these performance criteria are met. Paragraphs 4.1.1.1 through 4.1.1.5 of this section provide specific instructions for the required tests. All tests must be performed with the affected unit(s) operating (*i.e.*, combusting fuel). Except for the RATA, which must be performed at normal load, no particular load level is required for the certification tests.

4.1.1.1 *7-Day Calibration Error Test.* Perform the 7-day calibration error test on 7 consecutive source operating days, using a zero-level gas and either a high-level or a mid-level calibration gas standard (as defined in paragraphs 3.1.8, 3.1.10, and 3.1.11 of this appendix). Use a NIST-traceable elemental Hg gas standard (as defined in paragraphs 3.1.4 of this appendix) for the test. If your Hg CEMS lacks an integrated elemental Hg gas generator, you may continue to use NIST-traceable oxidized Hg gases for the 7-day calibration error test (or the daily calibration error check) until such time as NIST-traceable compressed elemental Hg gas standards, at appropriate concentration levels, are available from gas vendors. If moisture is added to the calibration gas, the dilution effect

of the moisture and/or chlorine addition on the calibration gas concentration must be accounted for in an appropriate manner. Operate the Hg CEMS in its normal sampling mode during the test. The calibrations should be approximately 24 hours apart, unless the 7-day test is performed over non-consecutive calendar days. On each day of the test, inject the zero-level and upscale gases in sequence and record the analyzer responses. Pass the calibration gas through all filters, scrubbers, conditioners, and other monitor components used during normal sampling, and through as much of the sampling probe as is practical. Do not make any manual adjustments to the monitor (*i.e.*, resetting the calibration) until after taking measurements at both the zero and upscale concentration levels. If automatic adjustments are made following both injections, conduct the calibration error test such that the magnitude of the adjustments can be determined, and use only the unadjusted analyzer responses in the calculations. Calculate the calibration error (CE) on each day of the test, as described in Table A-1 of this appendix. The CE on each day of the test must either meet the main performance specification or the alternative specification in Table A-1 of this appendix.

4.1.1.2 *Linearity Check.* Perform the linearity check using low, mid, and high-level concentrations of NIST-traceable elemental Hg standards. Three gas injections at each concentration level are required, with no two successive injections at the same concentration level. Introduce the calibration gas at the gas injection port, as specified in section 3.2.1.1.3.6 of this appendix. Operate the CEMS at its normal operating temperature and conditions. Pass the calibration gas through all filters, scrubbers, conditioners, and other components used during normal sampling, and through as much of the sampling probe as is practical. If moisture and/or chlorine is added to the calibration gas, the dilution effect of the moisture and/or chlorine addition on the calibration gas concentration must be accounted for in an appropriate manner. Record the monitor response from the data acquisition and handling system for each gas injection. At each concentration level, use the average analyzer response to calculate the linearity error (LE), as described in Table A-1. The LE must either meet the main performance specification or the alternative specification in Table A-1.

4.1.1.3 *Three-Level System Integrity Check.* Perform the 3-level system integrity check using low, mid, and high-level calibration gas concentrations generated by a NIST-traceable source of oxidized Hg. If your Hg CEMS lacks an integrated elemental Hg gas generator, you may continue to use NIST-traceable oxidized Hg gases for the 7-day calibration error test (or the daily calibration error check) until such time as NIST-traceable compressed elemental Hg gas standards, at appropriate concentration levels, are available from gas vendors. Follow the same basic procedure as for the linearity check. If moisture and/or chlorine is added to the calibration gas, the dilution effect of the moisture and/or chlorine addition on the calibration gas concentration must be accounted for in an appropriate manner. Calculate the system integrity error (SIE), as described in Table A-1 of this appendix. The SIE must either meet the main performance specification or the alternative specification in Table A-1 of this appendix.

**TABLE A-1—REQUIRED CERTIFICATION TESTS AND PERFORMANCE SPECIFICATIONS FOR H<sub>g</sub> CEMS**

| <b>For this required certification test . . .</b> | <b>The main performance specification<sup>1</sup> is . . .</b>                                  | <b>The alternate performance specification<sup>1</sup> is . . .</b> | <b>And the conditions of the alternate specification are . . .</b> |
|---------------------------------------------------|-------------------------------------------------------------------------------------------------|---------------------------------------------------------------------|--------------------------------------------------------------------|
| 7-day calibration error test <sup>2,6</sup>       | $ R - A  \leq 5.0\%$ of span value, for both the zero and upscale gases, on each of the 7 days. | $ R - A  \leq 1.0 \mu\text{g}/\text{scm}$                           | The alternate specification may be used on any day of              |



|                                             |                                                                                                                                                    |                                                                                 |                                                           |
|---------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------|-----------------------------------------------------------|
|                                             |                                                                                                                                                    |                                                                                 | the test.                                                 |
| Linearity check <sup>3 6</sup>              | $ R - A_{avg}  \leq 10.0\%$ of the reference gas concentration at each calibration gas level (low, mid, or high).                                  | $ R - A_{avg}  \leq 0.8$<br>$\mu\text{g}/\text{scm}$                            | The alternate specification may be used at any gas level. |
| 3-level system integrity check <sup>4</sup> | $ R - A_{avg}  \leq 10.0\%$ of the reference gas concentration at each calibration gas level.                                                      | $ R - A_{avg}  \leq 0.8$<br>$\mu\text{g}/\text{scm}$                            | The alternate specification may be used at any gas level. |
| RATA                                        | 20.0% RA                                                                                                                                           | $ RM_{avg} - C_{avg}  +  CC  \leq 0.5$<br>$\mu\text{g}/\text{scm}$ <sup>7</sup> | $RM_{avg} < 2.5$<br>$\mu\text{g}/\text{scm}$              |
| Cycle time test <sup>5</sup>                | 15 minutes where the stability criteria are readings change by $< 2.0\%$ of span <i>or</i> by $\leq 0.5$ $\mu\text{g}/\text{scm}$ , for 2 minutes. |                                                                                 |                                                           |

<sup>1</sup>Note that  $|R - A|$  is the absolute value of the difference between the reference gas value and the analyzer reading.  $|R - A_{avg}|$  is the absolute value of the difference between the reference gas concentration and the average of the analyzer responses, at a particular gas level.

<sup>2</sup>Use elemental Hg standards; a mid-level or high-level upscale gas may be used.

<sup>3</sup>Use elemental Hg standards.

<sup>4</sup>Use oxidized Hg standards.

<sup>5</sup>Use elemental Hg standards; a high-level upscale gas must be used. The cycle time test is not required for Hg CEMS that use integrated batch sampling; however, those monitoring systems must be capable of recording at least one Hg concentration reading every 15 minutes.

<sup>6</sup>If your Hg CEMS lacks an integrated elemental Hg gas generator, you may continue to use NIST-traceable oxidized Hg gases until such time as NIST-traceable compressed elemental Hg gas standards, at appropriate concentration levels, are available from gas vendors.

<sup>7</sup>Note that  $|RM_{avg} - C_{avg}|$  is the absolute difference between the mean reference method value and the mean CEMS value from the RATA; CC is the confidence coefficient from Equation 2-5 of Performance Specification 2 in appendix B to part 60 of this chapter.

4.1.1.4 *Cycle Time Test.* Perform the cycle time test, using a zero-level gas and a high-level calibration gas.

Either an elemental or oxidized NIST-traceable Hg standard may be used as the high-level gas. Perform the test in two stages—upscale and downscale. The slower of the upscale and downscale response times is the cycle time for the CEMS. Begin each stage of the test by injecting calibration gas after achieving a stable reading of the stack emissions. The cycle time is the amount of time it takes for the analyzer to register a reading that is 95 percent of the way between the stable stack emissions reading and the final, stable reading of the calibration gas concentration. Use the following criterion to determine when a stable reading of stack emissions or calibration gas has been

attained—the reading is stable if it changes by no more than 2.0 percent of the span value or 0.5 µg/scm (whichever is less restrictive) for two minutes, or a reading with a change of less than 6.0 percent from the measured average concentration over 6 minutes. Integrated batch sampling type Hg CEMS are exempted from this test; however, these systems must be capable of delivering a measured Hg concentration reading at least once every 15 minutes. If necessary to increase measurement sensitivity of a batch sampling type Hg CEMS for a specific application, you may petition the Administrator for approval of a time longer than 15 minutes between readings.

4.1.1.5 *Relative Accuracy Test Audit (RATA)*. Perform the RATA of the Hg CEMS at normal load. Acceptable Hg reference methods for the RATA include ASTM D6784-02 (Reapproved 2008), “Standard Test Method for Elemental, Oxidized, Particle-Bound and Total Mercury in Flue Gas Generated from Coal-Fired Stationary Sources (Ontario Hydro Method)” (incorporated by reference, see §63.14) and Methods 29, 30A, and 30B in appendix A-8 to part 60 of this chapter. When Method 29 or ASTM D6784-02 is used, paired sampling trains are required and the filterable portion of the sample need not be included when making comparisons to the Hg CEMS results for purposes of a RATA. To validate a Method 29 or ASTM D6784-02 test run, calculate the relative deviation (RD) using Equation A-1 of this section, and assess the results as follows to validate the run. The RD must not exceed 10 percent, when the average Hg concentration is greater than 1.0 µg/dscm. If the RD specification is met, the results of the two samples shall be averaged arithmetically.

$$RD = \frac{|C_a - C_b|}{C_a + C_b} \times 100 \quad (\text{Eq. A - 1})$$

[View or download PDF](#)

Where:

RD = Relative Deviation between the Hg concentrations of samples “a” and “b” (percent),

C<sub>a</sub> = Hg concentration of Hg sample “a” (µg/dscm), and

C<sub>b</sub> = Hg concentration of Hg sample “b” (µg/dscm).

4.1.1.5.1 *Special Considerations*. A minimum of nine valid test runs must be performed, directly comparing the CEMS measurements to the reference method. More than nine test runs may be performed. If this option is chosen, the results from a maximum of three test runs may be rejected so long as the total number of test results used to determine the relative accuracy is greater than or equal to nine; however, all data must be reported including the rejected data. The minimum time per run is 21 minutes if Method 30A is used. If Method 29, Method 30B, or ASTM D6784-02 (Reapproved 2008), “Standard Test Method for Elemental, Oxidized, Particle-Bound and Total Mercury in Flue Gas Generated from Coal-Fired Stationary Sources (Ontario Hydro Method)” (incorporated by reference, see §63.14) is used, the time per run must be long enough to collect a sufficient mass of Hg to analyze. Complete the RATA within 168 unit operating hours, except when Method 29 or ASTM D6784-02 is used, in which case up to 336 operating hours may be taken to finish the test.

4.1.1.5.2 *Calculation of RATA Results*. Calculate the relative accuracy (RA) of the monitoring system, on a µg/scm basis, as described in section 12 of Performance Specification (PS) 2 in appendix B to part 60 of this chapter (see Equations 2—3 through 2-6 of PS 2). For purposes of calculating the relative accuracy, ensure that the reference method and monitoring system data are on a consistent basis, either wet or dry. The CEMS must either meet the main performance specification or the alternative specification in Table A-1 of this appendix.

4.1.1.5.3 *Bias Adjustment.* Measurement or adjustment of Hg CEMS data for bias is not required.

4.1.2 *Sorbent Trap Monitoring Systems.* For the initial certification of a sorbent trap monitoring system, only a RATA is required.

4.1.2.1 *Reference Methods.* The acceptable reference methods for the RATA of a sorbent trap monitoring system are the same as those listed in paragraph 4.1.1.5 of this section.

4.1.2.2 “The special considerations specified in paragraph 4.1.1.5.1 of this section apply to the RATA of a sorbent trap monitoring system. During the RATA, the monitoring system must be operated and quality-assured in accordance with Performance Specification (PS) 12B in Appendix B to part 60 of this chapter with the following exceptions for sorbent trap section 2 breakthrough:

4.1.2.2.1 For stack Hg concentrations  $>1 \mu\text{g/dscm}$ ,  $\leq 10\%$  of section 1 Hg mass;

4.1.2.2.2 For stack Hg concentrations  $\leq 1 \mu\text{g/dscm}$  and  $>0.5 \mu\text{g/dscm}$ ,  $\leq 20\%$  of section 1 Hg mass;

4.1.2.2.3 For stack Hg concentrations  $\leq 0.5 \mu\text{g/dscm}$  and  $>0.1 \mu\text{g/dscm}$ ,  $\leq 50\%$  of section 1 Hg mass; and

4.1.2.2.4 For stack Hg concentrations  $\leq 0.1 \mu\text{g/dscm}$ , no breakthrough criterion assuming all other QA/QC specifications are met.

4.1.2.3 The type of sorbent material used by the traps during the RATA must be the same as for daily operation of the monitoring system; however, the size of the traps used for the RATA may be smaller than the traps used for daily operation of the system.

4.1.2.4 *Calculation of RATA Results.* Calculate the relative accuracy (RA) of the sorbent trap monitoring system, on a  $\mu\text{g/scm}$  basis, as described in section 12 of Performance Specification (PS) 2 in appendix B to part 60 of this chapter (see Equations 2-3 through 2-6 of PS2). For purposes of calculating the relative accuracy, ensure that the reference method and monitoring system data are on a consistent moisture basis, either wet or dry. The main and alternative RATA performance specifications in Table A-1 for Hg CEMS also apply to the sorbent trap monitoring system.

4.1.2.5 *Bias Adjustment.* Measurement or adjustment of sorbent trap monitoring system data for bias is not required.

4.1.3 *Diluent Gas, Flow Rate, and/or Moisture Monitoring Systems.* Monitoring systems that are used to measure stack gas volumetric flow rate, diluent gas concentration, or stack gas moisture content, either for routine operation of a sorbent trap monitoring system or to convert Hg concentration data to units of the applicable emission limit, must be certified in accordance with the applicable provisions of part 75 of this chapter.

4.2 *Recertification.* Whenever the owner or operator makes a replacement, modification, or change to a certified CEMS or sorbent trap monitoring system that may significantly affect the ability of the system to accurately measure or record pollutant or diluent gas concentrations, stack gas flow rates, or stack gas moisture content, the owner or operator shall recertify the monitoring system. Furthermore, whenever the owner or operator makes a replacement, modification, or change to the flue gas handling system or the unit operation that may significantly change the concentration or flow

profile, the owner or operator shall recertify the monitoring system. The same tests performed for the initial certification of the monitoring system shall be repeated for recertification, unless otherwise specified by the Administrator. Examples of changes that require recertification include: replacement of a gas analyzer; complete monitoring system replacement, and changing the location or orientation of the sampling probe.

## 5. ONGOING QUALITY ASSURANCE (QA) AND DATA VALIDATION

### 5.1 Hg CEMS.

5.1.1 *Required QA Tests.* Periodic QA testing of each Hg CEMS is required following initial certification. The required QA tests, the test frequencies, and the performance specifications that must be met are summarized in Table A-2, below. All tests must be performed with the affected unit(s) operating (*i.e.*, combusting fuel). Except for the RATA, which must be performed at normal load, no particular load level is required for the tests. For each test, follow the same basic procedures in section 4.1.1 of this appendix that were used for initial certification.

5.1.2 *Test Frequency.* The frequency for the required QA tests of the Hg CEMS shall be as follows:

5.1.2.1 Calibration error tests of the Hg CEMS are required daily, except during unit outages. Use a NIST-traceable elemental Hg gas standard for these calibrations. If your Hg CEMS lacks an integrated elemental Hg gas generator, you may continue to use NIST-traceable oxidized Hg gases for the 7-day calibration error test (or the daily calibration error check) until such time as NIST-traceable compressed elemental Hg gas standards, at appropriate concentration levels, are available from gas vendors. Both a zero-level gas and either a mid-level or high-level gas are required for these calibrations.

5.1.2.2 Perform a linearity check of the Hg CEMS in each QA operating quarter, using low-level, mid-level, and high-level NIST-traceable elemental Hg standards. For units that operate infrequently, limited exemptions from this test are allowed for “non-QA operating quarters”. A maximum of three consecutive exemptions for this reason are permitted, following the quarter of the last test. After the third consecutive exemption, a linearity check must be performed in the next calendar quarter or within a grace period of 168 unit or stack operating hours after the end of that quarter. The test frequency for 3-level system integrity checks (if performed in lieu of linearity checks) is the same as for the linearity checks. Use low-level, mid-level, and high-level NIST-traceable oxidized Hg standards for the system integrity checks.

5.1.2.3 Perform a single-level system integrity check weekly, *i.e.*, once every 7 operating days (see the third column in Table A-2 of this appendix).

5.1.2.4 The test frequency for the RATAs of the Hg CEMS shall be annual, *i.e.*, once every four QA operating quarters. For units that operate infrequently, extensions of RATA deadlines are allowed for non-QA operating quarters. Following a RATA, if there is a subsequent non-QA quarter, it extends the deadline for the next test by one calendar quarter. However, there is a limit to these extensions; the deadline may not be extended beyond the end of the eighth calendar quarter after the quarter of the last test. At that point, a RATA must either be performed within the eighth calendar quarter or in a 720 hour unit or stack operating hour grace period following that quarter. When a required annual RATA is done within a grace period, the deadline for the next RATA is three QA operating quarters after the quarter in which the grace period test is performed.

### 5.1.3 Grace Periods.

5.1.3.1 A 168 unit or stack operating hour grace period is available for quarterly linearity checks and 3-level system integrity checks of the Hg CEMS.

5.1.3.2 A 720 unit or stack operating hour grace period is available for RATAs of the Hg CEMS.

5.1.3.3 There is no grace period for weekly system integrity checks. The test must be completed once every 7 operating days.

5.1.4 *Data Validation.* The Hg CEMS is considered to be out-of-control, and data from the CEMS may not be reported as quality-assured, when any one of the acceptance criteria for the required QA tests in Table A-2 is not met. The CEMS is also considered to be out-of-control when a required QA test is not performed on schedule or within an allotted grace period. To end an out-of-control period, the QA test that was either failed or not done on time must be performed and passed. Out-of-control periods are counted as hours of monitoring system downtime.

5.1.5 *Conditional Data Validation.* For certification, recertification, and diagnostic testing of Hg monitoring systems, and for the required QA tests when non-redundant backup Hg monitoring systems or temporary like-kind Hg analyzers are brought into service, the conditional data validation provisions in §§75.20(b)(3)(ii) through (b)(3)(ix) of this chapter may be used to avoid or minimize data loss. The allotted window of time to complete 7-day calibration error tests, linearity checks, cycle time tests, and RATAs shall be as specified in §75.20(b)(3)(iv) of this chapter. Required system integrity checks must be completed within 168 unit or stack operating hours after the probationary calibration error test.

**TABLE A-2—ON-GOING QA TEST REQUIREMENTS FOR Hg CEMS**

| <b>Perform this type of QA test . . .</b>                | <b>At this frequency . . .</b> | <b>With these qualifications and exceptions . . .</b>                                                                                                                                                                                                  | <b>Acceptance criteria . . .</b>                                                                                                                                      |
|----------------------------------------------------------|--------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Calibration error test <sup>5</sup>                      | Daily                          | <ul style="list-style-type: none"> <li>• Use either a mid- or high-level gas</li> <li>• Use elemental Hg</li> <li>• Calibrations are not required when the unit is not in operation.</li> </ul>                                                        | $ R - A  \leq 5.0\%$ of span value<br><i>or</i><br>$ R - A  \leq 1.0 \mu\text{g}/\text{scm}$ .                                                                        |
| Single-level system integrity check                      | Weekly <sup>1</sup>            | <ul style="list-style-type: none"> <li>• Use oxidized Hg—either mid- or high-level</li> </ul>                                                                                                                                                          | $ R - A_{\text{avg}}  \leq 10.0\%$ of the reference gas value<br><i>or</i><br>$ R - A_{\text{avg}}  \leq 0.8 \mu\text{g}/\text{scm}$ .                                |
| Linearity check <i>or</i> 3-level system integrity check | Quarterly <sup>3</sup>         | <ul style="list-style-type: none"> <li>• Required in each “QA operating quarter”<sup>2</sup> and no less than once every 4 calendar quarters</li> <li>• 168 operating hour grace period available</li> <li>• Use elemental Hg for linearity</li> </ul> | $ R - A_{\text{avg}}  \leq 10.0\%$ of the reference gas value, at each calibration gas level<br><i>or</i><br>$ R - A_{\text{avg}}  \leq 0.8 \mu\text{g}/\text{scm}$ . |

|      |                     |                                                                                                                                                                                                                                             |                                                                                                                                                                                            |
|------|---------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|      |                     | check <ul style="list-style-type: none"> <li>• Use oxidized Hg for system integrity check</li> </ul>                                                                                                                                        |                                                                                                                                                                                            |
| RATA | Annual <sup>4</sup> | <ul style="list-style-type: none"> <li>• Test deadline may be extended for “non-QA operating quarters,” up to a maximum of 8 quarters from the quarter of the previous test</li> <li>• 720 operating hour grace period available</li> </ul> | $\leq 20.0\% \text{ RA or }  RM_{\text{avg}} - C_{\text{avg}}  +  \text{CC}  \leq 0.5 \text{ } \mu\text{g}/\text{scm}, \text{ if } RM_{\text{avg}} < 2.5 \text{ } \mu\text{g}/\text{scm}.$ |

<sup>1</sup>“Weekly” means once every 7 operating days.

<sup>2</sup>A “QA operating quarter” is a calendar quarter with at least 168 unit or stack operating hours.

<sup>3</sup>“Quarterly” means once every QA operating quarter.

<sup>4</sup>“Annual” means once every four QA operating quarters.

<sup>5</sup>If your Hg CEMS lacks an integrated elemental Hg gas generator, you may continue to use NIST-traceable oxidized Hg gases until such time as NIST-traceable compressed elemental Hg gas standards, at appropriate concentration levels, are available from gas vendors.

5.1.6 *Adjustment of Span.* If you discover that a span adjustment is needed (e.g., if the Hg concentration readings exceed the span value for a significant percentage of the unit operating hours in a calendar quarter), you must implement the span adjustment within 90 days after the end of the calendar quarter in which you identify the need for the adjustment. A diagnostic linearity check is required within 168 unit or stack operating hours after changing the span value.

## 5.2 Sorbent Trap Monitoring Systems.

5.2.1 Each sorbent trap monitoring system shall be continuously operated and maintained in accordance with Performance Specification (PS) 12B in appendix B to part 60 of this chapter. The QA/QC criteria for routine operation of the system are summarized in Table 12B-1 of PS 12B. Each pair of sorbent traps may be used to sample the stack gas for up to 15 operating days.

5.2.2 For ongoing QA, periodic RATAs of the system are required.

5.2.2.1 The RATA frequency shall be annual, *i.e.*, once every four QA operating quarters. The provisions in section 5.1.2.4 of this appendix pertaining to RATA deadline extensions also apply to sorbent trap monitoring systems.

5.2.2.2 The same RATA performance criteria specified in Table A-2 for Hg CEMS also apply to the annual RATAs of the sorbent trap monitoring system.

5.2.2.3 A 720 unit or stack operating hour grace period is available for RATAs of the monitoring system.

5.2.3 Data validation for sorbent trap monitoring systems shall be done in accordance with Table 12B-1 in Performance Specification (PS) 12B in appendix B to part 60 of this chapter. All periods of invalid data shall be counted as hours of monitoring system downtime.

5.3 *Flow Rate, Diluent Gas, and Moisture Monitoring Systems.* The on-going QA test requirements for these monitoring systems are specified in part 75 of this chapter (see §§63.10010(b) through (d)).

5.4 *QA/QC Program Requirements.* The owner or operator shall develop and implement a quality assurance/quality control (QA/QC) program for the Hg CEMS and/or sorbent trap monitoring systems that are used to provide data under this subpart. At a minimum, the program shall include a written plan that describes in detail (or that refers to separate documents containing) complete, step-by-step procedures and operations for the most important QA/QC activities. Electronic storage of the QA/QC plan is permissible, provided that the information can be made available in hard copy to auditors and inspectors. The QA/QC program requirements for the diluent gas, flow rate, and moisture monitoring systems described in section 3.2.1.3 of this appendix are specified in section 1 of appendix B to part 75 of this chapter.

#### 5.4.1 *General Requirements.*

5.4.1.1 *Preventive Maintenance.* Keep a written record of procedures needed to maintain the Hg CEMS and/or sorbent trap monitoring system(s) in proper operating condition and a schedule for those procedures. Include, at a minimum, all procedures specified by the manufacturers of the equipment and, if applicable, additional or alternate procedures developed for the equipment.

5.4.1.2 *Recordkeeping and Reporting.* Keep a written record describing procedures that will be used to implement the recordkeeping and reporting requirements of this appendix.

5.4.1.3 *Maintenance Records.* Keep a record of all testing, maintenance, or repair activities performed on any Hg CEMS or sorbent trap monitoring system in a location and format suitable for inspection. A maintenance log may be used for this purpose. The following records should be maintained: date, time, and description of any testing, adjustment, repair, replacement, or preventive maintenance action performed on any monitoring system and records of any corrective actions associated with a monitor outage period. Additionally, any adjustment that may significantly affect a system's ability to accurately measure emissions data must be recorded (e.g., changing the dilution ratio of a CEMS), and a written explanation of the procedures used to make the adjustment(s) shall be kept.

#### 5.4.2 *Specific Requirements for Hg CEMS.*

5.4.2.1 *Daily Calibrations, Linearity Checks and System Integrity Checks.* Keep a written record of the procedures used for daily calibrations of the Hg CEMS. If moisture and/or chlorine is added to the Hg calibration gas, document how the dilution effect of the moisture and/or chlorine addition on the calibration gas concentration is accounted for in an appropriate manner. Also keep records of the procedures used to perform linearity checks of the Hg CEMS and the procedures for system integrity checks of the Hg CEMS. Document how the test results are calculated and evaluated.

5.4.2.2 *Monitoring System Adjustments.* Document how each component of the Hg CEMS will be adjusted to provide correct responses to calibration gases after routine maintenance, repairs, or corrective actions.

5.4.2.3 *Relative Accuracy Test Audits.* Keep a written record of procedures used for RATAs of the Hg CEMS. Indicate the reference methods used and document how the test results are calculated and evaluated.

#### 5.4.3 *Specific Requirements for Sorbent Trap Monitoring Systems.*

5.4.3.1 *Sorbent Trap Identification and Tracking.* Include procedures for inscribing or otherwise permanently marking a unique identification number on each sorbent trap, for chain of custody purposes. Keep records of the ID of the monitoring system in which each sorbent trap is used, and the dates and hours of each Hg collection period.

5.4.3.2 *Monitoring System Integrity and Data Quality.* Document the procedures used to perform the leak checks when a sorbent trap is placed in service and removed from service. Also Document the other QA procedures used to ensure system integrity and data quality, including, but not limited to, gas flow meter calibrations, verification of moisture removal, and ensuring air-tight pump operation. In addition, the QA plan must include the data acceptance and quality control criteria in Table 12B-1 in section 9.0 of Performance Specification (PS) 12B in Appendix B to part 60 of this chapter. All reference meters used to calibrate the gas flow meters (e.g., wet test meters) shall be periodically recalibrated. Annual, or more frequent, recalibration is recommended. If a NIST-traceable calibration device is used as a reference flow meter, the QA plan must include a protocol for ongoing maintenance and periodic recalibration to maintain the accuracy and NIST-traceability of the calibrator.

5.4.3.3 *Hg Analysis.* Explain the chain of custody employed in packing, transporting, and analyzing the sorbent traps. Keep records of all Hg analyses. The analyses shall be performed in accordance with the procedures described in section 11.0 of Performance Specification (PS) 12B in Appendix B to part 60 of this chapter.

5.4.3.4 *Data Collection Period.* State, and provide the rationale for, the minimum acceptable data collection period (e.g., one day, one week, etc.) for the size of sorbent trap selected for the monitoring. Address such factors as the Hg concentration in the stack gas, the capacity of the sorbent trap, and the minimum mass of Hg required for the analysis. Each pair of sorbent traps may be used to sample the stack gas for up to 14 operating days.

5.4.3.5 *Relative Accuracy Test Audit Procedures.* Keep records of the procedures and details peculiar to the sorbent trap monitoring systems that are to be followed for relative accuracy test audits, such as sampling and analysis methods.

## 6. DATA REDUCTION AND CALCULATIONS

### 6.1 Data Reduction.

6.1.1 Reduce the data from Hg CEMS to hourly averages, in accordance with §60.13(h)(2) of this chapter.

6.1.2 For sorbent trap monitoring systems, determine the Hg concentration for each data collection period and assign this concentration value to each operating hour in the data collection period.

6.1.3 For any operating hour in which valid data are not obtained, either for Hg concentration or for a parameter used in the emissions calculations (*i.e.*, flow rate, diluent gas concentration, or



moisture, as applicable), do not calculate the Hg emission rate for that hour. For the purposes of this appendix, part 75 substitute data values are not considered to be valid data.

6.1.4 Operating hours in which valid data are not obtained for Hg concentration are considered to be hours of monitor downtime. The use of substitute data for Hg concentration is not required.

6.2 *Calculation of Hg Emission Rates.* Use the applicable calculation methods in paragraphs 6.2.1 and 6.2.2 of this section to convert Hg concentration values to the appropriate units of the emission standard.

6.2.1 *Heat Input-Based Hg Emission Rates.* Calculate hourly heat input-based Hg emission rates, in units of lb/TBtu, according to sections 6.2.1.1 through 6.2.1.4 of this appendix.

6.2.1.1 Select an appropriate emission rate equation from among Equations 19-1 through 19-9 in EPA Method 19 in appendix A-7 to part 60 of this chapter.

6.2.1.2 Calculate the Hg emission rate in lb/MMBtu, using the equation selected from Method 19. Multiply the Hg concentration value by  $6.24 \times 10^{-11}$  to convert it from  $\mu\text{g}/\text{scm}$  to lb/scf. In cases where an appropriate F-factor is not listed in Table 19-2 of Method 19, you may use F-factors from Table 1 in section 3.3.5 of appendix F to part 75 of this chapter, or F-factors derived using the procedures in section 3.3.6 of appendix to part 75 of this chapter. Also, for startup and shutdown hours, you may calculate the Hg emission rate using the applicable diluent cap value specified in section 3.3.4.1 of appendix F to part 75 of this chapter, provided that the diluent gas monitor is not out-of-control and the hourly average  $\text{O}_2$  concentration is above 14.0%  $\text{O}_2$  (19.0% for an IGCC) or the hourly average  $\text{CO}_2$  concentration is below 5.0%  $\text{CO}_2$  (1.0% for an IGCC), as applicable.

6.2.1.3 Multiply the lb/MMBtu value obtained in section 6.2.1.2 of this appendix by  $10^6$  to convert it to lb/TBtu.

6.2.1.4 The heat input-based Hg emission rate limit in Table 2 to this subpart must be met on a 30 boiler operating day rolling average basis, except as otherwise provided in §63.10009(a)(2). Use Equation 19-19 in EPA Method 19 to calculate the Hg emission rate for each averaging period. The term  $E_{hj}$  in Equation 19-19 must be in the units of the applicable emission limit. Do not include non-operating hours with zero emissions in the average.

6.2.2 *Electrical Output-Based Hg Emission Rates.* Calculate electrical output-based Hg emission limits in units of lb/GWh, according to sections 6.2.2.1 through 6.2.2.3 of this appendix.

6.2.2.1 Calculate the Hg mass emissions for each operating hour in which valid data are obtained for all parameters, using Equation A-2 of this section (for wet-basis measurements of Hg concentration) or Equation A-3 of this section (for dry-basis measurements), as applicable:

$$M_h = K C_h Q_h \quad (\text{Equation A-2})$$

[View or download PDF](#)

Where:

$M_h$  = Hg mass emission rate for the hour (lb/h)

$K$  = Units conversion constant,  $6.24 \times 10^{-11}$  lb-scm/ $\mu$ g-scf,

$C_h$  = Hourly average Hg concentration, wet basis ( $\mu$ g/scm)

$Q_h$  = Stack gas volumetric flow rate for the hour (scfh).

(NOTE: Use unadjusted flow rate values; bias adjustment is not required)

$$M_h = K C_h Q_h (1 - B_{ws}) \quad (\text{Equation A-3})$$

[View or download PDF](#)

Where:

$M_h$  = Hg mass emission rate for the hour (lb/h)

$K$  = Units conversion constant,  $6.24 \times 10^{-11}$  lb-scm/ $\mu$ g-scf.

$C_h$  = Hourly average Hg concentration, dry basis ( $\mu$ g/dscm).

$Q_h$  = Stack gas volumetric flow rate for the hour (scfh)

(NOTE: Use unadjusted flow rate values; bias adjustment is not required).

$B_{ws}$  = Moisture fraction of the stack gas, expressed as a decimal (equal to % H<sub>2</sub>O/100)

6.2.2.2 Use Equation A-4 of this section to calculate the emission rate for each unit or stack operating hour in which valid data are obtained for all parameters.

$$E_{ho} = \frac{M_h}{(MW)_h} \times 10^3 \quad (\text{Equation A-4})$$

[View or download PDF](#)

Where:

$E_{ho}$  = Electrical output-based Hg emission rate (lb/GWh).

$M_h$  = Hg mass emission rate for the hour, from Equation A-2 or A-3 of this section, as applicable (lb/h).

$(MW)_h$  = Gross electrical load for the hour, in megawatts (MW).

$10^3$  = Conversion factor from megawatts to gigawatts.

6.2.2.3 The applicable gross output-based Hg emission rate limit in Table 1 or 2 to this subpart must be met on a 30- (or 90-) boiler operating day rolling average basis, except as otherwise provided in §63.10009(a)(2). Use Equation A-5 of this appendix to calculate the Hg emission rate for each averaging period.

$$\bar{E}_o = \frac{\sum_{h=1}^n E_{ho}}{n} \quad (\text{Eq. A-5})$$

[View or download PDF](#)

Where:

$E_o$  = Hg emission rate for the averaging period (lb/GWh),

$E_{ho}$  = Gross output-based hourly Hg emission rate for unit or stack sampling hour “h” in the averaging period, from Equation A-4 of this appendix (lb/GWh), and

n = Number of unit or stack operating hours in the averaging period in which valid data were obtained for all parameters. (NOTE: DO *not* INCLUDE NON-OPERATING HOURS WITH ZERO EMISSION RATES IN THE AVERAGE).

## 7. RECORDKEEPING AND REPORTING

**7.1 Recordkeeping Provisions.** For the Hg CEMS and/or sorbent trap monitoring systems and any other necessary monitoring systems installed at each affected unit, the owner or operator must maintain a file of all measurements, data, reports, and other information required by this appendix in a form suitable for inspection, for 5 years from the date of each record, in accordance with §63.10033. The file shall contain the information in paragraphs 7.1.1 through 7.1.10 of this section.

**7.1.1 Monitoring Plan Records.** For each affected unit or group of units monitored at a common stack, the owner or operator shall prepare and maintain a monitoring plan for the Hg CEMS and/or sorbent trap monitoring system(s) and any other monitoring system(s) (*i.e.*, flow rate, diluent gas, or moisture systems) needed for routine operation of a sorbent trap monitoring system or to convert Hg concentrations to units of the applicable emission standard. The monitoring plan shall contain essential information on the continuous monitoring systems and shall Document how the data derived from these systems ensure that all Hg emissions from the unit or stack are monitored and reported.

**7.1.1.1 Updates.** Whenever the owner or operator makes a replacement, modification, or change in a certified continuous monitoring system that is used to provide data under this subpart (including a change in the automated data acquisition and handling system or the flue gas handling system) which affects information reported in the monitoring plan (e.g., a change to a serial number for a component of a monitoring system), the owner or operator shall update the monitoring plan.

**7.1.1.2 Contents of the Monitoring Plan.** For Hg CEMS and sorbent trap monitoring systems, the monitoring plan shall contain the information in sections 7.1.1.2.1 and 7.1.1.2.2 of this appendix, as applicable. For stack gas flow rate, diluent gas, and moisture monitoring systems, the monitoring plan shall include the information required for those systems under §75.53 (g) of this chapter.

**7.1.1.2.1 Electronic.** The electronic monitoring plan records must include the following: unit or stack ID number(s); monitoring location(s); the Hg monitoring methodologies used; Hg monitoring system information, including, but not limited to: Unique system and component ID numbers; the make, model, and serial number of the monitoring equipment; the sample acquisition method; formulas used to calculate Hg emissions; Hg monitor span and range information The electronic monitoring plan shall be evaluated and submitted using the Emissions Collection and Monitoring Plan System (ECMPS) Client Tool provided by the Clean Air Markets Division in the Office of Atmospheric Programs of the EPA.

**7.1.1.2.2 Hard Copy.** Keep records of the following: schematics and/or blueprints showing the location of the Hg monitoring system(s) and test ports; data flow diagrams; test protocols; monitor span and range calculations; miscellaneous technical justifications.

7.1.2 *Operating Parameter Records*. The owner or operator shall record the following information for each operating hour of each affected unit and also for each group of units utilizing a common stack, to the extent that these data are needed to convert Hg concentration data to the units of the emission standard. For non-operating hours, record only the items in paragraphs 7.1.2.1 and 7.1.2.2 of this section. If there is heat input to the unit(s), but no electrical load, record only the items in paragraphs 7.1.2.1, 7.1.2.2, and (if applicable) 7.1.2.4 of this section.

7.1.2.1 The date and hour;

7.1.2.2 The unit or stack operating time (rounded up to the nearest fraction of an hour (in equal increments that can range from one hundredth to one quarter of an hour, at the option of the owner or operator);

7.1.2.3 The hourly gross unit load (rounded to nearest MWe); and

7.1.2.4 If applicable, the F-factor used to calculate the heat input-based Hg emission rate.

7.1.2.5 If applicable, a flag to indicate that the hour is a startup or shutdown hour (as defined in §63.10042).

7.1.2.6 The EGUs that constitute an emissions averaging group.

7.1.3 *Hg Emissions Records (Hg CEMS)*. For each affected unit or common stack using a Hg CEMS, the owner or operator shall record the following information for each unit or stack operating hour:

7.1.3.1 The date and hour;

7.1.3.2 Monitoring system and component identification codes, as provided in the monitoring plan, if the CEMS provides a quality-assured value of Hg concentration for the hour;

7.1.3.3 The hourly Hg concentration, if a quality-assured value is obtained for the hour ( $\mu\text{g}/\text{scm}$ , rounded to three significant figures);

7.1.3.4 A special code, indicating whether or not a quality-assured Hg concentration is obtained for the hour. This code may be entered manually when a temporary like-kind replacement Hg analyzer is used for reporting; and

7.1.3.5 Monitor data availability, as a percentage of unit or stack operating hours, calculated according to §75.32 of this chapter.

7.1.4 *Hg Emissions Records (Sorbent Trap Monitoring Systems)*. For each affected unit or common stack using a sorbent trap monitoring system, each owner or operator shall record the following information for the unit or stack operating hour in each data collection period:

7.1.4.1 The date and hour;

7.1.4.2 Monitoring system and component identification codes, as provided in the monitoring plan, if the sorbent trap system provides a quality-assured value of Hg concentration for the hour;

7.1.4.3 The hourly Hg concentration, if a quality-assured value is obtained for the hour ( $\mu\text{g}/\text{scm}$ , rounded to three significant figures). Note that when a quality-assured Hg concentration value is obtained for a particular data collection period, that single concentration value is applied to each operating hour of the data collection period.

7.1.4.4 A special code, indicating whether or not a quality-assured Hg concentration is obtained for the hour;

7.1.4.5 The average flow rate of stack gas through each sorbent trap (in appropriate units, e.g., liters/min, cc/min, dscm/min);

7.1.4.6 The gas flow meter reading (in dscm, rounded to the nearest hundredth), at the beginning and end of the collection period and at least once in each unit operating hour during the collection period;

7.1.4.7 The ratio of the stack gas flow rate to the sample flow rate, as described in section 12.2 of Performance Specification (PS) 12B in Appendix B to part 60 of this chapter; and

7.1.4.8 Monitor data availability, as a percentage of unit or stack operating hours, calculated according to §75.32 of this chapter.

#### 7.1.5 *Stack Gas Volumetric Flow Rate Records.*

7.1.5.1 Hourly measurements of stack gas volumetric flow rate during unit operation are required for routine operation of sorbent trap monitoring systems, to maintain the required ratio of stack gas flow rate to sample flow rate (see section 8.2.2 of Performance Specification (PS) 12B in Appendix B to part 60 of this chapter). Hourly stack gas flow rate data are also needed in order to demonstrate compliance with electrical output-based Hg emissions limits, as provided in section 6.2.2 of this appendix.

7.1.5.2 For each affected unit or common stack, if hourly measurements of stack gas flow rate are needed for sorbent trap monitoring system operation or to convert Hg concentrations to the units of the emission standard, use a flow rate monitor that meets the requirements of part 75 of this chapter to record the required data. You must keep hourly flow rate records, as specified in §75.57(c)(2) of this chapter.

#### 7.1.6 *Records of Stack Gas Moisture Content.*

7.1.6.1 Correction of hourly Hg concentration data for moisture is sometimes required when converting Hg concentrations to the units of the applicable Hg emissions limit. In particular, these corrections are required:

7.1.6.1.1 For sorbent trap monitoring systems;

7.1.6.1.2 For Hg CEMS that measure Hg concentration on a dry basis, when you must calculate electrical output-based Hg emission rates; and

7.1.6.1.3 When using certain equations from EPA Method 19 in appendix A-7 to part 60 of this chapter to calculate heat input-based Hg emission rates.

7.1.6.2 If hourly moisture corrections are required, either use a fuel-specific default moisture percentage from §75.11(b)(1) of this chapter or a certified moisture monitoring system that meets the requirements of part 75 of this chapter, to record the required data. If you use a moisture monitoring system, you must keep hourly records of the stack gas moisture content, as specified in §75.57(c)(3) of this chapter.

*7.1.7 Records of Diluent Gas (CO<sub>2</sub> or O<sub>2</sub>) Concentration.*

7.1.7.1 When a heat input-based Hg mass emissions limit must be met, in units of lb/TBtu, hourly measurements of CO<sub>2</sub> or O<sub>2</sub> concentration are required to convert Hg concentrations to units of the standard.

7.1.7.2 If hourly measurements of diluent gas concentration are needed, use a certified CO<sub>2</sub> or O<sub>2</sub> monitor that meets the requirements of part 75 of this chapter to record the required data. You must keep hourly CO<sub>2</sub> or O<sub>2</sub> concentration records, as specified in §75.57(g) of this chapter.

*7.1.8 Hg Emission Rate Records.* For applicable Hg emission limits in units of lb/TBtu or lb/GWh, record the following information for each affected unit or common stack:

7.1.8.1 The date and hour;

7.1.8.2 The hourly Hg emissions rate (lb/TBtu or lb/GWh, as applicable, calculated according to section 6.2.1 or 6.2.2 of this appendix, rounded to three significant figures), if valid values of Hg concentration and all other required parameters (stack gas volumetric flow rate, diluent gas concentration, electrical load, and moisture data, as applicable) are obtained for the hour;

7.1.8.3 An identification code for the formula (either the selected equation from Method 19 in section 6.2.1 of this appendix or Equation A-4 in section 6.2.2 of this appendix) used to derive the hourly Hg emission rate from Hg concentration, flow rate, electrical load, diluent gas concentration, and moisture data (as applicable); and

7.1.8.4 A code indicating that the Hg emission rate was not calculated for the hour, if valid data for Hg concentration and/or any of the other necessary parameters are not obtained for the hour. For the purposes of this appendix, the substitute data values required under part 75 of this chapter for diluent gas concentration, stack gas flow rate and moisture content are not considered to be valid data.

7.1.8.5 If applicable, a code to indicate that the default gross output (as defined in §63.10042) was used to calculate the Hg emission rate.

7.1.8.6 If applicable, a code to indicate that the diluent cap (as defined in §63.10042) was used to calculate the Hg emission rate.

*7.1.9 Certification and Quality Assurance Test Records.* For any Hg CEMS and sorbent trap monitoring systems used to provide data under this subpart, record the following certification and quality-assurance information:

7.1.9.1 The reference values, monitor responses, and calculated calibration error (CE) values, and a flag to indicate whether the test was done using elemental or oxidized Hg, for all required 7-day calibration error tests and daily calibration error tests of the Hg CEMS;

7.1.9.2 The reference values, monitor responses, and calculated linearity error (LE) or system integrity error (SIE) values for all linearity checks of the Hg CEMS, and for all single-level and 3-level system integrity checks of the Hg CEMS;

7.1.9.3 The CEMS and reference method readings for each test run and the calculated relative accuracy results for all RATAs of the Hg CEMS and/or sorbent trap monitoring systems;

7.1.9.4 The stable stack gas and calibration gas readings and the calculated results for the upscale and downscale stages of all required cycle time tests of the Hg CEMS or, for a batch sampling Hg CEMS, the interval between measured Hg concentration readings;

7.1.9.5 Supporting information for all required RATAs of the Hg monitoring systems, including records of the test dates, the raw reference method and monitoring system data, the results of sample analyses to substantiate the reported test results, and records of sampling equipment calibrations;

7.1.9.6 For sorbent trap monitoring systems, also keep records of the results of all analyses of the sorbent traps used for routine daily operation of the system, and information documenting the results of all leak checks and the other applicable quality control procedures described in Table 12B-1 of Performance Specification (PS) 12B in appendix B to part 60 of this chapter.

7.1.9.7 For stack gas flow rate, diluent gas, and (if applicable) moisture monitoring systems, you must keep records of all certification, recertification, diagnostic, and on-going quality-assurance tests of these systems, as specified in §75.59 of this chapter.

## *7.2 Reporting Requirements.*

*7.2.1 General Reporting Provisions.* The owner or operator shall comply with the following requirements for reporting Hg emissions from each affected unit (or group of units monitored at a common stack) under this subpart:

7.2.1.1 Notifications, in accordance with paragraph 7.2.2 of this section;

7.2.1.2 Monitoring plan reporting, in accordance with paragraph 7.2.3 of this section;

7.2.1.3 Certification, recertification, and QA test submittals, in accordance with paragraph 7.2.4 of this section; and

7.2.1.4 Electronic quarterly report submittals, in accordance with paragraph 7.2.5 of this section.

*7.2.2 Notifications.* The owner or operator shall provide notifications for each affected unit (or group of units monitored at a common stack) under this subpart in accordance with §63.10030.

*7.2.3 Monitoring Plan Reporting.* For each affected unit (or group of units monitored at a common stack) under this subpart using Hg CEMS or sorbent trap monitoring system to measure Hg emissions, the owner or operator shall make electronic and hard copy monitoring plan submittals as follows:

7.2.3.1 Submit the electronic and hard copy information in section 7.1.1.2 of this appendix pertaining to the Hg monitoring systems at least 21 days prior to the applicable date in §63.9984.

Also submit the monitoring plan information in §75.53.(g) pertaining to the flow rate, diluent gas, and moisture monitoring systems within that same time frame, if the required records are not already in place.

7.2.3.2 Whenever an update of the monitoring plan is required, as provided in paragraph 7.1.1.1 of this section. An electronic monitoring plan information update must be submitted either prior to or concurrent with the quarterly report for the calendar quarter in which the update is required.

7.2.3.3 All electronic monitoring plan submittals and updates shall be made to the Administrator using the ECMPS Client Tool. Hard copy portions of the monitoring plan shall be kept on record according to section 7.1 of this appendix.

7.2.4 *Certification, Recertification, and Quality-Assurance Test Reporting.* Except for daily QA tests of the required monitoring systems (*i.e.*, calibration error tests and flow monitor interference checks), the results of all required certification, recertification, and quality-assurance tests described in paragraphs 7.1.9.1 through 7.1.9.7 of this section (except for test results previously submitted, *e.g.*, under the ARP) shall be submitted electronically, using the ECMPS Client Tool, either prior to or concurrent with the relevant quarterly electronic emissions report.

#### 7.2.5 *Quarterly Reports.*

7.2.5.1 Beginning with the report for the calendar quarter in which the initial compliance demonstration is completed or the calendar quarter containing the applicable date in §63.9984, the owner or operator of any affected unit shall use the ECMPS Client Tool to submit electronic quarterly reports to the Administrator, in an XML format specified by the Administrator, for each affected unit (or group of units monitored at a common stack) under this subpart.

7.2.5.2 The electronic reports must be submitted within 30 days following the end of each calendar quarter, except for units that have been placed in long-term cold storage.

7.2.5.3 Each electronic quarterly report shall include the following information:

7.2.5.3.1 The date of report generation;

7.2.5.3.2 Facility identification information;

7.2.5.3.3 The information in paragraphs 7.1.2 through 7.1.8 of this section, as applicable to the Hg emission measurement methodology (or methodologies) used and the units of the Hg emission standard(s); and

7.2.5.3.4 The results of all daily calibration error tests of the Hg CEMS, as described in paragraph 7.1.9.1 of this section and (if applicable) the results of all daily flow monitor interference checks.

7.2.5.4 *Compliance Certification.* Based on reasonable inquiry of those persons with primary responsibility for ensuring that all Hg emissions from the affected unit(s) under this subpart have been correctly and fully monitored, the owner or operator shall submit a compliance certification in support of each electronic quarterly emissions monitoring report. The compliance certification shall include a statement by a responsible official with that official's name, title, and signature, certifying that, to the best of his or her knowledge, the report is true, accurate, and complete.



[↑ Back to Top](#)

## Appendix B to Subpart UUUUU of Part 63—HCl and HF Monitoring Provisions

### 1. APPLICABILITY

These monitoring provisions apply to the measurement of HCl and/or HF emissions from electric utility steam generating units, using CEMS. The CEMS must be capable of measuring HCl and/or HF in the appropriate units of the applicable emissions standard (e.g., lb/MMBtu, lb/MWh, or lb/GWh).

### 2. MONITORING OF HCL AND/OR HF EMISSIONS

**2.1 *Monitoring System Installation Requirements.*** Install HCl and/or HF CEMS and any additional monitoring systems needed to convert pollutant concentrations to units of the applicable emissions limit in accordance with §63.10010(a) and either Performance Specification 15 (PS 15) of appendix B to part 60 of this chapter for extractive Fourier Transform Infrared Spectroscopy (FTIR) continuous emissions monitoring systems or Performance Specification 18 (PS 18) of appendix B to part 60 of this chapter for HCl CEMS.

**2.2 *Primary and Backup Monitoring Systems.*** The provisions pertaining to primary and redundant backup monitoring systems in section 2.2 of appendix A to this subpart apply to HCl and HF CEMS and any additional monitoring systems needed to convert pollutant concentrations to units of the applicable emissions limit.

**2.3 *FTIR Monitoring System Equipment, Supplies, Definitions, and General Operation.*** The following provisions apply:

2.3.1 PS 15, Sections 2.0, 3.0, 4.0, 5.0, 6.0, and 10.0 of appendix B to part 60 of this chapter;  
or

2.3.2 PS 18, Sections 3.0, 6.0, and 11.0 of appendix B to part 60 of this chapter.

### 3. INITIAL CERTIFICATION PROCEDURES

The initial certification procedures for the HCl or HF CEMS used to provide data under this subpart are as follows:

**3.1** If you choose to follow PS 15 of appendix B to part 60 of this chapter, then your HCl and/or HF CEMS must be certified according to PS 15 using the procedures for gas auditing and comparison to a reference method (RM) as specified in sections 3.1.1 and 3.1.2 below.

**3.1.1** You must conduct a gas audit of the HCl and/or HF CEMS as described in section 9.1 of Performance Specification 15, with the exceptions listed in sections 3.1.2.1 and 3.1.2.2 below.

**3.1.1.1** The audit sample gas does not have to be obtained from the Administrator; however, it must be (1) from a secondary source of certified gases (*i.e.*, independent of any calibration gas used for the daily calibration assessments) and (2) directly traceable to National Institute of Standards and

Technology (NIST) or VSL Dutch Metrology Institute (VSL) reference materials through an unbroken chain of comparisons. If audit gas traceable to NIST or VSL reference materials is not available, you may use a gas with a concentration certified to a specified uncertainty by the gas manufacturer.

3.1.1.2 Analyze the results of the gas audit using the calculations in section 12.1 of Performance Specification 15. The calculated correction factor (CF) from Eq. 6 of Performance Specification 15 must be between 0.85 and 1.15. You do not have to test the bias for statistical significance.

3.1.2 You must perform a relative accuracy test audit or RATA according to section 11.1.1.4 of Performance Specification 15 and the requirements below. Perform the RATA of the HCl or HF CEMS at normal load. Acceptable HCl/HF reference methods (RM) are Methods 26 and 26A in appendix A-8 to part 60 of this chapter, Method 320 in Appendix A to this part, or ASTM D6348-03 (Reapproved 2010) "Standard Test Method for Determination of Gaseous Compounds by Extractive Direct Interface Fourier Transform Infrared (FTIR) Spectroscopy" (incorporated by reference, see §63.14), each applied based on the criteria set forth in Table 5 of this subpart.

3.1.2.1 When ASTM D6348-03 is used as the RM, the following conditions must be met:

3.1.2.1.1 The test plan preparation and implementation in the Annexes to ASTM D6348-03, Sections A1 through A8 are mandatory;

3.1.2.1.2 In ASTM D6348-03 Annex A5 (Analyte Spiking Technique), the percent (%) R must be determined for each target analyte (see Equation A5.5);

3.1.2.1.3 For the ASTM D6348-03 test data to be acceptable for a target analyte, %R must be  $70\% \leq R \leq 130\%$ ; and

3.1.2.1.4 The %R value for each compound must be reported in the test report and all field measurements corrected with the calculated %R value for that compound using the following equation:

$$\text{Reported Result} = \frac{(\text{Measured Concentration in Stack})}{\%R} \times 100 \quad (\text{Eq. B-1})$$

[View or download PDF](#)

3.1.2.2 The relative accuracy (RA) of the HCl or HF CEMS must be no greater than 20 percent of the mean value of the RM test data in units of ppm on the same moisture basis. Alternatively, if the mean RM value is less than 1.0 ppm, the RA results are acceptable if the absolute value of the difference between the mean RM and CEMS values does not exceed 0.20 ppm.

3.2 If you choose to follow PS 18 of appendix B to part 60 of this chapter, then your HCl CEMS must be certified according to PS 18, sections 7.0, 8.0, 11.0, 12.0, and 13.0.

3.3 Any additional stack gas flow rate, diluent gas, and moisture monitoring system(s) needed to express pollutant concentrations in units of the applicable emissions limit must be certified according to part 75 of this chapter.

#### 4. RECERTIFICATION PROCEDURES

Whenever the owner or operator makes a replacement, modification, or change to a certified CEMS that may significantly affect the ability of the system to accurately measure or record pollutant or diluent gas concentrations, stack gas flow rates, or stack gas moisture content, the owner or operator shall recertify the monitoring system. Furthermore, whenever the owner or operator makes a replacement, modification, or change to the flue gas handling system or the unit operation that may significantly change the concentration or flow profile, the owner or operator shall recertify the monitoring system. The same tests performed for the initial certification of the monitoring system shall be repeated for recertification, unless otherwise specified by the Administrator. Examples of changes that require recertification include: Replacement of a gas analyzer; complete monitoring system replacement, and changing the location or orientation of the sampling probe.

#### 5. ON-GOING QUALITY ASSURANCE REQUIREMENTS

On-going QA test requirements for HCl and HF CEMS must be implemented as follows:

5.1 If you choose to follow Performance Specification 15 (PS 15) of appendix B to part 60 of this chapter, then the quality assurance/quality control procedures of PS 15 shall apply as set forth in sections 5.1.1 through 5.1.3 and 5.4.2 of this appendix.

5.1.1 On a daily basis, you must assess the calibration error of the HCl or HF CEMS using either a calibration transfer standard as specified in Performance Specification 15 Section 10.1 which references Section 4.5 of the FTIR Protocol or a HCl and/or HF calibration gas at a concentration no greater than two times the level corresponding to the applicable emission limit. A calibration transfer standard is a substitute calibration compound chosen to ensure that the FTIR is performing well at the wavelength regions used for analysis of the target analytes. The measured concentration of the calibration transfer standard or HCl and/or HF calibration gas results must agree within  $\pm 5$  percent of the reference gas value after correction for differences in pressure.

5.1.2 On a quarterly basis, you must conduct a gas audit of the HCl and/or HF CEMS as described in section 3.1.1 of this appendix. For the purposes of this appendix, "quarterly" means once every "QA operating quarter" (as defined in section 3.1.20 of appendix A to this subpart). You have the option to use HCl gas in lieu of HF gas for conducting this audit on an HF CEMS. To the extent practicable, perform consecutive quarterly gas audits at least 30 days apart. The initial quarterly audit is due in the first QA operating quarter following the calendar quarter in which certification testing of the CEMS is successfully completed. Up to three consecutive exemptions from the quarterly audit requirement are allowed for "non-QA operating quarters" (*i.e.*, calendar quarters in which there are less than 168 unit or stack operating hours). However, no more than four consecutive calendar quarters may elapse without performing a gas audit, except as otherwise provided in section 5.4.2.2.1 of this appendix.

5.1.3 You must perform an annual relative accuracy test audit or RATA of the HCl or HF CEMS as described in section 3.1.2 of this appendix. Perform the RATA at normal load. For the purposes of this appendix, "annual" means once every four "QA operating quarters" (as defined in section 3.1.20 of appendix A to this subpart). The first annual RATA is due within four QA operating quarters following the calendar quarter in which the initial certification testing of the HCl or HF CEMS is successfully completed. The provisions in section 5.1.2.4 of appendix A to this subpart pertaining to RATA deadline extensions also apply.

5.2 If you choose to follow Performance Specification PS 18 of appendix B to part 60 of this chapter, then the quality assurance/quality control procedures in Procedure 6 of appendix F to part

60 of this chapter shall apply. The quarterly and annual QA tests required under Procedure 6 shall be performed, respectively, at the frequencies specified in sections 5.1.2 and 5.1.3 of this appendix.

5.3 Stack gas flow rate, diluent gas, and moisture monitoring systems must meet the applicable on-going QA test requirements of part 75 of this chapter.

5.3.1 *Out-of-Control Periods.* A HCl or HF CEMS that is used to provide data under this appendix is considered to be out-of-control, and data from the CEMS may not be reported as quality-assured, when any acceptance criteria for a required QA test is not met. The HCl or HF CEMS is also considered to be out-of-control when a required QA test is not performed on schedule or within an allotted grace period. To end an out-of-control period, the QA test that was either failed or not done on time must be performed and passed. Out-of-control periods are counted as hours of monitoring system downtime.

5.3.2 *Grace Periods.* For the purposes of this appendix, a “grace period” is defined as a specified number of unit or stack operating hours after the deadline for a required quality-assurance test of a continuous monitor has passed, in which the test may be performed and passed without loss of data.

5.3.2.1 For the flow rate, diluent gas, and moisture monitoring systems described in section 5.2 of this appendix, a 168 unit or stack operating hour grace period is available for quarterly linearity checks, and a 720 unit or stack operating hour grace period is available for RATAs, as provided, respectively, in sections 2.2.4 and 2.3.3 of appendix B to part 75 of this chapter.

5.3.2.2 For the purposes of this appendix, if the deadline for a required gas audit or RATA of a HCl or HF CEMS cannot be met due to circumstances beyond the control of the owner or operator:

5.3.2.2.1 A 168 unit or stack operating hour grace period is available in which to perform the gas audit; or

5.3.2.2.2 A 720 unit or stack operating hour grace period is available in which to perform the RATA.

5.3.2.3 If a required QA test is performed during a grace period, the deadline for the next test shall be determined as follows:

5.3.2.3.1 For a gas audit or RATA of the monitoring systems described in section 5.1 of this appendix, determine the deadline for the next gas audit or RATA (as applicable) in accordance with section 2.2.4(b) or 2.3.3(d) of appendix B to part 75 of this chapter; treat a gas audit in the same manner as a linearity check.

5.3.2.3.2 For the gas audit of a HCl or HF CEMS, the grace period test only satisfies the audit requirement for the calendar quarter in which the test was originally due. If the calendar quarter in which the grace period audit is performed is a QA operating quarter, an additional gas audit is required for that quarter.

5.3.2.3.3 For the RATA of a HCl or HF CEMS, the next RATA is due within three QA operating quarters after the calendar quarter in which the grace period test is performed.

5.3.3 *Conditional Data Validation* For recertification and diagnostic testing of the monitoring systems that are used to provide data under this appendix, and for the required QA tests when non-

redundant backup monitoring systems or temporary like-kind replacement analyzers are brought into service, the conditional data validation provisions in §§75.20(b)(3)(ii) through (b)(3)(ix) of this chapter may be used to avoid or minimize data loss. The allotted window of time to complete calibration tests and RATAs shall be as specified in §75.20(b)(3)(iv) of this chapter; the allotted window of time to complete a gas audit shall be the same as for a linearity check (*i.e.*, 168 unit or stack operating hours).

#### 5.4 *Data Validation.*

5.4.1 *Out-of-Control Periods.* An HCl or HF CEMS that is used to provide data under this appendix is considered to be out-of-control, and data from the CEMS may not be reported as quality-assured, when any acceptance criteria for a required QA test is not met. The HCl or HF CEMS is also considered to be out-of-control when a required QA test is not performed on schedule or within an allotted grace period. To end an out-of-control period, the QA test that was either failed or not done on time must be performed and passed. Out-of-control periods are counted as hours of monitoring system downtime.

5.4.2 *Grace Periods.* For the purposes of this appendix, a “grace period” is defined as a specified number of unit or stack operating hours after the deadline for a required quality-assurance test of a continuous monitor has passed, in which the test may be performed and passed without loss of data.

5.4.2.1 For the monitoring systems described in section 5.3 of this appendix, a 168 unit or stack operating hour grace period is available for quarterly linearity checks, and a 720 unit or stack operating hour grace period is available for RATAs, as provided, respectively, in sections 2.2.4 and 2.3.3 of appendix B to part 75 of this chapter.

5.4.2.2 For the purposes of this appendix, if the deadline for a required gas audit/data accuracy assessment or RATA of an HCl CEMS cannot be met due to circumstances beyond the control of the owner or operator:

5.4.2.2.1 A 168 unit or stack operating hour grace period is available in which to perform the gas audit or other quarterly data accuracy assessment; or

5.4.2.2.2 A 720 unit or stack operating hour grace period is available in which to perform the RATA.

5.4.2.3 If a required QA test is performed during a grace period, the deadline for the next test shall be determined as follows:

5.4.2.3.1 For a gas audit or RATA of the monitoring systems described in sections 5.1 and 5.2 of this appendix, determine the deadline for the next gas audit or RATA (as applicable) in accordance with section 2.2.4(b) or 2.3.3(d) of appendix B to part 75 of this chapter; treat a gas audit in the same manner as a linearity check.

5.4.2.3.2 For the gas audit or other quarterly data accuracy assessment of an HCl or HF CEMS, the grace period test only satisfies the audit requirement for the calendar quarter in which the test was originally due. If the calendar quarter in which the grace period audit is performed is a QA operating quarter, an additional gas audit/data accuracy assessment is required for that quarter.

5.4.2.3.3 For the RATA of an HCl or HF CEMS, the next RATA is due within three QA operating quarters after the calendar quarter in which the grace period test is performed.

5.4.3 *Conditional Data Validation.* For recertification and diagnostic testing of the monitoring systems that are used to provide data under this appendix, the conditional data validation provisions in §75.20(b)(3)(ii) through (ix) of this chapter may be used to avoid or minimize data loss. The allotted window of time to complete calibration tests and RATAs shall be as specified in §75.20(b)(3)(iv) of this chapter; the allotted window of time to complete a quarterly gas audit or data accuracy assessment shall be the same as for a linearity check (*i.e.*, 168 unit or stack operating hours).

## 6. MISSING DATA REQUIREMENTS

For the purposes of this appendix, the owner or operator of an affected unit shall not substitute for missing data from HCl or HF CEMS. Any process operating hour for which quality-assured HCl or HF concentration data are not obtained is counted as an hour of monitoring system downtime.

## 7. BIAS ADJUSTMENT

Bias adjustment of hourly emissions data from a HCl or HF CEMS is not required.

## 8. QA/QC PROGRAM REQUIREMENTS

The owner or operator shall develop and implement a quality assurance/quality control (QA/QC) program for the HCl and/or HF CEMS that are used to provide data under this subpart. At a minimum, the program shall include a written plan that describes in detail (or that refers to separate documents containing) complete, step-by-step procedures and operations for the most important QA/QC activities. Electronic storage of the QA/QC plan is permissible, provided that the information can be made available in hard copy to auditors and inspectors. The QA/QC program requirements for the other monitoring systems described in section 5.3 of this appendix are specified in section 1 of appendix B to part 75 of this chapter.

### 8.1 *General Requirements for HCl and HF CEMS.*

8.1.1 *Preventive Maintenance.* Keep a written record of procedures needed to maintain the HCl and/or HF CEMS in proper operating condition and a schedule for those procedures. This shall, at a minimum, include procedures specified by the manufacturers of the equipment and, if applicable, additional or alternate procedures developed for the equipment.

8.1.2 *Recordkeeping and Reporting.* Keep a written record describing procedures that will be used to implement the recordkeeping and reporting requirements of this appendix.

8.1.3 *Maintenance Records.* Keep a record of all testing, maintenance, or repair activities performed on any HCl or HF CEMS in a location and format suitable for inspection. A maintenance log may be used for this purpose. The following records should be maintained: Date, time, and description of any testing, adjustment, repair, replacement, or preventive maintenance action performed on any monitoring system and records of any corrective actions associated with a monitor outage period. Additionally, any adjustment that may significantly affect a system's ability to accurately measure emissions data must be recorded and a written explanation of the procedures used to make the adjustment(s) shall be kept.

8.2 *Specific Requirements for HCl and HF CEMS.* The following requirements are specific to HCl and HF CEMS:

8.2.1 Keep a written record of the procedures used for each type of QA test required for each HCl and HF CEMS. Explain how the results of each type of QA test are calculated and evaluated.

8.2.2 Explain how each component of the HCl and/or HF CEMS will be adjusted to provide correct responses to calibration gases after routine maintenance, repairs, or corrective actions.

## 9. DATA REDUCTION AND CALCULATIONS

9.1 Design and operate the HCl and/or HF CEMS to complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

9.2 Reduce the HCl and/or HF concentration data to hourly averages in accordance with §60.13(h)(2) of this chapter.

9.3 Convert each hourly average HCl or HF concentration to an HCl or HF emission rate expressed in units of the applicable emissions limit.

9.3.1 For heat input-based emission rates, select an appropriate emission rate equation from among Equations 19-1 through 19-9 in EPA Method 19 in Appendix A-7 to part 60 of this chapter, to calculate the HCl or HF emission rate in lb/MMBtu. Multiply the HCl concentration value (ppm) by  $9.43 \times 10^{-8}$  to convert it to lb/scf, for use in the applicable Method 19 equation. For HF, the conversion constant from ppm to lb/scf is  $5.18 \times 10^{-8}$ . The appropriate diluent cap value from section 6.2.1.2 of Appendix A to this subpart may be used to calculate the HCl or HF emission rate (lb/MMBtu) during startup or shutdown hours.

9.3.2 For gross output-based emission rates, first calculate the HCl or HF mass emission rate (lb/h), using an equation that has the general form of Equation A-2 or A-3 in appendix A to this subpart (as applicable), replacing the value of K with  $9.43 \times 10^{-8}$  lb/scf-ppm (for HCl) or  $5.18 \times 10^{-8}$  (for HF) and defining  $C_h$  as the hourly average HCl or HF concentration in ppm. Then, divide the result by the hourly gross output (megawatts) to convert it to units of lb/MWh. If the gross output is zero during a startup or shutdown hour, use the default gross output (as defined in §63.10042) to calculate the HCl or HF emission rate. The default gross output is not considered to be a substitute data value.

9.4 Use Equation A-5 in appendix A of this subpart to calculate the required 30 operating day rolling average HCl or HF emission rates. Round off each 30 operating day average to two significant figures. The term  $E_{ho}$  in Equation A-5 must be in the units of the applicable emissions limit.

## 10. RECORDKEEPING REQUIREMENTS

10.1 For each HCl or HF CEMS installed at an affected source, and for any other monitoring system(s) needed to convert pollutant concentrations to units of the applicable emissions limit, the owner or operator must maintain a file of all measurements, data, reports, and other information required by this appendix in a form suitable for inspection, for 5 years from the date of each record, in accordance with §63.10033. The file shall contain the information in paragraphs 10.1.1 through 10.1.8 of this section.

10.1.1 *Monitoring Plan Records.* For each affected unit or group of units monitored at a common stack, the owner or operator shall prepare and maintain a monitoring plan for the HCl and/or HF CEMS and any other monitoring system(s) (*i.e.*, flow rate, diluent gas, or moisture systems) needed to convert pollutant concentrations to units of the applicable emission standard. The monitoring plan shall contain essential information on the continuous monitoring systems and shall explain how the data derived from these systems ensure that all HCl or HF emissions from the unit or stack are monitored and reported.

10.1.1.1 *Updates.* Whenever the owner or operator makes a replacement, modification, or change in a certified continuous HCl or HF monitoring system that is used to provide data under this subpart (including a change in the automated data acquisition and handling system or the flue gas handling system) which affects information reported in the monitoring plan (e.g., a change to a serial number for a component of a monitoring system), the owner or operator shall update the monitoring plan.

10.1.1.2 *Contents of the Monitoring Plan.* For HCl and/or HF CEMS, the monitoring plan shall contain the applicable electronic and hard copy information in sections 10.1.1.2.1 and 10.1.1.2.2 of this appendix. For stack gas flow rate, diluent gas, and moisture monitoring systems, the monitoring plan shall include the electronic and hard copy information required for those systems under §75.53 (g) of this chapter. The electronic monitoring plan shall be evaluated using the ECMPS Client Tool.

10.1.1.2.1 *Electronic.* Record the unit or stack ID number(s); monitoring location(s); the HCl or HF monitoring methodology used (*i.e.*, CEMS); HCl or HF monitoring system information, including, but not limited to: unique system and component ID numbers; the make, model, and serial number of the monitoring equipment; the sample acquisition method; formulas used to calculate emissions; monitor span and range information (if applicable).

10.1.1.2.2 *Hard Copy.* Keep records of the following: schematics and/or blueprints showing the location of the monitoring system(s) and test ports; data flow diagrams; test protocols; monitor span and range calculations (if applicable); miscellaneous technical justifications.

10.1.2 *Operating Parameter Records.* For the purposes of this appendix, the owner or operator shall record the following information for each operating hour of each affected unit or group of units utilizing a common stack, to the extent that these data are needed to convert pollutant concentration data to the units of the emission standard. For non-operating hours, record only the items in paragraphs 10.1.2.1 and 10.1.2.2 of this section. If there is heat input to the unit(s), but no electrical load, record only the items in paragraphs 10.1.2.1, 10.1.2.2, and (if applicable) 10.1.2.4 of this section.

10.1.2.1 The date and hour;

10.1.2.2 The unit or stack operating time (rounded up to the nearest fraction of an hour (in equal increments that can range from one hundredth to one quarter of an hour, at the option of the owner or operator);

10.1.2.3 The hourly gross unit load (rounded to nearest MWge); and

10.1.2.4 If applicable, the F-factor used to calculate the heat input-based pollutant emission rate.

10.1.2.5 If applicable, a flag to indicate that the hour is a startup or shutdown hour (as defined in §63.10042).



10.1.3 *HCl and/or HF Emissions Records.* For HCl and/or HF CEMS, the owner or operator must record the following information for each unit or stack operating hour:

10.1.3.1 The date and hour;

10.1.3.2 Monitoring system and component identification codes, as provided in the electronic monitoring plan, for each hour in which the CEMS provides a quality-assured value of HCl or HF concentration (as applicable);

10.1.3.3 The pollutant concentration, for each hour in which a quality-assured value is obtained. For HCl and HF, record the data in parts per million (ppm), rounded to three significant figures.

10.1.3.4 A special code, indicating whether or not a quality-assured HCl or HF concentration value is obtained for the hour. This code may be entered manually when a temporary like-kind replacement HCl or HF analyzer is used for reporting; and

10.1.3.5 Monitor data availability, as a percentage of unit or stack operating hours, calculated according to §75.32 of this chapter.

10.1.4 *Stack Gas Volumetric Flow Rate Records.*

10.1.4.1 Hourly measurements of stack gas volumetric flow rate during unit operation are required to demonstrate compliance with electrical output-based HCl or HF emissions limits (*i.e.*, lb/MWh or lb/GWh).

10.1.4.2 Use a flow rate monitor that meets the requirements of part 75 of this chapter to record the required data. You must keep hourly flow rate records, as specified in §75.57(c)(2) of this chapter.

10.1.5 *Records of Stack Gas Moisture Content.*

10.1.5.1 Correction of hourly pollutant concentration data for moisture is sometimes required when converting concentrations to the units of the applicable Hg emissions limit. In particular, these corrections are required:

10.1.5.1.1 To calculate electrical output-based pollutant emission rates, when using a CEMS that measures pollutant concentrations on a dry basis; and

10.1.5.1.2 To calculate heat input-based pollutant emission rates, when using certain equations from EPA Method 19 in appendix A-7 to part 60 of this chapter.

10.1.5.2 If hourly moisture corrections are required, either use a fuel-specific default moisture percentage for coal-fired units from §75.11(b)(1) of this chapter, an Administrator approved default moisture value for non-coal-fired units (as per paragraph 63.10010(d) of this subpart), or a certified moisture monitoring system that meets the requirements of part 75 of this chapter, to record the required data. If you elect to use a moisture monitoring system, you must keep hourly records of the stack gas moisture content, as specified in §75.57(c)(3) of this chapter.

10.1.6 *Records of Diluent Gas (CO<sub>2</sub> or O<sub>2</sub>) Concentration.*

10.1.6.1 To assess compliance with a heat input-based HCl or HF emission rate limit in units of lb/MMBtu, hourly measurements of CO<sub>2</sub> or O<sub>2</sub> concentration are required to convert pollutant concentrations to units of the standard.

10.1.6.2 If hourly measurements of diluent gas concentration are needed, you must use a certified CO<sub>2</sub> or O<sub>2</sub> monitor that meets the requirements of part 75 of this chapter to record the required data. For all diluent gas monitors, you must keep hourly CO<sub>2</sub> or O<sub>2</sub> concentration records, as specified in §75.57(g) of this chapter.

10.1.7 *HCl and HF Emission Rate Records.* For applicable HCl and HF emission limits in units of lb/MMBtu, lb/MWh, or lb/GWh, record the following information for each affected unit or common stack:

10.1.7.1 The date and hour;

10.1.7.2 The hourly HCl and/or HF emissions rate (lb/MMBtu, lb/MWh, or lb/GWh, as applicable, rounded to three significant figures), for each hour in which valid values of HCl or HF concentration and all other required parameters (stack gas volumetric flow rate, diluent gas concentration, electrical load, and moisture data, as applicable) are obtained for the hour;

10.1.7.3 An identification code for the formula used to derive the hourly HCl or HF emission rate from HCl or HF concentration, flow rate, electrical load, diluent gas concentration, and moisture data (as applicable); and

10.1.7.4 A code indicating that the HCl or HF emission rate was not calculated for the hour, if valid data for HCl or HF concentration and/or any of the other necessary parameters are not obtained for the hour. For the purposes of this appendix, the substitute data values required under part 75 of this chapter for diluent gas concentration, stack gas flow rate and moisture content are not considered to be valid data.

10.1.7.5 If applicable, a code to indicate that the default electrical load (as defined in §63.10042) was used to calculate the HCl or HF emission rate.

10.1.7.6 If applicable, a code to indicate that the diluent cap (as defined in §63.10042) was used to calculate the HCl or HF emission rate.

10.1.8 *Certification and Quality Assurance Test Records.* For the HCl and/or HF CEMS used to provide data under this subpart at each affected unit (or group of units monitored at a common stack), record the following information for all required certification, recertification, diagnostic, and quality-assurance tests:

10.1.8.1 *HCl and HF CEMS.*

10.1.8.1.1 For all required daily calibrations (including calibration transfer standard tests) of the HCl or HF CEMS, record the test dates and times, reference values, monitor responses, and calculated calibration error values;

10.1.8.1.2 For gas audits of HCl or HF CEMS, record the date and time of each spiked and unspiked sample, the audit gas reference values and uncertainties. Keep records of all calculations and data analyses required under sections 9.1 and 12.1 of Performance Specification 15, and the results of those calculations and analyses.

10.1.8.1.3 For each RATA of a HCl or HF CEMS, record the date and time of each test run, the reference method(s) used, and the reference method and HCl or HF CEMS values. Keep records of the data analyses and calculations used to determine the relative accuracy.

10.1.8.2 *Additional Monitoring Systems.* For the stack gas flow rate, diluent gas, and moisture monitoring systems described in section 3.2 of this appendix, you must keep records of all certification, recertification, diagnostic, and on-going quality-assurance tests of these systems, as specified in §75.59(a) of this chapter.

## 11. REPORTING REQUIREMENTS

11.1 *General Reporting Provisions.* The owner or operator shall comply with the following requirements for reporting HCl and/or HF emissions from each affected unit (or group of units monitored at a common stack):

11.1.1 Notifications, in accordance with paragraph 11.2 of this section;

11.1.2 Monitoring plan reporting, in accordance with paragraph 11.3 of this section;

11.1.3 Certification, recertification, and QA test submittals, in accordance with paragraph 11.4 of this section; and

11.1.4 Electronic quarterly report submittals, in accordance with paragraph 11.5 of this section.

11.2 *Notifications.* The owner or operator shall provide notifications for each affected unit (or group of units monitored at a common stack) in accordance with §63.10030.

11.3 *Monitoring Plan Reporting.* For each affected unit (or group of units monitored at a common stack) using HCl and/or HF CEMS, the owner or operator shall make electronic and hard copy monitoring plan submittals as follows:

11.3.1 Submit the electronic and hard copy information in section 10.1.1.2 of this appendix pertaining to the HCl and/or HF monitoring systems at least 21 days prior to the applicable date in §63.9984. Also, if applicable, submit monitoring plan information pertaining to any required flow rate, diluent gas, and/or moisture monitoring systems within that same time frame, if the required records are not already in place.

11.3.2 Update the monitoring plan when required, as provided in paragraph 10.1.1.1 of this appendix. An electronic monitoring plan information update must be submitted either prior to or concurrent with the quarterly report for the calendar quarter in which the update is required.

11.3.3 All electronic monitoring plan submittals and updates shall be made to the Administrator using the ECMPS Client Tool. Hard copy portions of the monitoring plan shall be kept on record according to section 10.1 of this appendix.

11.4 *Certification, Recertification, and Quality-Assurance Test Reporting Requirements.* Except for daily QA tests (*i.e.*, calibrations and flow monitor interference checks), which are included in each electronic quarterly emissions report, use the ECMPS Client Tool to submit the results of all required certification, recertification, quality-assurance, and diagnostic tests

of the monitoring systems required under this appendix electronically, either prior to or concurrent with the relevant quarterly electronic emissions report.

11.4.1 For daily calibrations (including calibration transfer standard tests), report the information in §75.59(a)(1) of this chapter, excluding paragraphs (a)(1)(ix) through (a)(1)(xi).

11.4.2 For each quarterly gas audit of a HCl or HF CEMS, report:

11.4.2.1 Facility ID information;

11.4.2.2 Monitoring system ID number;

11.4.2.3 Type of test (e.g., quarterly gas audit);

11.4.2.4 Reason for test;

11.4.2.5 Certified audit (spike) gas concentration value (ppm);

11.4.2.6 Measured value of audit (spike) gas, including date and time of injection;

11.4.2.7 Calculated dilution ratio for audit (spike) gas;

11.4.2.8 Date and time of each spiked flue gas sample;

11.4.2.9 Date and time of each unspiked flue gas sample;

11.4.2.10 The measured values for each spiked gas and unspiked flue gas sample (ppm);

11.4.2.11 The mean values of the spiked and unspiked sample concentrations and the expected value of the spiked concentration as specified in section 12.1 of Performance Specification 15 (ppm);

11.4.2.12 Bias at the spike level as calculated using equation 3 in section 12.1 of Performance Specification 15; and

11.4.2.13 The correction factor (CF), calculated using equation 6 in section 12.1 of Performance Specification 15.

11.4.3 For each RATA of a HCl or HF CEMS, report:

11.4.3.1 Facility ID information;

11.4.3.2 Monitoring system ID number;

11.4.3.3 Type of test (*i.e.*, initial or annual RATA);

11.4.3.4 Reason for test;

11.4.3.5 The reference method used;

11.4.3.6 Starting and ending date and time for each test run;

11.4.3.7 Units of measure;

11.4.3.8 The measured reference method and CEMS values for each test run, on a consistent moisture basis, in appropriate units of measure;

11.4.3.9 Flags to indicate which test runs were used in the calculations;

11.4.3.10 Arithmetic mean of the CEMS values, of the reference method values, and of their differences;

11.4.3.11 Standard deviation, as specified in Equation 2-4 of Performance Specification 2 in appendix B to part 60 of this chapter;

11.4.3.12 Confidence coefficient, as specified in Equation 2-5 of Performance Specification 2 in appendix B to part 60 of this chapter; and

11.4.3.13 Relative accuracy calculated using Equation 2-6 of Performance Specification 2 in appendix B to part 60 of this chapter or, if applicable, according to the alternative procedure for low emitters described in section 3.1.2.2 of this appendix. If applicable use a flag to indicate that the alternative RA specification for low emitters has been applied.

11.4.4 *Reporting Requirements for Diluent Gas, Flow Rate, and Moisture Monitoring Systems.* For the certification, recertification, diagnostic, and QA tests of stack gas flow rate, moisture, and diluent gas monitoring systems that are certified and quality-assured according to part 75 of this chapter, report the information in section 10.1.9.3 of this appendix.

## 11.5 *Quarterly Reports.*

11.5.1 Beginning with the report for the calendar quarter in which the initial compliance demonstration is completed or the calendar quarter containing the applicable date in §63.10005(g), (h), or (j) (whichever is earlier), the owner or operator of any affected unit shall use the ECMPS Client Tool to submit electronic quarterly reports to the Administrator, in an XML format specified by the Administrator, for each affected unit (or group of units monitored at a common stack).

11.5.2 The electronic reports must be submitted within 30 days following the end of each calendar quarter, except for units that have been placed in long-term cold storage.

11.5.3 Each electronic quarterly report shall include the following information:

11.5.3.1 The date of report generation;

11.5.3.2 Facility identification information;

11.5.3.3 The information in sections 10.1.2 through 10.1.7 of this appendix, as applicable to the type(s) of monitoring system(s) used to measure the pollutant concentrations and other necessary parameters.

11.5.3.4 The results of all daily calibrations (including calibration transfer standard tests) of the HCl or HF monitor as described in section 10.1.8.1.1 of this appendix; and

11.5.3.5 If applicable, the results of all daily flow monitor interference checks, in accordance with section 10.1.8.2 of this appendix.

11.5.4 *Compliance Certification.* Based on reasonable inquiry of those persons with primary responsibility for ensuring that all HCl and/or HF emissions from the affected unit(s) have been correctly and fully monitored, the owner or operator shall submit a compliance certification in support of each electronic quarterly emissions monitoring report. The compliance certification shall include a statement by a responsible official with that official's name, title, and signature, certifying that, to the best of his or her knowledge, the report is true, accurate, and complete.

[77 FR 9464, Feb. 16, 2012, as amended at 78 FR 24094, Apr. 24, 2013; 79 FR 68795, Nov. 19, 2014; 81 FR 20205, Apr. 6, 2016]

 [Back to Top](#)

[Need assistance?](#)