


**From:** [tsanders@cityofmountainhome.com](mailto:tsanders@cityofmountainhome.com)  
**To:** [Porter, Gina](#)  
**Subject:** 709 Baxter Ave  
**Date:** Tuesday, November 24, 2015 9:26:13 AM

---

In July 2015 we replaced 350' of sewer line on Baxter ave to repair the line that was crushed and causing the manhole at 709 Baxter to overflow. This work was completed July 29th 2015 .Their was a complaint call in to adeq the week of November 16th-20th about the manhole overflowing again. We went and inspected the manhole and could find no evidence of a overflow. We will be installing a manhole insert in the manhole so no water can enter the manhole as it is under water during a heavy rain fall. We informed the person at this address to call the water department if they feel their is a problem so we can handle it.

**Terry Sanders, Plant Manager**  
**City of Mountain Home**  
**WasteWater Treatment Plant**  
**720 S. Hickory St.**  
**Mountain Home, AR 72653**  
**Phone: 870-425-6510**  
**Fax: : 870-425-0190**  
**Cell : 870-321-3246**  
**Email : [tsanders@cityofmountainhome.com](mailto:tsanders@cityofmountainhome.com)**

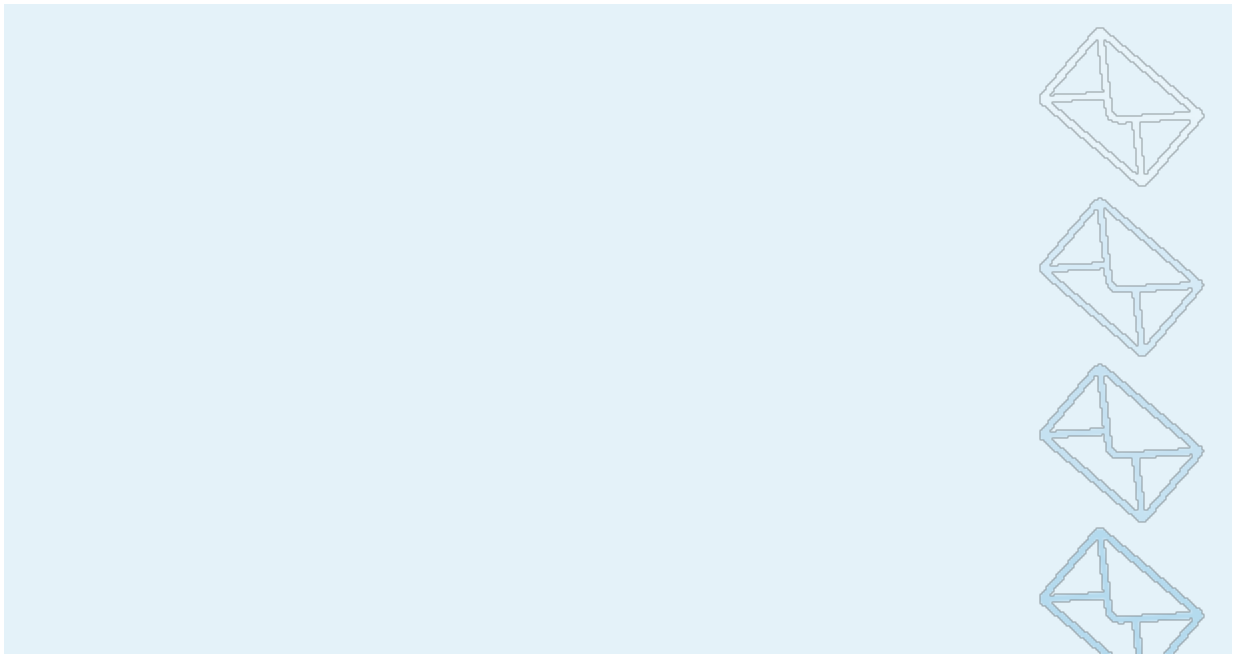

**FREE Animations for your email** [Click Here!](#)