


Phone (870) 238-2751

WYNNE WATER UTILITIES
WYNNE, ARKANSAS
72396

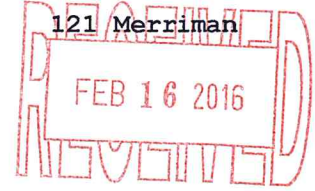

Date: February 5, 2016

Arkansas Department of Environmental Quality
NPDES Enforcement Section
5301 Northshore Dr.
North Little Rock, Arkansas 72118-5317

Re: NPDES Permit No: AR0021903

Client: Wynne, City Of
Address: 121 Merriman Ave.
City: Wynne
State: AR
Zip: 72396
Phone: 870-238-2751
Contact: Don M. O'Neal, Manager

Date of	Parameter	7 – Day Avg.	Permit Limit
Non-Compliance	Exceeded	38.000 MG/L	22.5 MG/L
January 20, 2015	TSS MG/L	Monthly Avg.	Permit Limit
	TSS MG/L	21.750 MG/L	15.0 MG/L

We feel this problem was due to:

On December 23-29 we had six straight days of rain amounting to around 8 inches and due to I & I problems our flow reached as much as 4.3 MGD. Due to this problem we lost a considerable amount of our flock. This gave us a problem with our settling which is to fast leaving solids suspended. At present we are working to regain our flock so as to return the process back to normal.

To correct this problem we are at present in the construction stage of building a holding pond that will help us regulate the amount of flow to our plant. This should be completed in May, 2016.

If you have any questions or concerns you may reach me at the above phone number.

Yours Very Truly,



Authorized Signature