

WYNNE WATER UTILITIES
WYNNE, ARKANSAS
72396

Date: May 9, 2013

Arkansas Department of Environmental Quality
NPDES Enforcement Section
5301 Northshore Dr.
North Little Rock, AR 72118-5317

Re: NPDES Permit No: AR0021903
Non-Compliance of Ammonia Nitrogen

Client: Wynne Water Utilities
Address: 121 E. Merriman
City: Wynne
State: Arkansas
Zip: 72396
Phone: 870-238-2751
Contact: Don O'Neal

To Whom It May Concern:


During the time of April 8th – April 19th we had to replace an aerator gear box to one of our oxidation ditches. While the maintenance was being preformed the other aerator had to be shut down periodically due to the circular motion of the water. The maintenance supervisor did not realize that it might cause any violation of the permit. We feel that this was the cause of the abnormal Ammonia Nitrogen results.

April Ammonia Nitrogen Limit monthly average: 2.1 mg/l
April Ammonia Nitrogen monthly average mg/l results: 2.624 mg/l


In the future we feel to prevent this from recurring the procedure will be if both aerators have to be put out of service we will isolate the aeration ditch from the system until repairs have been completed at which time it will remain isolated for 24 hours while it is being aerated and after that put back in service.

If you have any questions or concerns you may contact me at the above phone number.

Yours very truly,




Don M. O'Neal
General Manager

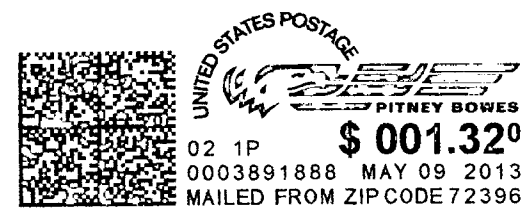

WYNNE WATER UTILITIES

121 E. MERRIMAN
WYNNE, AR 72396

(870) 238-2751
"Water is Life"



TO:

**Arkansas Department of Environmental Quality
NPDES Enforcement Section
5301 Northshore Dr.
North Little Rock, Arkansas 72118-5317**