

THE CITY OF NEWPORT  
 WASTEWATER TREATMENT PLANT  
 615 THIRD STREET  
 FACILITY LOCATION  
 121 HIGHWAY 17 SOUTH  
 NEWPORT, ARKANSAS 72112  
 PHONE: (870) 523-8121  
 FAX: (870) 523-8214

Arkansas Department Of Environmental Quality  
 5301 Northshore Drive  
 North Little Rock, AR 72112


11 February 2020

Re: NPDES Permit #AR0045225  
 Non Compliance Report for January 2020

DATE	OUTFALL	PARAMETER	UNITS	PERMIT LIMIT	VIOLATION
1/13/20	001	DO	mg/L	> 6.0	1.0
1/13/20	001	TSS Max	mg/L	30	3457
Jan 2020	001	TSS Month Avg	mg/L	20	3457
Jan 2020	001	TSS month Load	lb/day	83.4	4728
Jan 2020	001	Ammonia Nitrogen Month Avg	mg/L	8.0	9.7
1/13/20	001	Fecal Max	#/100ml	2000	21800
Jan 2020	001	Fecal Month Avg	#/100ml	1000	21800
1/13/20	001	CBOD Max	mg/L	30	1050.7
Jan 2020	001	CBOD Month Avg	mg/L	20	1050.7
Jan 2020	001	CBOD Month Load	lb/day	83.4	1437
1/13/20	001	O & G Max	mg/L	15.0	71.75
Jan 2020	001	O & G 30 day avg	mg/L	10.0	71.75
Jan 2020	001	O & G 30 day load	lb/day	41.7	73.1

Excessive rain caused the water level in the aeration basin to overflow the sludge blanket into the effluent pumping basin with more water than the pumps could handle. All overflow water went through the effluent flow meter and exited through outfall 001. Flow was measured and samples were taken for all permitted parameters as normal discharge. Discharge was ceased 1/20/20 and all water is now contained.

Sincerely,

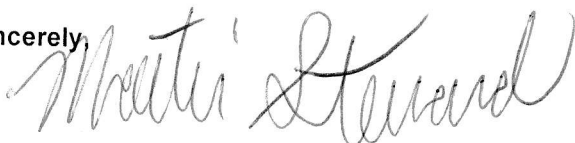

Martin Steward  
 Superintendent WWTP

cc: David Stewart, Mayor