

**ARKANSAS DEPARTMENT OF ENVIRONMENTAL QUALITY
MONITORING REPORT FOR DECENTRALIZED WASTEWATER TREATMENT FACILITIES VIA DRIP IRRIGATION
MONTHLY MONITORING REPORT**

PERMITTEE NAME
Benton County, Arkansas Suburban Sewer District No 1 Villages of Cross Creek
PERMITTEE ADDRESS
PO Box 9299 Fayetteville AR 72703

FACILITY NAME (IF DIFFERENT)
Villages of Cross Creek

PERMIT NO.
4811-WR-4

FACILITY ADDRESS
3302 N Dixieland Rd Little Flock AR

AFIN NO.
04-00899

WASTEWATER EFFLUENT MONITORING PERIOD	
MM/DD/YYYY	MM/DD/YYYY
3/1/2021	3/31/2021

TREATED WASTEWATER EFFLUENT SAMPLING

PARAMETER	Limit	Sample Measurement	UNITS	Monitoring	Reporting
Flow, Monthly total	REPORT	0.516,124	MG	Total Flow per calendar month	Prior to the 15th of the following Month
Flow, daily maximum	REPORT	0.021,235	MGD	Daily	
Carbonaceous Biochemical Oxygen Demand (CBOD5)	30	15.2	mg/l	Grab Sample once per month	
Total Suspended Solids (TSS)	30	24	mg/l		
Fecal Coliform Bacteria (FCB)	10,000	10.0	colonies/100ml		
pH	6.0 - 9.0	7.1	s.u.		
Total Phosphorus (TP)	REPORT	7	mg/l		
Total Kjeldahl Nitrogen (TKN)	REPORT		mg/l	Grab sample once per quarter	
Ammonia Nitrogen	REPORT		mg/l		
Nitrate Nitrogen (NO ₃ -N) + Nitrite Nitrogen (NO ₂ -N)	REPORT		mg/l		
Plant Available Nitrogen (PAN)	REPORT		mg/l		
Loading Rate	REPORT	SEE ATTACHED	gpd/ft ²	Daily	

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT.	 SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT	TELEPHONE	DATE
			(479) 530-5926	4/13/2021
TYPED OR PRINTED				MM/DD/YYYY

COMMENTS AND EXPLANATION OF VIOLATIONS (*Reference all attachments here*)

MARCH 2021 VILLAGES OF CROSS CREEK LOADING RATES

Daily Max

21,235

Zone Identification

GPD/sq 2

1

2400

2

2400

3

2400

4

2400

5

2400

6

2400

7

2272

8

2227

9

Not used

10

Combined with 8

11

2,336

12

Not used

13

Not used

14

Not used

15

Not used

16

Not used

17

Not used

Environmental Services Company, Inc.

Corporate Office
 13715 West Markham
 Little Rock, AR 72211
 Tel. (501)221-2565 Fax (501)221-1341

Northwest Arkansas Branch
 1107 Century Avenue
 Springdale, AR 72762
 Tel. (479)750-1170 Fax (479)750-1172

Control Number: 2103020035
 Customer Name : DIXIELAND UTILITY LLC
 Customer/Permit No. : 1698 / 4811-WR-4 001
 Report Date : 03/17/21

Sample Date : 03/11/21
 Sample Time : 1430
 Sample Type : GRAB
 Sample From : EFFLUENT

Collected By: HNS
 Delivery By : HNS
 Work Order :
 Purchase Order :

Laboratory Analysis

Analysis						Quality Assurance			
Date	Time	By	Parameter	Result	Notes	Quantity	Method	Precision	Accuracy
								% RPD	% Recovery
03/11	1432	HNS	pH	7.1 S.U.			SM 2011 4500-H+ B	0.00	N/A *
03/12	1130	HNS	Phosphorous, Total (as P)	7.00 mg/L			EPA 365.3	0.39	101.0 *
03/12	1300	HNS	Solids, Total Suspended	24.0 mg/L			SM 2011 2540 D	2.29	N/A *
03/11	1645	HNS	Fecal Coliform (MPN/100mL)	10.0 /100ml			06/2012 Colilert18	0.00	N/A *
03/12	0800	TWM	BOD, Carbonaceous	15.2 mg/L			SM 2001 5210 B	14.81	107.0 *

* QA data shown is from a different sample or standard on the same date.

All equipment used is checked and/or calibrated daily. All NPDES testing is conducted in accordance with 40 CFR Part 136. A minimum of 10% spiked and duplicate samples is run on each parameter where applicable for Quality Assurance purposes. Quality Assurance Plan on file with Arkansas Department of Environmental Quality. Analysis time indicates the time of the start of the analytical batch in which the specific sample was included.


Signature _____

Environmental Services Co., Inc.

Kristin Mullins

516124 21239

Environmental Services Company, Inc.
 - Northwest Arkansas
 1107 Century Street
 Springdale, Arkansas 72762
 website: www.esclabs.com

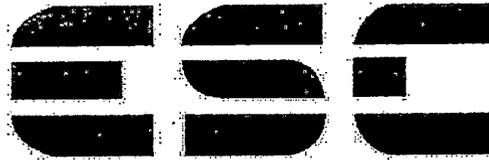



Corporate Office, Little Rock, Arkansas
 501-221-2565

Carlsbad, New Mexico
 575-887-1ESC

Phone: 479-750-1170 Fax: 479-750-1172

CHAIN OF CUSTODY

Client Information				Project Information						Requested Parameters									
Company Name: Dixieland Utility LLC.				Permit/Project #: Monthly						CBOD (70), TSS (28)	T-Phosphorus (25)	Fecal Coliform (43.IF)	pH (23)						
Address: 3302 N. Dixieland Rogers AR				Purchase Order #:															
Telephone: (479)936-0333 (Cell)				Sampler Name(s): <i>Hayden Smith</i>															
Telephone:				and Signature(s): <i>Hayden Smith</i>															
ESC Client Number: 1698																			
Sample Identification		Sample Collection				Sample Containers													
Identification	ESC Control #	Date	Time	Type	Matrix	Type	Volume	Preservative	#										
Dose Tank/Effluent	210300035	3-11-21	1430	GRAB	Water	plastic	1/2 gal	None, Cool	1	X									
Dose Tank/Effluent	↓	↓	↓	GRAB	Water	plastic	250 MI	H ₂ SO ₄ , pH < 2	1		X								
Dose Tank/Effluent	↓	↓	↓	GRAB	Water	Sterile	100 mL	Na ₂ S ₂ O ₄ , Cool	1			X							
Dose Tank/Effluent	↓	↓	↓	GRAB	Water	Glass	250 mL	None	0				X						
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)		Date	Time	Custody Seals:		Used? <input checked="" type="checkbox"/>		Intact? <input type="checkbox"/>							
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)		Date	Time	Turnaround:		Regular <input checked="" type="checkbox"/>		Special <input type="checkbox"/>							
Relinquished By: (Signature and Printed Name)		Date	Time	Received for Lab By: (Signature and Printed Name)		Date	Time	Were samples properly preserved:		Yes <input checked="" type="checkbox"/>		No <input type="checkbox"/>							
Comments:				FLOW DATA		Field Test		Time	Analyst	Result	Result	Units							
				Analyst:		pH:		1432	HNS	7.1	7.1	°C °F							
				Time:		Temp.:													
				Reading:		DO:													
				Units:		Debris:													
HNS Cool all samples to 6 degrees C.				Chlorinated? Yes No		This Document is Page 1 of 1													

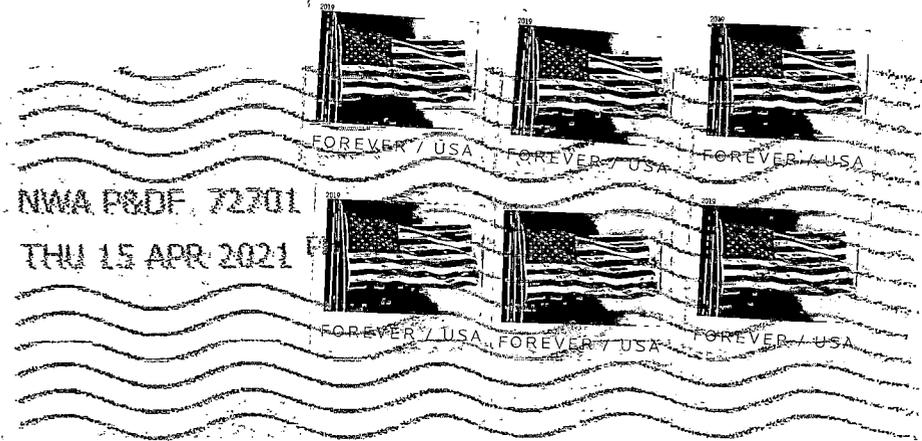

 ***NWA Utility Services Inc***
PO Box 9299
Fayetteville, AR 72703

ADEQ
WATER DIVISION/PERMITS BRANCH
5301 Northshore Drive
N Little Rock, AR 72118-5317