

**ARKANSAS DEPARTMENT OF ENVIRONMENTAL QUALITY
DECENTRALIZED WASTEWATER TREATMENT FACILITIES VIA DRIP IRRIGATION
MONTHLY MONITORING REPORT**

PERMITTEE NAME
Bethel Oaks Property Owners Association Inc
PERMITTEE ADDRESS
12531 Bethel Oaks Dr Farmington AR 72730

FACILITY NAME
Bethel Oaks Subdivision

PERMIT NO.
4875-WR-3

FACILITY ADDRESS
CR 62 Farmington AR

AFIN NO.
72-01656

WASTEWATER EFFLUENT MONITORING PERIOD		
MM/DD/YYYY		MM/DD/YYYY
3/1/2021		3/31/2021

TREATED WASTEWATER EFFLUENT SAMPLING					
Parameter	Limit	Sample Measurement	Units	Monitoring	Reporting
Flow, Monthly total	REPORT	0.255,060	MG	Total Flow per calendar month	Prior to the 15th of the following Month
Flow, daily maximum *	REPORT	0.013800	GD	Daily	
Carbonaceous Biochemical Oxygen Demand (CBOD5)	30	< 2.0	mg/l	Grab Sample once per month	
Total Suspended Solids (TSS)	45	20.8	mg/l		
Fecal Coliform Bacteria (FCB)	7,800	< 5.0	colonies/100ml		
pH	6.0 - 9.0	7.2	s.u.		
Total Phosphorus (TP)	REPORT	4.68	mg/l		
Total Kjeldahl Nitrogen (TKN)	REPORT		mg/l	Grab sample once per quarter	
Ammonia Nitrogen	REPORT		mg/l		
Nitrate Nitrogen (NO3-N) + Nitrite Nitrogen (NO2-N)	REPORT		mg/l		
Plant Available Nitrogen (PAN)	REPORT		mg/l		
NAME OF PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT.			TELEPHONE	
Kathy Bartlett				SIGNATURE OF COGNIZANT OFFICIAL	(479) 530-5926
TYPED OR PRINTED					DATE
COMMENTS AND EXPLANATION OF VIOLATIONS (Reference all attachments here)					
See attached NCR for explanation of elevated TSS limits this month					

* LOADING RATE BY ZONE					
Zone 1	1150	Zone 5	1150	Zone 9	1150
Zone 2	1150	Zone 6	1150	Zone 10	1150
Zone 3	1150	Zone 7	1150	Zone 11	1150
Zone 4	1150	Zone 8	1150	Zone 12	1150

Environmental Services Company, Inc.

Corporate Office
 13715 West Markham
 Little Rock, AR 72211
 Tel. (501)221-2565 Fax (501)221-1341

Northwest Arkansas Branch
 1107 Century Avenue
 Springdale, AR 72762
 Tel. (479)750-1170 Fax (479)750-1172

Control Number: 2103020059
 Customer Name : BETHEL OAKS UTILITY, LLC
 Customer/Permit No. : 1855 / 4875-WR-3
 Report Date : 03/26/21

Sample Date : 03/18/21
 Sample Time : 1615
 Sample Type : GRAB
 Sample From : EFFLUENT

Collected By: TWM
 Delivery By : TWM
 Work Order :
 Purchase Order :


Laboratory Analysis

Analysis						Quality Assurance			
Date	Time	By	Parameter	Result	Notes	Quantity	Method	Precision % RPD	Accuracy % Recovery
03/18	1620	TWM	pH	7.2 S.U.			SM 2011 4500-H+ B	0.00	N/A
03/22	1500	HNS	Phosphorous, Total (as P)	4.68 mg/L			EPA 365.3	0.38	98.0 *
03/19	1300	HNS	Solids, Total Suspended	20.8 mg/L			SM 2011 2540 D	5.71	N/A *
03/18	1715	TWM	Fecal Coliform (MPN/100mL)	< 5.0 /100mL			06/2012 Colilert18	0.00	N/A *
03/19	0810	TWM	BOD, Carbonaceous	< 2.0 mg/L			SM 2001 5210 B	0.00	79.7

* QA data shown is from a different sample or standard on the same date.

All equipment used is checked and/or calibrated daily. All NPDES testing is conducted in accordance with 40 CFR Part 136. A minimum of 10% spiked and duplicate samples is run on each parameter where applicable for Quality Assurance purposes. Quality Assurance Plan on file with Arkansas Department of Environmental Quality. Analysis time indicates the time of the start of the analytical batch in which the specific sample was included.

Signature _____

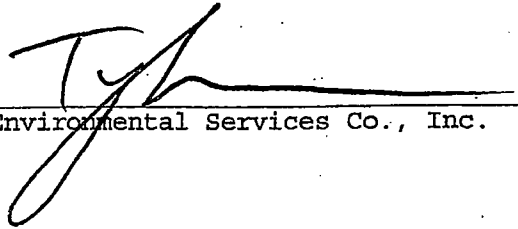

Environmental Services Co., Inc.

RSW

255060
 13800

Environmental Services Company, Inc.
 Northwest Arkansas
 1107 Century Street
 Springdale, Arkansas 72762
 website: www.esclabs.com





Corporate Office, Little Rock, Arkansas
 501-221-2565


Carlsbad, New Mexico
 575-887-1ESC

Phone: 479-750-1170 Fax: 479-750-1172

CHAIN OF CUSTODY

Client Information				Project Information						Requested Parameters									
Company Name: Bethel Oaks Utility, LLC				Permit/Project #: _____						T Phos (25)	Fecal Coliform (43.IF)	CBOD (70), TSS (28)	pH (23)						
Address: 6516 Mesa Street				Purchase Order #: _____															
Fayetteville, AR 72704				Sampler Name(s): <i>[Signature]</i>															
Telephone: 479-790-3813				and Signature(s): <i>[Signature]</i>															
Telephone: _____																			
ESC Client Number: 1855																			
Sample Identification		Sample Collection				Sample Containers													
Identification	ESC Control #	Date	Time	Type	Matrix	Type	Volume	Preservative	#										
EFFLUENT	2163020059	3/18/21	16:15	GRAB	Water	Plastic	8 oz	H ₂ SO ₄ , pH<2	1	X									
EFFLUENT	↓	↓	↓	GRAB	Water	Sterile	100 ml	Na ₂ S ₂ O ₃	1		X								
EFFLUENT	↓	↓	↓	GRAB	Water	Plastic	1 qt	none/ice	1			X							
EFFLUENT	↓	↓	↓	GRAB	Water	Glass	150 ml	none	0				X						
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)				Date	Time	Custody Seals:		Used?	<input checked="" type="checkbox"/>	Intact?	<input type="checkbox"/>				
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)				Date	Time	Turnaround:		Regular	<input checked="" type="checkbox"/>	Special	<input type="checkbox"/>				
Relinquished By: (Signature and Printed Name)		Date	Time	Received for Lab By: (Signature and Printed Name)				Date	Time	Were samples properly preserved:		Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>				
Comments:						FLOW DATA	Field Test	Time	Analyst	Result	Result	Units							
						Analyst:	pH:	1620	<i>[Signature]</i>	7.2	7.2								
						Time:	Temp.:					°C	°F						
						Reading:	DO:												
						Units:	Debris:												
Cool all samples to 6 degrees C.						Chlorinated? Yes No				This Document is Page <u>1</u> of <u>1</u>									

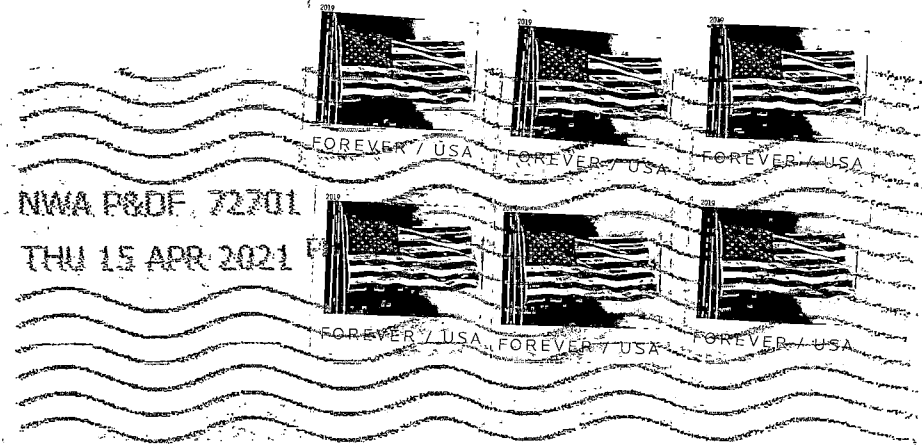

 ***NWA Utility Services Inc***
PO Box 9299
Fayetteville, AR 72703

ADEQ
WATER DIVISION/PERMITS BRANCH
5301 Northshore Drive
N Little Rock, AR 72118-5317