

**ARKANSAS DEPARTMENT OF ENVIRONMENTAL QUALITY
DECENTRALIZED WASTEWATER TREATMENT FACILITIES VIA DRIP IRRIGATION
MONTHLY MONITORING REPORT**

PERMITTEE NAME

First Asset Holding

PERMITTEE ADDRESS

PO Box 7
Ft Smith AR 72902

FACILITY NAME

Deer Haven Subdivision

FACILITY ADDRESS

15046 Smith Ridge Rd
Garfield AR 72732

PERMIT NO.

4908-WR-2

AFIN NO.

04-01681

WASTEWATER EFFLUENT MONITORING PERIOD

MM/DD/YYYY

11/1/2019

MM/DD/YYYY

11/30/2019

TREATED WASTEWATER EFFLUENT SAMPLING

Parameter	Limit	Sample Measurement	Units	Monitoring	Reporting
Flow, Monthly total	REPORT	0.297683	MG	Total Flow per calendar month	Prior to the 15th of the following Month
Flow, daily maximum *	REPORT	0.021247	GPD	Daily	
Carbonaceous Biochemical Oxygen Demand (CBOD5)	30	< 2.0	mg/l	Grab Sample once per month	
Total Suspended Solids (TSS)	45	9.2	mg/l		
Fecal Coliform Bacteria (FCB)	4,000	< 4.0	colonies/100ml		
pH	6.0 - 9.0	7.5	s.u.		
Total Phosphorus (TP)	REPORT	7.28	mg/l		
Total Kjeldahl Nitrogen (TKN)	REPORT		mg/l	Grab sample once per quarter	
Ammonia Nitrogen	REPORT		mg/l		
Nitrate Nitrogen (NO3-N) + Nitrite Nitrogen (NO2-N)	REPORT		mg/l		
Plant Available Nitrogen (PAN)	REPORT		mg/l		

NAME OF PRINCIPAL EXECUTIVE OFFICER

Kathy Bartlett

TYPED OR PRINTED

I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT.

Kathy Bartlett
SIGNATURE OF COGNIZANT OFFICIAL

TELEPHONE

(479) 530-5926

DATE

12/16/2019

COMMENTS AND EXPLANATION OF VIOLATIONS (Reference all attachments here)

*** LOADING RATE BY ZONE**

Zone 1	3548	Zone 5	3548
Zone 2	3548	Zone 6	3548
Zone 3	3548		
Zone 4	3548		

Environmental Services Company, Inc.

Corporate Office
13715 West Markham
Little Rock, AR 72211
Tel. (501)221-2565 Fax (501)221-1341

Northwest Arkansas Branch
1107 Century Avenue
Springdale, AR 72762
Tel. (479)750-1170 Fax (479)750-1172

Control Number: 1911020126
Customer Name : DEER HAVEN UTILITY LLC
Customer/Permit No. : 1821 / 4908-WR-1
Report Date : 12/02/19

Sample Date : 11/21/19
Sample Time : 1400
Sample Type : GRAB DEER HAVEN
Sample From : DOSE TANK EFFLUENT

Collected By: JEW
Delivery By : JEW
Work Order :
Purchase Order :


Laboratory Analysis

Analysis							Quality Assurance	
Date	Time	By	Parameter	Result	Notes	Quantity	Precision % RPD	Accuracy % Recovery
11/21	1410	JEW	pH	7.5 S.U.				
11/22	1445	TSB	Phosphorous, Total (as P)	7.28 mg/L			0.58	108.0 *
11/26	1430	TSB	Solids, Total Suspended	9.2 mg/L			5.00	N/A *
11/21	1712	TSB	Fecal Coliform (MPN/100mL)	< 4.0 /100mL			0.00	0.0 *
11/22	1200	TSB	BOD, Carbonaceous	< 2.0 mg/L			2.05	99.6 *

* QA data shown is from a different sample or standard on the same date.


All equipment used is checked and/or calibrated daily. All NPDES testing is conducted in accordance with 40 CFR Part 136. A minimum of 10% spiked and duplicate samples is run on each parameter where applicable for Quality Assurance purposes. Quality Assurance Plan on file with Arkansas Department of Environmental Quality. Analysis time indicates the time of the start of the analytical batch in which the specific sample was included.

Signature


Environmental Services Co., Inc.

297,683
21,247

Environmental Services Company, Inc.
Northwest Arkansas
1107 Century Street
Springdale, Arkansas 72762
website: www.esclabs.com

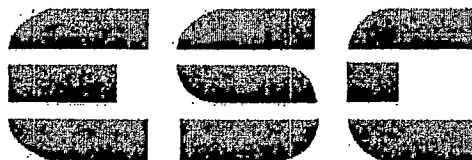

Corporate Office, Little Rock, Arkansas
501-221-2565

Carlsbad, New Mexico
575-887-1ESC


Phone: 479-750-1170 Fax: 479-750-1172

CHAIN OF CUSTODY


Client Information						Project Information					Requested Parameters							
Company Name: Deer Haven Utility LLC						Permit/Project #:					pH (23) Total P (25) CBOD(70), TSS(28) Fecal Coliform (43.IF)							
Address: PO Box 127						Purchase Order #:												
Avoca Ar 72711						Sampler Name(s): <i>James Wilk James Wilk</i>												
Telephone:						and Signature(s):												
Telephone:																		
ESC Client Number: 1821																		
Sample Identification		Sample Collection				Sample Containers												
Identification	ESC Control #	Date	Time	Type	Matrix	Type	Volume	Preservative	#									
Dose Tank/Effluent	1911020126	11-21-19	1400	GRAB	Water	teflon	150 ml	None, Cool [†]	1	X								
Dose Tank/Effluent	1911020126			GRAB	Water	Plastic	8 oz	H ₂ SO ₄ , pH<2	1		X							
Dose Tank/Effluent	1911020126			GRAB	Water	Plastic	1 qt	None, Cool [†]	1			X						
Dose Tank/Effluent	1911020126			GRAB	Water	Whirlpak	100 ml	NaS ₂ O ₄ Cool [†]	1				X					
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)		Date	Time	Custody Seals:										
<i>James Wilk James Wilk</i>		11-21-19	1700					Used? <input checked="" type="checkbox"/> Intact? <input type="checkbox"/>										
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)		Date	Time	Turnaround:										
								Regular <input checked="" type="checkbox"/> Special <input type="checkbox"/>										
Relinquished By: (Signature and Printed Name)		Date	Time	Received By: (Signature and Printed Name)		Date	Time	Were samples properly preserved:										
				<i>James Brooks James Brooks</i>		11-21-19	1700	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>										
Comments:						FLOW DATA	Field Test	Time	Analyst	Result	Result	Units						
						Analyst:	pH:	1410	UEW	7.5	7.5							
						Time:	Temp.:	1416	UEW	16.3	16.3	°C °F						
						Reading:	DO:											
						Units:	Debris:											
†Cool all samples to 6 degrees C.						Chlorinated? Yes No.				This Document is Page 1 of 1								

NWA UTILITY SERVICES, INC

PO Box 9299
Fayetteville, AR
72703

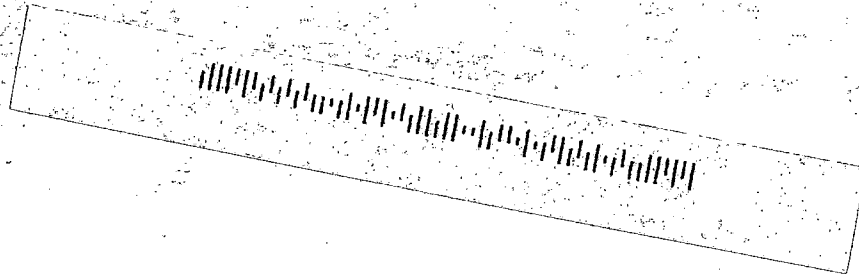

NWA PSDF 72701
FRI 20 DEC 2019 PM

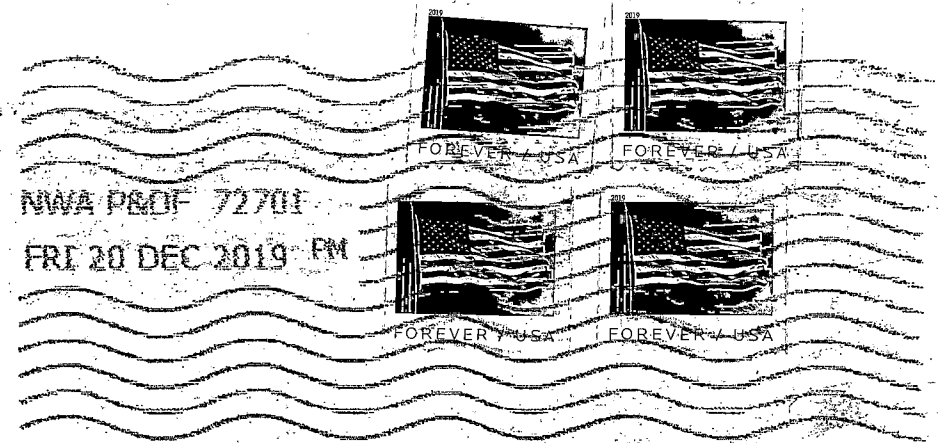

ADEQ
Water Division
Permits Branch
5301 Northshore Dr
North Little Rock, AR
72118