



COMMISSIONERS

Melinda Gould
Dean Pitts
Jess Thompson

Eddie Lindsey
Steven Sosebee
Hugh W. Harrison III, Gen. Mgr.

P.O. Box 1807 • Phone (479) 754-3148 • Clarksville, Arkansas 72830

January 23, 2007

Mr. Allen Gilliam
State Pretreatment Coordinator
ADEQ
P.O. Box 8913
Little Rock, AR. 72219-8913

RE: AR0022187

Dear Mr. Gilliam

Please find the enclosed 4th annual list – violator's industrial users as required by our permit. Please note the violations on attachment A. We do have one in S.N.C., which is Hanesbrand (formally known as Sara Lee) see attachment C. Also Stapleton's Corporation has went out of business see attachment D. I have included our MAHL as required by our permit.

If you have any questions please feel free to call us at 497-754-7929

Sincerely

Gregg Rainey
Superintendent

Pam Crow
Pretreatment Coordinator



NPDES PERMIT FILE
NPDES # AR0022187
AFIN # 3606038

2/6/07 Date Scanned

Legal Notice

In reference with Federal Regulations CFR 40 403.8 (f) (2) (VII) and Legal Authority, City Ordinance #10.04.13 (A), when an industry is in significant noncompliance it must be published in the newspaper.

Hanesbrand Inc. formerly known as Sara Lee is in significant non-compliance with the Publicly Owned Treatment Works. Hanesbrand is working aggressively to correct this problem.

Hugh Harrison, General Manager, Clarksville Light & Water Company.

(Published in the *Johnson County Graphic* Jan. 24, 2007.)

ATTACHMENT C
PRETREATMENT PERFORMANCE SUMMARY (PPS)

NOTE: ALL QUESTIONS REFER TO THE INDUSTRIAL PRETREATMENT PROGRAM AS APPROVED BY THE EPA. THE PERMITTEE SHOULD NOT ANSWER THE QUESTIONS BASED ON CHANGES MADE TO THE APPROVED PROGRAM WITHOUT DEPARTMENT AUTHORIZATION.

I. General Information

Control Authority Name Clarksville Light + Water
 Address P.O. Box 1807
 City Clarksville State/Zip AR. 72830
 Contact Person Pam Crow Position Pretreatment Coordinator
 Contact Telephone 479-754-7929 NPDES Permit Nos. AR0022187
 Reporting Period Jan. / 06 Dec. / 06
 (Beginning Month and Year) (Ending Month and Year)
 Total Number of Categorical IUs 3
 Total Number of Significant Noncategorical IUs 2

II. Significant Industrial User Compliance

	SIGNIFICANT INDUSTRIAL USERS	
	<u>Categorical</u>	<u>NonCategorical</u>
1) No. of SIUs Submitting BMRs/Total No. Required.	<u>0/0</u>	<u>N/A*</u>
2) No. of SIUs Submitting 90-Day Compliance Reports/No. Required.	<u>0/0</u>	<u>N/A*</u>
3) No. of SIUs Submitting Semiannual Reports/ Total No. Required.	<u>3/3</u>	<u>2/2</u>
4) No. of SIUs Meeting Compliance Schedule/ Total No. Required to Meet Schedule	<u>0/0</u>	<u>1/1</u>
5) No. of SIUs in Significant Noncompliance/ Total No. of SIUs	<u>0/0</u>	<u>1/2</u>
6) Rate of Significant Noncompliance for all SIUs (categorical and noncategorical) . . .		<u>1/5</u>

III. Compliance Monitoring Program

SIGNIFICANT INDUSTRIAL USERS
Categorical NonCategorical

1) No. of Control Documents Issued/Total No. Required.	<u>0/0</u>	<u>1/1</u>
2) No. of Nonsampling Inspections Conducted.	<u>3</u>	<u>2</u>
3) No. of Sampling Visits Conducted.	<u>9</u>	<u>1</u>
4) No. of Facilities Inspected (nonsampling)	<u>3</u>	<u>1</u>
5) No. of Facilities Sampled	<u>2</u>	<u>2</u>

IV. Enforcement Actions

SIGNIFICANT INDUSTRIAL USERS
Categorical NonCategorical

1) No. of Compliance Schedules Issued/No. of Schedules Required	<u>0/0</u>	<u>0/0</u>
2) No. of Notices of Violations Issued to SIUs	<u>6</u>	<u>27</u>
3) No. of Administrative Orders Issued to SIUs	<u>0</u>	
4) No. of Civil Suits Filed.	<u>0</u>	
5) No. of Criminal Suits Filed	<u>0</u>	
6) No. of Significant Violators (attach newspaper publication)	<u>1</u>	
7) Amount of Penalties Collected (total dollars/IUs assessed)	<u>0/0</u>	<u>\$ 33678.17 / \$ 33678.17</u>
8) Other Actions (sewer bans, etc.)	<u>0</u>	

The following certification must be signed in order for this form to be considered complete:

I certify that the information contained herein is complete and accurate to the best of my knowledge.

Scott Rainey
 Authorized Representative

1-24-07
 Date

ATTACHMENT A
 PRETREATMENT PROGRAM STATUS REPORT
 UPDATED SIGNIFICANT INDUSTRIAL USERS LIST

Industrial User	SIC Code	Categorical Determination	Control Document		New User	Times Inspected	Times Sampled	Compliance Status				Effluent Limits
			Y/N	Last Action				BMR	Reports			
									90-day Compliance	Semi Annual	Self Monitoring	
Bright Harvest	2033	Non-Categorical	Y	6/1/03	no	one	5	N/A	N/A	1/30	NC	
Sara Lee	2051	Non-Categorical	Y	9/1/04	no	one	6	N/A	N/A	2/30	SNC	
Greenville Tube	3356	Categorical	Y	2/1/04	no	one	4	N/A	N/A	1/30	NC	
Baldor	3621 3564	Categorical	Y	1/2/04	no	one	5	N/A	N/A	1/30	NC	
Stapletons	3499	categorical	Y	7/1/03	no	one	0	N/A	N/A	1/30	C	
Stapletons												
Stapletons												
Sara Lee's name has changed to Harvest Brand Inc. (see attached)												
Baldor has had 4 violations on zinc.												
Greenville Tube has had 1 violation on pH.												

Bright Harvest has had 1 violation non sampling

MONITORING RESULTS (1) FOR THE ANNUAL PRETREATMENT REPORT

REPORTING YEAR: Jan-06 TO Dec-06
 TREATMENT PLANT: CITY OF CLARKSVILLE NPDES PERMIT #AR0022187
 AVERAGE POTW FLOW: 11,065 % IU FLOW 2.67

METALS CYANIDE and PHENOLS (Total)	MAHL mg/l	Influent Dates Sampled (mg/l) Once/Quarter				WQ level/ limit mg/l	Effluent Dates Sampled (mg/l) Once/Quarter				Laboratory Analysis (See Attachment PPS)	
		1/12/06	4/25/06	7/17/06	10/17/06		1/13/06	4/26/06	7/18/06	10/18/06	EPA Method Used	Detection Level Achieved (ug/l)
Antimony	N/A	0	0	0	0	N/A	0	0	0	0	200.8	30
Cadmium	0.01	0	0	0	0	0.0018	0	0	0	0	200.8	4
Copper	0.02	0.044	0.062	0.043	0.017	0.0092	0.011	0.021	0.01	0	200.8	6
Lead	0.01	0	0	0	0	0.0027	0	0	0	0	200.8	40
Mercury	0.00003	0	0	0.00064	0.00045	0.00001	0	0	0	0	245.2	0.2
Nickel	0.04	0	0	0	0	0.097	0	0	0	0	200.8	8
Selenium	0.01	0	0	0.003	0	0.0056	0	0	0.0027	0	200.8	2
Silver	0.0018	0.009	0	0	0	0.0009	0	0	0	0	200.8	7
Zinc	0.22	0.17	0.16	0.26	0.061	0.0855	0.1	0.084	0.053	0.041	200.8	20
Chromium	0.16	0	0	0	0	0.2954	0	0	0	0	200.8	7
Cyanide	0.02	0	0	0	0	0.0058	0	0	0	0.031	335.2	0.00001
Arsenic	0.01	0	0	0	0	N/A	0	0	0	0	200.8	1
Molybdenum	0.01	0	0.011	0	0	N/A	0	0.018	0.01	0	200.8	8
Phenols	N/A	0.051	0.03	0	0.028	N/A	0	0	0.059	0	420.1	0.000005
Beryllium	N/A	0	0	0	0	N/A	0	0	0	0	200.8	0.3
Thallium	N/A	0	0	0	0	N/A	0	0	0	0	200.8	40
Flow, MGD	N/A	1.878	2.084	0.831	1.877	N/A	1.001	0.983	0.52	1.12		

Attachment "C"

1904 Clark Rd.
PO Box 669
Clarksville, AR 72830
USA
+1 479 979 3400 tel

HANESbrandsINC
Formerly Sara Lee


December 11, 2006

Clarksville Light and Water Company
P.O. Box 1807
Clarksville, AR 72830

We are pleased to announce we have successfully completed our spin-off from the Sara Lee, Corporation. Our new name is Hanesbrands, Inc. We began operation as an independent publicly traded company on September 5, 2006.

Hanesbrands, Inc. is a leading marketer of innerwear, outerwear and hosiery apparel.

Our address and phone number are the same, only our name has changed.



Very truly yours,
Hanesbrands, Inc.

Chris Allen
Plant Manager

HBI

Rec-
12/18/06
AC

ville, Ark. 72830

Wednesday, September 27, 2006

Stapleton Metals To Stop Production; Close Doors

Stapleton Metals, located on Mills Road in Clarksville, is closing its doors the week of Oct. 1 when the balance of remaining inventory is shipped out, said Bob Bean. Employees have spent the last few days fabricating product with inventory on hand, advised Bean.

Owner Bob Lensing stated employees were notified in May of the plant closing and expressed his appreciation for those employees who remained through the closing process.

The plant closing is a result of Stapleton's product being outsourced to a foreign country, added Lensing who stated the Van Buren plant will only serve as a distribution center with the accompanying departments such as accounting remaining.

An auction may be held in the future for fixtures and equipment at the Clarksville plant which produced ladders. Lensing stated that some of the equipment includes

stamping equipment, injection molding equipment, tube benders and other fabrication equipment.

The Clarksville plant was opened in 1992 and at the height of manufacturing, the Clarksville plant employed around 40 people, said Lensing and is now downsized to eight employees. Employees being laid off or already laid off will receive assistance through state programs which offer retraining and other special education benefits. One of the benefits is providing 104 weeks of school with full unemployment benefits, stated Bean.

"We've always had a good relationship with the city and community and hate to be leaving," said Lensing. "It's a sign of the times and manufacturing is a tough business." Lensing added that he had fought closing down the manufacturing operation in the face of foreign competition, but in the end, the company had no choice.

BRIGHT HARVEST 2006

DATE	C-BOD			PCF Sampling			Limits			Violat		
	mg/l	TSS	pH	Flow	Oil&Grease	Temp	mg/l	TSS	pH	Temp	Oil&Grease	Yes
2/15/06	38	32	7.6		1.73	7	250	250	6-9 units	150°F	100	
6/23/06	23.77	95.6	7.54		0	28.5	250	250	6-9 units	150°F	100	
6/26/06					54.1		250	250	6-9 units	150°F	100	
6/23/2006*	38	100	7.54		0	28.5	250	250	6-9 units	150°F	100	* Split
9/12/06	18.08	70	7.59		3.78	23.5	250	250	6-9 units	150°F	100	
11/14/06	30.54	69.57	7.08		36.4	13.5	250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
							250	250	6-9 units	150°F	100	
TOTAL	148.39	367	37	0	96.01	101						
AVERAGE	29.68	73.43	7.47	#DIV/0!	16.00	20.20						
MIN	18.08	32	7.08	0	0	7						
MAX	38.00	100	7.6	0	54.1	28.5						

Bright Harvest wanted to split another sample. The one with #10 the one they sent off.

PCF Sampling

DATE	INFLUENT			EFFLUENT			TSS	pH	Temp	Oil&Grease	Influent Oil & Grease	Flow	C-BOD lbs/day	mg/l	TSS	pH	Temp	Oil&Grease	Influent Oil & Grease	Flow	C-BOD lbs/day	mg/l	TSS		
	C-BOD lbs/day	mg/l	TSS lbs/day	C-BOD	Temp	C-BOD																		TSS	
3/9/06	0	0	0	0	40.8	222.5	6.19	22.6	211	211	2700	1350	2700	1350	2700	6.67	29.3	135	148	2700	1350	2700	1350	2700	1350
3/23/06	0	69	0	6.3	34.7	128	6.67	29.3	105	105	2700	1350	2700	1350	2700	6.19	22.6	135	148	2700	1350	2700	1350	2700	1350
5/23/06	0	276	0	6.69	34.7	128	6.67	29.3	105	105	2700	1350	2700	1350	2700	6.19	22.6	135	148	2700	1350	2700	1350	2700	1350
6/20/06	0	0	0	7.13	32.2	425.81	7.18	27.6	133	133	2700	1350	2700	1350	2700	6.42	20.2	52	91.8	2700	1350	2700	1350	2700	1350
8/16/06	0	53	0	6.4	28.4	593	6.42	20.2	91.8	91.8	2700	1350	2700	1350	2700	6.42	20.2	91.8	91.8	2700	1350	2700	1350	2700	1350
12/7/06	0	73	0	6.4	28.4	593	6.42	20.2	91.8	91.8	2700	1350	2700	1350	2700	6.42	20.2	91.8	91.8	2700	1350	2700	1350	2700	1350
TOTAL	3343.5	471	0	26.52	136.1	1369.31	26.46	99.7	727.8	727.8	2700	1350	2700	1350	2700	26.46	99.7	727.8	727.8	2700	1350	2700	1350	2700	1350
AVERAGE	835.875	117.75	0	6.63	34.025	342.3275	6.615	24.925	121.3	121.3	2700	1350	2700	1350	2700	6.615	24.925	121.3	121.3	2700	1350	2700	1350	2700	1350
MIN	758	53	0	6.3	28.4	128	6.19	20.2	52	52	2700	1350	2700	1350	2700	6.19	20.2	52	52	2700	1350	2700	1350	2700	1350
MAX	986.5	276	0	7.18	32.2	593	7.18	29.3	211	211	2700	1350	2700	1350	2700	7.18	29.3	211	211	2700	1350	2700	1350	2700	1350

Self-Monitoring

E	Cd	Cr	Cu	Pb	Ni	Ag	Zn	pH	Dil&Grease:	Temp	CN	Flow	Cd	Cr	Cu	Pb	Ni	Ag	Zn	pH	Dil&Grease:	Temp	CN	Flow
36	0	0.048	0	0	0.22	0	0.008	7.6	0	39.3	0	0.0714	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.081	0.016	0	0.19	0	0.017	6.3	0	39.6	0	0.0105	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.069	0.016	0	0.1	0	0.03	6	0	27.1	0	0.023	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.13	0.011	0	0.18	0	0.045	6.5	0	38.2	0	0.0263	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.11	0.0083	0	0.13	0	0.027	8	0	30.4	0	0.0312	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.0074	0.024	0	0	0	0.015	6.2	0	39.7	0	0.0949	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.04	0	0	0.08	0	0.019	7	0	44.9	0	0.0523	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
36	0	0.18	0.022	0	0.47	0	0.026	7	0	0	0	0.0408	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
06	0	0.22	0.015	0	0.55	0	0.021	7.3	0	35.4	0	0.13763	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
06	0	0.36	0.029	0	0.24	0	0.041	6.2	0	34.1	0	0.079	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
06	0	0.44	0.041	0	0.38	0	0.027	6.2	0	33.2	0	0.0755	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
06	0	0.12	0.0095	0	0.52	0	0	6	0	0	0	0.0755	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
l	0	1.7854	0.1918	0	3.04	0	0.276	60.3	0	361.9	0	0.66753	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
3e	0	0.148783	0.015963	0	0.253333	0	0.023	6.691667	0	36.19	0	0.05553	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
m	0	0.44	0.041	0	0.65	0	0.045	8	0	44.9	0	0.13763	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
m	0	0.0074	0	0	0	0	0	6	0	27.1	0	0.0105	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000


PCF Sampling

Limits


DATE	Cd	Cr	Cu	Pb	Ni	Ag	Zn	pH	Oil&Grease	Temp	CN	Flow	Cd	Cr	Cu	Pb	Ni	Ag	Zn	pH	Oil&Grease	Temp	CN	Flow
2/16/06	0	0.049	0.018	0	0.378	0	0.027	6.34	31.7	36.7			0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
5/25/06	0.416	0.014	0.015	0	0.26	0	0.014	7.5	18.3	35.3			0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
8/8/06	0	0.248	0.028	0	0.406	0.015	0.032	6.24	14.4	44.4			0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
11/14/06	0	0.179	0.018	0	0.308	0.022	0.019	5.35	8.7	30.1			0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
Total	0.416	0.49	0.079	0	1.362	0.037	0.062	25.43	73.1	148.5	0	0	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
average	0.104	0.1225	0.01975	0	0.338	0.00925	0.023	6.3575	18.275	37.125	#DIV/0!	#DIV/0!	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
maximum	0.416	0.248	0.028	0	0.406	0.022	0.032	7.5	31.7	44.4	0	0	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000
minium	0	0.014	0.015	0	0.26	0	0.014	5.35	8.7	30.1	0	0	0.07	1.77	2.07	0.43	2.38	0.24	1.48	6-9 units	100	150°F	0.65	6000

DATE	Self-Monitoring													Limits					Flow	CN	Temp	Oil&Grease	pH	Zn	Violar Yes
	Cd	Cr	Cu	Pb	Ni	Ag	Zn	pH	Oil&Grease	Temp	CN	Flow	Cd	Cr	Cu	Pb	Ni	Ag							
1/12/06	0	0	0.033	0	0	0	0.27	6.52	0	13.6	0	960	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
2/9/06	0	0	0.01	0	0	0	0.079	6.7	0	14	0	1440	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
3/9/06	0	0	0.042	0	0	0	0.23	6.17	35	13.1	0	960	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
3/30/06	0	0	0.16	0	0.017	0	0.76	8.01	22	23.9	0	840	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
4/13/06	0	0	0.023	0	0.014	0	0.3	7.53	0	19.2	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
5/18/06	0	0	0.12	0	0	0	1	6.4	0	27.1	0	840	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
6/6/06	0	0.012	0.053	0	0	0	0.3	7.35	14	34.3	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
7/13/06	0	0	0.055	0	0	0	0.024	7.51	12	53	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
8/10/06	0	0	0.084	0	0.01	0	1.5	6.3	12	27	0	1200	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
9/14/06	0	0	0.084	0	0.01	0	3.1	7.13	7.1	22.4	0	1320	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
9/23/06	0	0.0098	0.12	0	0	0	0.81	7.6	0	37.5	0	720	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
10/10/06	0	0	0.053	0	0	0	3.3	8.5	0	26.2	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
11/6/06	0	0.016	0.24	0	0.01	0	1.2	8.47	0	26.6	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
11/30/06	0	0	0.048	0	0	0	1.2	8.46	24	26.6	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
12/14/06	0	0	0.048	0	0	0	1.2	8.46	24	26.6	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
Total	0	0.0369	1.088	0	0.051	0	14.573	98.95	126.1	338.9	0	11520	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
Average	0	0.002536	0.077714	0	0.003643	0	1.040929	7.067857	8.406667	25.91538	0	866.1538	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
Min	0	0	0.01	0	0	0	0.024	6.17	0	13.1	0	480	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	
Max	0	0.016	0.24	0	0.017	0	3.3	8.47	35	53	0	1440	0.07	1.71	2.07	0.43	2.38	0.24	1.48	6-9 units	100	65.55	0.65	6000	


ANTIMONY

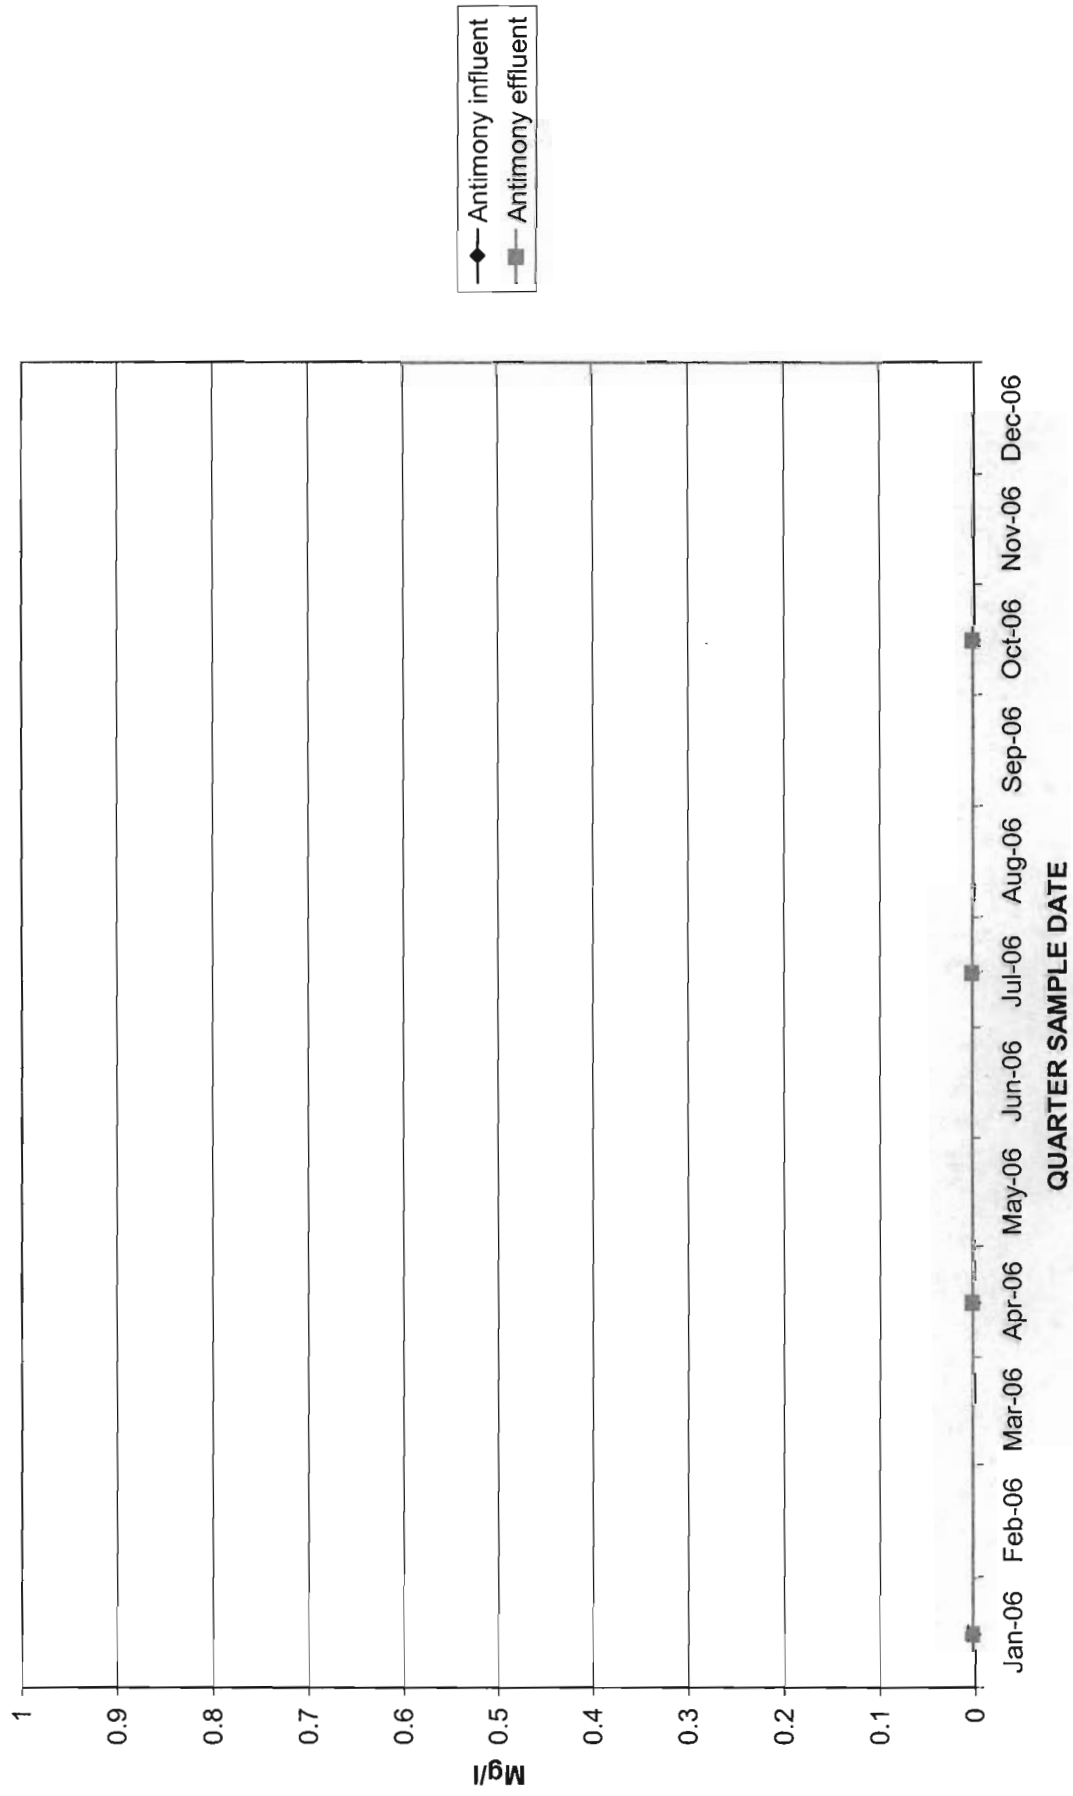


CADMIUM

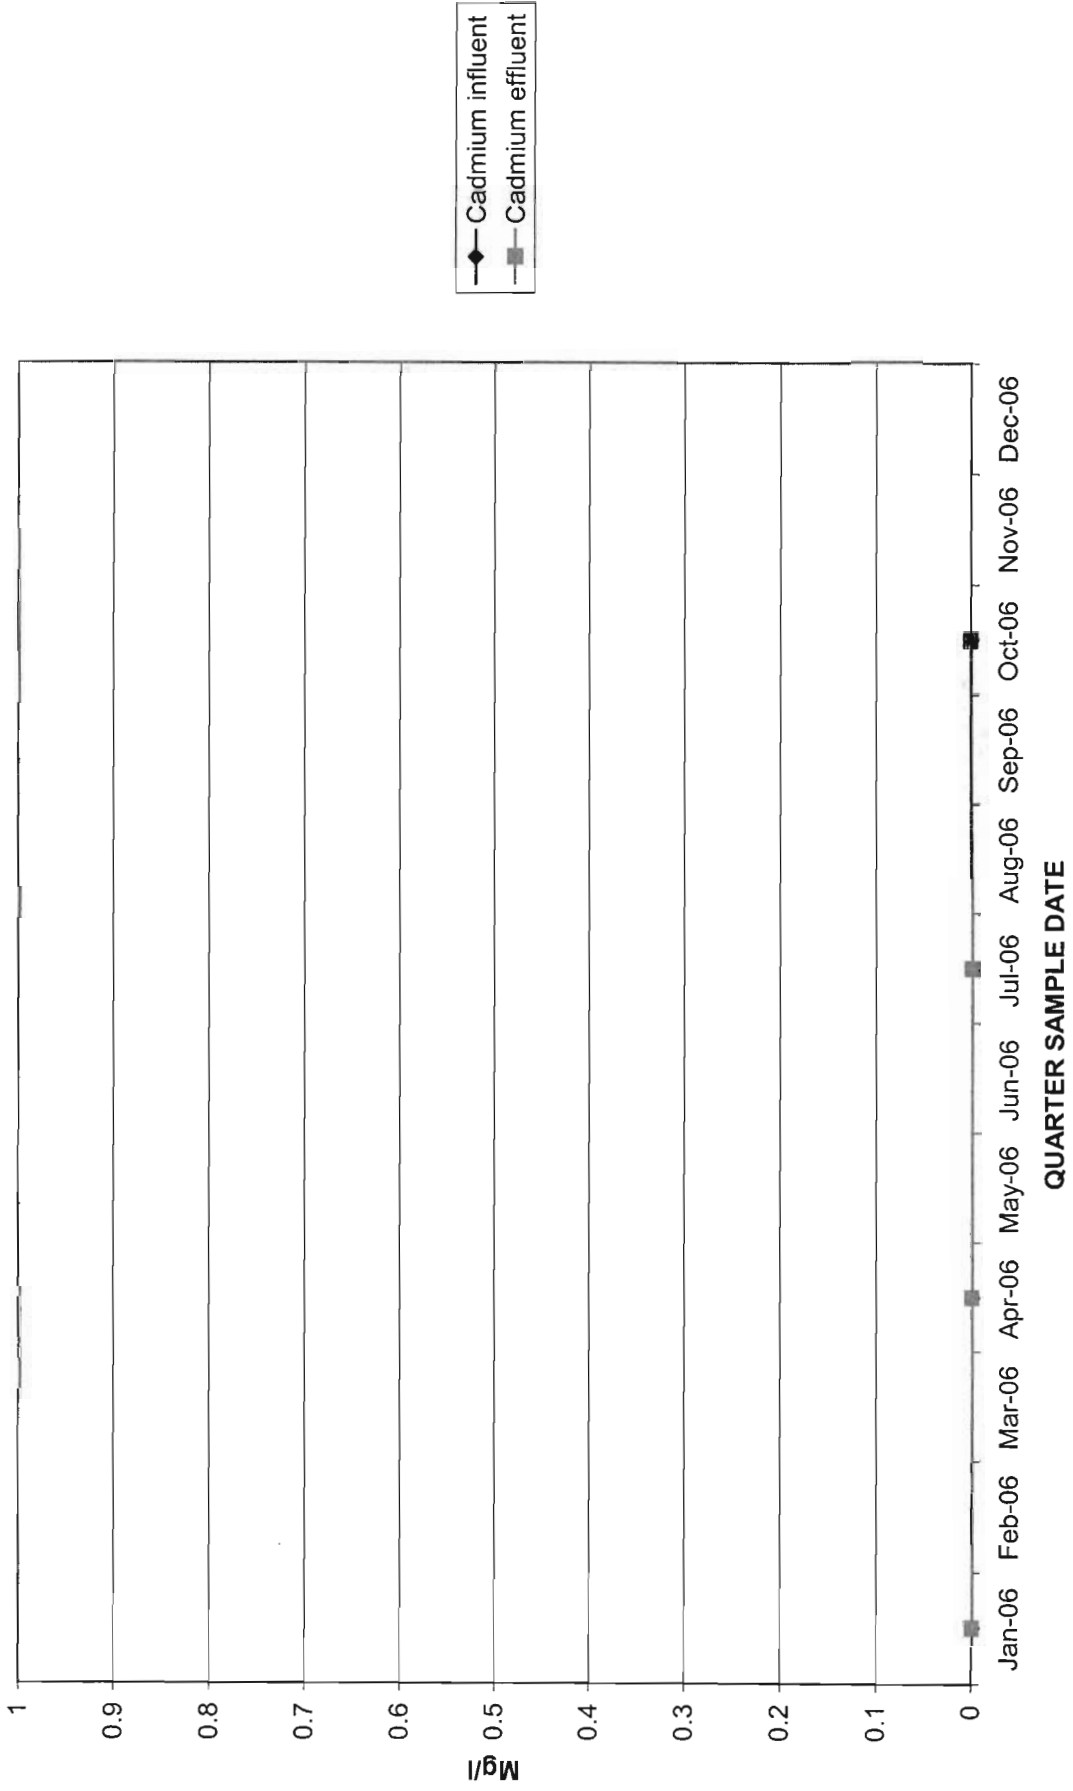


COPPER

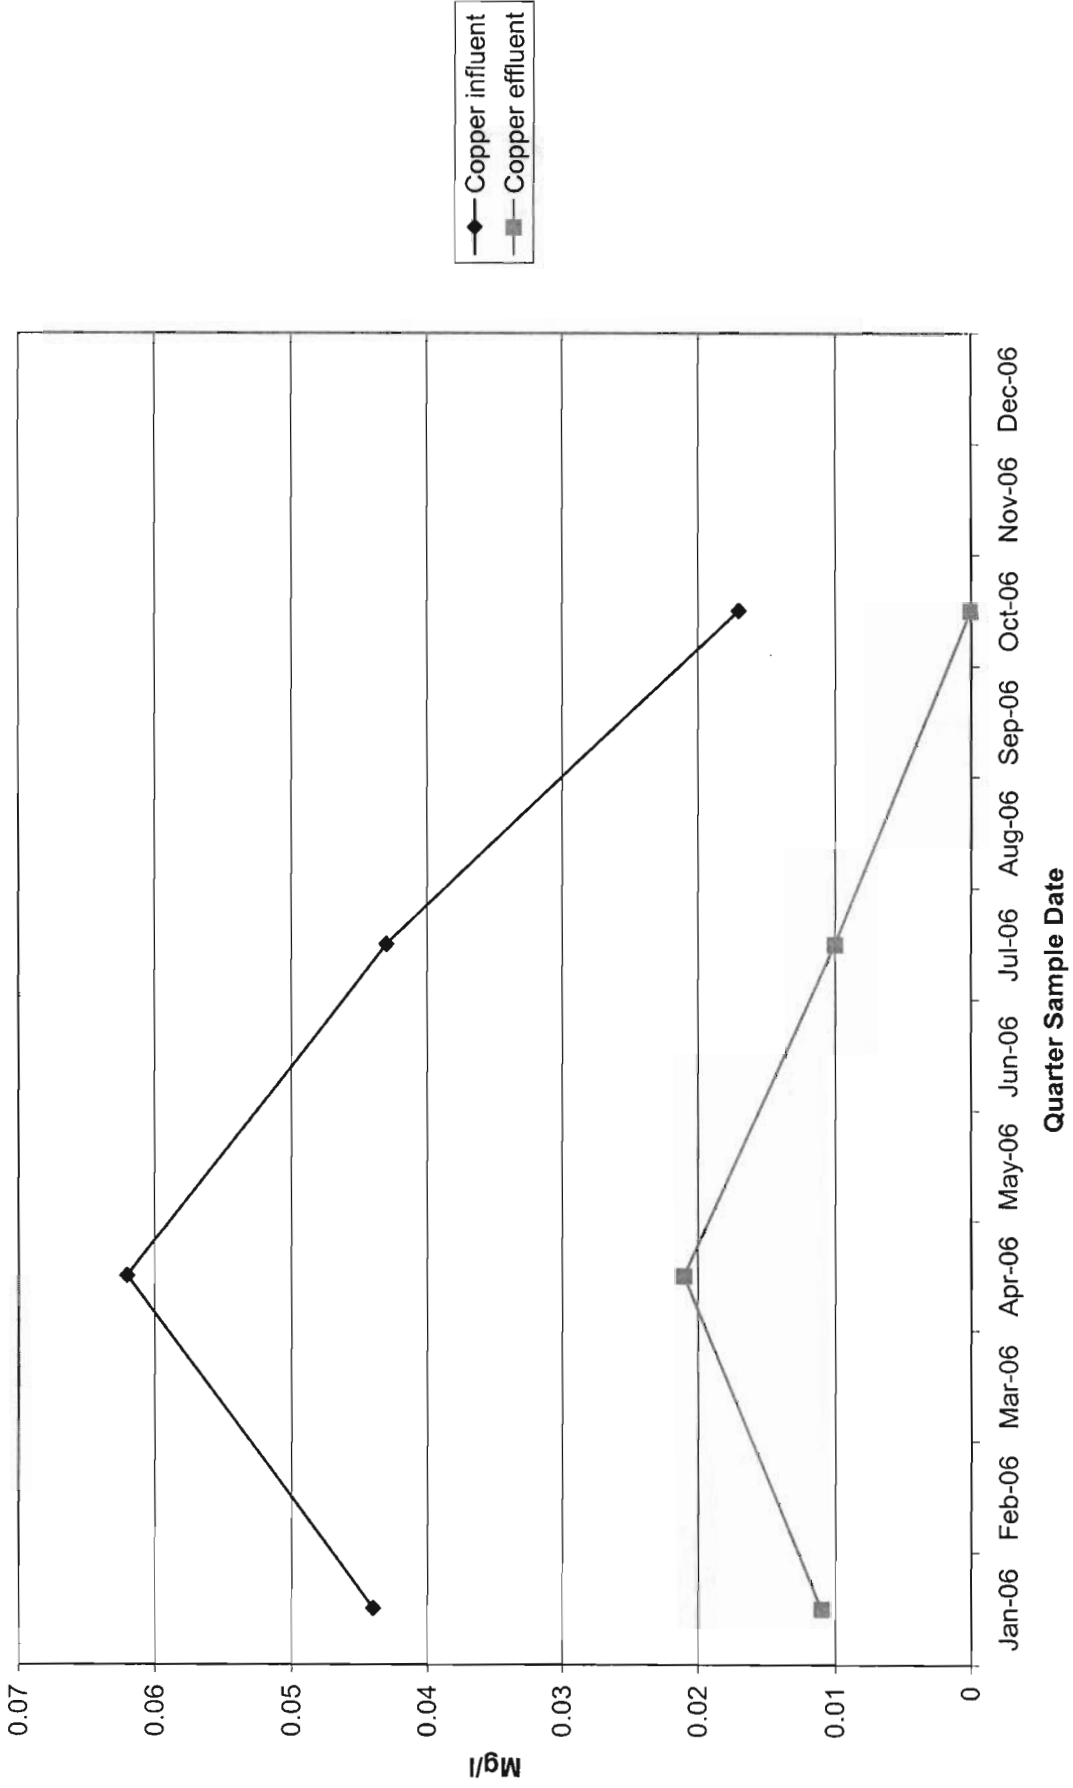


LEAD

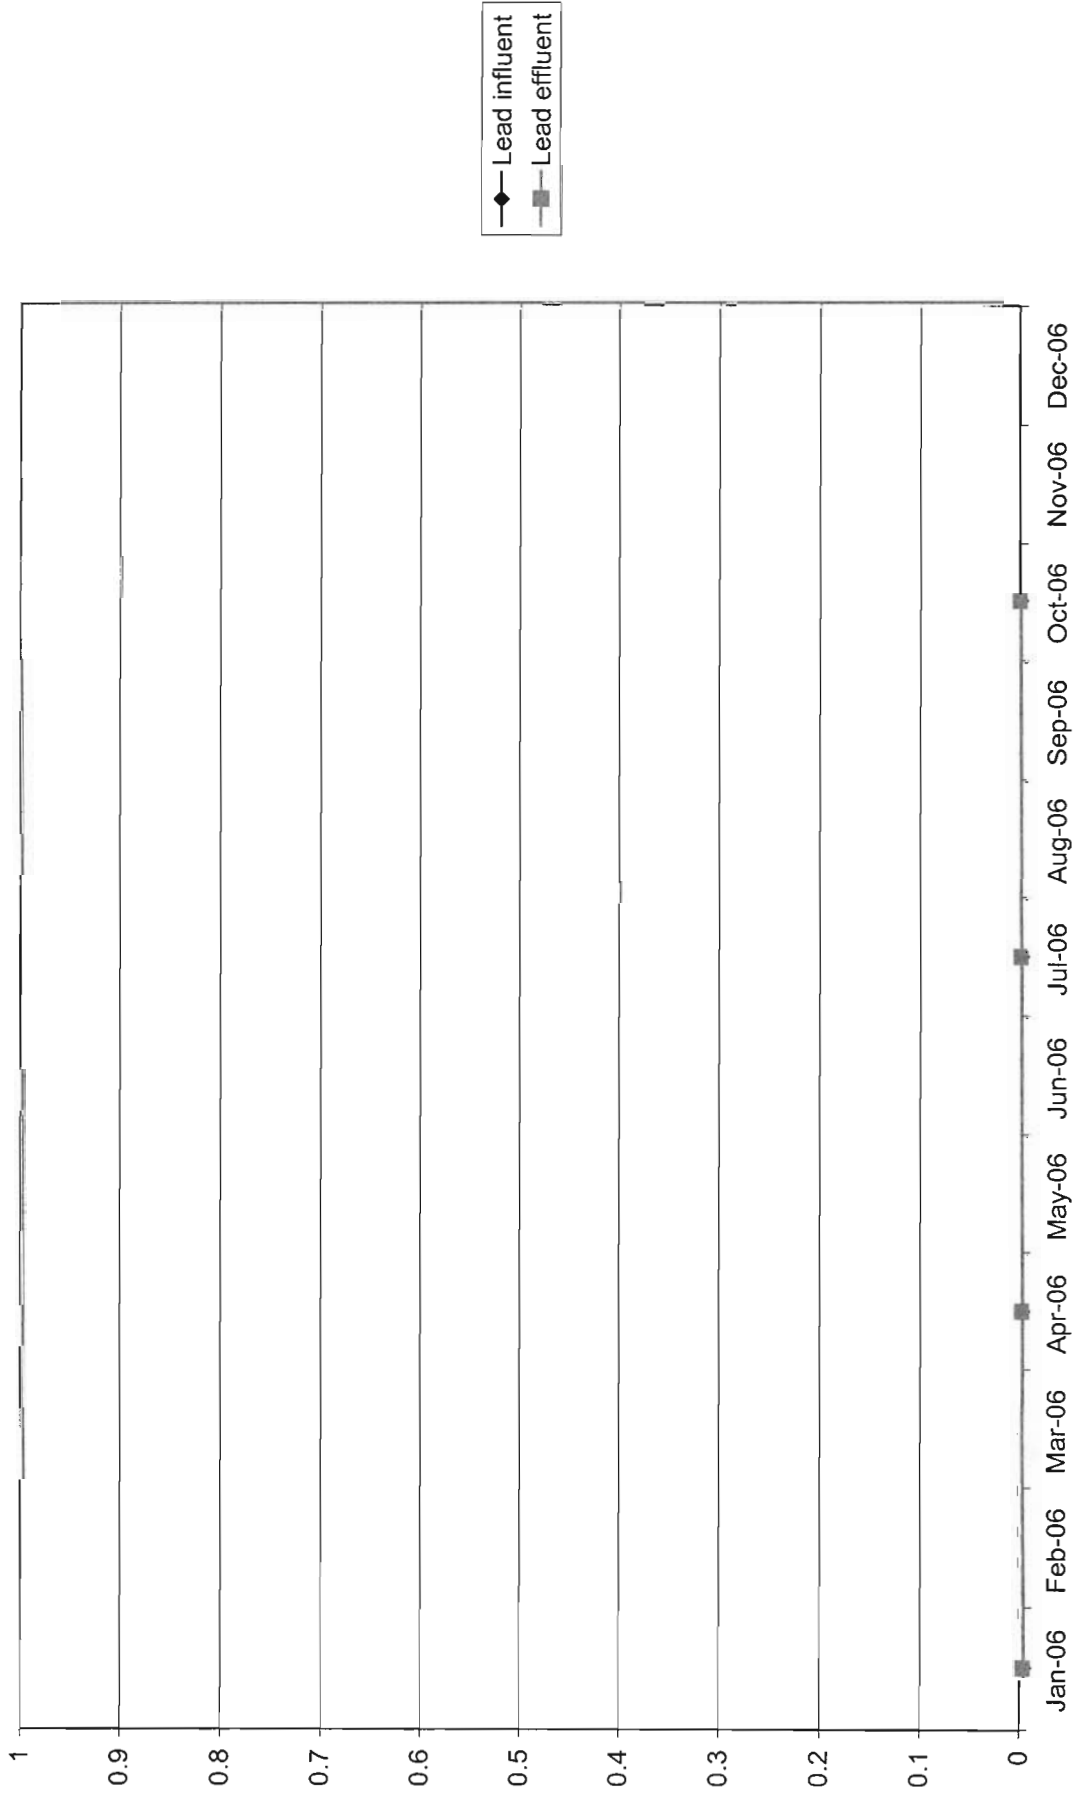


MERCURY

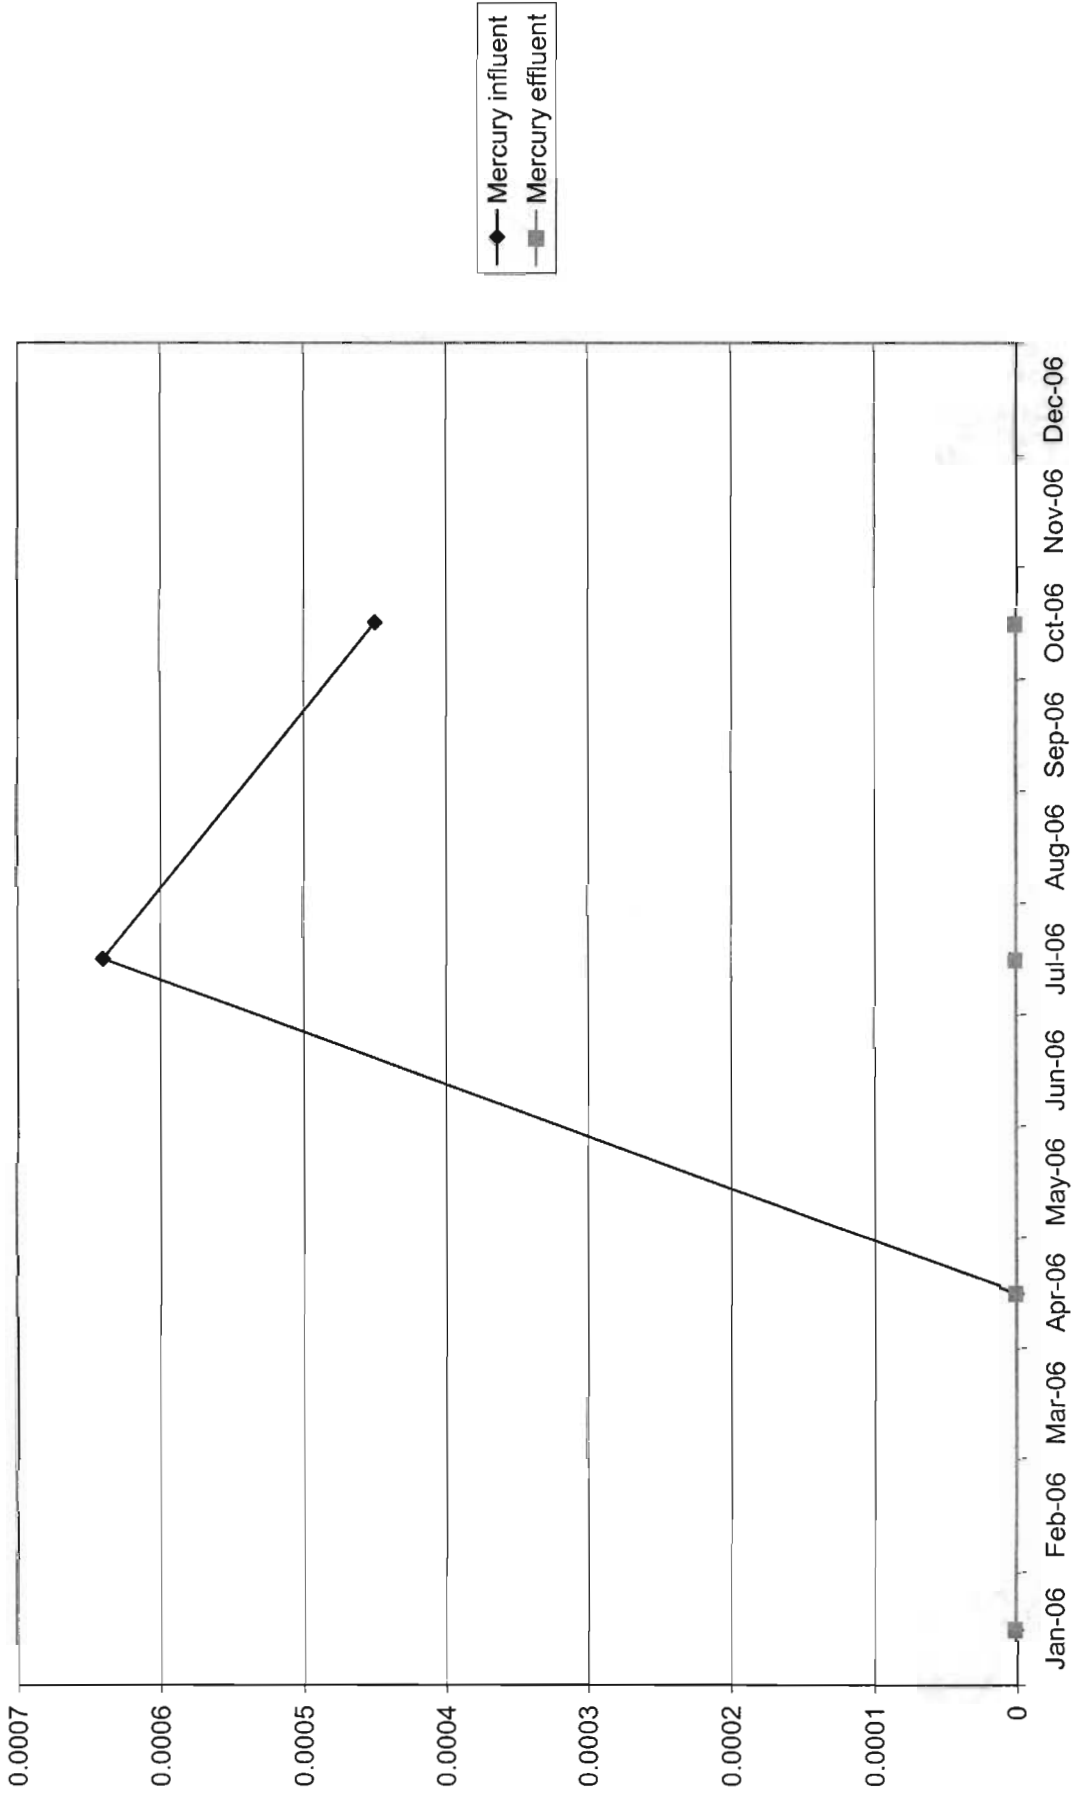


NICKEL

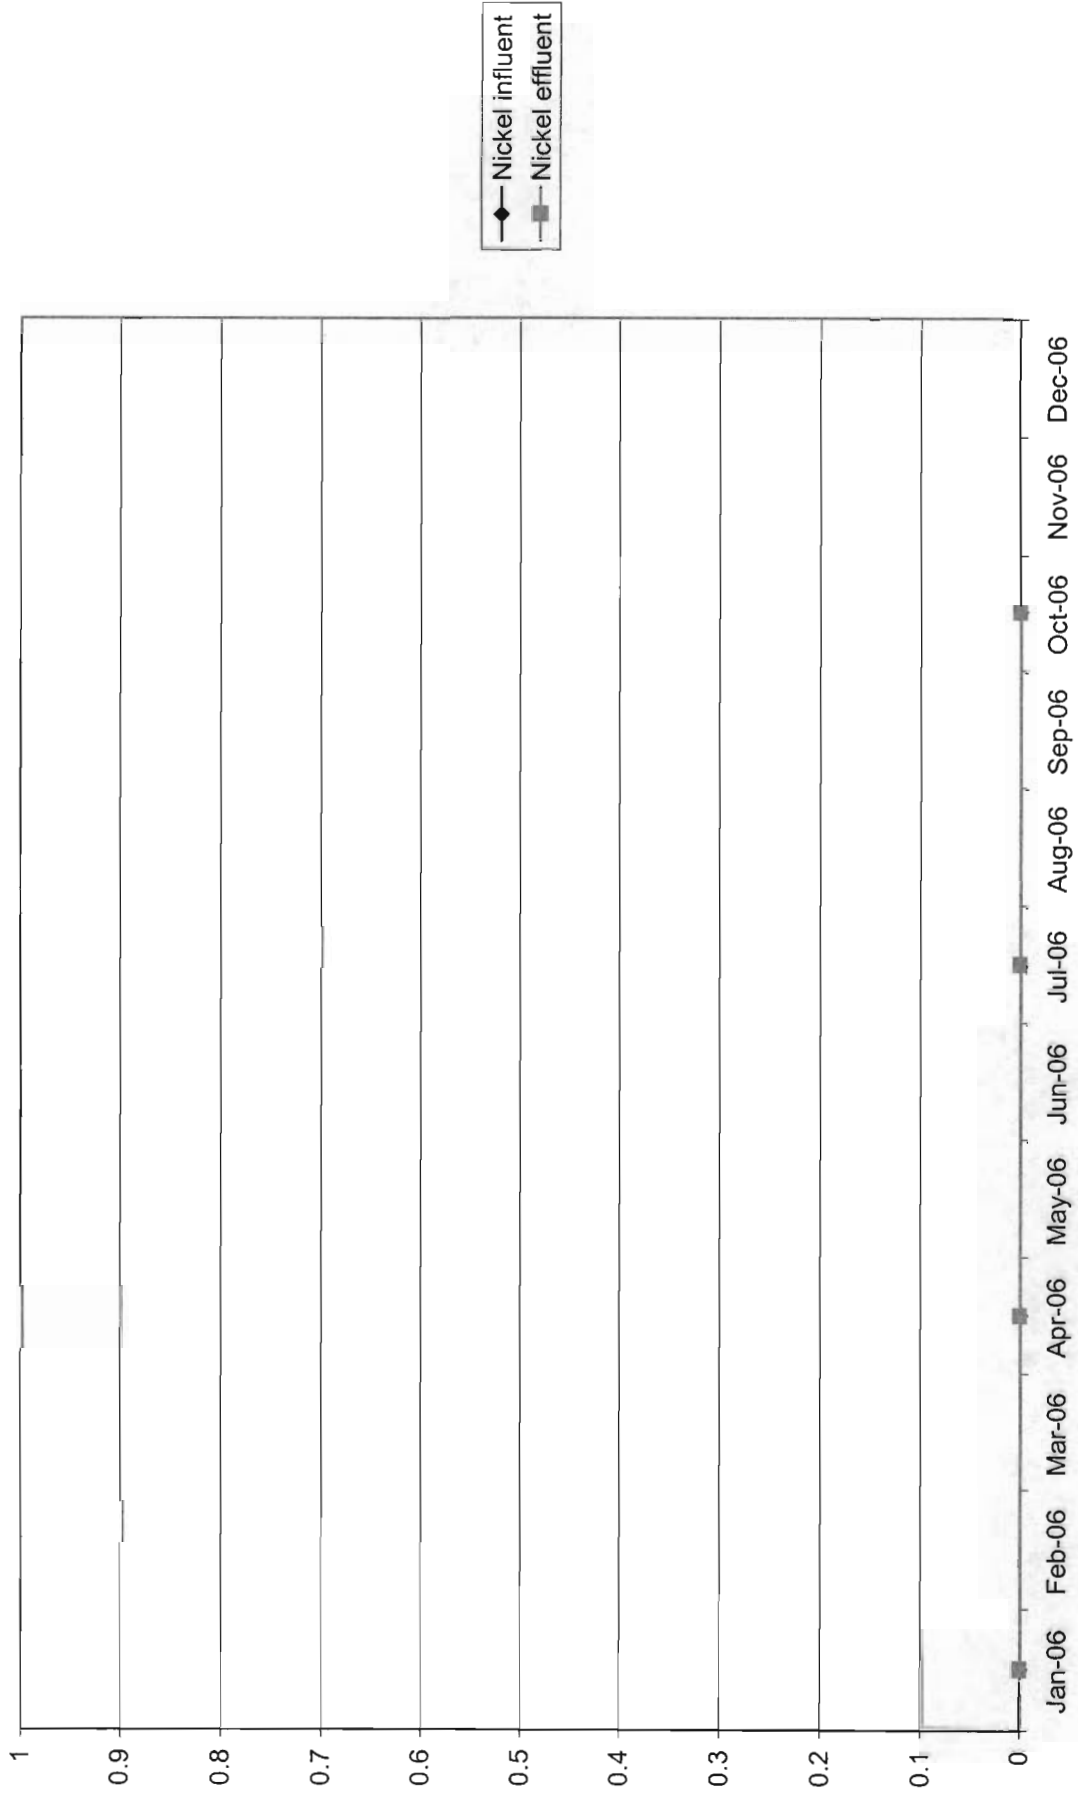


SELENIUM

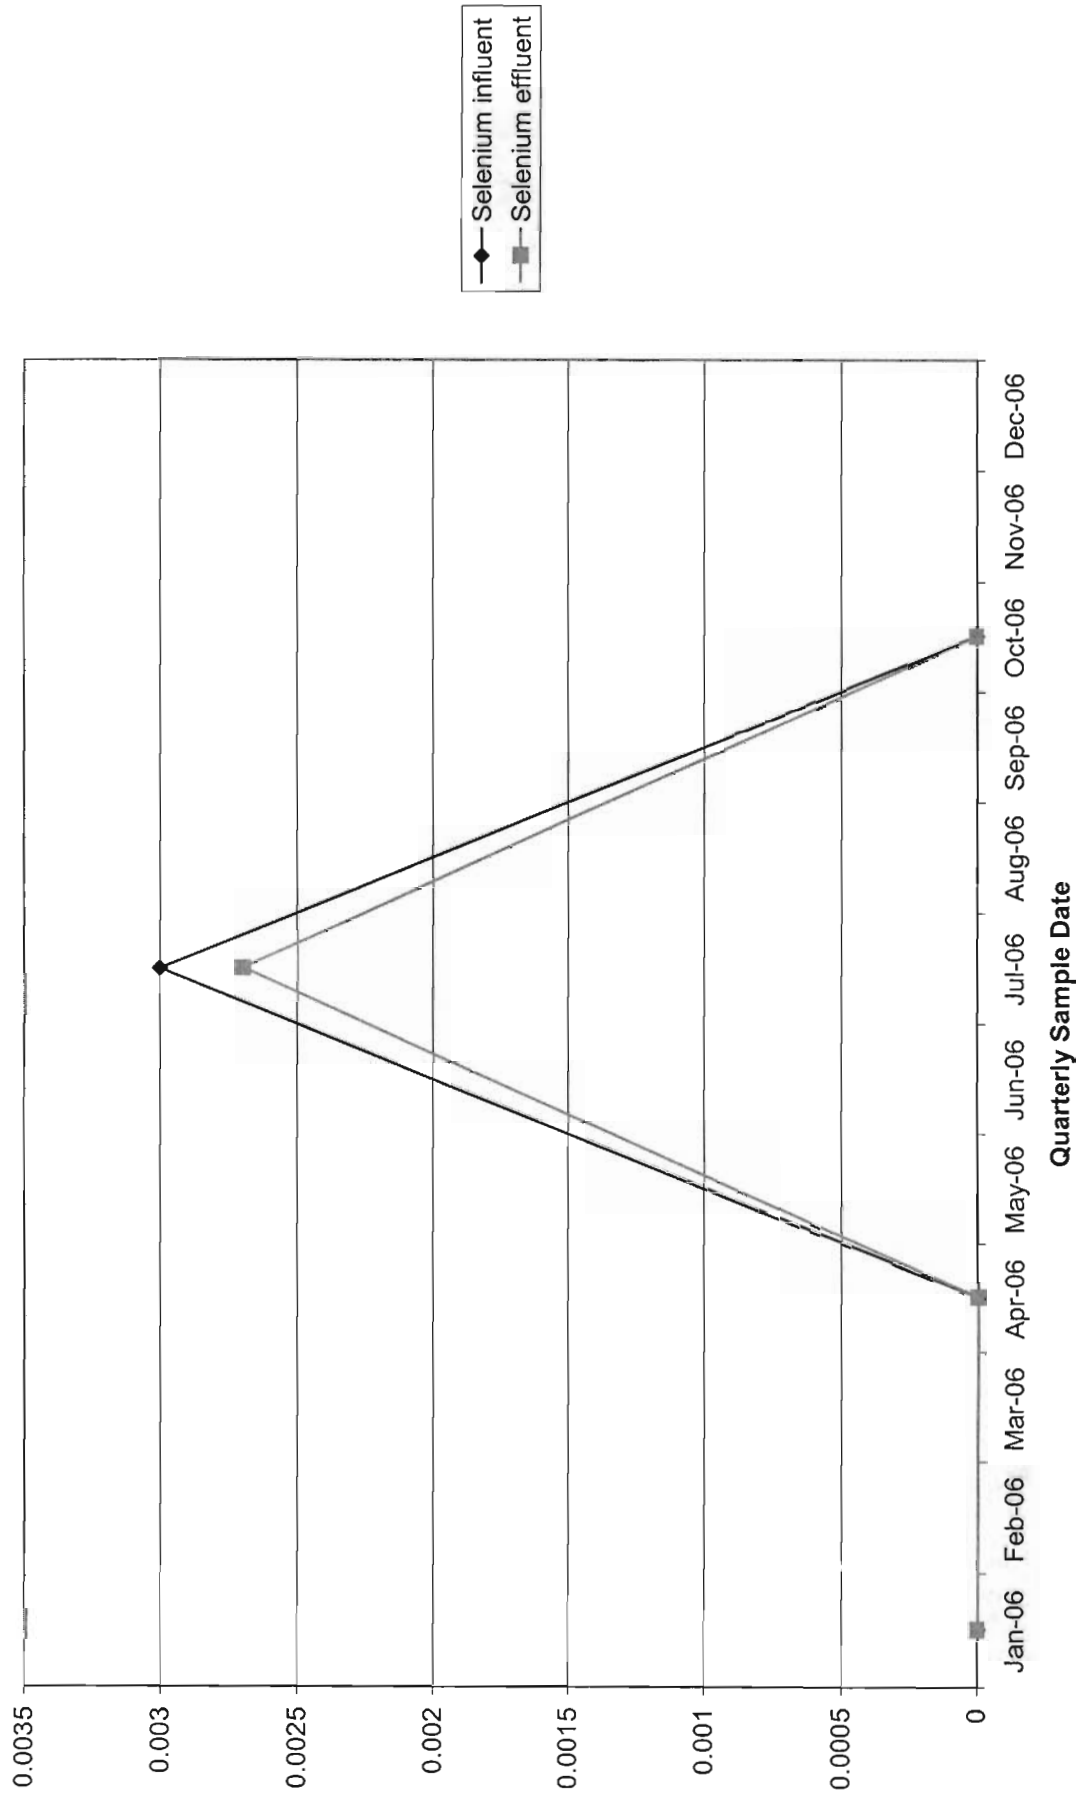


SILVER

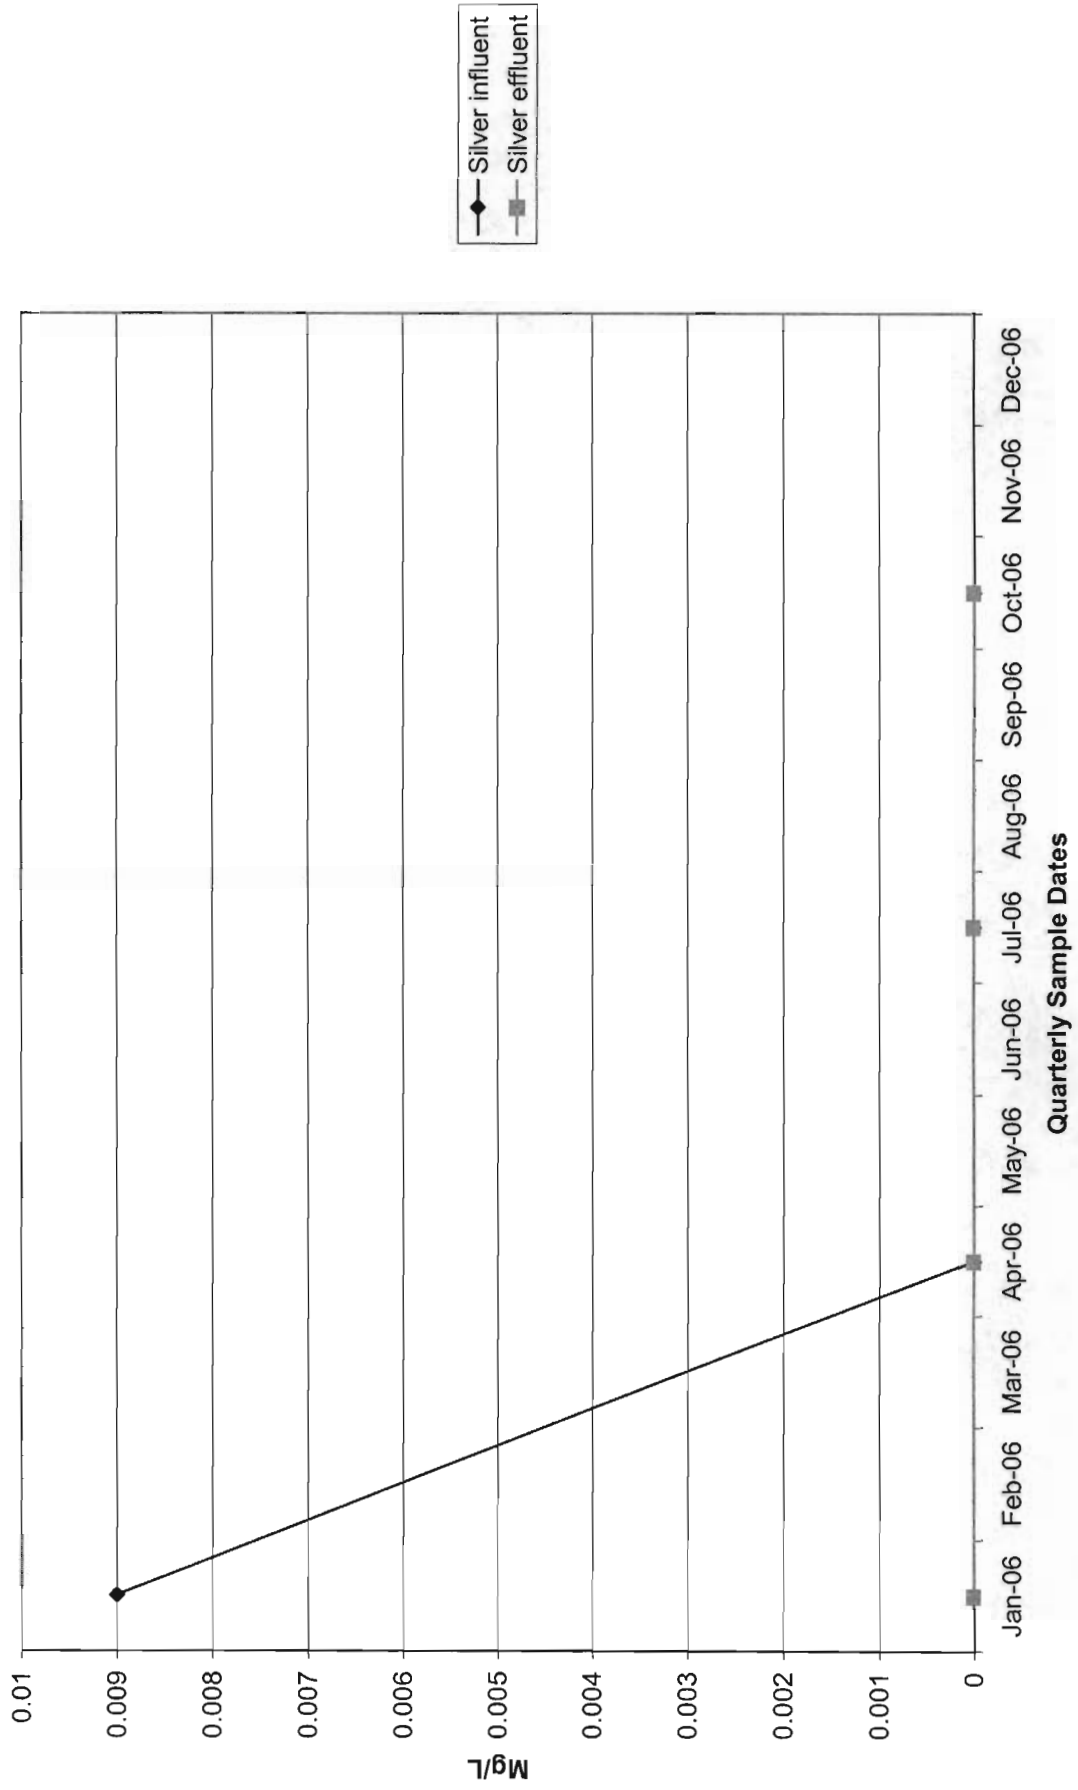


ZINC

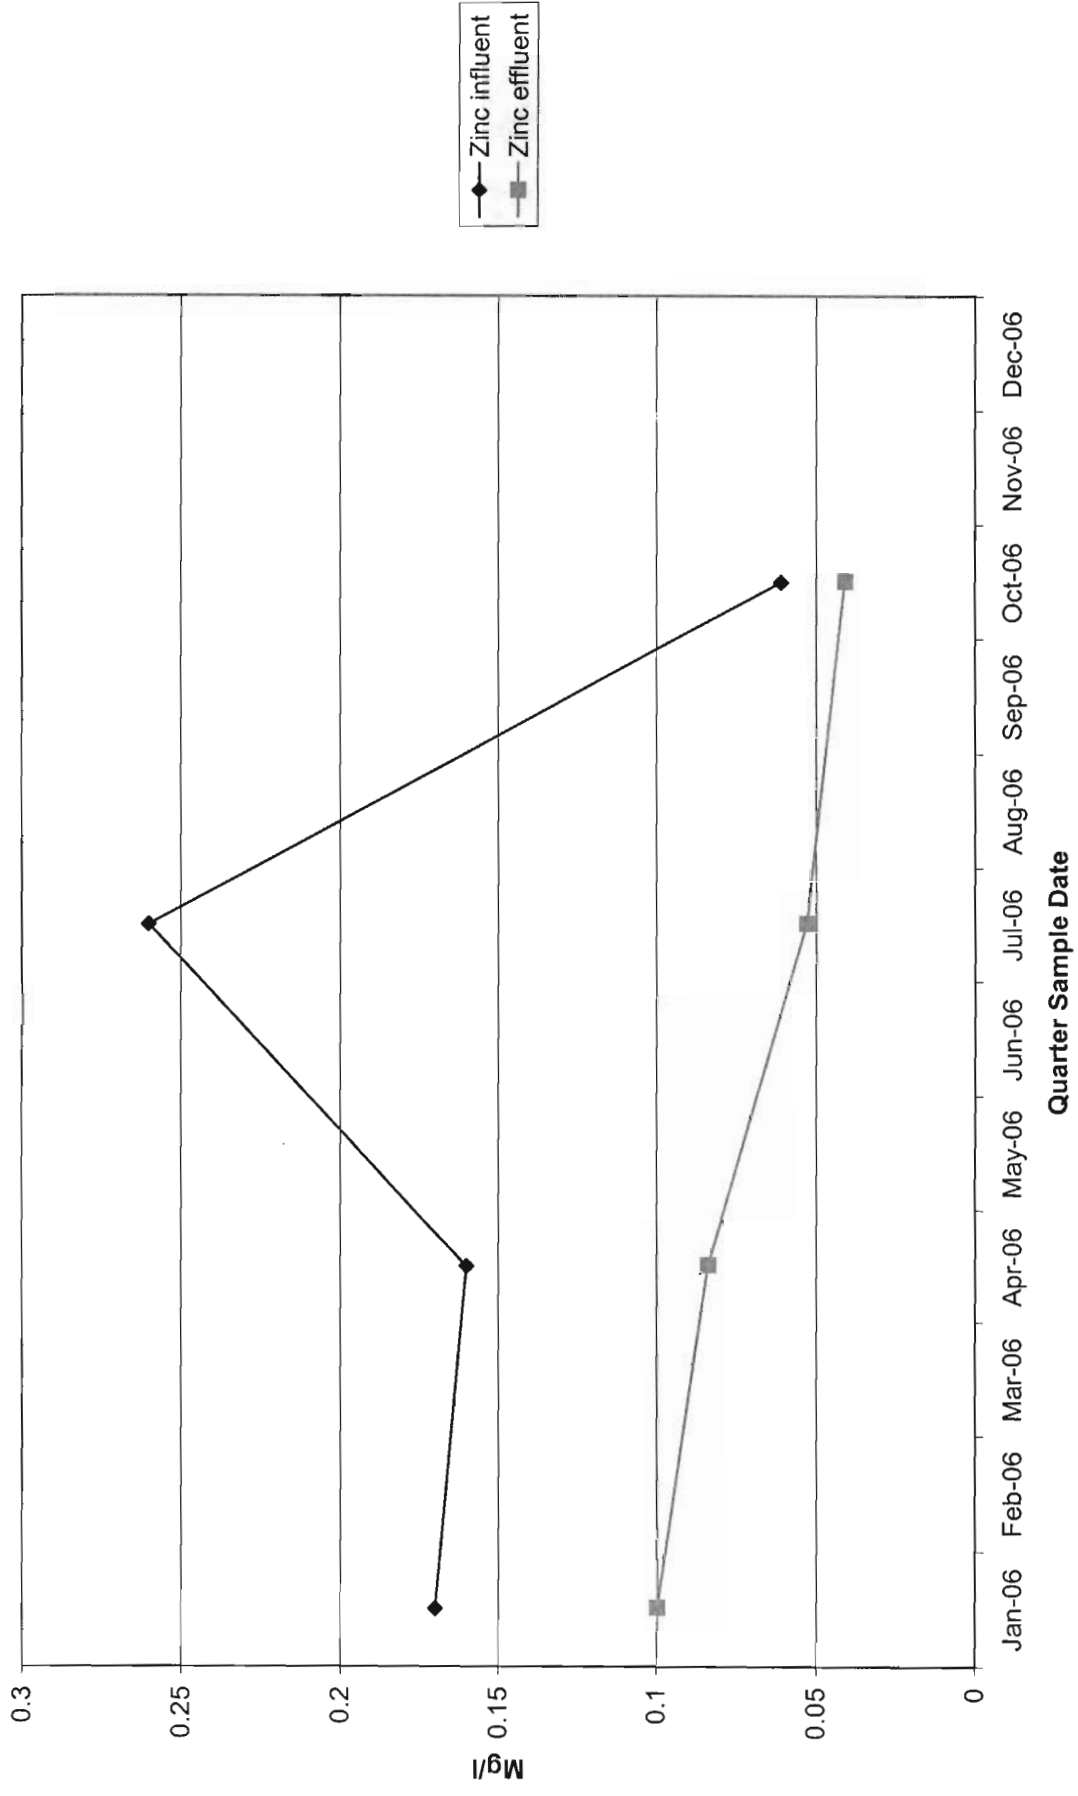


CHROMIUM

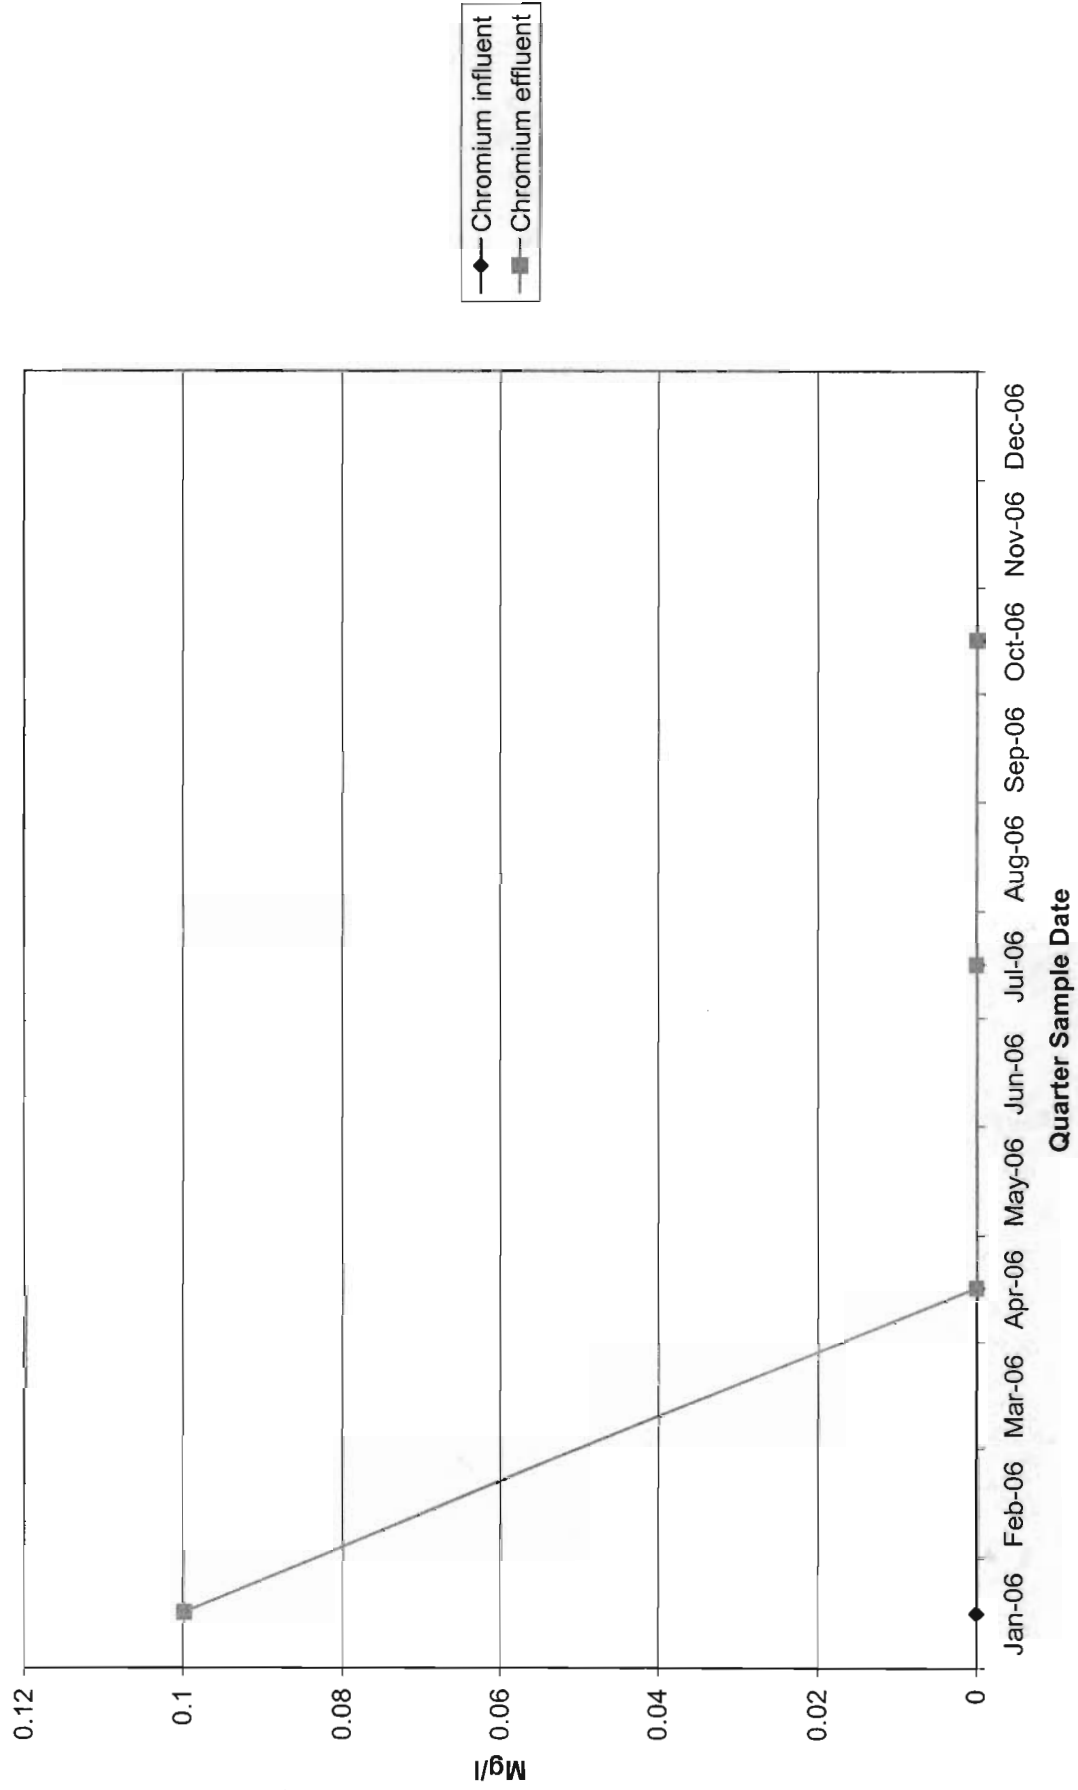


CYANIDE

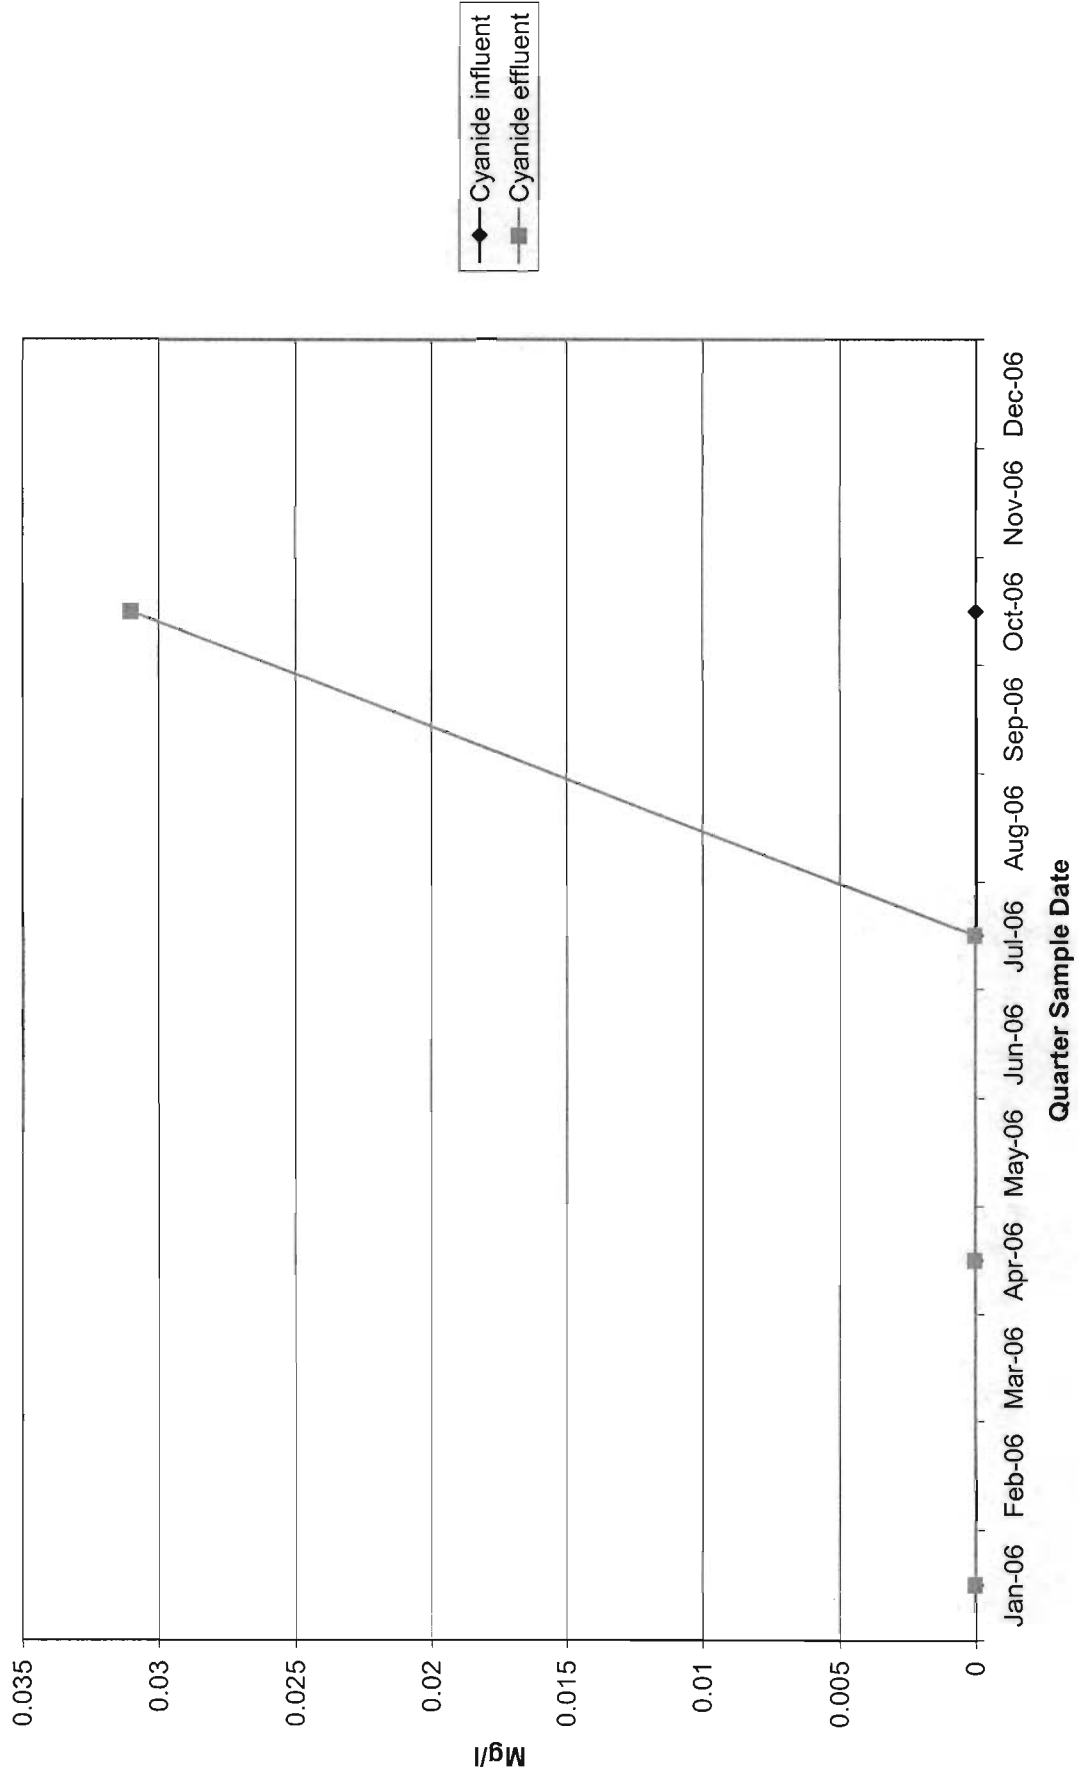


ARSENIC

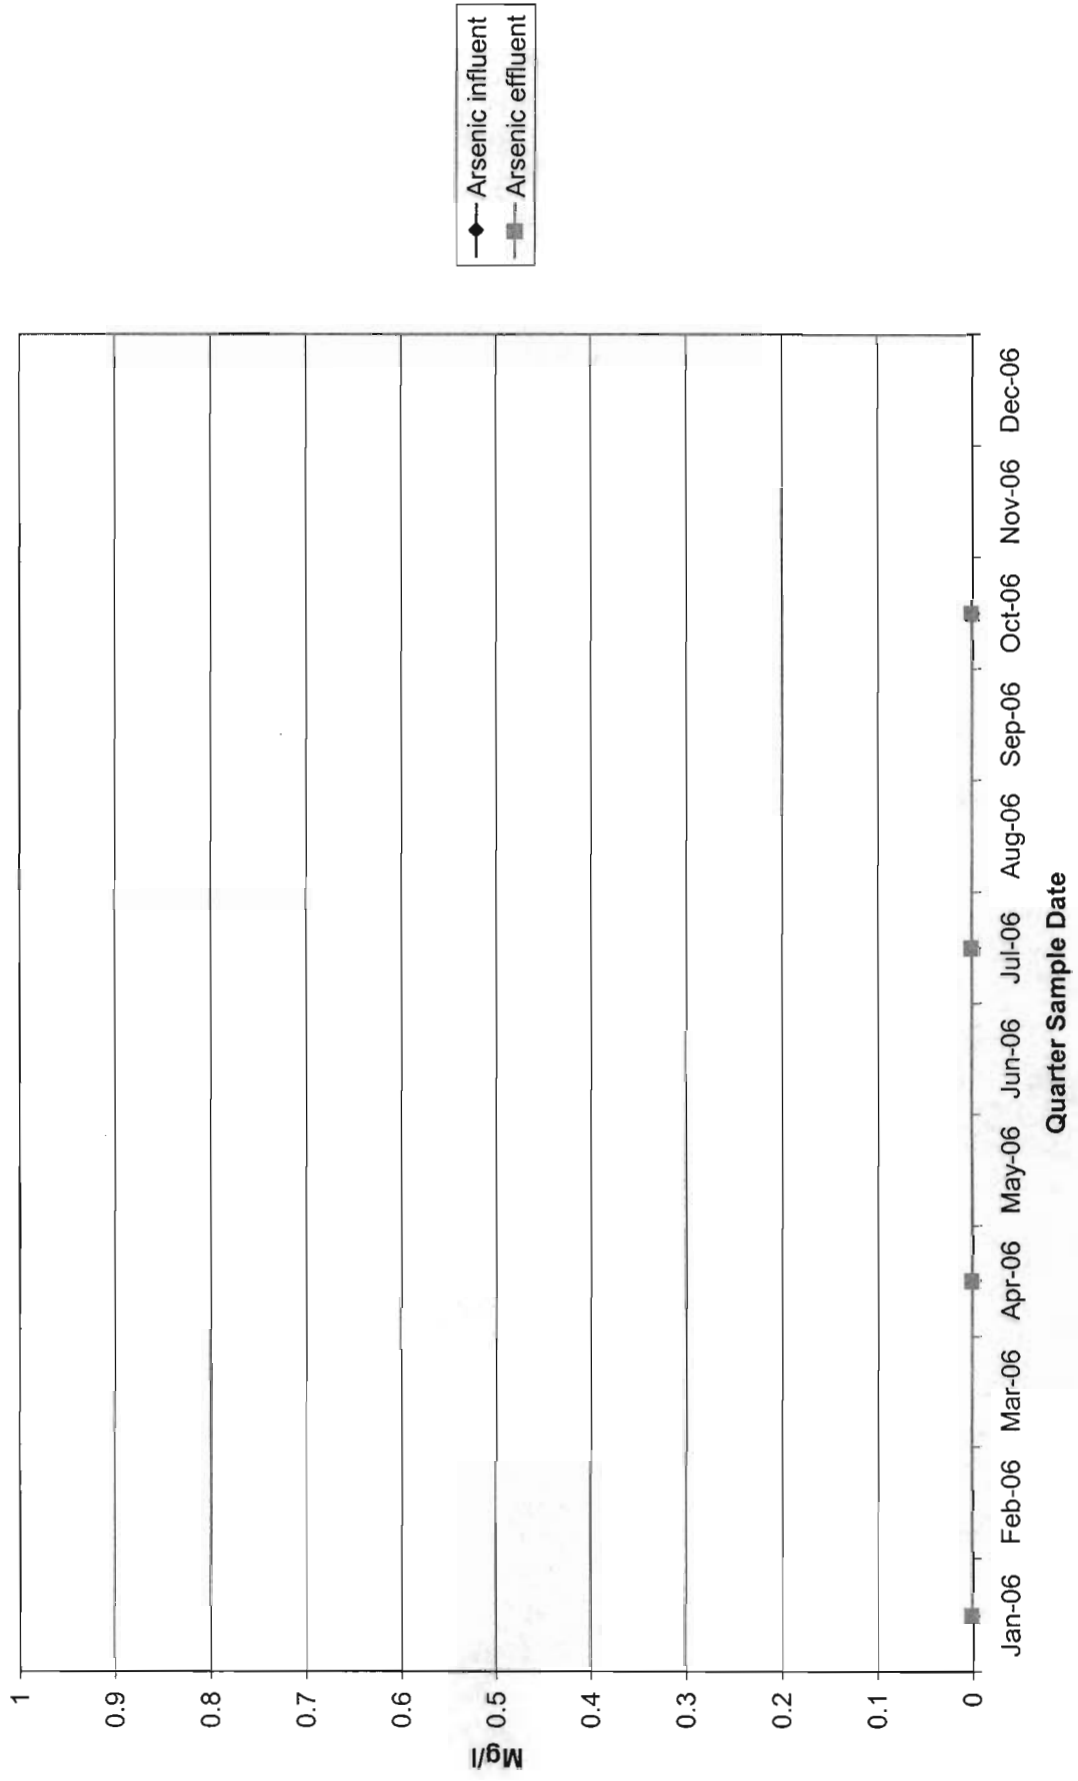


MOLYBDENUM

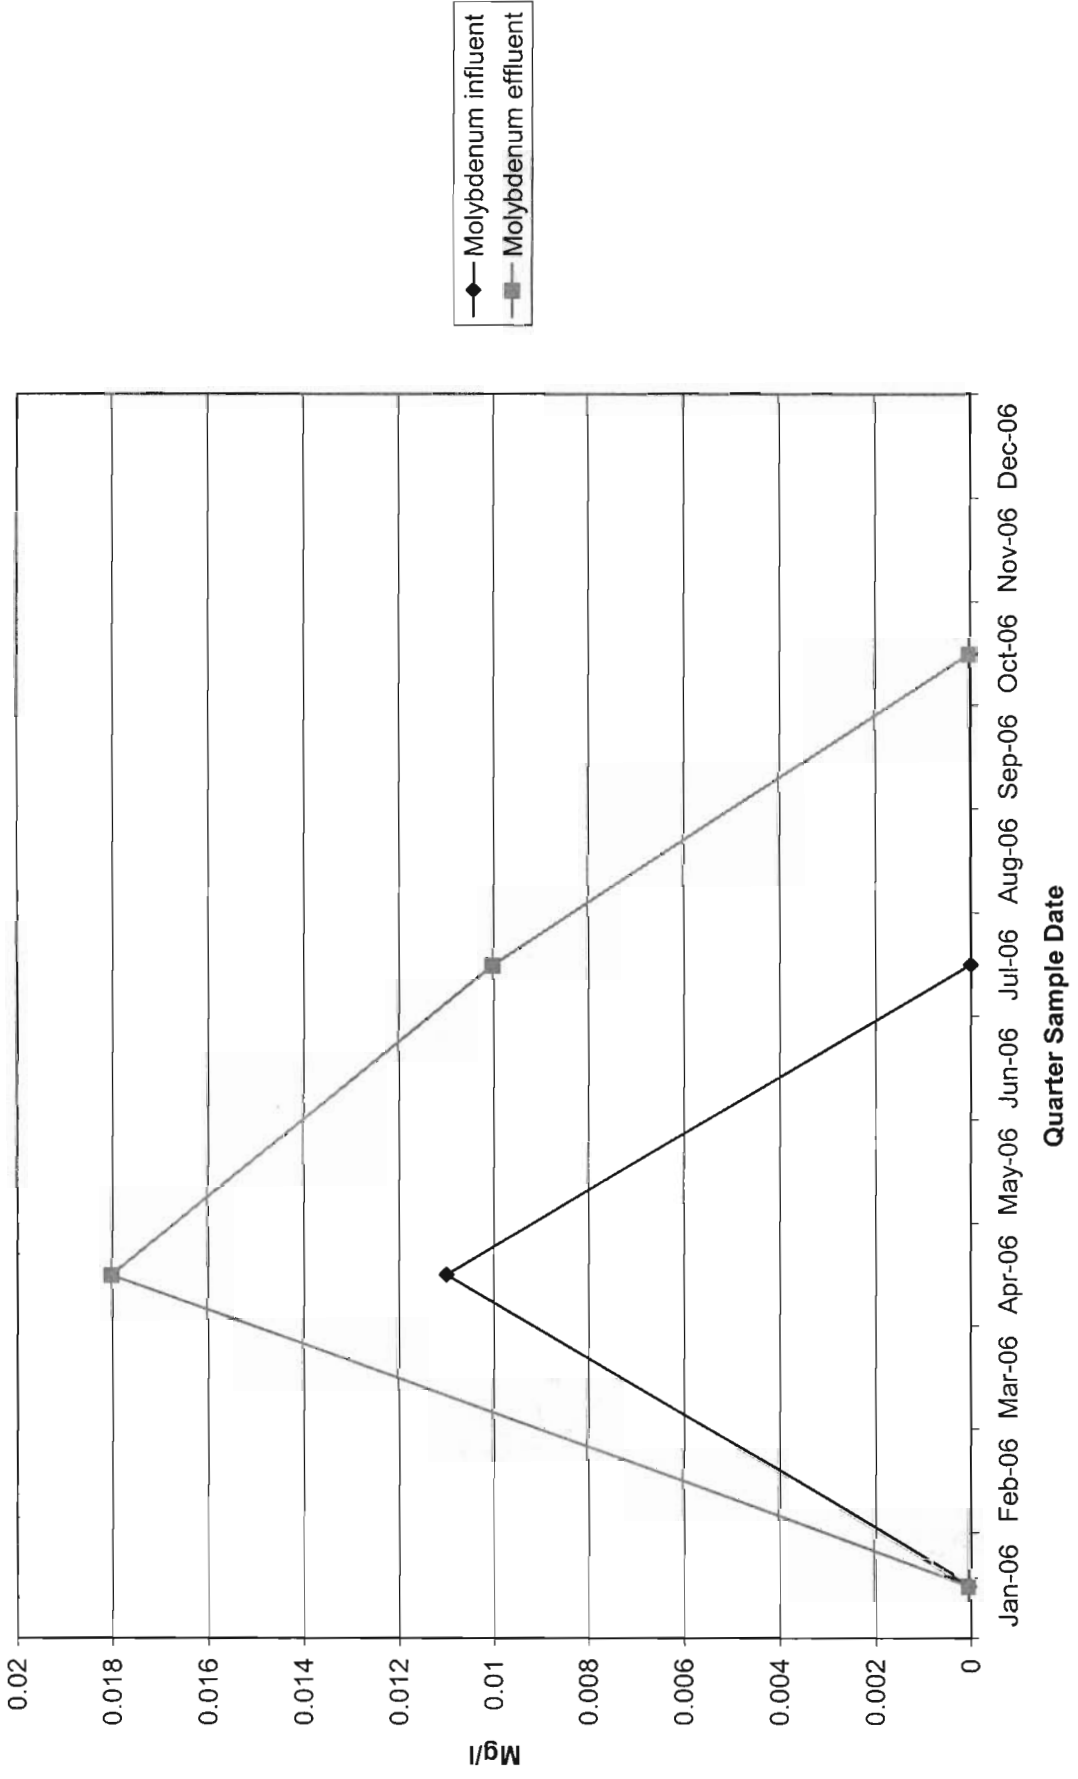


PHENOLS

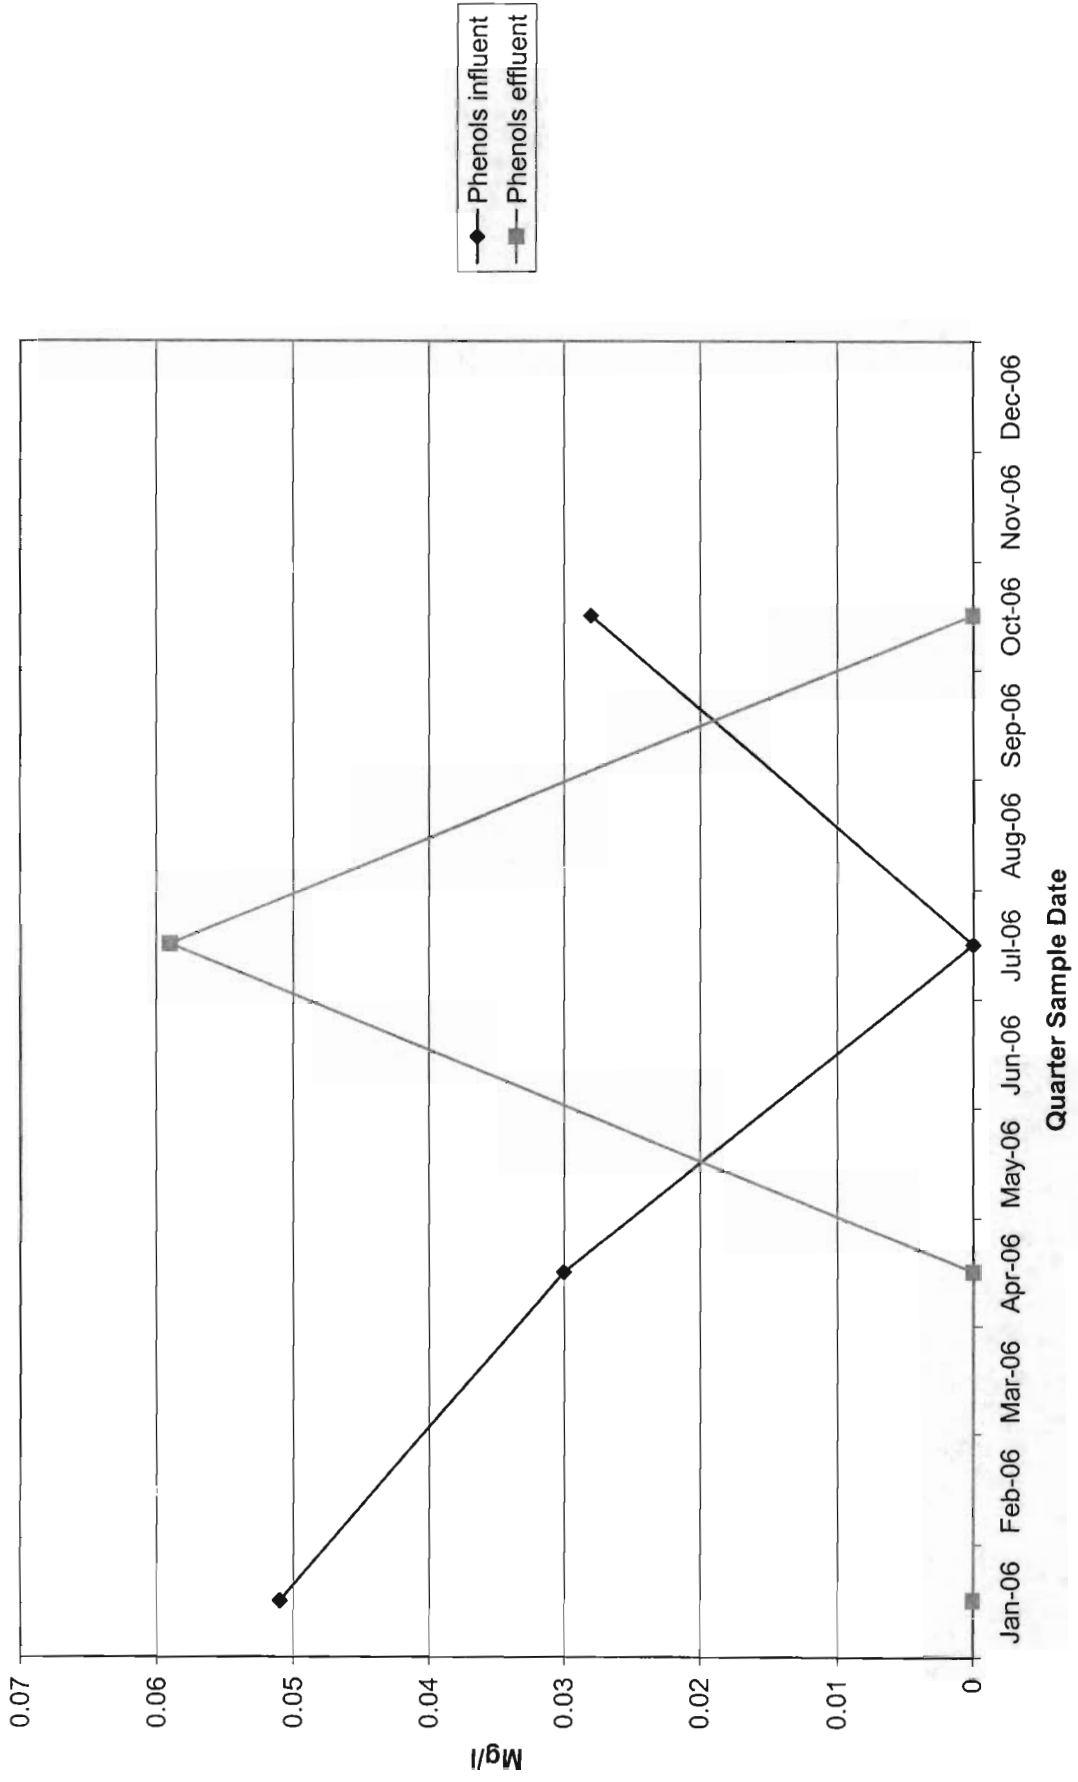


BERYLLIUM

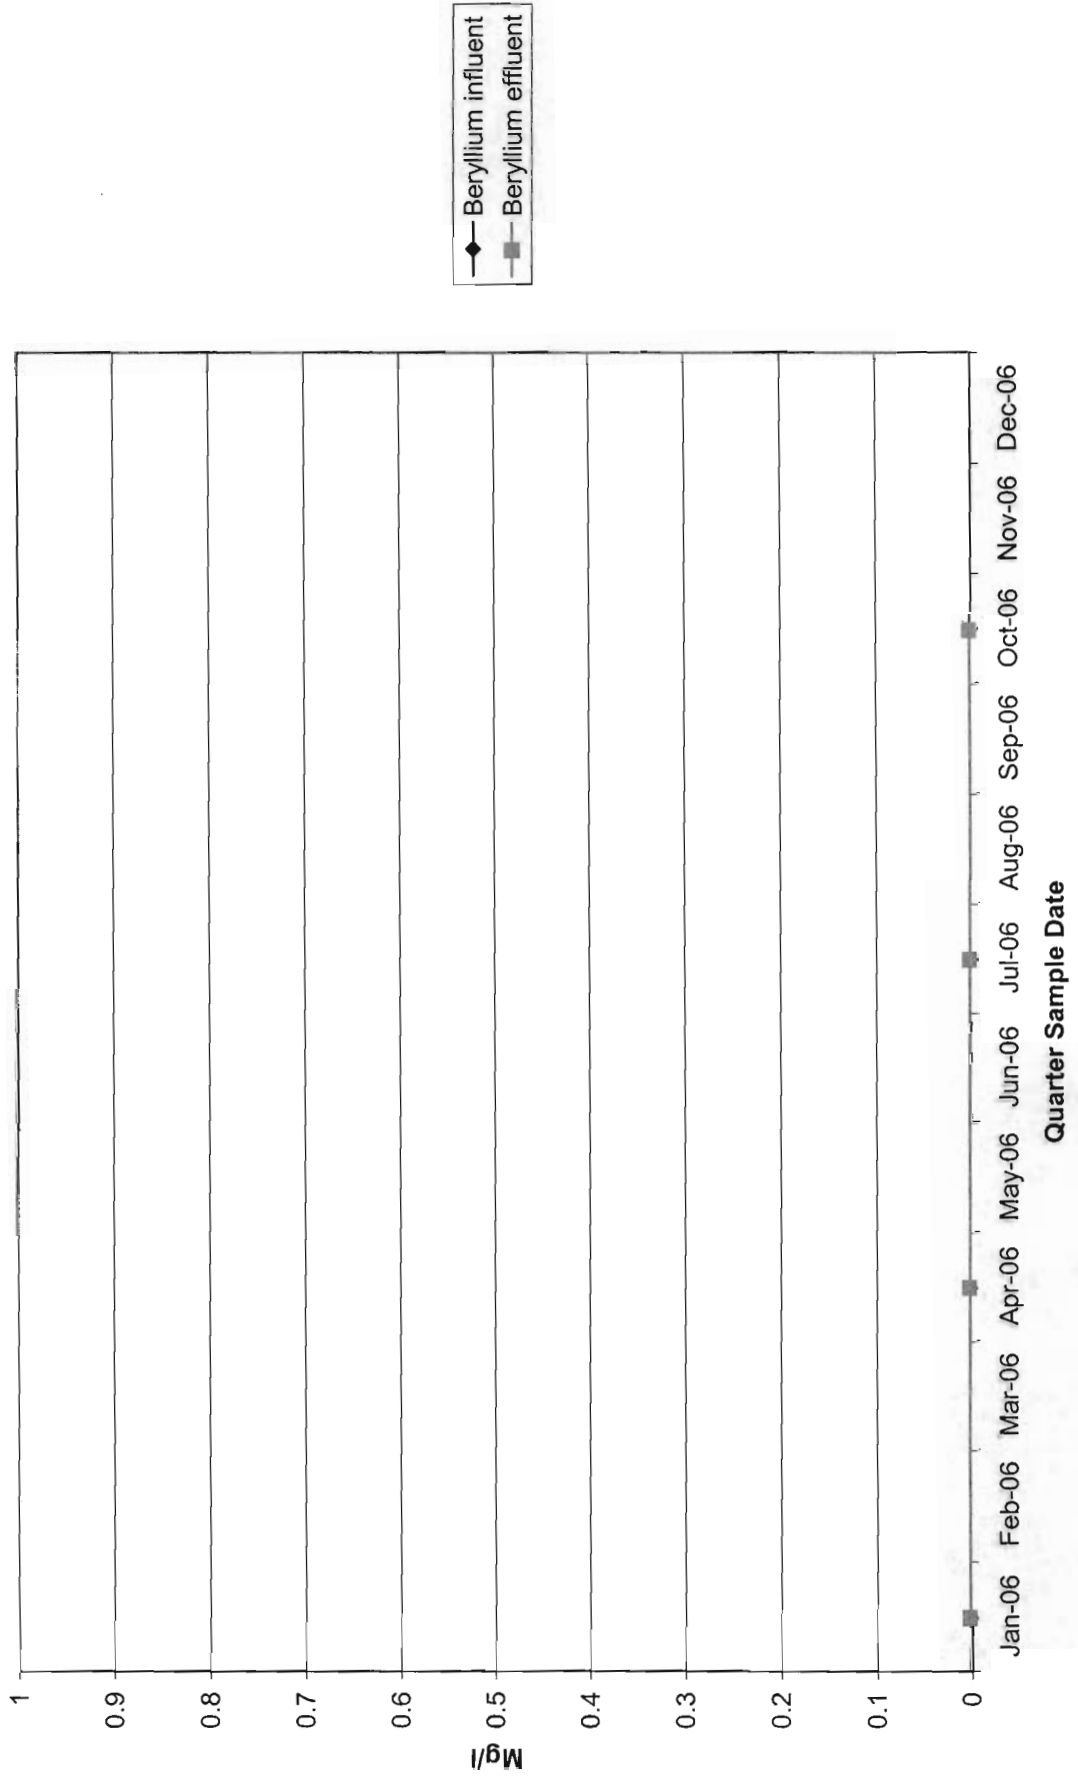

THALLIUM

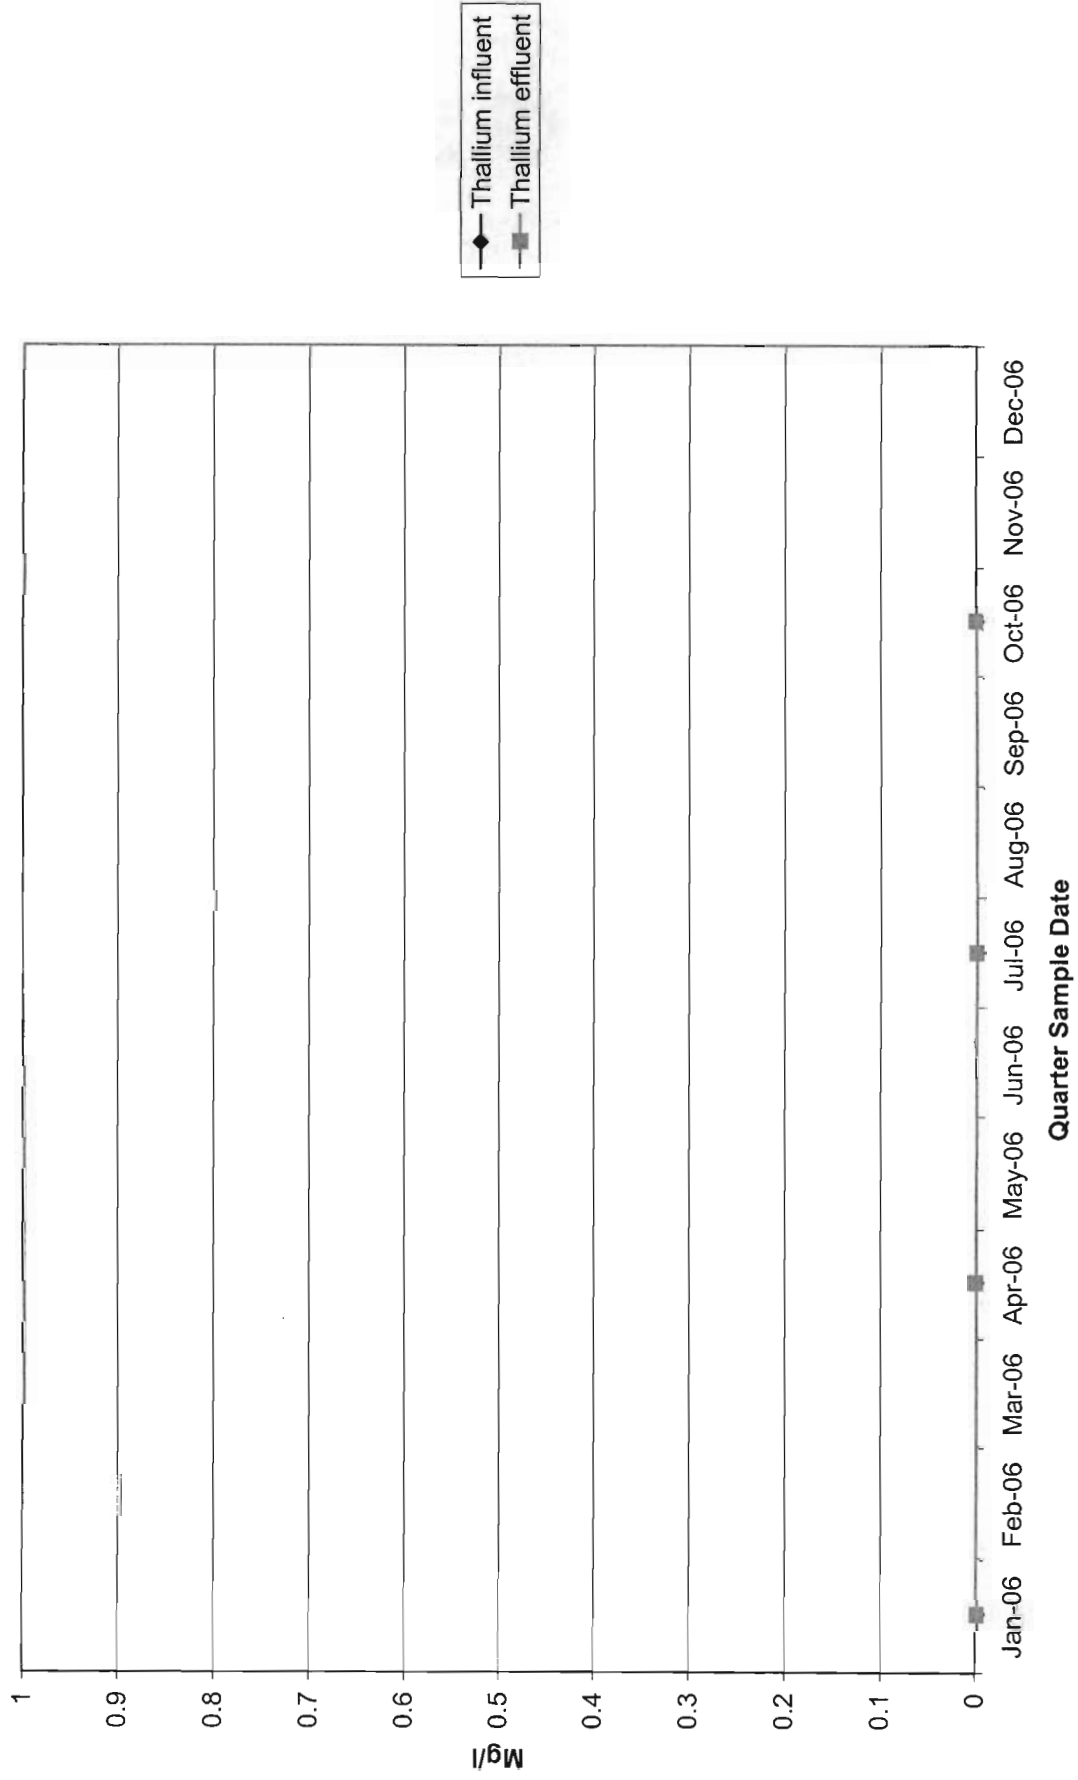

FLOW IN MGD

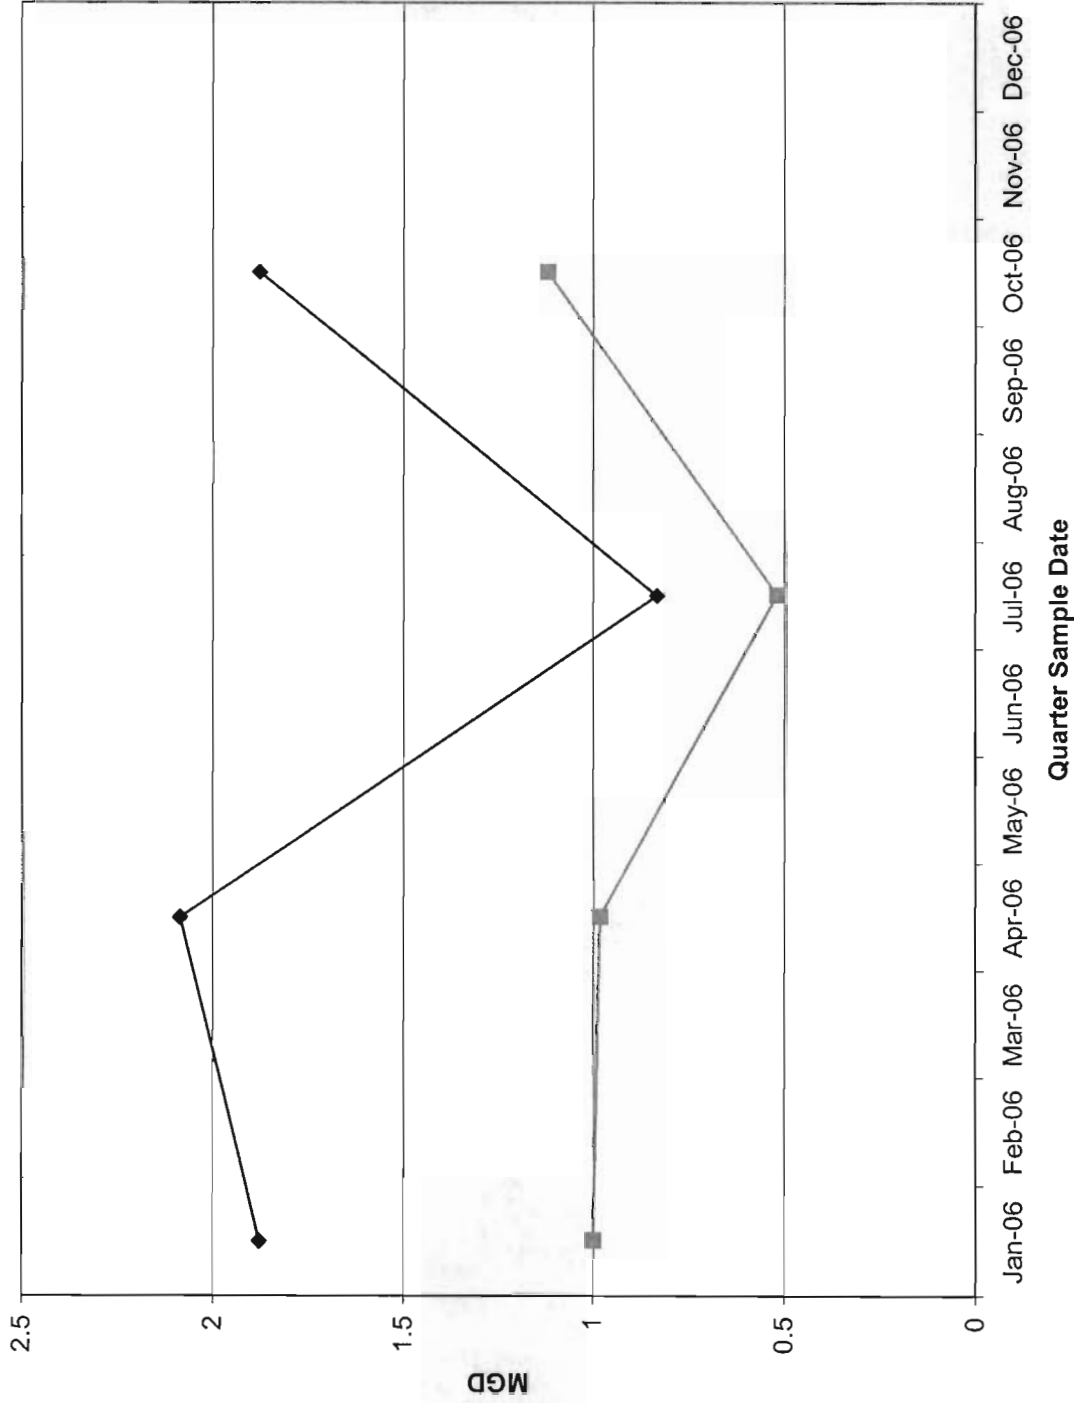

Flow, MGD influent
Flow, MGD effluent

CODE SHEET

Annual Report

		<u>CODE</u>
Auditor's Name	<u>Gilliam</u>	
Permit Number	<u>AR0022187</u>	
Period Report Covers End Date	<u>12/31/06</u>	PSED
Start Date	<u>1/1/06</u>	PSSD

PPETS WENDB DATA ELEMENTS

Significant IUs in Significant Noncompliance with Pretreatment Compliance Schedule	<u>0</u>	SSNC
NOV's and A.O.'s Issued Against Significant IUs	<u>33</u>	FENF
Civil and/or Criminal Judicial Actions Against Significant IUs	<u>0</u>	JUDI
Significant IUs with Significant Violations published in Newspaper	<u>1</u>	SVPU
IUs from which penalties have been collected	<u>1</u>	IUPN

COMMENTS:
