


Flint Creek Power Plant - Water Flow Diagram

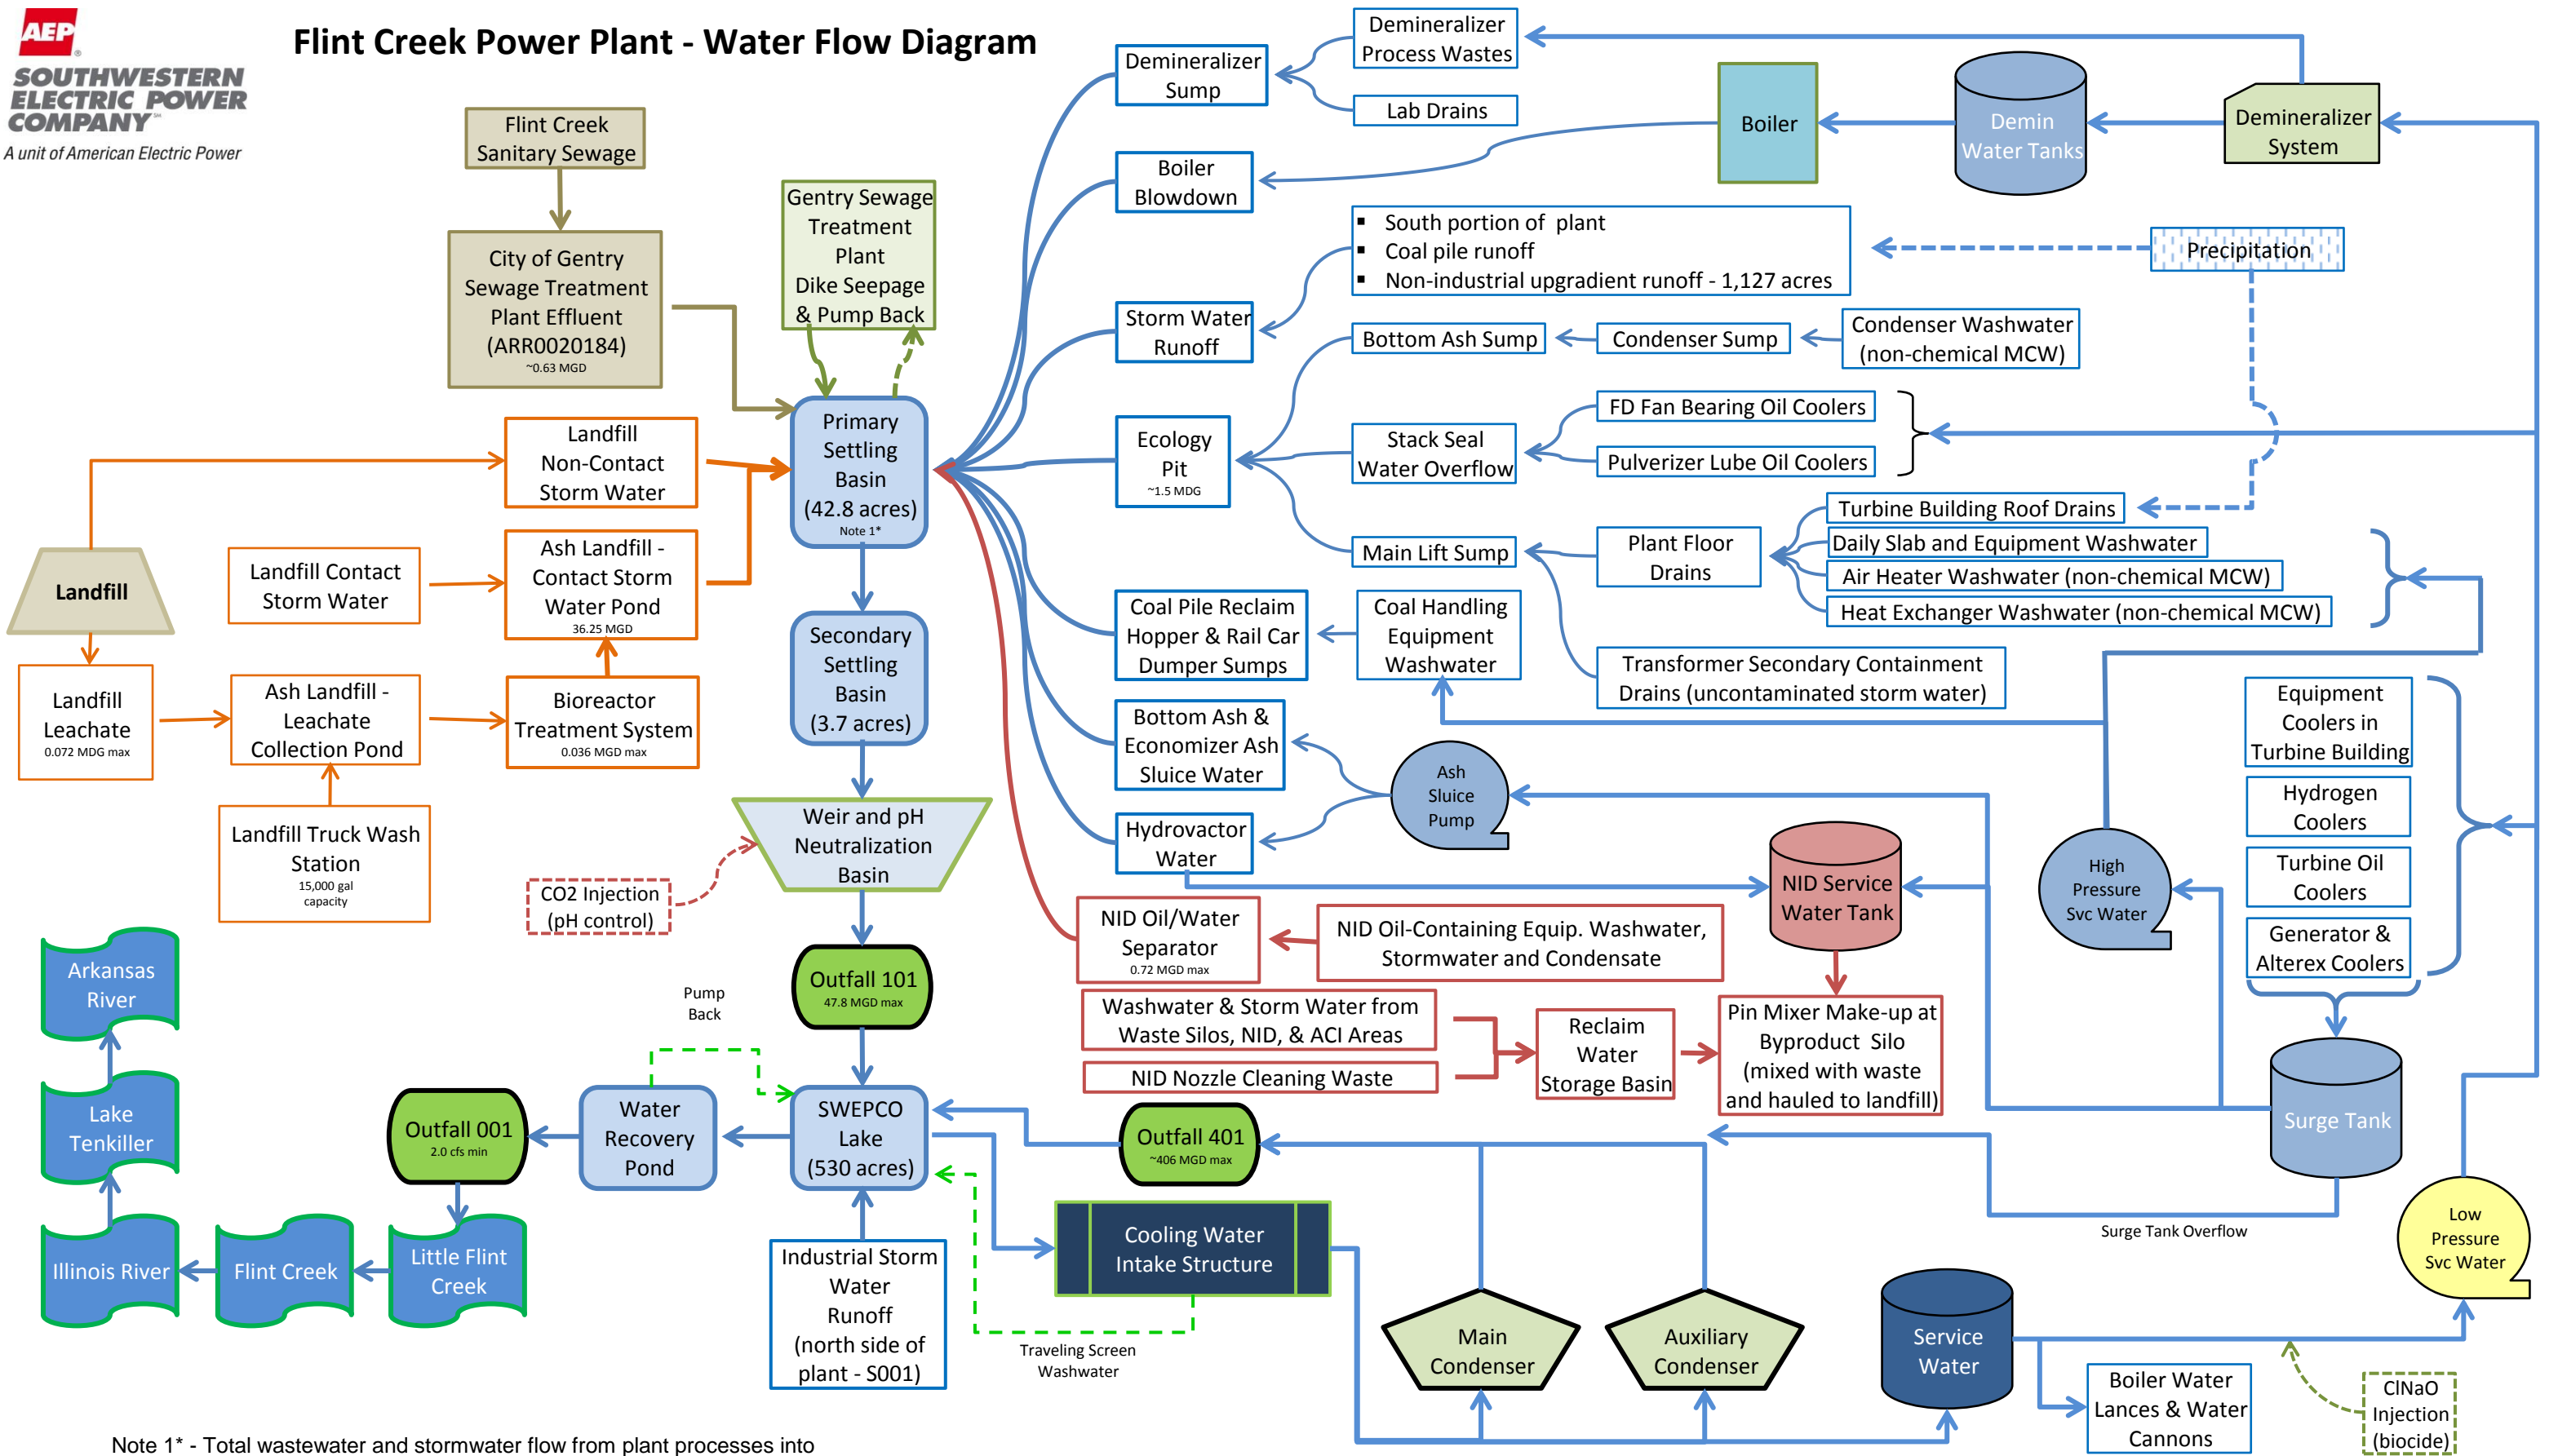

Note 1* - Total wastewater and stormwater flow from plant processes into the Primary Settling Basin is 128 MDG maximum