TETRA TECH

Phase I Environmental Site Assessment Report
Former Gray's Hospital
477 East Main Street
Batesville, Arkansas 72501

Prepared for:
Arkansas Department of Energy and Environment,
Division of Environmental Quality
5301 Northshore Drive
North Little Rock, AR, 72118

Prepared by:
Tetra Tech, Inc.
415 Oak Street
Kansas City, MO, 64106

Project No.:
103S9501016.001

October 9, 2025

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY 1
1.1 RECs 1
1.2 CRECs 2
1.3 HRECs 2
1.4 De minimis Conditions 2
1.5 Significant Data Gaps 2
1.6 BERs 2
2.0 INTRODUCTION 3
2.1 Purpose 3
2.2 Detailed Scope of Services 6
2.3 Significant Assumptions 6
2.4 Limitations 6
2.5 Exceptions 7
2.6 Limiting Conditions/Deviations 7
2.7 Special Terms and Conditions 7
2.8 User Reliance 7
3.0 USER PROVIDED INFORMATION 9
3.1 Title Records 9
3.2 Environmental Liens and Activity and Use Limitations 9
3.3 Specialized Knowledge 9
3.4 Actual Knowledge 9
3.5 Valuation Reduction for Environmental Issues 9
3.6 Commonly Known or Reasonably Ascertainable Information 9
3.7 Degree of Obviousness 9
3.8 Other 9
4.0 SITE RECONNAISSANCE 10
4.1 Observation 10
4.2 Methodology 10
4.3 Exterior Observations 10
4.4 Interior Observations 11
4.5 Limiting Conditions 13

4.6 Current Uses of Subject Property 13
4.7 Past Use of Subject Property 13
4.8 Current Use of Adjoining Properties and Surrounding Area 13
4.9 Topographic Conditions of Subject Property and Surrounding Area 14
4.10 Structures and Other Improvements 14
4.11 Roads 14
4.12 Potable Water Supply 14
4.13 Sewage Disposal System 14
4.14 Heating/Cooling 14
4.15 Wells 14
4.16 Septic System or Cesspools 14
5.0 RECORDS REVIEW 15
5.1 Physical Setting 15
5.1.1 Topography 15
5.1.2 Geologic Setting 15
5.1.3 Hydrogeology 15
5.2 Historical Records Review 15
5.2.1 Historical Aerial Photographs, Sanborn Maps, Topographic Maps, and City Directories 15
5.2.2 Chain-of-Title 24
5.2.3 Previous Environmental Reports 24
5.2.4 Past Uses of Subject Property 25
5.2.5 Past Uses of Adjoining Properties 25
5.2.6 Past Uses of Surrounding Area 25
5.3 Regulatory Records Review 25
5.3.1 Subject Property Database Listings 29
5.3.2 Adjoining and Relevant Non-subject Property Database Listings 29
5.4 Additional Environmental Record Sources 34
6.0 INTERVIEWS 36
6.1 Interview With Key Site Manager 36
6.2 Interviews With Occupants 36
6.3 Interviews With Past Owners, Operators, And Occupants 36
6.4 Interviews With State and Local Government Officials 36
7.0 FINDINGS AND OPINIONS 37
8.0 CONCLUSIONS AND RECOMMENDATIONS 38

9.0 ENVIRONMENTAL PROFESSIONAL STATEMENT 39

10.0 REFERENCES 40

FIGURES

Figure 1 – Subject Property Location Map 4

Figure 2 – Subject Property Layout Map 5

APPENDICES

Appendix A Property Records

Appendix B Photographic Documentation

Appendix C Interview Documentation

Appendix D Regulatory Database Report

Appendix E Regulatory File Review Documentation

Appendix F Historical Review Documentation

Appendix G Previous Environmental Reports

Appendix H Qualifications of Environmental Professionals

1.0 EXECUTIVE SUMMARY

Tetra Tech, Inc. (Tetra Tech) conducted this Phase I Environmental Site Assessment (ESA) of a former hospital at 477 East Main Street in Batesville, Arkansas (the subject property). The ESA was performed for the Arkansas Department of Energy and Environment, Division of Environmental Quality (ADEE-DEQ) (the client). This Phase I ESA generally accorded with Standard Practice for Environmental Site Assessments: Phase I Environmental Site Assessment Process, ASTM International (ASTM) Designation: E1527-21. The subject property hosted the Gray's Hospital from 1937 to the 1980s. Information about the subject property is as follows:

Item	Description
Subject Property Name	Former Gray's Hospital
Street Address	477 East Main Street
City	Batesville
County	Independence
State	Arkansas
Parcel Number(s)	1100657001C
Acres	0.68
Owner	Markowski Investments Holdings LLC
Current Use	Former Gray's Hospital (vacant building)

The purpose of this assessment was to evaluate whether hazardous substances or petroleum products have been released in, on, or at the subject property under conditions that would pose a recognized environmental condition (REC) for the subject property.

Below is a summary of known or suspect environmental conditions in connection with the subject property based on information gathered during the ESA. The items may include RECs, controlled recognized environmental conditions (CRECs), historical recognized environmental conditions (HRECs), de minimis conditions, significant data gaps (SDGs), and business environmental risks (BERs). Definitions of environmental conditions are in **Section 2.1**.

Finding	Determination
The historical use of an incinerator on the subject property.	REC
Due to the elevation, proximity, and length of operation, the historical Nu Way Cleaners (121 South 4th Street).	REC
The use of a nearby upgradient property as an automotive garage with lack of information, distance, and higher elevation.	REC
Asbestos-containing materials (ACM) has been documented in the subject property.	BER
Given the age of the structure on the subject property, this building may contain lead-based paint (LBP).	BER

1.1 RECs

The following RECs were identified:

- A permit was issued to the facility addressed as 477 East Main Street and identified as White River Medical for installation and operation of a medical waste incinerator in 1975, to be fueled by natural

gas. In addition, an older brick incinerator was observed in the basement, fuel source unknown. The historical use of an incinerator is considered a REC for the subject property.

- Nu Way Cleaners (121 South 4th Street) is approximately 158 feet southwest of the subject property. This facility is listed on the EDR Hist Cleaner, Hazardous Waste Generator (HW Gen), Permits, Resource Conservation and Recovery Act (RCRA) Non-generator/No longer regulated (NonGen/NLR), Facility Index System (FINDS), and Enforcement and Compliance History Online (ECHO) databases. According to the EDR Hist Cleaner database, this facility was a registered historical dry cleaner from 1969 to 2014. This facility has an North American Industry Classification System (NAICS) code of 81232, with the description "Drycleaning and Laundry Services (Except Coin Operated)." The hazardous waste summary included in the RCRA database includes chlorinated solvents. This facility was listed in the EDR database as a small quantity generator (SQG) with no violations or evaluations found; however, according to the Arkansas Department of Environmental Quality (ADEQ) Hazardous Waste Generator Database, the facility was inactive as of July 2019. Due to the elevation, proximity, and length of operation, the historical cleaner is considered a REC for the subject property.
- An auto repair garage/auto dealership, located approximately 150 feet southeast, was identified in the Sanborn maps. Due to the use as an automotive garage with lack of information, distance, and higher elevation, this facility is considered a REC for the subject property.

1.2 CRECs

No CRECs were identified.

1.3 HRECs

No HRECs were identified.

1.4 De minimis Conditions

De minimis staining was observed on the subject property.

1.5 Significant Data Gaps

No significant data gaps were identified.

1.6 BERs

The following BERs were identified:

- Tetra Tech requested previous environmental investigation reports regarding the subject property from the client. An Asbestos Inspection was conducted by Snyder Environmental in April 2018. The investigation identified ACM in mastic and insulation ranging from 2% to 20% chrysotile asbestos throughout the building. The documented presence of ACM is considered a BER for the subject property.
- Given the age of the structure on the subject property, this building may contain LBP. The potential presence of LBP is considered a BER.

2.0 INTRODUCTION

On September 8, 2025, Addie McClain, on behalf of ADEE-DEQ, authorized Tetra Tech to conduct a Phase I ESA of the Former Gray's Hospital facility. This evaluation accorded with Tetra Tech's Proposal dated August 25, 2025. Markowski Investments Holdings LLC currently owns the subject property. The City of Batesville (the User) is interested in redeveloping the subject property, and has requested Arkansas Brownfield Program Assessment (TBA) assistance from ADEE-DEQ.

The subject property is at 477 East Main Street, Batesville, Arkansas (**Figure 1**, Subject Property Location Map). According to tax parcel information accessible on the Independence County Assessor's Office website (Independence County 2025), the subject property encompasses 0.68 acres and includes one parcel of land (**Figure 2**, Subject Property Layout Map). Property records are in **Appendix A**, and photographic documentation of the site reconnaissance is in **Appendix B**.

The subject property is improved with a four-story building. The main portion of the school building was constructed in 1937 with later additions. The existing building currently encompasses approximately 13,000 square feet and is constructed of concrete with an asphalt parking lot on northwestern side of the subject property. A construction trailer and storage shed are on the northwestern corner of the subject property. The subject property, occupied by the former hospital, is currently vacant and out of use.

2.1 Purpose

The purpose of this ESA was to identify RECs, HRECs, CRECs, de minimis conditions, or BERs for the subject property. A REC is any of the following: (1) presence of hazardous substances or petroleum products in, on, or at the subject property because of a release to the environment; (2) likely presence of hazardous substances or petroleum products in, on, or at the subject property because of a release or likely release to the environment; or (3) presence of hazardous substances or petroleum products in, on, or at the subject property under conditions that pose a material threat of a future release to the environment. An HREC is a previous release of hazardous substances or petroleum products affecting the subject property that has been addressed to the satisfaction of the applicable regulatory authority or authorities and meeting unrestricted use criteria established by the applicable regulatory authority or authorities without subjecting the subject property to any controls. An HREC is not a REC. A CREC is a REC for the subject property that has been addressed to the satisfaction of the applicable regulatory authority or authorities with hazardous substances or petroleum products allowed to remain in place subject to implementation of required controls. A de minimis condition is a condition related to a release that generally does not present a threat to human health or the environment and that generally would not be the subject of an enforcement action if brought to the attention of appropriate governmental agencies. A de minimis condition is not a REC or a CREC. A BER is a risk that can have a material environmental or environmentally driven effect on a business associated with current or planned use of the subject property, but not necessarily related to those environmental issues required for investigation under ASTM E1527-21.

This ESA is intended to satisfy one of the requirements for the innocent landowner defense to Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) liability: that is, the practices that constitute "all appropriate inquiry into the previous ownership and uses of the subject property consistent with good customary practice," as defined in 42 *U.S. Code* Section 9601 (35)(B).

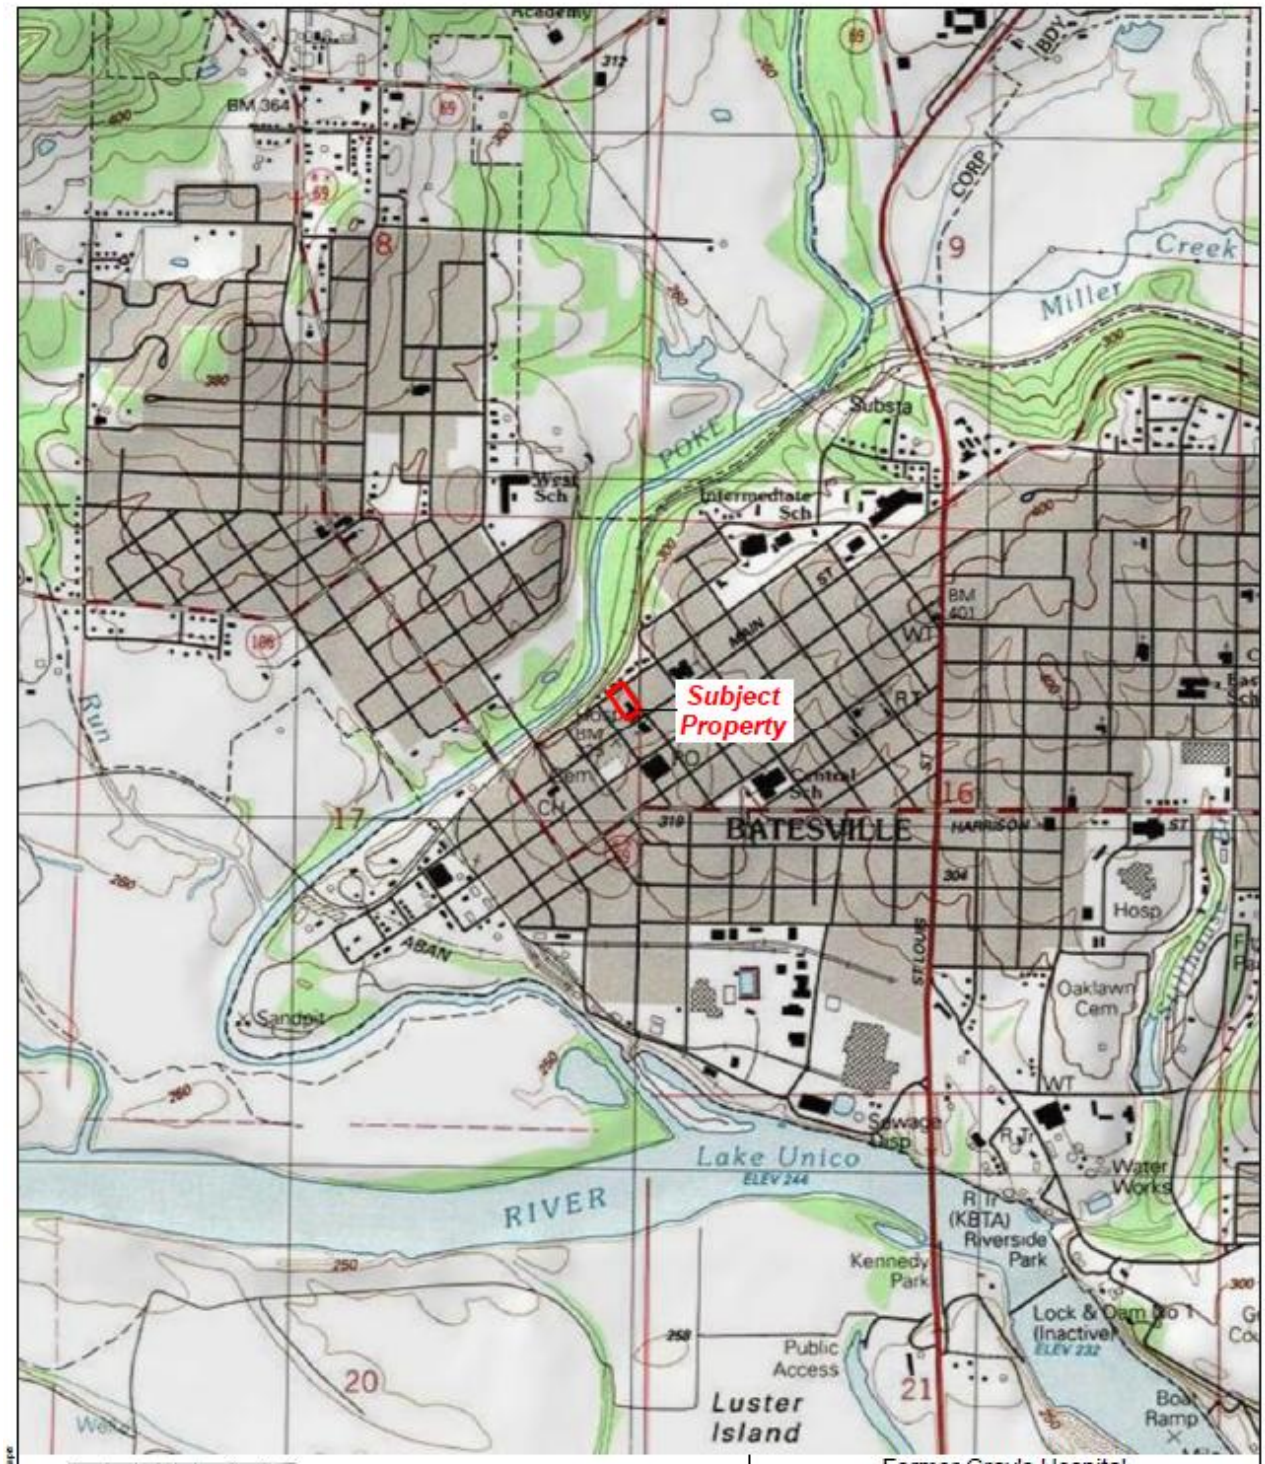
Subject Property
BATESVILLE
Lake Unico
ELEV 244
RIVER
Luster Island
Public Access
Kennedy Park
Riverside Park
Lock & Dam No 1 (Inactive)
ELEV 232
Water Works
Oaklawn Cem
Hosp
Central Sch
Intermediate Sch
West Sch
Substa
Miller Creek
POKE
ABAN
Run
Sandpit
Boat Ramp
Independence County
N
0 1,000 2,000
Feet
Source: USGS Batesville, AR 7.5 Minute Topo Quad, 1989
Former Gray's Hospital
477 East Main Street
Batesville, Arkansas
Figure 1
Subject Property Location Map
TETRA TECH

Water St
Water St
Water St
N 5th St
N 5th St
Construction trailer and storage shed
1100657001C
N 4th St
N 4th St
E Main St
E Main St
E Main St
N
0
50
100
Feet
Legend
Boiler
Fire Hydrant
Kitchen Floor Drain
Pole-mounted Transformer
Storm Drain
Inferred Groundwater Flow Direction
Parcel
Subject Property
Former Gray's Hospital
477 East Main Street
Batesville, Arkansas
Figure 2
Subject Property Layout Map
TETRA TECH
Source: EGRI, ArcGIS Online, World Imagery, 2021

2.2 Detailed Scope of Services

The scope of work (SOW), based on ASTM E1527-21 Environmental Site Assessments: Phase I Environmental Site Assessment Process, is to identify RECs for the subject property. Phase I ESAs typically proceed in a four-phase process, including: records review; site reconnaissance; interviews with current owners, occupants of the subject property, and local government agencies; and preparation of a report. The client also requested that Tetra Tech include recommendations for additional testing and assessment, if warranted. Those recommendations are in **Section 8**.

Report limitations are conveyed in **Section 2.4**. Deviations from ASTM E1527-21 are described in **Section 2.6.**

In addition to the site reconnaissance, readily available resources including, but not limited to, soil surveys, subject property maps, aerial photographs, U.S. Geological Survey (USGS) topographic maps, and regulatory records were reviewed. A listing of referenced documents utilized during this assessment is in **Section 10**.

ASTM E1527-21 establishes a 180-day viability period for Phase I ESA reports. The 180-day period commences upon the earliest date of five specific components of the report. The component dates and report viability date are as follows:

Phase I Environmental Site Assessment Task	Component Date
Date of Initial Interview(s) of Past and Present Owners and Occupants	September 22, 2025
Date of Initial Regulatory Record Reviews	September 10, 2025
Date of Visual Inspection(s) of Subject Property and Adjoining Properties	September 22, 2025
Earliest Date of Interviews, Record Reviews, and Inspections	September 9, 2025
Report Viability (expiration) Date	March 8, 2026

2.3 Significant Assumptions

In conducting the Phase I ESA, Tetra Tech assumed that all information obtained from others regarding the subject property is correct and complete. Additionally, Tetra Tech assumes that the client and/or the current owner(s) and/or occupants within the subject property have provided Tetra Tech with all reasonably ascertainable prior environmental information concerning the subject property. Tetra Tech assumes that the User will read this report in its entirety.

2.4 Limitations

Preparation of this Phase I ESA Report accorded with the scope of work approved by the client, under the terms and conditions defined in the contract between the client and Tetra Tech. This report is intended for the sole and exclusive use of the client. No other party is granted Reliance on this report without the express written consent of the client and execution of a Reliance Letter agreement between that party and Tetra Tech. To avoid any ambiguity, proper execution of a Reliance Letter in a form acceptable to Tetra Tech is a condition precedent to third-party reliance on the Report.

This Phase I ESA generally accorded with ASTM Standard E1527-21 and current, generally accepted practices and standards of care, consistent with the level of care and skill exercised under similar circumstances by other professional consultants or firms performing the same or similar services. Tetra Tech notes that no environmental standard can eliminate the role of professional judgment, and that other parties may reach different conclusions. Therefore, this section identifies limitations associated with this Phase I ESA.

An ASTM Standard E1527-21 Phase I ESA is not a comprehensive site assessment and should not be construed as such. This report presents opinions based on findings of visually observable on- and off-site conditions at the time of the site reconnaissance, a review of specific records and historical sources, and comments by interviewees. Lack of evidence of RECs does not guarantee absence of such conditions; rather, it indicates that none was identified as a result of the Phase I ESA scope of services implemented and conditions at the time the work was completed. This Phase I ESA is subject to the limitations cited in ASTM Standard E1527-21, including the limited period of viability of 180 days (as identified in the table in **Section 2.2**).

Unless specifically cited in this report, any conclusions associated with subsurface soil, soil vapor, and/or groundwater effects are limited to those that can be formed based on a review of the listed records, interviews with the listed individuals, visual observations at the time of inspection of the subject property, if applicable, and non-intrusive investigation.

This report and its findings are based on information from standard sources that are reasonably ascertainable (publicly available, readily obtainable within a reasonable time and cost, and practically reviewable). Tetra Tech has attempted to ascertain, but does not guarantee, the authenticity or reliability of information it has received from outside sources. Sources used in this report are cited in the text and in the references in **Section 10**.

This Phase I ESA's limited scope of services precludes Tetra Tech from providing a warranty or guarantee regarding presence or absence of hazardous substances or petroleum products that could affect the subject property. None of the work performed constitutes, nor should be represented as, a legal opinion of any kind or nature, but is a representation of professional findings of fact based on the information examined. Implementation or use of the findings or conclusions of this report does not preclude potential for present or future environmental liability.

2.5 Exceptions

There were no exceptions for this Phase I ESA.

2.6 Limiting Conditions/Deviations

The limiting conditions, deletions, or deviations from ASTM E1527-21 were identified:

- Surficial observations in the subject property building were limited by the presence of trash and debris observed throughout the floors of the building.
- According to Mr. Markowski, just the hospital building and immediate surrounding area are being donated to the hospital. The back parking lot area will remain with current ownership. Thus, Tetra Tech did not access the construction trailer or shed on the northwest corner of the parcel.
- The User Questionnaire was not received as of the issuance of the report.

Tetra Tech does not believe that these deviations affect its ability to render an opinion regarding RECs or de minimis conditions for the subject property.

2.7 Special Terms and Conditions

Tetra Tech conducted this ESA on behalf of the client, as authorized by client representative Addie McClain.

2.8 User Reliance

The client is the only party that has been involved in defining the scope of services needed to satisfactorily manage its risks. The client is the only intended beneficiary of this report. Reliance on this report by parties other than the client may result in reliance on assumptions whose extent and nature could distort the

meaning and effect of findings conveyed in this report. As such, no party except the client should rely upon estimates of possible presence of hazardous materials at the subject property. With the consent of the client, Tetra Tech is available to work with other parties in developing probability estimates, assuming mutually agreed contract terms, given other parties unique risk management concerns. Guidelines used to define hazardous substances and petroleum products came from ASTM Standard of Practice E1527-21. For the purposes of this report, the surrounding vicinity of the subject property is defined as properties within approximately 500 feet of the subject property.

3.0 USER PROVIDED INFORMATION

The following sections summarize information (if provided) from the City of Batesville, also identified as the User of this ESA. Tetra Tech provided an Environmental User Questionnaire to Mr. Rick Elumbaugh, Mayor of the City of Batesville. As of the issuance of this report the User Questionnaire has not been returned.

3.1 Title Records

The client provided no title records pertaining to the subject property. The Independence County Assessor's Office was contacted but property records were not received at the time of this report. Based on the environmental liens and activity and use limitations (AULs) report from Environmental Data Resources, Inc. (EDR) of Batesville, Arkansas (**Appendix D**), information about the last sale of the subject property is as follows:

- Parcel Number 1100657001C owned by Markowski Investment Holdings, LLC., was purchased from Preferred Family Healthcare, Inc. with a deed dated August 10, 2022.

3.2 Environmental Liens and Activity and Use Limitations

Environmental liens and AULs information was evaluated as part of this ESA. The subject property was not listed in the National Priorities List (NPL) Liens, Liens, Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) Liens Information, or Deed Restriction Listings databases searched by EDR. The EDR Database Report is in **Appendix D**. Tetra Tech requested from EDR a search for environmental liens and AULs imposed on the subject property parcel (**Appendix E**). No environmental liens or AULs were found.

3.3 Specialized Knowledge

The User did not provide any knowledge regarding or experience material to RECs for the subject property.

3.4 Actual Knowledge

The User did not provide any actual knowledge of any environmental lien or AULs encumbering the subject property or in connection with the subject property.

3.5 Valuation Reduction for Environmental Issues

The User did not provide any knowledge of valuation reduction for environmental issues associated with the subject property.

3.6 Commonly Known or Reasonably Ascertainable Information

The User did not provide any other commonly known or reasonably ascertainable information regarding RECs.

3.7 Degree of Obviousness

The User did not provide any obvious indications of presence or likely presence of releases or threatened releases at the subject property.

3.8 Other

According to the client, this Phase I ESA was requested as part of a TBA.

4.0 SITE RECONNAISSANCE

The purpose of the site reconnaissance is to collect information and make observations to help identify RECs, CRECs, de minimis conditions, and BERs for the subject property.

4.1 Observation

The subject property occupies an entire parcel in Batesville, Arkansas. The parcel is 0.68-acres of land and was identified with the address 477 East Main Street during the reconnaissance. The subject property is situated within an area predominantly developed with retail and institutional properties.

The subject property site visit was conducted on September 22, 2025, by Allie Cook, with Tetra Tech. At the time of the site reconnaissance, the weather was sunny, the temperature was 78 degrees Fahrenheit, and visibility was good.

During the site reconnaissance, the former hospital subject property building was vacant and out of use. Previously, the former Gray's Hospital building was in use from 1937 to 2021. The construction trailer and storage shed were erected when the property was purchased by the current owner in 2022.

The hospital building and main subject property areas were accessible during the site reconnaissance, except for a construction trailer and shed at the northwest corner of the parcel. Tetra Tech was accompanied in the morning on September 22, 2025, during the internal walk-through of the building by Mr. Markowski, property owner.

4.2 Methodology

The subject property is accessed via East Main Street on the southeastern property boundary.

The subject property site reconnaissance consisted of a walk-through of the subject property main structure and a grid-pattern pedestrian reconnaissance of the perimeter of the subject property to identify the presence of possible fuel tanks, drums, or other objects of potential environmental concern. The periphery of the structure on the subject property was visibly and physically observed. The interior of the structure at the subject property was visibly and physically observed including accessible common areas where hazardous substances or petroleum products were or may have been stored, used, treated, discharged, or disposed of.

The subject property and adjacent properties were also observed from adjoining public thoroughfares.

4.3 Exterior Observations

The subject property is situated within an area predominantly developed with retail. The subject property building is improved with a 13,000-square-foot building constructed in 1937, with two additions on the northwest side of the building. One of these additions was used as a storage building. The majority of the subject property surface surrounding the building is paved with asphalt. A construction trailer and storage shed are on the northwest corner of the subject property, installed by the current owner when the property was purchased in 2022. A storm drain is located along North 5th Street.

The following is a summary of exterior observations of the subject property, following which affirmative responses are discussed in detail:

Exterior Features	Observed
Storage Tanks	No
Drums, Barrels, Totes, and/or Containers > 5 gallons	No
Unidentified Substance Containers	No

Exterior Features	Observed
Chip Hoppers	No
Hazardous or Petroleum Waste Streams	No
Underground Storage Tanks	No
Fuel Dispensers	No
Sumps or Cisterns	No
On-site Septic or Sewage Treatment	No
Oil/Water Separators	No
Floor Drains, Trench Drains, etc.	No
Pipeline Markers	No
Stressed Vegetation	No
Stained Soil or Pavement	Yes
Pad- or Pole-Mounted Transformers and/or Capacitors	Yes
Polychlorinated biphenyl (PCB)-Containing Equipment	No
Wells (drinking, irrigation, water supply, injection, abandoned, monitoring, dry, or other wells)	No
Trash Compactor	No
Soil Piles of Unknown Origin	No
Back-up Power Generator(s)	No
Cooling Towers	No
Exterior Dumpsters with Staining	No
Leachate or Other Waste Seeps	No
Solid Waste, Debris, or Other Waste Materials	No
Uncontrolled Dumping or Disposal Areas	No
Surface Water Discoloration, Sheen, or Free Product	No
Strong, Pungent or Noxious Odors	No
Stormwater Retention or Detention Ponds	No

Stained Soil or Pavement: De minimis staining was present on the asphalt-paved areas throughout the parking lot of the subject property. The surficial staining varied in size from about 1 foot in diameter up to 3 to 5 feet in diameter in some areas and appeared to be associated with vehicles that were formerly present. Because the staining appeared to be surficial, did not appear to present a threat to human health or the environment, and would not likely require enforcement action if brought to the attention of appropriate governmental agencies, it is considered a de minimis condition.

Pad or pole-mounted Transformers and/or Capacitors: A pole-mounted transformer was visible, adjacent to the northwest storage building attached to the hospital. Non-PCB stickers were not visible, but the transformers appeared in good condition with no leaks or stains present. With the condition and no leaks or stains, the transformers are not considered RECs to the subject property.

4.4 Interior Observations

The interior of the main subject property building is accessed via the front reception area facing East Main Street or via the back entrance accessed from 2nd floor stairs that lead to the parking lot. The interior of the main building consists of the reception area, the main hallways, offices, patient rooms, surgery rooms, a

nurse's station, kitchen, and multiple record rooms. The building was vacant at the time of the site reconnaissance. The floors of the building were in good condition.

According to Mr. Markowski, just the hospital building and immediate surrounding area are being donated to the hospital and not the back parking lot area. Thus, Tetra Tech did not access the construction trailer or shed on the northwest corner of the parcel. According to Mr. Markowski, the shed just has miscellaneous junk, and will be torn down. The construction trailer has leftover building materials like siding, flooring and doors.

The following is a summary of observations of building interiors on the subject property, following which affirmative responses are discussed in detail:

Interior Features	Observed
Storage Tanks	No
Elevators (hydraulicly operated only)	No
Air Compressors	No
Chemical Fire Suppression System(s)	Yes
Incinerators	Yes
Stains or Corrosion on Floors, Walls, or Ceilings (except for staining from water)	No
Waste Treatment Systems (include process wastewater and indicate if present indoors and/or outdoors)	No
Presses/Stamping Equipment	No
Press Pits	No
Hydraulic Lifts or In-ground Hoists	No
PCB-Containing Equipment	No
Paint Booth	No
Plating Tanks	No
Lathes, Screw Machines, etc.	No
Drums, Barrels, Totes, and/or Containers > 5 gallons	No
Unidentified Substance Containers	No
Chip Hoppers	No
Hazardous or Petroleum Waste Streams	No
Underground Storage Tanks	No
Fuel Dispensers	No
Sumps or Cisterns	No
On-site Septic or Sewage Treatment	No
Wells (monitoring, vapor intrusion, potable water, or other wells)	No
Dry Cleaning Equipment	No
Photo Processing Equipment	No
Parts Washer	No
Cooking Grease Trap	No
Strong, Pungent, or Noxious Odors	No
Oil/Water Separators	No

Interior Features	Observed
Floor Drains, Trench Drains, etc.	Yes

Fire Suppression System: In the kitchen area of the subject property building a fire suppression system was observed over the former stove top/oven area. A large fire hydrant was observed hooked up the fire suppression system. The system appeared in a good condition and does not pose a REC for the subject property.

Incinerators: The former waste incinerator used by the hospital was observed in the boiler room. The unit was constructed of brick, with cast iron doors. The fuel source could not be determined. This unit does not appear to be the natural-gas-fueled steel incinerator installed and permitted in 1975 (**Section 5.3.1**), and presumably was the hospital's original medical waste incinerator. The historical use of an incinerator is considered a REC for the subject property.

Floor Drains: Multiple floor drains were observed throughout the hospital building. One floor drain was observed in the kitchen area of the building and the other floor drains were associated with bathrooms found throughout the floors and in patient rooms in the hospital building. According to Mr. Markowski, the floor drains drain to the sanitary sewer system. The drains are not considered a REC for the subject property.

4.5 Limiting Conditions

The following limiting conditions during the site reconnaissance:

- Surficial observations in the subject property building were limited by the presence of trash and debris observed throughout the floors of the building.
- According to Mr. Markowski, just the hospital building and immediate surrounding area are being donated to the hospital. The back parking lot area will remain with current ownership. Thus, Tetra Tech did not access the construction trailer or shed on the northwest corner of the parcel.

4.6 Current Uses of Subject Property

During the site reconnaissance, the subject property was occupied by a parking lot and vacant building (constructed in 1937). The subject property was most recently used as a hospital and stopped operation in 2021.

4.7 Past Use of Subject Property

Based on the site reconnaissance, the building was used as a hospital for the surrounding community and the parking lot of the subject property was most recently used as parking for the former employees of the building. **Section 5.2** provides additional details about the past uses of the subject property.

4.8 Current Use of Adjoining Properties and Surrounding Area

Adjoining properties were visually examined from public access rights-of-way to make a cursory assessment of the current land use and its potential for RECs which may have an impact on the subject property. The subject property appeared to be surrounded by retail properties.

The subject property is bound to the northwest by Water Street followed by a residential property, and Brad's Vacuums (499 Water Street) with the Poke Bayou (waterway) beyond; to the northeast by North 5th Street followed by Ozark Foothills Literacy Project (184 North 5th Street) and Merchants and Planters Bank (555 East Main Street); to the southeast by East Main Street followed by St. Paul's Episcopal Church (424 East Main Street); and to the southwest by various retail shops (204 South 4th Street and 407 East Main Street) and Ellis Machine Shop (184 North 4th Street).

4.9 Topographic Conditions of Subject Property and Surrounding Area

The topography of the subject property is relatively flat. Storm water runoff is directed to storm water drains located along North 5th Street. The area surrounding the subject property generally slopes northwest toward Poke Bayou, which is approximately 225 feet northwest of the property. Surface water presumably infiltrates the ground surface and would flow in the assumed downgradient direction to the northwest towards Poke Bayou.

4.10 Structures and Other Improvements

The subject property building is comprised of a 13,000-square-foot building with an asphalt parking lot north of the building. The core of the building was constructed in 1937, with two later additions on the northwest side of the building. The building is constructed on a reinforced concrete slab with concrete walls. One small basement area underlies the northern center portion of the building and was used as the historical boiler room. The subject property is accessed from East Main Street on the southern property boundary. The parking areas consist of asphalt areas in the northern portion of the subject property.

4.11 Roads

The subject property is accessed from East Main Street on the southern property boundary or from Water Street or North 5th Street to the parking lot on the northern portion of the property.

4.12 Potable Water Supply

Potable water to the subject property is supplied by the City of Batesville. The subject property's water had been shut off at the time of the site visit.

4.13 Sewage Disposal System

The City of Batesville provides sewage disposal services.

4.14 Heating/Cooling

The buildings are heated and cooled by roof-mounted heating, ventilation, and air conditioning (HVAC) systems. In the past, the property had been heated by a boiler.

4.15 Wells

No wells (including water supply, dry wells, irrigation wells, injection wells, monitoring wells, abandoned wells, or other wells) were observed at the subject property.

4.16 Septic System or Cesspools

No evidence of septic systems or cesspools was observed at the subject property.

5.0 RECORDS REVIEW

The purpose of the records review was to obtain and review records that would help identify RECs for the subject property.

5.1 Physical Setting

The following sections provide information about the geologic, hydrogeologic, hydrologic, or topographic characteristics of the area.

5.1.1 Topography

According to the EDR Lightbox Report, the subject property is approximately 320 to 330 feet above mean sea level and relatively flat with a general slope from the southeast corner to the northwest corner. Stormwater runoff is assumed to follow the topography to the northwest corner of the subject property.

5.1.2 Geologic Setting

According to the Geologic Map of the Batesville Quadrangle, Independence County, Arkansas, geology at the subject property is classified as the Chesterian Series of the Mississippian System (Arkansas Geological Survey 2022). The soils are classified as Linker, which consists of gravelly fine sandy loam, which are part of the Class B hydrologic group that have moderate infiltration rates and are considered to have deep and moderately deep to moderately well and well drained soils, with moderately coarse textures. These are considered well drained soils, that are not hydric and have a low corrosion potential. The depth to bedrock is greater than 77 inches.

5.1.3 Hydrogeology

Based on surface topography, as interpreted from a USGS topographic quadrangle map, groundwater in the immediate area of the subject property is assumed to flow northwest toward Poke Bayou. The actual groundwater flow direction may be locally influenced by factors such as surface topography, underground structures, oil and gas extraction, wetlands, seasonal fluctuations, soil and bedrock geology, water wells, and other factors.

5.2 Historical Records Review

Historical data regarding the subject property were gathered to assess past uses and evaluate visible environmental issues that may constitute RECs. If included with the subject property research data, uses of the adjoining and surrounding area also were evaluated for environmental issues that may constitute RECs. The following sections describe aerial photographs, Sanborn maps, topographic maps, city directories, chain-of-title records, and prior environmental reports reviewed.

5.2.1 Historical Aerial Photographs, Sanborn Maps, Topographic Maps, and City Directories

Historical resources were provided by EDR and were reviewed for information regarding the past uses of the subject property and surrounding area. An aerial photograph dated 2021 was obtained from ESRI World Imagery (ESRI, 2021) and a 2020 topographic map was obtained from The National Map, Topo Base from the USGS (USGS, 1989).

The following is a summary of information reviewed pertaining to the subject property. Historical EDR-provided documents are in **Appendix F**. The 2020 topographic map is included as **Figure 1**, and the 2021 aerial photograph is included as **Figure 2**.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory

Year	Source	Observation
1891	T	**Subject Property:** The subject property appears in an urban developed area with streets and town blocks. **Surrounding Area:** The surrounding properties are in an urban area developed with streets. The town is southwest-northeast trending above the east-west White River. Multiple streets are accessed from the town to the northwest, north, and northeast. A subdivision is across Poke Bayou to the northeast of the subject property. A railroad is accessed from the town to the southwest.
1892	S	**Subject Property:** The subject property is outside the area depicted on the map. **Surrounding Area:** Only the southwest adjacent properties are depicted which include a corral, a feed barn, photo gallery, and other businesses.
1897	S	**Subject Property:** The southeastern half of the subject property is depicted. There are three residential structures visible on the subject property. **Surrounding Area:** Only the southwestern, southern, southeastern, and northeastern properties are depicted. The closest identifiable buildings include a Presbyterian Church to the southwest and a Protestant Episcopal Church to the southeast.
1901	S	**Subject Property:** No significant changes were observed to the subject property. **Surrounding Area:** No significant changes were observed to the surrounding property.
1908	S	**Subject Property:** The subject property's northwest residential building appears to have had an extension built. **Surrounding Area:** An opera house and furniture warehouse appear to the southwest, approximately 600 feet southwest. The building between the opera house and the subject property on the corner of First Street and Main is the Post Office.
1914	S	**Subject Property:** More dwellings/residential structures appear on the north portion of the subject property along Water Street. **Surrounding Area:** The northwest half of the map is visible. Residential dwellings occupy the space to the northwest between the subject property and Poke Bayou. The Presbyterian Church to the southwest of the subject property has been replaced by the Business College.
1923	S	**Subject Property:** A structure appears in the northwest corner of the subject property between the two existing structures. The northwest attachment on the southeastern structure of the subject property has been removed. **Surrounding Area:** New structures (un-named) have appeared on North Church Street. The Episcopal Church to the southeast, across E. Main Street has been upgraded. Buildings to the northeast, approximately 150 feet, have been removed. A garage has appeared on the corner of E. Main Street and S. 2nd Street, approximately 150 southeast. The Business College has been replaced by a larger facility and a Furniture store.
1930	S	**Subject Property:** Small residential structures on the southwest corner and in the central area of the subject property appear.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory		
		Surrounding Area: The garage to the southeast of the subject property has expanded operations and is now a garage shop and auto sales dealership. The buildings to the southwest and on the corner of N. Church Street and W. Main Street, now labeled as Arkansas Dry Goods Co. A filling station with a least three tanks is depicted approximately 75 feet southwest of the subject property, across Main Street.
1942/1943	A, T	**Aerial Photograph - Subject Property:** The aerial photograph is grainy; however, the subject property appears to be developed with multiple structures. The existing building is located on the southern portion, and another structure appears to be on the northern portion along Water Street. **Aerial Photograph - Surrounding Area:** The surrounding area is developed with multiple urban structures and streets. **Topographic Map - Subject Property:** The existing hospital building is depicted on the southern portion of the subject property. **Topographic Map - Surrounding Area:** There is increased development in the town center. Batesville has expanded to the east. The subdivision to the northwest has expanded northwest.
1945	T	**Topographic Map – Subject Property:** No significant changes to the subject property were observed. **Topographic Map – Surrounding Area:** No significant changes to the surrounding area were observed.
1947	S	**Subject Property:** Gray's Hospital is depicted on the southeast portion of the subject property. A detached building to the southwest of the main building is indicated as "rooms." Dwellings and associated residential buildings are depicted on the northern portion of the subject property. **Surrounding Area:** Multiple new buildings appear to the southwest and are predominantly furniture and department stores. A Dry Cleaners and Steam Laundry business has appeared approximately 150 feet to the southwest across Main Street.
1960	S	**Subject Property:** Two small structures have been added in the southwest central and central area of the subject property. **Surrounding Area:** A printing store has appeared to the southwest across North 4th Street. A store named "Agricl Implts. Sales and Service" has appeared to the west of the subject property. An auto repair business has appeared to the east, across North 5th Street. The Episcopal Church to the southeast has an addition that extends to its southwest. A Dry Cleaners and Steam Laundry business has appeared approximately 150 feet to the southwest across Main Street.
1975	T	**Subject Property:** The subject property building is depicted and remainder of the subject property is shaded, depicting urban development. **Surrounding Area:** Urban development is portrayed as shaded, extending to the borders/extent of the outer streets.
1979	A	**Subject Property:** No significant changes to the subject property were observed, except the subject property building has expanded to its current configuration and the other residential buildings on the north portion are no longer visible.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory		
		Surrounding Area: No significant changes were observed to the surrounding area.
1981	T	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** Increased development to the northwest of the subject property continues. Multiple structures are observed the to the north-northeast of the subject property along Poke Bayou.
1984	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed to the surrounding area.
1986	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed to the surrounding area.
1989	T	**Subject Property:** A building is portrayed on the subject property on the southeast corner. **Surrounding Area:** The surrounding area displays increased development throughout town. Multiple buildings appear in the immediate vicinity to the subject property, most notably to the southeast and northeast. Urban development is highlighted greenish gray and is to the same extent as the prior year.
1992	C	**Subject Property:** The subject property address was not identified in this city directory report. **Surrounding Area:** 106 South 5th Street is approximately 280 feet southeast of the subject property and is identified as Mclean, James R Jr (residential listings). 424 East Main Street is approximately 166 feet southwest of the subject property and is identified as McIntyre, Don (residential listings). 500 East Main Street is approximately 300 feet southeast of the subject property and is identified as Hughes, Robert J Jr, Milligan, Tommy J., and Welch, John E (residential listings).
1994	A	**Subject Property:** No significant changes to the subject property were observed, except a building structure and shed are visible on the northwest corner of the subject property. **Surrounding Area:** No significant changes were observed to the surrounding area.
1995	C	**Subject Property:** The subject property address was not identified in this city directory report. **Surrounding Area:** 106 S 5th Street is approximately 280 feet southeast of the subject property and was identified as Mclean, James R JR. 400 East Main Street is approximately 220 feet southwest of the subject property and is identified as Drug Task Force. 409 East Main Street is approximately 180 feet southwest of the subject property and is identified as Pioneer General Store.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory		
		416 East Main Street is approximately 180 feet south of the subject property and is identified as Garcia's Exxon and Wrecker Service. 418 East Main Street is approximately 180 feet south of the subject property and is identified as Bonnie's Used Furniture, Economy Movers, and Lawrence, Ron. 500 East Main Street is approximately 312 feet southeast of the subject property and is identified as Auto Rental Resource Center, Batesville City Hall, Batesville Mayor's Office, Batesville Water Utility Main, Belew and Bell, and John Belew. 535 East Main Street is approximately 185 feet east of the subject property and is identified as Nels Ball and Sons Motor. 610 East Main Street is approximately 565 feet east of the subject property and is identified as First Baptist Church.
2000	C	**Subject Property:** The subject property was not identified in this city directory report. **Surrounding Area:** 359 East Main Street is approximately 406 feet southwest of the subject property and is identified as Grammer, John's. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as Hively T J Attorney. 369 East Main Street is approximately 346 feet southwest of the subject property and is identified as Brad's Vacuum and Sewing Center. 418 East Main Street is approximately 172 feet southwest of the subject property and is identified as Dominiques Fashion Café. 424 East Main Street is approximately 160 feet southwest of the subject property and is identified as Byars W Randall Interiors and Randalls II. 447 East Main Street is approximately 310 feet southeast of the subject property and is identified as The Birch Tree Community Incorporated. 500 East Main Street is approximately 320 feet southwest of the subject property and is identified as City of Batesville Mayor's Office, City of Batesville Water Department, Judy Belew Realtor, Bell Steve Attorney, Blankenship Leroy Attorney, Couch Bill CPA, Couch, B., Davidson J. Scott Attorney, Davidson, J., Hughes Robert J Jr CPA, and McGaha, Bobby. 535 East Main Street is approximately 185 feet northeast and is identified as Ball Nels and Sons Motor Company 555 East Main Street is approximately 195 feet northeast of the subject property and is identified as Merchants and Planters Bank. 610 East Main Street is approximately 565 feet east of the subject property and is identified as First Baptist Church.
2001	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed to the surrounding area.
2005	C	**Subject Property:** The subject property was not identified in this city directory report.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory		
		Surrounding Area: 347 East Main Street is approximately 439 feet southwest of the subject property and is identified as Wann Office Supply. 359 East Main Street is approximately 396 feet southwest of the subject property and is identified as Jills Alterations. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as Independence County Library, Independence County of Juvenile Court, and White River Regional Library. 409 East Main Street is approximately 180 feet southwest of the subject property and is identified as Gunsmith Inc. 424 East Main Street is approximately 160 feet southwest of the subject property and is identified as Saint Paul's Episcopal Church. 500 East Main Street is approximately 320 feet southwest of the subject property and is identified as Bartlesville (sic) Water Utilities, Belew and Bell, Judy R. Belew, Bis of Arkansas, City of Batesville, Civil Servies Inc., Grady, Jerrie L., Law office of Jerrie L Grady, S Rider LLC, Scott M Stalker, Robert Stroud, United States House Rep, United State Government US Rep MRN, Wilson Katharine C., and Wolfgang Professional Services Inc. 555 East Main Street is approximately 195 feet northeast of the subject property and is Bartlesville (sic) Merchants and Planters BA 610 East Main Street is approximately 565 feet east of the subject property and is identified as First Baptist Church. 615 East Main Street is approximately 762 feet northeast of the subject property and is identified as Day Out Preschool and First United Methodist Church.
2006	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed to the surrounding area.
2010	A, C	**Aerial Photograph - Subject Property:** No significant changes to the subject property were observed. **Aerial Photograph - Surrounding Area:** No significant changes were observed to the surrounding area. **City Directory – Subject Property:** The subject property address was not identified in this city directory report. **City Directory – Surrounding Area:** 347 East Main Street is approximately 439 feet southwest of the subject property and is identified as Wann Office Supply. 359 East Main Street is approximately 396 feet southwest of the subject property and is identified as Jills Alterations. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as Drug Task Force, Independence County Auditor, Independence County Hot Check, Independence County Emergency, Independence County Juvenile Court, Independence County Juvenile Judge, Independence Prosecuting Attorney, Police Dispatch, Volunteer Clearing House, and White River Regional Library.

A = Aerial Photograph	T = Topographic Map	S = Sanborn® Maps	C = City Directory
		377 East Main Street is approximately 347 feet southwest of the subject property and is identified as Hidden Treasures. 407 East Main Street is approximately 175 feet west-southwest of the subject property and is identified as Old Town Mall. 500 East Main Street is approximately 320 feet southwest of the subject property and is identified as Batesville City Hall, Batesville City Yard, Batesville Code Enforcement, Batesville Water Utilities, Belew and Bell, Bis of Arkansas, Jerrie L. Grady, Judy Belew Realtors, and Deborah L. Robert-Stroud 615 East Main Street is approximately 762 feet northeast of the subject property and is identified as Early Learning Center and First United Methodist Church. 655 East Main Street is approximately 755 feet northeast of the subject property and is identified as Plantlife.
2014	T, C	**Topographic Map - Subject Property:** No significant changes to the subject property. **Topographic Map - Surrounding Area:** No significant changes to the surrounding area. No buildings are depicted. **City Directory – Subject Property:** The subject property address was not identified in this city directory report. **City Directory – Surrounding Area:** 325 East Main Street is approximately 530 feet southwest of the subject property and is identified as Old World Lanterns by Benoit. 327 East Main Street is approximately 478 feet southwest of the subject property and is identified as Electric Wonderland. 345 East Main Street is approximately 450 feet southwest of the subject property and is identified as Independence County Economic Development. 347 East Main Street is approximately 439 feet southwest of the subject property and is identified as Wann Office Supply. 359 East Main Street is approximately 396 feet southwest of the subject property and is identified as Jills Alterations. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as County of Independence and White River Regional Library. 377 East Main Street is approximately 347 feet southwest of the subject property and is identified as Vintage Wine. 407 East Main Street is approximately 175 feet west-southwest of the subject property and is identified as Olde Towne Mall Antiques and Flea Market. 409 East Main Street is approximately 180 feet southwest of the subject property and is identified as Pioneer General Store. 417 East Main Street is approximately 130 feet west of the subject property and is identified as Embroidery and Beyond. 424 East Main Street is approximately 160 feet southwest of the subject property and is identified as Saint Paul's Episcopal Church.

A = Aerial Photograph	T = Topographic Map	S = Sanborn® Maps	C = City Directory
		500 East Main Street is approximately 320 feet southwest of the subject property and is identified as Batesville Water Utilities, Bell Steve Attorney at Law, Blair and Stroud ATTYS, Blair H David ATTY, David Blair, Castleberry T Lindsey Attorney at Law, Castleberry T., City of Batesville, Huff Michelle C ATTY, Methodist Counseling Clinic, Pfeiffer Water Association, Stalker Scott M ATTY, and Stroud Robert D ATTY 555 East Main Street is approximately 195 feet northeast of the subject property and is identified as Bartlesville (sic) Merchants and Planters Bank.
2015	A	**Subject Property:** No significant changes to the subject property were observed. New development is visible directly across the street to the northwest. **Surrounding Area:** No significant changes were observed in the immediate surrounding area. New development is visible to the north-northeast.
2017	T, C	**Topographic Map - Subject Property:** No significant changes to the subject property were observed. **Topographic Map - Surrounding Area:** No significant changes were observed to the surrounding area, except the addition of a road to the southwest, slightly north of White River, and the extension of W. Main Street to the southwest. **City Directory – Subject Property:** The subject property address was not identified in this city directory report. **City Directory – Surrounding Area:** 301 East Main Street is approximately 600 feet southwest of the subject property and is identified as Earth Station Nursery. 308 East Main Street is approximately 590 feet southwest of the subject property and is identified as Schwegmann's Office Supply. 325 East Main Street is approximately 530 feet southwest of the subject property and is identified as Old World Lanterns by Benoit. 327 East Main Street is approximately 478 feet southwest of the subject property and is identified as Electric Wonderland. 345 East Main Street is approximately 450 feet southwest of the subject property and is identified as Independence Fringe Salon. 347 East Main Street is approximately 439 feet southwest of the subject property and is identified as Wann Office Supply. 359 East Main Street is approximately 396 feet southwest of the subject property and is identified as Jills Alterations. 363 East Main Street is approximately 392 feet southwest of the subject property and is identified as Home for the Holidays. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as County of Independence. 377 East Main Street is approximately 347 feet southwest of the subject property and is identified as Petals and Plants Florist. 407 East Main Street is approximately 175 feet west-southwest of the subject property and is identified as Old Town Mall.

A = Aerial Photograph T = Topographic Map S = Sanborn® Maps C = City Directory		
		410 East Main Street is approximately 180 feet southwest of the subject property and is identified as T-shirt Express. 417 East Main Street is approximately 130 feet west of the subject property and is identified as Embroidery and Beyond. 424 East Main Street is approximately 160 feet southwest of the subject property and is identified as Saint Paul's Episcopal Church. 500 East Main Street is approximately 320 feet southwest of the subject property and is identified as Batesville Water Utilities, Bell Steve, Blair and Stroud, Castleberry, T., City of Batesville, Methodist Family Clinic, Steve Bell Attorney at Law, Deborah L. Stroud-Robert, and T Lindsey Castleberry Attorney at Law. 555 East Main Street is approximately 195 feet northeast of the subject property and is identified as JT Skinner Attorney, Merchants and Planters Bank, and Murphy Thompson Arnold Skinner and Cas. 610 East Main Street is approximately 565 feet east of the subject property and is identified as First Baptist Church. 615 East Main Street is approximately 762 feet northeast of the subject property and is identified as Early Learning Center and First United Methodist Church
2019	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed to the surrounding area.
2020	T	No significant changes to the subject property or surrounding area were observed.
2022	C	**Subject Property:** The subject property address was not identified in this city directory report. **Surrounding Area:** 301 East Main Street is approximately 600 feet southwest of the subject property and is identified as Earth Station Nursery, First Community Bank, and Platter Inn Music Store. 308 East Main Street is approximately 590 feet southwest of the subject property and is identified as Schwegmann's Office Supply and Terry King. 325 East Main Street is approximately 530 feet southwest of the subject property and is identified as Pocket Park. 347 East Main Street is approximately 439 feet southwest of the subject property and is identified as Jim Wann and Wann Office Supply. 363 East Main Street is approximately 392 feet southwest of the subject property and is identified as Beneath the Hollow, Elaine Hunterm, and Home Holidays and More. 368 East Main Street is approximately 387 feet southwest of the subject property and is identified as County of Independence, Don McSpadden, Drug Task Force, Independence Juvenile Court, Independence-County Prosecuting Attorney, Lee Harrod, Vanessa Adams, Volunteer Clearing House, and White River Regional Library.

A = Aerial Photograph	T = Topographic Map	S = Sanborn® Maps	C = City Directory
		369 East Main Street is approximately 346 feet southwest of the subject property and is identified as Embroidery and Beyond. 377 East Main Street is approximately 347 feet southwest of the subject property and is identified as Beverly Pitts and Petals and Plants Florist. 407 East Main Street is approximately 175 feet west-southwest of the subject property and is identified as Old Town Mall and Terri Chester. 410 East Main Street is approximately 180 feet southwest of the subject property and is identified as T-shirt Express. 417 East Main Street is approximately 130 feet west of the subject property and is identified as Embroidery and Beyond. 424 East Main Street is approximately 160 feet southwest of the subject property and is identified as John Drymon and Saint Paul's Episcopal Church. 500 East Main Street is approximately 320 feet southwest of the subject property and is identified as Alan Cockrill, Batesville Water Utilities, Belew and Bell, Blair and Stroud, Carol Helm, City of Batesville, City of Batesville City Hall, City of Batesville Code Enforcement, City of Batesville Landscaping Department, Damon Johnson, David H Blair, John Belew, Matthew Frederick, Methodist Family Clinic, Michelle C Huff Attorney, Michelle Huff, North Arkansas Seamless Gutters, Robert D Stroud, Robert D Stroud, Robert D Stroud Attorney, and Steve Bell 555 East Main Street is approximately 195 feet northeast of the subject property and is identified as Arnold Blair, Donnie Washam, Jerry Brightwell, and Merchants and Planters Ban 610 East Main Street is approximately 565 feet east of the subject property and is identified as First Baptist Church and Gene Tulberg. 615 East Main Street is approximately 762 feet northeast of the subject property and is identified as Batesville First United Methodist Church and Mark McDonald.
2023	A	**Subject Property:** No significant changes to the subject property were observed. **Surrounding Area:** No significant changes were observed in the immediate surrounding area. New development is visible directly across the street to the northwest and to the north-northeast.

5.2.2 Chain-of-Title

Chain-of-title records were not provided for review. Procurement of chain-of-title records was not included in the scope of work for this Phase I ESA.

5.2.3 Previous Environmental Reports

Tetra Tech requested previous environmental investigation reports regarding the subject property from the client. An Asbestos Inspection was conducted by Snyder Environmental (Snyder) in April 2018. The investigation identified asbestos ACM in mastic and insulation ranging from 2% to 20% chrysotile asbestos throughout the building (Snyder 2018).

5.2.4 Past Uses of Subject Property

From at least as early as 1891 to 1937, the subject property was occupied by residential structures. Historical Sanborn maps depict the subject property containing multiple residential structures in the southeastern corner as early as 1897, and northwestern corner as early as 1914. The main portion of the existing hospital building was constructed in 1937 with additions added through the years. According to the aerial photographs, a parking lot replaced the northern residential buildings by 1942. The existing metal sided building and shed were visible on the northwest corner from at least 1994 to 2020.

5.2.5 Past Uses of Adjoining Properties

If included during the review of the subject property historical data, historical uses of adjoining properties were reviewed. The following is a summary of historical uses of adjoining properties:

Direction	Description
North	Water Street; residential properties; Poke Bayou
East	North 5th Street; commercial properties, Bank and Ozark Foothills literacy project; East Main Street with commercial properties beyond; City of Batesville government offices and auto dealership and auto repair facility.
South	East Main Street; St. Paul's Episcopal Church and commercial properties; South 4th Street and East College Ave beyond including a filling station
West	Commercial properties and retail shops; Ellis Machine shop; North 4th Street, and commercial properties beyond.

The review of historical uses of adjoining properties did not identify past uses indicating potential RECs for the subject property, except for the following:

- An auto repair garage/auto dealership, located approximately 150 feet southeast, was identified in the Sanborn maps.
- A filling station depicted in the 1930, 1947, and 1960 Sanborn maps, approximately 75 feet to the southwest, is further discussed in **Section 5.3.2**.
- Drycleaners depicted in the 1947 and 1960 Sanborn maps, approximately 150 feet to the southwest, is further discussed in **Section 5.3.2**.

5.2.6 Past Uses of Surrounding Area

According to the review of historical information used to assess historical use of the subject property, historical uses of the surrounding area included residential, commercial, and institutional (churches) properties. These facilities are discussed in **Section 5.3.**

5.3 Regulatory Records Review

Federal, state, and local records were reviewed to assess whether the subject property or facilities within the ASTM E1527-21 approximate minimum search distance have undergone significant unauthorized releases of hazardous substances or other events with potentially adverse environmental effects. Tetra Tech contracted with EDR to perform a database search pertaining to the subject property in accordance with ASTM E1527-21. The database report is in **Appendix D**, and numbers of facilities listed are summarized below.

Database Acronym	Database Definition	Number of Facilities	Findings (REC or no REC)
Federal Records from Standard Sources			
NPL	National Priorities List	0	Not applicable (NA)
Proposed NPL	Proposed National Priorities List Sites	0	NA
NPL LIENS	Federal Superfund Liens	0	NA
DELISTED NPL	National Priorities List Deletions	0	NA
FEDERAL FACILITY	Federal Facility Site Information	0	NA
SEMS	Superfund Enterprise Management System	0	NA
SEMS-ARCHIVE	Superfund Enterprise Management System Archive	0	NA
SEMS LIENS	Superfund Enterprise Management System Liens	0	NA
CORRACTS	Corrective Action Report	0	NA
RCRA-TSDF	Resource Conservation and Recovery Act (RCRA) – Treatment, Storage, and Disposal	0	NA
RCRA-LQG	RCRA – Large Quantity Generators	0	NA
RCRA-SQG	RCRA – Small Quantity Generators	0	NA
RCRA-VSQG	RCRA – Very Small Quantity Generators	0	NA
LUCIS	Land Use Control Information System	0	NA
US ENG CONTROLS	Engineering Controls Sites List	0	NA
US INST CONTROL	Sites with Institutional Controls	0	NA
ERNS	Emergency Response Notification System	0	NA
FED BROWNFIELDS	The Assessment, Cleanup and Redevelopment Exchange System (ACRES) Brownfield Database	0	NA
CERCLIS	Comprehensive Environmental Response, Compensation, and Liability Information System	0	NA
CERCLIS NFRAP	CERCLIS – No Further Remedial Action Planned	0	NA
CERCLIS LIENS	CERCLIS Liens	0	NA
FRP	Facility Response Plan	0	NA
DELISTED FRP	Delisted Facility Response Plans	0	NA
REFN	Petroleum Refineries	0	NA
BULK TERMINAL	Petroleum Product and Crude Oil Rail Terminals	0	NA

Database Acronym	Database Definition	Number of Facilities	Findings (REC or no REC)
State and Tribal Records from Standard Sources			
SHWS	Hazardous Sites Cleanup Act Site List	0	NA
HSCA	Hazardous Sites Cleanup Act – Remedial Sites Listing	0	NA
SWF/LF	Operating Facilities – Landfills and Waste-to-Energy Facilities	0	NA
LUST	Underground Storage Tank Release Sites	0	NA
LTANKS	Leaking Storage Tank Locations	**5**	**No REC**
LST UNREG	Unregulated Storage Tank Releases	0	NA
LAST	Aboveground Storage Tank Release Sites	0	NA
DELISTED LST	Delisted Leaking Storage Tanks	0	NA
INDIAN LUST	Leaking Underground Storage Tanks on Indian Land	0	NA
UNREG LTANKS	Unregulated Tank Cases	0	NA
FEMA UST	Federal Emergency Management Agency (FEMA) Underground Storage Tank Listing	0	NA
UST	Listing of Arkansas Regulated Underground Storage Tanks	**8**	**No REC**
UST Finder	UST Finder Database	**7**	**No REC**
UST Finder Release	UST Finder Release Database	**5**	**No REC**
AST	Listing of Arkansas Regulated Aboveground Storage Tanks	**1**	**No REC**
TANKS	Storage Tanks	0	NA
DEL TANK	Delisted Tanks	0	NA
INDIAN UST	Underground Storage Tanks on Indian Land	0	NA
ENG CONTROLS	Engineering Controls Site Listing under Act 2 Program	0	NA
INST CONTROLS	Institutional Controls Site Listing under Act 2 Program	0	NA
AUL	Environmental Covenants Listing	0	NA
VCP	Voluntary Cleanup Program Sites	0	NA
INDIAN VCP	Voluntary Cleanup Priority Listing	0	NA
BROWNFIELDS	Arkansas Department of Environmental Quality Brownfields	0	NA

Database Acronym	Database Definition	Number of Facilities	Findings (REC or no REC)
Financial Assurance	Arkansas Financial Assurance Information	0	NA
Additional Environmental Federal, State, Tribal, and Local Records			
AR SWID	Solid Waste Illegal Dumps Database	0	NA
AR HW GEN	Arkansas Hazardous Waste Generators Database	**4**	**No REC**
AR ENF	Arkansas Enforcement Data	0	NA
AR SWRCY	Recycling Directory	**2**	**No REC**
Other Ascertainable Records			
RCRA NonGen/NLR	RCRA Non-generator / no longer regulated	**4**	**No REC**
AIRS	Aerometric Information Retrieval System	**1**	**No REC**
FUDS	Formerly Used Defense Sites	0	NA
DOD	Department of Defense Sites	0	NA
SCRD DRYCLEANERS	State Coalition for Remediation of Drycleaners Listing	0	NA
US FIN ASSUR	Financial Assurance Information	0	NA
US MINES	United States Mine Database	**1**	**No REC**
FINDS	Facility Index System/Facility Registry System	**1**	**No REC**
DOCKET HWC	Hazardous Waste Compliance Docket Listing	0	NA
ECHO	Enforcement & Compliance History Information	0	NA
ASBESTOS	Asbestos	0	NA
MANIFEST	Hazardous Waste Manifest Information	0	NA
PERMITS	Arkansas Department of Environmental Quality Permit Data System	**1**	**No REC**
EDR Databases			
EDR MGP	EDR Proprietary Manufactured Gas Plants	0	NA
EDR Hist Auto	EDR Exclusive Historic Gas Stations	3	**No REC**
EDR Hist Cleaner	EDR Exclusive Historic Dry Cleaners	1	**REC**

The databases searched have been developed and are updated by federal, state, and local agencies. Although these databases are reliable and comprehensive, cases of the data out of date and no longer reflective of actual facility conditions have occurred. The Government Records Searched/Data Currency Tracking section of the EDR Database Report in **Appendix D** identifies when each database was updated.

5.3.1 Subject Property Database Listings

The subject property was identified in one environmental database. The information is summarized as follows:

Item	Description
Facility Name	White River Medical
Databases	AIRS, PERMITS, FINDS
Address	Subject Property (477 E Main Street)
Distance (feet)	Not Applicable
Direction	Not Applicable
Elevation	Not Applicable
Comments	The subject property, identified as a general and surgical hospital, is listed on the AIRS, PERMITS, and FINDS regulatory databases at the subject property address of 477 East Main Street. According to the AIRS database, the facility is listed under the National American Industry Classification System code: 62211 as a General Medical and Surgical Hospital. According to the Permits database, a permit was issued in May 1975 for operation of an incinerator. According to the Freedom of Information Act (FOIA) records, a permit was issued on June 4, 1975, regarding the approval for the operation and installation of a natural-gas-fired, steel incinerator (**Section 6.4**). There was no modification recorded up to the expiration date in May 1991. According to the FINDS database, the facility is also listed under Air-0247-I (Incinerator) and RST-32000038 (State underground storage tank program). Tetra Tech searched the Arkansas Department of Environmental Quality (ADEQ) Storage Tank Facility Data Search website; however, no records for the subject property were identified (ADEQ 2025b). According to the FINDS database, the AFIN associated with the AIR and RST Permit Data is 32-00037 which is for the White River Medical Center facility located at 1710 Harrison Street, Batesville, AR; not the subject property whose AFIN is 32-00704. A search of the ADEQ Storage Tank Facility Data shows that the RST is associated with the AFIN 32-00037 property (ADEQ 2025b). It was determined that the FINDS database had the subject property address improperly labeled to the White River Medical Center and there is no UST associated with the subject property. No other information is reported in the EDR database. No further information about the listing was discovered during the additional environmental records review (**Section 5.4**) or through FOIA records requests (**Section 6.4**). The historical use of an incinerator is considered a REC for the subject property.

5.3.2 Adjoining and Relevant Non-subject Property Database Listings

Listed below are the adjoining and surrounding facilities listed on the EDR Database Report.

Item	Description
Facility Name	Downtown Exxon Service Station/Service Center and Wilkins Arthur
Databases	UST, PERMITS, UST FINDER, EDR HIST AUTO
Address	416 East Main Street
Distance (feet)	74
Direction	South-southwest
Elevation	Higher

Item	Description
Summary	Downtown Exxon Service Station (416 East Main Street) is adjacent to and southwest of the subject property. This facility is listed on the UST, Permits, UST Finder, and EDR Historical Automotive (EDR HIST AUTO) databases. Historical records indicated this facility was a filling station (1930 to 1960) and an historical automotive facility from 1969 to 1975 under Wilkins Arthur and from 1991 to 1994 under Downtown Exxon Service Station/Service Center. This facility had at least eight USTs including: two 4,000-gallon gasoline tanks, a 2,000-gallon gasoline tank, a 1,000-gallon tank with unreported contents, three 1,000-gallon gasoline tanks, and an 50-gallon used oil tank. The eight USTs were reportedly installed between January 1981 to January 1989 but are listed as "Permanently Out of Use." The UST Finder database indicated they were removed between January 1992 and January 1995, and all eight USTs have a status of closed without restriction. This site is not considered a REC for the subject property.
Facility Name	Nu-Way Cleaners and Laundry, Inc.
Databases	EDR HIST CLEANER, HW GEN, PERMITS, RCRA NonGen/NLR, FINDS, ECHO
Address	121 South 4th Street
Distance (feet)	158
Direction	South-southwest
Elevation	Higher
Summary	This historical dry cleaning facility is listed on the EDR Hist Cleaner, HW Gen, Permits, RCRA NonGen/NLR, FINDS, and ECHO regulatory databases. According to the EDR Hist Cleaner database, this facility was a registered historical dry cleaner from 1969 to 2014. However, Sanborn maps (**Section 5.2.1**) show that this was the location of a dry cleaner as early as 1947. This facility as an NAICS code of 81232, with the description "Drycleaning and Laundry Services (Except Coin Operated)." The hazardous waste summary included in the RCRA database includes chromium (waste code: D007); tetrachloroethylene (waste code: F002); and spent halogenated solvents: tetrachloroethylene, methylene chloride, trichloroethylene, 1,1,1-trichloroethane, chlorobenzene, 1,1,2-trichloro-1,2,2-trifluoroethane, ortho-dichlorobenzene, trichlorofluoromethane, and 1,1,2, trichloroethane; all spent solvent mixtures/blends containing, before use, a total of ten percent or more (by volume) of one or more of the above halogenated solvents or those solvents listed in F001, F004, and F005; and still bottoms from the recovery of these spent solvents and spent solvent mixtures. This facility was listed in the EDR report as a SQG with no violations or evaluations found. The Nu-Way Cleaners & Laundry is listed on the ADEQ Hazardous Waste Generator Database (AFIN 32-00100) as an inactive hazardous waste facility under permit number ARD035436997 as of July 22, 2019, (ADEQ 2025a). Due to the elevation, proximity, and duration of operation, the historical cleaner is considered to pose a REC for the subject property.
Facility Name	City of Batesville
Databases	SWRCY
Address	500 East Main Street
Distance (feet)	227
Direction	Southeast
Elevation	Higher

Item	Description
Comments	This facility is listed on the SWRCY recycling directory database. No other information was found within the EDR database. An SWRCY listing is not enough to pose a REC, and therefore this facility does not pose a REC to the subject property.
Facility Name	Office of Emergency Services
Databases	LTANKS, UST, FINANCIAL ASSURANCE, PERMITS, UST FINDER, AST
Address	368 East Main Street
Distance (feet)	280
Direction	West-southwest
Elevation	Higher
Comments	This facility is listed on the LTANKS, UST, Financial Assurance, Permits, UST Finder, and AST databases. This facility is reported to have two closed USTs: a 4000-gallon diesel tank(installed in January 1977 and removed in February 1994) and a 550-gallon diesel tank (installed in February 1994 and removed in November 2012). A release was reported and confirmed in October 2013, with cleanup initiated in March 2014, and later received a No Further Action (NFA) in March 2014. Based on the regulatory status and cross-gradient location from the subject property, this facility does not pose a REC for the subject property.
Facility Name	Collier Oil Company, Inc.
Databases	UST, AST, PERMITS
Address	Post Office Box 2222
Distance (feet)	417
Direction	Southeast
Elevation	Lower
Comments	This bulk plant facility is listed on the UST, AST, and Permits regulatory databases. According to the UST and AST database, this site had one previous 1,000-gallon UST that is permanently out of use, three 12,000-gallon ASTs, two 16,000-gallon ASTs, three 17,000-gallon ASTs, two 8,000-gallon ASTs, a 4,000-gallon AST, and a 5,000-gallon AST. The tanks appear to have been installed in the 1980s and out of service by 1997. The facility was likely plotted in the center of the Batesville based on the Post Office Box address; however, based on review of Sanborn maps and aerial photos, this does not appear to be the likely location the former bulk plant. Based on review of the surrounding area records available, the former bulk plant does not appear to have been located in the near vicinity upgradient of the subject property, and thus, is no considered to pose a REC for the subject property.
Facility Name	Crouch Funeral Home
Databases	UST, PERMITS, UST FINDER
Address	510 East College
Distance (feet)	439
Direction	Southeast
Elevation	Lower

Item	Description
Comments	This facility is listed in the UST, UST Finder, and Permits regulatory databases. According to the UST Finder database, this facility is reported to have one closed 550-gallon gasoline UST that was installed in January 1986 and removed in December 1992. Two permit records were created, with one in February 1991 and the other in May 2005 with a permit number of 32000053. Permit types were not available in the EDR database. Due to the lower topographic elevation, this site does not pose as a REC to the subject property.
Facility Name	AR Garbage
Databases	RCRA NonGen/NLR, HW GEN
Address	3rd and Main
Distance (feet)	507
Direction	Southwest
Elevation	Lower
Comments	This facility is listed in the RCRA NonGen/NLR, and HW Gen databases. According to the RCRA listings, this facility has a hazardous waste summary consisting of notable wastes: ignitable waste (waste code: D001); spent halogenated solvents used in degreasing (waste code: F001); spent halogenated solvents (waste code: F003); spent non-halogenated solvents (F005); non-defined (waste codes: F017 and F018); and 2-Imidazolidinethione (or) Ethylene thiourea (waste code: U116). No violations or evaluations found in the EDR database. The owner operator listed in the HW Gen database is Larry Barber. Due to the absence of reported violations and lower elevation / cross gradient position, this site is not considered to pose as a REC to the subject property.
Facility Name	Arkansas Sand Company
Databases	US MINES
Address	N/A
Distance (feet)	623
Direction	Southwest
Elevation	Lower
Comments	This facility is listed in the US Mines database with a Mine ID: 0301904, and a status of "Permanently Abandoned." No violations recorded in the EDR database. Due to the lower elevation and cross gradient position, this site does not pose as a REC to the subject property.
Facility Name	Jay F Shell
Databases	EDR HIST AUTO
Address	551 E Boswell St.
Distance (feet)	655
Direction	Southeast
Elevation	Higher
Comments	This facility is listed in the EDR Hist Auto database in the years 2002 and 2003. No violations reported. Due to the timeframe and no violations, this site does not pose as a REC to the subject property.
Facility Name	Quick Mart #1
Databases	UST FINDER, UST FINDER RELEASE, LTANKS, UST, PERMITS

Item	Description
Address	312 Fourth Street
Distance (feet)	813
Direction	South-southeast
Elevation	Lower
Comments	This facility is listed on the UST Finder, UST Finder Release, LTANKS, UST, and Permits databases. According to the UST Finder and UST databases, this facility has two closed USTs, both 6,000-gallon gasoline tanks that were installed in June 1968 and removed in August 2007. A release was recorded in July 2005. Voluntary cleanup of entire tank system was completed, with no soil contamination identified above reporting limits. A no further action (NFA) was issued based on streamlined preliminary assessment conducted in September 2007. Due to regulatory status, this facility does not pose a REC for the subject property.
Facility Name	Southwestern Bell Telephone Company
Databases	RCRA NonGen/NLR, FINDS, ECHO, HW GEN, PERMITS, UST, UST FINDER
Address	410 E Boswell
Distance (feet)	818
Direction	South-southeast
Elevation	Lower
Comments	This facility is listed on the RCRA NonGen/NLR, FINDS, ECHO, HW Gen, Permits, UST, and UST Finder database. According to the UST and UST Finder databases, this facility is reported to have one closed 1,000-gallon diesel UST. This UST was installed in January 1981 and removed in August 1992. No releases or violations were reported. Due to the status and lower elevation, this site does not pose as a REC to the subject property.
Facility Name	Independence Co. Recycling Center
Databases	SWRCY
Address	192 E. Main Street
Distance (feet)	961
Direction	West-southwest
Elevation	Lower
Comments	This Facility is listed on the SWRCY database. According to the SWRCY database, the facility ID is 127. No other relevant information was found in the EDR database. Due to the lower elevation and cross gradient position, this site does not pose as a REC to the subject property.
Facility Name	Synergy Group Inc.
Databases	RCRA NonGen/NLR, FINDS, ECHO, HW GEN
Address	N/A
Distance (feet)	1288
Direction	Southwest
Elevation	Lower

Item	Description
Comments	This facility is listed in the RCRA NonGen/NLR, FINDS, ECHO, and HW Gen databases. According to the RCRA listing, this facility has handled definable hazardous waste which includes ignitable waste (waste code: D001). No violations or evaluations were found. Due to the lower elevation and cross-gradient position, this site does not pose as a REC to the subject property.
Facility Name	Street Auto and Tractor Sales
Databases	UST, PERMITS, UST FINDER
Address	College and Central
Distance (feet)	1299
Direction	Southwest
Elevation	Lower
Comments	This facility is listed on the UST, UST Finder, and Permits databases. According to the UST Finder database, this facility is reported to have one closed 550-gallon gasoline UST. Due to the lower elevation and cross gradient position, this site does not pose as a REC to the subject property.
Facility Name	Coca Cola Bottling Company
Databases	UST FINDER, UST FINDER RELEASE, UST, LTANKS
Address	100 East College Street
Distance (feet)	1299
Direction	Southwest
Elevation	Lower
Comments	This facility is listed on the UST Finder, UST Finder Release, LTANKS, and UST databases. According to the UST databases, this facility is reported to have one closed 1.000-gallon gasoline UST that was installed in January 1981 and removed in August 1990. A release was reported in April 1989 and was issued an NFA following the incident. According to the EDR database, the fuel tank assessment was done by Grubbs, Garner, and Hoskyn on June 5, 1989. In February 1999, the file was closed by a NFA. Due to the regulatory status, lower elevation, and cross gradient position, this site does not pose as a REC to the subject property.

Based on distance, regulatory status, topographic location, and/or estimated direction of groundwater flow, the remaining facilities do not pose RECs for the subject property.

5.4 Additional Environmental Record Sources

Tetra Tech also reviewed the following records:

- EPA Envirofacts Database
  - Tetra Tech conducted a search of the EPA Envirofacts database on September 26, 2025 (EPA 2025a). The subject property was not listed in the Envirofacts database.
- EPA Cleanups in My Community
  - Tetra Tech conducted a search of the EPA Cleanups in My Community (CIMC) database on September 26, 2025 (EPA 2025b). The subject property was not listed in the CIMC database.
- U.S. Department of Transportation (DOT) National Pipeline Mapping System (NPMS)
  - Tetra Tech conducted a search of the NPMS on September 26, 2025 (DOT 2025). The NPMS website did not identify hazardous material pipelines on the subject property or adjoining properties.

- EPA Underground Storage Tank (UST) Finder
  - Tetra Tech conducted a search of the UST FINDER database on September 26, 2025 (EPA 2025c). The subject property was not listed in the UST FINDER database.
- Arkansas Department of Environmental Quality (ADEQ) Databases
  - Tetra Tech conducted a search of the ADEQ Office of Land Resources Generators/Treatment/Disposal/Storage Lists database (ADEQ 2025a), Licensed Solid Waste Facility Operators database (ADEQ 2025b), and the Storage Tank Facility Data database (ADEQ 2025c) on September 26, 2025. The subject property was not listed in any of these ADEQ databases.
  - Some nearby facilities were identified in the ADEQ databases; these are discussed as applicable in **Section 5.3.2**.

6.0 INTERVIEWS

The objective of the interviews is to obtain information concerning RECs for the subject property. This information was obtained verbally and in writing, as indicated below.

6.1 Interview With Key Site Manager

Tetra Tech received a completed questionnaire from the property owner, Joey Markowski, on September 23, 2025 (**Appendix C**). Mr. Markowski indicated that there is an old boiler system on the subject property but does not think there is an associated tank. Mr. Markowski has indicated that the subject property has asbestos as determined by an inspection performed by Snyder Environmental (Snyder 2018). Mr. Markowski has also informed Tetra Tech of a valuation reduction for the subject property based upon environmental issues, knowledge of activity and use limitations placed on the property due to residual contamination, and knowledge of the property being abandoned or evidence of unauthorized uses or uncontrolled access to the property. No other questionnaire categories were identified with further information for the subject property.

6.2 Interviews With Occupants

Mr. Markowski was also interviewed as the occupant. Information from the interview was discussed above in **Section 6.1**.

6.3 Interviews With Past Owners, Operators, And Occupants

Contact information pertaining to past owners, operators, and occupants was not provided.

6.4 Interviews With State and Local Government Officials

Tetra Tech submitted a written records request to ADEQ for records pertaining to the subject property on September 8, 2025. A response was received on September 9, 2025, and four records were provided (**Appendix C**). Records indicate a permit application dated May 8, 1975 for the installation and operation of an incinerator.

Tetra Tech submitted a written records request to the Independence County for records pertaining to the subject property on September 9, 2025. A response was received on September 9, 2025, indicating no records were found in regard to the request (**Appendix C**).

Tetra Tech submitted a written records request to the Batesville Fire Department for records pertaining to the subject property on September 9, 2025. A response was received on September 9, 2025, from the Batesville Fire Department that no records were found (**Appendix C**).

7.0 FINDINGS AND OPINIONS

The following summarizes presence or likely presence of hazardous substances or petroleum products in connection with the subject property based on information gathered during the ESA. For each item listed, Tetra Tech provides an opinion of the effect on the subject property based on an evaluation of results of record reviews, interviews, and site reconnaissance. Tetra Tech also provides rationale regarding whether an environmental condition is a REC, CREC, HREC, de minimis condition, or BER.

Three RECs were identified:

- A permit was issued to the facility addressed as 477 East Main Street and identified as White River Medical for installation and operation of a medical waste incinerator in 1975, to be fueled by natural gas. In addition, an older brick incinerator was observed in the basement, fuel source unknown. The historical use of an incinerator is considered a REC for the subject property.
- Nu Way Cleaners (121 South 4th Street) is approximately 158 feet southwest of the subject property. This facility is listed on the EDR Hist Cleaner, HW Gen, Permits, RCRA Nongen/NLR, FINDS, and ECHO databases. According to the EDR Hist Cleaner database, this facility was a registered historical dry cleaner from 1969 to 2014. This facility has an NAICS code of 81232, with the description "Drycleaning and Laundry Services (Except Coin Operated)." The hazardous waste summary included in the RCRA database includes chlorinated solvents. This facility was listed in the EDR database as a SQG with no violations or evaluations found; however, according to the ADEQ Hazardous Waste Generator Database the facility was inactive as of July 2019. Due to the elevation, proximity, and length of operation, the historical cleaner is considered a REC for the subject property.
- An auto repair garage/auto dealership, located approximately 150 feet southeast, was identified in the Sanborn maps. The use as an automotive garage with lack of information, distance, and higher elevation, this facility is considered a REC for the subject property.

No CRECs were identified.

De minimis staining was observed.

No SDG were identified at the subject property.

Two BERs were identified:

- Tetra Tech requested previous environmental investigation reports regarding the subject property from the client. An Asbestos Inspection was conducted by Snyder Environmental on April 12th and 13th, 2018. The investigation found ACM in mastic and insulation ranging from 2% to 20% chrysotile asbestos throughout the building. The documented presence of ACM is considered a BER to the subject property.
- Given the age of the structure on the subject property, this building may contain LBP. The potential presence of LBP is considered a BER.

8.0 CONCLUSIONS AND RECOMMENDATIONS

In conformance to the scope and limitations of ASTM E1527-21, Tetra Tech has performed a Phase I ESA of the Former Gray's Hospital at 477 East Main Street, Batesville, Arkansas (the subject property). Any exceptions to, or deviations from, this practice are described in **Section 2.5** and **Section 2.6** of this report. This assessment has revealed the following RECs and BERs for the subject property.

Three RECs were identified:

- The historical use of an incinerator is considered a REC for the subject property.
- Due to the elevation, proximity, and length of operation, the historical Nu Way Cleaners (121 South 4th Street) is considered a REC for the subject property.
- The use of a nearby upgradient property as an automotive garage with lack of information, distance, and higher elevation, this facility is considered a REC for the subject property.

Two BERs were identified:

- The documented presence of ACM is considered a BER to the subject property.
- The potential presence of LBP is considered a BER.

Tetra Tech recommends the following actions:

- Performing a Phase II ESA to evaluate the presence or absence of soil, soil gas, and groundwater contamination at the subject property. The Phase II ESA should include soil, groundwater, and soil gas sampling to determine the extent and magnitude of potential contaminants of concern. Potential contaminants of concern include volatile organic compounds (VOCs), semivolatile organic compounds (SVOCs), polychlorinated biphenyls (PCBs), and metals.
- Removal of any friable ACM by a licensed asbestos abatement contractor before any renovation work or demolition disturbs the materials. The removed waste must be transported to a disposal site able to accept friable and non-friable ACM. If the building is to be renovated and the materials are non-friable and not to be disturbed, those materials may remain in place.
- Conducting a LBP evaluation based on the age of the building. If identified LBP surfaces are impacted during renovation or demolition, Tetra Tech recommends that the contractor conducting the renovation or demolition comply with Occupational Safety and Health Administration (OSHA) Lead in Construction Standard, Title 29 of Code of Federal Regulations, Part 1926.62. LBP debris should be characterized and disposed of in accordance with state and local regulations.

9.0 ENVIRONMENTAL PROFESSIONAL STATEMENT

Kenny Edge with Tetra Tech prepared this report under supervision of Jessica Donahoe, EP. Resumes are in **Appendix G**.

Preparations and presentations of findings, recommendations, specifications, and professional opinions in this report accorded with generally accepted professional practice, and were within the scope of the project. No other warranty is expressed or implied.

We declare that, to the best of our professional knowledge and belief, we meet the definition of Environmental Professional as defined in 40 *Code of Federal Regulations* (CFR) 312.10. We have the specific qualifications based on education, training, and experience to assess a property of the nature, history, and setting of the subject property. We have developed and performed all appropriate inquiries in conformance to the standards and practices set forth in 40 CFR Part 312.

We appreciate the opportunity to work with you on this project. If you have any questions concerning the findings, conclusions, and recommendations conveyed in this report, please contact Allie Cook at (816) 412-1766, or via email at Allie.Cook@tetratech.com.

Kenny Edge
Environmental Scientist and Report Author
September 30, 2025

Jessica Donahoe
Environmental Scientist and Report Reviewer / EP
October 2, 2025

10.0 REFERENCES

Arkansas Department of Environmental Quality (ADEQ). 2025a. Hazardous Waste Generators Facility Summary Database Search. Accessed on September 21, 2025. https://www.adeq.state.ar.us/hazwaste/programs/rcra/

ADEQ. 2025b. Licensed Solid Waste Facility Operators Data Search. Accessed on September 21, 2025. https://www.adeq.state.ar.us/sw/programs/licensing/operators/

ADEQ. 2025c. Storage Tank Facility Data Search. Accessed on September 26, 2025. https://www.adeq.state.ar.us/rst/programs/fees/facility_data.aspx

Arkansas Geological Survey. 2022. Geologic Map of the Batesville Quadrangle, Independence County, Arkansas. https://www.geology.ar.gov/docs/pdf/maps-and-data/geologic_maps/24k/Batesville.pdf

ASTM International. 2021. Standard Practice for Environmental Site Assessments: Phase I Environmental Site Assessment Process. ASTM E1527-21.

Environmental Systems Research Institute (ESRI). 2021. ArcGIS online: World Imagery.

Independence County. 2025. County Accessor. Accessed on September 28, 2025. County Assessor | Independence County

Snyder Environmental (Snyder). 2018. Asbestos Inspection Report. Former Grays Hospital, 377 East Main Street, Batesville, Arkansas. April.

U.S. Department of Transportation (DOT). 2025. National Piping Mapping System Public Map Viewer. Accessed on September 26, 2025. https://pvnpms.phmsa.dot.gov/PublicViewer/

U.S. Environmental Protection Agency (EPA). 2025a. Envirofacts EnviroMapper. Accessed on September 26, 2025. https://enviro.epa.gov/enviro/em4ef.home

EPA. 2025b. Cleanups in My Community Map. Accessed on September 26, 2025. https://www.epa.gov/cleanups/cleanups-my-community

EPA. 2025c. UST Finder Database. Accessed on September 26, 2025. https://www.epa.gov/ust/ust-finder

United States Geological Survey. 1989. Batesville, Arkansas 7.5 Minute Topo Quadrangle.

APPENDIX A PROPERTY RECORDS

Parcel: 1100657001C
Previous Parcel: 1100657000E
As of: 8/18/2025 10:57:14 PM

ID: 43200

Independence County Report

Property Owner

Name:	MARKOWSKI INVESTMENTS HOLDINGS LLC
Mailing Address:	3001 HARRISON ST BATESVILLE, AR 72501
Type:	(CI) Comm. Impr.
Tax District:	(01C) BATESVILLE
Millage Rate:	53.35

Property Information

Physical Address:	477 E MAIN ST
Subdivision:	OLD TOWN
Block/Lot:	021 / N/A
S-T-R:	N/A
Size (Acres):	0.68
Legal:	LT 5, PT L3 & 4 & 6

Market and Assessed Values

	Estimated Market Value	Full Assessed (20% Market Value)	Taxable Value
Land	40,100	8,020	8,020
Building	60,300	12,060	12,060
Totals	**100,400**	**20,080**	**20,080**

Taxes

Estimated Taxes:	1,071	
Homestead Credit:	0	Note: Tax amounts are estimates only. Contact the county/parish tax collector for exact amounts.

Land

Land Use	Size	Units
N/A	29700.000	Sq.Ft
Total	**29,700.00**	

Deed Transfers

Deed Date	Book	Page	Deed Type	Stamps	Est. Sale	Grantee	Code	Type
8/12/2022	2022	5082	CorpWD	165.00	$50,000	MARKOWSKI INVESTMENTS HOLDINGS LLC	Unval.	Improved

Details for Commercial Card 1

Business Name(s):	FORMERLY GRAY'S HOSPITAL		
Number of Units:	N/A	**Total Floor Area:**	26845
Site Work:	Prep;	**Floor Cover:**	N/A
Foundation:	N/A	**Ceilings:**	09
Floor Structure:	N/A	**Interior Finish:**	N/A
Structure Frame:	Conc.Blk	**Insulation:**	N/A
Exterior Walls:	N/A	**Appliances:**	N/A
Ext. Wall Load:	LoadBear	**Plumbing:**	Sink Urinal Lavatory
Roof Structure:	N/A	**Electrical:**	Avg.B N/A
Roof Cover:	N/A	**Misc:**	N/A

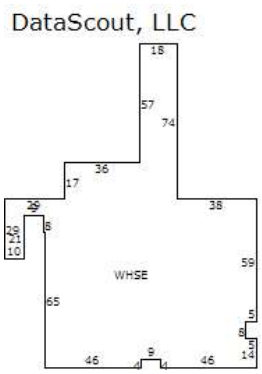

Building 1

Age/YC	Condition	Effective Age	Stories	Grade
N/A	L	60	4	C4

Avg Floor Area:	10427	**Common Wall:**	N/A
Avg Perimeter:	612	**Total Floor Area:**	26845
No. Floors:	4	**Total Height:**	30
Avg Floor Height:	10	**Unit Multiplier:**	N/A

	Occupancy	Heating/Cooling
Primary	Warehouses	IndThruHea
Secondary	N/A	N/A

Outbuildings and Yard Improvements

Item	Type	Size / Dim	Unit Multi.	Quality
Fence, Chain Link	#9WIRE	4x100	N/A	N/A
Multi-Purpose	SUBBL	19x24	N/A	N/A
Multi-Purpose	TILE	19x28	N/A	N/A
Multi-Purpose	SUBL	17x18	N/A	N/A
Garage or CP, Mult, C	4	17x36	N/A	N/A
Multi-Purpose	SUBF	20x40	N/A	N/A
Paving	ASPH	35362	N/A	N/A
Paving	CONC	16x37	N/A	N/A
PORCH2	OP2	146	N/A	N/A

Reappraisal Value History

Tax Year	Total Value	Total Assessed
2024	100,400.00	20,080.00

Map

Not a Legal Document

Subject to terms and conditions
www.actDataScout.com

APPENDIX B PHOTOGRAPHIC DOCUMENTATION

Photograph 1 (North-northwest): View of the front of the hospital building.

Photograph 2 (West): View of the fire suppression system in the kitchen of the subject property building.

Photograph 3 (South): View of the plumbing associated with the kitchen.

Photograph 4 (Overview): View of one of the floor drains observed in the kitchen.

Photograph 5 (North): View of a patient room typical of those seen throughout the subject property; trash and debris was observed throughout the subject property building.

Photograph 6 (Overview): View of the top of the elevator (not hydraulic) in the middle of the subject property building.

Photograph 7 (South): View of ductwork associated with the heating, ventilation, and air conditioning (HVAC) system observed in the ceiling of the expansion of the hospital building.

Photograph 8 (Overview): View of some of the equipment, typical of units found in various rooms throughout the subject property building.

Photograph 9 (East): View of the countertop at one of the nurses' stations; a wood stain container was observed.

Photograph 10 (Overview): View of containers of photograph fixer solution observed on the floor of the building.

Photograph 11 (Southeast): View of one of the nurses' stations.

Photograph 12 (West): View of the main hallway on the fourth floor of the hospital building; the fourth floor is where surgery formerly took place.

Photograph 13 (North): View of the small basement section of the hospital where there is a water heater and an older waste incinerator, fuel source unknown.

Photograph 14 (West-northwest): View of the former laboratory of the hospital building.

Photograph 15 (North): View of a former office found on the first floor of the hospital building.

Photograph 16 (North): View of the records rooms found on the first floor of the hospital building.

Photograph 17 (West): View of the boiler room off the back (northwest side) of the hospital building. Small (less than 5-gallon) containers of cleaning products were observed in this area.

Photograph 18 (Overview): View of a multiple small (less than 5-gallon) containers of cleaning chemicals observed next to the boiler.

Photograph 19 (Northwest): View of the storage building attached to the northwest side of the hospital building, with pole-mounted transformers beyond and within the subject property boundary. Transformers appeared in good condition with no staining visible.

Photograph 20 (West): View of office supplies that are stored in the storage building.

Photograph 21 (South): View of the back (northwest side) of the hospital building, with the attached storage building to the right.

Photograph 22 (Northeast): View of northeast adjoining property, with the Ozark Foothills Literacy Project building (184 North 5th Street).

Photograph 23 (South): View of the southeast adjoining property, with the St. Paul's Episcopal Church (424 East Main Street).

Photograph 24 (Southeast): View of the northeast adjoining property, with the Merchants and Planters Bank (555 East Main Street).

Photograph 25 (North): View along the southwestern side of the property building.

Photograph 26 (West): View of southwest adjoining retail shops and parking areas for the shops (240 South 4th Street).

APPENDIX C INTERVIEW DOCUMENTATION

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

SITE NAME: Former Gray's Hospital

SITE ADDRESS: 477 East Main Street, Batesville, Arkansas

DATE:

TETRA TECH PROJECT NUMBER: 103S9501016.001

PREPARED BY:

How long have you owned/occupied the property?

GENERAL QUESTIONS REGARDING PROPERTY CONDITION

ASTM RELATED QUESTIONS

	QUESTION	Owner			Occupant			Observed			COMMENTS
		Y	N	U	Y	N	U	Y	N	U	
1a	Is the property used for an industrial use?		X								
1b	Is any adjoining property used for an industrial use?		X								
2a	Did you observe evidence or do you have any prior knowledge that the property has been used for an industrial use in the past?		X								
2b	Did you observe evidence or do you have any prior knowledge that the adjoining property has been used for an industrial use in the past?		X								
3a	Is the property used as a gasoline station, motor repair facility, commercial printing facility, dry cleaners, photo developing laboratory, junkyard or landfill, or as a waste treatment, storage, disposal, processing, or recycling facility? (If applicable, identify which.)		X								
3b	Is the adjoining property used as a gasoline station, motor repair facility, commercial printing facility, dry cleaners, photo developing laboratory, junkyard or landfill, or as a waste treatment, storage, disposal, processing, or recycling facility? (If applicable, identify which.)		X								

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

	QUESTION	Owner			Occupant			Observed			COMMENTS
		Y	N	U	Y	N	U	Y	N	U	
4a	Did you observe evidence or do you have any prior knowledge that the property has been used as a gasoline station, motor repair facility, commercial printing facility, dry cleaners, photo developing laboratory, junkyard or landfill, or as a waste treatment storage, disposal, processing, or recycling facility? (If applicable, identify which.)		X								
4b	Did you observe evidence or do you have any prior knowledge that the adjoining property has been used as a gasoline station, motor repair facility, commercial printing facility, dry cleaners, photo developing laboratory, junkyard or landfill, or as a waste treatment storage, disposal, processing, or recycling facility? (If applicable, identify which.)		X								
5a	Are there currently any damaged or discarded automotive or industrial batteries, pesticides, paints or other chemicals in individual containers of > 5 gal (19 L) in volume or 50 gal (190 L) in the aggregate, stored on or used at the property or at the facility?		X								
5b	Did you observe evidence or do you have any prior knowledge that there have been previously any damaged or discarded automotive or industrial batteries, pesticides, paints or other chemicals in individual containers of > 5 gal (19 L) in volume or 50 gal (190 L) in the aggregate, stored on or used at the property or at the facility?		X								
6a	Are there currently any industrial drums (typically 55 gal (208 L)) or sacks of chemicals located on the property or at the facility?		X								
6b	Did you observe evidence or do you have any prior knowledge that there have been previously any industrial drums (typically 55 gal (208 L)) or sacks of chemicals located on the property or at the facility?		X								
7a	Did you observe evidence or do you have any prior knowledge that fill dirt has been brought onto the property that originated from a contaminated site?		X								
7b	Did you observe evidence or do you have any prior knowledge that fill dirt has been brought onto the property that is of an unknown origin?		X								

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

	QUESTION	Owner			Occupant			Observed			COMMENTS
		Y	N	U	Y	N	U	Y	N	U	
8a	Are there currently any pits, ponds, or lagoons located on the property in connection with waste treatment or waste disposal?		X								
8b	Did you observe evidence or do you have any prior knowledge that there have been previously any pits, ponds or lagoons located on the property in connection with waste treatment or waste disposal?		X								
9a	Is there currently any stained soil on the property?		X								
9b	Did you observe evidence or do you have any prior knowledge that there has been previously any stained soil on the property?		X								
10a	Are there currently any registered or unregistered storage tanks (above or underground) located on the property?			X							There is an old boiler system but I don't think there's a tank
10b	Did you observe evidence or do you have any prior knowledge that there have been previously, any registered or unregistered storage tanks (above or underground) located on the property?		X								
11a	Are there currently any vent pipes, fill pipes, or access ways indicating a fill pipe protruding from the ground on the property or adjacent to any structure on the property?		X								
11b	Did you observe evidence or do you have any prior knowledge that there have been previously any vent pipes, fill pipes, or access ways indicating a fill pipe protruding from the ground on the property or adjacent to any structure located on the property?		X								
12a	Are there currently any flooring, drains, or walls located within the facility that are stained by substances other than water or are emitting foul odors?		X								
12b	Did you observe evidence or do you have any prior knowledge that there have been previously any flooring, drains, or walls within the facility that are stained by substances other than water or were emitting foul odors?		X								

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

	QUESTION	Owner			Occupant			Observed			COMMENTS
		Y	N	U	Y	N	U	Y	N	U	
13a	If the property is served by a private well or non-public water system, is there evidence or do you have prior knowledge that contaminants have been identified in the well or system that exceed guidelines applicable to the water system?		X								
13b	If the property is served by a private well or non-public water system, is there evidence or do you have prior knowledge that the well has been designated as contaminated by any government environmental/health agency?		X								
14	Does the owner or occupant of the property have any knowledge of environmental liens or governmental notification relating to past or recurrent violations of environmental laws with respect to the property or any facility located on the property?		X								
15a	Has the owner or occupant of the property been informed of the past existence of hazardous substances or petroleum products with respect to the property or any facility located on the property?	X									Property has asbestos as determined by a study performed by Snyder Environmental
15b	Has the owner or occupant of the property been informed of the current existence of hazardous substances or petroleum products with respect to the property or any facility located on the property?	X									
15c	Has the owner or occupant of the property been informed of the past existence of environmental violations with respect to the property or any facility located on the property?		X								
15d	Has the owner or occupant of the property been informed of the current existence of environmental violations with respect to the property or any facility located on the property?		X								
16	Does the owner or occupant of the property have any knowledge of any environmental site assessment of the property or facility that indicated the presence of hazardous substances or petroleum products on, or contamination of, the property or recommended further assessment of the property?	X									SEE ABOVE

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

	QUESTION	Owner			Occupant			Observed			COMMENTS
		Y	N	U	Y	N	U	Y	N	U	
17	Does the owner or occupant of the property know of any past, threatened , or pending lawsuits or administrative proceedings concerning a release or threatened release of any hazardous substance or petroleum products involving the property by any owner or occupant of the property?		X								
18a	Does the property discharge waste water, on or adjacent to the property, other than storm water, into a storm water sewer system?		X								
18b	Does the property discharge waste water, on or adjacent to the property, other than storm water, into a sanitary sewer system?		X								
19	Did you observe evidence or do you have any prior knowledge that any hazardous substances or petroleum products, unidentified waste materials, tires, automotive or industrial batteries, or any other waste materials have been dumped above grade, buried and/or burned on the property?		X								
20	Is there a transformer, capacitor, or any hydraulic equipment for which there are any records indicating the presence of PCBs?			X							
21	Is there any knowledge of a valuation reduction for the property based upon environmental issues?	X									
22a	Is there any knowledge of activity and use limitations placed on the property due to residual contamination?	X									
22b	Is there any knowledge of activity and use limitations placed on adjacent properties due to residual contamination?		X								
23a	Is there any knowledge of the property being abandoned or evidence of unauthorized uses or uncontrolled access to the property?	X									
23b	Is there any knowledge of an adjacent property being abandoned or evidence of unauthorized uses or uncontrolled access to the property?		X								

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

ASTM1527-21
ENVIRONMENTAL SITE ASSESSMENT QUESTIONNAIRE

GOVERNMENT RECORDS/HISTORICAL SOURCES INQUIRY

24	Do any of the following Federal government record systems list the property or any property within the circumference of the area noted below:	Y	N	COMMENTS
	National Priorities List – within 1.0 mile (1.6 Km)?			Unknown
	CERCLIS List – within 0.5 mile (0.8 Km)?			Unknown
	RCRA CORRACTS Facilities – within 1.0 mile (1.6 Km)?			Unknown
	RCRA non-CORRACTS TSD Facilities – within 0.5 mile (0.8 Km)?			Unknown
25	Do any of the following state record systems list the property or any property within the circumference of the area noted below:	Y	N	COMMENTS
	List maintained by state environmental agency of hazardous waste sites identified for investigation or remediation that is the state equivalent to National Priorities List – within 1.0 mile (1.6 Km)?			Unknown
	List maintained by state environmental agency of sites identified for investigation or remediation that is the state equivalent to CERCLIS List – within 0.5 mile (0.8 Km)?			Unknown
	Leaking Underground Storage Tank (LUST) List – within 0.5 mile (0.8 Km)?			Unknown
	Solid Waste/Landfill Facilities – within 0.5 mile (0.8 Km)?			Unknown

26	Based upon a review of fire insurance maps or consultation with the local fire department serving the property, all as specified in the guide, are any buildings or other improvements on the property or on an adjoining property identified as having been used for an industrial use or uses likely to lead to contamination of the property?	Y	N	N/A	COMMENTS
			X		

KEY: *Y = YES, N = NO, U = UNKNOWN, N/A = NOT APPLICABLE*

Prepared by: Joey Makowski

Signature:	**Date:** 9/23/25	**Signature:**	**Date:**
Tetra Tech, Inc.			

Tetra Tech
415 Oak Street
Kansas City, Missouri 64106

Outlook

RE: 477 East Main Street, Batesville FOIA Request

From E&E FOIA <EE.FOIA@arkansas.gov>
Date Wed 9/10/2025 3:57 PM
To Cook, Allie <ALLIE.COOK@tetratech.com>

⚠ **CAUTION:** This email originated from an external sender. Verify the source before opening links or attachments. ⚠

Good afternoon,

The records responsive to your FOIA can be found here https://arkdhs-my.sharepoint.com/:f:/g/personal/sara_white_arkansas_gov/ElcEGjRS0SREke0297IhHG4BI-AUUd9Py2f6LbttqysRGg?email=allie.cook%40tetratech.com&e=gTteAR

Thank you,

Sara White
Legal Support Specialist
Energy and Environment | Office of Chief Counsel
e: sara.white@arkansas.gov
t: 501-682-0892

From: Cook, Allie <ALLIE.COOK@tetratech.com>
Sent: Monday, September 8, 2025 4:55 PM
To: E&E FOIA <ee.foia@arkansas.gov>
Subject: 477 East Main Street, Batesville FOIA Request

To Whom It May Concern:

Attached is a FOIA request for the property located at 477 East Main Street, Batesville, AR. Please let me know if you have any questions.

Thank you,
Allie

Allie Cook | Environmental Scientist
Direct **+1 (816) 412-1766** | Business **+1 (816) 412-1741** | Fax **+1 (816) 410-1748** |
allie.cook@tetratech.com

Tetra Tech | *Leading with Science®* | EMI
415 Oak Street | Kansas City, MO 64106 | tetratech.com

This message, including any attachments, may include privileged, confidential and/or inside information. Any distribution or use of this communication by anyone other than the intended recipient is strictly prohibited and may be unlawful. If you are not the intended recipient, please notify the sender by replying to this message and then delete it from your system.

Please consider the environment before printing. Read more

TETRA TECH

CSN	FACILITY NAME (SHORT)	FACILITY CITY	MAILING ADDRESS	MAILING CITY	MSTA	MAIL ZIP	SIC CODE DESCRIPTION
29-0040	MEDICAL PK HOSPITAL	HOPE	2001 SOUTH MAIN ST	HOPE	AR	71801-0000	GENERAL MEDICAL & SURGICAL HOS
16-0099	METHODIST HOSP JBORO	JONESBORO	3024 STADIUM BLVD	JONESBORO	AR	72401-0000	GENERAL MEDICAL & SURGICAL HOS
03-0034	MTN HOME NURSING HOM	MOUNTAIN HOME	PO BOX 325	MOUNTAIN HOME	AR	72653-0000	GENERAL MEDICAL & SURGICAL HOS
26-0209	NATIONAL PARK MEDICA	HOT SPRINGS	3010 MALVERN ROAD	HOT SPRINGS	AR	71901-0000	GENERAL MEDICAL & SURGICAL HOS
34-0076	NEWPORT HOSPITAL	NEWPORT	2000 MCLAIN ST	NEWPORT	AR	72112-0000	GENERAL MEDICAL & SURGICAL HOS
05-0024	NORTH ARK MED CENTER	HARRISON	620 N WILLOW ST	HARRISON	AR	72601-0000	GENERAL MEDICAL & SURGICAL HOS
11-0048	PIGGOT HOSPITAL	PIGGOTT	1206 HWY 62 WEST	PIGGOTT	AR	72454-0000	GENERAL MEDICAL & SURGICAL HOS
61-0036	RANDALPH CO MED CTR.	POCAHONTAS	PO BOX 757	POCAHONTAS	AR	72455-0000	GENERAL MEDICAL & SURGICAL HOS
60-0692	REBSAMEN REG MED CTR	JACKSONVILLE					GENERAL MEDICAL & SURGICAL HOS
04-0108	ROGERS MEMORIAL HOSP	ROGERS					GENERAL MEDICAL & SURGICAL HOS
63-0092	SALINE MEMORIAL HOSP	BENTON	NORTHEAST&MCNEIL ST	BENTON	AR	72015-0000	GENERAL MEDICAL & SURGICAL HOS
04-0202	SILOAM SPRINGS MEMOR	SILOAM SPRINGS					GENERAL MEDICAL & SURGICAL HOS
60-0733	SOUTHWEST HOSPITAL	LITTLE ROCK					GENERAL MEDICAL & SURGICAL HOS
66-0156	SPARKS MED CENTER	FORT SMITH					GENERAL MEDICAL & SURGICAL HOS
72-0097	SPRINGDALE MEM. HOSP	SPRINGDALE	P O BOX 47	SPRINGDALE	AR	72765-0000	GENERAL MEDICAL & SURGICAL HOS
16-0100	ST BERNARDS HOSPITAL	JONESBORO					GENERAL MEDICAL & SURGICAL HOS
66-0120	ST EDWARD MERCY MED	FORT SMITH	7301 ROGERS AVENUE	FORT SMITH	AR	72903-0000	GENERAL MEDICAL & SURGICAL HOS
26-0073	ST JOSEPH HOSPITAL	HOT SPRINGS					GENERAL MEDICAL & SURGICAL HOS
58-0038	ST MARY HOSPITAL	RUSSELLVILLE					GENERAL MEDICAL & SURGICAL HOS
46-0023	ST MICHAEL HOSPITAL	TEXARKANA	315 EAST 5TH ST	TEXARKANA	AR	75502-0000	GENERAL MEDICAL & SURGICAL HOS
60-0116	ST VINCENT INFIRMARY	LITTLE ROCK					GENERAL MEDICAL & SURGICAL HOS
69-0010	STONE COUNTY MEDICAL	MOUNTAIN VIEW	PO BOX 510	MOUNTAIN VIEW	AR	72560-0000	GENERAL MEDICAL & SURGICAL HOS
01-0058	STUTTGART MEM. HOSP	STUTTGART	RT 1 BOX 21-C	STUTTGART	AR	72160-0000	GENERAL MEDICAL & SURGICAL HOS
24-0013	TURNER MEMORIAL HOSP	OZARK	801 RIVER ST	OZARK	AR	72949-0000	GENERAL MEDICAL & SURGICAL HOS
10-0074	TWIN RIVER MED CTR	ARKADELPHIA	1420 PINE ST	ARKADELPHIA	AR	71923-0000	GENERAL MEDICAL & SURGICAL HOS
60-0302	U OF A MEDICAL CNTR	LITTLE ROCK					GENERAL MEDICAL & SURGICAL HOS
70-0260	UNION MEDICAL CENTER	EL DORADO	700 W GROVE ST	EL DORADO	AR	71730-0000	GENERAL MEDICAL & SURGICAL HOS
60-0296	VA HOSPITAL	LITTLE ROCK	7TH AND HOOPER	LITTLE ROCK	AR	72207-0000	GENERAL MEDICAL & SURGICAL HOS
60-0696	VA HOSPITAL	N LITTLE ROCK	4300 W 7TH ST	LITTLE ROCK	AR	72205-0000	GENERAL MEDICAL & SURGICAL HOS
71-0010	VAN BUREN COUNTY HOS	CLINTON	RT 1 BOX 206	CLINTON	AR	72031-0000	GENERAL MEDICAL & SURGICAL HOS
72-0096	WASHINGTON MED. CNTR	FAYETTEVILLE	1125 NORTH COLLEGE	FAYETTEVILLE	AR	72701-0000	GENERAL MEDICAL & SURGICAL HOS
73-0103	WHITE CO MEM HOSP	SEARCY	PO BOX 809	SEARCY	AR	72143-0000	GENERAL MEDICAL & SURGICAL HOS
32-0037	WHITE RIVER MEDICAL	BATESVILLE	477 E MAIN STREET	BATESVILLE	AR	72501-0000	GENERAL MEDICAL & SURGICAL HOS
57-0070	WILHELMENA MED CEN	MENA	NORTH MONROE STREET	MENA	AR	71953-0000	GENERAL MEDICAL & SURGICAL HOS
75-0013	YELL COUNTY HOSPITAL	DANVILLE	719 DETROIT	DANVILLE	AR	72833-0000	GENERAL MEDICAL & SURGICAL HOS
35-0118	N. C. T. R.	PINE BLUFF	HWY 65 NORTH	JEFFERSON	AR	72079-0000	MEDICAL LABORATORIES

TOTAL NUMBER QUICK LOOK REPORT LINES 89

SEPARATOR

32-00038

AIR

PERMITS

06/04/1975

0247-AI

June 4, 1975

Dr. Gray's Hospital
477 E. Main Street
Batesville, Arkansas 72501

Gentlemen:

This is to inform you that your permit application dated May 8, 1975 for the installation and operation of the incinerator as listed in the permit application was approved at the last regular Commission meeting of the Department of Pollution Control and Ecology.

This approval is given in accordance with the information submitted in the permit application and with the stipulations that emissions from the incinerator meet Subsection 4(a) of the Arkansas Air Pollution Control Code at all times.

This letter will serve as a temporary permit until such time that a regular permit is received and as such does not relieve the holder of his responsibilities to the Arkansas Air Pollution Control Code.

Sincerely,

S. Ladd Davies
Director

SLD/dm

cc/ Alan B. Peterson
Fire Engineers Inc.

DEPARTMENT OF POLLUTION CONTROL AND ECOLOGY
D.A.P.C.

SUMMARY REPORT RELATIVE TO PERMIT APPLICATION

SUBMITTED BY: Dr. Gray's Hospital

477 E. Main Street, Batesville, Arkansas

CSN:

FIRST SUBMITTAL: May 8, 1975 AMENDED:

CASE REFERENCES:

SUMMARY: Dr. Gray's Hospital in Batesville proposes to install a pathological incinerator (Fire Engineer Model HR-300) to burn 600 lbs. of type 0 and type IV wastes. The incinerator has a rated capacity of 260 lbs/hr and will be operated for 3 hrs/day. The test data submitted with the application shows the particulate emissions to be 0.061 gr/scf at 12% CO_2.

ESTIMATED COST: $9,146 TOTAL PROJECT: $ 9,146

COMMENCEMENT OF INSTALLATION:

DATE OF COMPLIANCE: GIVEN: SET:

REVIEWED BY: IB APPROVED: JES

RECOMMENDATION: Approval

ASSIGNED PERMIT NUMBER: 247-AI

COMMISSION MINUTE ORDER NUMBER:

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

December 13, 1973

Mr. Al Peterson
Fire Engineers, Inc.
900 Southgate Office Plaza
Minneapolis, Minnesota 55431

Dear Mr. Peterson,

The enclosed report concerns the performance of your Model HR 500 as tested on April 12, 1973. This report was prepared by Corning Laboratories, Incorporated of Cedar Falls, Iowa for review by the Minnesota Pollution Control Agency.

As tested, the unit meets the requirements of the common wealth of Virginia for incinerators buring type "O" waste. That requirement being 0.14 gr/SCF, as calculated from dry catch and corrected to 12% CO_2.

Cordially,

Kenneth E. Storms

Kenneth E. Storms
Project Engineer

KES:nh
224-H

Addendum to Model HR-500 Incinerator Test Data, April 12, 1973

I. CO_2 Produced by burners V_b, scfm

A. Net heat of combustion of natural gas is 1050 BTU/Ft^3

B. One Ft^3 of natural gas produces 1.08 cubic feet of CO_2 (70° F., 29.92 In. Hg.)

$$V_b = \frac{(250{,}000 \text{ BTU/HR}) (1.08 \text{ Ft}^3 \text{ CO}_2/\text{Ft}^3 \text{ Fuel})}{(1050 \text{ BTU/Ft}^3 \text{ Fuel}) (60 \text{ Min/Hour})}$$

$$V_b = 4.29 \text{ SCFM } CO_2$$

II. CO_2 produced by waste only, V_{wo}, % (Run #1)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\%\ CO_2) - (V_b) (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{78{,}427}{60} (7.4) - (4.29) (100)}{\frac{78{,}427}{60}}$$

$$V_{wo} = \frac{9672.69 - 429}{1307.12}$$

$$V_{wo} = 7.07\%$$

III. Particulate Concentration - Sample concentration

Method - Corrected to 12% CO_2 from waste, gr/ft^3 at 12% CO_2 (Run #1)

Dry Catch at dry standard conditions, gr/ft^3@12% CO_2

$$C_{ce} = \frac{(C_{cc}) (12)}{V_{wo}} = \frac{(0.079) (12)}{7.07}$$

$$= 0.134 \text{ GR/SCF}_{dg}\text{@12\% } CO_2$$

IV. CO_2 produced by waste only, V_{wo}, % (Run #2)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\%\ CO_2) - V_b (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{77792}{60} (7.5) - (4.29) (100)}{\frac{77792}{60}}$$

$$V_{wo} = \frac{1296.53 (7.5) - 429}{1296.53}$$

$$V_{wo} = 7.17\%$$

V. Particulate Concentration - Sample concentration method Corrected to 12% CO_2 from Waste - gr/ft^3 at 12% CO_2 (Run #2)
Dry Catch at dry standard conditions, gr/ft^3@ 12% CO_2

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.069)\ (12)}{7.17}$$

$$= 0.116\ Gr/SCF_{dg}\ @\ 12\%\ CO_2$$

VI. CO_2 produced by waste only, V_{wo}% (Run #3)

$$V_{wo} = \frac{(Q_{sd}\ _{std})\ (\%\ CO_2) - (V_b)\ (\theta_b)}{Q_{sd}\ _{std}}$$

$$V_{wo} = \frac{83162}{\frac{60}{83162}\ (7.3) - (4.29)\ (100)}$$

$$V_{wo} = \frac{1386.03\ (7.3) - 429}{1386.03}$$

$$V_{wo} = 6.99\%$$

VII. Particulate Concentration - Sample Concentration Method - Corrected to 12% CO_2 from Waste - gr/Ft^3 at 12% CO_2 (Run #3)

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.066)\ (12)}{6.99}$$

$$= 0.113\ GR/SCF_{dg}\ @\ 12\%\ CO_2$$

SUMMARY

	RUN #1	RUN #2	RUN #3	AVERAGE
Particulate Concentration: Sample Concentration Method (GR/SCF)	0.079	0.069	0.066	0.071
Stack Gas Flow Rate (SCF/HR)	78,427	77,792	83,162	79,7[illegible].67
Particulate Concentration Sample Conc. Method - Corrected to 12% CO_2 Dry Basis (GR/SCF)	0.134	0.116	0.113	0.121

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota.

Jerry W. Saddler

Jerry W. Saddler, P.E.
Date of Certification: March 11, 1974
Minnesota Registration No. 8951

Arkansas Pollution Control Commission
8001 National Drive
Little Rock, Arkansas 72209

Application for Permit to Construct, or Alter, and Operate an Incinerator

1. Name of Owner (Firm Name) Dr. Gray's Hospital

2. Address of Owner 477 East Main Street, Batesville, Arkansas 72501

3. Address of Installation Same

4. General Nature of Business Hospital

5. Incinerator: X New _____ Reconstruction

6. Incinerator: Make Fire Engineers Model HR-300 Class III

Rated Capacity 260 lbs/hr. cost $9146.40

7. Type of Waste (see attached code): "0"

Source of Waste: General room waste

Daily Amounts: 600 Lbs. X actual ____ estm.

Incinerator Operated 3 hours per day

8. Combustion Chambers: Primary Volume 56.89 cu. ft.
Secondary Volume 60.45 cu. ft.

9. Grate: Area 9.86 sq. ft. Burning Rate 26.37 lbs./sq.ft/hour

10. Auxiliary Burners:

Primary Chamber Burner: Type and Make Power - Hauck

Fuel Natural Gas Rating 500,000 BTU/hr.

Secondary Chamber Burner: Type and Make Power - Barber

Fuel Natural Gas Rating 750,000 BTU/hr.

11. Stack: Materials Stl Jacket & Rfty Height above grade 32.2 ft.

Dimensions 20"I.D. x 24" Velocity 21.72 ft/sec.

12. Spark Arrestor: Materials Stainless Steel Dimensions 3/8" x 3/8" open x 24" High

13. Dampers: Type Barometric Dimensions 14" I.D.

14. Draft: X Natural ____ Induced ____ Forced ____ CFM at ____ °F

15. Describe additional automatic or air pollution controls ____

Combustion Air Blower (see below)

16. Total Particulate Emissions: 0.061 grains/dSCF at 12% CO_2

17. Attach test data of similar unit simulating firing as proposed by application.

18. Attach drawings and specifications of incinerator.

19. Attach drawings of proposed incinerator location showing distances to all adjacent properties, all structures within 150 feet, and zoning of the area.

20. Signature of owner or authorized agent

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson, Authorized Agent

Signature of person preparing report

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson

Environmental Engineer

Incinerator is also factory prewired and prepiped requiring only final field connections to assure proper hookup.

ARKANSAS POLLUTION CONTROL COMMISSION
AIR POLLUTION CONTROL
PERMIT NO. 247-AI
Date May 8, 1975
Approved May 30, 1975

Classification of Wastes to be Incinerated

Type of Waste	Description of Waste
0	Trash- A mixture of highly combustible waste, primarily paper, cardboard, wood boxes, and combustible floor sweepings.
1	Rubbish - A mixture of combustible waste such as paper, cardboard, woodscrap, foliage, floor sweepings, and up to 20% cafeteria waste.
2	Refuse -- An even mixture by weight of rubbish and garbage
3	Gargage -- Animal and vegetable waste from restaurants, cafeterias, hotels, etc.
4	Pathological Waste -- Human and animal remains consisting of carcasses, organs, and solid organic wastes from hospitals, laboratories, etc.
5	Gaseous, liquid, or semi-liquid waste such as tar, paints, solvents, sludge, fumes, etc. from industrial operations.
6	Solid waste, such as rubber, plastics, wood waste, etc. from industrial operations.

RESULT OF SOURCE EMISSION TESTS
CONDUCTED ON
FEI MODEL HR500 INCINERATOR
LOCATED AT
FEI PLANT IN ARLINGTON, MINNESOTA
FOR
FEI CORP. OF MINNEAPOLIS, MINNESOTA
MAY 2, 1973

Prepared and Submitted by
CORNING LABORATORIES, INC.

Kenneth E Storms

May 21, 1973
nh 224H

Kenneth E. Storms
Project Engineer

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

TABLE OF CONTENTS

		Page No.
I	Introduction	1
II	Data Summary	2
III	Sampling and Analytical Techniques	5
IV	Calculations and Data	11
V	Field Data Sheets	23

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

INTRODUCTION

This report covers particulate emission tests made on model HR500 incinerator manufactured by the FEI Corporation of Minneapolis, Minnesota. A total of three sampling runs were conducted on April 12, 1973. The tests were conducted by Corning Laboratories, Inc., of Cedar Falls, Iowa. The unit tested was located at the FEI Plant on Highway 5 North of Arlington, Minnesota. The sampling equipment and procedures used conformed to procedures outlined in Volume 36, Number 247 of the "Federal Register". The unit tested was a horizontal, retort type incinerator with forced air in the secondary chamber. The incinerator is served by a variable burner, 0-750,000 BTU, set at 250,000 BTU. The unit had a 25 foot, 24 inch I.D. refractory stack. Two three inch I.D. sampler ports were located about 15 feet above the barometric damper.

Each test measured stack gas flow rate, stack gas composition, particulate concentration and mass flow rate. Velocity pressure valves were recorded at 1.5 minute intervals. Stack temperatures were recorded at 3 minute intervals, and all other data were recorded at 5 minute intervals. The unit was preheated prior to testing, and preliminary velocity and temperature traverses were conducted to determine the size of the sampling nozzle. Waste was weighed and charged manually at a rate of 380 pounds per hour.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

DATA SUMMARY

A summary of selected data and results is enclosed on the following page. Copies of the computer printout sheets, nomenclature sheets, and field data sheets are enclosed in the "Data and Calculations" section of this report.

In this report, "Particulate" includes everything caught on and before the filter plus the organic extract from the impinger as outlined in Method five of Volume 36, Number 159 of the "Federal Register". Results reported on a "Dry Basis" include only material collected before and on the filter in the EPA Sampling Train. Material which passes through the filter is considered to be "condensables" and is not reported as dry particulates.

Particulate concentrations are reported on a total and dry basis at standard conditions, and corrected to 12% CO_2. Particulate mass flow rates are reported on a total and dry basis in pounds per hour and pounds per 100 pounds of refuse burned.

Difficulties in sampling occurred near the end of test number one. As a result sampling was terminated after 10 points had been tested. Paragraph 2.13 on page 24882 of Volume 36, Number 247 of the

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

"Federal Register", December 23, 1971, states that in stack having a diameter of 2 feet or less it is necessary to sample only 2/3 of the usual number of points.

DATA SUMMARY
FEI CORP. MODEL HR500 INCINERATOR
APRIL 12, 1973

	RECORDED VALUES		
	Test #1	Test #2	Test #3
Total Volume Sampled (SCF)	29.22	36.55	40.04
Proportion by Volume as Water Vapor	.078	.070	.062
Proportion by Volume as CO_2	.074	.075	.073
Molecular Weight of Stack Gas (lb/lb-mole)	28.71	28.83	28.90
Average Stack Gas Temperature (°R)	1209.67	1393.87	1375.0
Stack Gas Velocity at Standard Conditions (ft/sec)	17.64	19.95	20.84
Stack Gas Flow Rate (SCF/hr)	78427	77792	83162
Percent of Isokinetic Sampling	95	100.7	104.1
Particulate Mass Flow Rate (lb/hr)	1.0	0.7	0.7
Charging Rate (100 lb/hr)	3.8	3.8	3.8
Mass Emission Rate (lb/100 lb charged)	0.23	.184	.184
Particulate Concentration: Sample Conc. Method (gr/SCF)	.079	.069	.066
Particulate Concentration Corrected to 12% CO_2 (gr/SCF)	0.128	0.110	0.113
Particulate Mass Flow Rate, Dry Basis (lb/hr)	0.510	.373	.349
Mass Emission Rate, Dry Basis (lb/100 lb. charged)	0.134	0.098	.092
Particulated Concentration, Dry Basis, S.C.M.: (gr/SCF)	.046	0.034	.029
Particulate concentration corrected to 12% CO_2, dry basis (gr/SCF)	.074	0.054	.048

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

SAMPLING AND ANALYTICAL TECHNIQUES

The equipment used for this sampling program was the Model AP-5000 Stac-O-Lator manufactured by Scientific Glass Blowing of Houston, Texas. It conforms to specifications outlined in "Construction Details of Isokinetic Source Sampling Equipment, APTD-0581." A schematic diagram of the equipment is shown in Figure 1.

The sample train consists of a stainless steel probe tip, an insulated quartz probe encased in an inconel sheath, a miniature glass cyclone and collection flask, a five inch diameter Gelman Type A glass fiber filter, a series of four Smith-Greenburg impingers, a leakless vacuum pump, a dry gas meter, and a calibrated orifice. The probe, cyclone and flasks, filter holder, impingers and connecting tubes are all glass. Connections are made by glass ball and socket joints. The quartz probe is wrapped with nichrome heating wire so the gas temperature in the probe can be maintained above 250°F. Also, the cyclone and the filter holder are contained in a heated chamber where the temperature was maintained above 250°F. The four impingers are in an ice bath to maintain a gas temperature of 70°F or less as it leaves the last impinger. The first, third, and fourth impingers are modified by replacing the high velocity tip with a 1/2 inch I.D. glass tube.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

The first and second impingers are initially filled with 100 milliliters each of distilled water. The third impinger is left dry, and the fourth impinger contains 200 grams of dry silica gel.

Stack temperature at the sampling point is measured by a thermocouple attached to the pitot tube. Temperatures in the probe, the heated filter box, the impinger effluent, and the inlet and outlet of the dry gas meter are also measured by thermocouples connected to a digital temperature indicator. Velocity pressure was measured by a calibrated, S-type pitot tube connected to an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Orifice meter pressure differential was measured by an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Before use, the dry gas meter and orifice meter were calibrated according to procedures outlined in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

During the sampling period, the sampling rate was adjusted to maintain isokinetic sampling conditions. At isokinetic conditions, the velocity of the stack gas entering the sampling nozzle should be equal to the stack gas velocity at the sampling point. These conditions were maintained by adjusting the pressure drop across the orifice meter in relation to the stack gas velocity pressure. The proper orifice differential was determined by using the nomographs

as specified in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

The sampling was conducted through two three-inch I.D. sample ports positioned at 90° to each other. Samples were collected at six sample points along each of the two diameters. The location of the sample points was determined by Method 1, "Federal Register," Vol. 36, No. 247. Orstat grab samples were collected during the test and analyzed to determine proportions of CO_2, O_2 and CO.

After each test, the probe, cyclone and flask, and the front half of the filter holder wer washed with acetone and the washings collected in glass storage containers. The filters were removed from the filter holder, folded and placed in envelopes. The water in the first two impingers was removed and the volume of the condensate determined. The back half of the filter holder, the first three impingers, and the connecting glassware were washed with distilled water and acetone. These washings were also collected in glass storage containers. The silica gel in the fourth impinger was removed and placed in glass storage containers.

Laboratory analysis consisted of determining the weight of particulate matter collected on the filter, in the condensate, and in the various acetone washings. Also, weight gain of the silica gel was determined. The filters were descicated and weighed to constant weight, ($\pm$0.50 milligrams). The acetone washings were evaporated at room temperature

and pressure, descicated and weighed to a constant weight. The condensate and water washings were extracted with chloroform and ethyl ether. The chloroform-either extract was evaporated to dryness at room temperature and pressure, descicated and weighed to constant weight as per Vol. 36, Number 159 of the "Federal Register."

Complete descriptions of the sampling equipment, sampling procedures, and analytical procedures can be found in the following publications:

Construction Details of Isokinetic Source-Sampling Equipment, APTD-0581, U.S. Environmental Protection Agency, April, 1971.

"Federal Register," Volume 36, Number 159, August 17, 1971.

"Federal Register," Volume 36, Number 247, December 23, 1971.

Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576, March, 1972.

Specifications for Incinerator Testing at Federal Facilities, U.S. Department of Health, Education, and Welfare, October, 1967.

SEPARATOR

32-00038

AIR

PERMITS

06/04/1975

0247-AI

June 4, 1975

Dr. Gray's Hospital
477 E. Main Street
Batesville, Arkansas 72501

Gentlemen:

This is to inform you that your permit application dated May 8, 1975 for the installation and operation of the incinerator as listed in the permit application was approved at the last regular Commission meeting of the Department of Pollution Control and Ecology.

This approval is given in accordance with the information submitted in the permit application and with the stipulations that emissions from the incinerator meet Subsection 4(a) of the Arkansas Air Pollution Control Code at all times.

This letter will serve as a temporary permit until such time that a regular permit is received and as such does not relieve the holder of his responsibilities to the Arkansas Air Pollution Control Code.

Sincerely,

S. Ladd Davies
Director

SLD/dm

cc/ Alan B. Peterson
Fire Engineers Inc.

DEPARTMENT OF POLLUTION CONTROL AND ECOLOGY
D.A.P.C.

SUMMARY REPORT RELATIVE TO PERMIT APPLICATION

SUBMITTED BY: Dr. Gray's Hospital

477 E. Main Street, Batesville, Arkansas

CSN:

FIRST SUBMITTAL: May 8, 1975 AMENDED:

CASE REFERENCES:

SUMMARY: Dr. Gray's Hospital in Batesville proposes to install a pathological incinerator (Fire Engineer Model HR-300) to burn 600 lbs. of type 0 and type IV wastes. The incinerator has a rated capacity of 260 lbs/hr and will be operated for 3 hrs/day. The test data submitted with the application shows the particulate emissions to be 0.061 gr/scf at 12% CO_2.

ESTIMATED COST: $9,146 TOTAL PROJECT: $ 9,146

COMMENCEMENT OF INSTALLATION:

DATE OF COMPLIANCE: GIVEN: SET:

REVIEWED BY: IB APPROVED: JES

RECOMMENDATION: Approval

ASSIGNED PERMIT NUMBER: 247-AI

COMMISSION MINUTE ORDER NUMBER:

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

December 13, 1973

Mr. Al Peterson
Fire Engineers, Inc.
900 Southgate Office Plaza
Minneapolis, Minnesota 55431

Dear Mr. Peterson,

The enclosed report concerns the performance of your Model HR 500 as tested on April 12, 1973. This report was prepared by Corning Laboratories, Incorporated of Cedar Falls, Iowa for review by the Minnesota Pollution Control Agency.

As tested, the unit meets the requirements of the common wealth of Virginia for incinerators buring type "O" waste. That requirement being 0.14 gr/SCF, as calculated from dry catch and corrected to 12% CO_2.

Cordially,

Kenneth E. Storms

Kenneth E. Storms
Project Engineer

KES:nh
224-H

Addendum to Model HR-500 Incinerator Test Data, April 12, 1973

I. CO_2 Produced by burners V_b, scfm

A. Net heat of combustion of natural gas is 1050 BTU/Ft^3

B. One Ft^3 of natural gas produces 1.08 cubic feet of CO_2 (70° F., 29.92 In. Hg.)

$$V_b = \frac{(250{,}000 \text{ BTU/HR}) (1.08 \text{ Ft}^3 \text{ CO}_2/\text{Ft}^3 \text{ Fuel})}{(1050 \text{ BTU/Ft}^3 \text{ Fuel}) (60 \text{ Min/Hour})}$$

$$V_b = 4.29 \text{ SCFM } CO_2$$

II. CO_2 produced by waste only, V_{wo}, % (Run #1)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\% CO_2) - (V_b) (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{78{,}427}{60} (7.4) - (4.29) (100)}{\frac{78{,}427}{60}}$$

$$V_{wo} = \frac{9672.69 - 429}{1307.12}$$

$$V_{wo} = 7.07\%$$

III. Particulate Concentration - Sample concentration

Method - Corrected to 12% CO_2 from waste, gr/ft^3 at 12% CO_2 (Run #1)

Dry Catch at dry standard conditions, gr/ft^3@12% CO_2

$$C_{ce} = \frac{(C_{cc}) (12)}{V_{wo}} = \frac{(0.079) (12)}{7.07}$$

$$= 0.134 \text{ GR/SCF}_{dg}@12\% \text{ CO}_2$$

IV. CO_2 produced by waste only, V_{wo}, % (Run #2)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\% CO_2) - V_b (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{77792}{60} (7.5) - (4.29) (100)}{\frac{77792}{60}}$$

$$V_{wo} = \frac{1296.53 (7.5) - 429}{1296.53}$$

$$V_{wo} = 7.17\%$$

V. Particulate Concentration - Sample concentration method
Corrected to 12% CO_2 from Waste - gr/ft^3 at 12% CO_2 (Run #2)
Dry Catch at dry standard conditions, gr/ft^3@ 12% CO_2

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.069)\ (12)}{7.17}$$

$$= 0.116\ Gr/SCF_{dg}\ @\ 12\%\ CO_2$$

VI. CO_2 produced by waste only, V_{wo}% (Run #3)

$$V_{wo} = \frac{(Q_{sd}\ _{std})\ (\%\ CO_2) - (V_b)\ (\theta_b)}{Q_{sd}\ _{std}}$$

$$V_{wo} = \frac{\frac{83162}{60}\ (7.3) - (4.29)\ (100)}{\frac{83162}{60}}$$

$$V_{wo} = \frac{1386.03\ (7.3) - 429}{1386.03}$$

$$V_{wo} = 6.99\%$$

VII. Particulate Concentration - Sample Concentration
Method - Corrected to 12% CO_2 from Waste - gr/Ft^3 at 12% CO_2 (Run #3)

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.066)\ (12)}{6.99}$$

$$= 0.113\ GR/SCF_{dg}\ @\ 12\%\ CO_2$$

SUMMARY

	RUN #1	RUN #2	RUN #3	AVERAGE
Particulate Concentration: Sample Concentration Method (GR/SCF)	0.079	0.069	0.066	0.071
Stack Gas Flow Rate (SCF/HR)	78,427	77,792	83,162	79,794.67
Particulate Concentration Sample Conc. Method - Corrected to 12% CO_2 Dry Basis (GR/SCF)	0.134	0.116	0.113	0.121

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota.

Jerry W. Saddler

Jerry W. Saddler, P.E.
Date of Certification: March 11, 1974
Minnesota Registration No. 8951

Arkansas Pollution Control Commission
8001 National Drive
Little Rock, Arkansas 72209

Application for Permit to Construct, or Alter, and Operate an Incinerator

1. Name of Owner (Firm Name) Dr. Gray's Hospital

2. Address of Owner 477 East Main Street, Batesville, Arkansas 72501

3. Address of Installation Same

4. General Nature of Business Hospital

5. Incinerator: X New _____ Reconstruction

6. Incinerator: Make Fire Engineers Model HR-300 Class III

Rated Capacity 260 lbs/hr. cost $9146.40

7. Type of Waste (see attached code): "0"

Source of Waste: General room waste

Daily Amounts: 600 Lbs. X actual ____ estm.

Incinerator Operated 3 hours per day

8. Combustion Chambers: Primary Volume 56.89 cu. ft.
Secondary Volume 60.45 cu. ft.

9. Grate: Area 9.86 sq. ft. Burning Rate 26.37 lbs./sq.ft/hour

10. Auxiliary Burners:

Primary Chamber Burner: Type and Make Power - Hauck

Fuel Natural Gas Rating 500,000 BTU/hr.

Secondary Chamber Burner: Type and Make Power - Barber

Fuel Natural Gas Rating 750,000 BTU/hr.

11. Stack: Materials Stl Jacket & Rfty Height above grade 32.2 ft.

Dimensions 20"I.D. x 24" Velocity 21.72 ft/sec.

12. Spark Arrestor: Materials Stainless Steel Dimensions 3/8" x 3/8" open x 24" High

13. Dampers: Type Barometric Dimensions 14" I.D.

14. Draft: X Natural ____ Induced ____ Forced ____ CFM at ____ °F

15. Describe additional automatic or air pollution controls ____

Combustion Air Blower (see below)

16. Total Particulate Emissions: 0.061 grains/dSCF at 12% CO_2

17. Attach test data of similar unit simulating firing as proposed by application.

18. Attach drawings and specifications of incinerator.

19. Attach drawings of proposed incinerator location showing distances to all adjacent properties, all structures within 150 feet, and zoning of the area.

20. Signature of owner or authorized agent

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson, Authorized Agent

Signature of person preparing report

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson

Environmental Engineer

Incinerator is also factory prewired and prepiped requiring only final field connections to assure proper hookup.

ARKANSAS POLLUTION CONTROL COMMISSION
AIR POLLUTION CONTROL
PERMIT NO. 247-AI
Date May 8, 1975
Approved May 30, 1975

Classification of Wastes to be Incinerated

Type of Waste	Description of Waste
0	Trash- A mixture of highly combustible waste, primarily paper, cardboard, wood boxes, and combustible floor sweepings.
1	Rubbish - A mixture of combustible waste such as paper, cardboard, woodscrap, foliage, floor sweepings, and up to 20% cafeteria waste.
2	Refuse -- An even mixture by weight of rubbish and garbage
3	Gargage -- Animal and vegetable waste from restaurants, cafeterias, hotels, etc.
4	Pathological Waste -- Human and animal remains consisting of carcasses, organs, and solid organic wastes from hospitals, laboratories, etc.
5	Gaseous, liquid, or semi-liquid waste such as tar, paints, solvents, sludge, fumes, etc. from industrial operations.
6	Solid waste, such as rubber, plastics, wood waste, etc. from industrial operations.

RESULT OF SOURCE EMISSION TESTS
CONDUCTED ON
FEI MODEL HR500 INCINERATOR
LOCATED AT
FEI PLANT IN ARLINGTON, MINNESOTA
FOR
FEI CORP. OF MINNEAPOLIS, MINNESOTA
MAY 2, 1973

Prepared and Submitted by
CORNING LABORATORIES, INC.

Kenneth E Storms

May 21, 1973
nh 224H

Kenneth E. Storms
Project Engineer

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

TABLE OF CONTENTS

		Page No.
I	Introduction	1
II	Data Summary	2
III	Sampling and Analytical Techniques	5
IV	Calculations and Data	11
V	Field Data Sheets	23

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

INTRODUCTION

This report covers particulate emission tests made on model HR500 incinerator manufactured by the FEI Corporation of Minneapolis, Minnesota. A total of three sampling runs were conducted on April 12, 1973. The tests were conducted by Corning Laboratories, Inc., of Cedar Falls, Iowa. The unit tested was located at the FEI Plant on Highway 5 North of Arlington, Minnesota. The sampling equipment and procedures used conformed to procedures outlined in Volume 36, Number 247 of the "Federal Register". The unit tested was a horizontal, retort type incinerator with forced air in the secondary chamber. The incinerator is served by a variable burner, 0-750,000 BTU, set at 250,000 BTU. The unit had a 25 foot, 24 inch I.D. refractory stack. Two three inch I.D. sampler ports were located about 15 feet above the barometric damper.

Each test measured stack gas flow rate, stack gas composition, particulate concentration and mass flow rate. Velocity pressure valves were recorded at 1.5 minute intervals. Stack temperatures were recorded at 3 minute intervals, and all other data were recorded at 5 minute intervals. The unit was preheated prior to testing, and preliminary velocity and temperature traverses were conducted to determine the size of the sampling nozzle. Waste was weighed and charged manually at a rate of 380 pounds per hour.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

DATA SUMMARY

A summary of selected data and results is enclosed on the following page. Copies of the computer printout sheets, nomenclature sheets, and field data sheets are enclosed in the "Data and Calculations" section of this report.

In this report, "Particulate" includes everything caught on and before the filter plus the organic extract from the impinger as outlined in Method five of Volume 36, Number 159 of the "Federal Register". Results reported on a "Dry Basis" include only material collected before and on the filter in the EPA Sampling Train. Material which passes through the filter is considered to be "condensables" and is not reported as dry particulates.

Particulate concentrations are reported on a total and dry basis at standard conditions, and corrected to 12% CO_2. Particulate mass flow rates are reported on a total and dry basis in pounds per hour and pounds per 100 pounds of refuse burned.

Difficulties in sampling occurred near the end of test number one. As a result sampling was terminated after 10 points had been tested. Paragraph 2.13 on page 24882 of Volume 36, Number 247 of the

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

"Federal Register", December 23, 1971, states that in stack having a diameter of 2 feet or less it is necessary to sample only 2/3 of the usual number of points.

DATA SUMMARY
FEI CORP. MODEL HR500 INCINERATOR
APRIL 12, 1973

	RECORDED VALUES		
	Test #1	Test #2	Test #3
Total Volume Sampled (SCF)	29.22	36.55	40.04
Proportion by Volume as Water Vapor	.078	.070	.062
Proportion by Volume as CO_2	.074	.075	.073
Molecular Weight of Stack Gas (lb/lb-mole)	28.71	28.83	28.90
Average Stack Gas Temperature (°R)	1209.67	1393.87	1375.0
Stack Gas Velocity at Standard Conditions (ft/sec)	17.64	19.95	20.84
Stack Gas Flow Rate (SCF/hr)	78427	77792	83162
Percent of Isokinetic Sampling	95	100.7	104.1
Particulate Mass Flow Rate (lb/hr)	1.0	0.7	0.7
Charging Rate (100 lb/hr)	3.8	3.8	3.8
Mass Emission Rate (lb/100 lb charged)	0.23	.184	.184
Particulate Concentration: Sample Conc. Method (gr/SCF)	.079	.069	.066
Particulate Concentration Corrected to 12% CO_2 (gr/SCF)	0.128	0.110	0.113
Particulate Mass Flow Rate, Dry Basis (lb/hr)	0.510	.373	.349
Mass Emission Rate, Dry Basis (lb/100 lb. charged)	0.134	0.098	.092
Particulated Concentration, Dry Basis, S.C.M.: (gr/SCF)	.046	0.034	.029
Particulate concentration corrected to 12% CO_2, dry basis (gr/SCF)	.074	0.054	.048

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

SAMPLING AND ANALYTICAL TECHNIQUES

The equipment used for this sampling program was the Model AP-5000 Stac-O-Lator manufactured by Scientific Glass Blowing of Houston, Texas. It conforms to specifications outlined in "Construction Details of Isokinetic Source Sampling Equipment, APTD-0581." A schematic diagram of the equipment is shown in Figure 1.

The sample train consists of a stainless steel probe tip, an insulated quartz probe encased in an inconel sheath, a miniature glass cyclone and collection flask, a five inch diameter Gelman Type A glass fiber filter, a series of four Smith-Greenburg impingers, a leakless vacuum pump, a dry gas meter, and a calibrated orifice. The probe, cyclone and flasks, filter holder, impingers and connecting tubes are all glass. Connections are made by glass ball and socket joints. The quartz probe is wrapped with nichrome heating wire so the gas temperature in the probe can be maintained above 250°F. Also, the cyclone and the filter holder are contained in a heated chamber where the temperature was maintained above 250°F. The four impingers are in an ice bath to maintain a gas temperature of 70°F or less as it leaves the last impinger. The first, third, and fourth impingers are modified by replacing the high velocity tip with a 1/2 inch I.D. glass tube.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

The first and second impingers are initially filled with 100 milliliters each of distilled water. The third impinger is left dry, and the fourth impinger contains 200 grams of dry silica gel.

Stack temperature at the sampling point is measured by a thermocouple attached to the pitot tube. Temperatures in the probe, the heated filter box, the impinger effluent, and the inlet and outlet of the dry gas meter are also measured by thermocouples connected to a digital temperature indicator. Velocity pressure was measured by a calibrated, S-type pitot tube connected to an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Orifice meter pressure differential was measured by an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Before use, the dry gas meter and orifice meter were calibrated according to procedures outlined in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

During the sampling period, the sampling rate was adjusted to maintain isokinetic sampling conditions. At isokinetic conditions, the velocity of the stack gas entering the sampling nozzle should be equal to the stack gas velocity at the sampling point. These conditions were maintained by adjusting the pressure drop across the orifice meter in relation to the stack gas velocity pressure. The proper orifice differential was determined by using the nomographs

as specified in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

The sampling was conducted through two three-inch I.D. sample ports positioned at 90° to each other. Samples were collected at six sample points along each of the two diameters. The location of the sample points was determined by Method 1, "Federal Register," Vol. 36, No. 247. Orstat grab samples were collected during the test and analyzed to determine proportions of CO_2, O_2 and CO.

After each test, the probe, cyclone and flask, and the front half of the filter holder wer washed with acetone and the washings collected in glass storage containers. The filters were removed from the filter holder, folded and placed in envelopes. The water in the first two impingers was removed and the volume of the condensate determined. The back half of the filter holder, the first three impingers, and the connecting glassware were washed with distilled water and acetone. These washings were also collected in glass storage containers. The silica gel in the fourth impinger was removed and placed in glass storage containers.

Laboratory analysis consisted of determining the weight of particulate matter collected on the filter, in the condensate, and in the various acetone washings. Also, weight gain of the silica gel was determined. The filters were descicated and weighed to constant weight, ($\pm$0.50 milligrams). The acetone washings were evaporated at room temperature

and pressure, descicated and weighed to a constant weight. The condensate and water washings were extracted with chloroform and ethyl ether. The chloroform-either extract was evaporated to dryness at room temperature and pressure, descicated and weighed to constant weight as per Vol. 36, Number 159 of the "Federal Register."

Complete descriptions of the sampling equipment, sampling procedures, and analytical procedures can be found in the following publications:

Construction Details of Isokinetic Source-Sampling Equipment, APTD-0581, U.S. Environmental Protection Agency, April, 1971.

"Federal Register," Volume 36, Number 159, August 17, 1971.

"Federal Register," Volume 36, Number 247, December 23, 1971.

Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576, March, 1972.

Specifications for Incinerator Testing at Federal Facilities, U.S. Department of Health, Education, and Welfare, October, 1967.

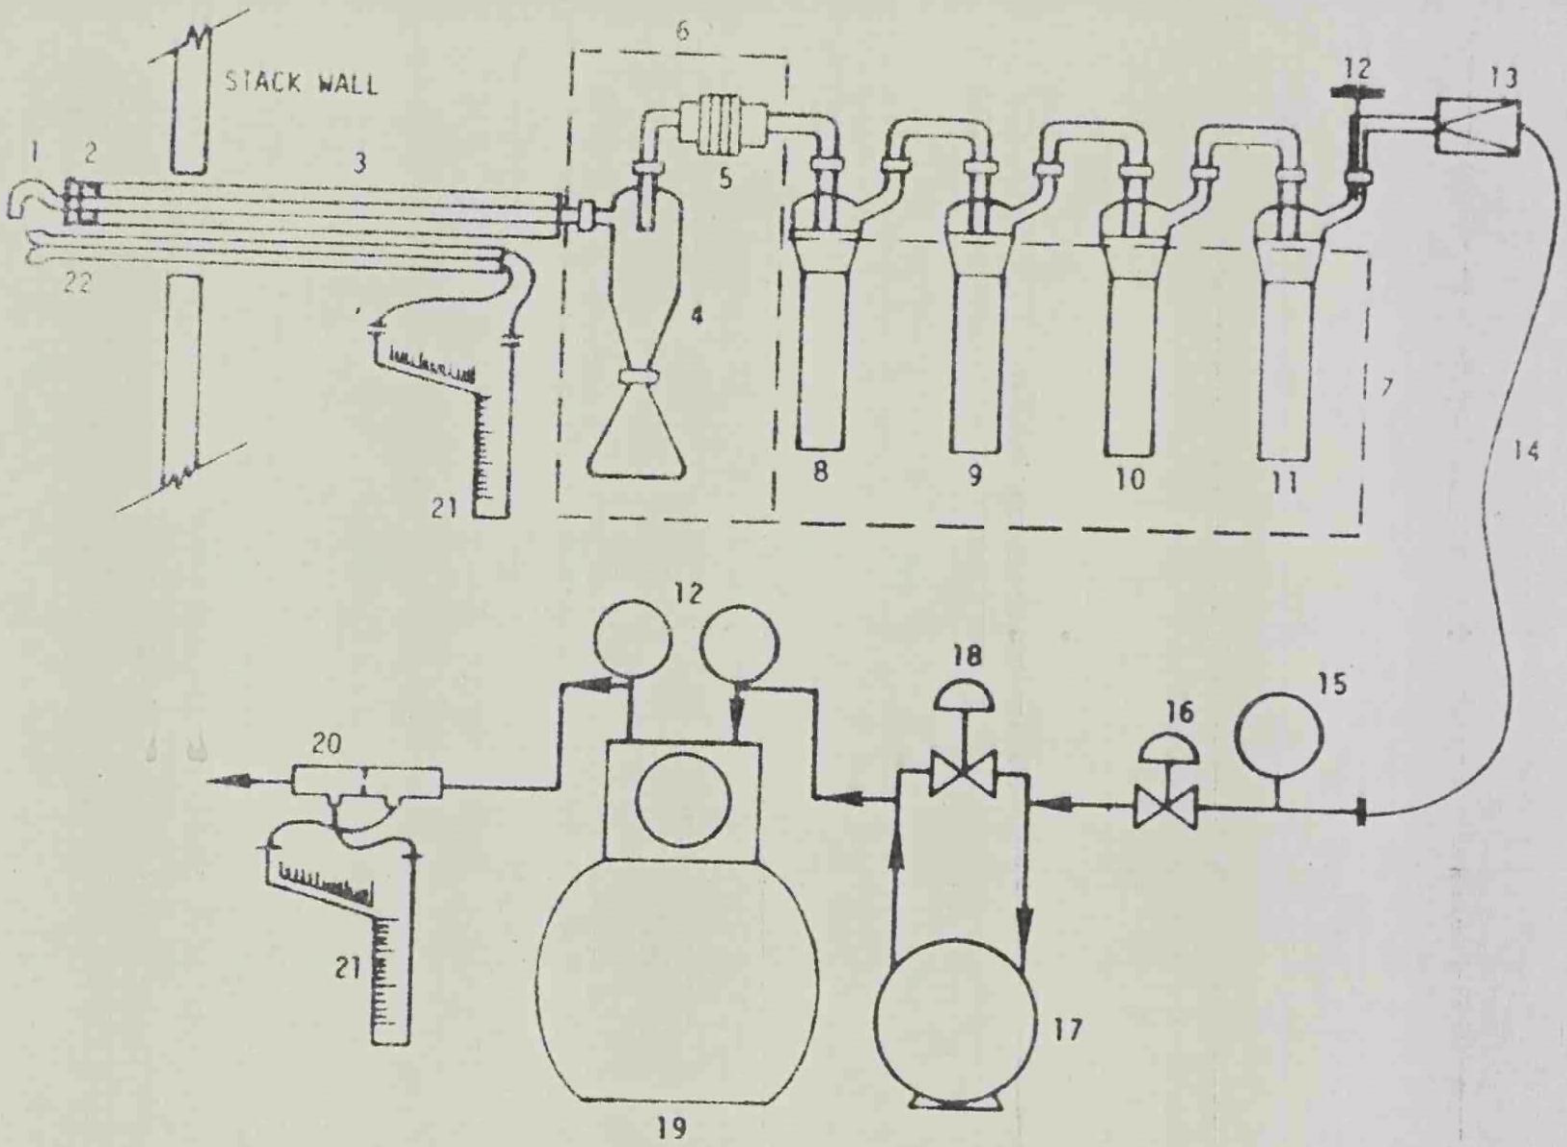

Figure 1. Particulate sampling train.

PARTICULATE SAMPLING TRAIN
NOMENCLATURE

1. Stainless Steel Nozzle
2. Stainless Steel Union Coupling
3. Heated Glass Probe and Sheath
4. Cyclone and Flask
5. Fiberglass and Filter Holder
6. Electrically Heated Enclosure
7. Ice Bath
8. Modified Greenburg-Smith Impinger, with 100 ml distilled water
9. Greenburg-Smith Impinger, with 100 ml distilled water
10. Modified Greenburg-Smith Impinger, dry
11. Modified Greenburg-Smith Impinger, with dry silica gel
12. Dial Thermometers
13. Check Valve
14. Vacuum Tubing
15. Vacuum Gauge
16. Valve
17. Leakless Vacuum Pump
18. By-Pass Valve
19. Dry Gas Meter
20. Calibrated Orifice
21. Manometer
22. S-Type Pitot Tube

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

DATA AND CALCULATIONS

The major portions of the calculations were conducted by IBM 1130 computer. The program and the data readout sheets are enclosed in this section. Values not calculated by computer include: particulate concentrations and mass flow rates on a dry basis, particulate concentrations and mass flow rates corrected for 12% CO_2, and emission rates in pounds per 100 pounds of refuse burned. The formulas for these calculations are as follows:

Mass Emission Rate (lb/100 lb refuse burned)

$$M_s = \frac{Qp}{CR}$$

M_s = Mass emission rate (lb/100 lb of refuse burned)

Q_p = Particulate mass flow rate (lb/hr)

CR = Charging rate (100 lb/hr)

Particulate Concentration, Dry Basis (lb/SCF)

$$C_{s_{dry}} = 2.205 \times 10^{-6} \text{ lb/mgm} \left(\frac{M_{n_{Dry}}}{V_{Total}}\right)$$

$C_{s_{dry}}$ = Particulate concentration (lb/SCF)

Mn_{dry} = Total Particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Mass Flow Rate, Dry Basis (lb/hr)

$$Q_{p_{dry}} = Q_s \times C_{s_{dry}}$$

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

$Q_{p_{dry}}$ = Particulate mass flow rate (lb/hr)

Q_s = Stack gas flow rate (SCF/hr)

$C_{s_{dry}}$ = Particulate concentration (lb/SCF)

Particulate Concentration, Dry Basis: Sample Concentration Method (gr/SCF)

$$c'_{s_{dry}} = 0.0154 \text{ gr/mgm}\left(\frac{M_{n_{dry}}}{V_{Total}}\right)$$

$c'_{s_{dry}}$ = Particulate concentration (gr/SCF)

$M_{n_{dry}}$ = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Mass Emission Rate, Dry Basis (lb/100 lb refuse burned)

$$M_{s_{dry}} = \frac{Q_{p_{dry}}}{CR}$$

$M_{s_{dry}}$ = Mass emission rate on a dry basis (lb/100 lb refuse burned)

$Q_{p_{dry}}$ = Particulate mass flow rate, dry basis (lb/hr)

CR = Charging rate (100 lb/hr)

Particulate Concentration, Corrected to 12% CO_2 Sample Concentration Method (gr/SCF)

$$c'_{s_{CO_2}} = \frac{c'_{s} \times .12}{B_{CO_2}}$$

$c'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 (gr/SCF)

c'_s = Particulate concentration: Sample Conc. Method (gr/SCF)

B_{CO_2} = Proportion by volume of CO_2 in stack gas.

Particulate Concentration, Dry Basis: Corrected to 12% CO_2: Sample Concentration Method (gr/SCF)

$$c'_{s_{dry/CO_2}} = \frac{c'_{s\ dry} \times 0.12}{B_{CO_2}}$$

$c'_{s_{dry/CO_2}}$ = Particulate concentration, dry basis; corrected to 12% CO_2: Sample Conc. Method (gr/SCF)

$c'_{s_{dry}}$ = Particulate concentration, dry basis; Sample Conc. Method (gr/SCF)

B_{CO_2} = Proportion by volume of CO_2 in stack gas

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets. Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO THE REPORT ON
MODEL HR500 INCINERATOR
TEST DATED APRIL 12, 1973

This addendum is issued to correct the stack gas composition for the CO_2 generated by the burner in the incinerator. Since no direct measurement of CO_2, due to the burner, was made during the test, the volume of CO_2 generated must be calculated. The corrected CO_2 concentration will be representative of the CO_2 produced by the waste only.

METHODS OF CALCULATION

V_b = Volume of CO_2 produced by the burners (SCFH)

(A) Net heat of combustion of Natural Gas is 1050 BRU/Ft^3
(B) One ft^3 of natural gas produced 1.08 ft^3 of CO_2 at STP

$$V_b = \frac{(250{,}000 \text{ BTU/hr})(1.08 \text{ ft}^3\text{CO}_2/\text{ft}^3 \text{ fuel})}{(1050 \text{ BTU/ft}^3 \text{ fuel}}$$

V_b = 257.14 SCFH CO_2

V_{WO} = Percent of CO_2 in stack gas produced by the waste

$$V_{WO} = \frac{(\dot{Q}s)(^{B}CO_2) - (V_b)}{(Qs)} \times 100$$

Q_s = Stack gas flow rate (SCF/hr)

$^{B}CO_2$ = Proportion by Volume of CO_2

V_b = Volume of CO_2 produced by burners

$C'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 from waste, sample concentration method (gr/SCF).

$$C'_{s_{CO_2}} = \frac{C'_s \times 12}{V_{WO}}$$

C'_s = Particulate concentration, sample conc. method (gr/SCF)

V_{WO} = Percent CO_2, by volume, produced by waste only

	V_b SCF/hr	V_{WO}, %	C'_s CO_2 gr/SCF
Run #1	257.14	7.07	0.134
Run #2	257.14	7.17	0.116
Run #3	257.14	6.99	0.113

$C'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 from waste, sample concentration method (gr/SCF).

$$C'_{s_{CO_2}} = \frac{C'_s \times 12}{V_{WO}}$$

C'_s = Particulate concentration, sample conc. method (gr/SCF)

V_{WO} = Percent CO_2, by volume, produced by waste only

	V_b SCF/hr	V_{WO}, %	C'_s CO_2 gr/SCF
Run #1	257.14	7.07	0.134
Run #2	257.14	7.17	0.116
Run #3	257.14	6.99	0.113

TEST NO. 224-H-1 UNIT TYPE ARSCO

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Arlington Minn

OBSERVER: Ken Storms DATE 4-16-73

TEST NO. 224-H-2 UNIT TYPE HR500

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Arlington Minn

OBSERVER: Ken Storms DATE 4-16-73

TEST NO. 224-H-3 UNIT TYPE HR500

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Rt. Tom Minn

OBSERVER: Ken Storms DATE 4-16-73

PARTICULATE EMISSION EVALUATION

FOR

F.E.I. CORPORATION

INCINERATOR MODEL RR3 (MOD)

at

F.E.I. BOAZ PLANT

BOAZ, ALABAMA

3/27/73

TYPE 0 WASTE

Submitted by:

Air Quality Testing & Design, Inc.
Post Office Box 76121
Atlanta, Georgia 30328

John J. Halligan, P. E.
Director of Engineering

Robert J. Labbe
Senior Test Engineer

I. Table of Contents
II. Introduction
III. Summary of Results
IV. Description of Installation
V. Sampling and Analytical Procedures
VI. Appendix

II. INTRODUCTION

The purpose of these source emission tests conducted at the F.E.I. Corporation, Boaz, Alabama plant on April 27, 1973 was to determine the outlet particulate emission of an F.E.I. incinerator, Model RR3 (MOD)

The F.E.I. Boaz plant is located at 655 Denson Road, Boaz, Alabama and is a part of the F.E.I. Corporation located at 900 Southgate Office Plaza, Minneapolis, Minnesota 55437.

The tests were performed under the supervision of Mr. John J. Halligan P. E., Director of Engineering and Mr. Robert J. Labbe, Chief Engineer of Air Quality Testing & Design, Incorporated, 175 West Wieuca Road, N. E., Atlanta, Georgia 30342.

AQT&D, Inc., would like to take this opportunity to extend its appreciation for the valuable assistance of F.E.I. Corporation personnel, Mr. Jerry Saddler, Mr. Lloyd Johnson and Mr. Don Noel, Plant Manager; and to Mr. Jack Smith of the Alabama Air Pollution Control Commission, in making these tests a success.

III. SUMMARY OF RESULTS

The summary of results, as illustrated in tabular form in Table I, demonstrate consistency and reproducibility of measured and calculated results. The emission values of Run 1 are, however, higher when the wet catch (condensible solids) are included. This may be due in part to curing the refractory of the incinerator during the first test. It can be seen from Table I that the emission results are within the allowable emissions as stated in the Georgia Department of Natural Resources document Rules and Regulations for Air Quality Control, Chapter 270-5-24, dated March 13, 1972. The standards for incinerator particulate emissions are cited on page 7, Item 2(c) (ii), of the above document and require that no greater than 0.1 grains per standard dry cubic foot gas, calculated to 12 percent carbon dioxide be emitted to the atmosphere.

IV. DESCRIPTION OF INSTALLATION

An F.E.I. Corporation Model RR3 (MOD) vertical design type incinerator was evaluated. An auxillary burner was used to complete combustion of primary chamber exhaust products. This burner used natural gas and had a rated capacity of 400,000 BTU/Hour as specified by the F.E.I. Corporation.

The incinerator was charged with "Type 0" waste at a rate of 260 lb./hour. The charging procedure was to input 13 lb. charges at three (3) minute time intervals. Each repetition was initiated from a cold start. There were no unusual operating conditions and no changes made in the incinerator operation for the purpose of testing.

V. SAMPLING AND ANALYTICAL PROCEDURE

The sampling train used for determining particulate emissions meets

Table I

Summary of Test Results

	Test No. 1	2	3
Sampling Time (minutes)	60	60	60
Volume Sampled (AFC)	1284.4	1273.0	1405.4
Volume Sampled (SCF_{dg})	61.21	54.78	58.89
Percent Moisture (% by vol.)	5.7	6.8	5.4
Total Sample Weight (mg)	1311	932	666
Volume Flow Rate, Q_s, (SCF_{dg}/min)	1147	1052	1190
Volume Flow Rate, Q_a, (ACF/min)	2407	2443	2841
Particulate Concentration (gr/ACF)	0.0157	0.0113	0.0073
Particulate Concentration (gr/SCF_{dg})	0.0330	0.0262	0.0174
Particulate Concentration (gr/SCF_{dg} @ 12% CO_2)	0.079	0.063	0.041
Particulate Emission Rate, (#/hr.)	0.324	0.236	0.178
Isokinetic Value, I (dimensionless)	115.6	112.9	107.2
Process Input Weight Rate	260	260	260
Allowable Particulate Emission Rate			

The above emission results are based on a dry catch. Results indicated below are based on total catch (including condensible solids/wet catch)

Particulate Concentration (gr/ACF)	0.0227	0.0145	0.0118
Particulate Concentration (gr/SCF_{dg})	0.0477	0.0337	0.0281
Particulate Concentration (gr/SCF_{dg} @ 12% CO_2)	0.114	0.081	0.066
Particulate Emission Rate, (#/hr.)	0.469	0.304	0.257
TOTAL SAMPLE W/ (mg)	1896	1199	1076

all requirements as published in the Federal Register, Volume 36, Number 247, Part II, dated December 23, 1971. *Enclosed is descriptive literature.*

The isokinetic sampling condition obtained in each of the repetitions and given in the Summary of Tabulated Results, Table I, are within ± 10 percent of the required value of 100.

The analytical procedures conform with those outlined in the Federal Register and are described in complete detail in the Appendix.

Preliminary Test Data

1. Size of Duct: 18 inches
2. Area of Duct: 1.767 sq. ft.
3. Stack Height: ≈ 30 ft.
4. Test Port Data:
   (a) Diameter: 3 inches
   (b) Extension: 3 inches
   (c) Upstream Disturbance ($\frac{L}{D}$): 8
   (d) Downstream Disturbance ($\frac{L}{D}$): 2
5. Number of Traverse Points: 24
6. Minimum Required Number of Traverse Points: 12

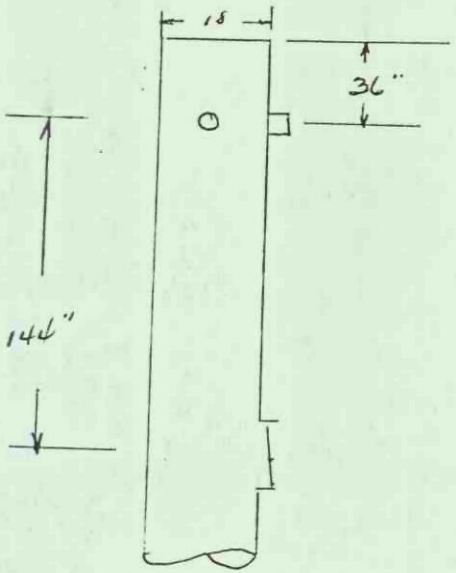

Model RR3(1160) Stack

Plant KET Corp
Run number Base Rea
Location
Date 3/31/73
Operator Lucchesi/Hummel
Sample box number 1
Meter box number 1

FEI-Bath
RR3-(1160)
24 Point Traverse
Velocity Survey

Ambient temperature, °F 72
Barometric pressure, in. Hg 29.87
Assumed moisture, % —
Heater box setting, °F —
Probe tip diameter, in. —
Probe length, ft. —
Probe heater setting —
Cp = 0.87

Point	Traverse Location / Clock time	Dry gas meter, ft3	Pitot, in. H2O Δp	Orifice ΔH, in. H2O Desired	Orifice ΔH, in. H2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	Stack pressure, in. Hg	Stack temperature, °F
1	0.375		0.06									
2	1.21		0.91									
3	3.13		2.03									
4	3.18		2.15									
5	4.50		2.15									
6	6.39		2.15									
7	11.61		2.15									
8	13.56		2.15									
9	14.82		2.15									
10	15.83		2.15									
11	16.74		2.11									
12	17.44											
1	—		—									
2												
3												
4												
5												
6												
7												
8												
9												
10												
11												
12			—									

Comments:

PARTICULATE FIELD DATA

Client FET

Plant Arlington

Date 4-12-73

Test No. 224B-3

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 50

Barometric Pressure 29.18

Assumed Moisture 10%

Nozzle Dia. 0.50

filter No. 48
Initial wt 2334gm
Initial Vol 200 ml

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft³)	Gas Sample Volume Final (ft³)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	700/690	.03	.60	791.211	793.67	66	67
2	5	695/840	.05	1.05	793.67	796.40	65	67
3	5	841/845	.06	1.35	796.40	799.57	66	67
4	5	920/940	.08	1.9	799.57	803.26	66	66
5	5	920/995	.08	1.9	803.26	807.00	68	67
6	5	1010/965	.05	1.05	807.00	809.98	68	66
7	5	880/850	.03	.60	809.98	812.28	67	65
8	5	840/825	.05	1.05	812.28	815.15	67	65
9	5	910/840	.06	1.35	815.15	817.78	68	65
10	5	1060/1070	.08	1.9	817.78	822.45	68	64
11	5	1060/1060	.08	1.9	822.45	826.29	69	64
12	5	1060/1015	.06	1.35	826.29	829.49	69	65
	60	915		1.35	38.08		66	

STACK GAS VELOCITY

Client FEC

Plant Pinkerton

Stack

Date 4-12-93

Test No. 2246-3

Stack Diameter 24"

Barometric Pressure 29.18

Static Pressure in Stack

Pitot Tube Correction Factor 0.81

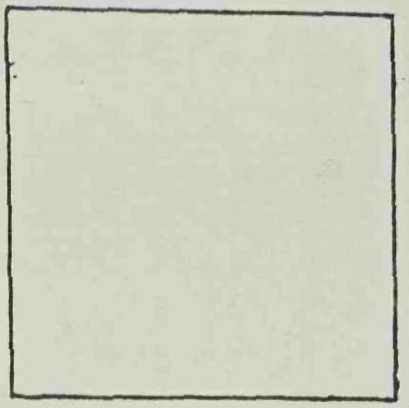

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.03	.03	.03			173	173	173		.519
2	.05	.05	.05			224	224	224		.671
3	.06	.06	.06			245	245	245		735
4	.08	.08	.08			283	283	283		848
5	.08	.08	.08			283	283	283		.848
6	.05	.05	.05			224	224	224		.671
7	.03	.03	.03			173	173	173		519
8	.05	.05	.06			173	173	245		591
9	.07	.06	.06			264	245	245		754
10	.08	.08	.08			283	283	283		848
11	.08	.08	.08			283	283	283		848
12	.06	.06	.05			245	245	224		714
								236		

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 1-12-73

Test No. 224-A-3

Barometric Pressure 29.16

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.3
O_2	10.0
~~CO~~	1.9

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	.073	3.12
O_2	32	.117	3.74
CO	28	000	000
N_2	28	.810	22.68
	Md =		29.54

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$M = M_d(1-B_w) + 18\ B_w$

$M =$ _____

STACK GAS VELOCITY

Client FEI

Plant Arlington

Stack

Date 4-12-73

Test No. 224 G-1

Stack Diameter 24"

Barometric Pressure 29.10

Static Pressure in Stack 29.15

Pitot Tube Correction Factor 0.81

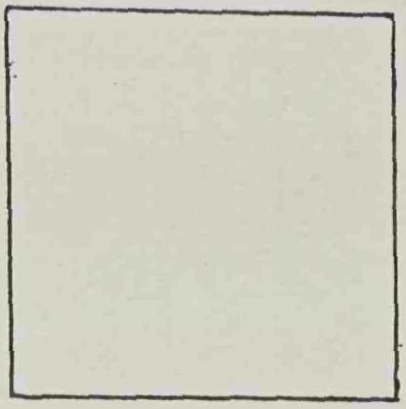

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.02	.025	.02			.141	.158	.141		440
2	.03	.03	.03			173	173	173		519
3	.04	.04	.04			.200	.200	.200		.600
4	.07	.07	.06			265	265	245		775
5	.07	.06	.04			265	245	245		755
6	.05	.05	.035			224	224	187		625
7	.03	.03	.03			173	173	173		519
8	.04	.04	.04			.2	.2	.2		.600
9	.055	.055	.055			235	235	235		704
10	.07	.07	.08			265	265	283		815
11										
12										
						.212				

A 19/3 min
3.0

PARTICULATE FIELD DATA

Client FEI

Plant Arington

Date 4-12-77

Test No. 2249-1

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 56

Barometric Pressure 29.10

Assumed Moisture 10 %

Nozzle Dia. 0.5

Filter No. 46
Initial wt 200 gm
Intial Vol 100 ml

756.45

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft^3)	Gas Sample Volume Final (ft^3)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	617/703	.02	.38	728.98	731.02	57	57
2	5	675/673	.03	.60	731.02	733.70	58	56
3	5	702/840	.04	.85	733.70	735.80	57	59
4	5	754/870	.04	.85	735.80	738.98	60	57
5	5	1020/940	.06	1.40	738.98	742.42	62	58
6	5	850/1400	.045	.95	742.40	745.41	65	60
7	5	800/575	.03	.60	745.41	747.62	63	63
8	5	600/686	.04	.85	747.62	750.13	62	61
9	5	665/700	.055	1.2	750.13	753.04	63	62
10	5	790/820	.08	1.9	753.01	756.1	65	62
11	~~5~~							
12	~~5~~							
					27.12		60.35	
50 min		749.67		.96				

STACK GAS VELOCITY

Client _____

Plant _____

Stack _____

Date 4-12-73

Test No. 224-G-2

Stack Diameter 24"

Barometric Pressure 29.16

Static Pressure in Stack _____

Pitot Tube Correction Factor 0.81

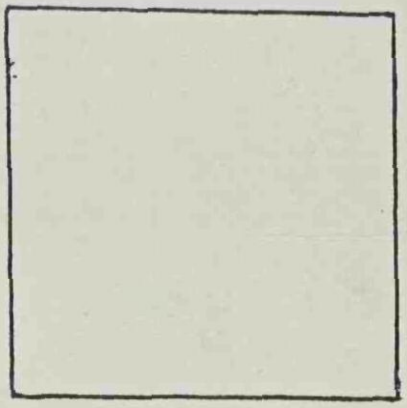

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.02	.02	.02			.141	.141	.141		.424
2	.03	.03	.03			.173	.173	.173		.519
3	.04	.04	.05			.20	.20	.224		.624
4	.07	.07	.07			265	265	265		.794
5	.07	.06	.07			265	245	265		.775
6	.05	.04	.05			224	.20	224		.648
7	.03	.03	.03			.173	.173	173		520
8	045	.05	.05			212	224	224		660
9	.06	.06	.06			245	245	245		735
10	.08	.07	.08			283	265	283		.830
11	.08	.08	.08			283	283	283		849
12	.05	.06	.05			224	245	224		683
							224			

#2

PARTICULATE FIELD DATA

Client FEI

Plant Arlington

Date 4-12-73

Test No. 2244-2

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 66

Barometric Pressure 29.96

Assumed Moisture 10%

Nozzle Dia. .50

Filter #47
Initial wt 200
Initial wt 200

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft^3)	Gas Sample Volume Final (ft^3)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	970/1000	.02	.38	756.84	758.60	65	66
2	5	685/744	.03	.60	758.60	760.91	66	66
3	5	804/780	.04	.81	760.91	763.47	66	64
4	5	940/886	.07	1.6	763.47	766.78	67	66
5	5	960/990	.07	1.6	766.78	770.12	67	65
6	5	890/980	.05	1.05	770.82	772.94	69	65
7	5	840	.05	1.05	772.94	775.20	69	65
8	5	900/940	.05	1.05	775.20	777.89	69	65
9	5	910/985	.06	1.35	777.89	781.06	70	66
10	5	1040/990	.08	1.90	781.06	784.68	71	66
11	5	1040/1090	.08	1.9	784.68	788.41	72	66
12	5	975/1030	.05	1.05	788.41	791.41	73	67
		93387		1.15	34.57		67	

#2

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 4-12-7?

Test No. 224-2

Barometric Pressure 29.16

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.5
O_2	18.9
~~N_2~~ CO	18.9

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	.075	3.3
O_2	32	.114	3.53
CO	28	0	
N_2	28	.811	22.71
	Md =		29.59

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$$M = M_d(1 - B_w) + 18\ B_w$$

M = _____

3/27/73

Sample Laboratory Data

Filter Data

Run No.	Ini. Weight	Final Weight	Net Weight
1	0.7494	0.8544	0.1050 Grams
2	0.7504	0.8238	0.0734
3	0.7297	0.7734	0.0437
4			

Probe Wash Data

1	1.1358	1.1619	0.0261 Grams
2	1.2231	1.2433	0.0202
3	1.2166	1.2395	0.0229
4			

Condensible Solid Data

1	81.5898	81.6483	0.0585 Grams
2	84.4194	84.4461	0.0267
3	78.4260	78.4670	0.0410
4			

Summary of Sample Laboratory Data

Run No.	Filter	Probe	Condensible Solid	Net Total
1	0.1050	0.0261	0.0585	0.1896 Grams
2	0.0730	0.0202	0.0267	0.1199
3	0.0437	0.0229	0.0410	0.1076
4				

3/27/73

Moisture Laboratory Data

Silica Gel Data

Run No.	Ini. Weight	Final Weight	Net Weight
1	200	218.0	18.0 ml.
2	200	225.3	25.3
3	200	219.3	19.3
4			

Impinger Data

Run No.	Ini. Volume	Final Volume	Net Volume
1	200	266.	66 ml.
2	200	260	60
3	200	251	51
4			

Summary of Moisture Laboratory Data

Run No.	Silica Gel	Impinger	Net Total
1	18.0	60	78.0 ml.
2	25.3	60	85.3
3	19.3	51	70.3
4			

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel Natural Gas

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.5 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\% CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(2444)(.153) - (7.5)(\quad)}{(2444)}$$

= 5.0 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_{s(12\%)} = C_s\left[\frac{12.0}{\% CO_2(corr)}\right]$$

$$= (.0337)\left[\frac{12.0}{(5)}\right]$$

$C_{s(12\%)}$ = 0.081 gr/SCF_{dg} @ 12% CO_2

Plant Test Corp.
Run number 2
Location Exit
Date 3/27/73
Operator Williams/Knapp
Sample box number 1
Meter box number 1

Ambient temperature, °F 72°F
Barometric pressure, in. Hg 29.87
Assumed moisture, % 5%
Heater box setting, °F 250°F
Probe tip diameter, in. 0.520
Probe length, ft. 5'-0"
Probe heater setting 250°F

Orifice ΔH = 1.5" I.D.

Point	Clock time	Dry gas meter, ft^3	Pitot, in. H_2O ΔP	Orifice ΔH, in. H_2O Desired	Orifice ΔH, in. H_2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	Stack pressure, in. Hg	Stack temperature, °F
Start 1		73.67										
2												
3												
4												
5												
6												
7												
8												
9												
10												
11												
12												
1												
2	3:41			1.75	1.74	64	84	5.9	231	124	30.1	256
3	3:46					65	84	6.0	232	124	30.1	264
4	3:51					65	84	6.1	232	125	30.1	266
5	3:56					65	84	6.1	232	124	33.2	270
6	4:01					65	84	6.1	232	125	33.2	267
7	4:06					65	84	6.1	232	126	33.2	263
8	4:11					65	84	6.1	232	126	33.2	260
9	4:16					65	84	6.1	232	126	33.2	257
10	4:21					65	84	6.1	232	126	33.2	260
11	4:26					65	84	6.1	232	126	33.2	260
12	4:31					65	84	6.1	232	126	33.2	260
	4:36	78.51										

Comments:

Plant FEL CORP. 13#/3MIN
Run number 3
Location PALM BEACH
Date 3/27/73
Operator HALLIGAN & LABBE
Sample box number 1
Meter box number 1
400,000 BTU/HR

PARTICULATE TEST

Ambient temperature, °F 72.00
Barometric pressure, in. Hg 29.87
Assumed moisture, % 5
Heater box setting, °F 250°F
Probe tip diameter, in. 0.500
Probe length, ft. 5'-0"
Probe heater setting 250°F

PITOT

Point	Clock time	Dry gas meter, ft³	Pitot, in. H₂O ΔP	Orifice ΔH, in. H₂O Desired	Orifice ΔH, in. H₂O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	~~Stack~~ pressure, ~~in. Hg~~	Stack temperature, °F
1												
2	4:35	77394	0.08	25	25	86	87	6.8	178	87	293	545
3	4:38	79754	0.08	25	25	85	84	6.8	180	85	280	505
4	4:41	80326	0.09	27	27	85	85	6.9	191	85	261	485
5	4:44	80803	0.10	31	31	85	85	7.2	193	86	260	615
6	4:47	80384	0.10	31	31	85	85	7.5	196	87	275	709
7	4:50	80206	0.12	38	38	84	86	9.0	201	91	288	746
8	4:54	81300	0.13	40	40	83	84	9.3	211	93	241	709
9	4:57	81619	0.13	40	40	83	82	9.3	209	98	255	750
10	5:00	81951	0.13	40	40	81	83	9.3	211	100	283	805
11	5:02	82203	0.12	38	38	81	81	9.2	208	101	288	786
12	5:05	82486										
1												
2	5:20	82486	0.07	20	20	80	80	6.0	190	103	255	684
3	5:23	82783	0.09	26	26	80	82	6.2	192	102	246	640
4	5:26	83021	0.09	26	26	79	77	6.2	210	103	255	715
5	5:29	83312	0.10	28	28	79	79	6.3	215	105	291	773
6	5:32	83549	0.11	32	32	78	78	7.5	229	104	290	732
7	5:35	83834	0.12	35	35	77	79	7.6	218	105	341	924
8	5:38	84130	0.135	38	38	75	78	8.8	216	105	312	803
9	5:41	84452	0.14	39	39	76	76	8.9	214	104	316	931
10	5:44	84765	0.13	36	36	75	76	8.8	214	104	321	932
11	5:47	85077	0.11	30	30	76	76	8.6	213	104	314	847
12	5:50	85370										

Comments:
TOO MANY LEAKS

TEST PARTICIPANTS
FROM
AIR QUALITY TESTING & DESIGN, INC.

1. John J. Halligan, P.E., Director of Engineering
2. Robert J. Labbe, Chief Engineer

Nomenclature

A_s	Cross-sectional area of stack, $ft.^2$
A_n	Cross-sectional area of nozzle, sq. ft.
ACF	Actual cubic feet of gas at stack conditions
ACFM	Actual cubic feet of gas per minute at stack conditions
B_{wo}	Proportion by volume of water vapor in the gas stream dimensionless
c'_s	Concentration of particulate matter in stack gas, gr/SCF_{dg}
c'_{sl}	Concentration of particulate matter in stack gas, gr/ADF
C_p	Pitot tube coefficient of Type S pitot tube
H	Average pressure drop across the orifice meter, inches H_2O
dp	Probe diameter, inches
(P) avg	Average velocity head of stack gas, inches H_2O
Q_E	Particulate emission rate, lb./hr.
K_p	Constant
M_d	Dry molecular weight, lb./lb.-mole
M_s	Molecular weight of stack gas (wet basis)
M_n	Total amount of particulate matter collected, mg
I	Percent Isokinetic Sampling
P_{bar}	Barometric pressure at orifice meter, inches HG
P_m	Barometric pressure at dry gas meter, inches HG
P_s	Absolute stack gas pressure, inches HG
P_{std}	Absolute pressure at standard conditions, 29.92 inches HG
Q_a	Volumetric flow rate, actual conditions ACF/min.
Q_s	Volumetric flow rate, dry basis, standard conditions SCF_{dg}/min.

Nomenclature (continued)

SCF_{dg}	Standard cubic feet of dry gas corrected to 70°F, 29.92 inches HG & dry
T_m	Average dry gas temperature at meter, °R
T_s	Absolute average stack gas temperature °R
T_{std}	Absolute temperature at standard conditions, 530 °R
θ	Total sampling time, minutes
V_a	Stack gas volume sampled, ACF
V_f	Final volume of impinger contents, ml.
V_i	Initial volume of impinger contents, ml.
V_{lc}	Total volume of liquid collected in impingers and silica gel, ml.
V_m	Volume of gas sample through the dry gas meter, (meter conditions), cu. ft.
$V_{m_{std}}$	Volume of gas sample through the dry gas meter, (standard conditions), cu. ft.
$V_{s\ gel}$	Equivalent volume of H_2O absorbed at std. conditions.
$V_{w_{std}}$	Volume of water vapor in the gas sample (standard conditions), cu. ft.

V. APPENDIX A

FIELD/LAB DATA AND CALCUATIONS

SUMMARY SHEET OF PARAMETERS

TEST # 1

1.	V_{lc}	=	78.0 ml.
2.	V_m	=	61.76 $ft.^3$
3.	P_{bar}	=	29.87 in. HG
4.	T_m	=	538 °R
5.	T_s	=	1047 °R
6.	ΔH	=	3.2 in. W.G.
7.	C_p	=	0.81
8.	$\sqrt{\Delta P_{avg}}$	=	0.297 $(in. W.G.)^{1/2}$
9.	P_s	=	29.87 in. HG
10.	A_s	=	1.767 sq. ft.
11.	M_n	=	189.6 mg. (WET)
12.	θ	=	60 min.
13.	dp	=	0.499 in.
14.	% CO_2	=	5.3
15.	% O_2	=	15.0
16.	% CO	=	79.7

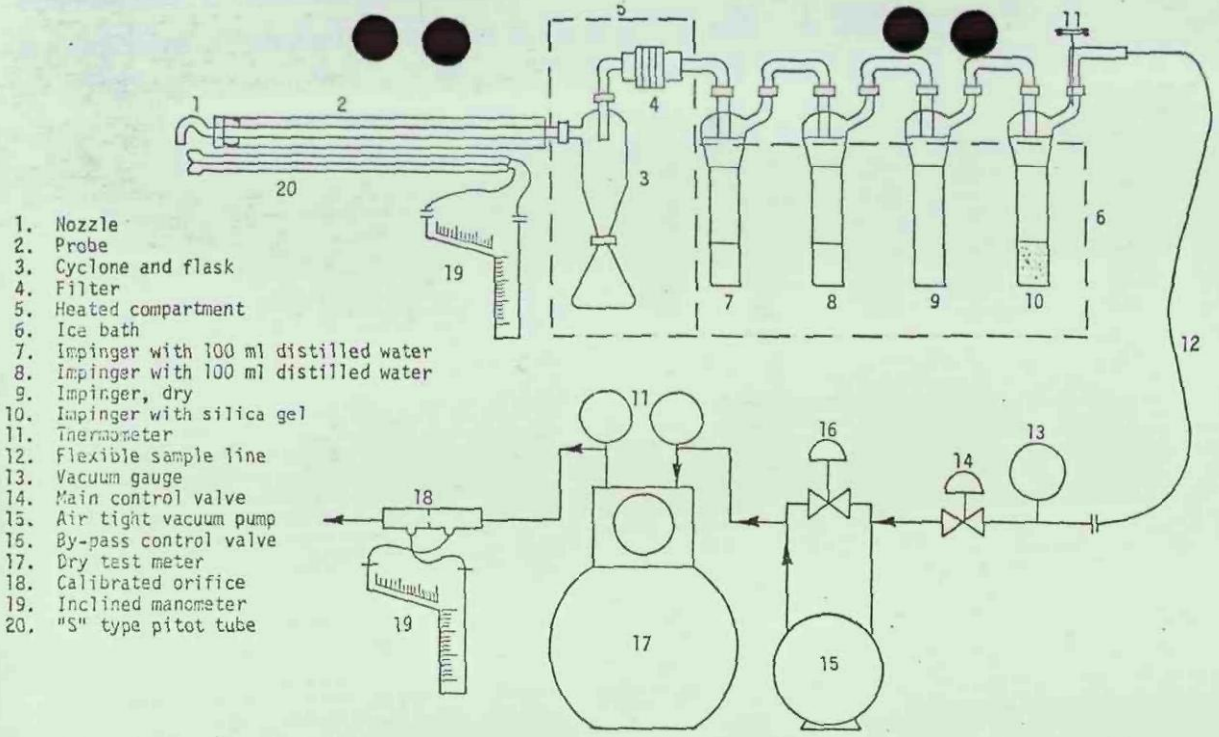

PARTICULATE SAMPLING TRAIN

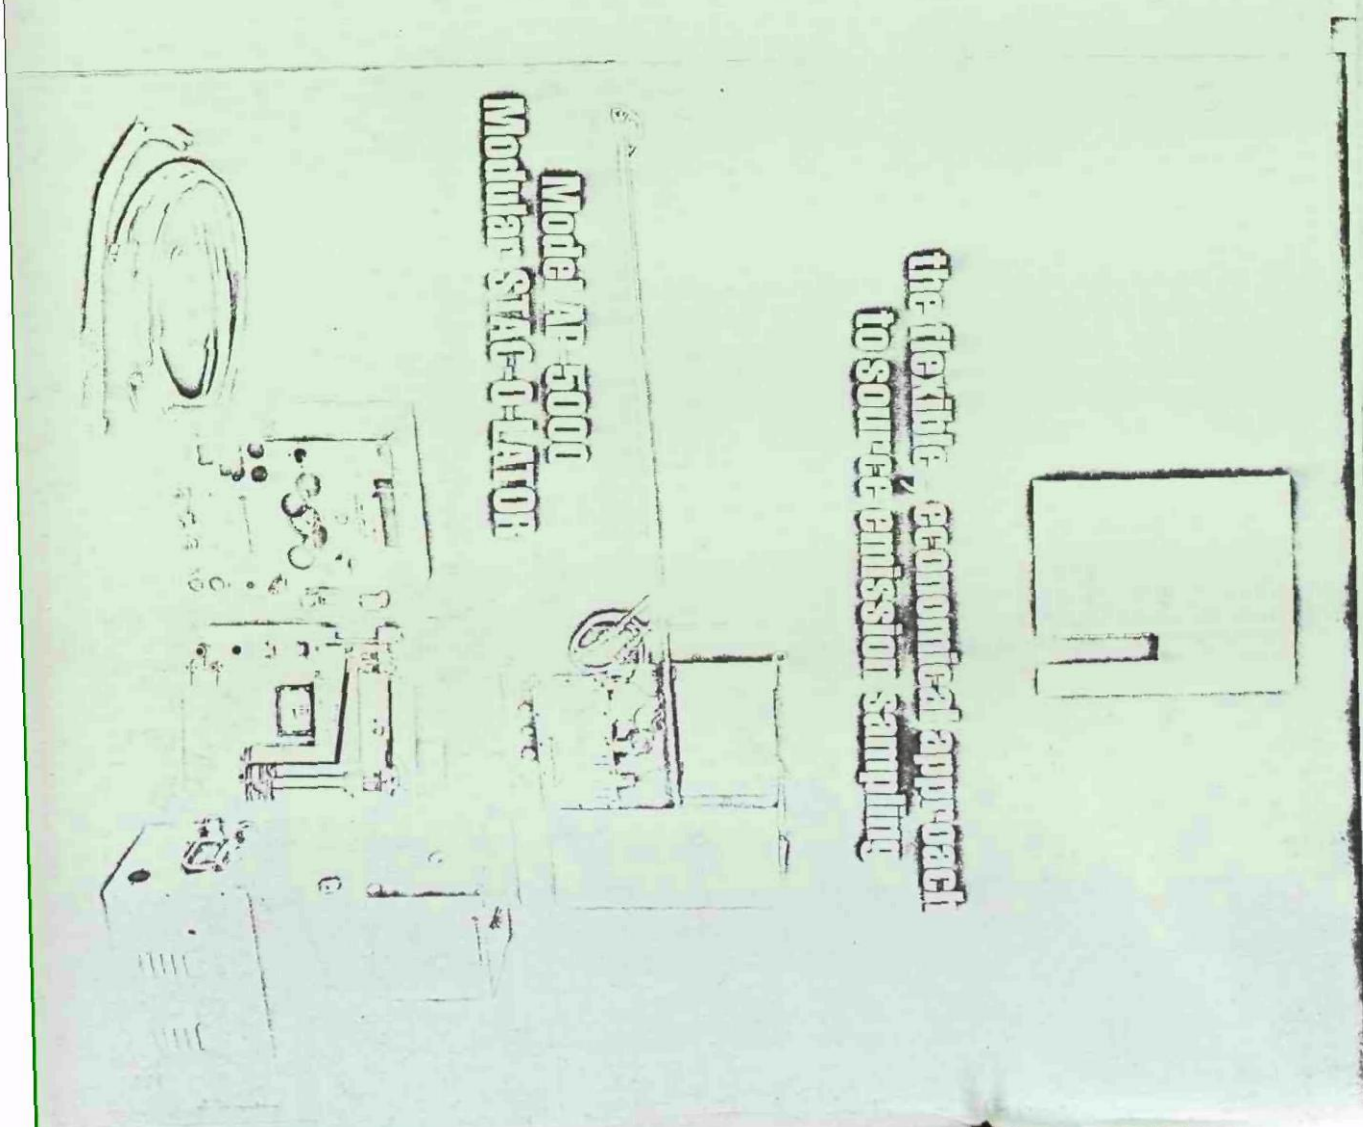

Model AP–5000 Modular STAC·O·LATOR™ represents a whole new concept in air pollution sampling instrumentation. Based on a building-block arrangement of individual components designed to handle specific stack emissions tests, the AP–5000 easily adapts to any or all of the E.P.A./A.P.C.O. requirements in Vol. 36, No. 247 of the *Federal Register*. In addition, the unit is capable of sampling for hazardous air pollutants from stationary sources in accordance with the methodology set forth by E.P.A./A.P.C.O. in Vol. 36, No. 234 of the *Federal Register*.

Development of the AP–5000 evolved from the need for having a *single* instrument capable of performing the wide variety of stack emissions tests now required by law. Without this new modular unit, as many as *seven* different instruments could be required in order to comply with new stack sampling regulations. Obviously, initial expense and problems in transporting to and from sampling locations would be prohibitive. SGB's new modular unit is the product of many varying ideas and concepts developed during actual sampling of sources by governmental agencies, consulting engineering firms and various private industries and has been thoroughly evaluated for the past year. It retains all the outstanding basic design features of its widely used predecessor, the STAC·O·LATOR,™ such as SGB's patented filter device that provides positive entrapment of solid particulate with a choice of different size filters; single-point data acquisition capability; ground to stack communications; variable timing mechanism; ground level temperature control requiring no thermostat; simplified monorail suspension for easier sampling and a special Nomograph accessory for fast calculation of velocities. Additional state-of-the-art improvements in the new system make operation even easier than before, assuring total source testing capability at minimum cost plus extreme accuracy in temperature and gas measurements.

Control Unit

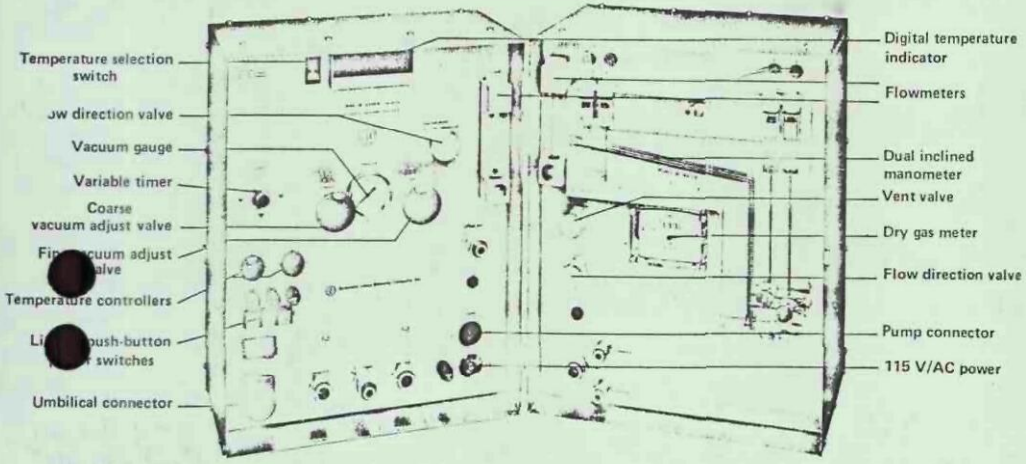

The Control Unit, which is operated at ground level, contains all controls and monitoring devices for isokinetic sampling. Total weight has been reduced to only 40 pounds and center hinges added so that the two compartments close in suitcase-like fashion for protection during transport. The unit's features include a 0·5 inch H_2O Dual-Inclined Manometer, Digital Temperature Indicator (DTI) that gives instant readout of any of 6 temperature points, and stainless steel cabinetry construction. Optional equipment allows the ground operator to have telephone communications with the stack and gives stack operator an alarm signal at the end of each sampling point period.

Ordering information:

Control Unit	Part No. 5000–3

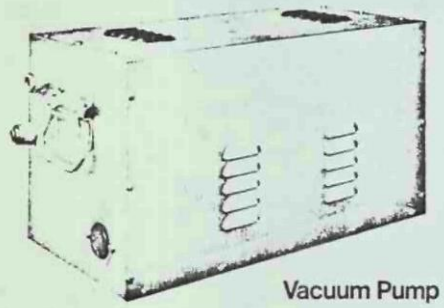

Vacuum Pump

The Vacuum Pump is now a separate component, self-contained in its own stainless steel carrying case. By removing the pump from control unit electronics, SGB has eliminated heat build-up errors and, at the same time, given customers a single pump for various applications. The Vacuum Pump is rated at 4 CFM at 0" Hg.

Ordering information:

Pump and Case	Part No. 5000–PC



Nomograph Part No. 1002N

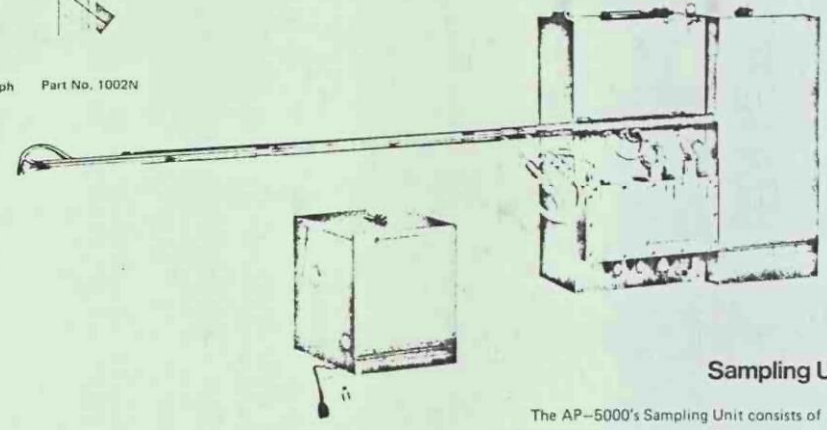

Sampling Unit

The AP–5000's Sampling Unit consists of three components: (1) the Impinger Case, (2) the Cyclone or Filter Oven, and (3) Pitobe. This flexible configuration allows the sampling team to make up all the trains required for the various sampling jobs.

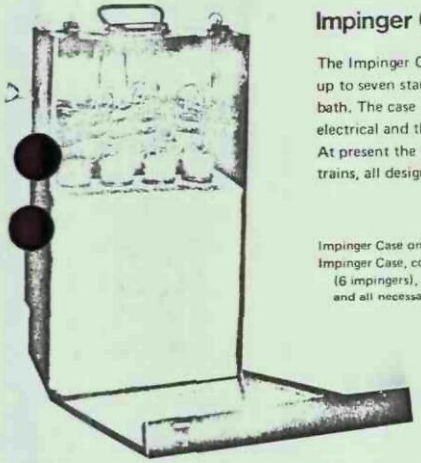

Impinger Case

The Impinger Case, with its own built-in carrying handle, holds up to seven standard 500 ml impingers in a closed-pore styrofoam ice bath. The case is equipped with vacuum and pitometer quick connects; electrical and thermocouple connections and an umbilical cord clamp. At present the Model AP–5000 offers *three* separate sampling trains, all designed to fit into the impinger case.

Ordering information:

Impinger Case only	Part No. 5000–1
Impinger Case, complete with glassware (6 impingers), styrofoam ice bath and all necessary #28 clamps	Part No. 5000–1CG

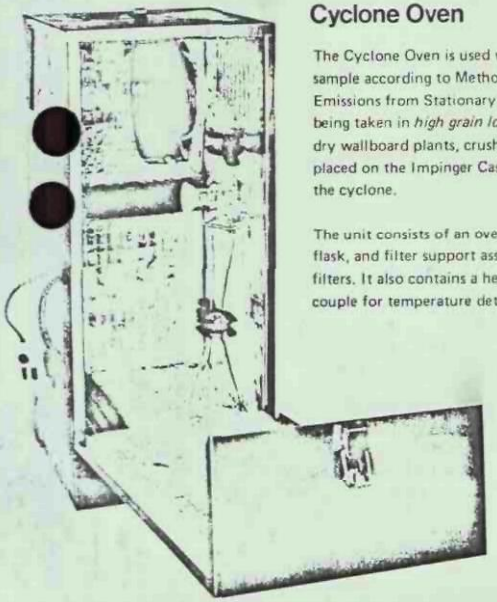

Cyclone Oven

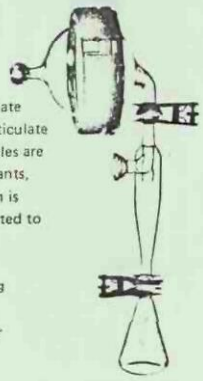

The Cyclone Oven is used when performing a particulate sample according to Method 5 (Determination of Particulate Emissions from Stationary Sources). When such samples are being taken in *high grain loading areas* like cement plants, dry wallboard plants, crushers, etc., the Cyclone Oven is placed on the Impinger Case and the Pitobe is connected to the cyclone.

The unit consists of an oven, a glass cyclone, receiving flask, and filter support assembly with 2, 3 or 4-inch filters. It also contains a heater element and a thermocouple for temperature detection.

Ordering Information:

Cyclone Oven Case Only	Part No. 5000–2A
Cyclone complete with glass cyclone receiving flask, 2-inch diameter filter and all necessary #28 clamps	Part No. 5000–2AG2
Same as above with 3-inch diameter filter	Part No. 5000–2AG3
Same as above with 4-inch diameter filter	Part No. 5000–2AG4

Pitobe

The Pitobe is a single assembly consisting of a Probe for sample-taking and a Pitot Tube for measuring stack temperature and velocity. Pitobes are available in type 316 stainless steel with either a heated Pyrex® glass or heated 316 stainless steel inner liner; or Inconel 601 with heated quartz glass inner liner.

When the sampling team performs a velocity traverse in accordance with Method 2 (Determination of Stack Gas Velocity and Volumetric Flow Rate), the S-type Pitot Tube is disconnected from the probe, and Pitometer lines are connected to the gas side of the Control Unit to measure the stack gas velocity on the dual inclined manometer. A permanently mounted Type K thermocouple on the S-type Pitot Tube gives direct stack temperature readout on the Digital Temperature Indicator. All Pitobe assemblies are grounded for maximum protection against electrical shock, and heated inner liners are supported on each end with packing glands. Outlet ball joint is 316 stainless steel for maximum protection of glass inner liners.

Ordering Information:

Type 316 S.S. with heated Pyrex glass inner liner

3-foot	Part No. 5000–PT3
5-foot	Part No. 5000–PT5
10-foot	Part No. 5000–PT10

Type 316 S.S. with heated 316 S.S. inner liner

3-foot	Part No. 5000–PT3S
5-foot	Part No. 5000–PT5S
10-foot	Part No. 5000–PT10S

Inconel 601 with heated quartz glass inner liner

3-foot	Part No. 5000–PTI3
5-foot	Part No. 5000–PTI5
10-foot	Part No. 5000–PTI10

Note: Jacketed probes for temperatures above 2000° F are available on request.

Typical Sampling Train – Method 5

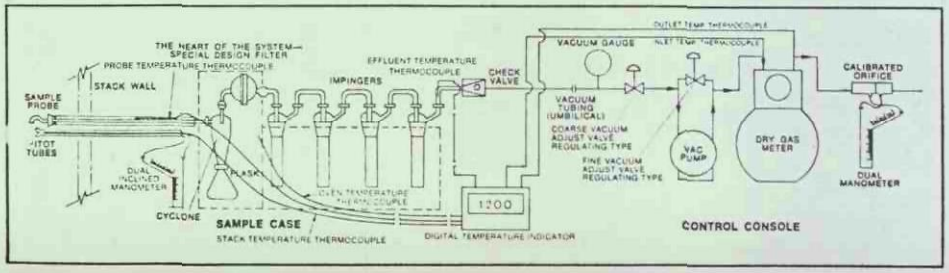

CALCULATIONS

Test No. 1

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

V_f = 260 ml.

V_i = 200 ml.

$V_{s\ gel}$ = 18.0 ml.

V_{lc} = 78.0 ml.

$V_{w_{std}}$ = 0.0474 ft^3/ ml. (V_{lc})

$V_{w_{std}}$ = 0.0474 ft^3/ ml. (78.0)

$V_{w_{std}}$ = 3.70 ft.^{3}

b. Dry gas volume through meter:

V_m = 61.76 ft.^{3}

P_{bar} = 29.87 in HG

T_m = 538 °R

ΔH = 3.2 in W. G.

$V_{m_{std}}$ = (17.71 °R/in HG) V_m $\left(\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m} \right)$

$V_{m_{std}}$ = 17.71 (61.76) $\left(\frac{29.87 + \frac{3.2}{13.6}}{538} \right)$

$V_{m_{std}}$ = 61.21 SCF_{dg}.

c. Moisture Content:

$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$

$B_{wo} = \frac{3.70}{3.70 + 61.21}$

B_{wo} = 0.057

d. Wet molecular weight:

M_d = 29.45 lb./lb. - mole.

$M_s = M_d(1. - B_{wo}) + 18.(B_{wo})$

M_s = (29.45)(.943) + 18. (.057)

M_s = 28.80 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

P_s = 29.87 in. HG

T_s = 1047 °R

P_{std} = 29.92 in. HG

T_{std} = 530 °R

$V_a = V_{m_{std}} (T_s) (P_{std}) / [1. - B_{wo}) (T_{std}) (P_s)]$

$$V_a = \frac{(6121)}{(.943)} \left(\frac{1047}{530}\right) \left(\frac{29.92}{29.57}\right)$$

V_a = 128.44 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

K_p = 85.48 ft./sec. (lb./lb. - mole °R) 1/2

C_p = 0.81

(T_s) avg = 1047 °R

$(\sqrt{\Delta P})$ avg = 0.297 (in. H_2O) 1/2

B_{wo} = 0.057

M_s = 28.80 lb./lb. - mole.

P_s = 29.57 in. HG

$$(V_s) \text{ avg} = K_p C_p (\sqrt{\Delta P}) \text{ avg} \sqrt{\frac{(T_s) \text{ avg}}{(P_s)(M_s)}}$$

(V_s) avg = 22.70 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

A_s = 1.767 sq. ft.

$Q_s = 60 (1.-B_{wo}) (V_s) \text{avg}^A \left(T_{std}/T_{s_{avg}}\right) (P_s/P_{std})$

Q_s = 1146.9 SCF_{dg}/min.

2. Actual conditions

$Q_a = (V_s) \text{ avg } A_s \, 60$

$Q_a = (22.7)(1.767)(60)$

Q_a = 2406.7 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 189.6 mg. (WET)

$V_{m_{std}}$ = 6121 SCF_{dg}

V_a = 128.44 ACF

$c_s' = 0.0154 \text{ grain/mg } (M_n/V_{m_{std}})$

$c_s' = 0.0154 \left(\frac{189.6}{6121}\right)$

c_s' = 0.0477 grains/SCF

$c_{s1}' = 0.0154 \text{ grain/mg } (M_n/V_a)$

$c_{s1}' = 0.0154 \left(\frac{189.6}{128.44}\right)$

c_{s1}' = 0.0227 grains/ACF

V. Emission Rate: (WET)

Q_s = 1146.9 SCF/min.

$E = 60 (Q_s) (c_s')$ lb./7000 grains

$$Q_E = \frac{60\ (V_{M7})\ (.0477)}{7000}$$

$$P_E = \underline{\quad 8.469 \quad} \text{ lb./hr.}$$

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = .499 inches

A_n = 0.00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{min.}{sec.})\ [(0.00267\ \frac{in.\ Hg\text{-}cu.\ ft.}{ml.\text{-}^\circ R})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ avg\ P_s A_n}$$

$$I = \frac{1047(1667)\left\{0.00267\ (75.0) + \frac{61.76}{535}\left(29.87 + \frac{3.2}{13.6}\right)\right\}}{60(22.7)(29.87)(.00136)}$$

I = 115.6

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel NATURAL GAS

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6,666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.51 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\%\ CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(240.7)(6.53) - (7.51)(\quad)}{(\quad)}$$

= 5.0 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_s(12\%) = C_s\left[\frac{12.0}{\%\ CO_2(corr)}\right]$$

$$= (.0477)\ \left[\frac{12.0}{(5.0)}\right]$$

$C_s(12\%)$ = 0.144 gr/SCF_{dg} @ 12% CO_2

Summary of Calculated Results

Test No. 1

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 3.70 ml.cc

b. Dry gas volume through meter: $V_{m_{std}}$ = 61.21 cu. ft.

c. Percent Moisture: B_{wo} = 5.7 %

d. Wet Molecular Weight: M_s = 28.80 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 128.44 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 2270 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1147 SCF_{dg}/min.

2. Q_a = 3407 ACF/min.

IV. Determination of Particulate Concentrations (WET)

a. c'_s = 0.0497 grains/SCF

b. c'_{s1} = 0.0227 grains/ACF

V. Emission Rate (WET)

Q_E = 0.469 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED

Gas Analysis: Orsat/Gas Chromatograph

		Orsat	Gas Chromatograph
% CO_2	=		5.3
% O_2	=		15.0
% CO	=		
% N_2	=		79.7

Dry Molecular Weight: M_d

M_d = 0.44 (%CO_2) + 0.32 (O_2) + 0.28 (%N_2 + %CO)

M_d = 0.44 (5.3) + 0.32 (15) + 0.28 (79.7)

M_d = 29.45 LB/LB-MOLE

Plant FEE CORP

Run number 1

Location Pond, Rm

Date 3/22/73

Operator HOLLAND & LOOSE

Sample box number 1

Meter box number 1

PARTICULATE TEST

Ambient temperature, °F 72

Barometric pressure, in. Hg 29.87

Assumed moisture, % 5

Heater box setting, °F 250°F

Probe tip diameter, in. 1/2"

Probe length, ft. 5.0"

Probe heater setting 250°F

Plane

Point	Clock time	Dry gas meter, ft^3	Pitot, in. H_2O ΔP	Orifice ΔH, in. H_2O Desired	Orifice ΔH, in. H_2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	~~Stack~~ pressure, ~~in. Hg~~	Stack temperature, °F
1												
2	10:45	67533	0.65	3.33	3.3	73	74	6.5	141	78		344
3	10:48		0.64	3.22	3.2	73	76	5.4	132	73		337
4	10:51	68046	0.65	3.48	3.4	73	74	7.3	143	73	1.68	406
5	10:54	68344	0.65	4.5	4.5	73	74	14.5	154	75	1.21	425
6	10:57	68654	0.65	4.6	4.6	73	75	15.0	156	77	1.36	451
7	11:00	68945	0.64	4.9	4.9	73	74	16.0	158	82	1.36	513
8	11:03	69249	0.64	4.9	4.9	74	74	16.3	161	83	1.15	503
9	11:06	69756	0.64	4.8	4.8	77	77	16.2	206	85	1.07	653
10	11:09	70100	0.62	4.5	4.5	76	76	12.0	218	84	1.35	653
11	11:12	70439	0.62	4.5	4.5	75	76	16.1	222	87	1.35	545
12	11:15	70783										
1												
2	12:00	70785	0.05	1.7	1.7	78	78	6.5	163	84	1.03	513
3	12:03	70810	0.61	3.5	3.5	78	77	7.7	165	82	2.07	481
4	12:06	71271	0.63	3.6	3.6	78	78	8.0	180	86	2.57	611
5	12:09	71543	0.64	3.5	3.5	77	78	11.0	184	86	2.84	747
6	12:12	71830	0.64	3.3	3.3	78	78	12.0	194	88	2.55	750
7	12:15	72132	0.61	4.0	4.0	78	78	14.0	204	84	2.57	749
8	12:18	72442	0.61	4.0	4.0	77	78	14.6	210	84	2.46	613
9	12:21	72763	0.61	4.0	4.0	77	78	14.5	220	84	2.45	633
10	12:24	73112	0.61	4.6	4.6	78	78	16.0	230	92	2.07	747
11	12:27	73415	0.60	3.5	3.5	78	78	15.7	237	94	2.13	723
12	12:30	73704										557

Comments:

Summary of Calculated Results

Test No. 2

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 4cc ml.cc.

b. Dry gas volume through meter: $V_{m_{STD}}$ = 54.75 cu. ft.

c. Percent Moisture: B_{WO} = 6.5 %

d. Wet Molecular Weight: M_s = 28.47 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 12730 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 2305 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1052 SCF_{dg}/min.

2. Q_a = 2444 ACF/min.

IV. Determination of Particulate Concentrations (wet)

a. c_s' = 0.0337 grains/SCF

b. c_{s1}' = 0.0045 grains/ACF

V. Emission Rate (wet)

E = 0.304 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED 2

Gas Analysis: Orsat/Gas Chromatograph

	Orsat	Gas Chromatograph
% CO_2 =		5.3
% O_2 =		14.9
% CO =		
% N_2 =		79.8

Dry Molecular Weight: M_d

$M_d = 0.44\ (\%CO_2) + 0.32\ (O_2) + 0.28\ (\%N_2 + \%CO)$

$M_d = 0.44\ (5.3) + 0.32\ (14.9) + 0.28\ (79.8)$

$M_d =$ 29.44 LB/LB-MOLE

CALCULATIONS

Test No. 2.

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

$V_f =$ 260 ml.

$V_i =$ 200 ml.

$V_{s\ gel} =$ 25.3 ml.

$V_{lc} =$ 85.3 ml.

$V_{w_{std}} = 0.0474\ ft^3/ml.\ (V_{lc})$

$V_{w_{std}} = 0.0474\ ft^3/ml.\ (85.3)$

$V_{w_{std}} =$ 404 $ft.^3$

b. Dry gas volume through meter:

$V_m =$ 55.74 $ft.^3$

$P_{bar} =$ 29.87 in HG

$T_m =$ 543 °R

$\Delta H =$ 3.6 in W. G.

$V_{m_{std}} = (17.71\ °R/in\ HG)\ V_m \left(\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m} \right)$

$V_{m_{std}} = 17.71\ (55.74)\ \left(\frac{29.87 + \frac{3L}{13.6}}{543}\right)$

$V_{m_{std}} =$ 54.78 SCF_{dg}.

c. Moisture Content:

$$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$$

$B_{wo} = \frac{404}{404 + 54.78}$

$B_{wo} =$ 0.068

d. Wet molecular weight:

$M_d =$ 29.47 lb./lb. - mole.

$M_s = M_d(1.-B_{wo}) + 18.\ (B_{wo})$

$M_s = (29.47)(.932) + 18.\ (.068)$

$M_s =$ 28.67 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

$P_s =$ 29.87 in. HG

$T_s =$ 1146 °R

$P_{std} =$ 29.92 in. HG

$T_{std} =$ 530 °R

$V_a = V_{m_{std}}\ (T_s)\ (P_{std}) / [1. - B_{wo})\ (T_{std})\ (P_s)]$

$V_a = \frac{(54.78)}{(.932)}\ \left(\frac{1146}{530}\right)\ \left(\frac{29.92}{29.87}\right)$

$V_a =$ 127.30 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

$K_p = 85.48$ ft./sec. (lb./lb. - mole °R) $^{1/2}$

$C_p = 0.81$

(T_s) avg = 1146 °R

$(\sqrt{\Delta P})$ avg = 0.287 (in. H_2O) $^{1/2}$

$B_{wo} =$ 0.068

$M_s =$ 28.67 lb./lb. - mole.

$P_s =$ 29.87 in. HG

$$(V_s)\ \text{avg} = K_p C_p\ (\sqrt{\Delta P})\ \text{avg} \sqrt{\frac{(T_s)\ \text{avg}}{(P_s)\ (M_s)}}$$

(V_s) avg = 23.05 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

$A_s =$ 1.767 sq. ft.

$Q_s = 60\ (1.-B_{wo})\ (V_s)\ \text{avg}^A\ (T_{std}/T_{s_{avg}})\ (P_s/P_{std})$

$Q_s =$ 1051.6 SCF_{dg}/min.

2. Actual conditions

Q_a = (V_s) avg A_s 60

Q_a = (23.05) (1.767) (60)

Q_a = 2443.8 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 119.9 mg.

$V_{m_{std}}$ = 54.78 SCF_{dg}

V_a = 127.30 ACF

c_s' = 0.0154 grain/mg $(M_n/V_{m_{std}})$

c_s' = 0.154 $(\frac{119.9}{54.78})$

c_s' = 0.0337 grains/SCF

c_{s1}' = 0.0154 grain/mg (M_n/V_a)

c_{s1}' = 0.154 $(\frac{119.9}{127.3})$

c_{s1}' = 0.0145 grains/ACF

V. Emission Rate: (WET)

Q_s = 10516 SCF/min.

$\overset{o}{E}$ = 60 (Q_s) (c_s') lb./7000 grains

$\overset{o}{E}$ = $\frac{60\ (10516)\ (.0337)}{7000}$

$\overset{o}{E}$ = 0.304 lb./hr.

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = .499 inches

A_n = .00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{min.}{sec.})\ [(0.00267\ \frac{in.\ Hg\text{-}cu.\ ft.}{ml.\text{-}^\circ R})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ avg\ P_s A_n}$$

$$I = \frac{114(100)\left\{0.00267(85.3) + \frac{55.74}{543}\left(29.87 + \frac{3.6}{13.6}\right)\right\}}{60(23.05)(29.87)(.00136)}$$

I = 112.9

SUMMARY SHEET OF PARAMETERS

TEST # 2

1. V_{lc} = 85.3 ml.
2. V_m = 55.74 $ft.^3$
3. P_{bar} = 29.87 in. HG
4. T_m = 543 °R
5. T_s = 1146 °R
6. ΔH = 3.6 in. W.G.
7. C_p = 0.81
8. $\sqrt{\Delta P_{avg}}$ = 0.287 $(in. W.G.)^{1/2}$
9. P_s = 29.87 in. HG
10. A_s = 1.767 sq. ft.
11. M_n = 1199 mg. (WET)
12. θ = 60 min.
13. dp = 0.499 in.
14. % CO_2 = 5.3
15. % O_2 = 14.9
16. % CO = 79.8

SUMMARY SHEET OF PARAMETERS

TEST # 3

1. V_{lc} = 70.3 ml.
2. V_m = 59.76 $ft.^3$
3. P_{bar} = 29.87 in. HG
4. T_m = 541 °R
5. T_s = 1195 °R
6. ΔH = 3.2 in. W.G.
7. C_p = 0.81
8. $\sqrt{\Delta P_{avg}}$ = 0.328 $(in. W.G.)^{1/2}$
9. P_s = 29.87 in. HG
10. A_s = 1.767 sq. ft.
11. M_n = 1076 mg.
12. θ = 60 min.
13. dp = 0.499 in.
14. % CO_2 = 5.4
15. % O_2 = 14.9
16. % CO = 79.7

Summary of Calculated Results

Test No. 3

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 333 ml

b. Dry gas volume through meter: $V_{m_{std}}$ = 58.89 cu. ft.

c. Percent Moisture: B_{wo} = 5.4 %

d. Wet Molecular Weight: M_s = 28.84 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 140.59 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 26.80 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1190 SCF_{dg}/min.

2. Q_a = 2841 ACF/min.

IV. Determination of Particulate Concentrations (WET)

a. c'_s = 0.0281 grains/SCF

b. c'_{s1} = 0.0118 grains/ACF

V. Emission Rate (WET)

E = 0.287 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED 3

Gas Analysis: Orsat/Gas Chromatograph

	Orsat	Gas Chromatograph
% CO_2 =		5.4
% O_2 =		14.9
% CO =		<500PPM
% N_2 =		79.7

Dry Molecular Weight: M_d

$M_d = 0.44\ (\%CO_2) + 0.32\ (O_2) + 0.28\ (\%N_2 + \%CO)$

$M_d = 0.44\ (5.4) + 0.32\ (14.9) + 0.28\ (79.7)$

M_d = 29.46

CALCULATIONS

Test No. 3

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

V_f = 251 ml.

V_i = 200 ml.

$V_{s\ gel}$ = 19.3 ml.

V_{lc} = 70.3 ml.

$V_{w_{std}}$ = 0.0474 ft ^{3}/ ml. (V_{lc})

$V_{w_{std}}$ = 0.0474 ft ^{3}/ ml. (70.3)

$V_{w_{std}}$ = 3.33 ft.^{3}

b. Dry gas volume through meter:

V_m = 59.76 ft.^{3}

P_{bar} = 29.87 in HG

T_m = 541 °R

ΔH = 3.2 in W. G.

$V_{m_{std}}$ = (17.71 °R/in HG) V_m ($\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m}$)

$V_{m_{std}}$ = 17.71 (59.76) ($\frac{29.87 + \frac{3.2}{13.6}}{541}$)

$V_{m_{std}}$ = 58.89 SCF_{dg}.

c. Moisture Content:

$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$

$B_{wo} = \frac{3.33}{3.33 + 58.89}$

B_{wo} = 0.054

d. Wet molecular weight:

M_d = 29.46 lb./lb. - mole.

$M_s = M_d(1.-B_{wo}) + 18.(B_{wo})$

M_s = (29.46)(.946) + 18. (.054)

M_s = 28.84 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

P_s = 29.87 in. HG

T_s = 1195 °R

P_{std} = 29.92 in. HG

T_{std} = 530 °R

$V_a = V_{m_{std}} (T_s) (P_{std}) / [1. - B_{wo}) (T_{std}) (P_s)]$

$V_a = \frac{(58.89)}{(.946)} \left(\frac{1195}{530}\right) \left(\frac{29.92}{29.87}\right)$

$V_a =$ 140.59 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

K_p = 85.48 ft./sec. (lb./lb. - mole °R) $^{1/2}$

C_p = 0.81

(T_s) avg = 1195 °R

$(\sqrt{\Delta P})$ avg = 0.328 (in. H_2O) $^{1/2}$

B_{wo} = 0.054

M_s = 28.84 lb./lb. - mole.

P_s = 29.87 in. HG

(V_s) avg = $K_p C_p (\sqrt{\Delta P})$ avg $\sqrt{\frac{(T_s) \text{ avg}}{(P_s)(M_s)}}$

(V_s) avg = 26.80 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

A_s = 1.767 sq. ft.

$Q_s = 60 (1.-B_{wo}) (V_s) \text{avg} A_s (T_{std}/T_{s_{avg}}) (P_s/P_{std})$

Q_s = 1190 SCF_{dg}/min.

2. Actual conditions

$Q_a = (V_s) \text{ avg } A_s \ 60$

$Q_a = (26.80)(1.767)(60)$

Q_a = 2841 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 107.6 mg.

$V_{m_{std}}$ = 58.89 SCF_{dg}

V_a = 140.59 ACF

$c_s' = 0.0154 \text{ grain/mg } (M_n/V_{m_{std}})$

$c_s' = 0.0154 \left(\frac{107.6}{58.89}\right)$

c_s' = 0.0281 grains/SCF

$c_{s1}' = 0.0154 \text{ grain/mg } (M_n/V_a)$

$c_{s1}' = 0.454 \left(\frac{107.6}{140.59}\right)$

c_{s1}' = 0.0118 grains/ACF

V. Emission Rate: (WET)

Q_s = 1190 SCF/min.

$E = 60 (Q_s) (c_s')$ lb./7000 grains

$$\overset{\circ}{E} = \frac{60\ (1190)\ (.0281)}{7000}$$

$$\overset{\circ}{E} = 0.287 \text{ lb./hr.}$$

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = 0.499 inches

A_n = 0.00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{\text{min.}}{\text{sec.}})\ [(0.00267\ \frac{\text{in. Hg-cu. ft.}}{\text{ml.-°R}})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ \text{avg}\ P_s A_n}$$

$$I = \frac{1195(1.667)\left\{.00267(70.3) + \frac{59.76}{54}\left(29.87 + \frac{3.2}{13.6}\right)\right\}}{60(26.80)(.2987)(.00136}$$

I = 107.2

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel Natural Gas

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.51 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\%\ CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(234)(.054) - (7.51)(\quad)}{(234)}$$

= 5.1 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_{s(12\%)} = C_s\left[\frac{12.0}{\%\ CO_2(corr)}\right]$$

$$= (.0251)\left[\frac{12.0}{(5.1)}\right]$$

$C_{s(12\%)}$ = 0.006 gr/SCF_{dg} @ 12% CO_2

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613
(319) 277-2401

METHOD OF CALCULATION

Volume of Stack Gas Sampled at the Meter (SCF)

$$V_{m_{std}} = V_m\left(\frac{T_{std}}{T_m}\right)\left(\frac{P_{atm} + \frac{\Delta H}{13.6}}{P_{std}}\right)$$

$V_{m_{std}}$ = Volume sampled at standard conditions (SCF)

V_m = Volume measured at the meter (ft^3)

T_{std} = Standard temperature (530°R)

T_m = Average temperature at the meter (°R)

P_{atm} = Atmospheric pressure (in Hg)

ΔH = Average orifice differential (in H_2O)

P_{std} = Standard pressure (29.92 in Hg)

Volume of Water Vapor Sampled (SCF)

$$V_{w_{std}} = V_{l_c}(0.0474\ ft^3/ml)$$

$V_{w_{std}}$ = Volume of water vapor sampled st standard conditions (SCF)

V_{l_c} = Volume of condensate collected (ml)

Total Volume Sampled (SCF)

$$V_{Total} = V_{m_{std}} + V_{w_{std}}$$

Proportion by Volume of Water Vapor

$$B_w = \frac{V_{w_{std}}}{V_{Total}}$$

B_w = Proportion of stack gas as water vapor

Dry Molecular Weight of Stack Gas (lb/lb-mole)

$$M_d = (44)(B_{CO_2}) + (32)(B_{O_2}) + (28)(B_{CO}) + (28)(B_{N_2})$$

M_d = Dry molecular weight (lb/lb-mole)

B_{CO_2} = Proportion by volume CO_2 in stack gas

B_{O_2} = Proportion by volume O_2 in stack gas

B_{CO} = Proportion by volume CO in stack gas

B_{N_2} = Proportion by volume N_2 in stack gas

Molecular Weight of Stack Gas (lb/lb-mole)

$$M = M_d(1 - B_w) + 18(B_w)$$

M = Molecular weight of stack gas (lb/lb-mole)

M_d = Dry molecular weight

B_w = Proportion by volume of water vapor

Stack Gas Velocity (ft/sec)

$$V_s = CpKp\sqrt{\frac{T_s}{M \times P_s}} \times \sqrt{\Delta p}$$

V_s = Stack gas velocity (ft/sec)

Cp = Pitot tube correction factor (dimensionless)

Kp = Constant 85.48 ft/sec (lb/lb-mole = °R)1/2

T_s = Average stack gas temperature (°R)

M = Molecular weight of stack gas (lb/lb-mole)

P_s = Stack pressure (in Hg)

p = Square root of velocity pressure

Stack Gas Velocity at Standard Conditions (ft/sec)

$$V_{s_{std}} = 17.71 \frac{°R}{\text{in Hg}} \left(\frac{V_s P_s}{T_s}\right)$$

$V_{s_{std}}$ = Stack gas velocity at 70°F and 29.92 in Hg (ft/sec)

V_s = Stack gas velocity (ft/sec)

P_s = Stack pressure (in Hg)

T_s = Average stack gas temperature (°R)

Stack Gas Flow Rate (SCFH)

$$Q_s = 3600(1-B_w) \times V_{s_{std}} \times A_s$$

Q_s = Stack gas flow rate (SCF/hr)

$V_{s_{std}}$ = Stack gas velocity at standard conditions (ft/sec)

B_w = Proportion by volume of water vapor

A_s = Area of the stack (ft^2)

Particulate Concentration (lb/SCF)

$$C_s = 2.205 \times 10^{-6} \text{ lb/mgm} \left(\frac{M_n}{V_{Total}}\right)$$

C_s = Particulate concentration (lb/SCF)

M_n = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Mass Flow Rate (lb/hr)

$$Q_p = Q_s \times C_s$$

Q_p = Particulate mass flow rate (lb/hr)

Q_s = Stack gas flow rate (SCF/hr)

C_s = Particulate concentration (lb/SCF)

Particulate Concentration: Sample Concentration Method (gr/SCF)

$$c_s' = 0.0154 \text{ gr/mgm}\left(\frac{Mn}{V_{Total}}\right)$$

c_s' = Particulate concentration (gr/SCF)

M_n = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Concentration: Ratio of Areas Method (gr/SCF)

$$c_s = (2.57 \times 10^{-4} \frac{\text{gr=min}}{\text{mgm-sec}})\left(\frac{Mn}{\theta\ V_{s_{std}}\ A_n}\right)$$

c_s = Particulate concentration (gr/SCF)

M_n = Total particulate mass collected (mgm)

θ = Total sampling time (min)

$V_{s_{std}}$ = Stack gas velocity at standard conditions (ft/sec)

A_n = Area of the sampling nozzle (ft^2)

Average Particulate Concentration (gr/SCF)

$$c_{ave} = \frac{c_s' + c_s}{2}$$

Percent of Isokinetic Sampling

$$I = \frac{c_s}{c_s'} \times 100$$

Prepared and Submitted by

CORNING LABORATORIES, INC.

PROJECT 224H1

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
27.12	29.10	0.96	520.35	48.50	0.074	0.112	0.000	0.814

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1209.67	29.15	0.212	3.14	169.9	50.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
26.92	2.29	29.22	0.078	29.63	28.71	17.64

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.53	78427.	0.0000128	1.0	0.089	0.085	0.087	95.0

PROJECT 224H-2

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
34.57	29.16	1.15	527.00	54.50	0.075	0.114	0.000	0.811

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1393.87	29.21	0.22	3.14	164.4	60.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
33.97	2.58	36.58	0.070	29.65	28.83	19.95

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.40	77792.	0.0000099	0.7	0.069	0.069	0.069	100.7

PROJECT 224H-3

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
38.08	29.18	1.33	526.00	52.80	0.073	0.117	0.000	0.810

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1375.00	29.23	0.236	3.14	172.8	60.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
37.53	2.50	40.04	0.062	29.63	28.90	20.84

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.84	83162.	0.0000095	0.7	0.066	0.069	0.067	104.1

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613
(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
TEST #1

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	26.92
V_m	Volume measured at the meter (ft^3)	27.12
T_m	Temperature at the meter (°R)	520.35
P_{atm}	Atmospheric pressure (in Hg)	29.10
ΔH	Average orifice differential (in H_2O)	0.96
V_{wstd}	Volume of water vapor sampled (SCF)	2.29
Vl_c	Volume of condensate collected (ml)	0.126
V_{Total}	Total volume sampled (SCF)	29.22
B_w	Proportion by volume of water vapor	0.078
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.63
B_{CO_2}	Proportion by Volume CO_2 in stack gas	0.074
B_{O_2}	Proportion by Volume O_2 in stack gas	0.112
B_{CO}	Proportion by Volume CO in stack gas	000
B_{N_2}	Proportion by Volume N_2 in stack gas	0.814
M	Molecular weight of stack gas (lb/lb-mole)	28.71
V_s	Stack gas velocity (ft/sec)	17.64
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1209.67
P_s	Stack pressure (in Hg)	29.15
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	0.212
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.53
Q_s	Stack gas flow rate (SCF/hr)	78427
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	1.13
M_n	Total particulate mass collected (mgm)*	149.9
Q_p	Particulate mass flow rate (lb/hr)	.88
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	0.079
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	0.075
θ	Total sampling time (min)	50
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	0.077
I	Percent of isokinetic sampling	95.0

Particulate Mass Breakdown

1	Before Filter (mgm)	44.8
2	Filter (mgm)	41.8
3	After Filter (mgm)	14.9
4	Impingers	48.4
	TOTAL (mgm)	149.9

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
MODEL HR500 TEST #1

NOMENCLATURE		VALUE
M_s	Mass emission rate (1b/100 1b refuse burned)	0.23
CR	Charging rate (100 1b/hr)	3.80
$C_{s_{dry}}$	Particulate Concentration, dry basis (1b/SCF)	6.54×10^{-6}
$M_{n_{dry}}$	Dry Particulate Mass collected (mgm)*	86.6
$Q_{P_{dry}}$	Particulate mass flow rate dry basis (1b/hr)	.51
$C'_{s_{dry}}$	Particulate concentration dry basis. Sample Concentration Method (gr/SCF)	.046
$M_{s_{dry}}$	Mass emission rate, dry basis (1b/100 1b refuse burned)	.134
$C'_{s_{CO_2}}$	Particulate concentration corrected to 12% CO_2 Sample Concentration Method (gr/SCF)	.128
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 sample concentration Method (gr/SCF)	.074

*Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
TEST #2

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	33.97
V_m	Volume measured at the meter (ft^3)	34.57
T_m	Temperature at the meter (°R)	527.00
P_{atm}	Atmospheric pressure (in Hg)	29.16
ΔH	Average orifice differential (in H_2O)	1.15
V_{wstd}	Volume of water vapor sampled (SCF)	2.58
Vl_c	Volume of condensate collected (ml)	.086
V_{Total}	Total volume sampled (SCF)	36.55
B_w	Proportion by volume of water vapor	.070
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.65
B_{CO_2}	Proportion by Volume CO_2 in stack gas	.075
B_{O_2}	Proportion by Volume O_2 in stack gas	.114
B_{CO}	Proportion by Volume CO in stack gas	.000
B_{N_2}	Proportion by Volume N_2 in stack gas	.811
M	Molecular weight of stack gas (lb/lb-mole)	28.83
V_s	Stack gas velocity (ft/sec)	19.95
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1393.87
P_s	Stack pressure (in Hg)	29.21
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	.224
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.4
Q_s	Stack gas flow rate (SCF/hr)	77792
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	9.9×10^{-6}
M_n	Total particulate mass collected (mgm)*	164.4
Q_p	Particulate mass flow rate (lb/hr)	0.7
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	.069
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	.069
θ	Total sampling time (min)	60
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	.069
I	Percent of isokinetic sampling	100.7

Particulate Mass Breakdown

1	Before Filter (mgm)	28.4
2	Filter (mgm)	51.5
3	After Filter (mgm)	16.3
4	Impingers	68.2
	TOTAL (mgm)	164.4

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
MODEL HR500 TEST #2

NOMENCLATURE		VALUE
M_s	Mass emission rate (lb/100 lb refuse burned)	0.184
CR	Charging rate (100 lb/hr)	3.8
$C_{s_{dry}}$	Particulate Concentration, dry basis (lb/SCF)	4.8×10^{-6}
$M_{n_{dry}}$	Dry Particulate mass collected (mgm)*	79.9
$Q_{p_{dry}}$	Particulate mass flow rate dry basis (lb/hr)	.375
$C'_{s_{dry}}$	Particulate concentration dry basis: Sample Concentration Method (gr/SCF)	.034
$M_{s_{dry}}$	Mass emission rate, dry basis (lb/100 lb refuse burned)	.098
$C'_{s\ CO_2}$	Particulate concentration corrected to 12% CO_2 Sample Concentration method (gr/SCF)	.11
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 sample concentration method (gr/SCF)	.054

* Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
Test #3

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	37.53
V_m	Volume measured at the meter (ft^3)	38.08
T_m	Temperature at the meter (°R)	526
P_{atm}	Atmospheric pressure (in Hg)	29.18
ΔH	Average orifice differential (in H_2O)	1.33
V_{wstd}	Volume of water vapor sampled (SCF)	2.50
Vl_c	Volume of condensate collected (ml)	52.8
V_{Total}	Total volume sampled (SCF)	40.04
B_w	Proportion by volume of water vapor	.062
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.63
B_{CO_2}	Proportion by Volume CO_2 in stack gas	.073
B_{O_2}	Proportion by Volume O_2 in stack gas	.117
B_{CO}	Proportion by Volume CO in stack gas	.000
B_{N_2}	Proportion by Volume N_2 in stack gas	.810
M	Molecular weight of stack gas (lb/lb-mole)	28.90
V_s	Stack gas velocity (ft/sec)	20.84
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1375.0
P_s	Stack pressure (in Hg)	29.23
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	.236
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.84
Q_s	Stack gas flow rate (SCF/hr)	83162
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	9.5×10^{-6}
M_n	Total particulate mass collected (mgm)*	172.8
Q_p	Particulate mass flow rate (lb/hr)	0.7
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	.066
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	.069
θ	Total sampling time (min)	60
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	.067
I	Percent of isokinetic sampling	104.1

Particulate Mass Breakdown

1	Before Filter (mgm)	43.9
2	Filter (mgm)	32.2
3	After Filter (mgm)	45.4
4	Impingers	51.2
	TOTAL (mgm)	172.8

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
TEST #3

NOMENCLATURE		VALUES
M_s	Mass emission rate (lb/100 lb refuse burned)	.184
CR	Charging rate (100 lb/hr)	3.8
$C_{s_{dry}}$	Particulate Concentration, dry basis (lb/SCF)	4.19×10^{-6}
$M_{n_{dry}}$	Dry Particulate mass collected (mgm)*	76.1
$Q_{p_{dry}}$	Particulate mass flow rate dry basis (lb/hr)	.349
$C'_{s_{dry}}$	Particulate concentration dry basis: Sample Concentration method (gr/SCF)	.029
$M_{s_{dry}}$	Mass emission rate, dry basis (lb/100 lb refuse burned)	.092
$C'_{s_{CO_2}}$	Particulate concentration corrected to 12% CO_2 Sample Concentration Method (gr/SCF)	.113
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 Sample concentration method (gr/SCF)	.048

* Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

#1

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 3-12-73

Test No. 224 81

Barometric Pressure 29.10

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.4
O_2	18.6
~~N_2~~ CO	18.6

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	074	3.26
O_2	32	.112	3.58
CO	28	0	0
N_2	28	.814	22.79
	Md =		29.63

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$M = M_d(1-B_w) + 18\ B_w$

$M =$ _____

```
      INTEGER DESC(8)
      REAL MD,M,I,MN
 1001 READ(2,100)DESC,VM,PATM,DH ,TM,V1C,BCO2,BO2,BCO,BN2
  100 FORMAT( 8A1,5F8.2,4F8.3)
      READ(2,200)DESC,CP    ,TS,PS,DP,AS,MN,THETA,AN
  200 FORMAT(8A1,3F8.2,F8.3,F8.2,2F8.1,F9.7)
      VMSTD = (17.71 * VM * (PATM + (DH / 13.6))) / TM
      VWSTD = V1C * .0474
      VTOT = VMSTD + VWSTD
      BW  = VWSTD / VTOT
      MD = (44.* BCO2) + (32. * BO2) + ( 28. * BCO) + ( 28. * BN2)
      M = (MD * (1-BW)) + (18 * BW)
      VS = CP * 85.48 *(SQRT(TS /(M*PS))) *      (DP)
      VSSTD = (17.71 * VS * PS) / TS
      QS = (3600 * (1-BW)) * VSSTD * AS
      CCS= .000002205 * (MN/VTOT)
      QP = QS * CCS
      CS1 = .0154 * (MN / VTOT)
      CS =   .000257 * (MN / (THETA * VSSTD * AN))
      CAVE = (CS1 + CS) / 2
      I  = (CS / CS1) * 100
      WRITE(3,600)DESC
  600 FORMAT(1H1,40X,'PROJECT'3X,8A1,///)
      WRITE(3,10)
   10 FORMAT(7X'VM'7X'PATM'8X'DH'7X'TM'7X'V1C'7X'BCO2'        7X'BO2'7X'B
     1CO'7X'BN2')
      WRITE(3,20)VM,PATM,DH,TM,V1C,BCO2,BO2,BCO,BN2
   20 FORMAT(1X,5(2X,F8.2),4(2X,F8.3),///)
      WRITE(3,30)
   30 FORMAT(7X'CP'7X'TS'7X'PS'7X'DP'7X'AS'7X'MN'5X'THETA'7X'AN')
      WRITE(3,40)CP,TS,PS,DP,AS,MN,THETA,AN
   40 FORMAT(1X3(1X,F8.2),1X,F8.3,F8.2,2(1X,F8.1),6X,F9.7,/////)
      WRITE(3,500)
  500 FORMAT(9X'VMST'7X'VWSTD'6X'VTOTAL'8X'BW'10X'MD'10X'M'11X'VS')
      WRITE(3,300)VMSTD,VWSTD,VTOT,BW,MD,M,VS
  300 FORMAT(1X,3F12.2,F12.3,3F12.2,///)
      WRITE(3,700)
  700 FORMAT(1X,8X,'VSSTD'06X'QS'9X'CCS'12X'QP'9X 'C1S'10X'CS'9X'CAVE',
     19X'I')
      WRITE(3,400)VSSTD,QS,CCS,QP,CS1,CS,CAVE,I
  400 FORMAT(1X,F12.2,F12.0,F12.7,F12.1,3F12.3,F12.1)
      CALL DATSW(1,ICODE)
      GO TO(1000,1001),ICODE
 1000 CALL EXIT
      END

FEATURES SUPPORTED
 ARITHMETIC TRACE
 ONE WORD INTEGERS
 EXTENDED PRECISION
 IOCS

CORE REQUIREMENTS FOR
 COMMON       0  VARIABLES     118  PROGRAM     620

 END OF COMPILATION
```

SEPARATOR

32-00038

AIR

PERMITS

06/04/1975

0247-AI

June 4, 1975

Dr. Gray's Hospital
477 E. Main Street
Batesville, Arkansas 72501

Gentlemen:

This is to inform you that your permit application dated May 8, 1975 for the installation and operation of the incinerator as listed in the permit application was approved at the last regular Commission meeting of the Department of Pollution Control and Ecology.

This approval is given in accordance with the information submitted in the permit application and with the stipulations that emissions from the incinerator meet Subsection 4(a) of the Arkansas Air Pollution Control Code at all times.

This letter will serve as a temporary permit until such time that a regular permit is received and as such does not relieve the holder of his responsibilities to the Arkansas Air Pollution Control Code.

Sincerely,

S. Ladd Davies
Director

SLD/dm

cc/ Alan B. Peterson
Fire Engineers Inc.

DEPARTMENT OF POLLUTION CONTROL AND ECOLOGY
D.A.P.C.

SUMMARY REPORT RELATIVE TO PERMIT APPLICATION

SUBMITTED BY: Dr. Gray's Hospital

477 E. Main Street, Batesville, Arkansas

CSN:

FIRST SUBMITTAL: May 8, 1975 AMENDED:

CASE REFERENCES:

SUMMARY: Dr. Gray's Hospital in Batesville proposes to install a pathological incinerator (Fire Engineer Model HR-300) to burn 600 lbs. of type 0 and type IV wastes. The incinerator has a rated capacity of 260 lbs/hr and will be operated for 3 hrs/day. The test data submitted with the application shows the particulate emissions to be 0.061 gr/scf at 12% CO_2.

ESTIMATED COST: $9,146 TOTAL PROJECT: $ 9,146

COMMENCEMENT OF INSTALLATION:

DATE OF COMPLIANCE: GIVEN: SET:

REVIEWED BY: IB APPROVED: JES

RECOMMENDATION: Approval

ASSIGNED PERMIT NUMBER: 247-AI

COMMISSION MINUTE ORDER NUMBER:

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

December 13, 1973

Mr. Al Peterson
Fire Engineers, Inc.
900 Southgate Office Plaza
Minneapolis, Minnesota 55431

Dear Mr. Peterson,

The enclosed report concerns the performance of your Model HR 500 as tested on April 12, 1973. This report was prepared by Corning Laboratories, Incorporated of Cedar Falls, Iowa for review by the Minnesota Pollution Control Agency.

As tested, the unit meets the requirements of the common wealth of Virginia for incinerators buring type "O" waste. That requirement being 0.14 gr/SCF, as calculated from dry catch and corrected to 12% CO_2.

Cordially,

Kenneth E. Storms

Kenneth E. Storms
Project Engineer

KES:nh
224-H

Addendum to Model HR-500 Incinerator Test Data, April 12, 1973

I. CO_2 Produced by burners V_b, scfm

A. Net heat of combustion of natural gas is 1050 BTU/Ft^3

B. One Ft^3 of natural gas produces 1.08 cubic feet of CO_2 (70° F., 29.92 In. Hg.)

$$V_b = \frac{(250{,}000 \text{ BTU/HR}) (1.08 \text{ Ft}^3 \text{ CO}_2/\text{Ft}^3 \text{ Fuel})}{(1050 \text{ BTU/Ft}^3 \text{ Fuel}) (60 \text{ Min/Hour})}$$

$$V_b = 4.29 \text{ SCFM } CO_2$$

II. CO_2 produced by waste only, V_{wo}, % (Run #1)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\% CO_2) - (V_b) (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{78{,}427}{60} (7.4) - (4.29) (100)}{\frac{78{,}427}{60}}$$

$$V_{wo} = \frac{9672.69 - 429}{1307.12}$$

$$V_{wo} = 7.07\%$$

III. Particulate Concentration - Sample concentration

Method - Corrected to 12% CO_2 from waste, gr/ft^3 at 12% CO_2 (Run #1)

Dry Catch at dry standard conditions, gr/ft^3@12% CO_2

$$C_{ce} = \frac{(C_{cc}) (12)}{V_{wo}} = \frac{(0.079) (12)}{7.07}$$

$$= 0.134 \text{ GR/SCF}_{dg}@12\% \text{ CO}_2$$

IV. CO_2 produced by waste only, V_{wo}, % (Run #2)

$$V_{wo} = \frac{(Q_{sd}{}_{std}) (\% CO_2) - V_b (\theta_b)}{Q_{sd}{}_{std}}$$

$$V_{wo} = \frac{\frac{77792}{60} (7.5) - (4.29) (100)}{\frac{77792}{60}}$$

$$V_{wo} = \frac{1296.53 (7.5) - 429}{1296.53}$$

$$V_{wo} = 7.17\%$$

V. Particulate Concentration - Sample concentration method
Corrected to 12% CO_2 from Waste - gr/ft^3 at 12% CO_2 (Run #2)
Dry Catch at dry standard conditions, gr/ft^3@ 12% CO_2

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.069)\ (12)}{7.17}$$

$$= 0.116\ Gr/SCF_{dg}\ @\ 12\%\ CO_2$$

VI. CO_2 produced by waste only, V_{wo}% (Run #3)

$$V_{wo} = \frac{(Q_{sd}\ _{std})\ (\%\ CO_2) - (V_b)\ (\theta_b)}{Q_{sd}\ _{std}}$$

$$V_{wo} = \frac{\frac{83162}{60}\ (7.3) - (4.29)\ (100)}{\frac{83162}{60}}$$

$$V_{wo} = \frac{1386.03\ (7.3) - 429}{1386.03}$$

$$V_{wo} = 6.99\%$$

VII. Particulate Concentration - Sample Concentration
Method - Corrected to 12% CO_2 from Waste - gr/Ft^3 at 12% CO_2 (Run #3)

$$C_{ce} = \frac{(C_{cc})\ (12)}{V_{mo}} = \frac{(0.066)\ (12)}{6.99}$$

$$= 0.113\ GR/SCF_{dg}\ @\ 12\%\ CO_2$$

SUMMARY

	RUN #1	RUN #2	RUN #3	AVERAGE
Particulate Concentration: Sample Concentration Method (GR/SCF)	0.079	0.069	0.066	0.071
Stack Gas Flow Rate (SCF/HR)	78,427	77,792	83,162	79,794.67
Particulate Concentration Sample Conc. Method - Corrected to 12% CO_2 Dry Basis (GR/SCF)	0.134	0.116	0.113	0.121

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota.

Jerry W. Saddler

Jerry W. Saddler, P.E.
Date of Certification: March 11, 1974
Minnesota Registration No. 8951

Arkansas Pollution Control Commission
8001 National Drive
Little Rock, Arkansas 72209

Application for Permit to Construct, or Alter, and Operate an Incinerator

1. Name of Owner (Firm Name) Dr. Gray's Hospital

2. Address of Owner 477 East Main Street, Batesville, Arkansas 72501

3. Address of Installation Same

4. General Nature of Business Hospital

5. Incinerator: X New _____ Reconstruction

6. Incinerator: Make Fire Engineers Model HR-300 Class III

Rated Capacity 260 lbs/hr. cost $9146.40

7. Type of Waste (see attached code): "0"

Source of Waste: General room waste

Daily Amounts: 600 Lbs. X actual ____ estm.

Incinerator Operated 3 hours per day

8. Combustion Chambers: Primary Volume 56.89 cu. ft.
Secondary Volume 60.45 cu. ft.

9. Grate: Area 9.86 sq. ft. Burning Rate 26.37 lbs./sq.ft/hour

10. Auxiliary Burners:

Primary Chamber Burner: Type and Make Power - Hauck

Fuel Natural Gas Rating 500,000 BTU/hr.

Secondary Chamber Burner: Type and Make Power - Barber

Fuel Natural Gas Rating 750,000 BTU/hr.

11. Stack: Materials Stl Jacket & Rfty Height above grade 32.2 ft.

Dimensions 20"I.D. x 24" Velocity 21.72 ft/sec.

12. Spark Arrestor: Materials Stainless Steel Dimensions 3/8" x 3/8" open x 24" High

13. Dampers: Type Barometric Dimensions 14" I.D.

14. Draft: X Natural ____ Induced ____ Forced ____ CFM at ____ °F

15. Describe additional automatic or air pollution controls ____

Combustion Air Blower (see below)

16. Total Particulate Emissions: 0.061 grains/dSCF at 12% CO_2

17. Attach test data of similar unit simulating firing as proposed by application.

18. Attach drawings and specifications of incinerator.

19. Attach drawings of proposed incinerator location showing distances to all adjacent properties, all structures within 150 feet, and zoning of the area.

20. Signature of owner or authorized agent

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson, Authorized Agent

Signature of person preparing report

Alan B. Peterson

Name and Title (printed or typed)

Alan B. Peterson

Environmental Engineer

Incinerator is also factory prewired and prepiped requiring only final field connections to assure proper hookup.

ARKANSAS POLLUTION CONTROL COMMISSION
AIR POLLUTION CONTROL
PERMIT NO. 247-AI
Date May 8, 1975
Approved May 30, 1975

Classification of Wastes to be Incinerated

Type of Waste	Description of Waste
0	Trash- A mixture of highly combustible waste, primarily paper, cardboard, wood boxes, and combustible floor sweepings.
1	Rubbish - A mixture of combustible waste such as paper, cardboard, woodscrap, foliage, floor sweepings, and up to 20% cafeteria waste.
2	Refuse -- An even mixture by weight of rubbish and garbage
3	Gargage -- Animal and vegetable waste from restaurants, cafeterias, hotels, etc.
4	Pathological Waste -- Human and animal remains consisting of carcasses, organs, and solid organic wastes from hospitals, laboratories, etc.
5	Gaseous, liquid, or semi-liquid waste such as tar, paints, solvents, sludge, fumes, etc. from industrial operations.
6	Solid waste, such as rubber, plastics, wood waste, etc. from industrial operations.

RESULT OF SOURCE EMISSION TESTS
CONDUCTED ON
FEI MODEL HR500 INCINERATOR
LOCATED AT
FEI PLANT IN ARLINGTON, MINNESOTA
FOR
FEI CORP. OF MINNEAPOLIS, MINNESOTA
MAY 2, 1973

Prepared and Submitted by
CORNING LABORATORIES, INC.

Kenneth E Storms

May 21, 1973
nh 224H

Kenneth E. Storms
Project Engineer

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

TABLE OF CONTENTS

		Page No.
I	Introduction	1
II	Data Summary	2
III	Sampling and Analytical Techniques	5
IV	Calculations and Data	11
V	Field Data Sheets	23

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

INTRODUCTION

This report covers particulate emission tests made on model HR500 incinerator manufactured by the FEI Corporation of Minneapolis, Minnesota. A total of three sampling runs were conducted on April 12, 1973. The tests were conducted by Corning Laboratories, Inc., of Cedar Falls, Iowa. The unit tested was located at the FEI Plant on Highway 5 North of Arlington, Minnesota. The sampling equipment and procedures used conformed to procedures outlined in Volume 36, Number 247 of the "Federal Register". The unit tested was a horizontal, retort type incinerator with forced air in the secondary chamber. The incinerator is served by a variable burner, 0-750,000 BTU, set at 250,000 BTU. The unit had a 25 foot, 24 inch I.D. refractory stack. Two three inch I.D. sampler ports were located about 15 feet above the barometric damper.

Each test measured stack gas flow rate, stack gas composition, particulate concentration and mass flow rate. Velocity pressure valves were recorded at 1.5 minute intervals. Stack temperatures were recorded at 3 minute intervals, and all other data were recorded at 5 minute intervals. The unit was preheated prior to testing, and preliminary velocity and temperature traverses were conducted to determine the size of the sampling nozzle. Waste was weighed and charged manually at a rate of 380 pounds per hour.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

DATA SUMMARY

A summary of selected data and results is enclosed on the following page. Copies of the computer printout sheets, nomenclature sheets, and field data sheets are enclosed in the "Data and Calculations" section of this report.

In this report, "Particulate" includes everything caught on and before the filter plus the organic extract from the impinger as outlined in Method five of Volume 36, Number 159 of the "Federal Register". Results reported on a "Dry Basis" include only material collected before and on the filter in the EPA Sampling Train. Material which passes through the filter is considered to be "condensables" and is not reported as dry particulates.

Particulate concentrations are reported on a total and dry basis at standard conditions, and corrected to 12% CO_2. Particulate mass flow rates are reported on a total and dry basis in pounds per hour and pounds per 100 pounds of refuse burned.

Difficulties in sampling occurred near the end of test number one. As a result sampling was terminated after 10 points had been tested. Paragraph 2.13 on page 24882 of Volume 36, Number 247 of the

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

"Federal Register", December 23, 1971, states that in stack having a diameter of 2 feet or less it is necessary to sample only 2/3 of the usual number of points.

DATA SUMMARY
FEI CORP. MODEL HR500 INCINERATOR
APRIL 12, 1973

	RECORDED VALUES		
	Test #1	Test #2	Test #3
Total Volume Sampled (SCF)	29.22	36.55	40.04
Proportion by Volume as Water Vapor	.078	.070	.062
Proportion by Volume as CO_2	.074	.075	.073
Molecular Weight of Stack Gas (lb/lb-mole)	28.71	28.83	28.90
Average Stack Gas Temperature (°R)	1209.67	1393.87	1375.0
Stack Gas Velocity at Standard Conditions (ft/sec)	17.64	19.95	20.84
Stack Gas Flow Rate (SCF/hr)	78427	77792	83162
Percent of Isokinetic Sampling	95	100.7	104.1
Particulate Mass Flow Rate (lb/hr)	1.0	0.7	0.7
Charging Rate (100 lb/hr)	3.8	3.8	3.8
Mass Emission Rate (lb/100 lb charged)	0.23	.184	.184
Particulate Concentration: Sample Conc. Method (gr/SCF)	.079	.069	.066
Particulate Concentration Corrected to 12% CO_2 (gr/SCF)	0.128	0.110	0.113
Particulate Mass Flow Rate, Dry Basis (lb/hr)	0.510	.373	.349
Mass Emission Rate, Dry Basis (lb/100 lb. charged)	0.134	0.098	.092
Particulated Concentration, Dry Basis, S.C.M.: (gr/SCF)	.046	0.034	.029
Particulate concentration corrected to 12% CO_2, dry basis (gr/SCF)	.074	0.054	.048

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

SAMPLING AND ANALYTICAL TECHNIQUES

The equipment used for this sampling program was the Model AP-5000 Stac-O-Lator manufactured by Scientific Glass Blowing of Houston, Texas. It conforms to specifications outlined in "Construction Details of Isokinetic Source Sampling Equipment, APTD-0581." A schematic diagram of the equipment is shown in Figure 1.

The sample train consists of a stainless steel probe tip, an insulated quartz probe encased in an inconel sheath, a miniature glass cyclone and collection flask, a five inch diameter Gelman Type A glass fiber filter, a series of four Smith-Greenburg impingers, a leakless vacuum pump, a dry gas meter, and a calibrated orifice. The probe, cyclone and flasks, filter holder, impingers and connecting tubes are all glass. Connections are made by glass ball and socket joints. The quartz probe is wrapped with nichrome heating wire so the gas temperature in the probe can be maintained above 250°F. Also, the cyclone and the filter holder are contained in a heated chamber where the temperature was maintained above 250°F. The four impingers are in an ice bath to maintain a gas temperature of 70°F or less as it leaves the last impinger. The first, third, and fourth impingers are modified by replacing the high velocity tip with a 1/2 inch I.D. glass tube.

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

The first and second impingers are initially filled with 100 milliliters each of distilled water. The third impinger is left dry, and the fourth impinger contains 200 grams of dry silica gel.

Stack temperature at the sampling point is measured by a thermocouple attached to the pitot tube. Temperatures in the probe, the heated filter box, the impinger effluent, and the inlet and outlet of the dry gas meter are also measured by thermocouples connected to a digital temperature indicator. Velocity pressure was measured by a calibrated, S-type pitot tube connected to an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Orifice meter pressure differential was measured by an inclined/vertical manometer with an inclined range of 0.000 to 1.000 inches of water and a vertical range of 1.0 to 5.0 inches of water. Before use, the dry gas meter and orifice meter were calibrated according to procedures outlined in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

During the sampling period, the sampling rate was adjusted to maintain isokinetic sampling conditions. At isokinetic conditions, the velocity of the stack gas entering the sampling nozzle should be equal to the stack gas velocity at the sampling point. These conditions were maintained by adjusting the pressure drop across the orifice meter in relation to the stack gas velocity pressure. The proper orifice differential was determined by using the nomographs

as specified in Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576.

The sampling was conducted through two three-inch I.D. sample ports positioned at 90° to each other. Samples were collected at six sample points along each of the two diameters. The location of the sample points was determined by Method 1, "Federal Register," Vol. 36, No. 247. Orstat grab samples were collected during the test and analyzed to determine proportions of CO_2, O_2 and CO.

After each test, the probe, cyclone and flask, and the front half of the filter holder wer washed with acetone and the washings collected in glass storage containers. The filters were removed from the filter holder, folded and placed in envelopes. The water in the first two impingers was removed and the volume of the condensate determined. The back half of the filter holder, the first three impingers, and the connecting glassware were washed with distilled water and acetone. These washings were also collected in glass storage containers. The silica gel in the fourth impinger was removed and placed in glass storage containers.

Laboratory analysis consisted of determining the weight of particulate matter collected on the filter, in the condensate, and in the various acetone washings. Also, weight gain of the silica gel was determined. The filters were descicated and weighed to constant weight, ($\pm$0.50 milligrams). The acetone washings were evaporated at room temperature

and pressure, descicated and weighed to a constant weight. The condensate and water washings were extracted with chloroform and ethyl ether. The chloroform-either extract was evaporated to dryness at room temperature and pressure, descicated and weighed to constant weight as per Vol. 36, Number 159 of the "Federal Register."

Complete descriptions of the sampling equipment, sampling procedures, and analytical procedures can be found in the following publications:

Construction Details of Isokinetic Source-Sampling Equipment, APTD-0581, U.S. Environmental Protection Agency, April, 1971.

"Federal Register," Volume 36, Number 159, August 17, 1971.

"Federal Register," Volume 36, Number 247, December 23, 1971.

Maintenance, Calibration, and Operation of Isokinetic Source Sampling Equipment, APTD-0576, March, 1972.

Specifications for Incinerator Testing at Federal Facilities, U.S. Department of Health, Education, and Welfare, October, 1967.

PARTICULATE SAMPLING TRAIN
NOMENCLATURE

1. Stainless Steel Nozzle
2. Stainless Steel Union Coupling
3. Heated Glass Probe and Sheath
4. Cyclone and Flask
5. Fiberglass and Filter Holder
6. Electrically Heated Enclosure
7. Ice Bath
8. Modified Greenburg-Smith Impinger, with 100 ml distilled water
9. Greenburg-Smith Impinger, with 100 ml distilled water
10. Modified Greenburg-Smith Impinger, dry
11. Modified Greenburg-Smith Impinger, with dry silica gel
12. Dial Thermometers
13. Check Valve
14. Vacuum Tubing
15. Vacuum Gauge
16. Valve
17. Leakless Vacuum Pump
18. By-Pass Valve
19. Dry Gas Meter
20. Calibrated Orifice
21. Manometer
22. S-Type Pitot Tube

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

DATA AND CALCULATIONS

The major portions of the calculations were conducted by IBM 1130 computer. The program and the data readout sheets are enclosed in this section. Values not calculated by computer include: particulate concentrations and mass flow rates on a dry basis, particulate concentrations and mass flow rates corrected for 12% CO_2, and emission rates in pounds per 100 pounds of refuse burned. The formulas for these calculations are as follows:

Mass Emission Rate (lb/100 lb refuse burned)

$$M_s = \frac{Qp}{CR}$$

M_s = Mass emission rate (lb/100 lb of refuse burned)

Q_p = Particulate mass flow rate (lb/hr)

CR = Charging rate (100 lb/hr)

Particulate Concentration, Dry Basis (lb/SCF)

$$C_{s_{dry}} = 2.205 \times 10^{-6} \text{ lb/mgm} \left(\frac{M_{n_{Dry}}}{V_{Total}}\right)$$

$C_{s_{dry}}$ = Particulate concentration (lb/SCF)

Mn_{dry} = Total Particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Mass Flow Rate, Dry Basis (lb/hr)

$$Q_{p_{dry}} = Q_s \times C_{s_{dry}}$$

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

$Q_{p_{dry}}$ = Particulate mass flow rate (lb/hr)

Q_s = Stack gas flow rate (SCF/hr)

$C_{s_{dry}}$ = Particulate concentration (lb/SCF)

Particulate Concentration, Dry Basis: Sample Concentration Method (gr/SCF)

$$c'_{s_{dry}} = 0.0154 \text{ gr/mgm}\left(\frac{M_{n_{dry}}}{V_{Total}}\right)$$

$c'_{s_{dry}}$ = Particulate concentration (gr/SCF)

$M_{n_{dry}}$ = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Mass Emission Rate, Dry Basis (lb/100 lb refuse burned)

$$M_{s_{dry}} = \frac{Q_{p_{dry}}}{CR}$$

$M_{s_{dry}}$ = Mass emission rate on a dry basis (lb/100 lb refuse burned)

$Q_{p_{dry}}$ = Particulate mass flow rate, dry basis (lb/hr)

CR = Charging rate (100 lb/hr)

Particulate Concentration, Corrected to 12% CO_2 Sample Concentration Method (gr/SCF)

$$c'_{s_{CO_2}} = \frac{c'_{s} \times .12}{B_{CO_2}}$$

$c'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 (gr/SCF)

c'_s = Particulate concentration: Sample Conc. Method (gr/SCF)

B_{CO_2} = Proportion by volume of CO_2 in stack gas.

Particulate Concentration, Dry Basis: Corrected to 12% CO_2: Sample Concentration Method (gr/SCF)

$$c'_{s_{dry/CO_2}} = \frac{c'_{s\ dry} \times 0.12}{B_{CO_2}}$$

$c'_{s_{dry/CO_2}}$ = Particulate concentration, dry basis; corrected to 12% CO_2: Sample Conc. Method (gr/SCF)

$c'_{s_{dry}}$ = Particulate concentration, dry basis; Sample Conc. Method (gr/SCF)

B_{CO_2} = Proportion by volume of CO_2 in stack gas

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets. Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO THE REPORT ON
MODEL HR500 INCINERATOR
TEST DATED APRIL 12, 1973

This addendum is issued to correct the stack gas composition for the CO_2 generated by the burner in the incinerator. Since no direct measurement of CO_2, due to the burner, was made during the test, the volume of CO_2 generated must be calculated. The corrected CO_2 concentration will be representative of the CO_2 produced by the waste only.

METHODS OF CALCULATION

V_b = Volume of CO_2 produced by the burners (SCFH)

(A) Net heat of combustion of Natural Gas is 1050 BRU/Ft^3
(B) One ft^3 of natural gas produced 1.08 ft^3 of CO_2 at STP

$$V_b = \frac{(250{,}000 \text{ BTU/hr})(1.08 \text{ ft}^3\text{CO}_2/\text{ft}^3 \text{ fuel})}{(1050 \text{ BTU/ft}^3 \text{ fuel}}$$

V_b = 257.14 SCFH CO_2

V_{WO} = Percent of CO_2 in stack gas produced by the waste

$$V_{WO} = \frac{(\dot{Q}s)(^{B}CO_2) - (V_b)}{(Qs)} \times 100$$

Q_s = Stack gas flow rate (SCF/hr)

$^{B}CO_2$ = Proportion by Volume of CO_2

V_b = Volume of CO_2 produced by burners

$C'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 from waste, sample concentration method (gr/SCF).

$$C'_{s_{CO_2}} = \frac{C'_s \times 12}{V_{WO}}$$

C'_s = Particulate concentration, sample conc. method (gr/SCF)

V_{WO} = Percent CO_2, by volume, produced by waste only

	V_b SCF/hr	V_{WO}, %	C'_s CO_2 gr/SCF
Run #1	257.14	7.07	0.134
Run #2	257.14	7.17	0.116
Run #3	257.14	6.99	0.113

$C'_{s_{CO_2}}$ = Particulate concentration corrected to 12% CO_2 from waste, sample concentration method (gr/SCF).

$$C'_{s_{CO_2}} = \frac{C'_s \times 12}{V_{WO}}$$

C'_s = Particulate concentration, sample conc. method (gr/SCF)

V_{WO} = Percent CO_2, by volume, produced by waste only

	V_b SCF/hr	V_{WO}, %	C'_s CO_2 gr/SCF
Run #1	257.14	7.07	0.134
Run #2	257.14	7.17	0.116
Run #3	257.14	6.99	0.113

TEST NO. 224-H-1 UNIT TYPE ARSCO

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Arlington Minn

OBSERVER: Ken Storms DATE 4-16-73

TEST NO. 224-H-2 UNIT TYPE HR500

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Arlington Minn

OBSERVER: Ken Storms DATE 4-16-73

TEST NO. 224-H-3 UNIT TYPE HR500

PLUME OBSERVATION RECORD FORM

LONG TERM OBSERVATIONS

	0	15	30	45		0	15	30	45
0	0	0	0	0	30	0	0	0	0
1	0	0	0	0	31	0	0	0	0
2	0	0	0	0	32	0	0	0	0
3	0	0	0	0	33	0	0	0	0
4	0	0	0	0	34	0	0	0	0
5	0	0	0	0	35	0	0	0	0
6	0	0	0	0	36	0	0	0	0
7	0	0	0	0	37	0	0	0	0
8	0	0	0	0	38	0	0	0	0
9	0	0	0	0	39	0	0	0	0
10	0	0	0	0	40	0	0	0	0
11	0	0	0	0	41	0	0	0	0
12	0	0	0	0	42	0	0	0	0
13	0	0	0	0	43	0	0	0	0
14	0	0	0	0	44	0	0	0	0
15	0	0	0	0	45	0	0	0	0
16	0	0	0	0	46	0	0	0	0
17	0	0	0	0	47	0	0	0	0
18	0	0	0	0	48	0	0	0	0
19	0	0	0	0	49	0	0	0	0
20	0	0	0	0	50	0	0	0	0
21	0	0	0	0	51	0	0	0	0
22	0	0	0	0	52	0	0	0	0
23	0	0	0	0	53	0	0	0	0
24	0	0	0	0	54	0	0	0	0
25	0	0	0	0	55	0	0	0	0
26	0	0	0	0	56	0	0	0	0
27	0	0	0	0	57	0	0	0	0
28	0	0	0	0	58	0	0	0	0
29	0	0	0	0	59	0	0	0	0

LOCATION: Rt. Tom Minn

OBSERVER: Ken Storms DATE 4-16-73

PARTICULATE EMISSION EVALUATION

FOR

F.E.I. CORPORATION

INCINERATOR MODEL RR3 (MOD)

at

F.E.I. BOAZ PLANT

BOAZ, ALABAMA

3/27/73

TYPE 0 WASTE

Submitted by:

Air Quality Testing & Design, Inc.
Post Office Box 76121
Atlanta, Georgia 30328

John J. Halligan, P. E.
Director of Engineering

Robert J. Labbe
Senior Test Engineer

I. Table of Contents
II. Introduction
III. Summary of Results
IV. Description of Installation
V. Sampling and Analytical Procedures
VI. Appendix

II. INTRODUCTION

The purpose of these source emission tests conducted at the F.E.I. Corporation, Boaz, Alabama plant on April 27, 1973 was to determine the outlet particulate emission of an F.E.I. incinerator, Model RR3 (MOD)

The F.E.I. Boaz plant is located at 655 Denson Road, Boaz, Alabama and is a part of the F.E.I. Corporation located at 900 Southgate Office Plaza, Minneapolis, Minnesota 55437.

The tests were performed under the supervision of Mr. John J. Halligan P. E., Director of Engineering and Mr. Robert J. Labbe, Chief Engineer of Air Quality Testing & Design, Incorporated, 175 West Wieuca Road, N. E., Atlanta, Georgia 30342.

AQT&D, Inc., would like to take this opportunity to extend its appreciation for the valuable assistance of F.E.I. Corporation personnel, Mr. Jerry Saddler, Mr. Lloyd Johnson and Mr. Don Noel, Plant Manager; and to Mr. Jack Smith of the Alabama Air Pollution Control Commission, in making these tests a success.

III. SUMMARY OF RESULTS

The summary of results, as illustrated in tabular form in Table I, demonstrate consistency and reproducibility of measured and calculated results. The emission values of Run 1 are, however, higher when the wet catch (condensible solids) are included. This may be due in part to curing the refractory of the incinerator during the first test. It can be seen from Table I that the emission results are within the allowable emissions as stated in the Georgia Department of Natural Resources document Rules and Regulations for Air Quality Control, Chapter 270-5-24, dated March 13, 1972. The standards for incinerator particulate emissions are cited on page 7, Item 2(c) (ii), of the above document and require that no greater than 0.1 grains per standard dry cubic foot gas, calculated to 12 percent carbon dioxide be emitted to the atmosphere.

IV. DESCRIPTION OF INSTALLATION

An F.E.I. Corporation Model RR3 (MOD) vertical design type incinerator was evaluated. An auxillary burner was used to complete combustion of primary chamber exhaust products. This burner used natural gas and had a rated capacity of 400,000 BTU/Hour as specified by the F.E.I. Corporation.

The incinerator was charged with "Type 0" waste at a rate of 260 lb./hour. The charging procedure was to input 13 lb. charges at three (3) minute time intervals. Each repetition was initiated from a cold start. There were no unusual operating conditions and no changes made in the incinerator operation for the purpose of testing.

V. SAMPLING AND ANALYTICAL PROCEDURE

The sampling train used for determining particulate emissions meets

Table I

Summary of Test Results

	Test No. 1	2	3
Sampling Time (minutes)	60	60	60
Volume Sampled (AFC)	1284.4	1273.0	1405.4
Volume Sampled (SCF_{dg})	61.21	54.78	58.89
Percent Moisture (% by vol.)	5.7	6.8	5.4
Total Sample Weight (mg)	1311	932	666
Volume Flow Rate, Q_s, (SCF_{dg}/min)	1147	1052	1190
Volume Flow Rate, Q_a, (ACF/min)	2407	2443	2841
Particulate Concentration (gr/ACF)	0.0157	0.0113	0.0073
Particulate Concentration (gr/SCF_{dg})	0.0330	0.0262	0.0174
Particulate Concentration (gr/SCF_{dg} @ 12% CO_2)	0.079	0.063	0.041
Particulate Emission Rate, (#/hr.)	0.324	0.236	0.178
Isokinetic Value, I (dimensionless)	115.6	112.9	107.2
Process Input Weight Rate	260	260	260
Allowable Particulate Emission Rate			

The above emission results are based on a dry catch. Results indicated below are based on total catch (including condensible solids/wet catch)

Particulate Concentration (gr/ACF)	0.0227	0.0145	0.0118
Particulate Concentration (gr/SCF_{dg})	0.0477	0.0337	0.0281
Particulate Concentration (gr/SCF_{dg} @ 12% CO_2)	0.114	0.081	0.066
Particulate Emission Rate, (#/hr.)	0.469	0.304	0.257
TOTAL SAMPLE W/ (mg)	1896	1199	1076

all requirements as published in the Federal Register, Volume 36, Number 247, Part II, dated December 23, 1971. *Enclosed is descriptive literature.*

The isokinetic sampling condition obtained in each of the repetitions and given in the Summary of Tabulated Results, Table I, are within ± 10 percent of the required value of 100.

The analytical procedures conform with those outlined in the Federal Register and are described in complete detail in the Appendix.

Preliminary Test Data

1. Size of Duct: 18 inches
2. Area of Duct: 1.767 sq. ft.
3. Stack Height: ≈ 30 ft.
4. Test Port Data:
   (a) Diameter: 3 inches
   (b) Extension: 3 inches
   (c) Upstream Disturbance ($\frac{L}{D}$): 8
   (d) Downstream Disturbance ($\frac{L}{D}$): 2
5. Number of Traverse Points: 24
6. Minimum Required Number of Traverse Points: 12

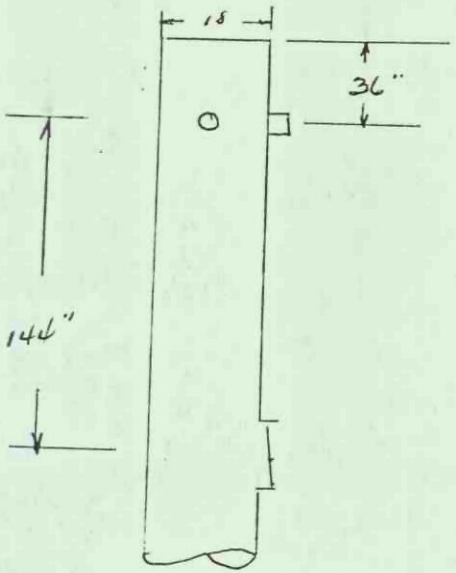

Model RR3(1160) Stack

Plant KET Corp
Run number Base Rea
Location
Date 3/31/73
Operator Lucchesi/Hummel
Sample box number 1
Meter box number 1

FEI-Bath
RR3-(1160)
24 Point Traverse
Velocity Survey

Ambient temperature, °F 72
Barometric pressure, in. Hg 29.87
Assumed moisture, % —
Heater box setting, °F —
Probe tip diameter, in. —
Probe length, ft. —
Probe heater setting —
Cp = 0.87

Point	Traverse Location / Clock time	Dry gas meter, ft3	Pitot, in. H2O Δp	Orifice ΔH, in. H2O Desired	Orifice ΔH, in. H2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	Stack pressure, in. Hg	Stack temperature, °F
1	0.375		0.06									
2	1.21		0.91									
3	3.13		2.03									
4	3.18		2.15									
5	4.50		2.15									
6	6.39		2.15									
7	11.61		2.15									
8	13.56		2.15									
9	14.82		2.15									
10	15.83		2.15									
11	16.74		2.11									
12	17.44											
1	—		—									
2												
3												
4												
5												
6												
7												
8												
9												
10												
11												
12			—									

Comments:

PARTICULATE FIELD DATA

Client FET

Plant Arlington

Date 4-12-73

Test No. 224B-3

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 50

Barometric Pressure 29.18

Assumed Moisture 10%

Nozzle Dia. 0.50

filter No. 48
Initial wt 2334gm
Initial Vol 200 ml

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft³)	Gas Sample Volume Final (ft³)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	700/690	.03	.60	791.211	793.67	66	67
2	5	695/840	.05	1.05	793.67	796.40	65	67
3	5	841/845	.06	1.35	796.40	799.57	66	67
4	5	920/940	.08	1.9	799.57	803.26	66	66
5	5	920/995	.08	1.9	803.26	807.00	68	67
6	5	1010/965	.05	1.05	807.00	809.98	68	66
7	5	880/850	.03	.60	809.98	812.28	67	65
8	5	840/825	.05	1.05	812.28	815.15	67	65
9	5	910/840	.06	1.35	815.15	817.78	68	65
10	5	1060/1070	.08	1.9	817.78	822.45	68	64
11	5	1060/1060	.08	1.9	822.45	826.29	69	64
12	5	1060/1015	.06	1.35	826.29	829.49	69	65
	60	915		1.35	38.08		66	

STACK GAS VELOCITY

Client FEC

Plant Pinkerton

Stack

Date 4-12-93

Test No. 2246-3

Stack Diameter 24"

Barometric Pressure 29.18

Static Pressure in Stack

Pitot Tube Correction Factor 0.81

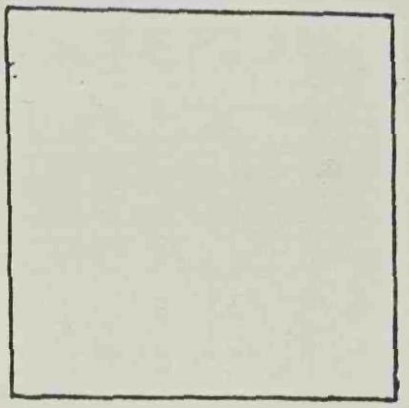

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.03	.03	.03			173	173	173		.519
2	.05	.05	.05			224	224	224		.671
3	.06	.06	.06			245	245	245		735
4	.08	.08	.08			283	283	283		848
5	.08	.08	.08			283	283	283		.848
6	.05	.05	.05			224	224	224		.671
7	.03	.03	.03			173	173	173		519
8	.05	.05	.06			173	173	245		591
9	.07	.06	.06			264	245	245		754
10	.08	.08	.08			283	283	283		848
11	.08	.08	.08			283	283	283		848
12	.06	.06	.05			245	245	224		714
								236		

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 1-12-73

Test No. 224-A-3

Barometric Pressure 29.16

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.3
O_2	10.0
~~CO~~	1.9

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	.073	3.12
O_2	32	.117	3.74
CO	28	000	000
N_2	28	.810	22.68
	Md =		29.54

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$M = M_d(1-B_w) + 18\ B_w$

$M =$ _____

STACK GAS VELOCITY

Client FEI

Plant Arlington

Stack

Date 4-12-73

Test No. 224 G-1

Stack Diameter 24"

Barometric Pressure 29.10

Static Pressure in Stack 29.15

Pitot Tube Correction Factor 0.81

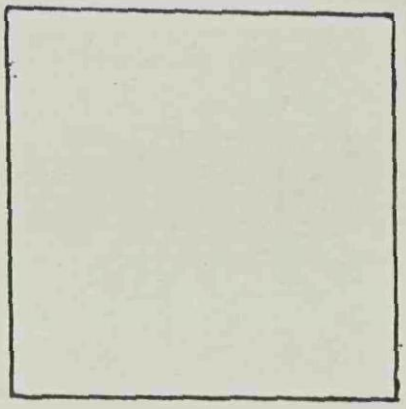

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.02	.025	.02			.141	.158	.141		440
2	.03	.03	.03			173	173	173		519
3	.04	.04	.04			.200	.200	.200		.600
4	.07	.07	.06			265	265	245		775
5	.07	.06	.04			265	245	245		755
6	.05	.05	.035			224	224	187		625
7	.03	.03	.03			173	173	173		519
8	.04	.04	.04			.2	.2	.2		.600
9	.055	.055	.055			235	235	235		704
10	.07	.07	.08			265	265	283		815
11										
12										
						.212				

A 19/3 min
3.0

PARTICULATE FIELD DATA

Client FEI

Plant Arington

Date 4-12-77

Test No. 2249-1

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 56

Barometric Pressure 29.10

Assumed Moisture 10 %

Nozzle Dia. 0.5

Filter No. 46
Initial wt 200 gm
Intial Vol 100 ml

756.45

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft^3)	Gas Sample Volume Final (ft^3)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	617/703	.02	.38	728.98	731.02	57	57
2	5	675/673	.03	.60	731.02	733.70	58	56
3	5	702/840	.04	.85	733.70	735.80	57	59
4	5	754/870	.04	.85	735.80	738.98	60	57
5	5	1020/940	.06	1.40	738.98	742.42	62	58
6	5	850/1400	.045	.95	742.40	745.41	65	60
7	5	800/575	.03	.60	745.41	747.62	63	63
8	5	600/686	.04	.85	747.62	750.13	62	61
9	5	665/700	.055	1.2	750.13	753.04	63	62
10	5	790/820	.08	1.9	753.01	756.1	65	62
11	~~5~~							
12	~~5~~							
					27.12		60.35	
50 min		749.67		.96				

STACK GAS VELOCITY

Client _____

Plant _____

Stack _____

Date 4-12-73

Test No. 224-G-2

Stack Diameter 24"

Barometric Pressure 29.16

Static Pressure in Stack _____

Pitot Tube Correction Factor 0.81

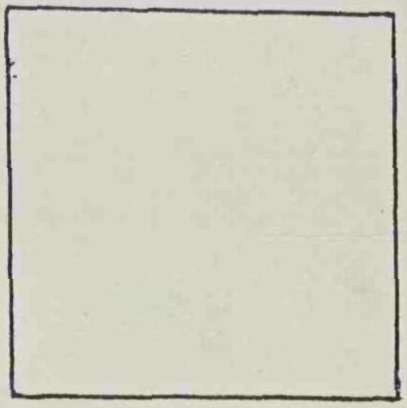

Schematic of Stack Cross Section

Traverse Point Number	Velocity Head in H_2O				$\sqrt{\Delta p}$	Stack Temperature °F				
1	.02	.02	.02			.141	.141	.141		.424
2	.03	.03	.03			.173	.173	.173		.519
3	.04	.04	.05			.20	.20	.224		.624
4	.07	.07	.07			265	265	265		.794
5	.07	.06	.07			265	245	265		.775
6	.05	.04	.05			224	.20	224		.648
7	.03	.03	.03			.173	.173	173		520
8	045	.05	.05			212	224	224		660
9	.06	.06	.06			245	245	245		735
10	.08	.07	.08			283	265	283		.830
11	.08	.08	.08			283	283	283		849
12	.05	.06	.05			224	245	224		683
							224			

#2

PARTICULATE FIELD DATA

Client FEI

Plant Arlington

Date 4-12-73

Test No. 2244-2

Meter ΔH@ 1.79

Cp 0.81

Ambient Temp 66

Barometric Pressure 29.96

Assumed Moisture 10%

Nozzle Dia. .50

Filter #47
Initial wt 200
Initial wt 200

Traverse Point Number	Sampling Time (min)	Stack Temp (°F)	Velocity Head (Δp)	Orifice Diff (ΔH)	Gas Sample Volume Initial (ft^3)	Gas Sample Volume Final (ft^3)	Temp at Meter Inlet (°F)	Temp at Meter Outlet (°F)
1	5	970/1000	.02	.38	756.84	758.60	65	66
2	5	685/744	.03	.60	758.60	760.91	66	66
3	5	804/780	.04	.81	760.91	763.47	66	64
4	5	940/886	.07	1.6	763.47	766.78	67	66
5	5	960/990	.07	1.6	766.78	770.12	67	65
6	5	890/980	.05	1.05	770.82	772.94	69	65
7	5	840	.05	1.05	772.94	775.20	69	65
8	5	900/940	.05	1.05	775.20	777.89	69	65
9	5	910/985	.06	1.35	777.89	781.06	70	66
10	5	1040/990	.08	1.90	781.06	784.68	71	66
11	5	1040/1090	.08	1.9	784.68	788.41	72	66
12	5	975/1030	.05	1.05	788.41	791.41	73	67
		93387		1.15	34.57		67	

#2

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 4-12-7?

Test No. 224-2

Barometric Pressure 29.16

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.5
O_2	18.9
~~N_2~~ CO	18.9

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	.075	3.3
O_2	32	.114	3.53
CO	28	0	
N_2	28	.811	22.71
	Md =		29.59

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$$M = M_d(1 - B_w) + 18\ B_w$$

M = _____

3/27/73

Sample Laboratory Data

Filter Data

Run No.	Ini. Weight	Final Weight	Net Weight
1	0.7494	0.8544	0.1050 Grams
2	0.7504	0.8238	0.0734
3	0.7297	0.7734	0.0437
4			

Probe Wash Data

1	1.1358	1.1619	0.0261 Grams
2	1.2231	1.2433	0.0202
3	1.2166	1.2395	0.0229
4			

Condensible Solid Data

1	81.5898	81.6483	0.0585 Grams
2	84.4194	84.4461	0.0267
3	78.4260	78.4670	0.0410
4			

Summary of Sample Laboratory Data

Run No.	Filter	Probe	Condensible Solid	Net Total
1	0.1050	0.0261	0.0585	0.1896 Grams
2	0.0730	0.0202	0.0267	0.1199
3	0.0437	0.0229	0.0410	0.1076
4				

3/27/73

Moisture Laboratory Data

Silica Gel Data

Run No.	Ini. Weight	Final Weight	Net Weight
1	200	218.0	18.0 ml.
2	200	225.3	25.3
3	200	219.3	19.3
4			

Impinger Data

Run No.	Ini. Volume	Final Volume	Net Volume
1	200	266.	66 ml.
2	200	260	60
3	200	251	51
4			

Summary of Moisture Laboratory Data

Run No.	Silica Gel	Impinger	Net Total
1	18.0	60	78.0 ml.
2	25.3	60	85.3
3	19.3	51	70.3
4			

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel Natural Gas

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.5 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\% CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(2444)(.153) - (7.5)(\quad)}{(2444)}$$

= 5.0 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_{s(12\%)} = C_s\left[\frac{12.0}{\% CO_2(corr)}\right]$$

$$= (.0337)\left[\frac{12.0}{(5)}\right]$$

$C_{s(12\%)}$ = 0.081 gr/SCF_{dg} @ 12% CO_2

Plant Test Corp.
Run number 2
Location Exit
Date 3/27/73
Operator Williams/Knapp
Sample box number 1
Meter box number 1

Ambient temperature, °F 72°F
Barometric pressure, in. Hg 29.87
Assumed moisture, % 5%
Heater box setting, °F 250°F
Probe tip diameter, in. 0.520
Probe length, ft. 5'-0"
Probe heater setting 250°F

Orifice ΔH = 1.5" I.D.

Point	Clock time	Dry gas meter, ft^3	Pitot, in. H_2O ΔP	Orifice ΔH, in. H_2O Desired	Orifice ΔH, in. H_2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	Stack pressure, in. Hg	Stack temperature, °F
Start 1		73.67										
2												
3												
4												
5												
6												
7												
8												
9												
10												
11												
12												
1												
2	3:41			1.75	1.74	64	84	5.9	231	124	30.1	256
3	3:46					65	84	6.0	232	124	30.1	264
4	3:51					65	84	6.1	232	125	30.1	266
5	3:56					65	84	6.1	232	124	33.2	270
6	4:01					65	84	6.1	232	125	33.2	267
7	4:06					65	84	6.1	232	126	33.2	263
8	4:11					65	84	6.1	232	126	33.2	260
9	4:16					65	84	6.1	232	126	33.2	257
10	4:21					65	84	6.1	232	126	33.2	260
11	4:26					65	84	6.1	232	126	33.2	260
12	4:31					65	84	6.1	232	126	33.2	260
	4:36	78.51										

Comments:

Plant FEL CORP. 13#/3MIN
Run number 3
Location PALM BEACH
Date 3/27/73
Operator HALLIGAN & LABBE
Sample box number 1
Meter box number 1
400,000 BTU/HR

PARTICULATE TEST

Ambient temperature, °F 72.00
Barometric pressure, in. Hg 29.87
Assumed moisture, % 5
Heater box setting, °F 250°F
Probe tip diameter, in. 0.500
Probe length, ft. 5'-0"
Probe heater setting 250°F

PITOT

Point	Clock time	Dry gas meter, ft³	Pitot, in. H₂O ΔP	Orifice ΔH, in. H₂O Desired	Orifice ΔH, in. H₂O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	~~Stack~~ pressure, ~~in. Hg~~	Stack temperature, °F
1												
2	4:35	77394	0.08	25	25	86	87	6.8	178	87	293	545
3	4:38	79754	0.08	25	25	85	84	6.8	180	85	280	505
4	4:41	80326	0.09	27	27	85	85	6.9	191	85	261	485
5	4:44	80803	0.10	31	31	85	85	7.2	193	86	260	615
6	4:47	80384	0.10	31	31	85	85	7.5	196	87	275	709
7	4:50	80206	0.12	38	38	84	86	9.0	201	91	288	746
8	4:54	81300	0.13	40	40	83	84	9.3	211	93	241	709
9	4:57	81619	0.13	40	40	83	82	9.3	209	98	255	750
10	5:00	81951	0.13	40	40	81	83	9.3	211	100	283	805
11	5:02	82203	0.12	38	38	81	81	9.2	208	101	288	786
12	5:05	82486										
1												
2	5:20	82486	0.07	20	20	80	80	6.0	190	103	255	684
3	5:23	82783	0.09	26	26	80	82	6.2	192	102	246	640
4	5:26	83021	0.09	26	26	79	77	6.2	210	103	255	715
5	5:29	83312	0.10	28	28	79	79	6.3	215	105	291	773
6	5:32	83549	0.11	32	32	78	78	7.5	229	104	290	732
7	5:35	83834	0.12	35	35	77	79	7.6	218	105	341	924
8	5:38	84130	0.135	38	38	75	78	8.8	216	105	312	803
9	5:41	84452	0.14	39	39	76	76	8.9	214	104	316	931
10	5:44	84765	0.13	36	36	75	76	8.8	214	104	321	932
11	5:47	85077	0.11	30	30	76	76	8.6	213	104	314	847
12	5:50	85370										

Comments:
TOO MANY LEAKS

TEST PARTICIPANTS
FROM
AIR QUALITY TESTING & DESIGN, INC.

1. John J. Halligan, P.E., Director of Engineering
2. Robert J. Labbe, Chief Engineer

Nomenclature

A_s	Cross-sectional area of stack, $ft.^2$
A_n	Cross-sectional area of nozzle, sq. ft.
ACF	Actual cubic feet of gas at stack conditions
ACFM	Actual cubic feet of gas per minute at stack conditions
B_{wo}	Proportion by volume of water vapor in the gas stream dimensionless
c'_s	Concentration of particulate matter in stack gas, gr/SCF_{dg}
c'_{sl}	Concentration of particulate matter in stack gas, gr/ADF
C_p	Pitot tube coefficient of Type S pitot tube
H	Average pressure drop across the orifice meter, inches H_2O
dp	Probe diameter, inches
(P) avg	Average velocity head of stack gas, inches H_2O
Q_E	Particulate emission rate, lb./hr.
K_p	Constant
M_d	Dry molecular weight, lb./lb.-mole
M_s	Molecular weight of stack gas (wet basis)
M_n	Total amount of particulate matter collected, mg
I	Percent Isokinetic Sampling
P_{bar}	Barometric pressure at orifice meter, inches HG
P_m	Barometric pressure at dry gas meter, inches HG
P_s	Absolute stack gas pressure, inches HG
P_{std}	Absolute pressure at standard conditions, 29.92 inches HG
Q_a	Volumetric flow rate, actual conditions ACF/min.
Q_s	Volumetric flow rate, dry basis, standard conditions SCF_{dg}/min.

Nomenclature (continued)

SCF_{dg}	Standard cubic feet of dry gas corrected to 70°F, 29.92 inches HG & dry
T_m	Average dry gas temperature at meter, °R
T_s	Absolute average stack gas temperature °R
T_{std}	Absolute temperature at standard conditions, 530 °R
θ	Total sampling time, minutes
V_a	Stack gas volume sampled, ACF
V_f	Final volume of impinger contents, ml.
V_i	Initial volume of impinger contents, ml.
V_{lc}	Total volume of liquid collected in impingers and silica gel, ml.
V_m	Volume of gas sample through the dry gas meter, (meter conditions), cu. ft.
$V_{m_{std}}$	Volume of gas sample through the dry gas meter, (standard conditions), cu. ft.
$V_{s\ gel}$	Equivalent volume of H_2O absorbed at std. conditions.
$V_{w_{std}}$	Volume of water vapor in the gas sample (standard conditions), cu. ft.

V. APPENDIX A

FIELD/LAB DATA AND CALCUATIONS

SUMMARY SHEET OF PARAMETERS

TEST # 1

1.	V_{lc}	=	78.0 ml.
2.	V_m	=	61.76 $ft.^3$
3.	P_{bar}	=	29.87 in. HG
4.	T_m	=	538 °R
5.	T_s	=	1047 °R
6.	ΔH	=	3.2 in. W.G.
7.	C_p	=	0.81
8.	$\sqrt{\Delta P_{avg}}$	=	0.297 $(in. W.G.)^{1/2}$
9.	P_s	=	29.87 in. HG
10.	A_s	=	1.767 sq. ft.
11.	M_n	=	189.6 mg. (WET)
12.	θ	=	60 min.
13.	dp	=	0.499 in.
14.	% CO_2	=	5.3
15.	% O_2	=	15.0
16.	% CO	=	79.7

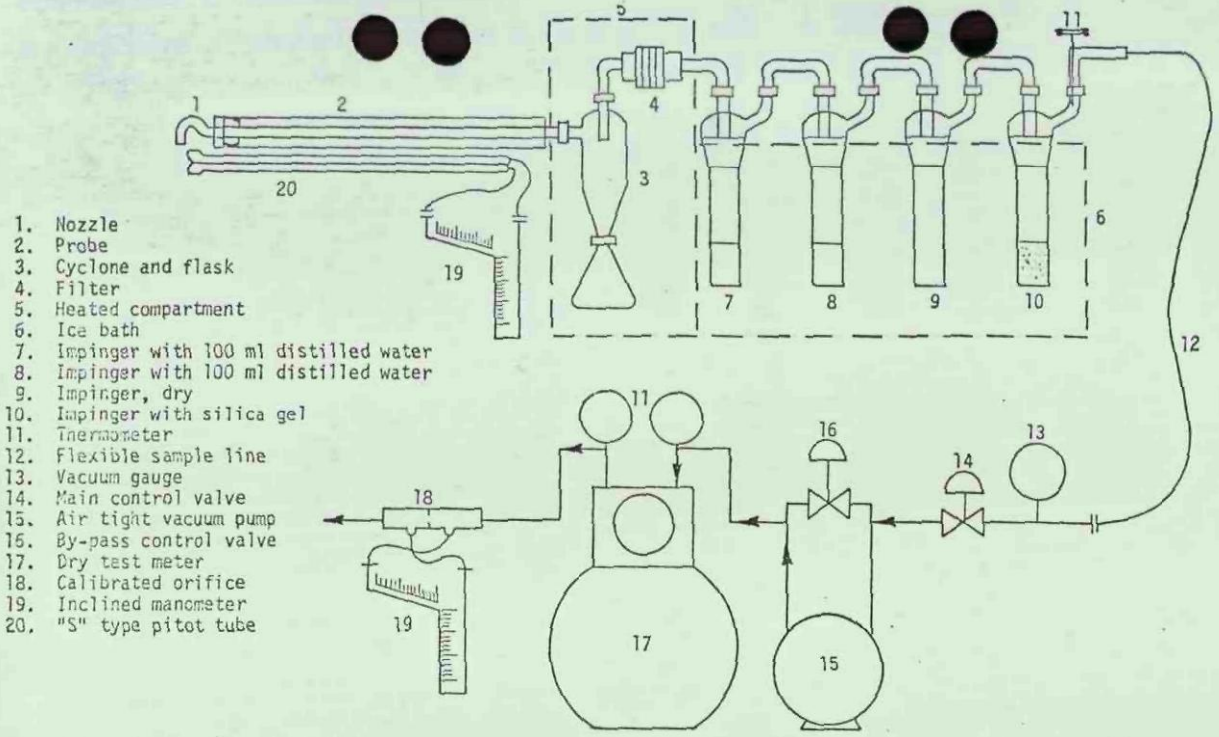

PARTICULATE SAMPLING TRAIN

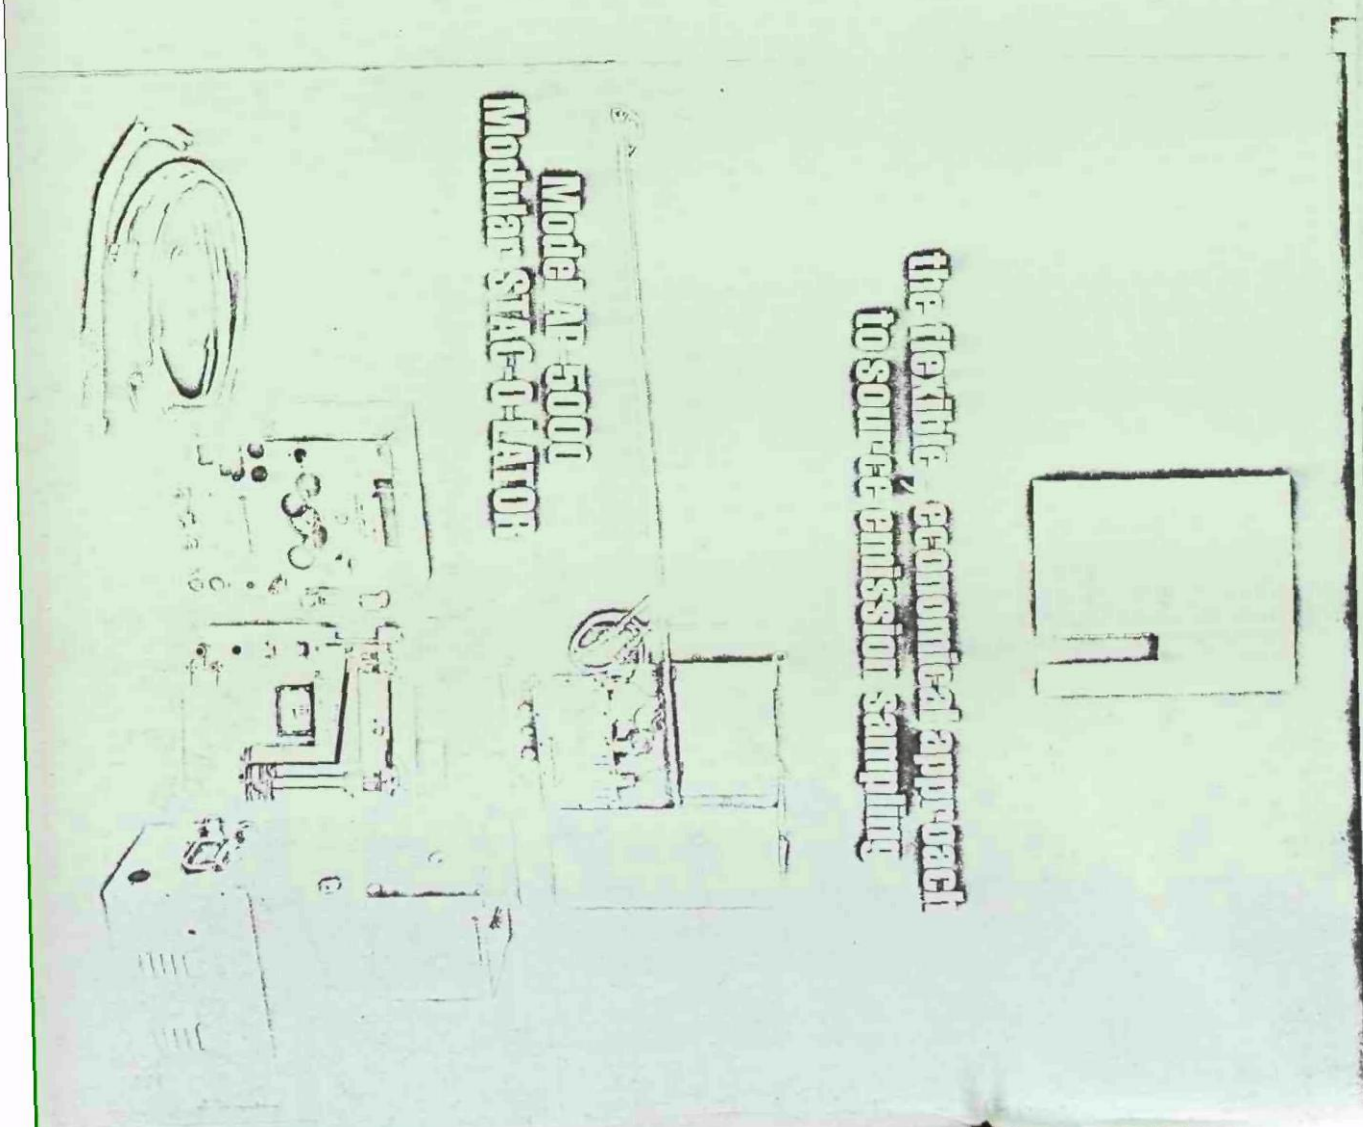

Model AP–5000 Modular STAC·O·LATOR™ represents a whole new concept in air pollution sampling instrumentation. Based on a building-block arrangement of individual components designed to handle specific stack emissions tests, the AP–5000 easily adapts to any or all of the E.P.A./A.P.C.O. requirements in Vol. 36, No. 247 of the *Federal Register*. In addition, the unit is capable of sampling for hazardous air pollutants from stationary sources in accordance with the methodology set forth by E.P.A./A.P.C.O. in Vol. 36, No. 234 of the *Federal Register*.

Development of the AP–5000 evolved from the need for having a *single* instrument capable of performing the wide variety of stack emissions tests now required by law. Without this new modular unit, as many as *seven* different instruments could be required in order to comply with new stack sampling regulations. Obviously, initial expense and problems in transporting to and from sampling locations would be prohibitive. SGB's new modular unit is the product of many varying ideas and concepts developed during actual sampling of sources by governmental agencies, consulting engineering firms and various private industries and has been thoroughly evaluated for the past year. It retains all the outstanding basic design features of its widely used predecessor, the STAC·O·LATOR,™ such as SGB's patented filter device that provides positive entrapment of solid particulate with a choice of different size filters; single-point data acquisition capability; ground to stack communications; variable timing mechanism; ground level temperature control requiring no thermostat; simplified monorail suspension for easier sampling and a special Nomograph accessory for fast calculation of velocities. Additional state-of-the-art improvements in the new system make operation even easier than before, assuring total source testing capability at minimum cost plus extreme accuracy in temperature and gas measurements.

Control Unit

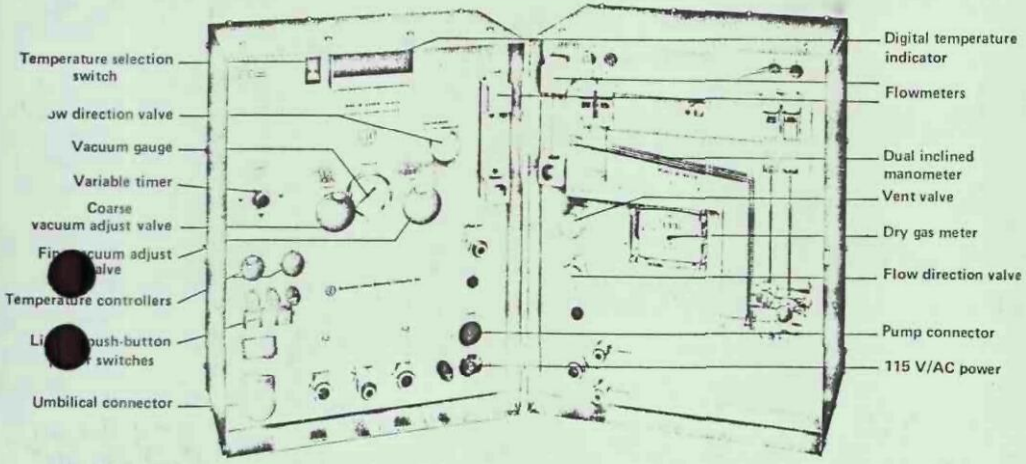

The Control Unit, which is operated at ground level, contains all controls and monitoring devices for isokinetic sampling. Total weight has been reduced to only 40 pounds and center hinges added so that the two compartments close in suitcase-like fashion for protection during transport. The unit's features include a 0·5 inch H_2O Dual-Inclined Manometer, Digital Temperature Indicator (DTI) that gives instant readout of any of 6 temperature points, and stainless steel cabinetry construction. Optional equipment allows the ground operator to have telephone communications with the stack and gives stack operator an alarm signal at the end of each sampling point period.

Ordering information:

Control Unit	Part No. 5000–3

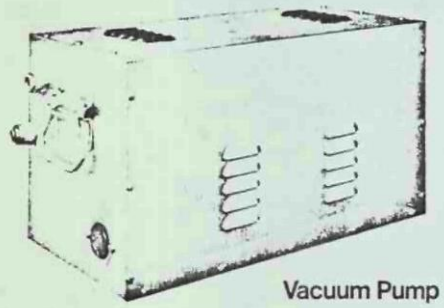

Vacuum Pump

The Vacuum Pump is now a separate component, self-contained in its own stainless steel carrying case. By removing the pump from control unit electronics, SGB has eliminated heat build-up errors and, at the same time, given customers a single pump for various applications. The Vacuum Pump is rated at 4 CFM at 0" Hg.

Ordering information:

Pump and Case	Part No. 5000–PC



Nomograph Part No. 1002N

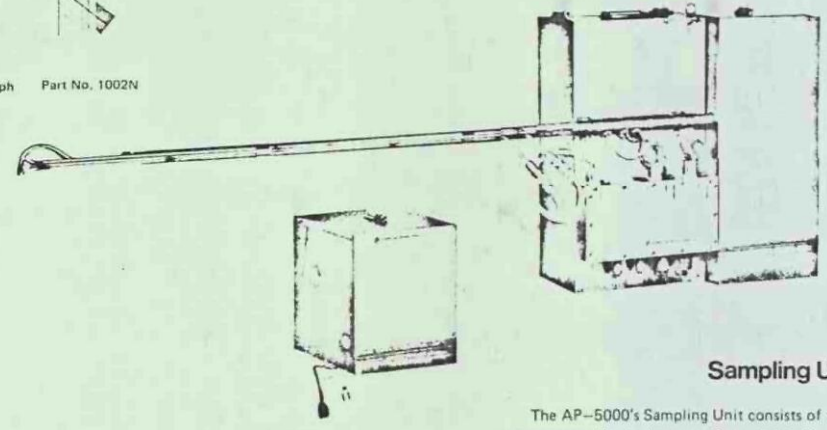

Sampling Unit

The AP–5000's Sampling Unit consists of three components: (1) the Impinger Case, (2) the Cyclone or Filter Oven, and (3) Pitobe. This flexible configuration allows the sampling team to make up all the trains required for the various sampling jobs.

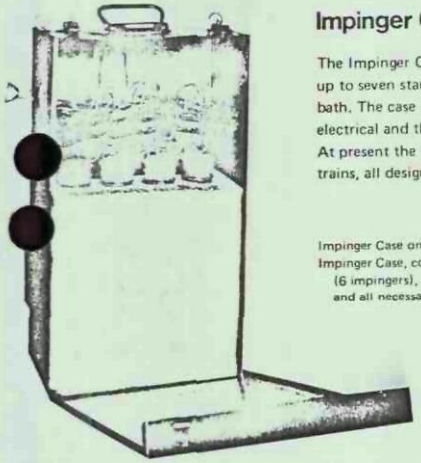

Impinger Case

The Impinger Case, with its own built-in carrying handle, holds up to seven standard 500 ml impingers in a closed-pore styrofoam ice bath. The case is equipped with vacuum and pitometer quick connects; electrical and thermocouple connections and an umbilical cord clamp. At present the Model AP–5000 offers *three* separate sampling trains, all designed to fit into the impinger case.

Ordering information:

Impinger Case only	Part No. 5000–1
Impinger Case, complete with glassware (6 impingers), styrofoam ice bath and all necessary #28 clamps	Part No. 5000–1CG

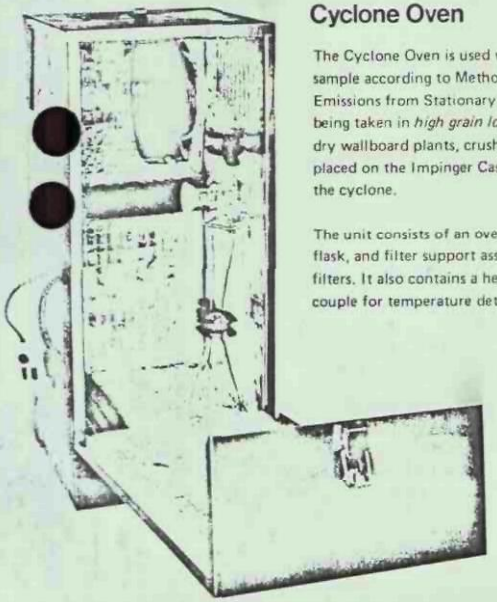

Cyclone Oven

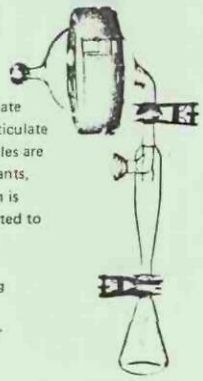

The Cyclone Oven is used when performing a particulate sample according to Method 5 (Determination of Particulate Emissions from Stationary Sources). When such samples are being taken in *high grain loading areas* like cement plants, dry wallboard plants, crushers, etc., the Cyclone Oven is placed on the Impinger Case and the Pitobe is connected to the cyclone.

The unit consists of an oven, a glass cyclone, receiving flask, and filter support assembly with 2, 3 or 4-inch filters. It also contains a heater element and a thermocouple for temperature detection.

Ordering Information:

Cyclone Oven Case Only	Part No. 5000–2A
Cyclone complete with glass cyclone receiving flask, 2-inch diameter filter and all necessary #28 clamps	Part No. 5000–2AG2
Same as above with 3-inch diameter filter	Part No. 5000–2AG3
Same as above with 4-inch diameter filter	Part No. 5000–2AG4

Pitobe

The Pitobe is a single assembly consisting of a Probe for sample-taking and a Pitot Tube for measuring stack temperature and velocity. Pitobes are available in type 316 stainless steel with either a heated Pyrex® glass or heated 316 stainless steel inner liner; or Inconel 601 with heated quartz glass inner liner.

When the sampling team performs a velocity traverse in accordance with Method 2 (Determination of Stack Gas Velocity and Volumetric Flow Rate), the S-type Pitot Tube is disconnected from the probe, and Pitometer lines are connected to the gas side of the Control Unit to measure the stack gas velocity on the dual inclined manometer. A permanently mounted Type K thermocouple on the S-type Pitot Tube gives direct stack temperature readout on the Digital Temperature Indicator. All Pitobe assemblies are grounded for maximum protection against electrical shock, and heated inner liners are supported on each end with packing glands. Outlet ball joint is 316 stainless steel for maximum protection of glass inner liners.

Ordering Information:

Type 316 S.S. with heated Pyrex glass inner liner

3-foot	Part No. 5000–PT3
5-foot	Part No. 5000–PT5
10-foot	Part No. 5000–PT10

Type 316 S.S. with heated 316 S.S. inner liner

3-foot	Part No. 5000–PT3S
5-foot	Part No. 5000–PT5S
10-foot	Part No. 5000–PT10S

Inconel 601 with heated quartz glass inner liner

3-foot	Part No. 5000–PTI3
5-foot	Part No. 5000–PTI5
10-foot	Part No. 5000–PTI10

Note: Jacketed probes for temperatures above 2000° F are available on request.

Typical Sampling Train – Method 5

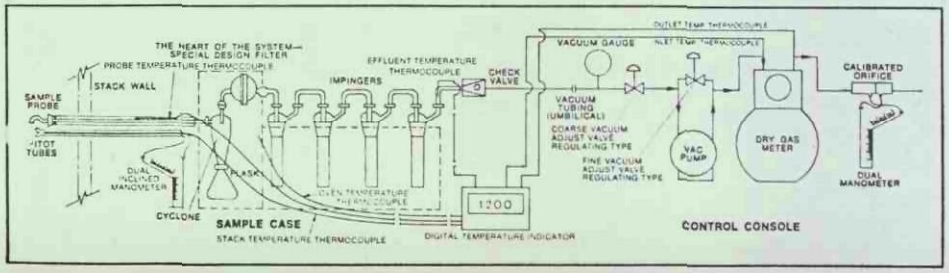

CALCULATIONS

Test No. 1

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

V_f = 260 ml.

V_i = 200 ml.

$V_{s\ gel}$ = 18.0 ml.

V_{lc} = 78.0 ml.

$V_{w_{std}}$ = 0.0474 ft^3/ ml. (V_{lc})

$V_{w_{std}}$ = 0.0474 ft^3/ ml. (78.0)

$V_{w_{std}}$ = 3.70 ft.^{3}

b. Dry gas volume through meter:

V_m = 61.76 ft.^{3}

P_{bar} = 29.87 in HG

T_m = 538 °R

ΔH = 3.2 in W. G.

$V_{m_{std}}$ = (17.71 °R/in HG) V_m $\left(\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m} \right)$

$V_{m_{std}}$ = 17.71 (61.76) $\left(\frac{29.87 + \frac{3.2}{13.6}}{538} \right)$

$V_{m_{std}}$ = 61.21 SCF_{dg}.

c. Moisture Content:

$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$

$B_{wo} = \frac{3.70}{3.70 + 61.21}$

B_{wo} = 0.057

d. Wet molecular weight:

M_d = 29.45 lb./lb. - mole.

$M_s = M_d(1. - B_{wo}) + 18.(B_{wo})$

M_s = (29.45)(.943) + 18. (.057)

M_s = 28.80 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

P_s = 29.87 in. HG

T_s = 1047 °R

P_{std} = 29.92 in. HG

T_{std} = 530 °R

$V_a = V_{m_{std}} (T_s) (P_{std}) / [1. - B_{wo}) (T_{std}) (P_s)]$

$$V_a = \frac{(6121)}{(.943)} \left(\frac{1047}{530}\right) \left(\frac{29.92}{29.57}\right)$$

V_a = 128.44 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

K_p = 85.48 ft./sec. (lb./lb. - mole °R) 1/2

C_p = 0.81

(T_s) avg = 1047 °R

$(\sqrt{\Delta P})$ avg = 0.297 (in. H_2O) 1/2

B_{wo} = 0.057

M_s = 28.80 lb./lb. - mole.

P_s = 29.57 in. HG

$$(V_s) \text{ avg} = K_p C_p (\sqrt{\Delta P}) \text{ avg} \sqrt{\frac{(T_s) \text{ avg}}{(P_s)(M_s)}}$$

(V_s) avg = 22.70 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

A_s = 1.767 sq. ft.

$Q_s = 60 (1.-B_{wo}) (V_s) \text{avg}^A \left(T_{std}/T_{s_{avg}}\right) (P_s/P_{std})$

Q_s = 1146.9 SCF_{dg}/min.

2. Actual conditions

$Q_a = (V_s) \text{ avg } A_s \, 60$

$Q_a = (22.7)(1.767)(60)$

Q_a = 2406.7 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 189.6 mg. (WET)

$V_{m_{std}}$ = 6121 SCF_{dg}

V_a = 128.44 ACF

$c_s' = 0.0154 \text{ grain/mg } (M_n/V_{m_{std}})$

$c_s' = 0.0154 \left(\frac{189.6}{6121}\right)$

c_s' = 0.0477 grains/SCF

$c_{s1}' = 0.0154 \text{ grain/mg } (M_n/V_a)$

$c_{s1}' = 0.0154 \left(\frac{189.6}{128.44}\right)$

c_{s1}' = 0.0227 grains/ACF

V. Emission Rate: (WET)

Q_s = 1146.9 SCF/min.

$E = 60 (Q_s) (c_s')$ lb./7000 grains

$$Q_E = \frac{60\ (V_{M7})\ (.0477)}{7000}$$

$$P_E = \underline{\quad 8.469 \quad} \text{ lb./hr.}$$

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = .499 inches

A_n = 0.00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{min.}{sec.})\ [(0.00267\ \frac{in.\ Hg\text{-}cu.\ ft.}{ml.\text{-}^\circ R})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ avg\ P_s A_n}$$

$$I = \frac{1047(1667)\left\{0.00267\ (75.0) + \frac{61.76}{535}\left(29.87 + \frac{3.2}{13.6}\right)\right\}}{60(22.7)(29.87)(.00136)}$$

I = 115.6

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel NATURAL GAS

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6,666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.51 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\%\ CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(240.7)(6.53) - (7.51)(\quad)}{(\quad)}$$

= 5.0 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_s(12\%) = C_s\left[\frac{12.0}{\%\ CO_2(corr)}\right]$$

$$= (.0477)\ \left[\frac{12.0}{(5.0)}\right]$$

$C_s(12\%)$ = 0.144 gr/SCF_{dg} @ 12% CO_2

Summary of Calculated Results

Test No. 1

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 3.70 ml.cc

b. Dry gas volume through meter: $V_{m_{std}}$ = 61.21 cu. ft.

c. Percent Moisture: B_{wo} = 5.7 %

d. Wet Molecular Weight: M_s = 28.80 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 128.44 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 2270 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1147 SCF_{dg}/min.

2. Q_a = 3407 ACF/min.

IV. Determination of Particulate Concentrations (WET)

a. c'_s = 0.0497 grains/SCF

b. c'_{s1} = 0.0227 grains/ACF

V. Emission Rate (WET)

Q_E = 0.469 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED

Gas Analysis: Orsat/Gas Chromatograph

		Orsat	Gas Chromatograph
% CO_2	=		5.3
% O_2	=		15.0
% CO	=		
% N_2	=		79.7

Dry Molecular Weight: M_d

M_d = 0.44 (%CO_2) + 0.32 (O_2) + 0.28 (%N_2 + %CO)

M_d = 0.44 (5.3) + 0.32 (15) + 0.28 (79.7)

M_d = 29.45 LB/LB-MOLE

Plant FEE CORP

Run number 1

Location Pond, Rm

Date 3/22/73

Operator HOLLAND & LOOSE

Sample box number 1

Meter box number 1

PARTICULATE TEST

Ambient temperature, °F 72

Barometric pressure, in. Hg 29.87

Assumed moisture, % 5

Heater box setting, °F 250°F

Probe tip diameter, in. 1/2"

Probe length, ft. 5.0"

Probe heater setting 250°F

Plane

Point	Clock time	Dry gas meter, ft^3	Pitot, in. H_2O ΔP	Orifice ΔH, in. H_2O Desired	Orifice ΔH, in. H_2O Actual	Dry gas temperature, °F Inlet	Dry gas temperature, °F Outlet	Pump vacuum, in. Hg gauge	Box temperature, °F	Impinger temperature, °F	~~Stack~~ pressure, ~~in. Hg~~	Stack temperature, °F
1												
2	10:45	67533	0.65	3.33	3.3	73	74	6.5	141	78		344
3	10:48		0.64	3.22	3.2	73	76	5.4	132	73		337
4	10:51	68046	0.65	3.48	3.4	73	74	7.3	143	73	1.68	406
5	10:54	68344	0.65	4.5	4.5	73	74	14.5	154	75	1.21	425
6	10:57	68654	0.65	4.6	4.6	73	75	15.0	156	77	1.36	451
7	11:00	68945	0.64	4.9	4.9	73	74	16.0	158	82	1.36	513
8	11:03	69249	0.64	4.9	4.9	74	74	16.3	161	83	1.15	503
9	11:06	69756	0.64	4.8	4.8	77	77	16.2	206	85	1.07	653
10	11:09	70100	0.62	4.5	4.5	76	76	12.0	218	84	1.35	653
11	11:12	70439	0.62	4.5	4.5	75	76	16.1	222	87	1.35	545
12	11:15	70783										
1												
2	12:00	70785	0.05	1.7	1.7	78	78	6.5	163	84	1.03	513
3	12:03	70810	0.61	3.5	3.5	78	77	7.7	165	82	2.07	481
4	12:06	71271	0.63	3.6	3.6	78	78	8.0	180	86	2.57	611
5	12:09	71543	0.64	3.5	3.5	77	78	11.0	184	86	2.84	747
6	12:12	71830	0.64	3.3	3.3	78	78	12.0	194	88	2.55	750
7	12:15	72132	0.61	4.0	4.0	78	78	14.0	204	84	2.57	749
8	12:18	72442	0.61	4.0	4.0	77	78	14.6	210	84	2.46	613
9	12:21	72763	0.61	4.0	4.0	77	78	14.5	220	84	2.45	633
10	12:24	73112	0.61	4.6	4.6	78	78	16.0	230	92	2.07	747
11	12:27	73415	0.60	3.5	3.5	78	78	15.7	237	94	2.13	723
12	12:30	73704										557

Comments:

Summary of Calculated Results

Test No. 2

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 4cc ml.cc.

b. Dry gas volume through meter: $V_{m_{STD}}$ = 54.75 cu. ft.

c. Percent Moisture: B_{WO} = 6.5 %

d. Wet Molecular Weight: M_s = 28.47 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 12730 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 2305 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1052 SCF_{dg}/min.

2. Q_a = 2444 ACF/min.

IV. Determination of Particulate Concentrations (wet)

a. c_s' = 0.0337 grains/SCF

b. c_{s1}' = 0.0045 grains/ACF

V. Emission Rate (wet)

E = 0.304 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED 2

Gas Analysis: Orsat/Gas Chromatograph

	Orsat	Gas Chromatograph
% CO_2 =		5.3
% O_2 =		14.9
% CO =		
% N_2 =		79.8

Dry Molecular Weight: M_d

$M_d = 0.44\ (\%CO_2) + 0.32\ (O_2) + 0.28\ (\%N_2 + \%CO)$

$M_d = 0.44\ (5.3) + 0.32\ (14.9) + 0.28\ (79.8)$

$M_d =$ 29.44 LB/LB-MOLE

CALCULATIONS

Test No. 2.

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

$V_f =$ 260 ml.

$V_i =$ 200 ml.

$V_{s\ gel} =$ 25.3 ml.

$V_{lc} =$ 85.3 ml.

$V_{w_{std}} = 0.0474\ ft^3/ml.\ (V_{lc})$

$V_{w_{std}} = 0.0474\ ft^3/ml.\ (85.3)$

$V_{w_{std}} =$ 404 $ft.^3$

b. Dry gas volume through meter:

$V_m =$ 55.74 $ft.^3$

$P_{bar} =$ 29.87 in HG

$T_m =$ 543 °R

$\Delta H =$ 3.6 in W. G.

$V_{m_{std}} = (17.71\ °R/in\ HG)\ V_m \left(\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m} \right)$

$V_{m_{std}} = 17.71\ (55.74)\ \left(\frac{29.87 + \frac{3L}{13.6}}{543}\right)$

$V_{m_{std}} =$ 54.78 SCF_{dg}.

c. Moisture Content:

$$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$$

$B_{wo} = \frac{404}{404 + 54.78}$

$B_{wo} =$ 0.068

d. Wet molecular weight:

$M_d =$ 29.47 lb./lb. - mole.

$M_s = M_d(1.-B_{wo}) + 18.\ (B_{wo})$

$M_s = (29.47)(.932) + 18.\ (.068)$

$M_s =$ 28.67 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

$P_s =$ 29.87 in. HG

$T_s =$ 1146 °R

$P_{std} =$ 29.92 in. HG

$T_{std} =$ 530 °R

$V_a = V_{m_{std}}\ (T_s)\ (P_{std}) / [1. - B_{wo})\ (T_{std})\ (P_s)]$

$V_a = \frac{(54.78)}{(.932)}\ \left(\frac{1146}{530}\right)\ \left(\frac{29.92}{29.87}\right)$

$V_a =$ 127.30 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

$K_p = 85.48$ ft./sec. (lb./lb. - mole °R) $^{1/2}$

$C_p = 0.81$

(T_s) avg = 1146 °R

$(\sqrt{\Delta P})$ avg = 0.287 (in. H_2O) $^{1/2}$

$B_{wo} =$ 0.068

$M_s =$ 28.67 lb./lb. - mole.

$P_s =$ 29.87 in. HG

$$(V_s)\ \text{avg} = K_p C_p\ (\sqrt{\Delta P})\ \text{avg} \sqrt{\frac{(T_s)\ \text{avg}}{(P_s)\ (M_s)}}$$

(V_s) avg = 23.05 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

$A_s =$ 1.767 sq. ft.

$Q_s = 60\ (1.-B_{wo})\ (V_s)\ \text{avg}^A\ (T_{std}/T_{s_{avg}})\ (P_s/P_{std})$

$Q_s =$ 1051.6 SCF_{dg}/min.

2. Actual conditions

Q_a = (V_s) avg A_s 60

Q_a = (23.05) (1.767) (60)

Q_a = 2443.8 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 119.9 mg.

$V_{m_{std}}$ = 54.78 SCF_{dg}

V_a = 127.30 ACF

c_s' = 0.0154 grain/mg $(M_n/V_{m_{std}})$

c_s' = 0.154 $(\frac{119.9}{54.78})$

c_s' = 0.0337 grains/SCF

c_{s1}' = 0.0154 grain/mg (M_n/V_a)

c_{s1}' = 0.154 $(\frac{119.9}{127.3})$

c_{s1}' = 0.0145 grains/ACF

V. Emission Rate: (WET)

Q_s = 10516 SCF/min.

$\overset{o}{E}$ = 60 (Q_s) (c_s') lb./7000 grains

$\overset{o}{E}$ = $\frac{60\ (10516)\ (.0337)}{7000}$

$\overset{o}{E}$ = 0.304 lb./hr.

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = .499 inches

A_n = .00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{min.}{sec.})\ [(0.00267\ \frac{in.\ Hg\text{-}cu.\ ft.}{ml.\text{-}^\circ R})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ avg\ P_s A_n}$$

$$I = \frac{114(100)\left\{0.00267(85.3) + \frac{55.74}{543}\left(29.87 + \frac{3.6}{13.6}\right)\right\}}{60(23.05)(29.87)(.00136)}$$

I = 112.9

SUMMARY SHEET OF PARAMETERS

TEST # 2

1. V_{lc} = 85.3 ml.
2. V_m = 55.74 $ft.^3$
3. P_{bar} = 29.87 in. HG
4. T_m = 543 °R
5. T_s = 1146 °R
6. ΔH = 3.6 in. W.G.
7. C_p = 0.81
8. $\sqrt{\Delta P_{avg}}$ = 0.287 $(in. W.G.)^{1/2}$
9. P_s = 29.87 in. HG
10. A_s = 1.767 sq. ft.
11. M_n = 1199 mg. (WET)
12. θ = 60 min.
13. dp = 0.499 in.
14. % CO_2 = 5.3
15. % O_2 = 14.9
16. % CO = 79.8

SUMMARY SHEET OF PARAMETERS

TEST # 3

1. V_{lc} = 70.3 ml.
2. V_m = 59.76 $ft.^3$
3. P_{bar} = 29.87 in. HG
4. T_m = 541 °R
5. T_s = 1195 °R
6. ΔH = 3.2 in. W.G.
7. C_p = 0.81
8. $\sqrt{\Delta P_{avg}}$ = 0.328 $(in. W.G.)^{1/2}$
9. P_s = 29.87 in. HG
10. A_s = 1.767 sq. ft.
11. M_n = 1076 mg.
12. θ = 60 min.
13. dp = 0.499 in.
14. % CO_2 = 5.4
15. % O_2 = 14.9
16. % CO = 79.7

Summary of Calculated Results

Test No. 3

I. Determination of Moisture in Stack Gases.

a. Volume of water vapor collected (std. cond.): 333 ml

b. Dry gas volume through meter: $V_{m_{std}}$ = 58.89 cu. ft.

c. Percent Moisture: B_{wo} = 5.4 %

d. Wet Molecular Weight: M_s = 28.84 lb/lb mole.

II. Actual Stack Gas Volume Sampled.

V_a = 140.59 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate:

a. Stack Velocity: (V_s) avg. = 26.80 ft/sec

b. Stack Volumetric Flow Rate:

1. Q_s = 1190 SCF_{dg}/min.

2. Q_a = 2841 ACF/min.

IV. Determination of Particulate Concentrations (WET)

a. c'_s = 0.0281 grains/SCF

b. c'_{s1} = 0.0118 grains/ACF

V. Emission Rate (WET)

E = 0.287 lb/hr.

Determination of Molecular Weight (Dry)

Technique: INTEGRATED 3

Gas Analysis: Orsat/Gas Chromatograph

	Orsat	Gas Chromatograph
% CO_2 =		5.4
% O_2 =		14.9
% CO =		<500PPM
% N_2 =		79.7

Dry Molecular Weight: M_d

$M_d = 0.44\ (\%CO_2) + 0.32\ (O_2) + 0.28\ (\%N_2 + \%CO)$

$M_d = 0.44\ (5.4) + 0.32\ (14.9) + 0.28\ (79.7)$

M_d = 29.46

CALCULATIONS

Test No. 3

I. Determination of Moisture in Stack Gases:

a. Volume of water vapor collected (std. cond.) cu. ft.

V_f = 251 ml.

V_i = 200 ml.

$V_{s\ gel}$ = 19.3 ml.

V_{lc} = 70.3 ml.

$V_{w_{std}}$ = 0.0474 ft ^{3}/ ml. (V_{lc})

$V_{w_{std}}$ = 0.0474 ft ^{3}/ ml. (70.3)

$V_{w_{std}}$ = 3.33 ft.^{3}

b. Dry gas volume through meter:

V_m = 59.76 ft.^{3}

P_{bar} = 29.87 in HG

T_m = 541 °R

ΔH = 3.2 in W. G.

$V_{m_{std}}$ = (17.71 °R/in HG) V_m ($\frac{P_{bar} + \frac{\Delta H}{13.6}}{T_m}$)

$V_{m_{std}}$ = 17.71 (59.76) ($\frac{29.87 + \frac{3.2}{13.6}}{541}$)

$V_{m_{std}}$ = 58.89 SCF_{dg}.

c. Moisture Content:

$B_{wo} = \frac{V_{w_{std}}}{V_{w_{std}} + V_{m_{std}}}$

$B_{wo} = \frac{3.33}{3.33 + 58.89}$

B_{wo} = 0.054

d. Wet molecular weight:

M_d = 29.46 lb./lb. - mole.

$M_s = M_d(1.-B_{wo}) + 18.(B_{wo})$

M_s = (29.46)(.946) + 18. (.054)

M_s = 28.84 lb./lb. - mole.

II. Actual Stack Gas Volume Sampled

P_s = 29.87 in. HG

T_s = 1195 °R

P_{std} = 29.92 in. HG

T_{std} = 530 °R

$V_a = V_{m_{std}} (T_s) (P_{std}) / [1. - B_{wo}) (T_{std}) (P_s)]$

$V_a = \frac{(58.89)}{(.946)} \left(\frac{1195}{530}\right) \left(\frac{29.92}{29.87}\right)$

$V_a =$ 140.59 ACF

III. Determination of Stack Gas Velocity and Volumetric Flow Rate

a. Stack velocity:

K_p = 85.48 ft./sec. (lb./lb. - mole °R) $^{1/2}$

C_p = 0.81

(T_s) avg = 1195 °R

$(\sqrt{\Delta P})$ avg = 0.328 (in. H_2O) $^{1/2}$

B_{wo} = 0.054

M_s = 28.84 lb./lb. - mole.

P_s = 29.87 in. HG

(V_s) avg = $K_p C_p (\sqrt{\Delta P})$ avg $\sqrt{\frac{(T_s) \text{ avg}}{(P_s)(M_s)}}$

(V_s) avg = 26.80 ft./sec.

b. Stack volumetric flow rate:

1. Standard conditions (dry)

A_s = 1.767 sq. ft.

$Q_s = 60 (1.-B_{wo}) (V_s) \text{avg} A_s (T_{std}/T_{s_{avg}}) (P_s/P_{std})$

Q_s = 1190 SCF_{dg}/min.

2. Actual conditions

$Q_a = (V_s) \text{ avg } A_s \ 60$

$Q_a = (26.80)(1.767)(60)$

Q_a = 2841 ACFM

IV. Determination of Particulate Concentration: (WET)

M_n = 107.6 mg.

$V_{m_{std}}$ = 58.89 SCF_{dg}

V_a = 140.59 ACF

$c_s' = 0.0154 \text{ grain/mg } (M_n/V_{m_{std}})$

$c_s' = 0.0154 \left(\frac{107.6}{58.89}\right)$

c_s' = 0.0281 grains/SCF

$c_{s1}' = 0.0154 \text{ grain/mg } (M_n/V_a)$

$c_{s1}' = 0.454 \left(\frac{107.6}{140.59}\right)$

c_{s1}' = 0.0118 grains/ACF

V. Emission Rate: (WET)

Q_s = 1190 SCF/min.

$E = 60 (Q_s) (c_s')$ lb./7000 grains

$$\overset{\circ}{E} = \frac{60\ (1190)\ (.0281)}{7000}$$

$$\overset{\circ}{E} = 0.287 \text{ lb./hr.}$$

VI. Determination of acceptability of sampling results.

θ = 60 min.

dp = 0.499 inches

A_n = 0.00136 sq. ft.

$$I = \frac{T_s\ (1.667\ \frac{\text{min.}}{\text{sec.}})\ [(0.00267\ \frac{\text{in. Hg-cu. ft.}}{\text{ml.-°R}})\ V_{lc} + \frac{V_m}{T_m}\ (P_{bar} + \frac{\Delta H}{13.6})]}{\theta\ (V_s)\ \text{avg}\ P_s A_n}$$

$$I = \frac{1195(1.667)\left\{.00267(70.3) + \frac{59.76}{54}\left(29.87 + \frac{3.2}{13.6}\right)\right\}}{60(26.80)(.2987)(.00136}$$

I = 107.2

VII. CO_2 Produced By Auxillary Gas Burners, $Q_{CO_2(g.b.)}$

Type of Fuel Natural Gas

H.I.P. = 6,666 BTU/min

H_{comb} = 1021 BTU/CF

$CO_2(sto)$ = 1.15 SCF/CF_{fuel}

$$Q_{CO_2(g.b.)} = \frac{(H.I.P)(CO_2(sto)}{H_{comb}}$$

$$Q_{CO_2(g.b.)} = \frac{(6666)(1.15)}{(1021)}$$

$Q_{CO_2(g.b.)}$ = 7.51 SCFM

VIII. % CO_2 Produced By Waste Only, % CO_2(corr)

$$\%\ CO_2 = \frac{Q_s(\%CO_2) - Q_{CO_2(g.b.)}}{Q_s}$$

$$= \frac{(234)(.054) - (7.51)(\quad)}{(234)}$$

= 5.1 % CO_2(corr)

IX. Particulate Concentration Corrected To 12% CO_2

$$C_{s(12\%)} = C_s\left[\frac{12.0}{\%\ CO_2(corr)}\right]$$

$$= (.0251)\left[\frac{12.0}{(5.1)}\right]$$

$C_{s(12\%)}$ = 0.006 gr/SCF_{dg} @ 12% CO_2

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613
(319) 277-2401

METHOD OF CALCULATION

Volume of Stack Gas Sampled at the Meter (SCF)

$$V_{m_{std}} = V_m\left(\frac{T_{std}}{T_m}\right)\left(\frac{P_{atm} + \frac{\Delta H}{13.6}}{P_{std}}\right)$$

$V_{m_{std}}$ = Volume sampled at standard conditions (SCF)

V_m = Volume measured at the meter (ft^3)

T_{std} = Standard temperature (530°R)

T_m = Average temperature at the meter (°R)

P_{atm} = Atmospheric pressure (in Hg)

ΔH = Average orifice differential (in H_2O)

P_{std} = Standard pressure (29.92 in Hg)

Volume of Water Vapor Sampled (SCF)

$$V_{w_{std}} = V_{l_c}(0.0474\ ft^3/ml)$$

$V_{w_{std}}$ = Volume of water vapor sampled st standard conditions (SCF)

V_{l_c} = Volume of condensate collected (ml)

Total Volume Sampled (SCF)

$$V_{Total} = V_{m_{std}} + V_{w_{std}}$$

Proportion by Volume of Water Vapor

$$B_w = \frac{V_{w_{std}}}{V_{Total}}$$

B_w = Proportion of stack gas as water vapor

Dry Molecular Weight of Stack Gas (lb/lb-mole)

$$M_d = (44)(B_{CO_2}) + (32)(B_{O_2}) + (28)(B_{CO}) + (28)(B_{N_2})$$

M_d = Dry molecular weight (lb/lb-mole)

B_{CO_2} = Proportion by volume CO_2 in stack gas

B_{O_2} = Proportion by volume O_2 in stack gas

B_{CO} = Proportion by volume CO in stack gas

B_{N_2} = Proportion by volume N_2 in stack gas

Molecular Weight of Stack Gas (lb/lb-mole)

$$M = M_d(1 - B_w) + 18(B_w)$$

M = Molecular weight of stack gas (lb/lb-mole)

M_d = Dry molecular weight

B_w = Proportion by volume of water vapor

Stack Gas Velocity (ft/sec)

$$V_s = CpKp\sqrt{\frac{T_s}{M \times P_s}} \times \sqrt{\Delta p}$$

V_s = Stack gas velocity (ft/sec)

Cp = Pitot tube correction factor (dimensionless)

Kp = Constant 85.48 ft/sec (lb/lb-mole = °R)1/2

T_s = Average stack gas temperature (°R)

M = Molecular weight of stack gas (lb/lb-mole)

P_s = Stack pressure (in Hg)

p = Square root of velocity pressure

Stack Gas Velocity at Standard Conditions (ft/sec)

$$V_{s_{std}} = 17.71 \frac{°R}{\text{in Hg}} \left(\frac{V_s P_s}{T_s}\right)$$

$V_{s_{std}}$ = Stack gas velocity at 70°F and 29.92 in Hg (ft/sec)

V_s = Stack gas velocity (ft/sec)

P_s = Stack pressure (in Hg)

T_s = Average stack gas temperature (°R)

Stack Gas Flow Rate (SCFH)

$$Q_s = 3600(1-B_w) \times V_{s_{std}} \times A_s$$

Q_s = Stack gas flow rate (SCF/hr)

$V_{s_{std}}$ = Stack gas velocity at standard conditions (ft/sec)

B_w = Proportion by volume of water vapor

A_s = Area of the stack (ft^2)

Particulate Concentration (lb/SCF)

$$C_s = 2.205 \times 10^{-6} \text{ lb/mgm} \left(\frac{M_n}{V_{Total}}\right)$$

C_s = Particulate concentration (lb/SCF)

M_n = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Mass Flow Rate (lb/hr)

$$Q_p = Q_s \times C_s$$

Q_p = Particulate mass flow rate (lb/hr)

Q_s = Stack gas flow rate (SCF/hr)

C_s = Particulate concentration (lb/SCF)

Particulate Concentration: Sample Concentration Method (gr/SCF)

$$c_s' = 0.0154 \text{ gr/mgm}\left(\frac{Mn}{V_{Total}}\right)$$

c_s' = Particulate concentration (gr/SCF)

M_n = Total particulate mass collected (mgm)

V_{Total} = Total volume of stack gas sampled (SCF)

Particulate Concentration: Ratio of Areas Method (gr/SCF)

$$c_s = (2.57 \times 10^{-4} \frac{\text{gr=min}}{\text{mgm-sec}})\left(\frac{Mn}{\theta\ V_{s_{std}}\ A_n}\right)$$

c_s = Particulate concentration (gr/SCF)

M_n = Total particulate mass collected (mgm)

θ = Total sampling time (min)

$V_{s_{std}}$ = Stack gas velocity at standard conditions (ft/sec)

A_n = Area of the sampling nozzle (ft^2)

Average Particulate Concentration (gr/SCF)

$$c_{ave} = \frac{c_s' + c_s}{2}$$

Percent of Isokinetic Sampling

$$I = \frac{c_s}{c_s'} \times 100$$

Prepared and Submitted by

CORNING LABORATORIES, INC.

PROJECT 224H1

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
27.12	29.10	0.96	520.35	48.50	0.074	0.112	0.000	0.814

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1209.67	29.15	0.212	3.14	169.9	50.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
26.92	2.29	29.22	0.078	29.63	28.71	17.64

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.53	78427.	0.0000128	1.0	0.089	0.085	0.087	95.0

PROJECT 224H-2

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
34.57	29.16	1.15	527.00	54.50	0.075	0.114	0.000	0.811

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1393.87	29.21	0.22	3.14	164.4	60.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
33.97	2.58	36.58	0.070	29.65	28.83	19.95

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.40	77792.	0.0000099	0.7	0.069	0.069	0.069	100.7

PROJECT 224H-3

VM	PATM	DH	TM	V1C	BCO2	BO2	BCO	BN2
38.08	29.18	1.33	526.00	52.80	0.073	0.117	0.000	0.810

CP	TS	PS	DP	AS	MN	THETA	AN
0.81	1375.00	29.23	0.236	3.14	172.8	60.0	0.0013630

VMST	VWSTD	VTOTAL	BW	MD	M	VS
37.53	2.50	40.04	0.062	29.63	28.90	20.84

VSSTD	QS	CCS	QP	C1S	CS	CAVE	I
7.84	83162.	0.0000095	0.7	0.066	0.069	0.067	104.1

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613
(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
TEST #1

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	26.92
V_m	Volume measured at the meter (ft^3)	27.12
T_m	Temperature at the meter (°R)	520.35
P_{atm}	Atmospheric pressure (in Hg)	29.10
ΔH	Average orifice differential (in H_2O)	0.96
V_{wstd}	Volume of water vapor sampled (SCF)	2.29
Vl_c	Volume of condensate collected (ml)	0.126
V_{Total}	Total volume sampled (SCF)	29.22
B_w	Proportion by volume of water vapor	0.078
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.63
B_{CO_2}	Proportion by Volume CO_2 in stack gas	0.074
B_{O_2}	Proportion by Volume O_2 in stack gas	0.112
B_{CO}	Proportion by Volume CO in stack gas	000
B_{N_2}	Proportion by Volume N_2 in stack gas	0.814
M	Molecular weight of stack gas (lb/lb-mole)	28.71
V_s	Stack gas velocity (ft/sec)	17.64
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1209.67
P_s	Stack pressure (in Hg)	29.15
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	0.212
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.53
Q_s	Stack gas flow rate (SCF/hr)	78427
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	1.13
M_n	Total particulate mass collected (mgm)*	149.9
Q_p	Particulate mass flow rate (lb/hr)	.88
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	0.079
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	0.075
θ	Total sampling time (min)	50
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	0.077
I	Percent of isokinetic sampling	95.0

Particulate Mass Breakdown

1	Before Filter (mgm)	44.8
2	Filter (mgm)	41.8
3	After Filter (mgm)	14.9
4	Impingers	48.4
	TOTAL (mgm)	149.9

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
MODEL HR500 TEST #1

NOMENCLATURE		VALUE
M_s	Mass emission rate (1b/100 1b refuse burned)	0.23
CR	Charging rate (100 1b/hr)	3.80
$C_{s_{dry}}$	Particulate Concentration, dry basis (1b/SCF)	6.54×10^{-6}
$M_{n_{dry}}$	Dry Particulate Mass collected (mgm)*	86.6
$Q_{P_{dry}}$	Particulate mass flow rate dry basis (1b/hr)	.51
$C'_{s_{dry}}$	Particulate concentration dry basis. Sample Concentration Method (gr/SCF)	.046
$M_{s_{dry}}$	Mass emission rate, dry basis (1b/100 1b refuse burned)	.134
$C'_{s_{CO_2}}$	Particulate concentration corrected to 12% CO_2 Sample Concentration Method (gr/SCF)	.128
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 sample concentration Method (gr/SCF)	.074

*Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
TEST #2

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	33.97
V_m	Volume measured at the meter (ft^3)	34.57
T_m	Temperature at the meter (°R)	527.00
P_{atm}	Atmospheric pressure (in Hg)	29.16
ΔH	Average orifice differential (in H_2O)	1.15
V_{wstd}	Volume of water vapor sampled (SCF)	2.58
Vl_c	Volume of condensate collected (ml)	.086
V_{Total}	Total volume sampled (SCF)	36.55
B_w	Proportion by volume of water vapor	.070
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.65
B_{CO_2}	Proportion by Volume CO_2 in stack gas	.075
B_{O_2}	Proportion by Volume O_2 in stack gas	.114
B_{CO}	Proportion by Volume CO in stack gas	.000
B_{N_2}	Proportion by Volume N_2 in stack gas	.811
M	Molecular weight of stack gas (lb/lb-mole)	28.83
V_s	Stack gas velocity (ft/sec)	19.95
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1393.87
P_s	Stack pressure (in Hg)	29.21
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	.224
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.4
Q_s	Stack gas flow rate (SCF/hr)	77792
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	9.9×10^{-6}
M_n	Total particulate mass collected (mgm)*	164.4
Q_p	Particulate mass flow rate (lb/hr)	0.7
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	.069
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	.069
θ	Total sampling time (min)	60
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	.069
I	Percent of isokinetic sampling	100.7

Particulate Mass Breakdown

1	Before Filter (mgm)	28.4
2	Filter (mgm)	51.5
3	After Filter (mgm)	16.3
4	Impingers	68.2
	TOTAL (mgm)	164.4

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
MODEL HR500 TEST #2

NOMENCLATURE		VALUE
M_s	Mass emission rate (lb/100 lb refuse burned)	0.184
CR	Charging rate (100 lb/hr)	3.8
$C_{s_{dry}}$	Particulate Concentration, dry basis (lb/SCF)	4.8×10^{-6}
$M_{n_{dry}}$	Dry Particulate mass collected (mgm)*	79.9
$Q_{p_{dry}}$	Particulate mass flow rate dry basis (lb/hr)	.375
$C'_{s_{dry}}$	Particulate concentration dry basis: Sample Concentration Method (gr/SCF)	.034
$M_{s_{dry}}$	Mass emission rate, dry basis (lb/100 lb refuse burned)	.098
$C'_{s\ CO_2}$	Particulate concentration corrected to 12% CO_2 Sample Concentration method (gr/SCF)	.11
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 sample concentration method (gr/SCF)	.054

* Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

Chemical Consultants in
Materials Analysis
Industrial Processes
Air and Water Pollution

CORNING LABORATORIES, INC.
Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

MODEL HR500
NOMENCLATURE AND RECORDED VALUES
Test #3

NOMENCLATURE		VALUE
$V_{m_{std}}$	Volume of stack gas sampled at the meter (SCF)	37.53
V_m	Volume measured at the meter (ft^3)	38.08
T_m	Temperature at the meter (°R)	526
P_{atm}	Atmospheric pressure (in Hg)	29.18
ΔH	Average orifice differential (in H_2O)	1.33
V_{wstd}	Volume of water vapor sampled (SCF)	2.50
Vl_c	Volume of condensate collected (ml)	52.8
V_{Total}	Total volume sampled (SCF)	40.04
B_w	Proportion by volume of water vapor	.062
M_d	Dry molecular weight of stack gas (lb/lb-mole)	29.63
B_{CO_2}	Proportion by Volume CO_2 in stack gas	.073
B_{O_2}	Proportion by Volume O_2 in stack gas	.117
B_{CO}	Proportion by Volume CO in stack gas	.000
B_{N_2}	Proportion by Volume N_2 in stack gas	.810
M	Molecular weight of stack gas (lb/lb-mole)	28.90
V_s	Stack gas velocity (ft/sec)	20.84
Cp	Pitot tube correction factor (dimensionless)	0.81
T_s	Average stack gas temperature (°R)	1375.0
P_s	Stack pressure (in Hg)	29.23
$\sqrt{\Delta p}$	Square root of velocity pressure (in H_2O)	.236
V_{sstd}	Stack gas velocity at standard conditions (ft/sec)	7.84
Q_s	Stack gas flow rate (SCF/hr)	83162
A_s	Area of the stack (ft^2)	3.14

NOMENCLATURE		VALUE
C_s	Particulate concentration (lb/SCF)	9.5×10^{-6}
M_n	Total particulate mass collected (mgm)*	172.8
Q_p	Particulate mass flow rate (lb/hr)	0.7
c_s'	Particulate concentration: Sample Conc. Method (gr/SCF)	.066
c_s	Particulate concentration: Ratio of Areas Method (gr/SCF)	.069
θ	Total sampling time (min)	60
A_n	Area of the sampling nozzle (ft^2)	1.36×10^{-3}
c_{ave}	Average particulate concentration (gr/SCF)	.067
I	Percent of isokinetic sampling	104.1

Particulate Mass Breakdown

1	Before Filter (mgm)	43.9
2	Filter (mgm)	32.2
3	After Filter (mgm)	45.4
4	Impingers	51.2
	TOTAL (mgm)	172.8

REMARKS:

Prepared and Submitted by

CORNING LABORATORIES, INC.

Member

CORNING LABORATORIES, INC.

Tenth and Main Streets, Box 625
Cedar Falls, Iowa 50613

(319) 277-2401

ADDENDUM TO
NOMENCLATURE AND RECORDED VALUES
TEST #3

NOMENCLATURE		VALUES
M_s	Mass emission rate (lb/100 lb refuse burned)	.184
CR	Charging rate (100 lb/hr)	3.8
$C_{s_{dry}}$	Particulate Concentration, dry basis (lb/SCF)	4.19×10^{-6}
$M_{n_{dry}}$	Dry Particulate mass collected (mgm)*	76.1
$Q_{p_{dry}}$	Particulate mass flow rate dry basis (lb/hr)	.349
$C'_{s_{dry}}$	Particulate concentration dry basis: Sample Concentration method (gr/SCF)	.029
$M_{s_{dry}}$	Mass emission rate, dry basis (lb/100 lb refuse burned)	.092
$C'_{s_{CO_2}}$	Particulate concentration corrected to 12% CO_2 Sample Concentration Method (gr/SCF)	.113
$C'_{s_{CO_2/dry}}$	Particulate concentration dry basis corrected to 12% CO_2 Sample concentration method (gr/SCF)	.048

* Dry particulate mass is all particulate matter collected before and on the filter in the EPA Sample Train

Chemical Consultants

Air and Water Pollution • Research and Development • Materials Analysis • Industrial Processes • Food Technology

#1

STACK GAS COMPOSITION

Client FEI

Plant Arlington

Stack

Date 3-12-73

Test No. 224 81

Barometric Pressure 29.10

Orsat Data

Component	Volume
Zero	0.0
CO_2	7.4
O_2	18.6
~~N_2~~ CO	18.6

Dry Molecular Weight (Md)

Component	Mx	Bx	MxBx
CO_2	44	074	3.26
O_2	32	.112	3.58
CO	28	0	0
N_2	28	.814	22.79
	Md =		29.63

Moisture Content (Bw)

$$V.P. = S.V.P. = .000367 \times P(t_d - t_w) \times \left(1 + \frac{t_w - 32}{1571}\right)$$

t_d _____

t_w _____

S.V.P. at t_w _____

T_s _____

Molecular Weight of Gas (M)

$M = M_d(1-B_w) + 18\ B_w$

$M =$ _____

```
      INTEGER DESC(8)
      REAL MD,M,I,MN
 1001 READ(2,100)DESC,VM,PATM,DH ,TM,V1C,BCO2,BO2,BCO,BN2
  100 FORMAT( 8A1,5F8.2,4F8.3)
      READ(2,200)DESC,CP    ,TS,PS,DP,AS,MN,THETA,AN
  200 FORMAT(8A1,3F8.2,F8.3,F8.2,2F8.1,F9.7)
      VMSTD = (17.71 * VM * (PATM + (DH / 13.6))) / TM
      VWSTD = V1C * .0474
      VTOT = VMSTD + VWSTD
      BW  = VWSTD / VTOT
      MD = (44.* BCO2) + (32. * BO2) + ( 28. * BCO) + ( 28. * BN2)
      M = (MD * (1-BW)) + (18 * BW)
      VS = CP * 85.48 *(SQRT(TS /(M*PS))) *      (DP)
      VSSTD = (17.71 * VS * PS) / TS
      QS = (3600 * (1-BW)) * VSSTD * AS
      CCS= .000002205 * (MN/VTOT)
      QP = QS * CCS
      CS1 = .0154 * (MN / VTOT)
      CS =   .000257 * (MN / (THETA * VSSTD * AN))
      CAVE = (CS1 + CS) / 2
      I  = (CS / CS1) * 100
      WRITE(3,600)DESC
  600 FORMAT(1H1,40X,'PROJECT'3X,8A1,///)
      WRITE(3,10)
   10 FORMAT(7X'VM'7X'PATM'8X'DH'7X'TM'7X'V1C'7X'BCO2'        7X'BO2'7X'B
     1CO'7X'BN2')
      WRITE(3,20)VM,PATM,DH,TM,V1C,BCO2,BO2,BCO,BN2
   20 FORMAT(1X,5(2X,F8.2),4(2X,F8.3),///)
      WRITE(3,30)
   30 FORMAT(7X'CP'7X'TS'7X'PS'7X'DP'7X'AS'7X'MN'5X'THETA'7X'AN')
      WRITE(3,40)CP,TS,PS,DP,AS,MN,THETA,AN
   40 FORMAT(1X3(1X,F8.2),1X,F8.3,F8.2,2(1X,F8.1),6X,F9.7,/////)
      WRITE(3,500)
  500 FORMAT(9X'VMST'7X'VWSTD'6X'VTOTAL'8X'BW'10X'MD'10X'M'11X'VS')
      WRITE(3,300)VMSTD,VWSTD,VTOT,BW,MD,M,VS
  300 FORMAT(1X,3F12.2,F12.3,3F12.2,///)
      WRITE(3,700)
  700 FORMAT(1X,8X,'VSSTD'06X'QS'9X'CCS'12X'QP'9X 'C1S'10X'CS'9X'CAVE',
     19X'I')
      WRITE(3,400)VSSTD,QS,CCS,QP,CS1,CS,CAVE,I
  400 FORMAT(1X,F12.2,F12.0,F12.7,F12.1,3F12.3,F12.1)
      CALL DATSW(1,ICODE)
      GO TO(1000,1001),ICODE
 1000 CALL EXIT
      END

FEATURES SUPPORTED
 ARITHMETIC TRACE
 ONE WORD INTEGERS
 EXTENDED PRECISION
 IOCS

CORE REQUIREMENTS FOR
 COMMON       0  VARIABLES     118  PROGRAM     620

 END OF COMPILATION
```

SEPARATOR

32-00037

AIR

COMPLIANCE

08/12/1991

423-I

WHITE RIVER MEDICAL CENTER

1710 HARRISON P.O. BOX 2197
BATESVILLE, ARKANSAS 72503-2197
501/793-1200

32-0037 Permit No. 423 I
CSN: .....
M'd'a: (A) Water, Solid, Hazardous
Sort: Permit, Compliance, Legal, Misc

AUGUST 12, 1991

MR. DAVID CHANNELL
DEPARTMENT OF POLLUTION CONTROL AND ECOLOGY
P.O. BOX 8913
LITTLE ROCK, AR 72219-8913

RE: CSN: 32-0037 PERMIT NUMBER: 423-I

DEAR MR. CHANNELL

IN RECEIPT OF YOUR LETTER DATED JULY, 30, 1991 CONCERNING INSPECTION OF INCINERATOR AT GRAY'S HOSPITAL - WRMC AT 477 EAST MAIN IN BATESVILLE, ARKANSAS. THE HOSPITAL HAS BEEN CLOSED FOR OVER 2 YEARS AND WILL NOT BE USED AGAIN AS A HOSPITAL. THE INCINERATOR HAS NOT BEEN USED EITHER NOR WILL IT EVER BE STARTED AGAIN. THE ELECTRICITY AND NATURAL GAS HAS BEEN DISCONNECTED. WE PLAN TO TAKE THE INCINERATOR OUT AT A TIME THAT HAS NOT BEEN DETERMINED BECAUSE OF THE EXPENSE IN RENTING A CRANE FOR THAT PURPOSE.

WE APPRECIATE YOUR EFFORTS IN HELPING KEEP OUR AIR CLEAN. AS HEALTH CARE PROVIDERS WE SEE MORE AND MORE ILLNESS THAT IS DIRECTLY A CAUSE OF BREATHING POLLUTION AIR.

THEIR IS NO NEED TO BILL US FOR A PERMIT ON THIS INCINERATOR IF I CAN ANSWER ANY MORE QUESTIONS FOR YOU PLEASE CALL ME AT (501) 793-1476.

SINCERELY,

JOE D. WALLS
DIRECTOR OF MATERIALS MANAGEMENT

Outlook

RE: 477 East Main Street, Batesville FOIA Request

From countyclerk@independencecounty.com <countyclerk@independencecounty.com>
Date Tue 9/9/2025 8:38 AM
To Cook, Allie <ALLIE.COOK@tetratech.com>

⚠ **CAUTION:** This email originated from an external sender. Verify the source before opening links or attachments. ⚠

I do not have any records concerning property owners or hazardous/environmental matters in my office. The tax assessor may be able to help you with a list of previous property owners. I believe that 477 E. Main is located within the city limits of Batesville. I'm not sure what property records are kept with the city.

Thank You,
Tracey Mitchell
Independence County Clerk
192 E. Main Street
Batesville, AR 72501
870-793-8828

-----Original Message-----
From: "Cook, Allie" <ALLIE.COOK@tetratech.com>
Sent: Tuesday, September 9, 2025 8:48am
To: "countyclerk@independencecounty.com" <countyclerk@independencecounty.com>
Subject: 477 East Main Street, Batesville FOIA Request

To Whom It May Concern:
Attached is a FOIA request for Independence County regarding the property located at 477 East Main Street, Batesville, AR.
Please let me know if you have any questions or if this request should be sent elsewhere.
Thank you,
Allie

Allie Cook | Environmental Scientist
Direct **+1 (816) 412-1766** | Business **+1 (816) 412-1741** | Fax **+1 (816) 410-1748** |
allie.cook@tetratech.com

Tetra Tech | *Leading with Science®* | EMI
415 Oak Street | Kansas City, MO 64106 | tetratech.com

This message, including any attachments, may include privileged, confidential and/or inside information. Any distribution or use of this communication by anyone other than the intended recipient is strictly prohibited and may be unlawful. If you are not the intended recipient, please notify the sender by replying to this message and then delete it from your system.

Please consider the environment before printing. Read more

TETRA TECH

Outlook

Re: FW: 477 East Main Street, Batesville FOIA Request

From Mark <batesvillechief@gmail.com>
Date Tue 9/9/2025 10:23 AM
To Cook, Allie <allie.cook@tetratech.com>

You don't often get email from batesvillechief@gmail.com. Learn why this is important

⚠ **CAUTION:** This email originated from an external sender. Verify the source before opening links or attachments. ⚠

To Whom It May Concern
Batesville Fire Department has no records of any hazardous materials of any kind at or on the address of 477 E Main Batesville Arkansas.

On Tue, Sep 9, 2025 at 9:59 AM <cityclerk@batesvillearkansas.gov> wrote:

> Mark,
>
> We received this FOIA request for the old hospital on Main St. Please see attachment
>
> ***Jessica Davis***
>
> City Clerk/Treasurer
>
> 500 E. Main Street
>
> City of Batesville, AR 72501
>
> Phone: 870.698.2400 ext. 103
>
> Email: cityclerk@batesvillearkansas.gov

From: Donna Smith <info@batesvillearkansas.gov>
Sent: Tuesday, September 09, 2025 8:23 AM
To: cityclerk@batesvillearkansas.gov
Subject: FW: 477 East Main Street, Batesville FOIA Request

From: Cook, Allie <ALLIE.COOK@tetratech.com>
Sent: Tuesday, September 09, 2025 7:40 AM
To: info@batesvillearkansas.gov
Subject: 477 East Main Street, Batesville FOIA Request

To Whom It May Concern:

Attached is a FOIA request for the City of Batesville and the Batesville Fire Department regarding the property located at 477 East Main Street, Batesville, AR.

Please let me know if you have any questions or if this request should be sent elsewhere.

Thank you,

Allie

Allie Cook | Environmental Scientist

Direct **+1 (816) 412-1766** | Business **+1 (816) 412-1741** | Fax **+1 (816) 410-1748** |

allie.cook@tetratech.com

Tetra Tech | *Leading with Science®* | EMI
415 Oak Street | Kansas City, MO 64106 | tetratech.com

This message, including any attachments, may include privileged, confidential and/or inside information. Any distribution or use of this communication by anyone other than the intended recipient is strictly prohibited and may be unlawful. If you are not the intended recipient, please notify the sender by replying to this message and then delete it from your system.

Please consider the environment before printing. Read more

TETRA TECH

APPENDIX D REGULATORY DATABASE REPORT

Former Grays Hospital
477 East Main Street
Batesville, AR 72501

Inquiry Number: 8101203.2s
September 08, 2025

The EDR Radius Map™ Report with GeoCheck®

6 Armstrong Road, 4th floor
Shelton, CT 06484
Toll Free: 800.352.0050
www.edrnet.com

TABLE OF CONTENTS

SECTION	PAGE
Executive Summary	ES1
Overview Map	2
Detail Map	3
Map Findings Summary	4
Map Findings	8
Orphan Summary	240
Government Records Searched/Data Currency Tracking	GR-1

GEOCHECK ADDENDUM

Physical Setting Source Addendum	A-1
Physical Setting Source Summary	A-2
Physical Setting SSURGO Soil Map	A-5
Physical Setting Source Map	A-10
Physical Setting Source Map Findings	A-12
Physical Setting Source Records Searched	PSGR-1

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. **NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA) INFORMATION PROVIDED IN THIS REPORT.** Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2025 by Environmental Data Resources, LLC. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, LLC, or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

EXECUTIVE SUMMARY

A search of available environmental records was conducted by Environmental Data Resources, Inc (EDR). The report was designed to assist parties seeking to meet the search requirements of EPA's Standards and Practices for All Appropriate Inquiries (40 CFR Part 312), the ASTM Standard Practice for Environmental Site Assessments (E1527 - 21), the ASTM Standard Practice for Environmental Site Assessments for Forestland or Rural Property (E2247 - 16), the ASTM Standard Practice for Limited Environmental Due Diligence: Transaction Screen Process (E1528 - 22) or custom requirements developed for the evaluation of environmental risk associated with a parcel of real estate.

TARGET PROPERTY INFORMATION

ADDRESS

477 EAST MAIN STREET
BATESVILLE, AR 72501

COORDINATES

Latitude (North):	35.7724880 - 35° 46' 20.95''
Longitude (West):	91.6509190 - 91° 39' 3.30''
Universal Tranverse Mercator:	Zone 15
UTM X (Meters):	621944.2
UTM Y (Meters):	3959354.0
Elevation:	322 ft. above sea level

USGS TOPOGRAPHIC MAP ASSOCIATED WITH TARGET PROPERTY

Target Property Map:	15654974 BATESVILLE, AR
Version Date:	2020

AERIAL PHOTOGRAPHY IN THIS REPORT

Portions of Photo from:	20230829
Source:	USDA

MAPPED SITES SUMMARY

Target Property Address:
477 EAST MAIN STREET
BATESVILLE, AR 72501

Click on Map ID to see full detail.

MAP ID	SITE NAME	ADDRESS	DATABASE ACRONYMS	RELATIVE ELEVATION	DIST (ft. & mi.) DIRECTION
A1	WHITE RIVER MEDICAL	477 E MAIN	AIRS, PERMITS		TP
A2	WHITE RIVER MEDICAL	477 E MAIN	FINDS		TP
A3	DOWNTOWN EXXON SS	416 EAST MAIN	UST, PERMITS	Higher	74, 0.014, South
A4	DOWNTOWN EXXON SS	416 EAST MAIN	UST FINDER	Higher	74, 0.014, South
A5	WILKINS ARTHUR	416 E MAIN ST	EDR Hist Auto	Higher	74, 0.014, South
A6	DOWNTOWN EXXON SERVI	416 MAIN E	EDR Hist Auto	Higher	74, 0.014, South
B7	NU-WAY CLEANERS & LA	121 S 4TH ST	EDR Hist Cleaner	Higher	158, 0.030, South
B8	NU-WAY CLEANERS & LA	121 S 4TH ST	HW GEN, PERMITS	Higher	158, 0.030, South
B9	NU-WAY CLEANERS & LA	121 S 4TH ST	RCRA NonGen / NLR, FINDS, ECHO	Higher	158, 0.030, South
C10	BATESVILLE, CITY OF	500 E. MAIN STREET	SWRCY	Higher	229, 0.043, ESE
B11	OFFICE OF EMERGENCY	368 E MAIN ST	LTANKS, UST, Financial Assurance, PERMITS	Higher	277, 0.052, SSW
B12	OFFICE OF EMERGENCY	368 E MAIN ST	UST FINDER, UST FINDER RELEASE	Higher	277, 0.052, SSW
C13	COLLIER OIL COMPANY,	POST OFFICE BOX 2222	UST, AST, PERMITS	Lower	419, 0.079, SE
C14	CROUCH FUNERAL HOME	510 E. COLLEGE	UST, PERMITS	Lower	439, 0.083, SE
C15	CROUCH FUNERAL HOME	510 E. COLLEGE	UST FINDER	Lower	439, 0.083, SE
D16	AR GARBAGE	3RD & MAIN	RCRA NonGen / NLR	Lower	507, 0.096, SW
D17	AR GARBAGE	3RD & MAIN	HW GEN	Lower	507, 0.096, SW
18	ARKANSAS SAND COMPAN		US MINES	Lower	626, 0.119, South
19	JAY F SHELL	551 E BOSWELL ST	EDR Hist Auto	Higher	654, 0.124, SE
E20	QUIK MART #1	312 FOURTH STREET	UST FINDER, UST FINDER RELEASE	Lower	813, 0.154, SSE
E21	QUIK MART #1	312 FOURTH STREET	LTANKS, UST, PERMITS	Lower	813, 0.154, SSE
E22	SOUTHWESTERN BELL	410 E BOSWELL	RCRA NonGen / NLR, FINDS, ECHO, HW GEN, PERMITS	Lower	818, 0.155, SSE
E23	SOUTHWESTERN BELL TE	410 EAST BOSWELL	UST	Lower	818, 0.155, SSE
E24	SOUTHWESTERN BELL TE	410 EAST BOSWELL	UST FINDER	Lower	818, 0.155, SSE
25	INDEPENDENCE CO.RECY	192 E. MAIN ST.	SWRCY	Lower	959, 0.182, SW
F26	SYNERGY GROUP INC	160 E BOSWELL	RCRA NonGen / NLR, FINDS, ECHO	Lower	1286, 0.244, SSW
F27	SYNERGY GROUP INC	160 E BOSWELL	HW GEN	Lower	1286, 0.244, SSW
G28	STREET AUTO & TRACTO	COLLEGE & CENTRAL	UST, PERMITS	Lower	1301, 0.246, SSW
G29	STREET AUTO & TRACTO	COLLEGE & CENTRAL	UST FINDER	Lower	1301, 0.246, SSW
G30	COCA COLA BOTTLING C	100 EAST COLLEGE STR	UST FINDER, UST FINDER RELEASE	Lower	1301, 0.246, SSW
G31	COCA COLA BOTTLING C	100 EAST COLLEGE STR	UST	Lower	1301, 0.246, SSW
G32	COCA-COLA BOTTLING C	100 EAST COLLEGE STR	LTANKS	Lower	1301, 0.246, SSW
H33	QUIK MART #5	587 CENTRAL AVE	UST FINDER, UST FINDER RELEASE	Lower	1843, 0.349, West
H34	QUIK MART #5	587 CENTRAL AVE	LTANKS, UST, PERMITS	Lower	1843, 0.349, West
I35	QUIK MART #16	810 HARRISON ST	UST FINDER, UST FINDER RELEASE	Lower	2115, 0.401, ESE
I36	QUIK MART #16	810 HARRISON ST	LTANKS, UST, PERMITS	Lower	2115, 0.401, ESE

EXECUTIVE SUMMARY

TARGET PROPERTY SEARCH RESULTS

The target property was identified in the following records. For more information on this property see page 8 of the attached EDR Radius Map report:

Site	Database(s)	EPA ID
WHITE RIVER MEDICAL 477 E MAIN BATESVILLE, AR 72501	AIRS Afin: 3200037 PERMITS Facility Status: A	N/A
WHITE RIVER MEDICAL 477 E MAIN BATESVILLE, AR 72501	FINDS Registry ID:: 110025002823	N/A

DATABASES WITH NO MAPPED SITES

No mapped sites were found in EDR's search of available ("reasonably ascertainable ") government records either on the target property or within the search radius around the target property for the following databases:

STANDARD ENVIRONMENTAL RECORDS

Lists of Federal NPL (Superfund) sites

NPL ---------- National Priority List
Proposed NPL ---------- Proposed National Priority List Sites
NPL LIENS ---------- Federal Superfund Liens

Lists of Federal Delisted NPL sites

Delisted NPL ---------- National Priority List Deletions

Lists of Federal sites subject to CERCLA removals and CERCLA orders

FEDERAL FACILITY ---------- Federal Facility Site Information listing
SEMS ---------- Superfund Enterprise Management System

Lists of Federal CERCLA sites with NFRAP

SEMS-ARCHIVE ---------- Superfund Enterprise Management System Archive

Lists of Federal RCRA facilities undergoing Corrective Action

CORRACTS ---------- Corrective Action Report

Lists of Federal RCRA TSD facilities

RCRA-TSDF ---------- RCRA - Treatment, Storage and Disposal

EXECUTIVE SUMMARY

Lists of Federal RCRA generators

RCRA-LQG ..... RCRA - Large Quantity Generators
RCRA-SQG ..... RCRA - Small Quantity Generators
RCRA-VSQG ..... RCRA - Very Small Quantity Generators (Formerly Conditionally Exempt Small Quantity Generators)

Federal institutional controls / engineering controls registries

LUCIS ..... Land Use Control Information System
US ENG CONTROLS ..... Engineering Controls Sites List
US INST CONTROLS ..... Institutional Controls Sites List

Federal ERNS list

ERNS ..... Emergency Response Notification System

Lists of state- and tribal (Superfund) equivalent sites

SHWS ..... Hazardous Substance Remedial Action Trust Fund Priority List

Lists of state and tribal landfills and solid waste disposal facilities

SWF/LF ..... Solid Waste Facility Permit Database
SWID ..... Solid Waste Illegal Dumps Database

Lists of state and tribal leaking storage tanks

INDIAN LUST ..... Leaking Underground Storage Tanks on Indian Land

Lists of state and tribal registered storage tanks

FEMA UST ..... Underground Storage Tank Listing
INDIAN UST ..... Underground Storage Tanks on Indian Land

State and tribal institutional control / engineering control registries

ENG CONTROLS ..... Engineering Controls Sites Listing
INST CONTROL ..... Institutional Control/Land Use Restriction Sites

Lists of state and tribal voluntary cleanup sites

INDIAN VCP ..... Voluntary Cleanup Priority Listing
VCP ..... Voluntary Cleanup Program Sites

Lists of state and tribal brownfield sites

BROWNFIELDS ..... Brownfields Projects

ADDITIONAL ENVIRONMENTAL RECORDS

Local Brownfield lists

US BROWNFIELDS ..... A Listing of Brownfields Sites

EXECUTIVE SUMMARY

Local Lists of Landfill / Solid Waste Disposal Sites

INDIAN ODI	Report on the Status of Open Dumps on Indian Lands
ODI	Open Dump Inventory
DEBRIS REGION 9	Torres Martinez Reservation Illegal Dump Site Locations
IHS OPEN DUMPS	Open Dumps on Indian Land

Local Lists of Hazardous waste / Contaminated Sites

US HIST CDL	Delisted National Clandestine Laboratory Register
CDL	Methamphetamine Contaminated Properties Listing
US CDL	National Clandestine Laboratory Register

Local Land Records

LIENS 2	CERCLA Lien Information

Records of Emergency Release Reports

HMIRS	Hazardous Materials Information Reporting System
SPILLS	Emergency Response Incidents
SPILLS 90	SPILLS 90 data from FirstSearch
SPILLS 80	SPILLS 80 data from FirstSearch

Other Ascertainable Records

FUDS	Formerly Used Defense Sites
DOD	Department of Defense Sites
SCRD DRYCLEANERS	State Coalition for Remediation of Drycleaners Listing
US FIN ASSUR	Financial Assurance Information
EPA WATCH LIST	EPA WATCH LIST
2020 COR ACTION	2020 Corrective Action Program List
TSCA	Toxic Substances Control Act
TRIS	Toxic Chemical Release Inventory System
SSTS	Section 7 Tracking Systems
ROD	Records Of Decision
RMP	Risk Management Plans
RAATS	RCRA Administrative Action Tracking System
PRP	Potentially Responsible Parties
PADS	PCB Activity Database System
ICIS	Integrated Compliance Information System
FTTS	FIFRA/ TSCA Tracking System - FIFRA (Federal Insecticide, Fungicide, & Rodenticide Act)/TSCA (Toxic Substances Control Act)
MLTS	Material Licensing Tracking System
COAL ASH DOE	Steam-Electric Plant Operation Data
COAL ASH EPA	Coal Combustion Residues Surface Impoundments List
PCB TRANSFORMER	PCB Transformer Registration Database
RADINFO	Radiation Information Database
HIST FTTS	FIFRA/TSCA Tracking System Administrative Case Listing
DOT OPS	Incident and Accident Data
CONSENT	Superfund (CERCLA) Consent Decrees
INDIAN RESERV	Indian Reservations
FUSRAP	Formerly Utilized Sites Remedial Action Program
UMTRA	Uranium Mill Tailings Sites

LEAD SMELTERS - Lead Smelter Sites
US AIRS - Aerometric Information Retrieval System Facility Subsystem
ABANDONED MINES - Abandoned Mines
MINES MRDS - Mineral Resources Data System
DOCKET HWC - Hazardous Waste Compliance Docket Listing
ECHO - Enforcement & Compliance History Information
UXO - Unexploded Ordnance Sites
FUELS PROGRAM - EPA Fuels Program Registered Listing
PFAS NPL - Superfund Sites with PFAS Detections Information
PFAS FEDERAL SITES - Federal Sites PFAS Information
PFAS TSCA - PFAS Manufacture and Imports Information
PFAS TRIS - List of PFAS Added to the TRI
PFAS RCRA MANIFEST - PFAS Transfers Identified In the RCRA Database Listing
PFAS ATSDR - PFAS Contamination Site Location Listing
PFAS WQP - Ambient Environmental Sampling for PFAS
PFAS PROJECT - NORTHEASTERN UNIVERSITY PFAS PROJECT
PFAS NPDES - Clean Water Act Discharge Monitoring Information
PFAS ECHO - Facilities in Industries that May Be Handling PFAS Listing
PFAS ECHO FIRE TRAIN - Facilities in Industries that May Be Handling PFAS Listing
PFAS PT 139 AIRPORT - All Certified Part 139 Airports PFAS Information Listing
AQUEOUS FOAM NRC - Aqueous Foam Related Incidents Listing
BIOSOLIDS - ICIS-NPDES Biosolids Facility Data
E MANIFEST - Hazardous Waste Electronic Manifest System
PFAS - Per- and Polyfluoroalkyl Substances
AQUEOUS FOAM - Aqueous Film-Forming Foam Site Listing
ASBESTOS - Asbestos Notification of Intent Database
COAL ASH - Coal Ash Disposal Site Listing
ENF - Consent Administrative Order, Notice of Violation Information Database
Financial Assurance - Financial Assurance Information Listing
AR Sludge - Poultry Sludge Permit Sites
TIER 2 - Tier 2 Information Listing
UIC - Underground Injection Wells Database Listing

EDR HIGH RISK HISTORICAL RECORDS

EDR Exclusive Records

EDR MGP - EDR Proprietary Manufactured Gas Plants

EDR RECOVERED GOVERNMENT ARCHIVES

Exclusive Recovered Govt. Archives

RGA HWS - Recovered Government Archive State Hazardous Waste Facilities List
RGA LF - Recovered Government Archive Solid Waste Facilities List
RGA LUST - Recovered Government Archive Leaking Underground Storage Tank

SURROUNDING SITES: SEARCH RESULTS

Surrounding sites were identified in the following databases.

Elevations have been determined from the USGS Digital Elevation Model and should be evaluated on a relative (not an absolute) basis. Relative elevation information between sites of close proximity should be field verified. Sites with an elevation equal to or higher than the target property have been differentiated below from sites with an elevation lower than the target property.
Page numbers and map identification numbers refer to the EDR Radius Map report where detailed data on individual sites can be reviewed.

Sites listed in ***bold italics*** are in multiple databases.

Unmappable (orphan) sites are not considered in the foregoing analysis.

EXECUTIVE SUMMARY

STANDARD ENVIRONMENTAL RECORDS

Lists of state and tribal leaking storage tanks

LTANKS: Leaking Storage Tank Locations

A review of the LTANKS list, as provided by EDR, and dated 06/05/2025 has revealed that there are 5 LTANKS sites within approximately 0.5 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
OFFICE OF EMERGENCY	***368 E MAIN ST***	***SSW 0 - 1/8 (0.052 mi.)***	***B11***	***61***
NFA Issued: 2014-03-20 00:00:00				

Lower Elevation	Address	Direction / Distance	Map ID	Page
QUIK MART #1	***312 FOURTH STREET***	***SSE 1/8 - 1/4 (0.154 mi.)***	***E21***	***90***
NFA Issued: 2007-09-27 00:00:00				
COCA-COLA BOTTLING C	100 EAST COLLEGE STR	SSW 1/8 - 1/4 (0.246 mi.)	G32	223
NFA Issued: 1999-02-19 00:00:00				
QUIK MART #5	***587 CENTRAL AVE***	***W 1/4 - 1/2 (0.349 mi.)***	***H34***	***225***
NFA Issued: 2007-09-18 00:00:00				
QUIK MART #16	***810 HARRISON ST***	***ESE 1/4 - 1/2 (0.401 mi.)***	***I36***	***233***
NFA Issued: 2007-09-18 00:00:00				

Lists of state and tribal registered storage tanks

UST: RST Owner & Facilities.

A review of the UST list, as provided by EDR, and dated 06/05/2025 has revealed that there are 8 UST sites within approximately 0.25 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
DOWNTOWN EXXON SS	***416 EAST MAIN***	***S 0 - 1/8 (0.014 mi.)***	***A3***	***13***
Tank Status: PO				
Facility Id: 32000050				
Facility Id: 32000050				
ADEQ Facility ID: 32-00355				
OFFICE OF EMERGENCY	***368 E MAIN ST***	***SSW 0 - 1/8 (0.052 mi.)***	***B11***	***61***
Tank Status: PO				
Facility Id: 32001616				
Facility Id: 32001616				
ADEQ Facility ID: 32-00469				

Lower Elevation	Address	Direction / Distance	Map ID	Page
COLLIER OIL COMPANY,	***POST OFFICE BOX 2222***	***SE 0 - 1/8 (0.079 mi.)***	***C13***	***69***
Tank Status: PO				
Facility Id: 32000044				

Facility Id: 32000044 ADEQ Facility ID: 32-00349				
CROUCH FUNERAL HOME Tank Status: PO Facility Id: 32000053 Facility Id: 32000053 ADEQ Facility ID: 32-00358	***510 E. COLLEGE***	***SE 0 - 1/8 (0.083 mi.)***	***C14***	***79***
QUIK MART #1 Tank Status: PO Facility Id: 32000082 Facility Id: 32000082 ADEQ Facility ID: 32-00386	***312 FOURTH STREET***	***SSE 1/8 - 1/4 (0.154 mi.)***	***E21***	***90***
SOUTHWESTERN BELL TE Tank Status: PO Facility Id: 32000107 Facility Id: 32000107 ADEQ Facility ID: 32-00288	410 EAST BOSWELL	SSE 1/8 - 1/4 (0.155 mi.)	E23	103
STREET AUTO & TRACTO Tank Status: PO Facility Id: 32000071 Facility Id: 32000071 ADEQ Facility ID: 32-00376	***COLLEGE & CENTRAL***	***SSW 1/8 - 1/4 (0.246 mi.)***	***G28***	***215***
COCA COLA BOTTLING C Tank Status: PO Facility Id: 32000063 Facility Id: 32000063 ADEQ Facility ID: 32-00001	100 EAST COLLEGE STR	SSW 1/8 - 1/4 (0.246 mi.)	G31	221

AST: Aboveground Tank Database

A review of the AST list, as provided by EDR, and dated 06/05/2025 has revealed that there is 1 AST site within approximately 0.25 miles of the target property.

Lower Elevation	Address	Direction / Distance	Map ID	Page
COLLIER OIL COMPANY, Facility Id: 32000044 Facility Id: 32000044 AFIN: 3200349	***POST OFFICE BOX 2222***	***SE 0 - 1/8 (0.079 mi.)***	***C13***	***69***

ADDITIONAL ENVIRONMENTAL RECORDS

Local Lists of Landfill / Solid Waste Disposal Sites

SWRCY: Registered Directory of the Department of Environmental Quality.

A review of the SWRCY list, as provided by EDR, and dated 07/24/2025 has revealed that there are 2 SWRCY sites within approximately 0.5 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
BATESVILLE, CITY OF Facility Id: 321 Facility Status: A	500 E. MAIN STREET	ESE 0 - 1/8 (0.043 mi.)	C10	35

Lower Elevation	Address	Direction / Distance	Map ID	Page
INDEPENDENCE CO.RECY Facility Id: 127 Facility Status: A	192 E. MAIN ST.	SW 1/8 - 1/4 (0.182 mi.)	25	106

Other Ascertainable Records

RCRA NonGen / NLR: RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Non-Generators do not presently generate hazardous waste.

A review of the RCRA NonGen / NLR list, as provided by EDR, and dated 06/02/2025 has revealed that there are 4 RCRA NonGen / NLR sites within approximately 0.25 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
NU-WAY CLEANERS & LA EPA ID:: ARD035436997	***121 S 4TH ST***	***S 0 - 1/8 (0.030 mi.)***	***B9***	***29***

Lower Elevation	Address	Direction / Distance	Map ID	Page
AR GARBAGE EPA ID:: ARD000708917	3RD & MAIN	SW 0 - 1/8 (0.096 mi.)	D16	84
SOUTHWESTERN BELL EPA ID:: ARR000001800	***410 E BOSWELL***	***SSE 1/8 - 1/4 (0.155 mi.)***	***E22***	***96***
SYNERGY GROUP INC EPA ID:: ARD084941582	***160 E BOSWELL***	***SSW 1/8 - 1/4 (0.244 mi.)***	***F26***	***211***

US MINES: Mines Master Index File. The source of this database is the Dept. of Labor, Mine Safety and Health Administration.

A review of the US MINES list, as provided by EDR, has revealed that there is 1 US MINES site within approximately 0.25 miles of the target property.

Lower Elevation	Address	Direction / Distance	Map ID	Page
ARKANSAS SAND COMPAN Database: US MINES, Date of Government Version: 05/01/2025 Mine ID:: 0301904		S 0 - 1/8 (0.119 mi.)	18	87

EXECUTIVE SUMMARY

UST FINDER: EPA developed UST Finder, a web map application containing a comprehensive, state-sourced national map of underground storage tank (UST) and leaking UST (LUST) data. It provides the attributes and locations of active and closed USTs, UST facilities, and LUST sites from states and from Tribal lands and US territories . UST Finder contains information about proximity of UST facilities and LUST sites to: surface and groundwater public drinking water protection areas; estimated number of private domestic wells and number of people living nearby; and flooding and wildfires.

A review of the UST FINDER list, as provided by EDR, and dated 06/08/2023 has revealed that there are 7 UST FINDER sites within approximately 0.25 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
DOWNTOWN EXXON SS	416 EAST MAIN	S 0 - 1/8 (0.014 mi.)	A4	22
OFFICE OF EMERGENCY	***368 E MAIN ST***	***SSW 0 - 1/8 (0.052 mi.)***	***B12***	***67***

Lower Elevation	Address	Direction / Distance	Map ID	Page
CROUCH FUNERAL HOME	510 E. COLLEGE	SE 0 - 1/8 (0.083 mi.)	C15	83
QUIK MART #1	***312 FOURTH STREET***	***SSE 1/8 - 1/4 (0.154 mi.)***	***E20***	***88***
SOUTHWESTERN BELL TE	410 EAST BOSWELL	SSE 1/8 - 1/4 (0.155 mi.)	E24	105
STREET AUTO & TRACTO	COLLEGE & CENTRAL	SSW 1/8 - 1/4 (0.246 mi.)	G29	219
COCA COLA BOTTLING C	***100 EAST COLLEGE STR***	***SSW 1/8 - 1/4 (0.246 mi.)***	***G30***	***220***

UST FINDER RELEASE: US EPA's UST Finder data is a national composite of leaking underground storage tanks. This data contains information about, and locations of, leaking underground storage tanks. Data was collected from state sources and standardized into a national profile by EPA's Office of Underground Storage Tanks, Office of Research and Development, and the Association of State and Territorial Solid Waste Management Officials.

A review of the UST FINDER RELEASE list, as provided by EDR, and dated 06/08/2023 has revealed that there are 5 UST FINDER RELEASE sites within approximately 0.5 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
OFFICE OF EMERGENCY	***368 E MAIN ST***	***SSW 0 - 1/8 (0.052 mi.)***	***B12***	***67***

Lower Elevation	Address	Direction / Distance	Map ID	Page
QUIK MART #1	***312 FOURTH STREET***	***SSE 1/8 - 1/4 (0.154 mi.)***	***E20***	***88***
COCA COLA BOTTLING C	***100 EAST COLLEGE STR***	***SSW 1/8 - 1/4 (0.246 mi.)***	***G30***	***220***
QUIK MART #5	***587 CENTRAL AVE***	***W 1/4 - 1/2 (0.349 mi.)***	***H33***	***224***
QUIK MART #16	***810 HARRISON ST***	***ESE 1/4 - 1/2 (0.401 mi.)***	***I35***	***232***

HW GEN: This is a database listing of Arkansas Hazardous Waste Generators.

A review of the HW GEN list, as provided by EDR, and dated 05/04/2025 has revealed that there are 4 HW GEN sites within approximately 0.25 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
NU-WAY CLEANERS & LA	***121 S 4TH ST***	***S 0 - 1/8 (0.030 mi.)***	***B8***	***26***

Lower Elevation	Address	Direction / Distance	Map ID	Page
AR GARBAGE	3RD & MAIN	SW 0 - 1/8 (0.096 mi.)	D17	87
SOUTHWESTERN BELL	***410 E BOSWELL***	***SSE 1/8 - 1/4 (0.155 mi.)***	***E22***	***96***
SYNERGY GROUP INC	160 E BOSWELL	SSW 1/8 - 1/4 (0.244 mi.)	F27	214

EXECUTIVE SUMMARY

EDR HIGH RISK HISTORICAL RECORDS

EDR Exclusive Records

EDR Hist Auto: EDR has searched selected national collections of business directories and has collected listings of potential gas station/filling station/service station sites that were available to EDR researchers. EDR's review was limited to those categories of sources that might, in EDR's opinion, include gas station/filling station/service station establishments. The categories reviewed included, but were not limited to gas, gas station, gasoline station, filling station, auto, automobile repair, auto service station, service station, etc. This database falls within a category of information EDR classifies as "High Risk Historical Records", or HRHR. EDR's HRHR effort presents unique and sometimes proprietary data about past sites and operations that typically create environmental concerns, but may not show up in current government records searches.

A review of the EDR Hist Auto list, as provided by EDR, has revealed that there are 3 EDR Hist Auto sites within approximately 0.125 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
WILKINS ARTHUR	416 E MAIN ST	S 0 - 1/8 (0.014 mi.)	A5	24
DOWNTOWN EXXON SERVI	416 MAIN E	S 0 - 1/8 (0.014 mi.)	A6	25
JAY F SHELL	551 E BOSWELL ST	SE 0 - 1/8 (0.124 mi.)	19	88

EDR Hist Cleaner: EDR has searched selected national collections of business directories and has collected listings of potential dry cleaner sites that were available to EDR researchers. EDR's review was limited to those categories of sources that might, in EDR's opinion, include dry cleaning establishments. The categories reviewed included, but were not limited to dry cleaners, cleaners, laundry, laundromat, cleaning/laundry, wash & dry etc. This database falls within a category of information EDR classifies as "High Risk Historical Records", or HRHR. EDR's HRHR effort presents unique and sometimes proprietary data about past sites and operations that typically create environmental concerns, but may not show up in current government records searches.

A review of the EDR Hist Cleaner list, as provided by EDR, has revealed that there is 1 EDR Hist Cleaner site within approximately 0.125 miles of the target property.

Equal/Higher Elevation	Address	Direction / Distance	Map ID	Page
NU-WAY CLEANERS & LA	121 S 4TH ST	S 0 - 1/8 (0.030 mi.)	B7	25

EXECUTIVE SUMMARY

There were no unmapped sites in this report.

OVERVIEW MAP - 8101203.2S

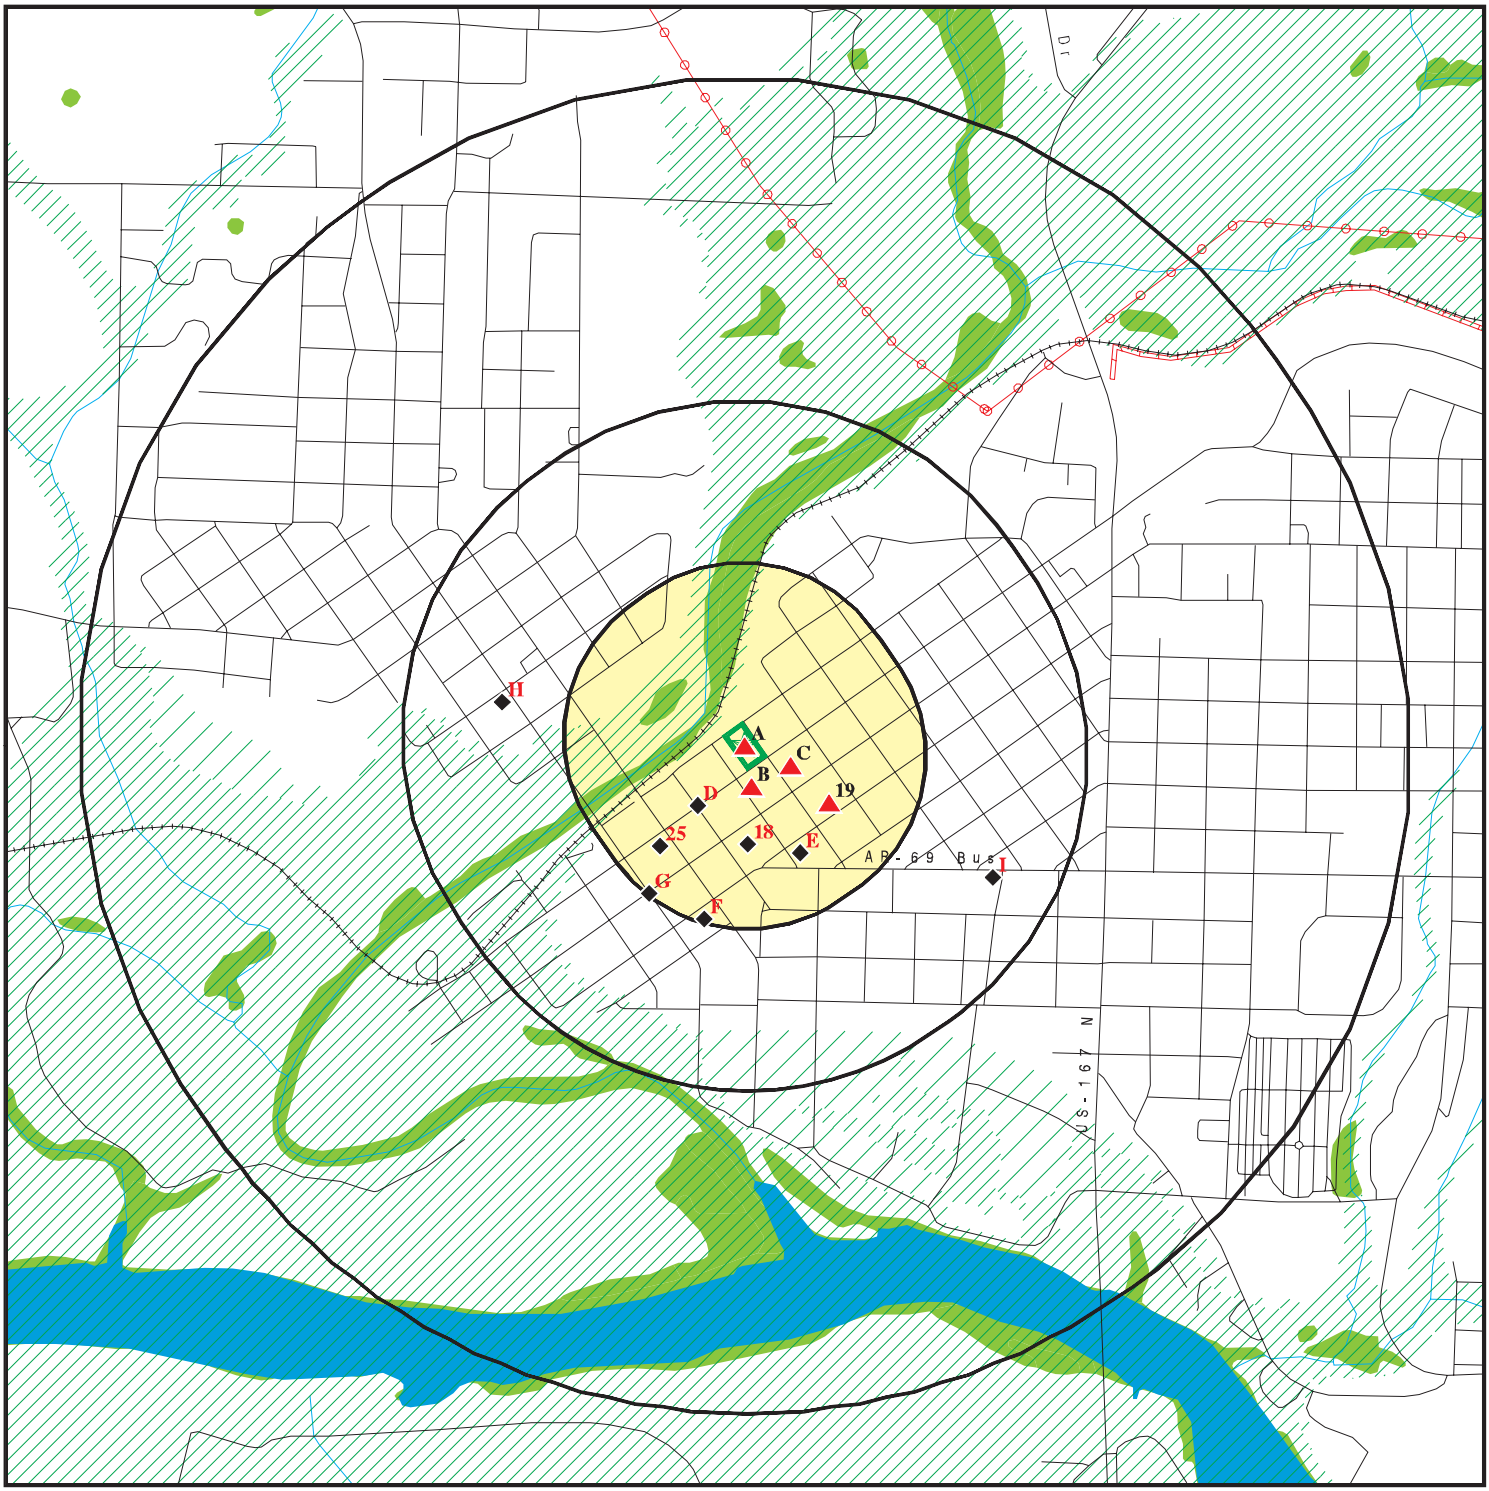

0 1/4 1/2 1 Miles

- Target Property
- Sites at elevations higher than or equal to the target property
- Sites at elevations lower than the target property
- Manufactured Gas Plants
- National Priority List Sites
- Dept. Defense Sites
- Indian Reservations BIA
- Power transmission lines
- Pipelines
- Special Flood Hazard Area (1%)
- 0.2% Annual Chance Flood Hazard
- National Wetland Inventory
- State Wetlands

This report includes Interactive Map Layers to display and/or hide map information. The legend includes only those icons for the default map view.

SITE NAME:	Former Grays Hospital	CLIENT:	Tetra Tech EMI
ADDRESS:	477 East Main Street Batesville AR 72501	CONTACT:	Allie Cook
		INQUIRY #:	8101203.2s
LAT/LONG:	35.772488 / 91.650919	DATE:	September 08, 2025 1:10 pm

Copyright © 2025 EDR, Inc. © 2015 TomTom Rel. 2015.

DETAIL MAP - 8101203.2S

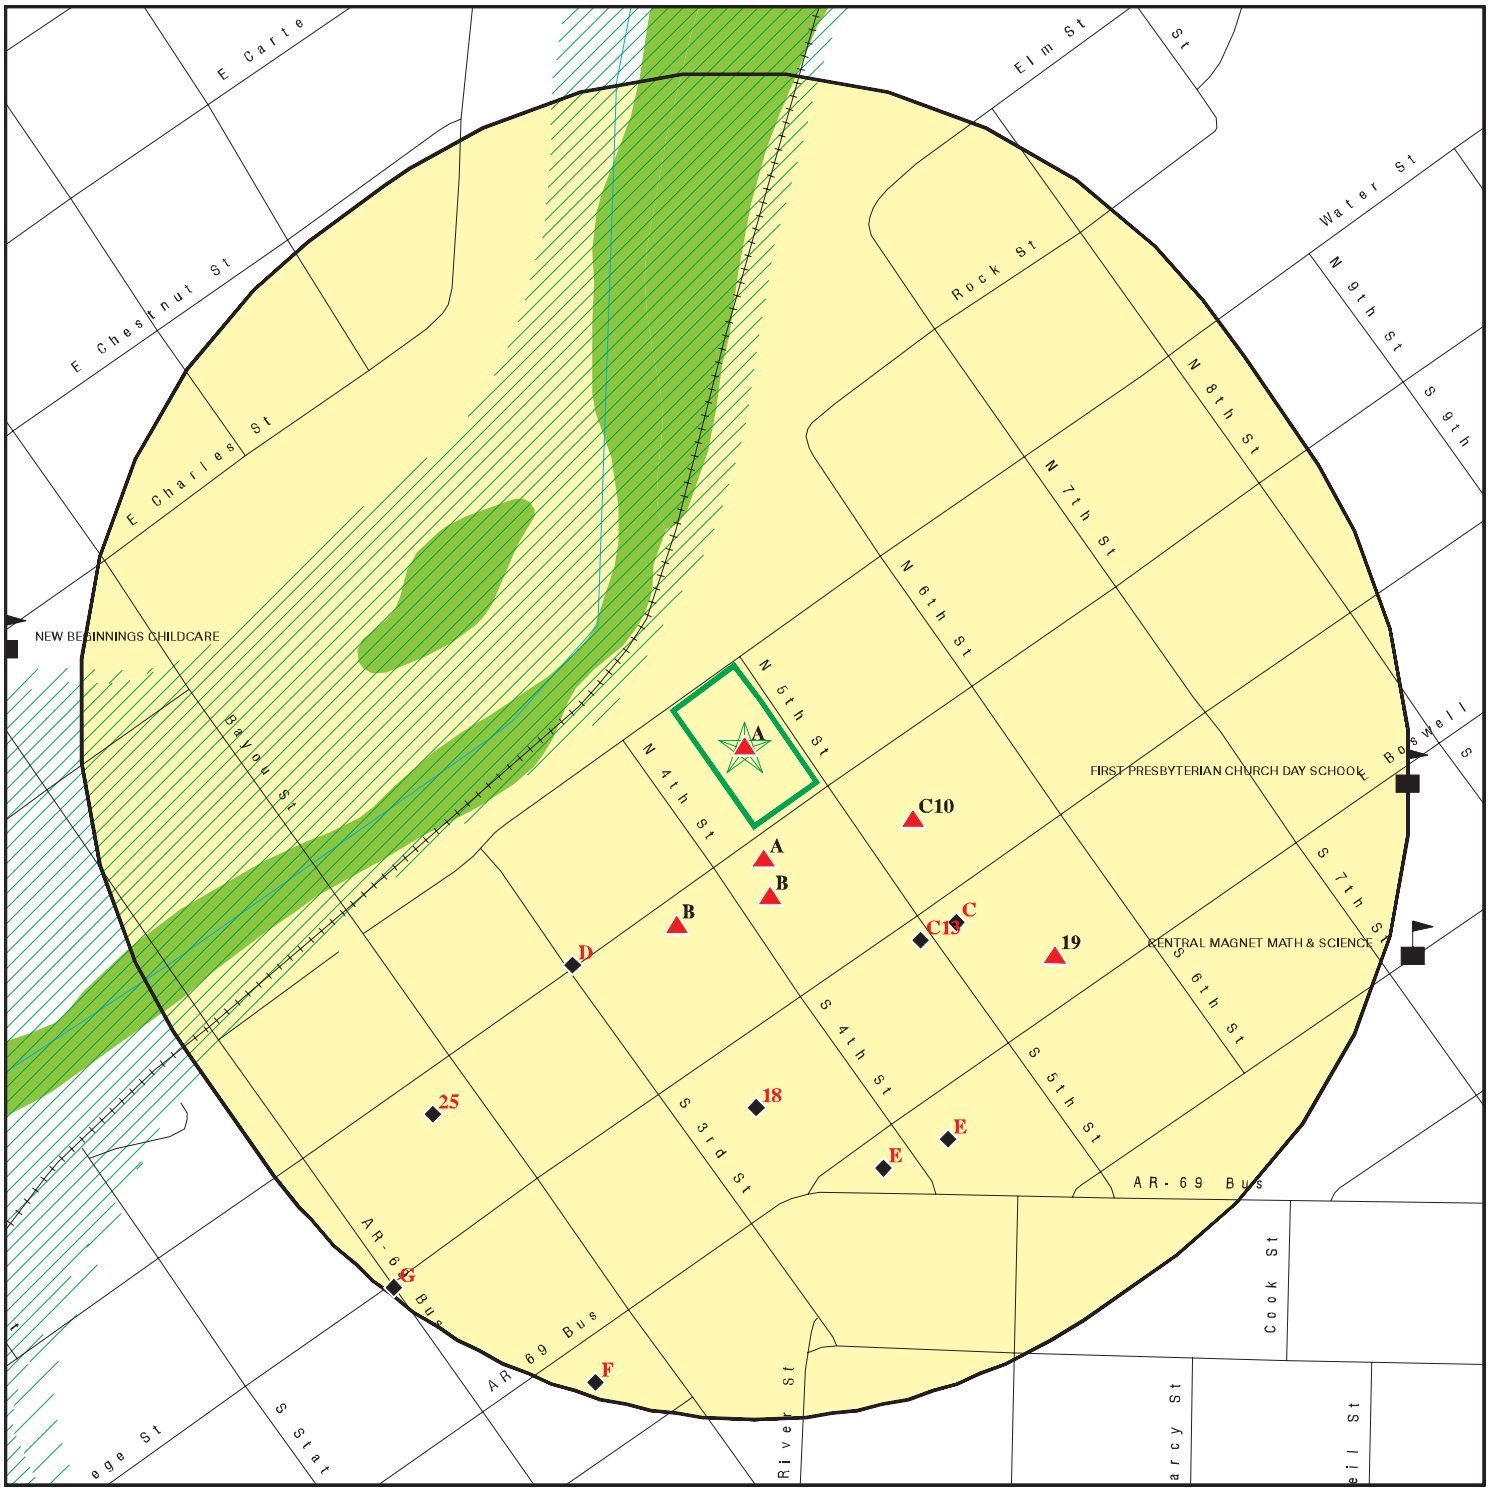

- Target Property
- Sites at elevations higher than or equal to the target property
- Sites at elevations lower than the target property
- Manufactured Gas Plants
- Sensitive Receptors
- National Priority List Sites
- Dept. Defense Sites
- Indian Reservations BIA
- Special Flood Hazard Area (1%)
- 0.2% Annual Chance Flood Hazard
- National Wetland Inventory
- State Wetlands

This report includes Interactive Map Layers to display and/or hide map information. The legend includes only those icons for the default map view.

SITE NAME:	Former Grays Hospital	CLIENT:	Tetra Tech EMI
ADDRESS:	477 East Main Street Batesville AR 72501	CONTACT:	Allie Cook
		INQUIRY #:	8101203.2s
LAT/LONG:	35.772488 / 91.650919	DATE:	September 08, 2025 1:12 pm

Copyright © 2025 EDR, Inc. © 2015 TomTom Rel. 2015.

MAP FINDINGS SUMMARY

Database	Search Distance (Miles)	Target Property	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
STANDARD ENVIRONMENTAL RECORDS								
Lists of Federal NPL (Superfund) sites								
NPL	1.000		0	0	0	0	NR	0
Proposed NPL	1.000		0	0	0	0	NR	0
NPL LIENS	1.000		0	0	0	0	NR	0
Lists of Federal Delisted NPL sites								
Delisted NPL	1.000		0	0	0	0	NR	0
Lists of Federal sites subject to CERCLA removals and CERCLA orders								
FEDERAL FACILITY	0.500		0	0	0	NR	NR	0
SEMS	0.500		0	0	0	NR	NR	0
Lists of Federal CERCLA sites with NFRAP								
SEMS-ARCHIVE	0.500		0	0	0	NR	NR	0
Lists of Federal RCRA facilities undergoing Corrective Action								
CORRACTS	1.000		0	0	0	0	NR	0
Lists of Federal RCRA TSD facilities								
RCRA-TSDF	0.500		0	0	0	NR	NR	0
Lists of Federal RCRA generators								
RCRA-LQG	0.250		0	0	NR	NR	NR	0
RCRA-SQG	0.250		0	0	NR	NR	NR	0
RCRA-VSQG	0.250		0	0	NR	NR	NR	0
Federal institutional controls / engineering controls registries								
LUCIS	0.500		0	0	0	NR	NR	0
US ENG CONTROLS	0.500		0	0	0	NR	NR	0
US INST CONTROLS	0.500		0	0	0	NR	NR	0
Federal ERNS list								
ERNS	TP		NR	NR	NR	NR	NR	0
Lists of state- and tribal (Superfund) equivalent sites								
SHWS	1.000		0	0	0	0	NR	0
Lists of state and tribal landfills and solid waste disposal facilities								
SWF/LF	0.500		0	0	0	NR	NR	0
SWID	0.500		0	0	0	NR	NR	0
Lists of state and tribal leaking storage tanks								
LTANKS	0.500		1	2	2	NR	NR	5

MAP FINDINGS SUMMARY

Database	Search Distance (Miles)	Target Property	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
INDIAN LUST	0.500		0	0	0	NR	NR	0
Lists of state and tribal registered storage tanks								
FEMA UST	0.250		0	0	NR	NR	NR	0
UST	0.250		4	4	NR	NR	NR	8
AST	0.250		1	0	NR	NR	NR	1
INDIAN UST	0.250		0	0	NR	NR	NR	0
State and tribal institutional control / engineering control registries								
ENG CONTROLS	0.500		0	0	0	NR	NR	0
INST CONTROL	0.500		0	0	0	NR	NR	0
Lists of state and tribal voluntary cleanup sites								
INDIAN VCP	0.500		0	0	0	NR	NR	0
VCP	0.500		0	0	0	NR	NR	0
Lists of state and tribal brownfield sites								
BROWNFIELDS	0.500		0	0	0	NR	NR	0
ADDITIONAL ENVIRONMENTAL RECORDS								
Local Brownfield lists								
US BROWNFIELDS	0.500		0	0	0	NR	NR	0
Local Lists of Landfill / Solid Waste Disposal Sites								
SWRCY	0.500		1	1	0	NR	NR	2
INDIAN ODI	0.500		0	0	0	NR	NR	0
ODI	0.500		0	0	0	NR	NR	0
DEBRIS REGION 9	0.500		0	0	0	NR	NR	0
IHS OPEN DUMPS	0.500		0	0	0	NR	NR	0
Local Lists of Hazardous waste / Contaminated Sites								
US HIST CDL	TP		NR	NR	NR	NR	NR	0
CDL	TP		NR	NR	NR	NR	NR	0
US CDL	TP		NR	NR	NR	NR	NR	0
Local Land Records								
LIENS 2	TP		NR	NR	NR	NR	NR	0
Records of Emergency Release Reports								
HMIRS	TP		NR	NR	NR	NR	NR	0
SPILLS	TP		NR	NR	NR	NR	NR	0
SPILLS 90	TP		NR	NR	NR	NR	NR	0
SPILLS 80	TP		NR	NR	NR	NR	NR	0
Other Ascertainable Records								
RCRA NonGen / NLR	0.250		2	2	NR	NR	NR	4

MAP FINDINGS SUMMARY

Database	Search Distance (Miles)	Target Property	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
FUDS	1.000		0	0	0	0	NR	0
DOD	1.000		0	0	0	0	NR	0
SCRD DRYCLEANERS	0.500		0	0	0	NR	NR	0
US FIN ASSUR	TP		NR	NR	NR	NR	NR	0
EPA WATCH LIST	TP		NR	NR	NR	NR	NR	0
2020 COR ACTION	0.250		0	0	NR	NR	NR	0
TSCA	TP		NR	NR	NR	NR	NR	0
TRIS	TP		NR	NR	NR	NR	NR	0
SSTS	TP		NR	NR	NR	NR	NR	0
ROD	1.000		0	0	0	0	NR	0
RMP	TP		NR	NR	NR	NR	NR	0
RAATS	TP		NR	NR	NR	NR	NR	0
PRP	TP		NR	NR	NR	NR	NR	0
PADS	TP		NR	NR	NR	NR	NR	0
ICIS	TP		NR	NR	NR	NR	NR	0
FTTS	TP		NR	NR	NR	NR	NR	0
MLTS	TP		NR	NR	NR	NR	NR	0
COAL ASH DOE	TP		NR	NR	NR	NR	NR	0
COAL ASH EPA	0.500		0	0	0	NR	NR	0
PCB TRANSFORMER	TP		NR	NR	NR	NR	NR	0
RADINFO	TP		NR	NR	NR	NR	NR	0
HIST FTTS	TP		NR	NR	NR	NR	NR	0
DOT OPS	TP		NR	NR	NR	NR	NR	0
CONSENT	1.000		0	0	0	0	NR	0
INDIAN RESERV	1.000		0	0	0	0	NR	0
FUSRAP	1.000		0	0	0	0	NR	0
UMTRA	0.500		0	0	0	NR	NR	0
LEAD SMELTERS	TP		NR	NR	NR	NR	NR	0
US AIRS	TP		NR	NR	NR	NR	NR	0
US MINES	0.250		1	0	NR	NR	NR	1
ABANDONED MINES	0.250		0	0	NR	NR	NR	0
MINES MRDS	0.250		0	0	NR	NR	NR	0
FINDS	TP	1	NR	NR	NR	NR	NR	1
DOCKET HWC	TP		NR	NR	NR	NR	NR	0
ECHO	TP		NR	NR	NR	NR	NR	0
UXO	1.000		0	0	0	0	NR	0
FUELS PROGRAM	0.250		0	0	NR	NR	NR	0
PFAS NPL	0.250		0	0	NR	NR	NR	0
PFAS FEDERAL SITES	0.250		0	0	NR	NR	NR	0
PFAS TSCA	0.250		0	0	NR	NR	NR	0
PFAS TRIS	0.250		0	0	NR	NR	NR	0
PFAS RCRA MANIFEST	0.250		0	0	NR	NR	NR	0
PFAS ATSDR	0.250		0	0	NR	NR	NR	0
PFAS WQP	0.250		0	0	NR	NR	NR	0
PFAS PROJECT	0.250		0	0	NR	NR	NR	0
PFAS NPDES	0.250		0	0	NR	NR	NR	0
PFAS ECHO	0.250		0	0	NR	NR	NR	0
PFAS ECHO FIRE TRAIN	0.250		0	0	NR	NR	NR	0
PFAS PT 139 AIRPORT	0.250		0	0	NR	NR	NR	0
AQUEOUS FOAM NRC	0.250		0	0	NR	NR	NR	0
BIOSOLIDS	TP		NR	NR	NR	NR	NR	0

MAP FINDINGS SUMMARY

Database	Search Distance (Miles)	Target Property	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
UST FINDER	0.250		3	4	NR	NR	NR	7
UST FINDER RELEASE	0.500		1	2	2	NR	NR	5
E MANIFEST	0.250		0	0	NR	NR	NR	0
PFAS	0.250		0	0	NR	NR	NR	0
AQUEOUS FOAM	0.250		0	0	NR	NR	NR	0
AIRS	TP	1	NR	NR	NR	NR	NR	1
ASBESTOS	TP		NR	NR	NR	NR	NR	0
COAL ASH	0.500		0	0	0	NR	NR	0
ENF	TP		NR	NR	NR	NR	NR	0
Financial Assurance	TP		NR	NR	NR	NR	NR	0
HW GEN	0.250		2	2	NR	NR	NR	4
PERMITS	TP	1	NR	NR	NR	NR	NR	1
AR Sludge	0.500		0	0	0	NR	NR	0
TIER 2	TP		NR	NR	NR	NR	NR	0
UIC	TP		NR	NR	NR	NR	NR	0
EDR HIGH RISK HISTORICAL RECORDS								
EDR Exclusive Records								
EDR MGP	1.000		0	0	0	0	NR	0
EDR Hist Auto	0.125		3	NR	NR	NR	NR	3
EDR Hist Cleaner	0.125		1	NR	NR	NR	NR	1
EDR RECOVERED GOVERNMENT ARCHIVES								
Exclusive Recovered Govt. Archives								
RGA HWS	TP		NR	NR	NR	NR	NR	0
RGA LF	TP		NR	NR	NR	NR	NR	0
RGA LUST	TP		NR	NR	NR	NR	NR	0
- Totals --		3	20	17	4	0	0	44

NOTES:

TP = Target Property

NR = Not Requested at this Search Distance

Sites may be listed in more than one database

A1 **WHITE RIVER MEDICAL CENTER** **AIRS** **S106414185**
Target **477 E MAIN** **PERMITS** **N/A**
Property **BATESVILLE, AR 72501**

Site 1 of 6 in cluster A

Actual:
322 ft.

AIRS:

Name:	WHITE RIVER MEDICAL CENTER
Alternate Name:	Not reported
Address:	477 E MAIN
City,State,Zip:	BATESVILLE, AR 72501-000
Plant ID:	Not reported
Afin:	3200037
Afin Dash:	32-00037
Facility Phone Number:	Not reported
Facility Fax Number:	Not reported
Facility E-mail Address:	Not reported
AFIN Status Code:	A
Mailing Address:	Not reported
Status:	Active
Mailing City:	Not reported
Facility Type Description:	Standard
Facility Type Code:	STD
Mailing State:	Not reported
Mailing Zip Code:	Not reported
Facility Owner ID:	002852
Owner Name:	WHITE RIVER MEDICAL CENTER
Facility Invoice Billing Month:	Not reported
Utm Zone:	15
Primary SIC Code:	8062
Company:	WHITE RIVER MEDICAL CENTER
SIC Description:	GENERAL MEDICAL & SURGICAL HOS
Latitude:	35.767368
Longitude:	-91.633949
SIC Code 2:	Not reported
Contact Address:	477 E MAIN
Sic Code Description 2:	Not reported
Contact City:	BATESVILLE
Contact State:	AR
Contact Zip:	72501-000
Contact County:	Not reported
NAICS Code:	62211
NAICS Description:	General Medical and Surgical Hospitals
Mailing Contact:	Not reported
NAICS Code 2:	Not reported
Mailing Company:	Not reported
Naics Description 2:	Not reported
Latitude Degrees:	35
Latitude Minutes:	46
Latitude Seconds:	2.52
Longitude Degrees:	-91
Longitude Minutes:	38
Longitude Seconds:	2.22
UTM Northing:	3959006.45
UTM Easting:	623483.80
Tertiary SIC Code:	Not reported
Tertiary SIC Description:	Not reported
Tertiary NAICS Code:	Not reported
Tertiary NAICS Description:	Not reported

WHITE RIVER MEDICAL CENTER (Continued) **S106414185**

PERMITS:

Name:	WHITE RIVER MEDICAL CENTER
Address:	477 E MAIN
City,State,Zip:	BATESVILLE, AR 72501-000
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200037
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	WHITE RIVER MEDICAL CENTER
Owner ID:	002852
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	ACCOUNTS PAYABLE
Facility Invoice Address 2:	WHITE RIVER MEDICAL CENTER
Facility Invoice Address 3:	477 E MAIN
Facility Invoice City,St,Zip:	BATESVILLE, AR 72501-000
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	8062
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	62211
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Lat/Long
GIS Original Datum Code:	WGS84
GIS Current Datum Code:	NAD83
UTM Northing:	3959006.45
UTM Easting:	623483.80
UTM Zone:	15
Section/Township/Range:	Not reported
GIS Date Measured:	11/14/2002
GIS Source Name:	ADEQ-GPS (autonomous)
GIS Collector Staff Code:	Frame, Philip
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Garmin GPS III Plus
GPS Receiver Cannels:	12
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Converted from RST Inspection 05/15/2005
GIS Huc:	11010004
GIS Planning Segment:	4F
GIS Ark Sen Dist:	12

WHITE RIVER MEDICAL CENTER (Continued) **S106414185**

GIS Ark Rep Dist:	072
Created By:	Not reported
Record Created:	Not reported
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	GENERAL MEDICAL & SURGICAL HOS
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	General Medical and Surgical Hospitals
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	35
Latitude Minute:	46
Latitude Second:	2.52
Longitude Degree:	-91
Longitude Minute:	38
Longitude Second:	2.22
Latitude Decimal:	35.767368
Longitude Decimal:	-91.633949
Comments:	Not reported
Permit Number:	0247-I
Permit Issued Date:	1975-05-30
Permit Modified Date:	Not reported
Permit Expiration Date:	1991-05-01
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	AI
Permit Type:	A
Permit Staff:	Not reported
Permit Status:	V
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	A
Permit Fee Volume:	.000000
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	Not reported
Permit Contact Telephone:	Not reported
Permit Mail Address 1:	Not reported
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	Not reported
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	WGS84
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959006.45
Permit UTM Easting:	623483.80
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2002-11-14 00:00:00

WHITE RIVER MEDICAL CENTER (Continued) **S106414185**

Permit GIS Source Name:	ADEQ-GPS (autonomous)
Permit GIS Collector Staff Code:	Frame, Philip
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Garmin GPS III Plus
Permit GPS Receiver Cannels:	12
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Converted from RST Inspection 05/15/2005 (Copied from AFIN, 04/02/06)
Permit GIS Huc:	11010004
Permit GIS Planning Segment:	4F
Permit GIS Ark Sen Dist:	12
Permit GIS Ark Rep Dist:	072
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	Not reported
Permit Media Description:	Air-Incinerator
Permit Type:	Air Code
Permit Status Description:	Voided
Permit Fee Description:	Air Code
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 2.52 / -91 38 2.22

Permit Number:	32000038
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	DANNY OLIVER
Permit Contact Telephone:	8702626278
Permit Mail Address 1:	WHITE RIVER MEDICAL CENTER
Permit Mail Address 2:	1710 HARRISON
Permit Mail County Code:	32
Permit Mail County Name:	Independence

WHITE RIVER MEDICAL CENTER (Continued) **S106414185**

Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3958993.34
Permit UTM Easting:	623490.43
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2015-04-30 00:00:00
Permit GIS Source Name:	ADEQ-GPS (postprocessed)
Permit GIS Collector Staff Code:	Bissell, Jack
Permit GIS Certified Measurment:	Yes
Permit GPS Receiver Type Name:	GeoXM
Permit GPS Receiver Cannels:	8
Permit GIS Base Station Name:	CORS, Little Rock, AR
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	12
Permit GIS PDOP Mask:	5
Permit GIS SNR Mask:	39
Permit GIS Hoizontal Accuracy:	1.8
Permit GIS Comment:	Tank; Imported by PUCKETT on 5/15/2015 (R043013A.cor).
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1986-09-08 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 2.07 / -91 38 1.94

A2
Target Property

WHITE RIVER MEDICAL CENTER
477 E MAIN
BATESVILLE, AR 72501

FINDS **1009576420**
N/A

Site 2 of 6 in cluster A

Actual:
322 ft.

FINDS:
Registry ID: 110025002823

Click Here for FRS Facility Detail Report:

Environmental Interest/Information System:
The Arkansas Permit Data System (PDS) is an integrated system maintaining data on air quality, mining, tires, solid waste, tank, water and hazardous waste, as well as inspections, invoicing and complaints.

WHITE RIVER MEDICAL CENTER (Continued) **1009576420**

Click this hyperlink while viewing on your computer to access additional FINDS: detail in the EDR Site Report.

A3 **DOWNTOWN EXXON SS** **UST** **U001220106**
South **416 EAST MAIN** **PERMITS** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.014 mi.
74 ft. **Site 3 of 6 in cluster A**

Relative:
Higher

Actual:
324 ft.

UST:

Facility Id:	32000050
ADEQ Facility ID:	32-00355
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	05/05/1995
Lust Flag:	UST
Leak ID Number:	Not reported
Date Received:	05/09/1986
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	J.W. COLLIER
Contact Title:	PRESIDENT
Contact Phone:	501-793-7644
Certified Name:	J. W. COLLIER
Certified Title:	PRESIDENT
Date Signed:	11/16/1990
Amended:	Yes
No Bill:	Not reported
Facility Entry Clerk:	BRADFORD
Facility Update Date:	10/28/1992
Facility Update Clerk:	NFIELDS
Latitude:	Not reported
Longitude:	Not reported

Owner:

Owner ID:	002881
Owner Name:	BONE, JIM DBA COLLIER OIL
Owner Address:	POB 2283
Owner City,St,Zip:	BATESVILLE, AR 72501
Owner County:	INDEPENDENCE
Owner Phone:	8707933655
Owner Type:	Private Industry

AST/UST Eligible:

Facility Id:	32000050
Date Eligible:	11/15/1991
Transaction Code:	CIOU
Entry Clerk:	GCRAGG
Entry Date:	11/15/1991
Update Clerk:	Not reported
Update Date:	Not reported
Eligibility Description:	Certificate issued, original, UST

Tank Info:

DOWNTOWN EXXON SS (Continued) **U001220106**

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	MARSH
Record Modified Date:	4/6/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	1
Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1981
Tank Contents:	Empty, Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	4000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	MARSH
Record Modified Date:	4/6/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID: 2

DOWNTOWN EXXON SS (Continued) **U001220106**

Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1981
Tank Contents:	Empty, Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	2000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	MARSH
Record Modified Date:	4/6/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	3
Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1981
Tank Contents:	Empty, Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	4000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported

DOWNTOWN EXXON SS (Continued) **U001220106**

Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

Facility ID:	32000050
Record Created By:	MARSH
Record Created Date:	01/06/1993
Record Modified By:	MARSH
Record Modified Date:	4/6/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	No
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	4
Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1984
Tank Contents:	Empty,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	01/01/1989
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported

DOWNTOWN EXXON SS (Continued) **U001220106**

Record Modified By:	TERESA
Record Modified Date:	7/7/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	5
Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1989
Tank Contents:	Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Tank Number Changed 05/15/2005. Old tank number was A

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	TERESA
Record Modified Date:	7/7/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	6
Tank Status:	**PO 01/10/1992**
Install Date:	01/01/1989
Tank Contents:	Gasoline,

DOWNTOWN EXXON SS (Continued) **U001220106**

Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Tank Number Changed 05/15/2005. Old tank number was B

Facility ID:	32000050
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	TERESA
Record Modified Date:	7/7/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	7
Tank Status:	**PO 01/10/1995**
Install Date:	01/01/1989
Tank Contents:	Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,

DOWNTOWN EXXON SS (Continued) **U001220106**

Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Tank Number Changed 05/15/2005. Old tank number was C

Facility ID:	32000050
Record Created By:	MARSH
Record Created Date:	02/17/1995
Record Modified By:	TERESA
Record Modified Date:	7/7/1995
Site Assessment Date:	Not reported
Site Assessment Leak:	No
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	8
Tank Status:	**PO 01/10/1995**
Install Date:	Not reported
Tank Contents:	Used Oil,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	50
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Unknown,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Tank Number Changed 05/15/2005. Old tank number was D

PERMITS:

Name:	DOWNTOWN EXXON SS
Address:	416 EAST MAIN
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported

DOWNTOWN EXXON SS (Continued) **U001220106**

Facility Status:	Active
AFIN:	3200355
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	BONE, JIM DBA COLLIER OIL
Owner ID:	002881
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported

DOWNTOWN EXXON SS (Continued) **U001220106**

Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported
Permit Number:	32000050
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	J.W. COLLIER
Permit Contact Telephone:	5017937644
Permit Mail Address 1:	DOWNTOWN EXXON SS
Permit Mail Address 2:	416 EAST MAIN
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Not reported
Permit GIS Original Datum Code:	Not reported
Permit GIS Current Datum Code:	Not reported
Permit UTM Northing:	Not reported
Permit UTM Easting:	Not reported
Permit UTM Zone:	Not reported
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Not reported
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	Not reported
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported

DOWNTOWN EXXON SS (Continued) **U001220106**

Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Not reported
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-08-06 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	Not reported

A4 **DOWNTOWN EXXON SS** **UST FINDER** **1028163640**
South **416 EAST MAIN** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.014 mi.
74 ft. **Site 4 of 6 in cluster A**

Relative: UST FINDER:
Higher

Object ID:	34966
Facility ID:	AR32000050
Name:	DOWNTOWN EXXON SS
Address:	416 EAST MAIN
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	StreetAddress
Open USTs:	0
Closed USTs:	8
TOS USTs:	0
Population 1500ft:	314
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported

Actual:
324 ft.

DOWNTOWN EXXON SS (Continued) **1028163640**

Coordinate Source: Geocode
X Coord: -91.650946
Y Coord: 35.7717870000001
Latitude: 35.771787
Longitude: -91.650946

UST FINDER:
Object ID: 97430
Facility ID: AR32000050
Tank ID: AR32000050_6
Tank Status: Closed
Installation Date: 1989/01/01 16:00:00+00
Removal Date: 1992/01/10 15:59:59+00
Tank Capacity: 1000
Substances: Gasoline
Tank Wall Type: Single

Object ID: 94480
Facility ID: AR32000050
Tank ID: AR32000050_5
Tank Status: Closed
Installation Date: 1989/01/01 16:00:00+00
Removal Date: 1995/01/10 15:59:59+00
Tank Capacity: 1000
Substances: Gasoline
Tank Wall Type: Single

Object ID: 94481
Facility ID: AR32000050
Tank ID: AR32000050_7
Tank Status: Closed
Installation Date: 1989/01/01 16:00:00+00
Removal Date: 1995/01/10 15:59:59+00
Tank Capacity: 1000
Substances: Gasoline
Tank Wall Type: Single

Object ID: 94486
Facility ID: AR32000050
Tank ID: AR32000050_4
Tank Status: Closed
Installation Date: 1984/01/01 16:00:00+00
Removal Date: 1995/01/10 15:59:59+00
Tank Capacity: 1000
Substances: Empty
Tank Wall Type: Single

Object ID: 94487
Facility ID: AR32000050
Tank ID: AR32000050_1
Tank Status: Closed
Installation Date: 1981/01/01 16:00:00+00
Removal Date: 1995/01/10 15:59:59+00
Tank Capacity: 4000
Substances: Empty Gasoline
Tank Wall Type: Single

Object ID: 94488

DOWNTOWN EXXON SS (Continued) **1028163640**

Facility ID:	AR32000050
Tank ID:	AR32000050_2
Tank Status:	Closed
Installation Date:	1981/01/01 16:00:00+00
Removal Date:	1995/01/10 15:59:59+00
Tank Capacity:	2000
Substances:	Empty Gasoline
Tank Wall Type:	Single

Object ID:	94489
Facility ID:	AR32000050
Tank ID:	AR32000050_3
Tank Status:	Closed
Installation Date:	1981/01/01 16:00:00+00
Removal Date:	1995/01/10 15:59:59+00
Tank Capacity:	4000
Substances:	Empty Gasoline
Tank Wall Type:	Single

Object ID:	94493
Facility ID:	AR32000050
Tank ID:	AR32000050_8
Tank Status:	Closed
Installation Date:	Not reported
Removal Date:	1995/01/10 15:59:59+00
Tank Capacity:	Not reported
Substances:	Used_Oil
Tank Wall Type:	Single

A5 **WILKINS ARTHUR** **EDR Hist Auto** **1021286736**
South **416 E MAIN ST** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.014 mi.
74 ft. **Site 5 of 6 in cluster A**

Relative: EDR Hist Auto
Higher

Actual: **324 ft.**

Year:	Name:	Type:
1969	WILKINS ARTHUR	Gasoline Service Stations
1970	WILKINS ARTHUR	Gasoline Service Stations
1971	WILKINS ARTHUR	Gasoline Service Stations
1972	WILKINS ARTHUR	Gasoline Service Stations
1973	WILKINS ARTHUR	Gasoline Service Stations
1974	WILKINS ARTHUR	Gasoline Service Stations
1975	WILKINS ARTHUR	Gasoline Service Stations
1991	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations
1992	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations
1993	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations
1994	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations

A6 **DOWNTOWN EXXON SERVICE CENTER** **EDR Hist Auto** **1020360959**
South **416 MAIN E** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.014 mi.
74 ft. **Site 6 of 6 in cluster A**

Relative: EDR Hist Auto
Higher

Actual: **324 ft.**

Year:	Name:	Type:
1989	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations
1990	DOWNTOWN EXXON SERVICE CENTER	Gasoline Service Stations

B7 **NU-WAY CLEANERS & LAUNDRY INC** **EDR Hist Cleaner** **1018627615**
South **121 S 4TH ST** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.030 mi.
158 ft. **Site 1 of 5 in cluster B**

Relative: EDR Hist Cleaner
Higher

Actual: **323 ft.**

Year:	Name:	Type:
1969	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1970	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1971	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1972	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1973	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1974	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1975	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1976	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1977	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1978	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1979	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1980	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1982	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1983	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1985	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1986	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1987	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1988	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1989	NU-WAY CLEANERS & LAUNDRY	Drycleaning Plants, Except Rugs
1990	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1991	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1992	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1993	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1994	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1995	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1996	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1997	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1998	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
1999	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2000	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2001	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2002	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2003	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2004	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2005	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2006	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2007	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2008	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2009	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1018627615**

2010	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2011	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2012	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2013	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs
2014	NU-WAY CLEANERS & LAUNDRY INC	Drycleaning Plants, Except Rugs

---

B8 **NU-WAY CLEANERS & LAUNDRY INC** **HW GEN** **S108990226**
South **121 S 4TH ST** **PERMITS** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.030 mi.
158 ft. **Site 2 of 5 in cluster B**

Relative:
Higher

Actual:
323 ft.

HW GEN:

Name:	NU-WAY CLEANERS & LAUNDRY INC
Address:	121 S 4TH ST
City,State,Zip:	BATESVILLE, AR 72501
EPAID:	ARD035436997
AFIN:	3200100
AFIN Dash:	32-00100
Owner Operator Name:	LIONEL & CASSIE CREIGHTON
Owner Operator Address:	Not reported
Owner Operator City:	Not reported
Owner Operator State:	Not reported
Owner Operator Zip:	Not reported
Owner Operator Phone Number:	Not reported
Type Description:	Private
Federal Generator Status:	N
State Generator Status:	6
NAICS Code:	81232
NAICS Desc:	DRYCLEANING AND LAUNDRY SERVICES (EXCEPT COIN-OPERATED)
CME:	Not reported
CA:	Not reported
Permit:	Not reported

EPAECHO Compliance Link:

Contact:

EPAID:	ARD035436997
Mailing Address:	121 S 4TH ST
Mailing City:	BATESVILLE
Mailing State:	AR
Mailing Zip:	72501
Contact Name:	CHARLES L CREIGHTON
Contact Telephone:	870-793-5775
Contact Address:	121 S 4TH ST
Contact City:	BATESVILLE
Contact State:	AR
Contact Zip:	72501

PERMITS:

Name:	NU-WAY CLEANERS & LAUNDRY
Address:	121 S 4TH STREET
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200100

NU-WAY CLEANERS & LAUNDRY INC (Continued) **S108990226**

AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	Not reported
Owner ID:	Not reported
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	CHARLES CREIGHTON
Facility Invoice Address 2:	NU-WAY CLEANERS & LAUNDRY
Facility Invoice Address 3:	121 S 4TH
Facility Invoice City,St,Zip:	BATESVILLE, AR 72501-000
Facility Invoice Country:	Not reported
Facility Telephone:	8707935775
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	CHARLES CREIGLTON
Mailing Address 2:	121 S 4TH STREET
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	7216
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	81232
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	Not reported
Modified By:	Not reported
Modified Date:	2003-05-08 07:32:00
Primary SIC Desc:	DRY CLEANING PLANTS, EXCEPT RU
Secondary SIC Desc:	Not reported

NU-WAY CLEANERS & LAUNDRY INC (Continued) **S108990226**

Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Drycleaning and Laundry Services (except Coin
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported
Permit Number:	ARD035436997
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	HE
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	I
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	1950.000000
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	Not reported
Permit Inv Single Lbl:	Not reported
Permit Contact Name:	CHARLES L CREIGHTON
Permit Contact Telephone:	8707935775
Permit Mail Address 1:	NU-WAY CLEANERS & LAUNDRY INC
Permit Mail Address 2:	121 S 4TH ST
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959456.29
Permit UTM Easting:	621931.75
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2019-07-22 00:00:00
Permit GIS Source Name:	EPA
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported

NU-WAY CLEANERS & LAUNDRY INC (Continued) **S108990226**

Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Imported by jacksonw on 7/22/2019. Source datafile unknown.
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	Not reported
Permit Media Description:	Haz Waste EPAID
Permit Type:	Not reported
Permit Status Description:	Inactive
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 17.80 / -91 39 3.74

B9 **NU-WAY CLEANERS & LAUNDRY INC** **RCRA NonGen / NLR** **1000435823**
South **121 S 4TH ST** **FINDS** **ARD035436997**
< 1/8 **BATESVILLE, AR 72501** **ECHO**
0.030 mi.
158 ft. **Site 3 of 5 in cluster B**

Relative: **Higher**
Actual: **323 ft.**

RCRA Listings:

Date Form Received by Agency:	20040405
Handler Name:	Nu-Way Cleaners & Laundry Inc
Handler Address:	S 4th St
Handler City,State,Zip:	BATESVILLE, AR 72501
EPA ID:	ARD035436997
Contact Name:	CHARLES L CREIGHTON
Contact Address:	121 S 4TH ST
Contact City,State,Zip:	BATESVILLE, AR 72501
Contact Telephone:	870-793-5775
Contact Fax:	Not reported
Contact Email:	Not reported
Contact Title:	Not reported
EPA Region:	06
Land Type:	Private
Federal Waste Generator Description:	Not a generator, verified
Non-Notifier:	Not reported
Biennial Report Cycle:	Not reported
Accessibility:	Not reported
Active Site Indicator:	Not reported
State District Owner:	Ar
State District:	1
Mailing Address:	S 4TH ST
Mailing City,State,Zip:	BATESVILLE, AR 72501
Owner Name: Lionel & Cassie Creighton	
Owner Type:	Private
Operator Name: Lionel Creighton	

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

Operator Type:	Private
Short-Term Generator Activity:	No
Importer Activity:	No
Mixed Waste Generator:	No
Transporter Activity:	No
Transfer Facility Activity:	No
Recycler Activity with Storage:	No
Small Quantity On-Site Burner Exemption:	No
Smelting Melting and Refining Furnace Exemption:	No
Underground Injection Control:	No
Off-Site Waste Receipt:	No
Universal Waste Indicator:	No
Universal Waste Destination Facility:	No
Federal Universal Waste:	No
Active Site State-Reg Handler:	---
Federal Facility Indicator:	Not reported
Hazardous Secondary Material Indicator:	N
Sub-Part K Indicator:	Not reported
2018 GPRA Permit Baseline:	Not on the Baseline
2018 GPRA Renewals Baseline:	Not on the Baseline
202 GPRA Corrective Action Baseline:	No
Subject to Corrective Action Universe:	No
Non-TSDFs Where RCRA CA has Been Imposed Universe:	No
Corrective Action Priority Ranking:	No NCAPS ranking
Environmental Control Indicator:	No
Institutional Control Indicator:	No
Human Exposure Controls Indicator:	N/A
Groundwater Controls Indicator:	N/A
Significant Non-Complier Universe:	No
Unaddressed Significant Non-Complier Universe:	No
Addressed Significant Non-Complier Universe:	No
Significant Non-Complier With a Compliance Schedule Universe:	No
Financial Assurance Required:	Not reported
Handler Date of Last Change:	20040618
Recognized Trader-Importer:	No
Recognized Trader-Exporter:	No
Importer of Spent Lead Acid Batteries:	No
Exporter of Spent Lead Acid Batteries:	No
Recycler Activity Without Storage:	No
Manifest Broker:	No
Sub-Part P Indicator:	No

Biennial: List of Years
Year: 2003

Click Here for Biennial Reporting System Data:
Year: 2001

Click Here for Biennial Reporting System Data:

Hazardous Waste Summary:
Waste Code: D007
Waste Description: Chromium

Waste Code: D039
Waste Description: Tetrachloroethylene

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

Waste Code: F002
Waste Description: The Following Spent Halogenated Solvents: Tetrachloroethylene, Methylene Chloride, Trichloroethylene, 1,1,1-Trichloroethane, Chlorobenzene, 1,1,2-Trichloro-1,2,2-Trifluoroethane, Ortho-Dichlorobenzene, Trichlorofluoromethane, And 1,1,2, Trichloroethane; All Spent Solvent Mixtures/Blends Containing, Before Use, A Total Of Ten Percent Or More (By Volume) Of One Or More Of The Above Halogenated Solvents Or Those Solvents Listed In F001, F004, And F005; And Still Bottoms From The Recovery Of These Spent Solvents And Spent Solvent Mixtures.

Handler - Owner Operator:

Owner/Operator Indicator:	Owner
Owner/Operator Name: LIONEL & CASSIE CREIGHTON	
Legal Status:	Private
Date Became Current:	19630101
Date Ended Current:	Not reported
Owner/Operator Address:	Not reported
Owner/Operator City,State,Zip:	AR
Owner/Operator Telephone:	Not reported
Owner/Operator Telephone Ext:	Not reported
Owner/Operator Fax:	Not reported
Owner/Operator Email:	Not reported

Owner/Operator Indicator:	Operator
Owner/Operator Name: LIONEL CREIGHTON	
Legal Status:	Private
Date Became Current:	19630101
Date Ended Current:	Not reported
Owner/Operator Address:	Not reported
Owner/Operator City,State,Zip:	Not reported
Owner/Operator Telephone:	Not reported
Owner/Operator Telephone Ext:	Not reported
Owner/Operator Fax:	Not reported
Owner/Operator Email:	Not reported

Owner/Operator Indicator:	Operator
Owner/Operator Name: LIONEL CREIGHTON	
Legal Status:	Private
Date Became Current:	19630101
Date Ended Current:	Not reported
Owner/Operator Address:	Not reported
Owner/Operator City,State,Zip:	Not reported
Owner/Operator Telephone:	Not reported
Owner/Operator Telephone Ext:	Not reported
Owner/Operator Fax:	Not reported
Owner/Operator Email:	Not reported

Owner/Operator Indicator:	Owner
Owner/Operator Name: CREIGHTON LIONEL	
Legal Status:	Private
Date Became Current:	Not reported
Date Ended Current:	Not reported
Owner/Operator Address:	UNKNOWN
Owner/Operator City,State,Zip:	UNKNOWN, AR 00000-0000
Owner/Operator Telephone:	000-000-0000
Owner/Operator Telephone Ext:	Not reported

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Owner/Operator Indicator: Owner
Owner/Operator Name: LIONEL & CASSIE CREIGHTON
Legal Status: Private
Date Became Current: 19630101
Date Ended Current: Not reported
Owner/Operator Address: Not reported
Owner/Operator City,State,Zip: Not reported
Owner/Operator Telephone: Not reported
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Owner/Operator Indicator: Owner
Owner/Operator Name: LIONEL CREIGHTON
Legal Status: Private
Date Became Current: 19630101
Date Ended Current: Not reported
Owner/Operator Address: Not reported
Owner/Operator City,State,Zip: Not reported
Owner/Operator Telephone: Not reported
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Owner/Operator Indicator: Operator
Owner/Operator Name: LIONEL CREIGHTON
Legal Status: Private
Date Became Current: 19630101
Date Ended Current: Not reported
Owner/Operator Address: Not reported
Owner/Operator City,State,Zip: Not reported
Owner/Operator Telephone: Not reported
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Owner/Operator Indicator: Owner
Owner/Operator Name: LIONEL & CASSIE CREIGHTON
Legal Status: Private
Date Became Current: 19630101
Date Ended Current: Not reported
Owner/Operator Address: Not reported
Owner/Operator City,State,Zip: AR
Owner/Operator Telephone: Not reported
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Owner/Operator Indicator: Operator
Owner/Operator Name: LIONEL CREIGHTON
Legal Status: Private
Date Became Current: 19630101
Date Ended Current: Not reported
Owner/Operator Address: Not reported

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

Owner/Operator City,State,Zip: Not reported
Owner/Operator Telephone: Not reported
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Historic Generators:

Receive Date: 19860520
Handler Name: NU-WAY CLEANERS & LAUNDRY
Federal Waste Generator Description: Small Quantity Generator
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: No
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

Receive Date: 20020128
Handler Name: NU-WAY CLEANERS & LAUNDRY
Federal Waste Generator Description: Small Quantity Generator
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: No
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

Receive Date: 20030108
Handler Name: NU-WAY CLEANERS & LAUNDRY INC
Federal Waste Generator Description: Small Quantity Generator
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: No
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

Receive Date: 20040405
Handler Name: NU-WAY CLEANERS & LAUNDRY INC
Federal Waste Generator Description: Not a generator, verified
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: Yes
Non Storage Recycler Activity: Not reported

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

Electronic Manifest Broker: Not reported

Receive Date: 20020128
Handler Name: NU-WAY CLEANERS & LDRY INC
Federal Waste Generator Description: Small Quantity Generator
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: No
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

Receive Date: 20040301
Handler Name: NU-WAY CLEANERS & LAUNDRY INC.
Federal Waste Generator Description: Not a generator, verified
State District Owner: Not reported
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: No
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

List of NAICS Codes and Descriptions:
NAICS Code: 81232
NAICS Description: Drycleaning And Laundry Services (Except Coin-Operated)

NAICS Code: 812331
NAICS Description: Linen Supply

NAICS Code: 812332
NAICS Description: Industrial Launderers

Facility Has Received Notices of Violations:
Violations: No Violations Found

Evaluation Action Summary:
Evaluations: No Evaluations Found

FINDS:
Registry ID: 110003393989

Click Here for FRS Facility Detail Report:

Environmental Interest/Information System:
All generators and treatment, storage, and disposal (TSD) facilities who handle hazardous waste are required to report to the EPA Administrator at least once every two years. The data collected is used to create the National Biennial Resource Conservation and Recovery Act (RCRA) Hazardous Waste Report. This data is processed

NU-WAY CLEANERS & LAUNDRY INC (Continued) **1000435823**

within the RCRA Information (RCRAInfo) database
The Arkansas Permit Data System (PDS) is an integrated system maintaining data on air quality, mining, tires, solid waste, tank, water and hazardous waste, as well as inspections, invoicing and complaints.
The Resource Conservation and Recovery Act Information System (RCRAInfo) is EPA's comprehensive information system in support of the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. It tracks many types of information about generators, transporters, treaters, storers, and disposers of hazardous waste.

Click this hyperlink while viewing on your computer to access additional FINDS: detail in the EDR Site Report.

ECHO:

Envid:	1000435823
Registry ID:	110003393989
DFR URL:	
Name:	NU-WAY CLEANERS & LAUNDRY INC
Address:	121 S 4th St
City,State,Zip:	BATESVILLE, AR 72501

C10 **BATESVILLE, CITY OF** **SWRCY** **S101360312**
ESE **500 E. MAIN STREET** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.043 mi.
229 ft. **Site 1 of 4 in cluster C**

Relative:
Higher

Actual:
324 ft.

SWRCY:

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015

BATESVILLE, CITY OF (Continued) **S101360312**

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501

BATESVILLE, CITY OF (Continued) **S101360312**

Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2008

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2009

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2010

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2009

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported

BATESVILLE, CITY OF (Continued) **S101360312**

Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2010

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2011

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI

BATESVILLE, CITY OF (Continued) **S101360312**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

BATESVILLE, CITY OF (Continued) **S101360312**

Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2016
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept.

BATESVILLE, CITY OF (Continued) **S101360312**

NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False
Facility Community Services: True
Facility Tax Credit APP: False
Facility Curbside: False
Facility Dropoff: False
Material Category Year: 2013

Name: BATESVILLE, CITY OF
Address: 500 E. MAIN STREET
City,State,Zip: BATESVILLE, AR 72501
Region Name: Northeast
Facility ID: 321
Facility Status: A
Facility Status Date: 12/07/2009
Contact Type: Not reported
Fullname: Not reported
Telephone: Not reported
Fax: 8706982406
RSWM District: WRI
EMail: Not reported
Broker: False
Collector: True
Processor: False
Position: Not reported
Notes: Facility location; 40 General Drive Marty Thompson, Sanitation Dept.
NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False
Facility Community Services: True
Facility Tax Credit APP: False
Facility Curbside: False
Facility Dropoff: False
Material Category Year: 2015

Name: BATESVILLE, CITY OF
Address: 500 E. MAIN STREET
City,State,Zip: BATESVILLE, AR 72501
Region Name: Northeast
Facility ID: 321
Facility Status: A
Facility Status Date: 12/07/2009
Contact Type: Not reported
Fullname: Not reported
Telephone: Not reported
Fax: 8706982406
RSWM District: WRI
EMail: Not reported
Broker: False
Collector: True
Processor: False
Position: Not reported
Notes: Facility location; 40 General Drive Marty Thompson, Sanitation Dept.
NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Dropoff:	False
Material Category Year:	2015
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013

BATESVILLE, CITY OF (Continued) **S101360312**

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501

BATESVILLE, CITY OF (Continued) **S101360312**

Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported

BATESVILLE, CITY OF (Continued) **S101360312**

Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI

BATESVILLE, CITY OF (Continued) **S101360312**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2010
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2011
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

BATESVILLE, CITY OF (Continued) **S101360312**

Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept.

BATESVILLE, CITY OF (Continued) **S101360312**

NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False
Facility Community Services: True
Facility Tax Credit APP: False
Facility Curbside: False
Facility Dropoff: False
Material Category Year: 2014

Name: BATESVILLE, CITY OF
Address: 500 E. MAIN STREET
City,State,Zip: BATESVILLE, AR 72501
Region Name: Northeast
Facility ID: 321
Facility Status: A
Facility Status Date: 12/07/2009
Contact Type: Not reported
Fullname: Not reported
Telephone: Not reported
Fax: 8706982406
RSWM District: WRI
EMail: Not reported
Broker: False
Collector: True
Processor: False
Position: Not reported
Notes: Facility location; 40 General Drive Marty Thompson, Sanitation Dept.
NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False
Facility Community Services: True
Facility Tax Credit APP: False
Facility Curbside: False
Facility Dropoff: False
Material Category Year: 2013

Name: BATESVILLE, CITY OF
Address: 500 E. MAIN STREET
City,State,Zip: BATESVILLE, AR 72501
Region Name: Northeast
Facility ID: 321
Facility Status: A
Facility Status Date: 12/07/2009
Contact Type: Not reported
Fullname: Not reported
Telephone: Not reported
Fax: 8706982406
RSWM District: WRI
EMail: Not reported
Broker: False
Collector: True
Processor: False
Position: Not reported
Notes: Facility location; 40 General Drive Marty Thompson, Sanitation Dept.
NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned: False

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2016
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Dropoff:	False
Material Category Year:	2000
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2008
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2009

BATESVILLE, CITY OF (Continued) **S101360312**

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2010

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2011

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501

BATESVILLE, CITY OF (Continued) **S101360312**

Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2014
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported

BATESVILLE, CITY OF (Continued) **S101360312**

Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2016

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2010

Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI

BATESVILLE, CITY OF (Continued) **S101360312**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

BATESVILLE, CITY OF (Continued) **S101360312**

Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2015
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept.

BATESVILLE, CITY OF (Continued) **S101360312**

	NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2012
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	False
Facility Dropoff:	False
Material Category Year:	2013
Name:	BATESVILLE, CITY OF
Address:	500 E. MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	321
Facility Status:	A
Facility Status Date:	12/07/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8706982406
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	False
Position:	Not reported
Notes:	Facility location; 40 General Drive Marty Thompson, Sanitation Dept. NOTE: Exactly same amt reported in 2008 and 2009 forTons Recycled and Diversion Savings. Phone Number: (870) 698-2400
Facility Privately Owned:	False

BATESVILLE, CITY OF (Continued) **S101360312**

Facility Community Services: True
Facility Tax Credit APP: False
Facility Curbside: False
Facility Dropoff: False
Material Category Year: 2015

B11 **OFFICE OF EMERGENCY SERVICES** **LTANKS** **U001714659**
SSW **368 E MAIN ST** **UST** **N/A**
< 1/8 **BATESVILLE, AR 72501** **Financial Assurance**
0.052 mi. **PERMITS**
277 ft. **Site 4 of 5 in cluster B**

Relative: **Higher**
Actual: **323 ft.**

LTANKS:
Name: OFFICE OF EMERGENCY SERVICES
Address: 368 E MAIN STREET
Address 2: Not reported
City,State,Zip: BATESVILLE, AR 72501
RST Facility ID: 32001616
Facility Telephone: (870) 793-8816

Owner: OFFICE OF EMERGENCY SERVICES
Lust Owner: 006188
Leak Date: Not reported
Leak Volume: Not reported
Substance Stored: Diesel
Release Status: Confirmed
Release Confirmed: 10/21/2013
Damage Description: Sub Surface Soils/Groundwater
Lust Tank Type: Underground Tank
Lust Dicovery: Closure Assessment
Notification Date: 10/21/2013
Cleanup Initiated: 3/20/2014
Notification Name: ANONYMOUS
Notification Address: Not reported
Notification City,St,Zip: Not reported
Notification Telephone: Not reported
Notice Number: 320033
Tech Branch: 12/26/2013
AFIN Number: 3200469
Emergency Response: No
Emergency Response 2: Not reported
Hazard Abatement: Not reported
Remedial Action: Not reported
ISC Date: Not reported
Priority Score: L
SAR Date: Not reported
Cap Submit: Not reported
Public Notify: Not reported
Cap Approve: Not reported
NFA Issued: 2014-03-20 00:00:00
Funding Source: Not reported
Cleanup Lead: Not reported
Gis Location: Not reported
Lust Tank Type 2: Underground Tank
RST Modified Date: Not reported
Leak Damage: Not reported
Memo: TWO SOIL SAMPLE RESULTS FROM CLOSURE DOCUMENTS SHOW DRO LEVELS EXCEEDING ADEQ GUIDELINES. SAMPLE A LEVEL WAS 430 AND SAMPLE B WAS

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

293. BISSELL [BISSELL 11/25/2013 1:30:14 PM]. THIS LUST REFERRED TO THE TECHNICAL DIVISION THIS DATE. [WILSONS 12/26/2013 9:46:33 AM]. Case file assigned to D. Frazier on 01/10/14. Case manager conducted site reconnaissance on 02/11/14. [frazier 3/6/2014 9:05:03 AM]. Preliminary Assessment completed on 03/14/14. Case closed by issuance of "no further action" letter on 03/20/14. [frazier 3/20/2014 10:42:43 AM].

UST:

Facility Id:	32001616
ADEQ Facility ID:	32-00469
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	07/16/2012
Lust Flag:	UST
Leak ID Number:	32-0033
Date Received:	10/21/2013
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	GLEN WILLIS
Contact Title:	COORDINATOR
Contact Phone:	501-793-8816
Certified Name:	GLEN WILLIS
Certified Title:	COORDINATOR
Date Signed:	09/22/2013
Amended:	No
No Bill:	Not reported
Facility Entry Clerk:	NFIELDS
Facility Update Date:	01/03/2014
Facility Update Clerk:	SCHENK
Latitude:	35.771146
Longitude:	-91.651570

Owner:

Owner ID:	006188
Owner Name:	OFFICE OF EMERGENCY SERVICES
Owner Address:	130 S FOURTH ST
Owner City,St,Zip:	BATESVILLE, AR 72501
Owner County:	INDEPENDENCE
Owner Phone:	8707938816
Owner Type:	Private Industry

AST/UST Eligible:

Facility Id:	32001616
Date Eligible:	9/29/2010
Transaction Code:	FAOF
Entry Clerk:	WOOD
Entry Date:	9/29/2010 7:55:05 AM
Update Clerk:	Not reported
Update Date:	Not reported
Eligibility Description:	Financial Assurance on file

Tank Info:

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

Facility ID:	32001616
Record Created By:	NFIELDS
Record Created Date:	02/02/1994
Record Modified By:	SUMMERS
Record Modified Date:	3/25/1994
Site Assessment Date:	Not reported
Site Assessment Leak:	No
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	1
Tank Status:	**PO 02/23/1994**
Install Date:	01/01/1977
Tank Contents:	Diesel,
Cerclis Name:	Not reported
Tank Material:	Unknown,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	4000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Unknown,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Auto Flow,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	X
Release Detection:	Not reported
Tank Comments:	Not reported

Facility ID:	32001616
Record Created By:	BRADFORD
Record Created Date:	03/21/1994
Record Modified By:	SCHENK
Record Modified Date:	1/3/2014 9:32:36 AM
Site Assessment Date:	11/07/2012
Site Assessment Leak:	Yes
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	2

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

Tank Status:	**PO 11/07/2012**
Install Date:	02/24/1994
Tank Contents:	Empty, Diesel
Cerclis Name:	Not reported
Tank Material:	Epoxy
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	550
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	IC Flag, Vapor Monitoring, Ground Water Monitoring, Ground Water Monitoring
Release Detection Install Date:	02/24/1994
Tank External Corrosion Protection:	Diesel, CPS Flag
Tank Ext Corrosion Protection Install Date:	02/24/1994
Pipe Material:	WRAPPED PIPE
Pipe Type:	Suction PVC
Pipe Release Detection:	Vapor Monitor
Pipe Corrosion Protection:	CPS
Tank Spill and Overfill Protection:	Basin
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	CPS
Corrosion Protection:	X
Spill and Overflow:	X
Release Detection:	Yes
Tank Comments:	Tech Branch Referral 12/26/2013, LUST 32-0033.

AR Financial Assurance 3:

Name:	OFFICE OF EMERGENCY SERVICES
Address:	368 E MAIN ST
City,State,Zip:	BATESVILLE, AR 72501
Region:	3
Facility Id:	32001616
Eligible Certification:	Financial Assurance on file

PERMITS:

Name:	OFFICE OF EMERGENCY SERVICES
Address:	368 MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200469
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	OFFICE OF EMERGENCY SERVICES
Owner ID:	006188
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Lat/Long
GIS Original Datum Code:	WGS84
GIS Current Datum Code:	NAD83
UTM Northing:	3959441.06
UTM Easting:	621917.41
UTM Zone:	15
Section/Township/Range:	Not reported
GIS Date Measured:	11/14/2002
GIS Source Name:	ADEQ-GPS (autonomous)
GIS Collector Staff Code:	Frame, Philip
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Garmin GPS III Plus
GPS Receiver Cannels:	12
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Converted from RST Inspection 05/15/2005
GIS Huc:	11010004
GIS Planning Segment:	4F
GIS Ark Sen Dist:	12
GIS Ark Rep Dist:	072
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	35
Latitude Minute:	46
Latitude Second:	17.33
Longitude Degree:	-91
Longitude Minute:	39
Longitude Second:	4.35
Latitude Decimal:	35.771481
Longitude Decimal:	-91.651207
Comments:	Not reported
Permit Number:	32001616
Permit Issued Date:	Not reported

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	GLEN WILLIS
Permit Contact Telephone:	5017938816
Permit Mail Address 1:	OFFICE OF EMERGENCY SERVICES
Permit Mail Address 2:	368 E MAIN ST
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959404.14
Permit UTM Easting:	621884.51
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2012-09-06 00:00:00
Permit GIS Source Name:	ADEQ-GPS (postprocessed)
Permit GIS Collector Staff Code:	Brown, Shanetta
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Juno Series 3
Permit GPS Receiver Cannels:	12
Permit GIS Base Station Name:	CORS, Batesville, AR
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	22
Permit GIS PDOP Mask:	3
Permit GIS SNR Mask:	39
Permit GIS Hoizontal Accuracy:	2.5
Permit GIS Comment:	Tank; Imported by HATTENHAUER on 9/6/2012 (JB090609A_12.cor).
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1994-02-02 00:00:00

OFFICE OF EMERGENCY SERVICES (Continued) **U001714659**

Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 16.12 / -91 39 5.65

B12 **OFFICE OF EMERGENCY SERVICES** **UST FINDER** **1028163728**
SSW **368 E MAIN ST** **UST FINDER RELEASE** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.052 mi.
277 ft. **Site 5 of 5 in cluster B**

Relative:
Higher

Actual:
323 ft.

UST FINDER:

Object ID:	34878
Facility ID:	AR32001616
Name:	OFFICE OF EMERGENCY SERVICES
Address:	368 E MAIN ST
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	Not reported
Open USTs:	0
Closed USTs:	2
TOS USTs:	0
Population 1500ft:	293
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	State
X Coord:	-91.6515699999999
Y Coord:	35.771146
Latitude:	35.771146
Longitude:	-91.65157

UST FINDER:

Object ID:	95376
Facility ID:	AR32001616
Tank ID:	AR32001616_1
Tank Status:	Closed
Installation Date:	1977/01/01 16:00:00+00
Removal Date:	1994/02/23 15:59:59+00
Tank Capacity:	4000

OFFICE OF EMERGENCY SERVICES (Continued) **1028163728**

Substances:	Diesel
Tank Wall Type:	Single
Object ID:	84856
Facility ID:	AR32001616
Tank ID:	AR32001616_2
Tank Status:	Closed
Installation Date:	1994/02/24 15:59:59+00
Removal Date:	2012/11/07 15:59:59+00
Tank Capacity:	550
Substances:	Empty Diesel
Tank Wall Type:	Single

UST FINDER RELEASE:

Object ID:	9104
Facility ID:	AR32001616
Lust ID:	AR320033
Name:	OFFICE OF EMERGENCY SERVICES
Address:	368 E MAIN STREET
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Reported Date:	2013/10/21 15:59:59+00
Status:	No Further Action
Substance:	Diesel
Population within 1500ft:	294
Domestic Wells within 1500ft:	0
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - SurRELEASEe Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Within 100yr Floodplain:	No
Tribe:	Not reported
EPA Region:	6
NFA Letter 1:	Not reported
NFA Letter 2:	Not reported
NFA Letter 3:	Not reported
NFA Letter 4:	Not reported
Closed With Residual Contaminate:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.6514505
Y Coord:	35.7714360000001
Latitude:	35.771436
Longitude:	-91.6514505

C13 **COLLIER OIL COMPANY, INC.** **UST** **U001903560**
SE **POST OFFICE BOX 2222** **AST** **N/A**
< 1/8 **BATESVILLE, AR 72503** **PERMITS**
0.079 mi.
419 ft. **Site 2 of 4 in cluster C**

Relative:
Lower

Actual:
318 ft.

UST:

Facility Id:	32000044
ADEQ Facility ID:	32-00349
Active Site:	Not reported
Above Ground:	Yes
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	05/24/1996
Lust Flag:	UST
Leak ID Number:	Not reported
Date Received:	05/09/1986
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	J. W. COLLIER
Contact Title:	PRESIDENT
Contact Phone:	501-793-7644
Certified Name:	J. W. COLLIER
Certified Title:	PRESIDENT
Date Signed:	05/01/1986
Amended:	No
No Bill:	Not reported
Facility Entry Clerk:	GCRAGG
Facility Update Date:	Not reported
Facility Update Clerk:	Not reported
Latitude:	Not reported
Longitude:	Not reported

Owner:

Owner ID:	002881
Owner Name:	BONE, JIM DBA COLLIER OIL
Owner Address:	POB 2283
Owner City,St,Zip:	BATESVILLE, AR 72501
Owner County:	INDEPENDENCE
Owner Phone:	8707933655
Owner Type:	Private Industry

Tank Info:

Facility ID:	32000044
Record Created By:	Not reported
Record Created Date:	01/16/1991
Record Modified By:	Not reported
Record Modified Date:	Not reported
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID: 1

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Tank Status:	**PO 12/01/1988**
Install Date:	01/01/1987
Tank Contents:	Empty, Used Oil,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported

Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

AST:

Facility Id:	32000044
AFIN:	3200349
Date Owner Notice Rec:	05/09/1986
Active Site:	Not reported
Underground-Aboveground:	Not reported
Underground Temp Out:	Not reported
Aboveground Temp Out:	Not reported
Underground Perm Out:	Yes
Aboveground Perm Out:	Yes
Aboveground in Use:	Not reported
Underground in Use:	Not reported
Aboveground:	Yes
Below Ground:	Yes
Federal Flag:	Yes
No Bill:	Not reported
Date Signed:	05/01/1986
Amendments Exist for Facility:	No
Date Reg Cert. Issued:	05/24/1996
Leaking UST Incident:	Not reported
Leak Id Number:	Not reported
With Inspection Pix:	Not reported
With Inspection Reports:	Not reported
Contact Title:	PRESIDENT
Contact Name:	J. W. COLLIER
Contact Phone:	5017937644
Certified Title:	PRESIDENT
Certified Name:	J. W. COLLIER
Entry Clerk:	GCRAGG
Entry Date:	01/16/1991

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Update Clerk: Not reported
Update Date: Not reported
Latitude: Not reported
Longitude: Not reported

Owner:
Owner ID: 002881
Owner Name: BONE, JIM DBA COLLIER OIL
Owner Address: POB 2283
Owner City,St,Zip: BATESVILLE, AR 72501
Owner County: INDEPENDENCE
Owner Phone: 8707933655
Owner Type: Private Industry

Tank Info:
Facility ID: 32000044
Tank ID: 1
Tank Status: Permanently Out of Service
Tank Status Date: Not reported
Capacity: 12000
Install Date: 01/01/1984
Last Used Date: Not reported
Removal Status: Not reported
Gallons Removed: 0
Number of Compartments: 1
Tank Material: Steel
Tank Material Other: Not reported
Currently or Last Substance Stored: Gasoline
Other Substance Description: Not reported
Piping Material: Galvanized Steel
Internal Corrosion Protection: None
External Corrosion Prot: Painted
GIS Location ID: Not reported
REC Create By: Not reported
REC Create Date: Not reported
REC Modified By: MARSH
REC Modified Date: 03/21/1997
Tank Comments: Not reported
Decode for Tstatus: Permanently Out of Use

Facility ID: 32000044
Tank ID: 2
Tank Status: Permanently Out of Service
Tank Status Date: Not reported
Capacity: 12000
Install Date: 01/01/1984
Last Used Date: Not reported
Removal Status: Not reported
Gallons Removed: 0
Number of Compartments: 1
Tank Material: Steel
Tank Material Other: Not reported
Currently or Last Substance Stored: Diesel
Other Substance Description: Not reported
Piping Material: Galvanized Steel
Internal Corrosion Protection: None
External Corrosion Prot: Painted

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use
Facility ID:	32000044
Tank ID:	3
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	12000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Gasoline
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use
Facility ID:	32000044
Tank ID:	4
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	16000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Gasoline
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Facility ID:	32000044
Tank ID:	5
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	16000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Diesel
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	6
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	17000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Diesel
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	7
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	17000
Install Date:	01/01/1984
Last Used Date:	Not reported

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Gasoline
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	8
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	17000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Gasoline
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	9
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	8000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Kerosene
Other Substance Description:	Not reported

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	10
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	4000
Install Date:	01/01/1984
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Kerosene
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	11
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	5000
Install Date:	01/01/1983
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Diesel
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

Facility ID:	32000044
Tank ID:	12
Tank Status:	Permanently Out of Service
Tank Status Date:	Not reported
Capacity:	8000
Install Date:	01/01/1983
Last Used Date:	Not reported
Removal Status:	Not reported
Gallons Removed:	0
Number of Compartments:	1
Tank Material:	Steel
Tank Material Other:	Not reported
Currently or Last Substance Stored:	Diesel
Other Substance Description:	Not reported
Piping Material:	Galvanized Steel
Internal Corrosion Protection:	None
External Corrosion Prot:	Painted
GIS Location ID:	Not reported
REC Create By:	Not reported
REC Create Date:	Not reported
REC Modified By:	MARSH
REC Modified Date:	03/21/1997
Tank Comments:	Not reported
Decode for Tstatus:	Permanently Out of Use

PERMITS:

Name:	COLLIER OIL COMPANY, INC.
Address:	POST OFFICE BOX 2222
City,State,Zip:	BATESVILLE, AR 72503
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200349
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	BONE, JIM DBA COLLIER OIL
Owner ID:	002881
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported
Permit Number:	32000044
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R

COLLIER OIL COMPANY, INC. (Continued) **U001903560**

Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	J. W. COLLIER
Permit Contact Telephone:	5017937644
Permit Mail Address 1:	COLLIER OIL COMPANY, INC.
Permit Mail Address 2:	POST OFFICE BOX 2222
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72503
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Not reported
Permit GIS Original Datum Code:	Not reported
Permit GIS Current Datum Code:	Not reported
Permit UTM Northing:	Not reported
Permit UTM Easting:	Not reported
Permit UTM Zone:	Not reported
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Not reported
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	Not reported
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Not reported
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-01-16 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	Not reported

C14
SE
< 1/8
0.083 mi.
439 ft.

CROUCH FUNERAL HOME
510 E. COLLEGE
BATESVILLE, AR 72501

Site 3 of 4 in cluster C

UST
PERMITS

U001903563
N/A

Relative:
Lower

Actual:
320 ft.

UST:

Facility Id:	32000053
ADEQ Facility ID:	32-00358
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	Not reported
Lust Flag:	UST
Leak ID Number:	Not reported
Date Received:	05/09/1986
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	JIM CROUCH
Contact Title:	OWNER
Contact Phone:	501-793-4161
Certified Name:	J. W. COLLIER
Certified Title:	PRESIDENT
Date Signed:	03/10/1988
Amended:	Yes
No Bill:	Not reported
Facility Entry Clerk:	Jane Marsh
Facility Update Date:	10/17/1991
Facility Update Clerk:	BRADFORD
Latitude:	Not reported
Longitude:	Not reported

Owner:

Owner ID:	002866
Owner Name:	CROUCH, JAMES P.
Owner Address:	510 E. COLLEGE
Owner City,St,Zip:	BATESVILLE, AR 72501
Owner County:	INDEPENDENCE
Owner Phone:	5017934161
Owner Type:	Private Industry

AST/UST Eligible:

Facility Id:	32000053
Date Eligible:	11/14/1991
Transaction Code:	CIOU
Entry Clerk:	GCRAGG
Entry Date:	11/14/1991
Update Clerk:	Not reported
Update Date:	Not reported
Eligibility Description:	Certificate issued, original, UST

Tank Info:

Facility ID:	32000053
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	SUMMERS
Record Modified Date:	1/4/1993

CROUCH FUNERAL HOME (Continued) **U001903563**

Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	1
Tank Status:	**PO 12/08/1992**
Install Date:	01/01/1986
Tank Contents:	Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	550
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Galvanized Steel,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

PERMITS:

Name:	CROUCH FUNERAL HOME
Address:	510 E. COLLEGE
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200358
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	CROUCH, JAMES P.
Owner ID:	002866
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported

CROUCH FUNERAL HOME (Continued) **U001903563**

Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported
Permit Number:	32000053
Permit Issued Date:	Not reported

CROUCH FUNERAL HOME (Continued) **U001903563**

Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	JIM CROUCH
Permit Contact Telephone:	5017934161
Permit Mail Address 1:	CROUCH FUNERAL HOME
Permit Mail Address 2:	510 E. COLLEGE
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Not reported
Permit GIS Original Datum Code:	Not reported
Permit GIS Current Datum Code:	Not reported
Permit UTM Northing:	Not reported
Permit UTM Easting:	Not reported
Permit UTM Zone:	Not reported
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Not reported
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	Not reported
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Not reported
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-02-04 00:00:00

CROUCH FUNERAL HOME (Continued) **U001903563**

Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	Not reported

C15 **CROUCH FUNERAL HOME** **UST FINDER** **1028163643**
SE **510 E. COLLEGE** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.083 mi.
439 ft. **Site 4 of 4 in cluster C**

Relative: **Lower**
Actual: **320 ft.**

UST FINDER:

Object ID:	34963
Facility ID:	AR32000053
Name:	CROUCH FUNERAL HOME
Address:	510 E. COLLEGE
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Open USTs:	0
Closed USTs:	1
TOS USTs:	0
Population 1500ft:	443
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.649421
Y Coord:	35.771373
Latitude:	35.771373
Longitude:	-91.649421

UST FINDER:

Object ID:	96547
Facility ID:	AR32000053
Tank ID:	AR32000053_1
Tank Status:	Closed
Installation Date:	1986/01/01 16:00:00+00
Removal Date:	1992/12/08 15:59:59+00
Tank Capacity:	550

CROUCH FUNERAL HOME (Continued) **1028163643**

Substances: Gasoline
Tank Wall Type: Single

D16 **AR GARBAGE** **RCRA NonGen / NLR** **1000115017**
SW **3RD & MAIN** **ARD000708917**
< 1/8 **BATESVILLE, AR 72501**
0.096 mi.
507 ft. **Site 1 of 2 in cluster D**

Relative: **Lower**
Actual: **314 ft.**

RCRA Listings:

Date Form Received by Agency:		19990709
Handler Name:		Ar Garbage
Handler Address:		3rd & Main
Handler City,State,Zip:		BATESVILLE, AR 72501
EPA ID:		ARD000708917
Contact Name:		LARRY BARBER
Contact Address:		PO BOX 2834
Contact City,State,Zip:		BATESVILLE, AR 72501
Contact Telephone:		870-698-1098
Contact Fax:		Not reported
Contact Email:		Not reported
Contact Title:		Not reported
EPA Region:		06
Land Type:		Private
Federal Waste Generator Description:		Not a generator, verified
Non-Notifier:		Not reported
Biennial Report Cycle:		Not reported
Accessibility:		Not reported
Active Site Indicator:		Not reported
State District Owner:		Ar
State District:		1
Mailing Address:		PO BOX 2834
Mailing City,State,Zip:		BATESVILLE, AR 72501
Owner Name:	Larry Barber	
Owner Type:		Private
Operator Name:	Not reported	
Operator Type:		Not reported
Short-Term Generator Activity:		No
Importer Activity:		No
Mixed Waste Generator:		No
Transporter Activity:		No
Transfer Facility Activity:		No
Recycler Activity with Storage:		No
Small Quantity On-Site Burner Exemption:		No
Smelting Melting and Refining Furnace Exemption:		No
Underground Injection Control:		No
Off-Site Waste Receipt:		No
Universal Waste Indicator:		No
Universal Waste Destination Facility:		No
Federal Universal Waste:		No
Active Site State-Reg Handler:		---
Federal Facility Indicator:		Not reported
Hazardous Secondary Material Indicator:		N
Sub-Part K Indicator:		Not reported
2018 GPRA Permit Baseline:		Not on the Baseline
2018 GPRA Renewals Baseline:		Not on the Baseline
202 GPRA Corrective Action Baseline:		No

AR GARBAGE (Continued) **1000115017**

Subject to Corrective Action Universe:	No
Non-TSDFs Where RCRA CA has Been Imposed Universe:	No
Corrective Action Priority Ranking:	No NCAPS ranking
Environmental Control Indicator:	No
Institutional Control Indicator:	No
Human Exposure Controls Indicator:	N/A
Groundwater Controls Indicator:	N/A
Significant Non-Complier Universe:	No
Unaddressed Significant Non-Complier Universe:	No
Addressed Significant Non-Complier Universe:	No
Significant Non-Complier With a Compliance Schedule Universe:	No
Financial Assurance Required:	Not reported
Handler Date of Last Change:	20000902
Recognized Trader-Importer:	No
Recognized Trader-Exporter:	No
Importer of Spent Lead Acid Batteries:	No
Exporter of Spent Lead Acid Batteries:	No
Recycler Activity Without Storage:	No
Manifest Broker:	No
Sub-Part P Indicator:	No

Hazardous Waste Summary:

Waste Code:	D000
Waste Description:	Not Defined
Waste Code:	D001
Waste Description:	Ignitable Waste
Waste Code:	F001
Waste Description:	The Following Spent Halogenated Solvents Used In Degreasing: Tetrachloroethylene, Trichlorethylene, Methylene Chloride, 1,1,1-Trichloroethane, Carbon Tetrachloride And Chlorinated Fluorocarbons; All Spent Solvent Mixtures/Blends Used In Degreasing Containing, Before Use, A Total Of Ten Percent Or More (By Volume) Of One Or More Of The Above Halogenated Solvents Or Those Solvents Listed In F002, F004, And F005; And Still Bottoms From The Recovery Of These Spent Solvents And Spent Solvent Mixtures.
Waste Code:	F003
Waste Description:	The Following Spent Nonhalogenated Solvents: Xylene, Acetone, Ethyl Acetate, Ethyl Benzene, Ethyl Ether, Methyl Isobutyl Ketone, N-Butyl Alcohol, Cyclohexanone, And Methanol; All Spent Solvent Mixtures/Blends Containing, Before Use, Only The Above Spent Nonhalogenated Solvents; And All Spent Solvent Mixtures/Blends Containing, Before Use, One Or More Of The Above Nonhalogenated Solvents, And A Total Of Ten Percent Or More (By Volume) Of One Or More Of Those Solvents Listed In F001, F002, F004, And F005; And Still Bottoms From The Recovery Of These Spent Solvents And Spent Solvent Mixtures.
Waste Code:	F005
Waste Description:	The Following Spent Nonhalogenated Solvents: Toluene, Methyl Ethyl Ketone, Carbon Disulfide, Isobutanol, Pyridine, Benzene, 2-Ethoxyethanol, And 2-Nitropropane; All Spent Solvent Mixtures/Blends Containing, Before Use, A Total Of Ten Percent Or More (By Volume) Of One Or More Of The Above Nonhalogenated Solvents Or Those Solvents

AR GARBAGE (Continued) **1000115017**

Listed In F001, F002, Or F004; And Still Bottoms From The Recovery Of These Spent Solvents And Spent Solvent Mixtures.

Waste Code: F017
Waste Description: Not Defined

Waste Code: F018
Waste Description: Not Defined

Waste Code: U116
Waste Description: 2-Imidazolidinethione (Or) Ethylenethiourea

Handler - Owner Operator:
Owner/Operator Indicator: Owner
Owner/Operator Name: LARRY BARBER
Legal Status: Private
Date Became Current: Not reported
Date Ended Current: Not reported
Owner/Operator Address: PO BOX 2834
Owner/Operator City,State,Zip: BATESVILLE, AR 72501
Owner/Operator Telephone: 870-698-1098
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Historic Generators:
Receive Date: 19990709
Handler Name: AR GARBAGE
Federal Waste Generator Description: Not a generator, verified
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: Yes
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

List of NAICS Codes and Descriptions:
NAICS Codes: No NAICS Codes Found

Facility Has Received Notices of Violations:
Violations: No Violations Found

Evaluation Action Summary:
Evaluations: No Evaluations Found

D17
SW
< 1/8
0.096 mi.
507 ft.

AR GARBAGE
3RD & MAIN
BATESVILLE, AR 72501

Site 2 of 2 in cluster D

HW GEN

S125897312
N/A

Relative:
Lower

Actual:
314 ft.

HW GEN:

Name:	AR GARBAGE
Address:	3RD & MAIN
City,State,Zip:	BATESVILLE, AR 72501
EPAID:	ARD000708917
AFIN:	3200085
AFIN Dash:	32-00085
Owner Operator Name:	LARRY BARBER
Owner Operator Address:	Not reported
Owner Operator City:	Not reported
Owner Operator State:	Not reported
Owner Operator Zip:	Not reported
Owner Operator Phone Number:	Not reported
Type Description:	Private
Federal Generator Status:	N
State Generator Status:	6
NAICS Code:	Not reported
NAICS Desc:	Not reported
CME:	Not reported
CA:	Not reported
Permit:	Not reported

EPAECHO Compliance Link:

Contact:

EPAID:	ARD000708917
Mailing Address:	PO BOX 2834
Mailing City:	BATESVILLE
Mailing State:	AR
Mailing Zip:	72501
Contact Name:	LARRY BARBER
Contact Telephone:	870-698-1098
Contact Address:	PO BOX 2834
Contact City:	BATESVILLE
Contact State:	AR
Contact Zip:	72501

18
South
< 1/8
0.119 mi.
626 ft.

ARKANSAS SAND COMPANY

INDEPENDENCE (County), AR

US MINES

1009578990
N/A

Relative:
Lower

Actual:
319 ft.

US MINES:

Sic Code(s):	144600
Sic Code(s):	000000
Sic Code(s):	000000
Sic Code(s):	000000
Sic Code(s):	000000
Sic Code(s):	000000
Mine ID:	0301904
Entity Name:	ARKANSAS SAND COMPANY
Company:	ARKANSAS SAND COMPANY

ARKANSAS SAND COMPANY (Continued) **1009578990**

Status:	Permanently Abandoned
Status Date:	20121211
Operation Class:	2
Number of Shops:	0
Number of Plants:	0
Latitude Degree:	35
Longitude Degree:	091
Latitude Minute:	46
Latitude Seconds:	13
Longitude Minutes:	39
Longitude Seconds:	03
Number of Pits:	000

---

19 **JAY F SHELL** **EDR Hist Auto** **1020960303**
SE **551 E BOSWELL ST** **N/A**
< 1/8 **BATESVILLE, AR 72501**
0.124 mi.
654 ft.

Relative: EDR Hist Auto
Higher

Actual:
322 ft.

Year:	Name:	Type:
2002	JAY F SHELL	Gasoline Service Stations
2003	JAY F SHELL	Gasoline Service Stations

E20 **QUIK MART #1** **UST FINDER** **1028163671**
SSE **312 FOURTH STREET** **UST FINDER RELEASE** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.154 mi.
813 ft. **Site 1 of 5 in cluster E**

Relative: UST FINDER:
Lower

Actual:
314 ft.

Object ID:	34935
Facility ID:	AR32000082
Name:	QUIK MART #1
Address:	312 FOURTH STREET
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	Not reported
Open USTs:	0
Closed USTs:	2
TOS USTs:	0
Population 1500ft:	447
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)

QUIK MART #1 (Continued) **1028163671**

Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	State
X Coord:	-91.64955
Y Coord:	35.7699710000001
Latitude:	35.769971
Longitude:	-91.64955

UST FINDER:

Object ID:	85831
Facility ID:	AR32000082
Tank ID:	AR32000082_1
Tank Status:	Closed
Installation Date:	1968/06/01 16:00:01+00
Removal Date:	2007/08/28 15:59:59+00
Tank Capacity:	6000
Substances:	Empty Gasoline
Tank Wall Type:	Single

Object ID:	85832
Facility ID:	AR32000082
Tank ID:	AR32000082_2
Tank Status:	Closed
Installation Date:	1968/06/01 16:00:01+00
Removal Date:	2007/08/28 15:59:59+00
Tank Capacity:	6000
Substances:	Empty Gasoline
Tank Wall Type:	Single

UST FINDER RELEASE:

Object ID:	9096
Facility ID:	AR32000082
Lust ID:	AR320014
Name:	QUIK MART #1
Address:	312 FOURTH STREET
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Reported Date:	2005/07/27 15:59:59+00
Status:	No Further Action
Substance:	Gasoline Diesel
Population within 1500ft:	421
Domestic Wells within 1500ft:	0
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - SurRELEASEe Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Within 100yr Floodplain:	No
Tribe:	Not reported

QUIK MART #1 (Continued) **1028163671**

EPA Region:	6
NFA Letter 1:	Not reported
NFA Letter 2:	Not reported
NFA Letter 3:	Not reported
NFA Letter 4:	Not reported
Closed With Residual Contaminate:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.6499295
Y Coord:	35.770023
Latitude:	35.770023
Longitude:	-91.6499295

E21 **QUIK MART #1** **LTANKS** **U003403986**
SSE **312 FOURTH STREET** **UST** **N/A**
1/8-1/4 **BATESVILLE, AR 72501** **PERMITS**
0.154 mi.
813 ft. **Site 2 of 5 in cluster E**

Relative: LTANKS:
Lower

Actual: **314 ft.**

Name:	QUIK MART #1
Address:	312 FOURTH STREET
Address 2:	Not reported
City,State,Zip:	BATESVILLE, AR 72501
RST Facility ID:	32000082
Facility Telephone:	Not reported
Owner:	RSB PROPERTIES, LLC
Lust Owner:	010237
Leak Date:	Not reported
Leak Volume:	Not reported
Substance Stored:	Gasoline, Diesel
Release Status:	Confirmed
Release Confirmed:	9/13/2005
Damage Description:	Sub Surface Soils/Groundwater
Lust Tank Type:	Underground Tank
Lust Dicovery:	PT Assessment
Notification Date:	7/27/2005
Cleanup Initiated:	8/28/2007
Notification Name:	CHUCK RICHESIN
Notification Address:	POLLUTION MANAGEMENT INC.
Notification Address2:	3512 SOUTH SHACKLEFORD
Notification City,St,Zip:	LITTLE ROCK, AR 72201
Notification Telephone:	(501) 221-7122
Notice Number:	320014
Tech Branch:	9/20/2005
AFIN Number:	3200386
Emergency Response:	No
Emergency Response 2:	Not reported
Hazard Abatement:	Not reported
Remedial Action:	Excv Disp
ISC Date:	Not reported
Priority Score:	Not reported
SAR Date:	Not reported
Cap Submit:	Not reported
Public Notify:	Not reported
Cap Approve:	Not reported
NFA Issued:	2007-09-27 00:00:00
Funding Source:	Not reported

QUIK MART #1 (Continued) **U003403986**

Cleanup Lead: Not reported
Gis Location: Not reported
Lust Tank Type 2: Underground Tank
RST Modified Date: Not reported
Leak Damage: UNKNOWN
Memo: CONTAMINATION DISCOVERED DURING PHASE INSPECTION BY PMI, PER INSPECTOR SUPERVISOR, REFERED TO TECH BRANCH BASED ON PROVIDED SAMPLE RESULTS 8/27/07 Voluntary closure of entire tank system completed, with no soil contamination above reporting limits. 9/27/07 No further action letter issued based on streamlined preliminary assessment conducted 9/25/07. [routh 9/28/2007 8:38:39 AM].

UST:
Facility Id: 32000082
ADEQ Facility ID: 32-00386
Active Site: Not reported
Above Ground: Not reported
Below Ground: Yes
Aboveground in Use: UST
Underground in Use: UST
Date Reg Cert Issued: 07/06/2007
Lust Flag: UST
Leak ID Number: 32-0014
Date Received: 09/25/2007
Location SIC: Not reported
Federal Flag: Yes
Contact Name: CARLA STIGER
Contact Title: SR V PRESIDENT
Contact Phone: 870-523-3601
Certified Name: CARLA STIGER BY/ B WINNINGHAM
Certified Title: CONTRACTOR
Date Signed: 09/24/2007
Amended: Yes
No Bill: UST
Facility Entry Clerk: LST
Facility Update Date: 11/28/2007
Facility Update Clerk: schenk
Latitude: 35.769971
Longitude: -91.649550

Owner:
Owner ID: 010237
Owner Name: RSB PROPERTIES LLC
Owner Address: 120 HAZEL ST
Owner Address 2: PO BOX 650
Owner City,St,Zip: NEWPORT, AR 72112
Owner County: JACKSON
Owner Phone: 8705233601
Owner Type: Private Industry

AST/UST Eligible:
Facility Id: 32000082
Date Eligible: 11/14/1991
Transaction Code: CIOU
Entry Clerk: GCRAGG
Entry Date: 11/14/1991
Update Clerk: Not reported

QUIK MART #1 (Continued) **U003403986**

Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Facility Id: 32000082
Date Eligible: 4/22/2005
Transaction Code: CIOU
Entry Clerk: BATEMAN
Entry Date: 4/22/2005
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Facility Id: 32000082
Date Eligible: 8/26/2005
Transaction Code: CIOU
Entry Clerk: fields
Entry Date: 8/26/2005 9:27:57 AM
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Tank Info:
Facility ID: 32000082
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: schenk
Record Modified Date: 11/28/2007 11:59:00 AM
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: 08/20/1998
Certificate of Compliance Test Company License: 000059
Certificate of Compliance Tester License: 000939
Certificate of Compliance Installation Date: Not reported
Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 1
Tank Status: PO 08/28/2007
Install Date: 06/01/1968
Tank Contents: Empty, Gasoline
Cerclis Name: Not reported
Tank Material: Steel, External Liner
GIS Location: Not reported
Federal Flag: Not reported
Hazardous: Not reported
Capacity in Gallons: 6000
Number of Compartments: 1
Decode for Tstatus: Permanently Out of Use
Release Detection: IC Flag
Release Detection Install Date: Not reported
Tank External Corrosion Protection: Lined
Tank Ext Corrosion Protection Install Date: Not reported
Pipe Material: Fiberglass Reinforced Plastic
Pipe Type: Pressure
Pipe Release Detection: Tightness, Line Leak
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection: Basin, Auto Shutoff, Auto Flow

QUIK MART #1 (Continued) **U003403986**

Pipe Repaired: Not reported
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Corrosion Protection: X
Spill and Overflow: X
Release Detection: Yes
Tank Comments: Not reported

Facility ID: 32000082
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: schenk
Record Modified Date: 11/28/2007 11:59:18 AM
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: 08/20/1998
Certificate of Compliance Test Company License: 000059
Certificate of Compliance Tester License: 000939
Certificate of Compliance Installation Date: Not reported
Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 2
Tank Status: PO 08/28/2007
Install Date: 06/01/1968
Tank Contents: Empty, Gasoline
Cerclis Name: Not reported
Tank Material: Steel, External Liner
GIS Location: Not reported
Federal Flag: Not reported
Hazardous: Not reported
Capacity in Gallons: 6000
Number of Compartments: 1
Decode for Tstatus: Permanently Out of Use
Release Detection: IC Flag
Release Detection Install Date: Not reported
Tank External Corrosion Protection: Lined
Tank Ext Corrosion Protection Install Date: Not reported
Pipe Material: Fiberglass Reinforced Plastic
Pipe Type: Pressure
Pipe Release Detection: Tightness, Line Leak
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection: Basin, Auto Shutoff, Auto Flow
Pipe Repaired: Not reported
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Corrosion Protection: X
Spill and Overflow: X
Release Detection: Yes
Tank Comments: Not reported

PERMITS:
Name: QUIK MART #1
Address: 312 FOURTH STREET
City,State,Zip: BATESVILLE, AR 72501
Facility Type Desc: Standard
Alternate Facility Name: Not reported
Facility Status: Active
AFIN: 3200386

QUIK MART #1 (Continued) **U003403986**

AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	RSB PROPERTIES LLC
Owner ID:	010237
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Lat/Long
GIS Original Datum Code:	NAD83
GIS Current Datum Code:	NAD83
UTM Northing:	3959276.35
UTM Easting:	622068.94
UTM Zone:	15
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Geocoded
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Original data replaced by Geocoded values on 6/12/2006 12:28:15 PM by hamptons
GIS Huc:	11010004
GIS Planning Segment:	4F
GIS Ark Sen Dist:	12
GIS Ark Rep Dist:	072
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	2005-08-02 15:00:00
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported

QUIK MART #1 (Continued) **U003403986**

Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	35
Latitude Minute:	46
Latitude Second:	11.89
Longitude Degree:	-91
Longitude Minute:	38
Longitude Second:	58.39
Latitude Decimal:	35.769971
Longitude Decimal:	-91.649550
Comments:	Not reported
Permit Number:	32000082
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	UST
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	CARLA STIGER
Permit Contact Telephone:	8705233601
Permit Mail Address 1:	QUIK MART #1
Permit Mail Address 2:	312 FOURTH STREET
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959276.35
Permit UTM Easting:	622068.94
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Geocoded
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported

QUIK MART #1 (Continued) **U003403986**

Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Original data replaced by Geocoded values on 6/12/2006 12:28:15 PM by hamptons
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1987-05-18 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	RST Underground Tank
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 11.89 / -91 38 58.39

E22 **SOUTHWESTERN BELL** **RCRA NonGen / NLR** **1001075368**
SSE **410 E BOSWELL** **FINDS** **ARR000001800**
1/8-1/4 **BATESVILLE, AR 72501** **ECHO**
0.155 mi. **HW GEN**
818 ft. **Site 3 of 5 in cluster E** **PERMITS**

Relative: **Lower**
Actual: **319 ft.**

RCRA Listings:

Date Form Received by Agency:	19970226
Handler Name:	Southwestern Bell
Handler Address:	E Boswell
Handler City,State,Zip:	BATESVILLE, AR 72501
EPA ID:	ARR000001800
Contact Name:	BOBBIE DAY
Contact Address:	1010 PINE ST ROOM 20-E-48
Contact City,State,Zip:	ST LOUIS, MO 63101
Contact Telephone:	314-235-4549
Contact Fax:	Not reported
Contact Email:	Not reported
Contact Title:	Not reported
EPA Region:	06
Land Type:	Private
Federal Waste Generator Description:	Not a generator, verified
Non-Notifier:	Not reported
Biennial Report Cycle:	Not reported
Accessibility:	Not reported
Active Site Indicator:	Not reported
State District Owner:	Ar
State District:	1
Mailing Address:	PINE ST ROOM 20-E-48
Mailing City,State,Zip:	ST LOUIS, MO 63101
Owner Name:	Southwestern Bell Telephone Company
Owner Type:	Private
Operator Name:	Not reported
Operator Type:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Short-Term Generator Activity:	No
Importer Activity:	No
Mixed Waste Generator:	No
Transporter Activity:	No
Transfer Facility Activity:	No
Recycler Activity with Storage:	No
Small Quantity On-Site Burner Exemption:	No
Smelting Melting and Refining Furnace Exemption:	No
Underground Injection Control:	No
Off-Site Waste Receipt:	No
Universal Waste Indicator:	No
Universal Waste Destination Facility:	No
Federal Universal Waste:	No
Active Site State-Reg Handler:	---
Federal Facility Indicator:	Not reported
Hazardous Secondary Material Indicator:	N
Sub-Part K Indicator:	Not reported
2018 GPRA Permit Baseline:	Not on the Baseline
2018 GPRA Renewals Baseline:	Not on the Baseline
202 GPRA Corrective Action Baseline:	No
Subject to Corrective Action Universe:	No
Non-TSDFs Where RCRA CA has Been Imposed Universe:	No
Corrective Action Priority Ranking:	No NCAPS ranking
Environmental Control Indicator:	No
Institutional Control Indicator:	No
Human Exposure Controls Indicator:	N/A
Groundwater Controls Indicator:	N/A
Significant Non-Complier Universe:	No
Unaddressed Significant Non-Complier Universe:	No
Addressed Significant Non-Complier Universe:	No
Significant Non-Complier With a Compliance Schedule Universe:	No
Financial Assurance Required:	Not reported
Handler Date of Last Change:	20000902
Recognized Trader-Importer:	No
Recognized Trader-Exporter:	No
Importer of Spent Lead Acid Batteries:	No
Exporter of Spent Lead Acid Batteries:	No
Recycler Activity Without Storage:	No
Manifest Broker:	No
Sub-Part P Indicator:	No

Hazardous Waste Summary:

Waste Code:	D008
Waste Description:	Lead

Handler - Owner Operator:

Owner/Operator Indicator:	Owner
Owner/Operator Name:	SOUTHWESTERN BELL TELEPHONE COMPANY
Legal Status:	Private
Date Became Current:	Not reported
Date Ended Current:	Not reported
Owner/Operator Address:	1010 PINE ST
Owner/Operator City,State,Zip:	ST LOUIS, MO 63101
Owner/Operator Telephone:	314-235-4549
Owner/Operator Telephone Ext:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Historic Generators:
Receive Date: 19970226
Handler Name: SOUTHWESTERN BELL
Federal Waste Generator Description: Not a generator, verified
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: Yes
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

List of NAICS Codes and Descriptions:
NAICS Codes: No NAICS Codes Found

Facility Has Received Notices of Violations:
Violations: No Violations Found

Evaluation Action Summary:
Evaluations: No Evaluations Found

FINDS:
Registry ID: 110001707074

Click Here for FRS Facility Detail Report:

Environmental Interest/Information System:
The Arkansas Permit Data System (PDS) is an integrated system maintaining data on air quality, mining, tires, solid waste, tank, water and hazardous waste, as well as inspections, invoicing and complaints.
The Resource Conservation and Recovery Act Information System (RCRAInfo) is EPA's comprehensive information system in support of the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. It tracks many types of information about generators, transporters, treaters, storers, and disposers of hazardous waste.

Click this hyperlink while viewing on your computer to access additional FINDS: detail in the EDR Site Report.

ECHO:
Envid: 1001075368
Registry ID: 110001707074

DFR URL:
Name: SOUTHWESTERN BELL
Address: 410 E Boswell
City,State,Zip: BATESVILLE, AR 72501

SOUTHWESTERN BELL (Continued) **1001075368**

HW GEN:

Name:	SOUTHWESTERN BELL
Address:	410 E BOSWELL
City,State,Zip:	BATESVILLE, AR 72501
EPAID:	ARR000001800
AFIN:	3200288
AFIN Dash:	32-00288
Owner Operator Name:	SOUTHWESTERN BELL TELEPHONE COMPANY
Owner Operator Address:	Not reported
Owner Operator City:	Not reported
Owner Operator State:	Not reported
Owner Operator Zip:	Not reported
Owner Operator Phone Number:	Not reported
Type Description:	Private
Federal Generator Status:	N
State Generator Status:	6
NAICS Code:	Not reported
NAICS Desc:	Not reported
CME:	Not reported
CA:	Not reported
Permit:	Not reported

EPAECHO Compliance Link:

Contact:

EPAID:	ARR000001800
Mailing Address:	1010 PINE ST ROOM 20-E-48
Mailing City:	ST LOUIS
Mailing State:	MO
Mailing Zip:	63101
Contact Name:	BOBBIE DAY
Contact Telephone:	314-235-4549
Contact Address:	1010 PINE ST ROOM 20-E-48
Contact City:	ST LOUIS
Contact State:	MO
Contact Zip:	63101

PERMITS:

Name:	SOUTHWESTERN BELL
Address:	410 E BOSWELL
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200288
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	SOUTHWESTERN BELL TEL CO LP
Owner ID:	000963
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Facility Invoice Country:	Not reported
Facility Telephone:	3142354549
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	BOBBIE DAY
Mailing Address 2:	1010 PINE ST ROOM 20-E-48
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	2003-09-11 07:08:00
Modified By:	Not reported
Modified Date:	2003-09-22 14:41:00
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Permit Number:	32000107
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	CHARLIE DAVIDSON
Permit Contact Telephone:	5013733040
Permit Mail Address 1:	SOUTHWESTERN BELL TELEPHONE CO
Permit Mail Address 2:	410 EAST BOSWELL
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Not reported
Permit GIS Original Datum Code:	Not reported
Permit GIS Current Datum Code:	Not reported
Permit UTM Northing:	Not reported
Permit UTM Easting:	Not reported
Permit UTM Zone:	Not reported
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Not reported
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	Not reported
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Not reported
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-08-14 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	Not reported
Permit Number:	ARR000001800
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	HE
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	I
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	Not reported
Permit Inv Single Lbl:	Not reported
Permit Contact Name:	BOBBIE DAY
Permit Contact Telephone:	3142354549
Permit Mail Address 1:	SOUTHWESTERN BELL
Permit Mail Address 2:	1010 PINE ST ROOM 20-E-48
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	ST LOUIS, MO 63101
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959300.40
Permit UTM Easting:	622051.43
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2019-07-22 00:00:00
Permit GIS Source Name:	EPA
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported

SOUTHWESTERN BELL (Continued) **1001075368**

Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Imported by jacksonw on 7/22/2019. Source datafile unknown.
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1996-01-17 00:00:00
Permit Media Description:	Haz Waste EPAID
Permit Type:	Not reported
Permit Status Description:	Inactive
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 12.68 / -91 38 59.06

E23 **SOUTHWESTERN BELL TELEPHONE CO** **UST** **U001220142**
SSE **410 EAST BOSWELL** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.155 mi.
818 ft. **Site 4 of 5 in cluster E**

Relative: **Lower**

Actual: **319 ft.**

UST:

Facility Id:	32000107
ADEQ Facility ID:	32-00288
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	Not reported
Lust Flag:	UST
Leak ID Number:	Not reported
Date Received:	02/03/1988
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	CHARLIE DAVIDSON
Contact Title:	ENVIRONMENTAL MANAGE
Contact Phone:	501-373-3040
Certified Name:	LINDA LOWRY
Certified Title:	MGR ENVI REG
Date Signed:	01/28/1988
Amended:	No
No Bill:	Not reported
Facility Entry Clerk:	HANCOCK
Facility Update Date:	Not reported
Facility Update Clerk:	Not reported
Latitude:	Not reported
Longitude:	Not reported

Owner:

SOUTHWESTERN BELL TELEPHONE CO (Continued) **U001220142**

Owner ID:	000963
Owner Name:	SOUTHWESTERN BELL TEL CO LP
Owner Address:	ENVIRONMENTAL MANAGEMENT
Owner Address 2:	308 S AKARD ST, RM 1700
Owner City,St,Zip:	DALLAS, TX 75202-5399
Owner County:	DALLAS
Owner Phone:	8664926836
Owner Type:	Private Industry

AST/UST Eligible:

Facility Id:	32000107
Date Eligible:	12/5/1991
Transaction Code:	CIOU
Entry Clerk:	GCRAGG
Entry Date:	12/5/1991
Update Clerk:	Not reported
Update Date:	Not reported
Eligibility Description:	Certificate issued, original, UST

Tank Info:

Facility ID:	32000107
Record Created By:	Not reported
Record Created Date:	12/07/1990
Record Modified By:	MARSH
Record Modified Date:	9/18/1992

Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID:	1
Tank Status:	**PO 08/19/1992**
Install Date:	01/01/1981
Tank Contents:	Diesel,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported

Capacity in Gallons:	1000
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Asphalt
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Unknown,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported

SOUTHWESTERN BELL TELEPHONE CO (Continued) **U001220142**

Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

E24 **SOUTHWESTERN BELL TELEPHONE CO** **UST FINDER** **1028163690**
SSE **410 EAST BOSWELL** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.155 mi.
818 ft. **Site 5 of 5 in cluster E**

Relative: **Lower**

Actual: **319 ft.**

UST FINDER:

Object ID:	34916
Facility ID:	AR32000107
Name:	SOUTHWESTERN BELL TELEPHONE CO
Address:	410 EAST BOSWELL
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Open USTs:	0
Closed USTs:	1
TOS USTs:	0
Population 1500ft:	441
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.649673
Y Coord:	35.770086
Latitude:	35.770086
Longitude:	-91.649673

UST FINDER:

Object ID:	96870
Facility ID:	AR32000107
Tank ID:	AR32000107_1
Tank Status:	Closed
Installation Date:	1981/01/01 16:00:00+00
Removal Date:	1992/08/19 15:59:59+00
Tank Capacity:	1000
Substances:	Diesel
Tank Wall Type:	Single

25
SW
1/8-1/4
0.182 mi.
959 ft.

INDEPENDENCE CO.RECYCLING CTR.
192 E. MAIN ST.
BATESVILLE, AR 72501

SWRCY **S118950275**
N/A

Relative:
Lower

Actual:
299 ft.

SWRCY:

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Dropoff:	True
Material Category Year:	2015
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

incorporated and rural areas. City of Batesville reports its numbers.

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

incorporated and rural areas. City of Batesville reports its numbers.

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Dropoff:	True
Material Category Year:	1996
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Material Category Year:	1997
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009

Name:	INDEPENDENCE CO.RECYCLING CTR.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2008

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2009
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2011

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2012

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2013
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2014
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2015

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2016

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2002

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1996

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997

Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1997
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1998
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m.

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	1999
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2000
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2001
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2003
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all

INDEPENDENCE CO.RECYCLING CTR. (Continued) **S118950275**

	incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2004
Name:	INDEPENDENCE CO.RECYCLING CTR.
Address:	192 E. MAIN ST.
City,State,Zip:	BATESVILLE, AR 72501
Region Name:	Northeast
Facility ID:	127
Facility Status:	A
Facility Status Date:	12/02/2009
Contact Type:	Not reported
Fullname:	Not reported
Telephone:	Not reported
Fax:	8707938803
RSWM District:	WRI
EMail:	Not reported
Broker:	False
Collector:	True
Processor:	True
Position:	Not reported
Notes:	The recycling facility phone number is 870-793-8892. 7 a.m.- 5 p.m. M-F and 8 a.m. to 3 p.m. Saturday. City of Batesville coordinates with county; county-wide curbside collection is in place, including all incorporated and rural areas. City of Batesville reports its numbers.
Facility Privately Owned:	False
Facility Community Services:	True
Facility Tax Credit APP:	False
Facility Curbside:	True
Facility Dropoff:	True
Material Category Year:	2010

F26 **SYNERGY GROUP INC** **RCRA NonGen / NLR** **1000220095**
SSW **160 E BOSWELL** **FINDS** **ARD084941582**
1/8-1/4 **BATESVILLE, AR 72501** **ECHO**
0.244 mi.
1286 ft. **Site 1 of 2 in cluster F**

Relative: **Lower**
Actual: **299 ft.**

RCRA Listings:

Date Form Received by Agency:	19800818
Handler Name:	Synergy Group Inc
Handler Address:	E Boswell
Handler City,State,Zip:	BATESVILLE, AR 72501
EPA ID:	ARD084941582
Contact Name:	TOM-N WATSON
Contact Address:	175 PRICE PARKWAY
Contact City,State,Zip:	FARMINGDALE, NY 11735
Contact Telephone:	Not reported
Contact Fax:	Not reported
Contact Email:	Not reported
Contact Title:	Not reported
EPA Region:	06
Land Type:	Private
Federal Waste Generator Description:	Not a generator, verified

SYNERGY GROUP INC (Continued) **1000220095**

Non-Notifier:		Not reported
Biennial Report Cycle:		Not reported
Accessibility:		Not reported
Active Site Indicator:		Not reported
State District Owner:		Ar
State District:		1
Mailing Address:		PRICE PARKWAY
Mailing City,State,Zip:		FARMINGDALE, NY 11735
Owner Name:	Sun Gas Liquids Inc	
Owner Type:		Private
Operator Name:	Not reported	
Operator Type:		Not reported
Short-Term Generator Activity:		No
Importer Activity:		No
Mixed Waste Generator:		No
Transporter Activity:		No
Transfer Facility Activity:		No
Recycler Activity with Storage:		No
Small Quantity On-Site Burner Exemption:		No
Smelting Melting and Refining Furnace Exemption:		No
Underground Injection Control:		No
Off-Site Waste Receipt:		No
Universal Waste Indicator:		No
Universal Waste Destination Facility:		No
Federal Universal Waste:		No
Active Site State-Reg Handler:		---
Federal Facility Indicator:		Not reported
Hazardous Secondary Material Indicator:		N
Sub-Part K Indicator:		Not reported
2018 GPRA Permit Baseline:		Not on the Baseline
2018 GPRA Renewals Baseline:		Not on the Baseline
202 GPRA Corrective Action Baseline:		No
Subject to Corrective Action Universe:		No
Non-TSDFs Where RCRA CA has Been Imposed Universe:		No
Corrective Action Priority Ranking:		No NCAPS ranking
Environmental Control Indicator:		No
Institutional Control Indicator:		No
Human Exposure Controls Indicator:		N/A
Groundwater Controls Indicator:		N/A
Significant Non-Complier Universe:		No
Unaddressed Significant Non-Complier Universe:		No
Addressed Significant Non-Complier Universe:		No
Significant Non-Complier With a Compliance Schedule Universe:		No
Financial Assurance Required:		Not reported
Handler Date of Last Change:		20150414
Recognized Trader-Importer:		No
Recognized Trader-Exporter:		No
Importer of Spent Lead Acid Batteries:		No
Exporter of Spent Lead Acid Batteries:		No
Recycler Activity Without Storage:		No
Manifest Broker:		No
Sub-Part P Indicator:		No

Hazardous Waste Summary:

Waste Code:	D000
Waste Description:	Not Defined

SYNERGY GROUP INC (Continued) **1000220095**

Waste Code: D001
Waste Description: Ignitable Waste

Handler - Owner Operator:
Owner/Operator Indicator: Owner
Owner/Operator Name: SUN GAS LIQUIDS INC
Legal Status: Private
Date Became Current: 19800818
Date Ended Current: Not reported
Owner/Operator Address: 160 E BOSWELL
Owner/Operator City,State,Zip: BATESVILLE, AR 72501
Owner/Operator Telephone: 000-000-0000
Owner/Operator Telephone Ext: Not reported
Owner/Operator Fax: Not reported
Owner/Operator Email: Not reported

Historic Generators:
Receive Date: 19800818
Handler Name: SYNERGY GROUP INC
Federal Waste Generator Description: Not a generator, verified
State District Owner: Ar
Large Quantity Handler of Universal Waste: No
Recognized Trader Importer: No
Recognized Trader Exporter: No
Spent Lead Acid Battery Importer: No
Spent Lead Acid Battery Exporter: No
Current Record: Yes
Non Storage Recycler Activity: Not reported
Electronic Manifest Broker: Not reported

List of NAICS Codes and Descriptions:
NAICS Codes: No NAICS Codes Found

Facility Has Received Notices of Violations:
Violations: No Violations Found

Evaluation Action Summary:
Evaluations: No Evaluations Found

FINDS:
Registry ID: 110003396156

Click Here for FRS Facility Detail Report:

Environmental Interest/Information System:
The Arkansas Permit Data System (PDS) is an integrated system maintaining data on air quality, mining, tires, solid waste, tank, water and hazardous waste, as well as inspections, invoicing and complaints.
The Resource Conservation and Recovery Act Information System (RCRAInfo) is EPA's comprehensive information system in support of the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. It tracks many types of information about generators, transporters, treaters,

SYNERGY GROUP INC (Continued) **1000220095**

storers, and disposers of hazardous waste.

Click this hyperlink while viewing on your computer to access additional FINDS: detail in the EDR Site Report.

ECHO:

Envid:	1000220095
Registry ID:	110003396156

DFR URL:

Name:	SYNERGY GROUP INC
Address:	160 E Boswell
City,State,Zip:	BATESVILLE, AR 72501

F27 **SYNERGY GROUP INC** **HW GEN** **S125897316**
SSW **160 E BOSWELL** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.244 mi.
1286 ft. **Site 2 of 2 in cluster F**

Relative:
Lower

Actual:
299 ft.

HW GEN:

Name:	SYNERGY GROUP INC
Address:	160 E BOSWELL
City,State,Zip:	BATESVILLE, AR 72501
EPAID:	ARD084941582
AFIN:	3200103
AFIN Dash:	32-00103
Owner Operator Name:	SUN GAS LIQUIDS INC
Owner Operator Address:	Not reported
Owner Operator City:	Not reported
Owner Operator State:	Not reported
Owner Operator Zip:	Not reported
Owner Operator Phone Number:	Not reported
Type Description:	Private
Federal Generator Status:	N
State Generator Status:	N
NAICS Code:	Not reported
NAICS Desc:	Not reported
CME:	Not reported
CA:	Not reported
Permit:	Not reported

EPAECHO Compliance Link:

Contact:

EPAID:	ARD084941582
Mailing Address:	175 PRICE PARKWAY
Mailing City:	FARMINGDALE
Mailing State:	NY
Mailing Zip:	11735
Contact Name:	TOM-N WATSON
Contact Telephone:	Not reported
Contact Address:	175 PRICE PARKWAY
Contact City:	FARMINGDALE
Contact State:	NY
Contact Zip:	11735

G28 **STREET AUTO & TRACTOR SALES** **UST** **U001220122**
SSW **COLLEGE & CENTRAL** **PERMITS** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.246 mi.
1301 ft. **Site 1 of 5 in cluster G**

Relative:
Lower

Actual:
290 ft.

UST:

Facility Id:	32000071
ADEQ Facility ID:	32-00376
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	Not reported
Lust Flag:	UST
Leak ID Number:	Not reported
Date Received:	05/09/1986
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	JAMES STREET
Contact Title:	DEALER
Contact Phone:	501-793-6823
Certified Name:	HAROLD McKINNEY
Certified Title:	VICE PRESIDENT,
Date Signed:	05/07/1986
Amended:	No
No Bill:	Not reported
Facility Entry Clerk:	GCRAGG
Facility Update Date:	Not reported
Facility Update Clerk:	Not reported
Latitude:	Not reported
Longitude:	Not reported

Owner:

Owner ID:	002853
Owner Name:	WHITE RIVER PETROLEUM CO INC
Owner Address:	PO BOX 2464
Owner City,St,Zip:	BATESVILLE, AR 72503
Owner County:	INDEPENDENCE
Owner Phone:	8706133219
Owner Type:	Private Industry

Tank Info:

Facility ID:	32000071
Record Created By:	Not reported
Record Created Date:	Not reported
Record Modified By:	Not reported
Record Modified Date:	Not reported
Site Assessment Date:	Not reported
Site Assessment Leak:	Not reported
Certificate of Compliance Final Test Date:	Not reported
Certificate of Compliance Test Company License:	Not reported
Certificate of Compliance Tester License:	Not reported
Certificate of Compliance Installation Date:	Not reported
Certificate of Compliance Install Company License:	Not reported
Certificate of Compliance Installer License:	Not reported

Tank ID: 1

STREET AUTO & TRACTOR SALES (Continued) **U001220122**

Tank Status:	**PO 01/01/1977**
Install Date:	01/01/1982
Tank Contents:	Empty, Gasoline,
Cerclis Name:	Not reported
Tank Material:	Steel,
GIS Location:	Not reported
Federal Flag:	Not reported
Hazardous:	Not reported
Capacity in Gallons:	550
Number of Compartments:	1
Decode for Tstatus:	Permanently Out of Use
Release Detection:	Unknown,
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Unknown
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Unknown,
Pipe Type:	Unknown,
Pipe Release Detection:	Unknown,
Pipe Corrosion Protection:	Unknown,
Tank Spill and Overfill Protection:	Unknown,
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Unknown,
Corrosion Protection:	Not reported
Spill and Overflow:	Not reported
Release Detection:	Not reported
Tank Comments:	Not reported

PERMITS:

Name:	STREET AUTO & TRACTOR SALES
Address:	COLLEGE & CENTRAL
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200376
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	WHITE RIVER PETROLEUM CO INC
Owner ID:	002853
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported

STREET AUTO & TRACTOR SALES (Continued) **U001220122**

Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Not reported
GIS Original Datum Code:	Not reported
GIS Current Datum Code:	Not reported
UTM Northing:	Not reported
UTM Easting:	Not reported
UTM Zone:	Not reported
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Not reported
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Not reported
GIS Huc:	Not reported
GIS Planning Segment:	Not reported
GIS Ark Sen Dist:	Not reported
GIS Ark Rep Dist:	Not reported
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	Not reported
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	Not reported
Latitude Minute:	Not reported
Latitude Second:	Not reported
Longitude Degree:	Not reported
Longitude Minute:	Not reported
Longitude Second:	Not reported
Latitude Decimal:	Not reported
Longitude Decimal:	Not reported
Comments:	Not reported
Permit Number:	32000071
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported

STREET AUTO & TRACTOR SALES (Continued) **U001220122**

Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	Not reported
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	JAMES STREET
Permit Contact Telephone:	5017936823
Permit Mail Address 1:	STREET AUTO & TRACTOR SALES
Permit Mail Address 2:	COLLEGE & CENTRAL
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Not reported
Permit GIS Original Datum Code:	Not reported
Permit GIS Current Datum Code:	Not reported
Permit UTM Northing:	Not reported
Permit UTM Easting:	Not reported
Permit UTM Zone:	Not reported
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Not reported
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	Not reported
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Not reported
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-02-04 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	Not reported
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	Not reported

G29
SSW
1/8-1/4
0.246 mi.
1301 ft.

STREET AUTO & TRACTOR SALES
COLLEGE & CENTRAL
BATESVILLE, AR 72501

Site 2 of 5 in cluster G

UST FINDER | **1028163661** | **N/A**

Relative:
Lower

Actual:
290 ft.

UST FINDER:

Object ID:	34945
Facility ID:	AR32000071
Name:	STREET AUTO & TRACTOR SALES
Address:	COLLEGE & CENTRAL
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	StreetInt
Open USTs:	0
Closed USTs:	1
TOS USTs:	0
Population 1500ft:	175
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.653552
Y Coord:	35.769168
Latitude:	35.769168
Longitude:	-91.653552

UST FINDER:

Object ID:	113751
Facility ID:	AR32000071
Tank ID:	AR32000071_1
Tank Status:	Closed
Installation Date:	Not reported
Removal Date:	Not reported
Tank Capacity:	550
Substances:	Empty Gasoline
Tank Wall Type:	Single

G30
SSW
1/8-1/4
0.246 mi.
1301 ft.

COCA COLA BOTTLING COMPANY
100 EAST COLLEGE STREET
BATESVILLE, AR 72501

Site 3 of 5 in cluster G

UST FINDER **1028163653**
UST FINDER RELEASE **N/A**

Relative:
Lower

Actual:
291 ft.

UST FINDER:

Object ID:	34953
Facility ID:	AR32000063
Name:	COCA COLA BOTTLING COMPANY
Address:	100 EAST COLLEGE STREET
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	StreetAddress
Open USTs:	0
Closed USTs:	1
TOS USTs:	0
Population 1500ft:	181
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.6534609999999
Y Coord:	35.7691520000001
Latitude:	35.769152
Longitude:	-91.653461

UST FINDER:

Object ID:	99886
Facility ID:	AR32000063
Tank ID:	AR32000063_1
Tank Status:	Closed
Installation Date:	1981/01/01 16:00:00+00
Removal Date:	1990/08/28 15:59:59+00
Tank Capacity:	1000
Substances:	Gasoline
Tank Wall Type:	Single

UST FINDER RELEASE:

Object ID:	9090
Facility ID:	AR32000063
Lust ID:	AR320001
Name:	COCA-COLA BOTTLING COMPANY
Address:	100 EAST COLLEGE STREET
City,State,Zip:	BATESVILLE, AR 72501

COCA COLA BOTTLING COMPANY (Continued) **1028163653**

Address Match Type:	StreetAddress
Reported Date:	1989/04/18 16:00:00+00
Status:	No Further Action
Substance:	Unknown
Population within 1500ft:	180
Domestic Wells within 1500ft:	0
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - SurRELEASEe Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Within 100yr Floodplain:	No
Tribe:	Not reported
EPA Region:	6
NFA Letter 1:	Not reported
NFA Letter 2:	Not reported
NFA Letter 3:	Not reported
NFA Letter 4:	Not reported
Closed With Residual Contaminate:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.653461299
Y Coord:	35.769151922
Latitude:	35.7691519224075
Longitude:	-91.653461298801

G31 **COCA COLA BOTTLING COMPANY** **UST** **U001220116**
SSW **100 EAST COLLEGE STREET** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.246 mi.
1301 ft. **Site 4 of 5 in cluster G**

Relative: **Lower**
Actual: **291 ft.**

UST:

Facility Id:	32000063
ADEQ Facility ID:	32-00001
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	Not reported
Lust Flag:	UST
Leak ID Number:	32-0001
Date Received:	01/17/1986
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	BUFORD MADDOX
Contact Title:	PLANT MANAGER
Contact Phone:	501-793-3320
Certified Name:	BUFORD MADDOX
Certified Title:	PLANT MANAGER
Date Signed:	12/27/1985
Amended:	No

COCA COLA BOTTLING COMPANY (Continued) **U001220116**

No Bill: Not reported
Facility Entry Clerk: Jane Marsh
Facility Update Date: 05/22/2003
Facility Update Clerk: LYNDA
Latitude: Not reported
Longitude: Not reported

Owner:
Owner ID: 002858
Owner Name: COCA COLA BOTTLING COMPANY OF AR
Owner Address: 100 EAST COLLEGE STREET
Owner City,St,Zip: BATESVILLE, AR 72501
Owner County: INDEPENDENCE
Owner Phone: 5017933320
Owner Type: Private Industry

Tank Info:
Facility ID: 32000063
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: Not reported
Record Modified Date: Not reported
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: Not reported
Certificate of Compliance Test Company License: Not reported
Certificate of Compliance Tester License: Not reported
Certificate of Compliance Installation Date: Not reported
Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 1
Tank Status: PO 08/28/1990
Install Date: 01/01/1981
Tank Contents: Gasoline,
Cerclis Name: Not reported
Tank Material: Steel,
GIS Location: Not reported
Federal Flag: Not reported
Hazardous: Not reported
Capacity in Gallons: 1000
Number of Compartments: 1
Decode for Tstatus: Permanently Out of Use
Release Detection: Unknown,
Release Detection Install Date: Not reported
Tank External Corrosion Protection: Asphalt
Tank Ext Corrosion Protection Install Date: Not reported
Pipe Material: Galvanized Steel,
Pipe Type: Unknown,
Pipe Release Detection: Unknown,
Pipe Corrosion Protection: Unknown,
Tank Spill and Overfill Protection: Unknown,
Pipe Repaired: Not reported
Pipe Corrosion Protection: Unknown,
Corrosion Protection: Not reported
Spill and Overflow: Not reported
Release Detection: Not reported

COCA COLA BOTTLING COMPANY (Continued) **U001220116**

Tank Comments: Not reported

G32 **COCA-COLA BOTTLING COMPANY** **LTANKS** **S101152396**
SSW **100 EAST COLLEGE STREET** **N/A**
1/8-1/4 **BATESVILLE, AR 72501**
0.246 mi.
1301 ft. **Site 5 of 5 in cluster G**

Relative: LTANKS:
Lower
Actual: Name: COCA-COLA BOTTLING COMPANY
291 ft. Address: 100 EAST COLLEGE STREET
Address 2: Not reported
City,State,Zip: BATESVILLE, AR 72501
RST Facility ID: 32000063
Facility Telephone: 5017933320

Owner: COCA-COLA BOTTLING COMPANY
Lust Owner: Not reported
Leak Date: 4/17/1989
Leak Volume: Not reported
Substance Stored: Unknown
Release Status: Confirmed
Release Confirmed: 6/5/1989
Damage Description: Sub Surface Soils/Groundwater
Lust Tank Type: Underground Tank
Lust Dicovery: PT Assessment
Notification Date: 4/18/1989 10:00:00 AM
Cleanup Initiated: 3/11/1993
Notification Name: MARY GREEN
Notification Address: COCA-COLA BOTTLING COMPANY
Notification Address2: 7000 I-30, P.O. BOX 3508
Notification City,St,Zip: LITTLE ROCK, AR 72209
Notification Telephone: 5015692700
Notice Number: 320001
Tech Branch: 3/11/1993
AFIN Number: 3200001
Emergency Response: Not reported
Emergency Response 2: Not reported
Hazard Abatement: Not reported
Remedial Action: Not reported
ISC Date: 3/11/1993
Priority Score: Not reported
SAR Date: Not reported
Cap Submit: Not reported
Public Notify: Not reported
Cap Approve: 3/11/1993
NFA Issued: 1999-02-19 00:00:00
Funding Source: Not reported
Cleanup Lead: Not reported
Gis Location: Not reported
Lust Tank Type 2: Underground Tank
RST Modified Date: Not reported
Leak Damage: UNKNOWN.
Memo: FUEL TANK ASSESSMENT WAS DONE BY GRUBBS, GARNER & HOSKYN ON JUNE 5, 1989. 9/13/91 J. ATCHLEY CAP APPROVED THIS DATE. 3-11-93 James Atchley Technical Branch case file opened this date. 2/19/99 (James Atchley) File closed by our No Further Action letter this date.

H33
West
1/4-1/2
0.349 mi.
1843 ft.

QUIK MART #5
587 CENTRAL AVE
BATESVILLE, AR 72501

Site 1 of 2 in cluster H

UST FINDER **1028163670**
UST FINDER RELEASE **N/A**

Relative:
Lower

Actual:
282 ft.

UST FINDER:

Object ID:	34936
Facility ID:	AR32000081
Name:	QUIK MART #5
Address:	587 CENTRAL AVE
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	Not reported
Open USTs:	0
Closed USTs:	2
TOS USTs:	0
Population 1500ft:	517
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	State
X Coord:	-91.6573769999999
Y Coord:	35.7734390000001
Latitude:	35.773439
Longitude:	-91.657377

UST FINDER:

Object ID:	85846
Facility ID:	AR32000081
Tank ID:	AR32000081_1
Tank Status:	Closed
Installation Date:	1973/06/01 16:00:00+00
Removal Date:	2007/08/15 15:59:59+00
Tank Capacity:	8000
Substances:	Empty Gasoline
Tank Wall Type:	Single

Object ID:	85847
Facility ID:	AR32000081
Tank ID:	AR32000081_2
Tank Status:	Closed
Installation Date:	1973/06/01 16:00:00+00
Removal Date:	2007/08/15 15:59:59+00
Tank Capacity:	6000
Substances:	Empty Gasoline
Tank Wall Type:	Single

QUIK MART #5 (Continued) **1028163670**

UST FINDER RELEASE:

Object ID:	9099
Facility ID:	AR32000081
Lust ID:	AR320017
Name:	QUIK MART #5
Address:	587 CENTRAL AVENUE
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Reported Date:	2005/08/01 15:59:59+00
Status:	No Further Action
Substance:	Gasoline
Population within 1500ft:	540
Domestic Wells within 1500ft:	0
Land Use:	Developed, Low Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - SurRELEASEe Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Within 100yr Floodplain:	No
Tribe:	Not reported
EPA Region:	6
NFA Letter 1:	Not reported
NFA Letter 2:	Not reported
NFA Letter 3:	Not reported
NFA Letter 4:	Not reported
Closed With Residual Contaminate:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.65753
Y Coord:	35.7735960000001
Latitude:	35.773596
Longitude:	-91.65753

H34 **QUIK MART #5** **LTANKS** **U003403985**
West **587 CENTRAL AVE** **UST** **N/A**
1/4-1/2 **BATESVILLE, AR 72501** **PERMITS**
0.349 mi.
1843 ft. **Site 2 of 2 in cluster H**

Relative:
Lower

Actual:
282 ft.

LTANKS:

Name:	QUIK MART #5
Address:	587 CENTRAL AVENUE
Address 2:	Not reported
City,State,Zip:	BATESVILLE, AR 72501
RST Facility ID:	32000081
Facility Telephone:	Not reported
Owner:	RSB PROPERTIES, LLC
Lust Owner:	010237
Leak Date:	Not reported
Leak Volume:	Not reported
Substance Stored:	Gasoline

QUIK MART #5 (Continued) **U003403985**

Release Status:	Confirmed
Release Confirmed:	9/16/2005
Damage Description:	Sub Surface Soils/Groundwater
Lust Tank Type:	Underground Tank
Lust Dicovery:	PT Assessment
Notification Date:	8/1/2005 10:00:00 PM
Cleanup Initiated:	8/15/2007
Notification Name:	Chuck Richesin
Notification Address:	3512 South Shackleford
Notification City,St,Zip:	Little Rock, AR 72205
Notification Telephone:	(501) 221-7122
Notice Number:	320017
Tech Branch:	1/26/2006
AFIN Number:	3200385
Emergency Response:	No
Emergency Response 2:	Not reported
Hazard Abatement:	Not reported
Remedial Action:	Excv Disp
ISC Date:	Not reported
Priority Score:	Not reported
SAR Date:	Not reported
Cap Submit:	Not reported
Public Notify:	Not reported
Cap Approve:	Not reported
NFA Issued:	2007-09-18 00:00:00
Funding Source:	Not reported
Cleanup Lead:	Not reported
Gis Location:	Not reported
Lust Tank Type 2:	Underground Tank
RST Modified Date:	Not reported
Leak Damage:	Unknown
Memo:	9/02/2005 Phase II assessment submitted. 9/04/2007 Voluntary closure report submitted, entire tank system removed. 9/18/2007 NFA issued, based on Streamlined preliminary assessment conducted 9/17/2007. [routh 9/18/2007 2:10:00 PM].

UST:

Facility Id:	32000081
ADEQ Facility ID:	32-00385
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	07/06/2007
Lust Flag:	UST
Leak ID Number:	32-0017
Date Received:	09/04/2007
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	CARLA STIGER
Contact Title:	MANAGER
Contact Phone:	501-523-3601
Certified Name:	CARLA STIGER BY B WINNINGHAM
Certified Title:	MGR / CONTRACTOR
Date Signed:	07/20/2005
Amended:	Yes

QUIK MART #5 (Continued) **U003403985**

No Bill: UST
Facility Entry Clerk: BRADFORD
Facility Update Date: 10/29/2007
Facility Update Clerk: schenk
Latitude: 35.806500
Longitude: -91.684300

Owner:
Owner ID: 010237
Owner Name: RSB PROPERTIES LLC
Owner Address: 120 HAZEL ST
Owner Address 2: PO BOX 650
Owner City,St,Zip: NEWPORT, AR 72112
Owner County: JACKSON
Owner Phone: 8705233601
Owner Type: Private Industry

AST/UST Eligible:
Facility Id: 32000081
Date Eligible: 11/21/1991
Transaction Code: CIOU
Entry Clerk: GCRAGG
Entry Date: 11/21/1991
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Facility Id: 32000081
Date Eligible: 4/22/2005
Transaction Code: CIOU
Entry Clerk: BATEMAN
Entry Date: 4/22/2005
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Facility Id: 32000081
Date Eligible: 8/26/2005
Transaction Code: CIOU
Entry Clerk: fields
Entry Date: 8/26/2005 9:29:54 AM
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Tank Info:
Facility ID: 32000081
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: schenk
Record Modified Date: 10/29/2007 4:02:30 PM
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: 08/19/1998
Certificate of Compliance Test Company License: 000059
Certificate of Compliance Tester License: 001048
Certificate of Compliance Installation Date: Not reported

QUIK MART #5 (Continued) **U003403985**

Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 1
Tank Status: PO 08/15/2007
Install Date: 06/01/1973
Tank Contents: Empty, Gasoline
Cerclis Name: Not reported
Tank Material: Steel, External Liner
GIS Location: Not reported
Federal Flag: Not reported
Hazardous: Not reported
Capacity in Gallons: 8000
Number of Compartments: 1
Decode for Tstatus: Permanently Out of Use
Release Detection: Tightness, IC Flag
Release Detection Install Date: Not reported
Tank External Corrosion Protection: Lined
Tank Ext Corrosion Protection Install Date: Not reported
Pipe Material: Fiberglass Reinforced Plastic
Pipe Type: Suction PVC
Pipe Release Detection: Unknown
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection: Basin, Auto Shutoff, Auto Flow
Pipe Repaired: Not reported
Pipe Corrosion Protection: Fiberglass Reinforced Plastic
Corrosion Protection: X
Spill and Overflow: X
Release Detection: Not reported
Tank Comments: Not reported

Facility ID: 32000081
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: schenk
Record Modified Date: 10/29/2007 4:02:48 PM
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: 08/19/1998
Certificate of Compliance Test Company License: 000059
Certificate of Compliance Tester License: 001048
Certificate of Compliance Installation Date: Not reported
Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 2
Tank Status: PO 08/15/2007
Install Date: 06/01/1973
Tank Contents: Empty, Gasoline
Cerclis Name: Not reported
Tank Material: Steel, External Liner
GIS Location: Not reported
Federal Flag: Not reported
Hazardous: Not reported
Capacity in Gallons: 6000
Number of Compartments: 1
Decode for Tstatus: Permanently Out of Use

QUIK MART #5 (Continued) **U003403985**

Release Detection:	Tightness, IC Flag
Release Detection Install Date:	Not reported
Tank External Corrosion Protection:	Lined
Tank Ext Corrosion Protection Install Date:	Not reported
Pipe Material:	Fiberglass Reinforced Plastic
Pipe Type:	Suction PVC
Pipe Release Detection:	Unknown
Pipe Corrosion Protection:	Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection:	Basin, Auto Shutoff, Auto Flow
Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Fiberglass Reinforced Plastic
Corrosion Protection:	X
Spill and Overflow:	X
Release Detection:	Not reported
Tank Comments:	Not reported

PERMITS:

Name:	QUIK MART #5
Address:	587 CENTRAL AVENUE
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200385
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	RSB PROPERTIES LLC
Owner ID:	010237
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Lat/Long
GIS Original Datum Code:	NAD83
GIS Current Datum Code:	NAD83
UTM Northing:	3963285.41
UTM Easting:	618873.24
UTM Zone:	15
Section/Township/Range:	Not reported
GIS Date Measured:	11/27/2018
GIS Source Name:	Geocoded

QUIK MART #5 (Continued) **U003403985**

GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported
GIS Horizontal Accuracy:	Not reported
GIS Comment:	Geocoded using updated information; Imported by jacksonw on 11/27/2018. Source datafile unknown.
GIS Huc:	11010004
GIS Planning Segment:	4F
GIS Ark Sen Dist:	12
GIS Ark Rep Dist:	072
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	2018-11-27 13:18:00
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	35
Latitude Minute:	48
Latitude Second:	23.40
Longitude Degree:	-91
Longitude Minute:	41
Longitude Second:	3.48
Latitude Decimal:	35.806500
Longitude Decimal:	-91.684300
Comments:	Not reported
Permit Number:	32000081
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	UST
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	CARLA STIGER

QUIK MART #5 (Continued) **U003403985**

Permit Contact Telephone:	5015233601
Permit Mail Address 1:	QUIK MART #5
Permit Mail Address 2:	587 CENTRAL AVE
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long
Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3963285.41
Permit UTM Easting:	618873.24
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	2018-11-27 00:00:00
Permit GIS Source Name:	Geocoded
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Geocoded using updated information; Imported by jacksonw on 11/27/2018. Source datafile unknown.
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1991-08-06 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	RST Underground Tank
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 48 23.40 / -91 41 3.48

I35
ESE
1/4-1/2
0.401 mi.
2115 ft.

QUIK MART #16
810 HARRISON ST
BATESVILLE, AR 72501

Site 1 of 2 in cluster I

UST FINDER **1028163669**
UST FINDER RELEASE **N/A**

Relative:
Lower

Actual:
305 ft.

UST FINDER:

Object ID:	34937
Facility ID:	AR32000080
Name:	QUIK MART #16
Address:	810 HARRISON ST
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	Not reported
Open USTs:	0
Closed USTs:	2
TOS USTs:	0
Population 1500ft:	537
Private Wells 1500ft:	0
Within 100yr Floodplain:	No
Land Use:	Developed, High Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - Surface Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Facility Status:	Closed UST(s)
Date of Last Inspection:	Not reported
EPA Region:	6
Tribe:	Not reported
Coordinate Source:	State
X Coord:	-91.643157
Y Coord:	35.7697370000001
Latitude:	35.769737
Longitude:	-91.643157

UST FINDER:

Object ID:	85853
Facility ID:	AR32000080
Tank ID:	AR32000080_2
Tank Status:	Closed
Installation Date:	1968/06/01 16:00:01+00
Removal Date:	2007/08/06 15:59:59+00
Tank Capacity:	6000
Substances:	Empty Gasoline
Tank Wall Type:	Single

Object ID:	85854
Facility ID:	AR32000080
Tank ID:	AR32000080_1
Tank Status:	Closed
Installation Date:	1968/01/01 16:00:01+00
Removal Date:	2007/08/06 15:59:59+00
Tank Capacity:	6000
Substances:	Empty Gasoline
Tank Wall Type:	Single

QUIK MART #16 (Continued) **1028163669**

UST FINDER RELEASE:

Object ID:	9098
Facility ID:	AR32000080
Lust ID:	AR320016
Name:	QUIK MART #16
Address:	810 HARRISON STREET
City,State,Zip:	BATESVILLE, AR 72501
Address Match Type:	PointAddress
Reported Date:	2005/08/01 15:59:59+00
Status:	No Further Action
Substance:	Gasoline
Population within 1500ft:	542
Domestic Wells within 1500ft:	0
Land Use:	Developed, Medium Intensity
Within SPA:	Yes
SPA PWS Facility ID:	AR0000250_2529
SPA Water Type:	SW - SurRELEASEe Water
SPA Facility Type:	IN - Intake
SPA HUC12:	110100040704
Within WHPA:	No
WHPA PWS Facility ID:	Not reported
WHPA Water Type:	Not reported
WHPA Facility Type:	Not reported
WHPA HUC12:	Not reported
Within 100yr Floodplain:	No
Tribe:	Not reported
EPA Region:	6
NFA Letter 1:	Not reported
NFA Letter 2:	Not reported
NFA Letter 3:	Not reported
NFA Letter 4:	Not reported
Closed With Residual Contaminate:	Not reported
Coordinate Source:	Geocode
X Coord:	-91.6441515
Y Coord:	35.769573
Latitude:	35.769573
Longitude:	-91.6441515

I36 **QUIK MART #16** **LTANKS** **U001220128**
ESE **810 HARRISON ST** **UST** **N/A**
1/4-1/2 **BATESVILLE, AR 72501** **PERMITS**
0.401 mi.
2115 ft. **Site 2 of 2 in cluster I**

Relative:
Lower

Actual:
305 ft.

LTANKS:

Name:	QUIK MART #16
Address:	810 HARRISON STREET
Address 2:	Not reported
City,State,Zip:	BATESVILLE, AR 72501
RST Facility ID:	32000080
Facility Telephone:	Not reported
Owner:	RSB PROPERTIES, LLC
Lust Owner:	010237
Leak Date:	Not reported
Leak Volume:	Not reported
Substance Stored:	Gasoline

QUIK MART #16 (Continued) **U001220128**

Release Status:	Confirmed
Release Confirmed:	9/16/2005
Damage Description:	Sub Surface Soils/Groundwater
Lust Tank Type:	Underground Tank
Lust Dicovery:	PT Assessment
Notification Date:	8/1/2005 10:00:00 PM
Cleanup Initiated:	8/6/2007
Notification Name:	Chuck Richesin
Notification Address:	3512 South Shackleford
Notification City,St,Zip:	Little Rock, AR 72205
Notification Telephone:	(501) 221-7122
Notice Number:	320016
Tech Branch:	1/26/2006
AFIN Number:	3200384
Emergency Response:	No
Emergency Response 2:	Not reported
Hazard Abatement:	Not reported
Remedial Action:	Excv Disp
ISC Date:	Not reported
Priority Score:	Not reported
SAR Date:	Not reported
Cap Submit:	Not reported
Public Notify:	Not reported
Cap Approve:	Not reported
NFA Issued:	2007-09-18 00:00:00
Funding Source:	Not reported
Cleanup Lead:	Not reported
Gis Location:	Not reported
Lust Tank Type 2:	Underground Tank
RST Modified Date:	Not reported
Leak Damage:	Unknown
Memo:	9/16/2005 Phase II assessment submitted. 9/04/2007 Voluntary closure report submitted, entire tank system removed 8/6/2007. 9/18/2007 NFA issued based on Streamlined Preliminary Assessment conducted 8/17/2007. [routh 9/18/2007 1:59:53 PM].

UST:

Facility Id:	32000080
ADEQ Facility ID:	32-00384
Active Site:	Not reported
Above Ground:	Not reported
Below Ground:	Yes
Aboveground in Use:	UST
Underground in Use:	UST
Date Reg Cert Issued:	08/14/2007
Lust Flag:	UST
Leak ID Number:	32-0016
Date Received:	09/04/2007
Location SIC:	Not reported
Federal Flag:	Yes
Contact Name:	CARLA STIGER
Contact Title:	MANAGER
Contact Phone:	870) 523-3601
Certified Name:	CARLA STIGER BY B WINNINGHAM
Certified Title:	SR VP / CONTRACTOR
Date Signed:	09/01/2007
Amended:	Yes

QUIK MART #16 (Continued) **U001220128**

No Bill: UST
Facility Entry Clerk: LST
Facility Update Date: 10/29/2007
Facility Update Clerk: schenk
Latitude: 35.769737
Longitude: -91.643157

Owner:
Owner ID: 010237
Owner Name: RSB PROPERTIES LLC
Owner Address: 120 HAZEL ST
Owner Address 2: PO BOX 650
Owner City,St,Zip: NEWPORT, AR 72112
Owner County: JACKSON
Owner Phone: 8705233601
Owner Type: Private Industry

AST/UST Eligible:
Facility Id: 32000080
Date Eligible: 4/22/2005
Transaction Code: CIOU
Entry Clerk: BATEMAN
Entry Date: 4/22/2005
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Facility Id: 32000080
Date Eligible: 8/26/2005
Transaction Code: CIOU
Entry Clerk: fields
Entry Date: 8/26/2005 9:29:18 AM
Update Clerk: Not reported
Update Date: Not reported
Eligibility Description: Certificate issued, original, UST

Tank Info:
Facility ID: 32000080
Record Created By: Not reported
Record Created Date: Not reported
Record Modified By: schenk
Record Modified Date: 10/29/2007 3:09:48 PM
Site Assessment Date: Not reported
Site Assessment Leak: Not reported
Certificate of Compliance Final Test Date: 08/20/1998
Certificate of Compliance Test Company License: 000059
Certificate of Compliance Tester License: 000939
Certificate of Compliance Installation Date: Not reported
Certificate of Compliance Install Company License: Not reported
Certificate of Compliance Installer License: Not reported

Tank ID: 1
Tank Status: PO 08/06/2007
Install Date: 01/01/1968
Tank Contents: Empty, Gasoline
Cerclis Name: Not reported
Tank Material: Steel, External Liner

QUIK MART #16 (Continued) **U001220128**

GIS Location:	Not reported	
Federal Flag:	Not reported	
Hazardous:	Not reported	
Capacity in Gallons:		6000
Number of Compartments:		1
Decode for Tstatus:		Permanently Out of Use
Release Detection:		IC Flag
Release Detection Install Date:		Not reported
Tank External Corrosion Protection:		Lined
Tank Ext Corrosion Protection Install Date:		Not reported
Pipe Material:		Fiberglass Reinforced Plastic
Pipe Type:		Pressure
Pipe Release Detection:		Tightness, Line Leak
Pipe Corrosion Protection:		Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection:		Basin, Auto Shutoff, Auto Flow
Pipe Repaired:		Not reported
Pipe Corrosion Protection:		Fiberglass Reinforced Plastic
Corrosion Protection:		X
Spill and Overflow:		X
Release Detection:		Yes
Tank Comments:	Not reported	

Facility ID:	32000080	
Record Created By:	Not reported	
Record Created Date:	Not reported	
Record Modified By:	schenk	
Record Modified Date:	10/29/2007 3:10:05 PM	
Site Assessment Date:		Not reported
Site Assessment Leak:		Not reported
Certificate of Compliance Final Test Date:		08/20/1998
Certificate of Compliance Test Company License:		000059
Certificate of Compliance Tester License:		000939
Certificate of Compliance Installation Date:		Not reported
Certificate of Compliance Install Company License:		Not reported
Certificate of Compliance Installer License:		Not reported

Tank ID:	2	
Tank Status:	**PO 08/06/2007**	
Install Date:	06/01/1968	
Tank Contents:	Empty, Gasoline	
Cerclis Name:	Not reported	
Tank Material:	Steel, External Liner	
GIS Location:	Not reported	
Federal Flag:	Not reported	
Hazardous:	Not reported	
Capacity in Gallons:		6000
Number of Compartments:		1
Decode for Tstatus:		Permanently Out of Use
Release Detection:		IC Flag
Release Detection Install Date:		Not reported
Tank External Corrosion Protection:		Lined
Tank Ext Corrosion Protection Install Date:		Not reported
Pipe Material:		Fiberglass Reinforced Plastic
Pipe Type:		Pressure
Pipe Release Detection:		Tightness, Line Leak
Pipe Corrosion Protection:		Fiberglass Reinforced Plastic
Tank Spill and Overfill Protection:		Basin, Auto Shutoff, Auto Flow

QUIK MART #16 (Continued) **U001220128**

Pipe Repaired:	Not reported
Pipe Corrosion Protection:	Fiberglass Reinforced Plastic
Corrosion Protection:	X
Spill and Overflow:	X
Release Detection:	Yes
Tank Comments:	Not reported

PERMITS:

Name:	QUIK MART #16
Address:	810 HARRISON STREET
City,State,Zip:	BATESVILLE, AR 72501
Facility Type Desc:	Standard
Alternate Facility Name:	Not reported
Facility Status:	Active
AFIN:	3200384
AFIN Status Date:	Not reported
AFIN Status Desc:	Active
Type Description:	STD
Owner Name:	RSB PROPERTIES LLC
Owner ID:	010237
Secondary Facility Address:	Not reported
Facility Invoice Billing Month:	Not reported
Facility Invoice Phone Number:	Not reported
Facility Invoice Comments:	Not reported
Facility Invoice Address:	Not reported
Facility Invoice City,St,Zip:	Not reported
Facility Invoice Country:	Not reported
Facility Telephone:	Not reported
Facility Fax:	Not reported
Facility Email:	Not reported
Mailing Address 1:	Not reported
Mailing Country:	Not reported
Other Identifier:	Not reported
Primary SIC Code:	Not reported
Secondary SIC Code:	Not reported
Tertiary SIC Code:	Not reported
Primary NAIC Code:	Not reported
Secondary NAIC Code:	Not reported
Tertiary NAICS Code:	Not reported
GIS Original Coordinate System:	Lat/Long
GIS Original Datum Code:	NAD83
GIS Current Datum Code:	NAD83
UTM Northing:	3959258.37
UTM Easting:	622647.20
UTM Zone:	15
Section/Township/Range:	Not reported
GIS Date Measured:	Not reported
GIS Source Name:	Geocoded
GIS Collector Staff Code:	Not reported
GIS Certifield Measurment:	No
GPS Receiver Type Name:	Not reported
GPS Receiver Cannels:	Not reported
GIS Base Station Name:	Not reported
GIS Base Station Distance:	Not reported
GIS Min Point Positions:	Not reported
GIS Pdop Mask:	Not reported
GIS Snr Mask:	Not reported

QUIK MART #16 (Continued) **U001220128**

GIS Horizontal Accuracy:	Not reported
GIS Comment:	Original data replaced by Geocoded values on 6/12/2006 12:26:41 PM by hamptons
GIS Huc:	11010004
GIS Planning Segment:	4F
GIS Ark Sen Dist:	12
GIS Ark Rep Dist:	072
Created By:	Not reported
Record Created:	2005-05-15 00:00:00
Modified By:	Not reported
Modified Date:	2005-08-02 13:29:00
Primary SIC Desc:	Not reported
Secondary SIC Desc:	Not reported
Tertiary SIC Desc:	Not reported
Primary NAICS Desc:	Not reported
Secondary NAICS Desc:	Not reported
Tertiary NIACS Desc:	Not reported
Latitude Degree:	35
Latitude Minute:	46
Latitude Second:	11.05
Longitude Degree:	-91
Longitude Minute:	38
Longitude Second:	35.37
Latitude Decimal:	35.769737
Longitude Decimal:	-91.643157
Comments:	Not reported
Permit Number:	32000080
Permit Issued Date:	Not reported
Permit Modified Date:	Not reported
Permit Expiration Date:	Not reported
Permit Void Date:	Not reported
Permit Notice of Intent Date:	Not reported
SW Div Fac Open Closed Code:	Not reported
SW Div Fac Open Closed Desc:	Not reported
Permit Post Closure Date:	Not reported
Permit Media:	R
Permit Type:	Not reported
Permit Staff:	Not reported
Permit Status:	Not reported
Permit Status Date:	Not reported
Initial Payment Fee Inventory Number:	Not reported
Permit Fee Code:	UST
Permit Fee Volume:	Not reported
Permit Inventory Comment:	Not reported
Permit Inv Comment Prt:	N
Permit Inv Single Prt:	N
Permit Inv Single Lbl:	N
Permit Contact Name:	CARLA STIGER
Permit Contact Telephone:	870) 523-3601
Permit Mail Address 1:	QUIK MART #16
Permit Mail Address 2:	810 HARRISON ST
Permit Mail County Code:	32
Permit Mail County Name:	Independence
Permit Mail City,St,Zip:	BATESVILLE, AR 72501
Permit Contact Fax Number:	Not reported
Permit Contact Email Address:	Not reported
Permit GIS Original Coordinate System:	Lat/Long

QUIK MART #16 (Continued) **U001220128**

Permit GIS Original Datum Code:	NAD83
Permit GIS Current Datum Code:	NAD83
Permit UTM Northing:	3959258.37
Permit UTM Easting:	622647.20
Permit UTM Zone:	15
Permit Section Township Range:	Not reported
Permit GIS Date Measured:	Not reported
Permit GIS Source Name:	Geocoded
Permit GIS Collector Staff Code:	Not reported
Permit GIS Certified Measurment:	No
Permit GPS Receiver Type Name:	Not reported
Permit GPS Receiver Cannels:	Not reported
Permit GIS Base Station Name:	Not reported
Permit GIS Base Station Distance:	Not reported
Permit GIS Min Point Positions:	Not reported
Permit GIS PDOP Mask:	Not reported
Permit GIS SNR Mask:	Not reported
Permit GIS Hoizontal Accuracy:	Not reported
Permit GIS Comment:	Original data replaced by Geocoded values on 6/12/2006 12:26:41 PM by hamptons
Permit GIS Huc:	Not reported
Permit GIS Planning Segment:	Not reported
Permit GIS Ark Sen Dist:	Not reported
Permit GIS Ark Rep Dist:	Not reported
Permit Prior Permit Number:	Not reported
Permit Other Identifier:	Not reported
Permit Primary SIC Code:	Not reported
Permit Secondary SIC Code:	Not reported
Permit Record Created:	1987-05-18 00:00:00
Permit Media Description:	RST
Permit Type:	Not reported
Permit Status Description:	Not reported
Permit Fee Description:	RST Underground Tank
Permit Staff Name:	Not reported
Permit History:	Not reported
Permit Comment:	Not reported
Lat/Long (dms):	35 46 11.05 / -91 38 35.37

Count: 0 records. ORPHAN SUMMARY

City	EDR ID	Site Name	Site Address	Zip	Database(s)
		NO SITES FOUND			

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

To maintain currency of the following federal and state databases, EDR contacts the appropriate governmental agency on a monthly or quarterly basis, as required.

Number of Days to Update: Provides confirmation that EDR is reporting records that have been updated within 90 days from the date the government agency made the information available to the public.

STANDARD ENVIRONMENTAL RECORDS

Lists of Federal NPL (Superfund) sites

NPL: National Priority List

National Priorities List (Superfund). The NPL is a subset of CERCLIS and identifies over 1,200 sites for priority cleanup under the Superfund Program. NPL sites may encompass relatively large areas. As such, EDR provides polygon coverage for over 1,000 NPL site boundaries produced by EPA's Environmental Photographic Interpretation Center (EPIC) and regional EPA offices.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: EPA
Telephone: N/A
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Quarterly

NPL Site Boundaries

Sources:

EPA's Environmental Photographic Interpretation Center (EPIC)
Telephone: 202-564-7333

EPA Region 1
Telephone 617-918-1143

EPA Region 6
Telephone: 214-655-6659

EPA Region 3
Telephone 215-814-5418

EPA Region 7
Telephone: 913-551-7247

EPA Region 4
Telephone 404-562-8033

EPA Region 8
Telephone: 303-312-6774

EPA Region 5
Telephone 312-886-6686

EPA Region 9
Telephone: 415-947-4246

EPA Region 10
Telephone 206-553-8665

Proposed NPL: Proposed National Priority List Sites

A site that has been proposed for listing on the National Priorities List through the issuance of a proposed rule in the Federal Register. EPA then accepts public comments on the site, responds to the comments, and places on the NPL those sites that continue to meet the requirements for listing.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: EPA
Telephone: N/A
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Quarterly

NPL LIENS: Federal Superfund Liens

Federal Superfund Liens. Under the authority granted the USEPA by CERCLA of 1980, the USEPA has the authority to file liens against real property in order to recover remedial action expenditures or when the property owner received notification of potential liability. USEPA compiles a listing of filed notices of Superfund Liens.

Date of Government Version: 10/15/1991
Date Data Arrived at EDR: 02/02/1994
Date Made Active in Reports: 03/30/1994
Number of Days to Update: 56

Source: EPA
Telephone: 202-564-4267
Last EDR Contact: 08/15/2011
Next Scheduled EDR Contact: 11/28/2011
Data Release Frequency: No Update Planned

Lists of Federal Delisted NPL sites

Delisted NPL: National Priority List Deletions

The National Oil and Hazardous Substances Pollution Contingency Plan (NCP) establishes the criteria that the EPA uses to delete sites from the NPL. In accordance with 40 CFR 300.425.(e), sites may be deleted from the NPL where no further response is appropriate.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: EPA
Telephone: N/A
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Quarterly

Lists of Federal sites subject to CERCLA removals and CERCLA orders

FEDERAL FACILITY: Federal Facility Site Information listing

A listing of National Priority List (NPL) and Base Realignment and Closure (BRAC) sites found in the Comprehensive Environmental Response, Compensation and Liability Information System (CERCLIS) Database where EPA Federal Facilities Restoration and Reuse Office is involved in cleanup activities.

Date of Government Version: 05/05/2025
Date Data Arrived at EDR: 06/20/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 68

Source: Environmental Protection Agency
Telephone: 703-603-8704
Last EDR Contact: 06/20/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Varies

SEMS: Superfund Enterprise Management System

SEMS (Superfund Enterprise Management System) tracks hazardous waste sites, potentially hazardous waste sites, and remedial activities performed in support of EPA's Superfund Program across the United States. The list was formerly know as CERCLIS, renamed to SEMS by the EPA in 2015. The list contains data on potentially hazardous waste sites that have been reported to the USEPA by states, municipalities, private companies and private persons, pursuant to Section 103 of the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA). This dataset also contains sites which are either proposed to or on the National Priorities List (NPL) and the sites which are in the screening and assessment phase for possible inclusion on the NPL.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: EPA
Telephone: 800-424-9346
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Quarterly

Lists of Federal CERCLA sites with NFRAP

SEMS-ARCHIVE: Superfund Enterprise Management System Archive

SEMS-ARCHIVE (Superfund Enterprise Management System Archive) tracks sites that have no further interest under the Federal Superfund Program based on available information. The list was formerly known as the CERCLIS-NFRAP, renamed to SEMS ARCHIVE by the EPA in 2015. EPA may perform a minimal level of assessment work at a site while it is archived if site conditions change and/or new information becomes available. Archived sites have been removed and archived from the inventory of SEMS sites. Archived status indicates that, to the best of EPA's knowledge, assessment at a site has been completed and that EPA has determined no further steps will be taken to list the site on the National Priorities List (NPL), unless information indicates this decision was not appropriate or other considerations require a recommendation for listing at a later time. The decision does not necessarily mean that there is no hazard associated with a given site; it only means that. based upon available information, the location is not judged to be potential NPL site.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: EPA
Telephone: 800-424-9346
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Quarterly

Lists of Federal RCRA facilities undergoing Corrective Action

CORRACTS: Corrective Action Report

CORRACTS identifies hazardous waste handlers with RCRA corrective action activity.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/03/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 13

Source: EPA
Telephone: 800-424-9346
Last EDR Contact: 06/03/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

Lists of Federal RCRA TSD facilities

RCRA-TSDF: RCRA - Treatment, Storage and Disposal

RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Transporters are individuals or entities that move hazardous waste from the generator offsite to a facility that can recycle, treat, store, or dispose of the waste. TSDFs treat, store, or dispose of the waste.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 12

Source: Environmental Protection Agency
Telephone: 214-665-6444
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

Lists of Federal RCRA generators

RCRA-LQG: RCRA - Large Quantity Generators

RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Large quantity generators (LQGs) generate over 1,000 kilograms (kg) of hazardous waste, or over 1 kg of acutely hazardous waste per month.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 12

Source: Environmental Protection Agency
Telephone: 214-665-6444
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

RCRA-SQG: RCRA - Small Quantity Generators

RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Small quantity generators (SQGs) generate between 100 kg and 1,000 kg of hazardous waste per month.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 12

Source: Environmental Protection Agency
Telephone: 214-665-6444
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

RCRA-VSQG: RCRA - Very Small Quantity Generators (Formerly Conditionally Exempt Small Quantity Generators)

RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Very small quantity generators (VSQGs) generate less than 100 kg of hazardous waste, or less than 1 kg of acutely hazardous waste per month.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 12

Source: Environmental Protection Agency
Telephone: 214-665-6444
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

Federal institutional controls / engineering controls registries

LUCIS: Land Use Control Information System

LUCIS contains records of land use control information pertaining to the former Navy Base Realignment and Closure properties.

Date of Government Version: 03/11/2025
Date Data Arrived at EDR: 04/02/2025
Date Made Active in Reports: 06/24/2025
Number of Days to Update: 83

Source: Department of the Navy
Telephone: 843-820-7326
Last EDR Contact: 07/29/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

US ENG CONTROLS: Engineering Controls Sites List

A listing of sites with engineering controls in place. Engineering controls include various forms of caps, building foundations, liners, and treatment methods to create pathway elimination for regulated substances to enter environmental media or effect human health.

Date of Government Version: 05/19/2025
Date Data Arrived at EDR: 05/20/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 70

Source: Environmental Protection Agency
Telephone: 703-603-0695
Last EDR Contact: 08/15/2025
Next Scheduled EDR Contact: 12/02/2024
Data Release Frequency: Varies

US INST CONTROLS: Institutional Controls Sites List

A listing of sites with institutional controls in place. Institutional controls include administrative measures, such as groundwater use restrictions, construction restrictions, property use restrictions, and post remediation care requirements intended to prevent exposure to contaminants remaining on site. Deed restrictions are generally required as part of the institutional controls.

Date of Government Version: 05/19/2025
Date Data Arrived at EDR: 05/20/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 70

Source: Environmental Protection Agency
Telephone: 703-603-0695
Last EDR Contact: 08/15/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Varies

Federal ERNS list

ERNS: Emergency Response Notification System

Emergency Response Notification System. ERNS records and stores information on reported releases of oil and hazardous substances.

Date of Government Version: 06/10/2025
Date Data Arrived at EDR: 06/12/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 4

Source: National Response Center, United States Coast Guard
Telephone: 202-267-2180
Last EDR Contact: 06/12/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

Lists of state- and tribal (Superfund) equivalent sites

SHWS: Hazardous Substance Remedial Action Trust Fund Priority List

A partial prioritized listing of sites at which remedial actions and/or investigations shall be provided by the Hazardous Substance Remedial Action Trust Fund.

Date of Government Version: 05/30/2025
Date Data Arrived at EDR: 05/30/2025
Date Made Active in Reports: 08/25/2025
Number of Days to Update: 87

Source: Department of Environmental Quality
Telephone: 501-682-0850
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Annually

Lists of state and tribal landfills and solid waste disposal facilities

SWF/LF: Solid Waste Facility Permit Database

Solid Waste Facilities/Landfill Sites. SWF/LF type records typically contain an inventory of solid waste disposal facilities or landfills in a particular state. Depending on the state, these may be active or inactive facilities or open dumps that failed to meet RCRA Subtitle D Section 4004 criteria for solid waste landfills or disposal sites.

Date of Government Version: 04/28/2025
Date Data Arrived at EDR: 04/29/2025
Date Made Active in Reports: 07/18/2025
Number of Days to Update: 80

Source: Department of Environmental Quality
Telephone: 501-682-0597
Last EDR Contact: 07/24/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Quarterly

SWID: Solid Waste Illegal Dumps Database

A listing of illegal solid waste dumps.

Date of Government Version: 04/27/2025
Date Data Arrived at EDR: 04/29/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 79

Source: Department of Environmental Quality
Telephone: 501-682-0600
Last EDR Contact: 07/24/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Quarterly

Lists of state and tribal leaking storage tanks

LTANKS: Leaking Underground Storage Tank Data

A listing of leaking underground and aboveground storage tank locations.

Date of Government Version: 06/05/2025
Date Data Arrived at EDR: 06/05/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 82

Source: Department of Environmental Quality
Telephone: 501-682-0984
Last EDR Contact: 09/05/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Quarterly

INDIAN LUST R6: Leaking Underground Storage Tanks on Indian Land

LUSTs on Indian land in New Mexico and Oklahoma.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 6
Telephone: 214-665-6597
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R5: Leaking Underground Storage Tanks on Indian Land
Leaking underground storage tanks located on Indian Land in Michigan, Minnesota and Wisconsin.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA, Region 5
Telephone: 312-886-7439
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R9: Leaking Underground Storage Tanks on Indian Land
LUSTs on Indian land in Arizona, California, New Mexico and Nevada

Date of Government Version: 01/07/2025
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: Environmental Protection Agency
Telephone: 415-972-3372
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R7: Leaking Underground Storage Tanks on Indian Land
LUSTs on Indian land in Iowa, Kansas, and Nebraska

Date of Government Version: 01/07/2025
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 7
Telephone: 913-551-7003
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R10: Leaking Underground Storage Tanks on Indian Land
LUSTs on Indian land in Alaska, Idaho, Oregon and Washington.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 10
Telephone: 206-553-2857
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R1: Leaking Underground Storage Tanks on Indian Land
A listing of leaking underground storage tank locations on Indian Land.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 1
Telephone: 617-918-1313
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R4: Leaking Underground Storage Tanks on Indian Land
LUSTs on Indian land in Florida, Mississippi and North Carolina.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 4
Telephone: 404-562-8677
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN LUST R8: Leaking Underground Storage Tanks on Indian Land
LUSTs on Indian land in Colorado, Montana, North Dakota, South Dakota, Utah and Wyoming.

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81
Source: EPA Region 8
Telephone: 303-312-6271
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

Lists of state and tribal registered storage tanks

FEMA UST: Underground Storage Tank Listing
A listing of all FEMA owned underground storage tanks.

Date of Government Version: 04/08/2025
Date Data Arrived at EDR: 04/23/2025
Date Made Active in Reports: 04/24/2025
Number of Days to Update: 1
Source: FEMA
Telephone: 202-646-5797
Last EDR Contact: 06/24/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

UST: Underground Storage Tank Data
Registered Underground Storage Tanks. UST's are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA) and must be registered with the state department responsible for administering the UST program. Available information varies by state program.

Date of Government Version: 06/05/2025
Date Data Arrived at EDR: 06/05/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 82
Source: Department of Environmental Quality
Telephone: 501-682-0984
Last EDR Contact: 09/05/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Quarterly

AST: Aboveground Tank Database
Aboveground storage tank locations.

Date of Government Version: 06/05/2025
Date Data Arrived at EDR: 06/05/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 82
Source: Department of Environmental Quality
Telephone: 501-682-0984
Last EDR Contact: 09/05/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Quarterly

INDIAN UST R1: Underground Storage Tanks on Indian Land
The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 1 (Connecticut, Maine, Massachusetts, New Hampshire, Rhode Island, Vermont and ten Tribal Nations).

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81
Source: EPA, Region 1
Telephone: 617-918-1313
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R5: Underground Storage Tanks on Indian Land
The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 5 (Michigan, Minnesota and Wisconsin and Tribal Nations).

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81
Source: EPA Region 5
Telephone: 312-886-6136
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R10: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 10 (Alaska, Idaho, Oregon, Washington, and Tribal Nations).

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 10
Telephone: 206-553-2857
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R4: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 4 (Alabama, Florida, Georgia, Kentucky, Mississippi, North Carolina, South Carolina, Tennessee and Tribal Nations)

Date of Government Version: 11/08/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 4
Telephone: 404-562-9424
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R9: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 9 (Arizona, California, Hawaii, Nevada, the Pacific Islands, and Tribal Nations).

Date of Government Version: 10/15/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 9
Telephone: 415-972-3368
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R8: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 8 (Colorado, Montana, North Dakota, South Dakota, Utah, Wyoming and 27 Tribal Nations).

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 8
Telephone: 303-312-6137
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R7: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 7 (Iowa, Kansas, Missouri, Nebraska, and 9 Tribal Nations).

Date of Government Version: 01/07/2025
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 7
Telephone: 913-551-7003
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

INDIAN UST R6: Underground Storage Tanks on Indian Land

The Indian Underground Storage Tank (UST) database provides information about underground storage tanks on Indian land in EPA Region 6 (Louisiana, Arkansas, Oklahoma, New Mexico, Texas and 65 Tribes).

Date of Government Version: 11/18/2024
Date Data Arrived at EDR: 01/16/2025
Date Made Active in Reports: 04/07/2025
Number of Days to Update: 81

Source: EPA Region 6
Telephone: 214-665-7591
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

State and tribal institutional control / engineering control registries

ENG CONTROLS: Engineering Controls Sites Listing
A listing of sites with engineering controls in place.

Date of Government Version: 05/04/2025
Date Data Arrived at EDR: 05/06/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 72

Source: Department of Environmental Quality
Telephone: 501-682-0867
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

INST CONTROL: Institutional Control/Land Use Restriction Sites
Sites that have institutional controls and/or land use restrictions in place.

Date of Government Version: 05/04/2025
Date Data Arrived at EDR: 05/06/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 72

Source: Department of Environmental Quality
Telephone: 501-682-0867
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

Lists of state and tribal voluntary cleanup sites

INDIAN VCP R1: Voluntary Cleanup Priority Listing
A listing of voluntary cleanup priority sites located on Indian Land located in Region 1.

Date of Government Version: 07/27/2015
Date Data Arrived at EDR: 09/29/2015
Date Made Active in Reports: 02/18/2016
Number of Days to Update: 142

Source: EPA, Region 1
Telephone: 617-918-1102
Last EDR Contact: 06/10/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Varies

INDIAN VCP R7: Voluntary Cleanup Priority Lisitng
A listing of voluntary cleanup priority sites located on Indian Land located in Region 7.

Date of Government Version: 03/20/2008
Date Data Arrived at EDR: 04/22/2008
Date Made Active in Reports: 05/19/2008
Number of Days to Update: 27

Source: EPA, Region 7
Telephone: 913-551-7365
Last EDR Contact: 07/08/2021
Next Scheduled EDR Contact: 07/20/2009
Data Release Frequency: Varies

VCP: Voluntary Cleanup Program Sites
A listing of Voluntary Cleanup Program projects.

Date of Government Version: 04/30/2025
Date Data Arrived at EDR: 05/07/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 71

Source: Department of Environmental Quality
Telephone: 501-682-0867
Last EDR Contact: 08/04/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

Lists of state and tribal brownfield sites

BROWNFIELDS: Brownfields Projects
Projects that the Department of Environmental Quality has received Brownfields applications for.

Date of Government Version: 05/04/2025
Date Data Arrived at EDR: 05/06/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 72

Source: Department of Environmental Quality
Telephone: 501-682-0867
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

ADDITIONAL ENVIRONMENTAL RECORDS

Local Brownfield lists

US BROWNFIELDS: A Listing of Brownfields Sites

Brownfields are real property, the expansion, redevelopment, or reuse of which may be complicated by the presence or potential presence of a hazardous substance, pollutant, or contaminant. Cleaning up and reinvesting in these properties takes development pressures off of undeveloped, open land, and both improves and protects the environment. Assessment, Cleanup and Redevelopment Exchange System (ACRES) stores information reported by EPA Brownfields grant recipients on brownfields properties assessed or cleaned up with grant funding as well as information on Targeted Brownfields Assessments performed by EPA Regions. A listing of ACRES Brownfield sites is obtained from Cleanups in My Community. Cleanups in My Community provides information on Brownfields properties for which information is reported back to EPA, as well as areas served by Brownfields grant programs.

Date of Government Version: 09/09/2024
Date Data Arrived at EDR: 09/11/2024
Date Made Active in Reports: 12/06/2024
Number of Days to Update: 86

Source: Environmental Protection Agency
Telephone: 202-566-2777
Last EDR Contact: 09/04/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Semi-Annually

Local Lists of Landfill / Solid Waste Disposal Sites

SWRCY: Recycling Directory

A listing of recycling facilities.

Date of Government Version: 07/24/2025
Date Data Arrived at EDR: 07/24/2025
Date Made Active in Reports: 08/15/2025
Number of Days to Update: 22

Source: Department of Environmental Quality
Telephone: 501-682-0865
Last EDR Contact: 07/24/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Semi-Annually

INDIAN ODI: Report on the Status of Open Dumps on Indian Lands

Location of open dumps on Indian land.

Date of Government Version: 12/31/1998
Date Data Arrived at EDR: 12/03/2007
Date Made Active in Reports: 01/24/2008
Number of Days to Update: 52

Source: Environmental Protection Agency
Telephone: 703-308-8245
Last EDR Contact: 07/15/2025
Next Scheduled EDR Contact: 11/03/2025
Data Release Frequency: Varies

ODI: Open Dump Inventory

An open dump is defined as a disposal facility that does not comply with one or more of the Part 257 or Part 258 Subtitle D Criteria.

Date of Government Version: 06/30/1985
Date Data Arrived at EDR: 08/09/2004
Date Made Active in Reports: 09/17/2004
Number of Days to Update: 39

Source: Environmental Protection Agency
Telephone: 800-424-9346
Last EDR Contact: 06/09/2004
Next Scheduled EDR Contact: N/A
Data Release Frequency: No Update Planned

DEBRIS REGION 9: Torres Martinez Reservation Illegal Dump Site Locations

A listing of illegal dump sites location on the Torres Martinez Indian Reservation located in eastern Riverside County and northern Imperial County, California.

Date of Government Version: 01/12/2009
Date Data Arrived at EDR: 05/07/2009
Date Made Active in Reports: 09/21/2009
Number of Days to Update: 137

Source: EPA, Region 9
Telephone: 415-947-4219
Last EDR Contact: 07/08/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: No Update Planned

IHS OPEN DUMPS: Open Dumps on Indian Land

A listing of all open dumps located on Indian Land in the United States.

Date of Government Version: 02/07/2024
Date Data Arrived at EDR: 11/13/2024
Date Made Active in Reports: 11/19/2024
Number of Days to Update: 6

Source: Department of Health & Human Serivces, Indian Health Service
Telephone: 301-443-1452
Last EDR Contact: 07/17/2025
Next Scheduled EDR Contact: 11/03/2025
Data Release Frequency: Varies

Local Lists of Hazardous waste / Contaminated Sites

US HIST CDL: National Clandestine Laboratory Register

A listing of clandestine drug lab locations that have been removed from the DEAs National Clandestine Laboratory Register.

Date of Government Version: 04/04/2025
Date Data Arrived at EDR: 06/02/2025
Date Made Active in Reports: 08/12/2025
Number of Days to Update: 71

Source: Drug Enforcement Administration
Telephone: 202-307-1000
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: No Update Planned

CDL: Methamphetamine Contaminated Properties Listing

A listing of properties believed to be contaminated by the illegal manufacture of drugs.

Date of Government Version: 04/14/2025
Date Data Arrived at EDR: 04/15/2025
Date Made Active in Reports: 07/02/2025
Number of Days to Update: 78

Source: Department of Environmental Quality
Telephone: 501-683-1552
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

US CDL: Clandestine Drug Labs

A listing of clandestine drug lab locations. The U.S. Department of Justice ("the Department") provides this web site as a public service. It contains addresses of some locations where law enforcement agencies reported they found chemicals or other items that indicated the presence of either clandestine drug laboratories or dumpsites. In most cases, the source of the entries is not the Department, and the Department has not verified the entry and does not guarantee its accuracy. Members of the public must verify the accuracy of all entries by, for example, contacting local law enforcement and local health departments.

Date of Government Version: 04/04/2025
Date Data Arrived at EDR: 06/02/2025
Date Made Active in Reports: 08/12/2025
Number of Days to Update: 71

Source: Drug Enforcement Administration
Telephone: 202-307-1000
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Quarterly

Local Land Records

LIENS 2: CERCLA Lien Information

A Federal CERCLA ('Superfund') lien can exist by operation of law at any site or property at which EPA has spent Superfund monies. These monies are spent to investigate and address releases and threatened releases of contamination. CERCLIS provides information as to the identity of these sites and properties.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: Environmental Protection Agency
Telephone: 202-564-6023
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Semi-Annually

Records of Emergency Release Reports

HMIRS: Hazardous Materials Information Reporting System
Hazardous Materials Incident Report System. HMIRS contains hazardous material spill incidents reported to DOT.

Date of Government Version: 06/11/2025
Date Data Arrived at EDR: 06/12/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 4
Source: U.S. Department of Transportation
Telephone: 202-366-4555
Last EDR Contact: 06/12/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

SPILLS: Emergency Response Incidents
Spills and releases notified to the Department of Environmental Quality

Date of Government Version: 03/30/2025
Date Data Arrived at EDR: 04/01/2025
Date Made Active in Reports: 06/18/2025
Number of Days to Update: 78
Source: Department of Environmental Quality
Telephone: 501-682-0716
Last EDR Contact: 06/25/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Quarterly

SPILLS 90: SPILLS90 data from FirstSearch
Spills 90 includes those spill and release records available exclusively from FirstSearch databases. Typically, they may include chemical, oil and/or hazardous substance spills recorded after 1990. Duplicate records that are already included in EDR incident and release records are not included in Spills 90.

Date of Government Version: 05/08/2011
Date Data Arrived at EDR: 01/03/2013
Date Made Active in Reports: 03/06/2013
Number of Days to Update: 62
Source: FirstSearch
Telephone: N/A
Last EDR Contact: 01/03/2013
Next Scheduled EDR Contact: N/A
Data Release Frequency: No Update Planned

SPILLS 80: SPILLS80 data from FirstSearch
Spills 80 includes those spill and release records available from FirstSearch databases prior to 1990. Typically, they may include chemical, oil and/or hazardous substance spills recorded before 1990. Duplicate records that are already included in EDR incident and release records are not included in Spills 80.

Date of Government Version: 03/30/2009
Date Data Arrived at EDR: 01/03/2013
Date Made Active in Reports: 03/06/2013
Number of Days to Update: 62
Source: FirstSearch
Telephone: N/A
Last EDR Contact: 01/03/2013
Next Scheduled EDR Contact: N/A
Data Release Frequency: No Update Planned

Other Ascertainable Records

RCRA NonGen / NLR: RCRA - Non Generators / No Longer Regulated
RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Non-Generators do not presently generate hazardous waste.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 12
Source: Environmental Protection Agency
Telephone: 214-665-6444
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

FUDS: Formerly Used Defense Sites
The listing includes locations of Formerly Used Defense Sites properties where the US Army Corps of Engineers is actively working or will take necessary cleanup actions.

Date of Government Version: 07/23/2025
Date Data Arrived at EDR: 07/23/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 6

Source: U.S. Army Corps of Engineers
Telephone: 202-528-4285
Last EDR Contact: 07/23/2025
Next Scheduled EDR Contact: 11/24/2025
Data Release Frequency: Varies

DOD: Department of Defense Sites

This data set consists of federally owned or administered lands, administered by the Department of Defense, that have any area equal to or greater than 640 acres of the United States, Puerto Rico, and the U.S. Virgin Islands.

Date of Government Version: 06/07/2021
Date Data Arrived at EDR: 07/13/2021
Date Made Active in Reports: 03/09/2022
Number of Days to Update: 239

Source: USGS
Telephone: 888-275-8747
Last EDR Contact: 07/07/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Varies

FEDLAND: Federal and Indian Lands

Federally and Indian administrated lands of the United States. Lands included are administrated by: Army Corps of Engineers, Bureau of Reclamation, National Wild and Scenic River, National Wildlife Refuge, Public Domain Land, Wilderness, Wilderness Study Area, Wildlife Management Area, Bureau of Indian Affairs, Bureau of Land Management, Department of Justice, Forest Service, Fish and Wildlife Service, National Park Service.

Date of Government Version: 04/02/2018
Date Data Arrived at EDR: 04/11/2018
Date Made Active in Reports: 11/06/2019
Number of Days to Update: 574

Source: U.S. Geological Survey
Telephone: 888-275-8747
Last EDR Contact: 06/25/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: N/A

SCRD DRYCLEANERS: State Coalition for Remediation of Drycleaners Listing

The State Coalition for Remediation of Drycleaners was established in 1998, with support from the U.S. EPA Office of Superfund Remediation and Technology Innovation. It is comprised of representatives of states with established drycleaner remediation programs. Currently the member states are Alabama, Connecticut, Florida, Illinois, Kansas, Minnesota, Missouri, North Carolina, Oregon, South Carolina, Tennessee, Texas, and Wisconsin.

Date of Government Version: 07/30/2021
Date Data Arrived at EDR: 02/03/2023
Date Made Active in Reports: 02/10/2023
Number of Days to Update: 7

Source: Environmental Protection Agency
Telephone: 615-532-8599
Last EDR Contact: 08/07/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

US FIN ASSUR: Financial Assurance Information

All owners and operators of facilities that treat, store, or dispose of hazardous waste are required to provide proof that they will have sufficient funds to pay for the clean up, closure, and post-closure care of their facilities.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/03/2025
Date Made Active in Reports: 06/16/2025
Number of Days to Update: 13

Source: Environmental Protection Agency
Telephone: 202-566-1917
Last EDR Contact: 06/03/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

EPA WATCH LIST: EPA Watch List

EPA maintains a "Watch List" to facilitate dialogue between EPA, state and local environmental agencies on enforcement matters relating to facilities with alleged violations identified as either significant or high priority. Being on the Watch List does not mean that the facility has actually violated the law only that an investigation by EPA or a state or local environmental agency has led those organizations to allege that an unproven violation has in fact occurred. Being on the Watch List does not represent a higher level of concern regarding the alleged violations that were detected, but instead indicates cases requiring additional dialogue between EPA, state and local agencies - primarily because of the length of time the alleged violation has gone unaddressed or unresolved.

Date of Government Version: 08/30/2013
Date Data Arrived at EDR: 03/21/2014
Date Made Active in Reports: 06/17/2014
Number of Days to Update: 88

Source: Environmental Protection Agency
Telephone: 617-520-3000
Last EDR Contact: 07/24/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: No Update Planned

2020 COR ACTION: 2020 Corrective Action Program List

The EPA has set ambitious goals for the RCRA Corrective Action program by creating the 2020 Corrective Action Universe. This RCRA cleanup baseline includes facilities expected to need corrective action. The 2020 universe contains a wide variety of sites. Some properties are heavily contaminated while others were contaminated but have since been cleaned up. Still others have not been fully investigated yet, and may require little or no remediation. Inclusion in the 2020 Universe does not necessarily imply failure on the part of a facility to meet its RCRA obligations.

Date of Government Version: 09/30/2017
Date Data Arrived at EDR: 05/08/2018
Date Made Active in Reports: 07/20/2018
Number of Days to Update: 73

Source: Environmental Protection Agency
Telephone: 703-308-4044
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Varies

TSCA: Toxic Substances Control Act

Toxic Substances Control Act. TSCA identifies manufacturers and importers of chemical substances included on the TSCA Chemical Substance Inventory list. It includes data on the production volume of these substances by plant site.

Date of Government Version: 12/31/2020
Date Data Arrived at EDR: 06/14/2022
Date Made Active in Reports: 03/24/2023
Number of Days to Update: 283

Source: EPA
Telephone: 202-260-5521
Last EDR Contact: 06/12/2025
Next Scheduled EDR Contact: 09/22/2025
Data Release Frequency: Every 4 Years

TRIS: Toxic Chemical Release Inventory System

Toxic Release Inventory System. TRIS identifies facilities which release toxic chemicals to the air, water and land in reportable quantities under SARA Title III Section 313.

Date of Government Version: 12/31/2023
Date Data Arrived at EDR: 02/11/2025
Date Made Active in Reports: 02/18/2025
Number of Days to Update: 7

Source: EPA
Telephone: 202-566-0250
Last EDR Contact: 08/11/2025
Next Scheduled EDR Contact: 11/24/2025
Data Release Frequency: Annually

SSTS: Section 7 Tracking Systems

Section 7 of the Federal Insecticide, Fungicide and Rodenticide Act, as amended (92 Stat. 829) requires all registered pesticide-producing establishments to submit a report to the Environmental Protection Agency by March 1st each year. Each establishment must report the types and amounts of pesticides, active ingredients and devices being produced, and those having been produced and sold or distributed in the past year.

Date of Government Version: 04/14/2025
Date Data Arrived at EDR: 04/15/2025
Date Made Active in Reports: 07/08/2025
Number of Days to Update: 84

Source: EPA
Telephone: 202-564-4203
Last EDR Contact: 07/14/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Annually

ROD: Records Of Decision

Record of Decision. ROD documents mandate a permanent remedy at an NPL (Superfund) site containing technical and health information to aid in the cleanup.

Date of Government Version: 07/29/2025
Date Data Arrived at EDR: 08/04/2025
Date Made Active in Reports: 08/12/2025
Number of Days to Update: 8

Source: EPA
Telephone: 703-416-0223
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 12/08/2025
Data Release Frequency: Annually

RMP: Risk Management Plans

When Congress passed the Clean Air Act Amendments of 1990, it required EPA to publish regulations and guidance for chemical accident prevention at facilities using extremely hazardous substances. The Risk Management Program Rule (RMP Rule) was written to implement Section 112(r) of these amendments. The rule, which built upon existing industry codes and standards, requires companies of all sizes that use certain flammable and toxic substances to develop a Risk Management Program, which includes a(n): Hazard assessment that details the potential effects of an accidental release, an accident history of the last five years, and an evaluation of worst-case and alternative accidental releases; Prevention program that includes safety precautions and maintenance, monitoring, and employee training measures; and Emergency response program that spells out emergency health care, employee training measures and procedures for informing the public and response agencies (e.g the fire department) should an accident occur.

Date of Government Version: 04/05/2025
Date Data Arrived at EDR: 04/11/2025
Date Made Active in Reports: 07/08/2025
Number of Days to Update: 88

Source: Environmental Protection Agency
Telephone: 202-564-8600
Last EDR Contact: 07/09/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

RAATS: RCRA Administrative Action Tracking System

RCRA Administration Action Tracking System. RAATS contains records based on enforcement actions issued under RCRA pertaining to major violators and includes administrative and civil actions brought by the EPA. For administration actions after September 30, 1995, data entry in the RAATS database was discontinued. EPA will retain a copy of the database for historical records. It was necessary to terminate RAATS because a decrease in agency resources made it impossible to continue to update the information contained in the database.

Date of Government Version: 04/17/1995
Date Data Arrived at EDR: 07/03/1995
Date Made Active in Reports: 08/07/1995
Number of Days to Update: 35

Source: EPA
Telephone: 202-564-4104
Last EDR Contact: 06/02/2008
Next Scheduled EDR Contact: 09/01/2008
Data Release Frequency: No Update Planned

PRP: Potentially Responsible Parties

A listing of verified Potentially Responsible Parties

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 28

Source: EPA
Telephone: 202-564-6023
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Quarterly

PADS: PCB Activity Database System

PCB Activity Database. PADS Identifies generators, transporters, commercial storers and/or brokers and disposers of PCB's who are required to notify the EPA of such activities.

Date of Government Version: 07/01/2024
Date Data Arrived at EDR: 10/02/2024
Date Made Active in Reports: 01/10/2025
Number of Days to Update: 100

Source: EPA
Telephone: 202-566-0500
Last EDR Contact: 07/02/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Annually

ICIS: Integrated Compliance Information System

The Integrated Compliance Information System (ICIS) supports the information needs of the national enforcement and compliance program as well as the unique needs of the National Pollutant Discharge Elimination System (NPDES) program.

Date of Government Version: 11/18/2016
Date Data Arrived at EDR: 11/23/2016
Date Made Active in Reports: 02/10/2017
Number of Days to Update: 79

Source: Environmental Protection Agency
Telephone: 202-564-2501
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Quarterly

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

FTTS: FIFRA/ TSCA Tracking System - FIFRA (Federal Insecticide, Fungicide, & Rodenticide Act)/TSCA (Toxic Substances Control Act)
FTTS tracks administrative cases and pesticide enforcement actions and compliance activities related to FIFRA, TSCA and EPCRA (Emergency Planning and Community Right-to-Know Act). To maintain currency, EDR contacts the Agency on a quarterly basis.

Date of Government Version: 04/09/2009
Date Data Arrived at EDR: 04/16/2009
Date Made Active in Reports: 05/11/2009
Number of Days to Update: 25
Source: EPA/Office of Prevention, Pesticides and Toxic Substances
Telephone: 202-566-1667
Last EDR Contact: 08/18/2017
Next Scheduled EDR Contact: 12/04/2017
Data Release Frequency: No Update Planned

FTTS INSP: FIFRA/ TSCA Tracking System - FIFRA (Federal Insecticide, Fungicide, & Rodenticide Act)/TSCA (Toxic Substances Control Act)
A listing of FIFRA/TSCA Tracking System (FTTS) inspections and enforcements.

Date of Government Version: 04/09/2009
Date Data Arrived at EDR: 04/16/2009
Date Made Active in Reports: 05/11/2009
Number of Days to Update: 25
Source: EPA
Telephone: 202-566-1667
Last EDR Contact: 08/18/2017
Next Scheduled EDR Contact: 12/04/2017
Data Release Frequency: No Update Planned

MLTS: Material Licensing Tracking System
MLTS is maintained by the Nuclear Regulatory Commission and contains a list of approximately 8,100 sites which possess or use radioactive materials and which are subject to NRC licensing requirements. To maintain currency, EDR contacts the Agency on a quarterly basis.

Date of Government Version: 05/07/2025
Date Data Arrived at EDR: 05/07/2025
Date Made Active in Reports: 06/03/2025
Number of Days to Update: 27
Source: Nuclear Regulatory Commission
Telephone: 301-415-0717
Last EDR Contact: 07/08/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Quarterly

COAL ASH DOE: Steam-Electric Plant Operation Data
A listing of power plants that store ash in surface ponds.

Date of Government Version: 12/31/2023
Date Data Arrived at EDR: 10/16/2024
Date Made Active in Reports: 01/14/2025
Number of Days to Update: 90
Source: Department of Energy
Telephone: 202-586-8719
Last EDR Contact: 08/28/2025
Next Scheduled EDR Contact: 12/08/2025
Data Release Frequency: Varies

COAL ASH EPA: Coal Combustion Residues Surface Impoundments List
A listing of coal combustion residues surface impoundments with high hazard potential ratings.

Date of Government Version: 01/12/2017
Date Data Arrived at EDR: 03/05/2019
Date Made Active in Reports: 11/11/2019
Number of Days to Update: 251
Source: Environmental Protection Agency
Telephone: N/A
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/08/2025
Data Release Frequency: Varies

PCB TRANSFORMER: PCB Transformer Registration Database
The database of PCB transformer registrations that includes all PCB registration submittals.

Date of Government Version: 09/13/2019
Date Data Arrived at EDR: 11/06/2019
Date Made Active in Reports: 02/10/2020
Number of Days to Update: 96
Source: Environmental Protection Agency
Telephone: 202-566-0517
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Varies

RADINFO: Radiation Information Database
The Radiation Information Database (RADINFO) contains information about facilities that are regulated by U.S. Environmental Protection Agency (EPA) regulations for radiation and radioactivity.

Date of Government Version: 07/01/2019
Date Data Arrived at EDR: 07/01/2019
Date Made Active in Reports: 09/23/2019
Number of Days to Update: 84

Source: Environmental Protection Agency
Telephone: 202-343-9775
Last EDR Contact: 06/17/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Quarterly

HIST FTTS: FIFRA/TSCA Tracking System Administrative Case Listing

A complete administrative case listing from the FIFRA/TSCA Tracking System (FTTS) for all ten EPA regions. The information was obtained from the National Compliance Database (NCDB). NCDB supports the implementation of FIFRA (Federal Insecticide, Fungicide, and Rodenticide Act) and TSCA (Toxic Substances Control Act). Some EPA regions are now closing out records. Because of that, and the fact that some EPA regions are not providing EPA Headquarters with updated records, it was decided to create a HIST FTTS database. It included records that may not be included in the newer FTTS database updates. This database is no longer updated.

Date of Government Version: 10/19/2006
Date Data Arrived at EDR: 03/01/2007
Date Made Active in Reports: 04/10/2007
Number of Days to Update: 40

Source: Environmental Protection Agency
Telephone: 202-564-2501
Last EDR Contact: 12/17/2007
Next Scheduled EDR Contact: 03/17/2008
Data Release Frequency: No Update Planned

HIST FTTS INSP: FIFRA/TSCA Tracking System Inspection & Enforcement Case Listing

A complete inspection and enforcement case listing from the FIFRA/TSCA Tracking System (FTTS) for all ten EPA regions. The information was obtained from the National Compliance Database (NCDB). NCDB supports the implementation of FIFRA (Federal Insecticide, Fungicide, and Rodenticide Act) and TSCA (Toxic Substances Control Act). Some EPA regions are now closing out records. Because of that, and the fact that some EPA regions are not providing EPA Headquarters with updated records, it was decided to create a HIST FTTS database. It included records that may not be included in the newer FTTS database updates. This database is no longer updated.

Date of Government Version: 10/19/2006
Date Data Arrived at EDR: 03/01/2007
Date Made Active in Reports: 04/10/2007
Number of Days to Update: 40

Source: Environmental Protection Agency
Telephone: 202-564-2501
Last EDR Contact: 12/17/2008
Next Scheduled EDR Contact: 03/17/2008
Data Release Frequency: No Update Planned

DOT OPS: Incident and Accident Data

Department of Transporation, Office of Pipeline Safety Incident and Accident data.

Date of Government Version: 03/31/2025
Date Data Arrived at EDR: 04/22/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 86

Source: Department of Transporation, Office of Pipeline Safety
Telephone: 202-366-4595
Last EDR Contact: 07/17/2025
Next Scheduled EDR Contact: 11/03/2025
Data Release Frequency: Quarterly

CONSENT: Superfund (CERCLA) Consent Decrees

Major legal settlements that establish responsibility and standards for cleanup at NPL (Superfund) sites. Released periodically by United States District Courts after settlement by parties to litigation matters.

Date of Government Version: 03/31/2025
Date Data Arrived at EDR: 05/02/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 76

Source: Department of Justice, Consent Decree Library
Telephone: Varies
Last EDR Contact: 06/24/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

BRS: Biennial Reporting System

The Biennial Reporting System is a national system administered by the EPA that collects data on the generation and management of hazardous waste. BRS captures detailed data from two groups: Large Quantity Generators (LQG) and Treatment, Storage, and Disposal Facilities.

Date of Government Version: 12/31/2023
Date Data Arrived at EDR: 02/19/2025
Date Made Active in Reports: 03/07/2025
Number of Days to Update: 16

Source: EPA/NTIS
Telephone: 800-424-9346
Last EDR Contact: 06/03/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Biennially

INDIAN RESERV: Indian Reservations

This map layer portrays Indian administered lands of the United States that have any area equal to or greater than 640 acres.

Date of Government Version: 12/31/2014
Date Data Arrived at EDR: 07/14/2015
Date Made Active in Reports: 01/10/2017
Number of Days to Update: 546

Source: USGS
Telephone: 202-208-3710
Last EDR Contact: 06/25/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Semi-Annually

FUSRAP: Formerly Utilized Sites Remedial Action Program

DOE established the Formerly Utilized Sites Remedial Action Program (FUSRAP) in 1974 to remediate sites where radioactive contamination remained from Manhattan Project and early U.S. Atomic Energy Commission (AEC) operations.

Date of Government Version: 03/03/2023
Date Data Arrived at EDR: 03/03/2023
Date Made Active in Reports: 06/09/2023
Number of Days to Update: 98

Source: Department of Energy
Telephone: 202-586-3559
Last EDR Contact: 07/28/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Varies

UMTRA: Uranium Mill Tailings Sites

Uranium ore was mined by private companies for federal government use in national defense programs. When the mills shut down, large piles of the sand-like material (mill tailings) remain after uranium has been extracted from the ore. Levels of human exposure to radioactive materials from the piles are low; however, in some cases tailings were used as construction materials before the potential health hazards of the tailings were recognized.

Date of Government Version: 05/15/2025
Date Data Arrived at EDR: 05/15/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 75

Source: Department of Energy
Telephone: 505-845-0011
Last EDR Contact: 08/11/2025
Next Scheduled EDR Contact: 11/24/2025
Data Release Frequency: Varies

LEAD SMELTER 1: Lead Smelter Sites

A listing of former lead smelter site locations.

Date of Government Version: 06/26/2025
Date Data Arrived at EDR: 07/01/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 16

Source: Environmental Protection Agency
Telephone: 703-603-8787
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 10/06/2025
Data Release Frequency: Varies

LEAD SMELTER 2: Lead Smelter Sites

A list of several hundred sites in the U.S. where secondary lead smelting was done from 1931and 1964. These sites may pose a threat to public health through ingestion or inhalation of contaminated soil or dust

Date of Government Version: 04/05/2001
Date Data Arrived at EDR: 10/27/2010
Date Made Active in Reports: 12/02/2010
Number of Days to Update: 36

Source: American Journal of Public Health
Telephone: 703-305-6451
Last EDR Contact: 12/02/2009
Next Scheduled EDR Contact: N/A
Data Release Frequency: No Update Planned

US AIRS (AFS): Aerometric Information Retrieval System Facility Subsystem (AFS)

The database is a sub-system of Aerometric Information Retrieval System (AIRS). AFS contains compliance data on air pollution point sources regulated by the U.S. EPA and/or state and local air regulatory agencies. This information comes from source reports by various stationary sources of air pollution, such as electric power plants, steel mills, factories, and universities, and provides information about the air pollutants they produce. Action, air program, air program pollutant, and general level plant data. It is used to track emissions and compliance data from industrial plants.

Date of Government Version: 10/12/2016
Date Data Arrived at EDR: 10/26/2016
Date Made Active in Reports: 02/03/2017
Number of Days to Update: 100

Source: EPA
Telephone: 202-564-2496
Last EDR Contact: 09/26/2017
Next Scheduled EDR Contact: 01/08/2018
Data Release Frequency: Annually

US AIRS MINOR: Air Facility System Data
A listing of minor source facilities.

Date of Government Version: 10/12/2016
Date Data Arrived at EDR: 10/26/2016
Date Made Active in Reports: 02/03/2017
Number of Days to Update: 100

Source: EPA
Telephone: 202-564-2496
Last EDR Contact: 09/26/2017
Next Scheduled EDR Contact: 01/08/2018
Data Release Frequency: Annually

US MINES: Mines Master Index File
Contains all mine identification numbers issued for mines active or opened since 1971. The data also includes violation information.

Date of Government Version: 05/01/2025
Date Data Arrived at EDR: 05/20/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 70

Source: Department of Labor, Mine Safety and Health Administration
Telephone: 303-231-5959
Last EDR Contact: 08/18/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Semi-Annually

MINES VIOLATIONS: MSHA Violation Assessment Data
Mines violation and assessment information. Department of Labor, Mine Safety & Health Administration.

Date of Government Version: 04/01/2025
Date Data Arrived at EDR: 04/02/2025
Date Made Active in Reports: 06/24/2025
Number of Days to Update: 83

Source: DOL, Mine Safety & Health Admi
Telephone: 202-693-9424
Last EDR Contact: 07/01/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Quarterly

US MINES 2: Ferrous and Nonferrous Metal Mines Database Listing
This map layer includes ferrous (ferrous metal mines are facilities that extract ferrous metals, such as iron ore or molybdenum) and nonferrous (Nonferrous metal mines are facilities that extract nonferrous metals, such as gold, silver, copper, zinc, and lead) metal mines in the United States.

Date of Government Version: 04/08/2025
Date Data Arrived at EDR: 05/20/2025
Date Made Active in Reports: 08/12/2025
Number of Days to Update: 84

Source: USGS
Telephone: 703-648-7709
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Varies

US MINES 3: Active Mines & Mineral Plants Database Listing
Active Mines and Mineral Processing Plant operations for commodities monitored by the Minerals Information Team of the USGS.

Date of Government Version: 04/14/2011
Date Data Arrived at EDR: 06/08/2011
Date Made Active in Reports: 09/13/2011
Number of Days to Update: 97

Source: USGS
Telephone: 703-648-7709
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Varies

MINES MRDS: Mineral Resources Data System
Mineral Resources Data System

Date of Government Version: 06/04/2024
Date Data Arrived at EDR: 11/22/2024
Date Made Active in Reports: 02/18/2025
Number of Days to Update: 88

Source: USGS
Telephone: 703-648-6533
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Varies

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

ABANDONED MINES: Abandoned Mines

An inventory of land and water impacted by past mining (primarily coal mining) is maintained by OSMRE to provide information needed to implement the Surface Mining Control and Reclamation Act of 1977 (SMCRA). The inventory contains information on the location, type, and extent of AML impacts, as well as, information on the cost associated with the reclamation of those problems. The inventory is based upon field surveys by State, Tribal, and OSMRE program officials. It is dynamic to the extent that it is modified as new problems are identified and existing problems are reclaimed.

Date of Government Version: 05/28/2025
Date Data Arrived at EDR: 05/28/2025
Date Made Active in Reports: 06/03/2025
Number of Days to Update: 6

Source: Department of Interior
Telephone: 202-208-2609
Last EDR Contact: 08/26/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Quarterly

FINDS: Facility Index System/Facility Registry System

Facility Index System. FINDS contains both facility information and 'pointers' to other sources that contain more detail. EDR includes the following FINDS databases in this report: PCS (Permit Compliance System), AIRS (Aerometric Information Retrieval System), DOCKET (Enforcement Docket used to manage and track information on civil judicial enforcement cases for all environmental statutes), FURS (Federal Underground Injection Control), C-DOCKET (Criminal Docket System used to track criminal enforcement actions for all environmental statutes), FFIS (Federal Facilities Information System), STATE (State Environmental Laws and Statutes), and PADS (PCB Activity Data System).

Date of Government Version: 04/22/2025
Date Data Arrived at EDR: 05/05/2025
Date Made Active in Reports: 05/21/2025
Number of Days to Update: 16

Source: EPA
Telephone: (214) 665-2200
Last EDR Contact: 08/21/2025
Next Scheduled EDR Contact: 12/08/2025
Data Release Frequency: Quarterly

DOCKET HWC: Hazardous Waste Compliance Docket Listing

A complete list of the Federal Agency Hazardous Waste Compliance Docket Facilities.

Date of Government Version: 05/06/2021
Date Data Arrived at EDR: 05/21/2021
Date Made Active in Reports: 08/11/2021
Number of Days to Update: 82

Source: Environmental Protection Agency
Telephone: 202-564-0527
Last EDR Contact: 08/12/2025
Next Scheduled EDR Contact: 12/01/2025
Data Release Frequency: Varies

ECHO: Enforcement & Compliance History Information

ECHO provides integrated compliance and enforcement information for about 800,000 regulated facilities nationwide.

Date of Government Version: 06/22/2025
Date Data Arrived at EDR: 06/25/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 63

Source: Environmental Protection Agency
Telephone: 202-564-2280
Last EDR Contact: 06/25/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Quarterly

UXO: Unexploded Ordnance Sites

A listing of unexploded ordnance site locations

Date of Government Version: 02/14/2025
Date Data Arrived at EDR: 03/11/2025
Date Made Active in Reports: 06/03/2025
Number of Days to Update: 84

Source: Department of Defense
Telephone: 703-704-1564
Last EDR Contact: 07/02/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Varies

FUELS PROGRAM: EPA Fuels Program Registered Listing

This listing includes facilities that are registered under the Part 80 (Code of Federal Regulations) EPA Fuels Programs. All companies now are required to submit new and updated registrations.

Date of Government Version: 05/07/2025
Date Data Arrived at EDR: 05/13/2025
Date Made Active in Reports: 07/29/2025
Number of Days to Update: 77

Source: EPA
Telephone: 800-385-6164
Last EDR Contact: 08/07/2025
Next Scheduled EDR Contact: 11/24/2025
Data Release Frequency: Quarterly

PFAS NPL: Superfund Sites with PFAS Detections Information

EPA's Office of Land and Emergency Management and EPA Regional Offices maintain data describing what is known about site investigations, contamination, and remedial actions under the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) where PFAS is present in the environment.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 703-603-8895
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS FEDERAL SITES: Federal Sites PFAS Information

Several federal entities, such as the federal Superfund program, Department of Defense, National Aeronautics and Space Administration, Department of Transportation, and Department of Energy provided information for sites with known or suspected detections at federal facilities.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS TSCA: PFAS Manufacture and Imports Information

EPA issued the Chemical Data Reporting (CDR) Rule under the Toxic Substances Control Act (TSCA) and requires chemical manufacturers and facilities that manufacture or import chemical substances to report data to EPA. EPA publishes non-confidential business information (non-CBI) and includes descriptive information about each site, corporate parent, production volume, other manufacturing information, and processing and use information.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS TRIS: List of PFAS Added to the TRI

Section 7321 of the National Defense Authorization Act for Fiscal Year 2020 (NDAA) immediately added certain per- and polyfluoroalkyl substances (PFAS) to the list of chemicals covered by the Toxics Release Inventory (TRI) under Section 313 of the Emergency Planning and Community Right-to-Know Act (EPCRA) and provided a framework for additional PFAS to be added to TRI on an annual basis.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-566-0250
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS RCRA MANIFEST: PFAS Transfers Identified In the RCRA Database Listing

To work around the lack of PFAS waste codes in the RCRA database, EPA developed the PFAS Transfers dataset by mining e-Manifest records containing at least one of these common PFAS keywords: PFAS, PFOA, PFOS, PERFL, AFFF, GENX, GEN-X (plus the VT waste codes). These keywords were searched for in the following text fields: Manifest handling instructions (MANIFEST_HANDLING_INSTR), Non-hazardous waste description (NON_HAZ_WASTE_DESCRIPTION), DOT printed information (DOT_PRINTED_INFORMATION), Waste line handling instructions (WASTE_LINE_HANDLING_INSTR), Waste residue comments (WASTE_RESIDUE_COMMENTS).

Date of Government Version: 03/23/2025
Date Data Arrived at EDR: 04/02/2025
Date Made Active in Reports: 05/05/2025
Number of Days to Update: 33

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS ATSDR: PFAS Contamination Site Location Listing

PFAS contamination site locations from the Department of Health & Human Services, Center for Disease Control & Prevention. ATSDR is involved at a number of PFAS-related sites, either directly or through assisting state and federal partners. As of now, most sites are related to drinking water contamination connected with PFAS production facilities or fire training areas where aqueous film-forming firefighting foam (AFFF) was regularly used.

Date of Government Version: 06/24/2020
Date Data Arrived at EDR: 03/17/2021
Date Made Active in Reports: 11/08/2022
Number of Days to Update: 601

Source: Department of Health & Human Services
Telephone: 202-741-5770
Last EDR Contact: 07/16/2025
Next Scheduled EDR Contact: 11/03/2025
Data Release Frequency: Varies

PFAS WQP: Ambient Environmental Sampling for PFAS

The Water Quality Portal (WQP) is a part of a modernized repository storing ambient sampling data for all environmental media and tissue samples. A wide range of federal, state, tribal and local governments, academic and non-governmental organizations and individuals submit project details and sampling results to this public repository. The information is commonly used for research and assessments of environmental quality.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS NPDES: Clean Water Act Discharge Monitoring Information

Any discharger of pollutants to waters of the United States from a point source must have a National Pollutant Discharge Elimination System (NPDES) permit. The process for obtaining limits involves the regulated entity (permittee) disclosing releases in a NPDES permit application and the permitting authority (typically the state but sometimes EPA) deciding whether to require monitoring or monitoring with limits. Caveats and Limitations: Less than half of states have required PFAS monitoring for at least one of their permittees and fewer states have established PFAS effluent limits for permittees. New rulemakings have been initiated that may increase the number of facilities monitoring for PFAS in the future.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS PROJECT: NORTHEASTERN UNIVERSITY PFAS PROJECT

The PFAS Contamination Site Tracker records qualitative and quantitative data from each site in a chart, specifically examining discovery, contamination levels, government response, litigation, health impacts, media coverage, and community characteristics. All data presented in the chart were extracted from government websites, such as state health departments or the Environmental Protection Agency, and news articles.

Date of Government Version: 05/15/2024
Date Data Arrived at EDR: 03/06/2025
Date Made Active in Reports: 06/03/2025
Number of Days to Update: 89

Source: Social Science Environmental Health Research Institute
Telephone: N/A
Last EDR Contact: 09/02/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Varies

PFAS ECHO: Facilities in Industries that May Be Handling PFAS Listing

Regulators and the public have expressed interest in knowing which regulated entities may be using PFAS. EPA has developed a dataset from various sources that show which industries may be handling PFAS. Approximately 120,000 facilities subject to federal environmental programs have operated or currently operate in industry sectors with processes that may involve handling and/or release of PFAS.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS ECHO FIRE TRAIN: Facilities in Industries that May Be Handling PFAS Listing

A list of fire training sites was added to the Industry Sectors dataset using a keyword search on the permitted facilitys name to identify sites where fire-fighting foam may have been used in training exercises. Additionally, you may view an example spreadsheet of the subset of fire training facility data, as well as the keywords used in selecting or deselecting a facility for the subset. as well as the keywords used in selecting or deselecting a facility for the subset. These keywords were tested to maximize accuracy in selecting facilities that may use fire-fighting foam in training exercises, however, due to the lack of a required reporting field in the data systems for designating fire training sites, this methodology may not identify all fire training sites or may potentially misidentify them.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PFAS PT 139 AIRPORT: All Certified Part 139 Airports PFAS Information Listing

Since July 1, 2006, all certified part 139 airports are required to have fire-fighting foam onsite that meet military specifications (MIL-F-24385) (14 CFR 139.317). To date, these military specification fire-fighting foams are fluorinated and have been historically used for training and extinguishing. The 2018 FAA Reauthorization Act has a provision stating that no later than October 2021, FAA shall not require the use of fluorinated AFFF. This provision does not prohibit the use of fluorinated AFFF at Part 139 civilian airports; it only prohibits FAA from mandating its use. The Federal Aviation Administration?s document AC 150/5210-6D - Aircraft Fire Extinguishing Agents provides guidance on Aircraft Fire Extinguishing Agents, which includes Aqueous Film Forming Foam (AFFF).

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-272-0167
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

AQUEOUS FOAM NRC: Aqueous Foam Related Incidents Listing

The National Response Center (NRC) serves as an emergency call center that fields initial reports for pollution and railroad incidents and forwards that information to appropriate federal/state agencies for response. The spreadsheets posted to the NRC website contain initial incident data that has not been validated or investigated by a federal/state response agency. Response center calls from 1990 to the most recent complete calendar year where there was indication of Aqueous Film Forming Foam (AFFF) usage are included in this dataset. NRC calls may reference AFFF usage in the ?Material Involved? or ?Incident Description? fields.

Date of Government Version: 06/23/2025
Date Data Arrived at EDR: 06/26/2025
Date Made Active in Reports: 08/27/2025
Number of Days to Update: 62

Source: Environmental Protection Agency
Telephone: 202-267-2675
Last EDR Contact: 06/26/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

PCS: Permit Compliance System

PCS is a computerized management information system that contains data on National Pollutant Discharge Elimination System (NPDES) permit holding facilities. PCS tracks the permit, compliance, and enforcement status of NPDES facilities.

Date of Government Version: 12/16/2016
Date Data Arrived at EDR: 01/06/2017
Date Made Active in Reports: 03/10/2017
Number of Days to Update: 63

Source: EPA, Office of Water
Telephone: 202-564-2496
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: No Update Planned

PCS ENF: Enforcement data
No description is available for this data

Date of Government Version: 12/31/2014
Date Data Arrived at EDR: 02/05/2015
Date Made Active in Reports: 03/06/2015
Number of Days to Update: 29

Source: EPA
Telephone: 202-564-2497
Last EDR Contact: 06/23/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Varies

BIOSOLIDS: ICIS-NPDES Biosolids Facility Data
The data reflects compliance information about facilities in the biosolids program.

Date of Government Version: 04/13/2025
Date Data Arrived at EDR: 04/15/2025
Date Made Active in Reports: 07/08/2025
Number of Days to Update: 84

Source: Environmental Protection Agency
Telephone: 202-564-4700
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

UST FINDER RELEASE: UST Finder Releases Database
US EPA's UST Finder data is a national composite of leaking underground storage tanks. This data contains information about, and locations of, leaking underground storage tanks. Data was collected from state sources and standardized into a national profile by EPA's Office of Underground Storage Tanks, Office of Research and Development, and the Association of State and Territorial Solid Waste Management Officials.

Date of Government Version: 06/08/2023
Date Data Arrived at EDR: 10/31/2023
Date Made Active in Reports: 01/18/2024
Number of Days to Update: 79

Source: Environmental Protecton Agency
Telephone: 202-564-0394
Last EDR Contact: 08/13/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Semi-Annually

UST FINDER: UST Finder Database
EPA developed UST Finder, a web map application containing a comprehensive, state-sourced national map of underground storage tank (UST) and leaking UST (LUST) data. It provides the attributes and locations of active and closed USTs, UST facilities, and LUST sites from states and from Tribal lands and US territories . UST Finder contains information about proximity of UST facilities and LUST sites to: surface and groundwater public drinking water protection areas; estimated number of private domestic wells and number of people living nearby; and flooding and wildfires.

Date of Government Version: 06/08/2023
Date Data Arrived at EDR: 10/04/2023
Date Made Active in Reports: 01/18/2024
Number of Days to Update: 106

Source: Environmental Protection Agency
Telephone: 202-564-0394
Last EDR Contact: 08/13/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Varies

E MANIFEST: Hazardous Waste Electronic Manifest System
EPA established a national system for tracking hazardous waste shipments electronically. This system, known as ?e-Manifest,? will modernize the nation?s cradle-to-grave hazardous waste tracking process while saving valuable time, resources, and dollars for industry and states.

Date of Government Version: 06/02/2025
Date Data Arrived at EDR: 06/04/2025
Date Made Active in Reports: 08/13/2025
Number of Days to Update: 70

Source: Environmental Protection Agency
Telephone: 833-501-6826
Last EDR Contact: 06/04/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Varies

PFAS: Per- and Polyfluoroalkyl Substances
A listing of PFAS contaminated sites. PFAS is a class of chemicals that includes PFOA (perfluorooctanoic acid), PFOS (perfluorooctanesulfonic acid), PFNA (perfluorononanoic acid) and PFHxA (perfluorohexanoic acid). PFOA and PFOS, are the most commonly found and potent PFASs at contamination sites.

Date of Government Version: 05/28/2025
Date Data Arrived at EDR: 06/03/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 84

Source: Department of Environmental Quality
Telephone: 501-683-6977
Last EDR Contact: 08/26/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Varies

AQUEOUS FOAM: Aqueous Film-Forming Foam Site Listing

Aqueous foam sites are categorized and listed as spill sites in spills database. Aqueous Foam sites will have material type listed as AFFF or aqueous foam.

Date of Government Version: 03/30/2025
Date Data Arrived at EDR: 04/01/2025
Date Made Active in Reports: 06/18/2025
Number of Days to Update: 78

Source: Department of Environmental Quality
Telephone: 501-683-6977
Last EDR Contact: 06/25/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: Quarterly

AIRS: Permitted Facility Emission & Stack Data

Permitted facility emissions and stack data for the state.

Date of Government Version: 03/17/2025
Date Data Arrived at EDR: 03/18/2025
Date Made Active in Reports: 06/03/2025
Number of Days to Update: 77

Source: Department of Environmental Quality
Telephone: 501-682-0726
Last EDR Contact: 06/12/2025
Next Scheduled EDR Contact: 09/29/2025
Data Release Frequency: Quarterly

ASBESTOS: Asbestos Notification of Intent Database

The database contains all properties/facilities that have submitted a Notice of Intent for renovation or demolition activities.

Date of Government Version: 04/14/2025
Date Data Arrived at EDR: 04/15/2025
Date Made Active in Reports: 07/02/2025
Number of Days to Update: 78

Source: Department of Environmental Quality
Telephone: 501-682-0717
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Quarterly

COAL ASH: Coal Ash Disposal Site Listing

A listing of coal ash disposal site locations.

Date of Government Version: 01/30/2023
Date Data Arrived at EDR: 05/02/2023
Date Made Active in Reports: 07/24/2023
Number of Days to Update: 83

Source: Department of Environmental Quality
Telephone: 501-682-0600
Last EDR Contact: 07/24/2025
Next Scheduled EDR Contact: 11/10/2025
Data Release Frequency: Varies

ENFORCEMENT: Consent Administrative Order, Notice of Violation Information Database

Violations issued to facilities in various Department of Environmental Quality programs, including Air, Hazardous Waste, Storage Tanks, Solid Waste and Water.

Date of Government Version: 04/14/2025
Date Data Arrived at EDR: 04/15/2025
Date Made Active in Reports: 07/02/2025
Number of Days to Update: 78

Source: Department of Environmental Quality
Telephone: 501-682-0892
Last EDR Contact: 07/10/2025
Next Scheduled EDR Contact: 10/27/2025
Data Release Frequency: Varies

FIN ASSURANCE 1: Financial Assurance Information Listing

Financial assurance is intended to ensure that resources are available to pay for the cost of closure, post-closure care, and corrective measures if the owner or operator of a regulated facility is unable or unwilling to pay.

Date of Government Version: 09/16/2019
Date Data Arrived at EDR: 09/18/2019
Date Made Active in Reports: 11/19/2019
Number of Days to Update: 62

Source: Department of Environmental Quality
Telephone: 501-682-0876
Last EDR Contact: 09/03/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Varies

FIN ASSURANCE 2: Financial Assurance Information Listing

Financial assurance is intended to ensure that resources are available to pay for the cost of closure, post-closure care, and corrective measures if the owner or operator of a regulated facility is unable or unwilling to pay.

Date of Government Version: 03/26/2025
Date Data Arrived at EDR: 03/27/2025
Date Made Active in Reports: 06/18/2025
Number of Days to Update: 83

Source: Department of Environmental Quality
Telephone: 501-682-0589
Last EDR Contact: 06/24/2025
Next Scheduled EDR Contact: 10/13/2025
Data Release Frequency: No Update Planned

FIN ASSURANCE 3: Financial Assurance Information Listing

A listing of financial assurance information for underground storage tank facilities.

Date of Government Version: 06/05/2025
Date Data Arrived at EDR: 06/05/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 82

Source: Department of Environmental Quality
Telephone: 501-682-0979
Last EDR Contact: 09/05/2025
Next Scheduled EDR Contact: 12/22/2025
Data Release Frequency: Quarterly

HW GEN: Hazardous Waste Generators Facility Summary

This is a database listing of Arkansas Hazardous Waste Generators.

Date of Government Version: 05/04/2025
Date Data Arrived at EDR: 05/06/2025
Date Made Active in Reports: 07/17/2025
Number of Days to Update: 72

Source: Department of Environmental Quality
Telephone: 501-683-0069
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: Quarterly

PERMITS: Permit Data System

A list of sites permitted by the Department of Environmental Quality, including Air, Mining, Solid Waste and Water.

Date of Government Version: 05/30/2025
Date Data Arrived at EDR: 05/30/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 88

Source: Department of Environmental Quality
Telephone: 501-682-0673
Last EDR Contact: 08/29/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Quarterly

SLUDGE: Poultry Sludge Permit Sites

Broiler fryer roast chickens, chicken eggs, poultry hatcheries, poultry and egg processing sites.

Date of Government Version: 05/30/2025
Date Data Arrived at EDR: 05/30/2025
Date Made Active in Reports: 08/26/2025
Number of Days to Update: 88

Source: Department of Environmental Quality
Telephone: 501-682-0673
Last EDR Contact: 08/29/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Quarterly

TIER 2: Tier 2 Information Listing

A listing of facilities which store or manufacture hazardous materials and submit a chemical inventory report.

Date of Government Version: 12/31/2023
Date Data Arrived at EDR: 02/26/2025
Date Made Active in Reports: 05/19/2025
Number of Days to Update: 82

Source: Department of Environmental Management
Telephone: 501-683-6700
Last EDR Contact: 07/29/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: No Update Planned

UIC: Underground Injection Wells Database Listing

A listing of wells identified as Underground Injection Wells, in the Arkansas Oil and Gas Wells data base.

Date of Government Version: 04/03/2025
Date Data Arrived at EDR: 04/08/2025
Date Made Active in Reports: 05/06/2025
Number of Days to Update: 28

Source: Arkansas Oil & Gas Commission
Telephone: 870-862-4965
Last EDR Contact: 07/03/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Varies

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

EDR HIGH RISK HISTORICAL RECORDS

EDR Exclusive Records

EDR MGP: EDR Proprietary Manufactured Gas Plants

The EDR Proprietary Manufactured Gas Plant Database includes records of coal gas plants (manufactured gas plants) compiled by EDR's researchers. Manufactured gas sites were used in the United States from the 1800's to 1950's to produce a gas that could be distributed and used as fuel. These plants used whale oil, rosin, coal, or a mixture of coal, oil, and water that also produced a significant amount of waste. Many of the byproducts of the gas production, such as coal tar (oily waste containing volatile and non-volatile chemicals), sludges, oils and other compounds are potentially hazardous to human health and the environment. The byproduct from this process was frequently disposed of directly at the plant site and can remain or spread slowly, serving as a continuous source of soil and groundwater contamination.

Date of Government Version: N/A
Date Data Arrived at EDR: N/A
Date Made Active in Reports: N/A
Number of Days to Update: N/A

Source: EDR, Inc.
Telephone: N/A
Last EDR Contact: N/A
Next Scheduled EDR Contact: N/A
Data Release Frequency: No Update Planned

EDR Hist Auto: EDR Exclusive Historical Auto Stations

EDR has searched selected national collections of business directories and has collected listings of potential gas station/filling station/service station sites that were available to EDR researchers. EDR's review was limited to those categories of sources that might, in EDR's opinion, include gas station/filling station/service station establishments. The categories reviewed included, but were not limited to gas, gas station, gasoline station, filling station, auto, automobile repair, auto service station, service station, etc. This database falls within a category of information EDR classifies as "High Risk Historical Records", or HRHR. EDR's HRHR effort presents unique and sometimes proprietary data about past sites and operations that typically create environmental concerns, but may not show up in current government records searches.

Date of Government Version: N/A
Date Data Arrived at EDR: N/A
Date Made Active in Reports: N/A
Number of Days to Update: N/A

Source: EDR, Inc.
Telephone: N/A
Last EDR Contact: N/A
Next Scheduled EDR Contact: N/A
Data Release Frequency: Varies

EDR Hist Cleaner: EDR Exclusive Historical Cleaners

EDR has searched selected national collections of business directories and has collected listings of potential dry cleaner sites that were available to EDR researchers. EDR's review was limited to those categories of sources that might, in EDR's opinion, include dry cleaning establishments. The categories reviewed included, but were not limited to dry cleaners, cleaners, laundry, laundromat, cleaning/laundry, wash & dry etc. This database falls within a category of information EDR classifies as "High Risk Historical Records", or HRHR. EDR's HRHR effort presents unique and sometimes proprietary data about past sites and operations that typically create environmental concerns, but may not show up in current government records searches.

Date of Government Version: N/A
Date Data Arrived at EDR: N/A
Date Made Active in Reports: N/A
Number of Days to Update: N/A

Source: EDR, Inc.
Telephone: N/A
Last EDR Contact: N/A
Next Scheduled EDR Contact: N/A
Data Release Frequency: Varies

EDR RECOVERED GOVERNMENT ARCHIVES

Exclusive Recovered Govt. Archives

RGA HWS: Recovered Government Archive State Hazardous Waste Facilities List

The EDR Recovered Government Archive State Hazardous Waste database provides a list of SHWS incidents derived from historical databases and includes many records that no longer appear in current government lists. Compiled from Records formerly available from the Department of Environmental Quality in Arkansas.

Date of Government Version: N/A
Date Data Arrived at EDR: 07/01/2013
Date Made Active in Reports: 01/02/2014
Number of Days to Update: 185

Source: Department of Environmental Quality
Telephone: N/A
Last EDR Contact: 06/01/2012
Next Scheduled EDR Contact: N/A
Data Release Frequency: Varies

RGA LF: Recovered Government Archive Solid Waste Facilities List

The EDR Recovered Government Archive Landfill database provides a list of landfills derived from historical databases and includes many records that no longer appear in current government lists. Compiled from Records formerly available from the Department of Environmental Quality in Arkansas.

Date of Government Version: N/A
Date Data Arrived at EDR: 07/01/2013
Date Made Active in Reports: 01/16/2014
Number of Days to Update: 199

Source: Department of Environmental Quality
Telephone: N/A
Last EDR Contact: 06/01/2012
Next Scheduled EDR Contact: N/A
Data Release Frequency: Varies

RGA LUST: Recovered Government Archive Leaking Underground Storage Tank

The EDR Recovered Government Archive Leaking Underground Storage Tank database provides a list of LUST incidents derived from historical databases and includes many records that no longer appear in current government lists. Compiled from Records formerly available from the Department of Environmental Quality in Arkansas.

Date of Government Version: N/A
Date Data Arrived at EDR: 07/01/2013
Date Made Active in Reports: 01/04/2014
Number of Days to Update: 187

Source: Department of Environmental Quality
Telephone: N/A
Last EDR Contact: 06/01/2012
Next Scheduled EDR Contact: N/A
Data Release Frequency: Varies

OTHER DATABASE(S)

Depending on the geographic area covered by this report, the data provided in these specialty databases may or may not be complete. For example, the existence of wetlands information data in a specific report does not mean that all wetlands in the area covered by the report are included. Moreover, the absence of any reported wetlands information does not necessarily mean that wetlands do not exist in the area covered by the report.

CT MANIFEST: Hazardous Waste Manifest Data

Facility and manifest data. Manifest is a document that lists and tracks hazardous waste from the generator through transporters to a tsd facility.

Date of Government Version: 05/04/2025
Date Data Arrived at EDR: 05/06/2025
Date Made Active in Reports: 07/21/2025
Number of Days to Update: 76

Source: Department of Energy & Environmental Protection
Telephone: 860-424-3375
Last EDR Contact: 07/31/2025
Next Scheduled EDR Contact: 11/17/2025
Data Release Frequency: No Update Planned

NY MANIFEST: Facility and Manifest Data

Manifest is a document that lists and tracks hazardous waste from the generator through transporters to a TSD facility.

Date of Government Version: 12/31/2019
Date Data Arrived at EDR: 11/30/2023
Date Made Active in Reports: 12/01/2023
Number of Days to Update: 1

Source: Department of Environmental Conservation
Telephone: 518-402-8651
Last EDR Contact: 07/17/2025
Next Scheduled EDR Contact: 11/03/2025
Data Release Frequency: Quarterly

PA MANIFEST: Manifest Information

Hazardous waste manifest information.

Date of Government Version: 06/30/2018
Date Data Arrived at EDR: 07/19/2019
Date Made Active in Reports: 09/10/2019
Number of Days to Update: 53

Source: Department of Environmental Protection
Telephone: 717-783-8990
Last EDR Contact: 07/01/2025
Next Scheduled EDR Contact: 10/20/2025
Data Release Frequency: Annually

RI MANIFEST: Manifest information
Hazardous waste manifest information

Date of Government Version: 12/31/2020
Date Data Arrived at EDR: 11/30/2021
Date Made Active in Reports: 02/18/2022
Number of Days to Update: 80

Source: Department of Environmental Management
Telephone: 401-222-2797
Last EDR Contact: 08/06/2025
Next Scheduled EDR Contact: 11/24/2025
Data Release Frequency: Annually

WI MANIFEST: Manifest Information
Hazardous waste manifest information.

Date of Government Version: 05/31/2018
Date Data Arrived at EDR: 06/19/2019
Date Made Active in Reports: 09/03/2019
Number of Days to Update: 76

Source: Department of Natural Resources
Telephone: N/A
Last EDR Contact: 08/27/2025
Next Scheduled EDR Contact: 12/15/2025
Data Release Frequency: Annually

Oil/Gas Pipelines
Source: Endeavor Business Media
Petroleum Bundle (Crude Oil, Refined Products, Petrochemicals, Gas Liquids (LPG/NGL), and Specialty Gases (Miscellaneous)) N = Natural Gas Bundle (Natural Gas, Gas Liquids (LPG/NGL), and Specialty Gases (Miscellaneous)). This map includes information copyrighted by Endeavor Business Media. This information is provided on a best effort basis and Endeavor Business Media does not guarantee its accuracy nor warrant its fitness for any particular purpose. Such information has been reprinted with the permission of Endeavor Business Media.

Electric Power Transmission Line Data
Source: Endeavor Business Media
This map includes information copyrighted by Endeavor Business Media. This information is provided on a best effort basis and Endeavor Business Media does not guarantee its accuracy nor warrant its fitness for any particular purpose. Such information has been reprinted with the permission of Endeavor Business Media.

Sensitive Receptors: There are individuals deemed sensitive receptors due to their fragile immune systems and special sensitivity to environmental discharges. These sensitive receptors typically include the elderly, the sick, and children. While the location of all sensitive receptors cannot be determined, EDR indicates those buildings and facilities - schools, daycares, hospitals, medical centers, and nursing homes - where individuals who are sensitive receptors are likely to be located.

AHA Hospitals:
Source: American Hospital Association, Inc.
Telephone: 312-280-5991
The database includes a listing of hospitals based on the American Hospital Association's annual survey of hospitals.

Medical Centers: Provider of Services Listing
Source: Centers for Medicare & Medicaid Services
Telephone: 410-786-3000
A listing of hospitals with Medicare provider number, produced by Centers of Medicare & Medicaid Services, a federal agency within the U.S. Department of Health and Human Services.

Nursing Homes
Source: National Institutes of Health
Telephone: 301-594-6248
Information on Medicare and Medicaid certified nursing homes in the United States.

Public Schools
Source: National Center for Education Statistics
Telephone: 202-502-7300
The National Center for Education Statistics' primary database on elementary and secondary public education in the United States. It is a comprehensive, annual, national statistical database of all public elementary and secondary schools and school districts, which contains data that are comparable across all states.

Private Schools
Source: National Center for Education Statistics
Telephone: 202-502-7300
The National Center for Education Statistics' primary database on private school locations in the United States.

Flood Zone Data: This data was obtained from the Federal Emergency Management Agency (FEMA). It depicts 100-year and 500-year flood zones as defined by FEMA. It includes the National Flood Hazard Layer (NFHL) which incorporates Flood Insurance Rate Map (FIRM) data and Q3 data from FEMA in areas not covered by NFHL.
Source: FEMA
Telephone: 877-336-2627
Date of Government Version: 2003, 2015

NWI: National Wetlands Inventory. This data, available in select counties across the country, was obtained by EDR in 2002, 2005, 2010 and 2015 from the U.S. Fish and Wildlife Service.

State Wetlands Data: Wetland Inventory
Source: US Fish & Wildlife Service
Telephone: 703-358-2171

Current USGS 7.5 Minute Topographic Map
Source: U.S. Geological Survey

STREET AND ADDRESS INFORMATION

© 2015 TomTom North America, Inc. All rights reserved. This material is proprietary and the subject of copyright protection and other intellectual property rights owned by or licensed to Tele Atlas North America, Inc. The use of this material is subject to the terms of a license agreement. You will be held liable for any unauthorized copying or disclosure of this material.

GEOCHECK ®- PHYSICAL SETTING SOURCE ADDENDUM

TARGET PROPERTY ADDRESS

FORMER GRAYS HOSPITAL
477 EAST MAIN STREET
BATESVILLE, AR 72501

TARGET PROPERTY COORDINATES

Latitude (North):	35.772488 - 35° 46' 20.96''
Longitude (West):	91.650919 - 91° 39' 3.31''
Universal Tranverse Mercator:	Zone 15
UTM X (Meters):	621944.2
UTM Y (Meters):	3959354.0
Elevation:	322 ft. above sea level

USGS TOPOGRAPHIC MAP

Target Property Map:	15654974 BATESVILLE, AR
Version Date:	2020

EDR's GeoCheck Physical Setting Source Addendum is provided to assist the environmental professional in forming an opinion about the impact of potential contaminant migration.

Assessment of the impact of contaminant migration generally has two principle investigative components:

1. Groundwater flow direction, and
2. Groundwater flow velocity.

Groundwater flow direction may be impacted by surface topography, hydrology, hydrogeology, characteristics of the soil, and nearby wells. Groundwater flow velocity is generally impacted by the nature of the geologic strata.

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

GROUNDWATER FLOW DIRECTION INFORMATION

Groundwater flow direction for a particular site is best determined by a qualified environmental professional using site-specific well data. If such data is not reasonably ascertainable, it may be necessary to rely on other sources of information, such as surface topographic information, hydrologic information, hydrogeologic data collected on nearby properties, and regional groundwater flow information (from deep aquifers).

TOPOGRAPHIC INFORMATION

Surface topography may be indicative of the direction of surficial groundwater flow. This information can be used to assist the environmental professional in forming an opinion about the impact of nearby contaminated properties or, should contamination exist on the target property, what downgradient sites might be impacted.

TARGET PROPERTY TOPOGRAPHY

General Topographic Gradient: General WNW

SURROUNDING TOPOGRAPHY: ELEVATION PROFILES

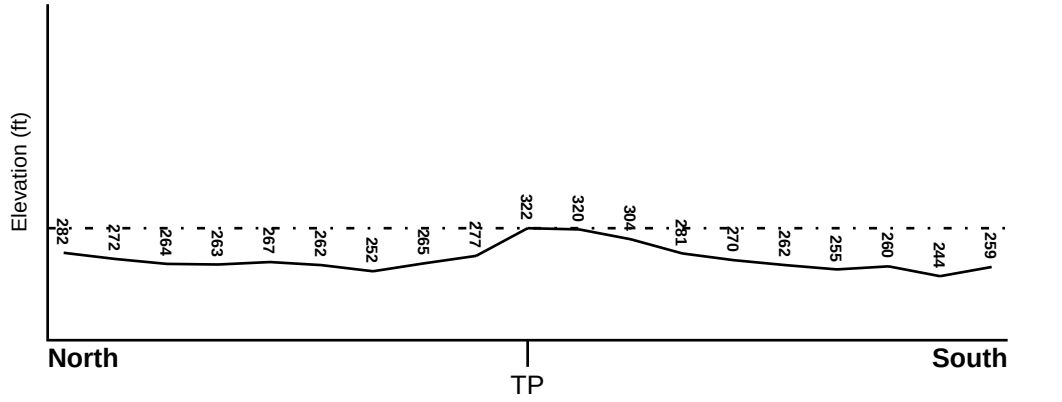

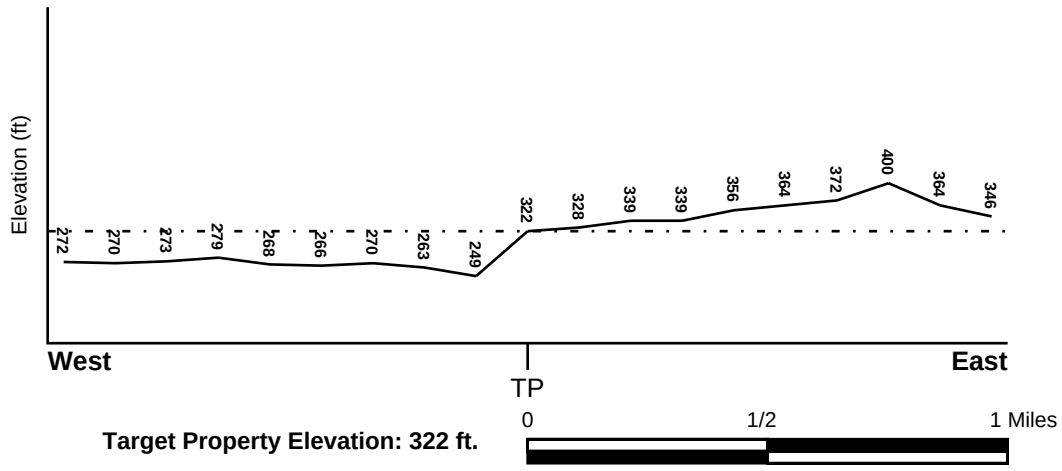

Target Property Elevation: 322 ft.

Source: Topography has been determined from the USGS 7.5' Digital Elevation Model and should be evaluated on a relative (not an absolute) basis. Relative elevation information between sites of close proximity should be field verified.

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

HYDROLOGIC INFORMATION

Surface water can act as a hydrologic barrier to groundwater flow. Such hydrologic information can be used to assist the environmental professional in forming an opinion about the impact of nearby contaminated properties or, should contamination exist on the target property, what downgradient sites might be impacted.

Refer to the Physical Setting Source Map following this summary for hydrologic information (major waterways and bodies of water).

FEMA FLOOD ZONE

Flood Plain Panel at Target Property	FEMA Source Type
05063C0195E	FEMA FIRM Flood data

Additional Panels in search area:	FEMA Source Type
Not Reported	

NATIONAL WETLAND INVENTORY

NWI Quad at Target Property	NWI Electronic Data Coverage
BATESVILLE	YES - refer to the Overview Map and Detail Map

HYDROGEOLOGIC INFORMATION

Hydrogeologic information obtained by installation of wells on a specific site can often be an indicator of groundwater flow direction in the immediate area. Such hydrogeologic information can be used to assist the environmental professional in forming an opinion about the impact of nearby contaminated properties or, should contamination exist on the target property, what downgradient sites might be impacted.

AQUIFLOW®

Search Radius: 1.000 Mile.

EDR has developed the AQUIFLOW Information System to provide data on the general direction of groundwater flow at specific points. EDR has reviewed reports submitted by environmental professionals to regulatory authorities at select sites and has extracted the date of the report, groundwater flow direction as determined hydrogeologically, and the depth to water table.

MAP ID	LOCATION FROM TP	GENERAL DIRECTION GROUNDWATER FLOW
Not Reported		

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

GROUNDWATER FLOW VELOCITY INFORMATION

Groundwater flow velocity information for a particular site is best determined by a qualified environmental professional using site specific geologic and soil strata data. If such data are not reasonably ascertainable, it may be necessary to rely on other sources of information, including geologic age identification, rock stratigraphic unit and soil characteristics data collected on nearby properties and regional soil information. In general, contaminant plumes move more quickly through sandy-gravelly types of soils than silty-clayey types of soils.

GEOLOGIC INFORMATION IN GENERAL AREA OF TARGET PROPERTY

Geologic information can be used by the environmental professional in forming an opinion about the relative speed at which contaminant migration may be occurring.

ROCK STRATIGRAPHIC UNIT

Era:	Paleozoic
System:	Mississippian
Series:	Chesterian Series
Code:	M3 *(decoded above as Era, System & Series)*

GEOLOGIC AGE IDENTIFICATION

Category: Stratified Sequence

Geologic Age and Rock Stratigraphic Unit Source: P.G. Schruben, R.E. Arndt and W.J. Bawiec, Geology of the Conterminous U.S. at 1:2,500,000 Scale - a digital representation of the 1974 P.B. King and H.M. Beikman Map, USGS Digital Data Series DDS - 11 (1994).

SSURGO SOIL MAP - 8101203.2s

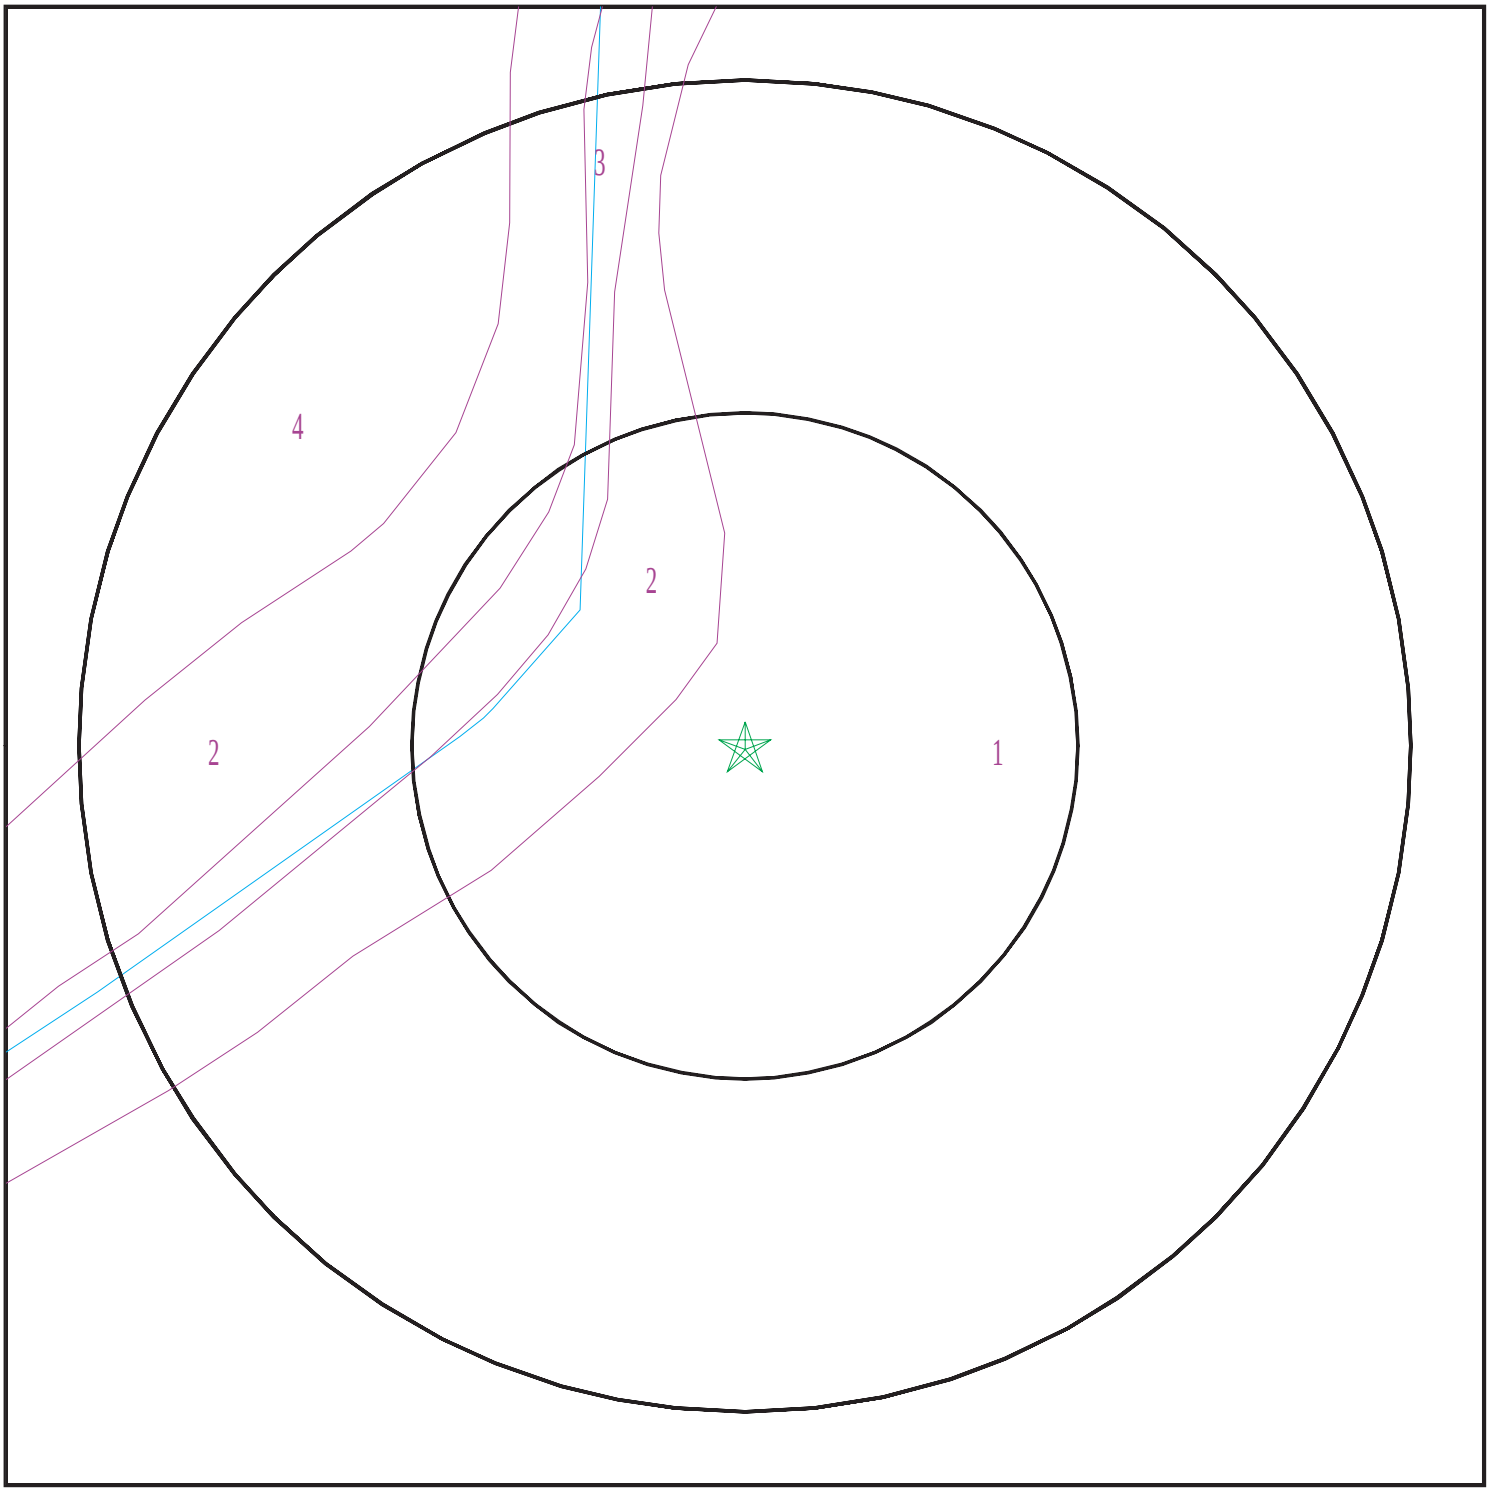

Target Property
SSURGO Soil
Water

0 1/16 1/8 1/4 Miles

N

SITE NAME:	Former Grays Hospital	CLIENT:	Tetra Tech EMI
ADDRESS:	477 East Main Street Batesville AR 72501	CONTACT:	Allie Cook
		INQUIRY #:	8101203.2s
LAT/LONG:	35.772488 / 91.650919	DATE:	September 08, 2025 1:12 pm

Copyright © 2025 EDR, Inc. © 2015 TomTom Rel. 2015.

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

DOMINANT SOIL COMPOSITION IN GENERAL AREA OF TARGET PROPERTY

The U.S. Department of Agriculture's (USDA) Soil Conservation Service (SCS) leads the National Cooperative Soil Survey (NCSS) and is responsible for collecting, storing, maintaining and distributing soil survey information for privately owned lands in the United States. A soil map in a soil survey is a representation of soil patterns in a landscape. The following information is based on Soil Conservation Service SSURGO data.

Soil Map ID: 1

Soil Component Name: Linker

Soil Surface Texture: gravelly fine sandy loam

Hydrologic Group: Class B - Moderate infiltration rates. Deep and moderately deep, moderately well and well drained soils with moderately coarse textures.

Soil Drainage Class: Well drained

Hydric Status: Not hydric

Corrosion Potential - Uncoated Steel: Low

Depth to Bedrock Min: > 77 inches

Depth to Watertable Min: > 0 inches

Soil Layer Information							
	Boundary			Classification		Saturated hydraulic conductivity micro m/sec	Soil Reaction (pH)
Layer	Upper	Lower	Soil Texture Class	AASHTO Group	Unified Soil		
1	0 inches	3 inches	gravelly fine sandy loam	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
2	3 inches	9 inches	gravelly fine sandy loam	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
3	9 inches	24 inches	gravelly loam	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	Not reported	Max: 1.4 Min: 0.42	Max: Min:

Soil Layer Information							
	Boundary			Classification		Saturated hydraulic conductivity micro m/sec	Soil Reaction (pH)
Layer	Upper	Lower	Soil Texture Class	AASHTO Group	Unified Soil		
4	24 inches	29 inches	gravelly sandy clay loam	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
5	29 inches	31 inches	unweathered bedrock	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	Not reported	Max: 1.4 Min: 0.42	Max: Min:

Soil Map ID: 2

Soil Component Name: Wideman

Soil Surface Texture: loamy fine sand

Hydrologic Group: Class A - High infiltration rates. Soils are deep, well drained to excessively drained sands and gravels.

Soil Drainage Class: Excessively drained

Hydric Status: Partially hydric

Corrosion Potential - Uncoated Steel: Low

Depth to Bedrock Min: > 0 inches

Depth to Watertable Min: > 0 inches

Soil Layer Information							
	Boundary			Classification		Saturated hydraulic conductivity micro m/sec	Soil Reaction (pH)
Layer	Upper	Lower	Soil Texture Class	AASHTO Group	Unified Soil		
1	0 inches	9 inches	loamy fine sand	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	COARSE-GRAINED SOILS, Sands, Sands with fines, Silty Sand.	Max: 42 Min: 14	Max: 7.3 Min: 5.1

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

Soil Layer Information							
	Boundary			Classification		Saturated hydraulic conductivity micro m/sec	Soil Reaction (pH)
Layer	Upper	Lower	Soil Texture Class	AASHTO Group	Unified Soil		
2	9 inches	40 inches	loamy fine sand	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	COARSE-GRAINED SOILS, Sands, Sands with fines, Silty Sand.	Max: 42 Min: 14	Max: 7.3 Min: 5.1
3	40 inches	44 inches	fine sandy loam	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	COARSE-GRAINED SOILS, Sands, Sands with fines, Silty Sand.	Max: 42 Min: 14	Max: 7.3 Min: 5.1
4	44 inches	64 inches	fine sand	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	COARSE-GRAINED SOILS, Sands, Sands with fines, Silty Sand.	Max: 42 Min: 14	Max: 7.3 Min: 5.1
5	64 inches	72 inches	loamy fine sand	Granular materials (35 pct. or less passing No. 200), Silty, or Clayey Gravel and Sand.	COARSE-GRAINED SOILS, Sands, Sands with fines, Silty Sand.	Max: 42 Min: 14	Max: 7.3 Min: 5.1

Soil Map ID: 3

Soil Component Name: Water

Soil Surface Texture: loamy fine sand

Hydrologic Group: Class A - High infiltration rates. Soils are deep, well drained to excessively drained sands and gravels.

Soil Drainage Class:
Hydric Status: Unknown

Corrosion Potential - Uncoated Steel: Not Reported

Depth to Bedrock Min: > 0 inches

Depth to Watertable Min: > 0 inches

No Layer Information available.

Soil Map ID: 4

Soil Component Name: Linker

Soil Surface Texture: fine sandy loam

Hydrologic Group: Class B - Moderate infiltration rates. Deep and moderately deep, moderately well and well drained soils with moderately coarse textures.

Soil Drainage Class: Well drained

Hydric Status: Not hydric

Corrosion Potential - Uncoated Steel: Low

Depth to Bedrock Min: > 77 inches

Depth to Watertable Min: > 0 inches

Soil Layer Information

	Boundary			Classification		Saturated hydraulic conductivity micro m/sec	Soil Reaction (pH)
Layer	Upper	Lower	Soil Texture Class	AASHTO Group	Unified Soil		
1	0 inches	5 inches	fine sandy loam	Silt-Clay Materials (more than 35 pct. passing No. 200), Silty Soils.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
2	5 inches	9 inches	gravelly loam	Silt-Clay Materials (more than 35 pct. passing No. 200), Silty Soils.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
3	9 inches	24 inches	gravelly loam	Silt-Clay Materials (more than 35 pct. passing No. 200), Silty Soils.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
4	24 inches	29 inches	gravelly sandy clay loam	Silt-Clay Materials (more than 35 pct. passing No. 200), Silty Soils.	Not reported	Max: 1.4 Min: 0.42	Max: Min:
5	29 inches	31 inches	unweathered bedrock	Silt-Clay Materials (more than 35 pct. passing No. 200), Silty Soils.	Not reported	Max: 1.4 Min: 0.42	Max: Min:

GEOCHECK® - PHYSICAL SETTING SOURCE SUMMARY

LOCAL / REGIONAL WATER AGENCY RECORDS

EDR Local/Regional Water Agency records provide water well information to assist the environmental professional in assessing sources that may impact ground water flow direction, and in forming an opinion about the impact of contaminant migration on nearby drinking water wells.

WELL SEARCH DISTANCE INFORMATION

DATABASE	SEARCH DISTANCE (miles)
Federal USGS	1.000
Federal FRDS PWS	Nearest PWS within 1 mile
State Database	1.000

FEDERAL USGS WELL INFORMATION

MAP ID	WELL ID	LOCATION FROM TP
No Wells Found		

FEDERAL FRDS PUBLIC WATER SUPPLY SYSTEM INFORMATION

MAP ID	WELL ID	LOCATION FROM TP
1	ARN000008	1/2 - 1 Mile ESE

Note: PWS System location is not always the same as well location.

STATE DATABASE WELL INFORMATION

MAP ID	WELL ID	LOCATION FROM TP
No Wells Found		

PHYSICAL SETTING SOURCE MAP - 8101203.2s

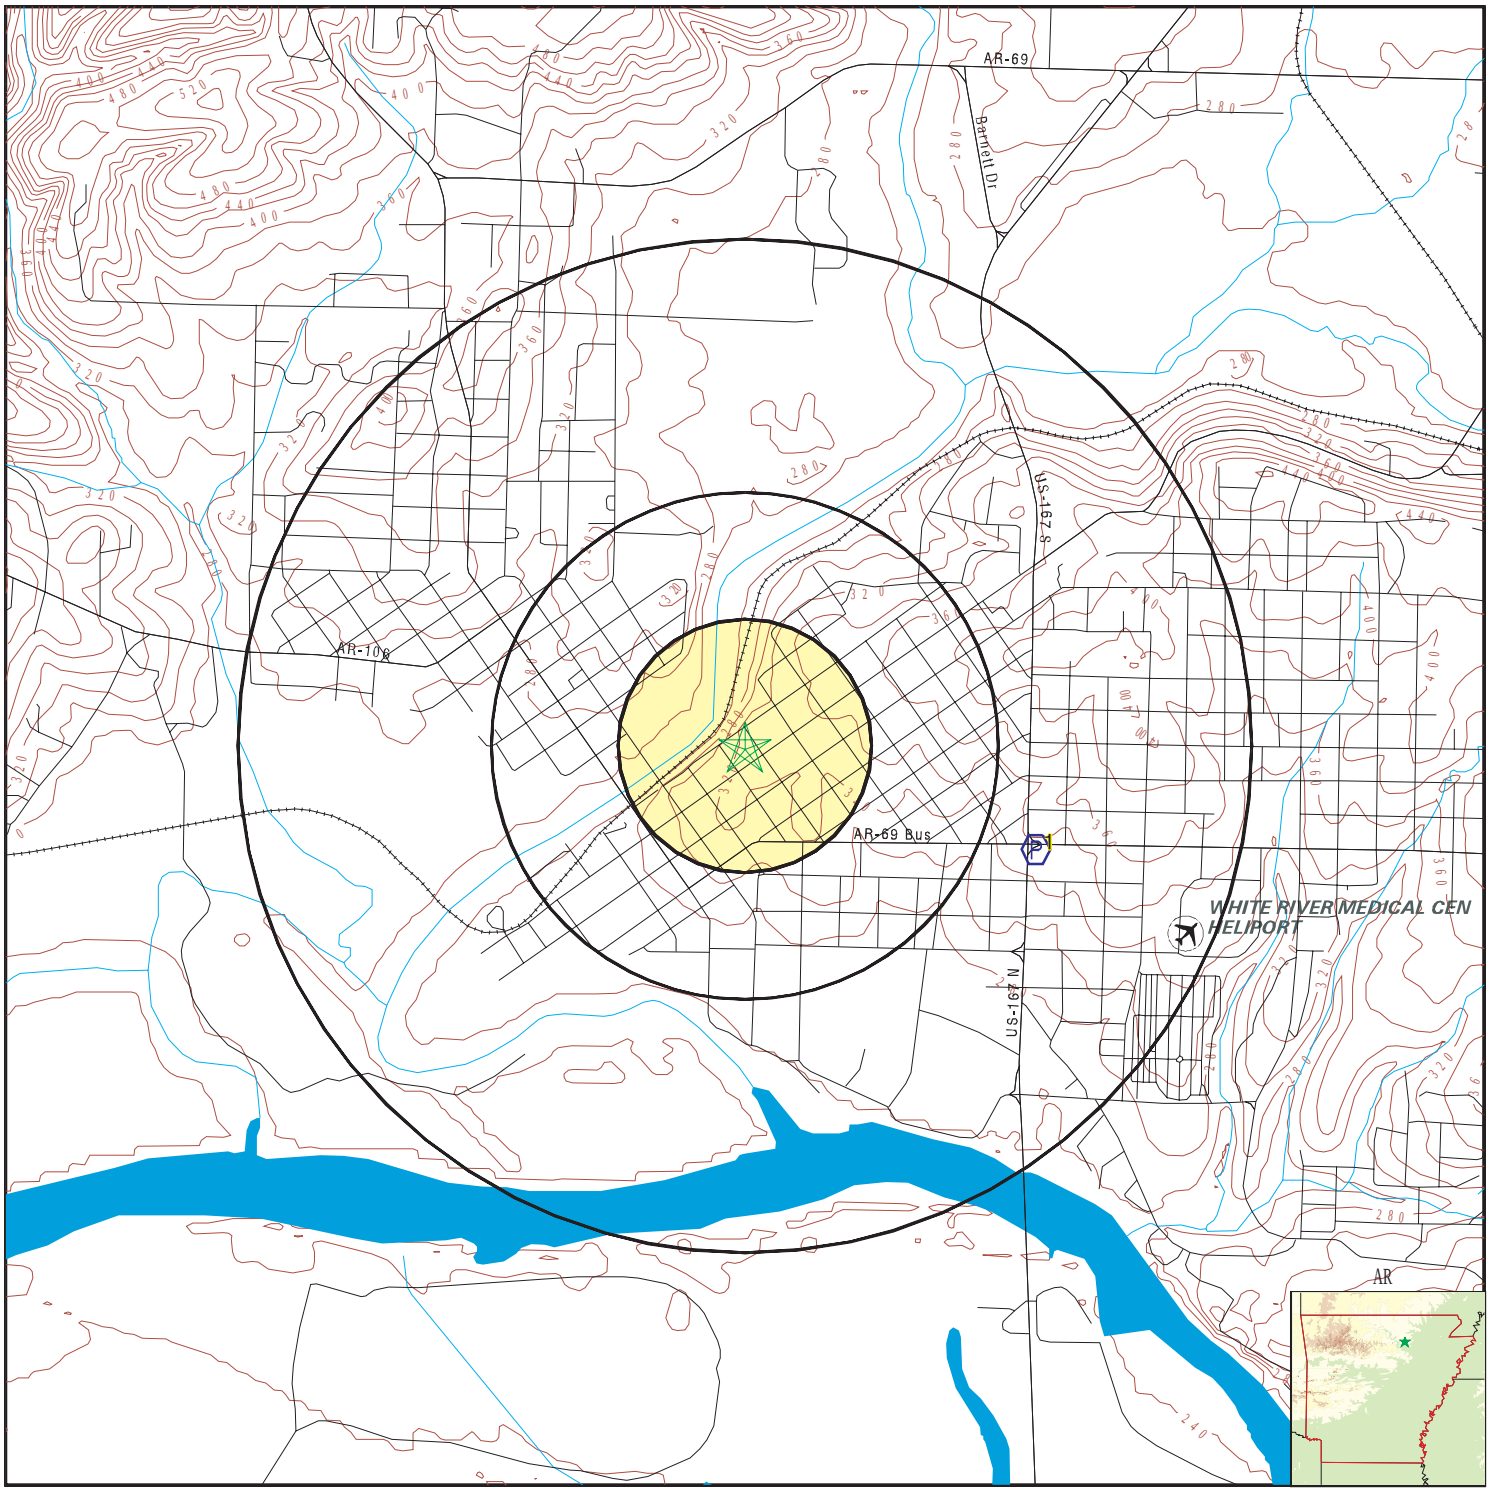

County Boundary
Major Roads
Contour Lines
Airports
Earthquake epicenter, Richter 5 or greater
Water Wells
Public Water Supply Wells
Cluster of Multiple Icons

0 1/4 1/2 1 Miles

Groundwater Flow Direction
GI Indeterminate Groundwater Flow at Location
GV Groundwater Flow Varies at Location
HD Closest Hydrogeological Data
Oil, gas or related wells

N

SITE NAME:	Former Grays Hospital	CLIENT:	Tetra Tech EMI
ADDRESS:	477 East Main Street Batesville AR 72501	CONTACT:	Allie Cook
		INQUIRY #:	8101203.2s
LAT/LONG:	35.772488 / 91.650919	DATE:	September 08, 2025 1:12 pm

Copyright © 2025 EDR, Inc. © 2015 TomTom Rel. 2015.

GEOCHECK® - PHYSICAL SETTING SOURCE MAP FINDINGS

Map ID
Direction
Distance
Elevation | Database | EDR ID Number

1
ESE
1/2 - 1 Mile
Higher | **FRDS PWS** | **ARN000008**

Epa region:	06	State:	AR
Pwsid:	ARN000008	Pwsname:	ARK EASTMAN CO
Cityserved:	Not Reported	Stateserved:	AR
Zipserved:	Not Reported	Fipscounty:	05063
Status:	Closed	Retpopsrvd:	25
Pwssvcconn:	1	Psource longname:	Groundwater
Pwstype:	NTNCWS	Owner:	Local_Govt
Contact:	Not Reported	Contactorgname:	Not Reported
Contactphone:	501- -	Contactaddress1:	Not Reported
Contactaddress2:	Not Reported	Contactcity:	BATESVILLE
Contactstate:	AR	Contactzip:	72501
Pwsactivitycode:	I		
PWS ID:	ARN000008	PWS type:	Not Reported
PWS name:	Not Reported	PWS address:	Not Reported
PWS city:	Not Reported	PWS state:	Not Reported
PWS zip:	Not Reported	PWS ID:	ARN000008
Activity status:	Active	Date system activated:	7706
Date system deactivated:	Not Reported	Retail population:	00000025
System name:	ARK EASTMAN CO	System address:	Not Reported
System address:	P. O. BOX 2357	System city:	BATESVILLE
System state:	AR	System zip:	72501
Population served:	Under 101 Persons	Treatment:	Treated
Latitude:	354610	Longitude:	0913826

GEOCHECK® - PHYSICAL SETTING SOURCE MAP FINDINGS
RADON

AREA RADON INFORMATION

State Database: AR Radon

Radon Test Results

Total Meas	Mean	Geom mean	Median	Std Dev	Max	% Sites>4 pCi/L	% Sites>20 pCi/L
22	1.4	0.8	1.1	1.5	5.9	9	0

Federal EPA Radon Zone for INDEPENDENCE County: 2

Note: Zone 1 indoor average level > 4 pCi/L.
: Zone 2 indoor average level >= 2 pCi/L and <= 4 pCi/L.
: Zone 3 indoor average level < 2 pCi/L.

Federal Area Radon Information for Zip Code: 72501

Number of sites tested: 15

Area	Average Activity	% <4 pCi/L	% 4-20 pCi/L	% >20 pCi/L
Living Area - 1st Floor	1.293 pCi/L	93%	7%	0%
Living Area - 2nd Floor	Not Reported	Not Reported	Not Reported	Not Reported
Basement	1.500 pCi/L	100%	0%	0%

PHYSICAL SETTING SOURCE RECORDS SEARCHED

TOPOGRAPHIC INFORMATION

USGS 7.5' Digital Elevation Model (DEM)
Source: United States Geologic Survey
EDR acquired the USGS 7.5' Digital Elevation Model in 2002 and updated it in 2006. The 7.5 minute DEM corresponds to the USGS 1:24,000- and 1:25,000-scale topographic quadrangle maps. The DEM provides elevation data with consistent elevation units and projection.

Current USGS 7.5 Minute Topographic Map
Source: U.S. Geological Survey

HYDROLOGIC INFORMATION

Flood Zone Data: This data was obtained from the Federal Emergency Management Agency (FEMA). It depicts 100-year and 500-year flood zones as defined by FEMA. It includes the National Flood Hazard Layer (NFHL) which incorporates Flood Insurance Rate Map (FIRM) data and Q3 data from FEMA in areas not covered by NFHL.
Source: FEMA
Telephone: 877-336-2627
Date of Government Version: 2003, 2015

NWI: National Wetlands Inventory. This data, available in select counties across the country, was obtained by EDR in 2002, 2005, 2010 and 2015 from the U.S. Fish and Wildlife Service.

State Wetlands Data: Wetland Inventory
Source: US Fish & Wildlife Service
Telephone: 703-358-2171

HYDROGEOLOGIC INFORMATION

AQUIFLOW^{R} Information System
Source: EDR proprietary database of groundwater flow information
EDR has developed the AQUIFLOW Information System (AIS) to provide data on the general direction of groundwater flow at specific points. EDR has reviewed reports submitted to regulatory authorities at select sites and has extracted the date of the report, hydrogeologically determined groundwater flow direction and depth to water table information.

GEOLOGIC INFORMATION

Geologic Age and Rock Stratigraphic Unit
Source: P.G. Schruben, R.E. Arndt and W.J. Bawiec, Geology of the Conterminous U.S. at 1:2,500,000 Scale - A digital representation of the 1974 P.B. King and H.M. Beikman Map, USGS Digital Data Series DDS - 11 (1994).

STATSGO: State Soil Geographic Database
Source: Department of Agriculture, Natural Resources Conservation Service (NRCS)
The U.S. Department of Agriculture's (USDA) Natural Resources Conservation Service (NRCS) leads the national Conservation Soil Survey (NCSS) and is responsible for collecting, storing, maintaining and distributing soil survey information for privately owned lands in the United States. A soil map in a soil survey is a representation of soil patterns in a landscape. Soil maps for STATSGO are compiled by generalizing more detailed (SSURGO) soil survey maps.

SSURGO: Soil Survey Geographic Database
Source: Department of Agriculture, Natural Resources Conservation Service (NRCS)
Telephone: 800-672-5559
SSURGO is the most detailed level of mapping done by the Natural Resources Conservation Service, mapping scales generally range from 1:12,000 to 1:63,360. Field mapping methods using national standards are used to construct the soil maps in the Soil Survey Geographic (SSURGO) database. SSURGO digitizing duplicates the original soil survey maps. This level of mapping is designed for use by landowners, townships and county natural resource planning and management.

PHYSICAL SETTING SOURCE RECORDS SEARCHED

LOCAL / REGIONAL WATER AGENCY RECORDS

FEDERAL WATER WELLS

PWS: Public Water Systems
Source: EPA/Office of Drinking Water
Telephone: 202-564-3750
Public Water System data from the Federal Reporting Data System. A PWS is any water system which provides water to at least 25 people for at least 60 days annually. PWSs provide water from wells, rivers and other sources.

PWS ENF: Public Water Systems Violation and Enforcement Data
Source: EPA/Office of Drinking Water
Telephone: 202-564-3750
Violation and Enforcement data for Public Water Systems from the Safe Drinking Water Information System (SDWIS) after August 1995. Prior to August 1995, the data came from the Federal Reporting Data System (FRDS).

USGS Water Wells: USGS National Water Inventory System (NWIS)
This database contains descriptive information on sites where the USGS collects or has collected data on surface water and/or groundwater. The groundwater data includes information on wells, springs, and other sources of groundwater.

STATE RECORDS

Arkansas Community Public Water Systems
Source: Health Department
Telephone: 501-661-2623

OTHER STATE DATABASE INFORMATION

Oil and Gas Well Database
Source: Arkansas Geographic Information Office
Telephone: 501-682-2929
Oil and gas well locations.

RADON

State Database: AR Radon
Source: Department of Health
Telephone: 501-661-2301
Radon Test Results

Area Radon Information
Source: USGS
Telephone: 703-356-4020
The National Radon Database has been developed by the U.S. Environmental Protection Agency (USEPA) and is a compilation of the EPA/State Residential Radon Survey and the National Residential Radon Survey. The study covers the years 1986 - 1992. Where necessary data has been supplemented by information collected at private sources such as universities and research institutions.

EPA Radon Zones
Source: EPA
Telephone: 703-356-4020
Sections 307 & 309 of IRAA directed EPA to list and identify areas of U.S. with the potential for elevated indoor radon levels.

OTHER

Airport Landing Facilities: Private and public use landing facilities
Source: Federal Aviation Administration, 800-457-6656

Epicenters: World earthquake epicenters, Richter 5 or greater
Source: Department of Commerce, National Oceanic and Atmospheric Administration

Earthquake Fault Lines: The fault lines displayed on EDR's Topographic map are digitized quaternary faultlines, prepared in 1975 by the United State Geological Survey

PHYSICAL SETTING SOURCE RECORDS SEARCHED

STREET AND ADDRESS INFORMATION

© 2015 TomTom North America, Inc. All rights reserved. This material is proprietary and the subject of copyright protection and other intellectual property rights owned by or licensed to Tele Atlas North America, Inc. The use of this material is subject to the terms of a license agreement. You will be held liable for any unauthorized copying or disclosure of this material.

APPENDIX E REGULATORY FILE REVIEW DOCUMENTATION

Former Grays Hospital
477 East Main Street
Batesville, Arkansas 72501

Inquiry Number: 8101203.7
September 10, 2025

EDR Environmental Lien and AUL Search

6 Armstrong Road, 4th floor
Shelton, CT 06484
Toll Free: 800.352.0050
www.edrnet.com

EDR Environmental Lien and AUL Search

The EDR Environmental LienSearch Report provides results from a search of available current land title records for environmental cleanup liens and other activity and use limitations (AULs), such as engineering controls and institutional controls.

A network of professional, trained researchers, following established procedures, uses client supplied address information to:

- search for parcel number and/or legal description
- search for current ownership information
- research official land title documents recorded at jurisdictional agencies such as recorders' offices, registries of deeds, county clerks' offices, etc.
- search for publicly available environmental encumbering instrument(s) filed on or after the recording of the current deed; between the recording of the current deed and the most current publicly available date
- provide a copy of any environmental encumbrance(s)
- provide a copy of the current deed when available

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC and The FOX Group, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA), ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT. Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2025 by Environmental Data Resources, LLC. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, LLC, or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

EDR Environmental Lien and AUL Search

ADDRESS

FORMER GRAYS HOSPITAL
477 EAST MAIN STREET
BATESVILLE, ARKANSAS 72501

RESEARCH SOURCE

Source 1: Independence Recorder
Independence County, Arkansas

Source 2: Independence Assessor
Independence County, Arkansas

PROPERTY INFORMATION

Deed 1:

Type of Deed:	Warranty Deed
Title is vested in:	Markowski Investment Holdings, LLC
Title received from:	Preferred Family Healthcare, Inc.
Deed Dated:	August 10, 2022
Deed Recorded:	August 12, 2022
Book:	2022
Page:	5082

Legal Description:	**See Legal**
Legal Current Owner:	**Markowski Investment Holdings, LLC**
Property Identifiers:	**1100657001C**

EDR Environmental Lien and AUL Search

ENVIRONMENTAL LIEN

Environmental Lien: Found ☐ Not Found ☒

OTHER ACTIVITY AND USE LIMITATIONS (AULs)

Other AUL's: Found ☐ Not Found ☒

DEED EXHIBIT A

Documents provided by DataTree LLC via it's proprietary imaging and delivery system. Copyright 2003, All rights reserved.

L202205027
INDEPENDENCE CO. AR FEE
PRESENTED & RECORDED
08/12/2022 08:03:27
GREG WALLIS
CIRCUIT CLERK
BY: MIKE NEAL
DEPUTY CLERK
BK: DEED 2022
PG: 5082 - 5085

After recording please return to:
Waco Title Company
2592 S. 48th St.
Springdale, AR 72762

WARRANTY DEED
(CORPORATION)

File #: **2208358-106**

KNOW ALL MEN BY THESE PRESENTS:

That, **PREFERRED FAMILY HEALTHCARE, INC., successor in interest by merger with Alternative Opportunities, Inc., successor in interest by merger with Health Resources of Arkansas, Inc., being previously known as North Arkansas Human Services Systems, Inc.,** a corporation organized under and by virtue of the laws of the State of Missouri, hereinafter called GRANTOR, by its undersigned officer(s), duly authorized by proper resolution of its Board of Directors, for and in consideration of the sum of ---ONE AND 00/100--- DOLLARS---($1.00)---and other good and valuable consideration, in hand paid by **Markowski Investment Holdings, LLC, an Arkansas limited liability company,** hereinafter called GRANTEE(S), does hereby grant, bargain, sell and convey unto GRANTEE(S), and unto its successors and assigns forever, the following described land, situated in **Independence** County, **Arkansas** to-wit:

SEE ATTACHED EXHIBIT "A"

TO HAVE AND TO HOLD the said lands and appurtenances unto the said Grantee(s) and unto its successors and assigns forever. And said corporation hereby covenants with said Grantee(s) that it is lawfully seized of said land and premises, that the same is unencumbered, and that it will forever warrant and defend the title to the said lands against all claims whatsoever.

Prepared under the supervision of
Buckley Bridges, Attorney
2592 S. 48th St.
Springdale, AR. 72762

Documents provided by DataTree LLC via it's proprietary imaging and delivery system. Copyright 2003, All rights reserved.

IN TESTIMONY WHEREOF, The name of the grantor is hereunto affixed by its undersigned officer(s) and its seal affixed this 10 **day of August, 2022.**

I certify under penalty of false swearing that documentary stamps or a documentary symbol in the legally correct amount has been placed on this instrument.

GRANTEE OR AGENT: Waco Title as Agent

GRANTEE'S ADDRESS: 3001 Harrison St.

Batesville, AR 72501

Preferred Family Healthcare, Inc.,
a Missouri not-for profit corporation

By: _____
Tom Weber, CFO

ACKNOWLEDGMENT

STATE OF _____)
) SS.
COUNTY OF_____)

On this day, before the undersigned, a Notary Public, duly commissioned, qualified and acting, within and for the said County and State, appeared in person the within named **Tom Weber** to me personally known (or satisfactorily proven) to be the person whose name is subscribed to the foregoing instrument, who stated that he/she is the CFO, of Preferred Family Healthcare, Inc. a Missouri not-for profit corporation, , and is duly authorized in his/her capacity to execute the foregoing instrument for and in the name and behalf of said corporation, and further stated and acknowledged that he/she had so signed, executed and delivered said instrument for the consideration, uses and purposes therein mentioned and set forth.

IN TESTIMONY WHEREOF, I have hereunto set my hand and official seal this 10th day of August, 2022.

_____
Notary Public

My commission expires:

3/27/2023

ALICIA DAWN SAYRE
Notary Public, Notary Seal
State of Missouri
Greene County
Commission # 19222395
My Commission Expires 03-27-2023

Documents provided by DataTree LLC via it's proprietary imaging and delivery system. Copyright 2003, All rights reserved.

EXHIBIT "A"

Tract 1:

A part of Block 21 of Old Town Addition in the City of Batesville, Arkansas, described as follows: Beginning at the nominal Northwest Corner of said Block 21; thence North 53 degrees 48 minutes 00 seconds East along the South right-of-way line of Water Street a distance of 115 feet to the Point of Beginning of this tract; thence North 53 degrees 48 minutes 00 seconds East a distance of 165 feet to the Northeast corner of Block 21; thence South 36 degrees 00 minutes 00 seconds East a distance of 93 feet; thence South 53 degrees 48 minutes 00 seconds West a distance of 110 feet; thence South 36 degrees 00 minutes 00 seconds East a distance of 210 feet to the North right-of-way line of Main Street; thence South 53 degrees 48 minutes 00 seconds West a distance of 57 feet; thence North 36 degrees 00 minutes 00 seconds West a distance of 190 feet; thence North 53 degrees 48 minutes 00 seconds East a distance of 2 feet; thence North 36 degrees 00 minutes 00 seconds West a distance of 110 feet to the Point of Beginning.

Tract 2:

A tract of land being all of Lot Five (5) and a part of Lots Three (3), Four (4) and Six (6) of Block Twenty-One (21) of the Old Town Subdivision, Batesville, Independence County, Arkansas, and more particularly described as follows: Beginning at the intersection of the Northwest line of Main Street and the Southwest line of the Fifth Street, said point also being the Southeast Corner of said Lot Five; thence North 36 degrees West along the Southwest right-of way line of Fifth Street a distance of 207.00 feet; thence South 53 degrees 48 minutes West a distance of 110.00 feet; thence South 36 degrees East a distance of 207.00 feet to a point on the Northwest R/W line of Main Street; thence North 53 degrees 48 minutes East along said Northwest R/W line a distance of 110.00 feet to the Point of Beginning.

Subject to easements, rights-of-way, and protective covenants of record, if any.
Subject to all prior mineral reservations and oil and gas leases.

Documents provided by DataTree LLC via it's proprietary imaging and delivery system. Copyright 2003, All rights reserved.

0-L1333897424 atL005

STATE OF ARKANSAS
DEPARTMENT OF FINANCE AND ADMINISTRATION
MISCELLANEOUS TAX SECTION
P.O. BOX 896, LITTLE ROCK, AR 72203-0896

Real Estate Transfer Tax Stamp

Proof of Tax Paid

File Number: 2208358-106

Grantee:	MARKOWSKI INVESTMENT HOLDINGS, LLC
Mailing Address:	3001 HARRISON ST BATESVILLE AR 725010000
Grantor:	PREFERRED FAMILY HEALTHCARE, INC.
Mailing Address:	2885 W. BATTLEFIELD SPRINGFIELD MO 656190000
Property Purchase Price:	$50,000.00
Tax Amount:	$165.00
County:	INDEPENDENCE
Date Issued:	08/12/2022
Stamp ID:	335910912

I certify under penalty of false swearing that documentary stamps or a documentary symbol in the legally correct amount has been placed on this instrument

Grantee or Agent Name (printed): Markowski Investment Holdings LLC

Grantee or Agent Name (signature): Waco Title as Agent/BSheyWdd Date: 8/12/22

Address: 3001 Harrison Street

City/State/Zip: Batesville, AR 72501

APPENDIX F HISTORICAL REVIEW DOCUMENTATION

Former Grays Hospital

477 East Main Street

Batesville, AR 72501

Inquiry Number: 8101203.11

September 09, 2025

The EDR Aerial Photo Decade Package

6 Armstrong Road, 4th floor
Shelton, CT 06484
Toll Free: 800.352.0050
www.edrnet.com

EDR Aerial Photo Decade Package

09/09/25

Site Name:

Former Grays Hospital
477 East Main Street
Batesville, AR 72501
EDR Inquiry # 8101203.11

Client Name:

Tetra Tech EMI
415 Oak Street
Kansas City, MO 64106
Contact: Allie Cook

Environmental Data Resources, Inc. (EDR) Aerial Photo Decade Package is a screening tool designed to assist environmental professionals in evaluating potential liability on a target property resulting from past activities. EDR's professional researchers provide digitally reproduced historical aerial photographs, and when available, provide one photo per decade.

Search Results:

Year	*Scale*	*Details*	*Source*
2023	1"=500'	Flight Year: 2023	USDA/NAIP
2019	1"=500'	Flight Year: 2019	USDA/NAIP
2015	1"=500'	Flight Year: 2015	USDA/NAIP
2010	1"=500'	Flight Year: 2010	USDA/NAIP
2006	1"=500'	Flight Year: 2006	USDA/NAIP
2001	1"=500'	Flight Year: 2001	USGS/DOQQ
1994	1"=500'	Acquisition Date: March 03, 1994	USGS/DOQQ
1986	1"=500'	Flight Date: March 01, 1986	USGS
1984	1"=500'	Flight Date: April 06, 1984	USGS
1979	1"=500'	Flight Date: April 05, 1979	USGS
1942	1"=500'	Flight Date: February 13, 1942	USGS

When delivered electronically by EDR, the aerial photo images included with this report are for ONE TIME USE ONLY. Further reproduction of these aerial photo images is prohibited without permission from EDR. For more information contact your EDR Account Executive.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA), ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT.

Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2025 by Environmental Data Resources, Inc. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, Inc., or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

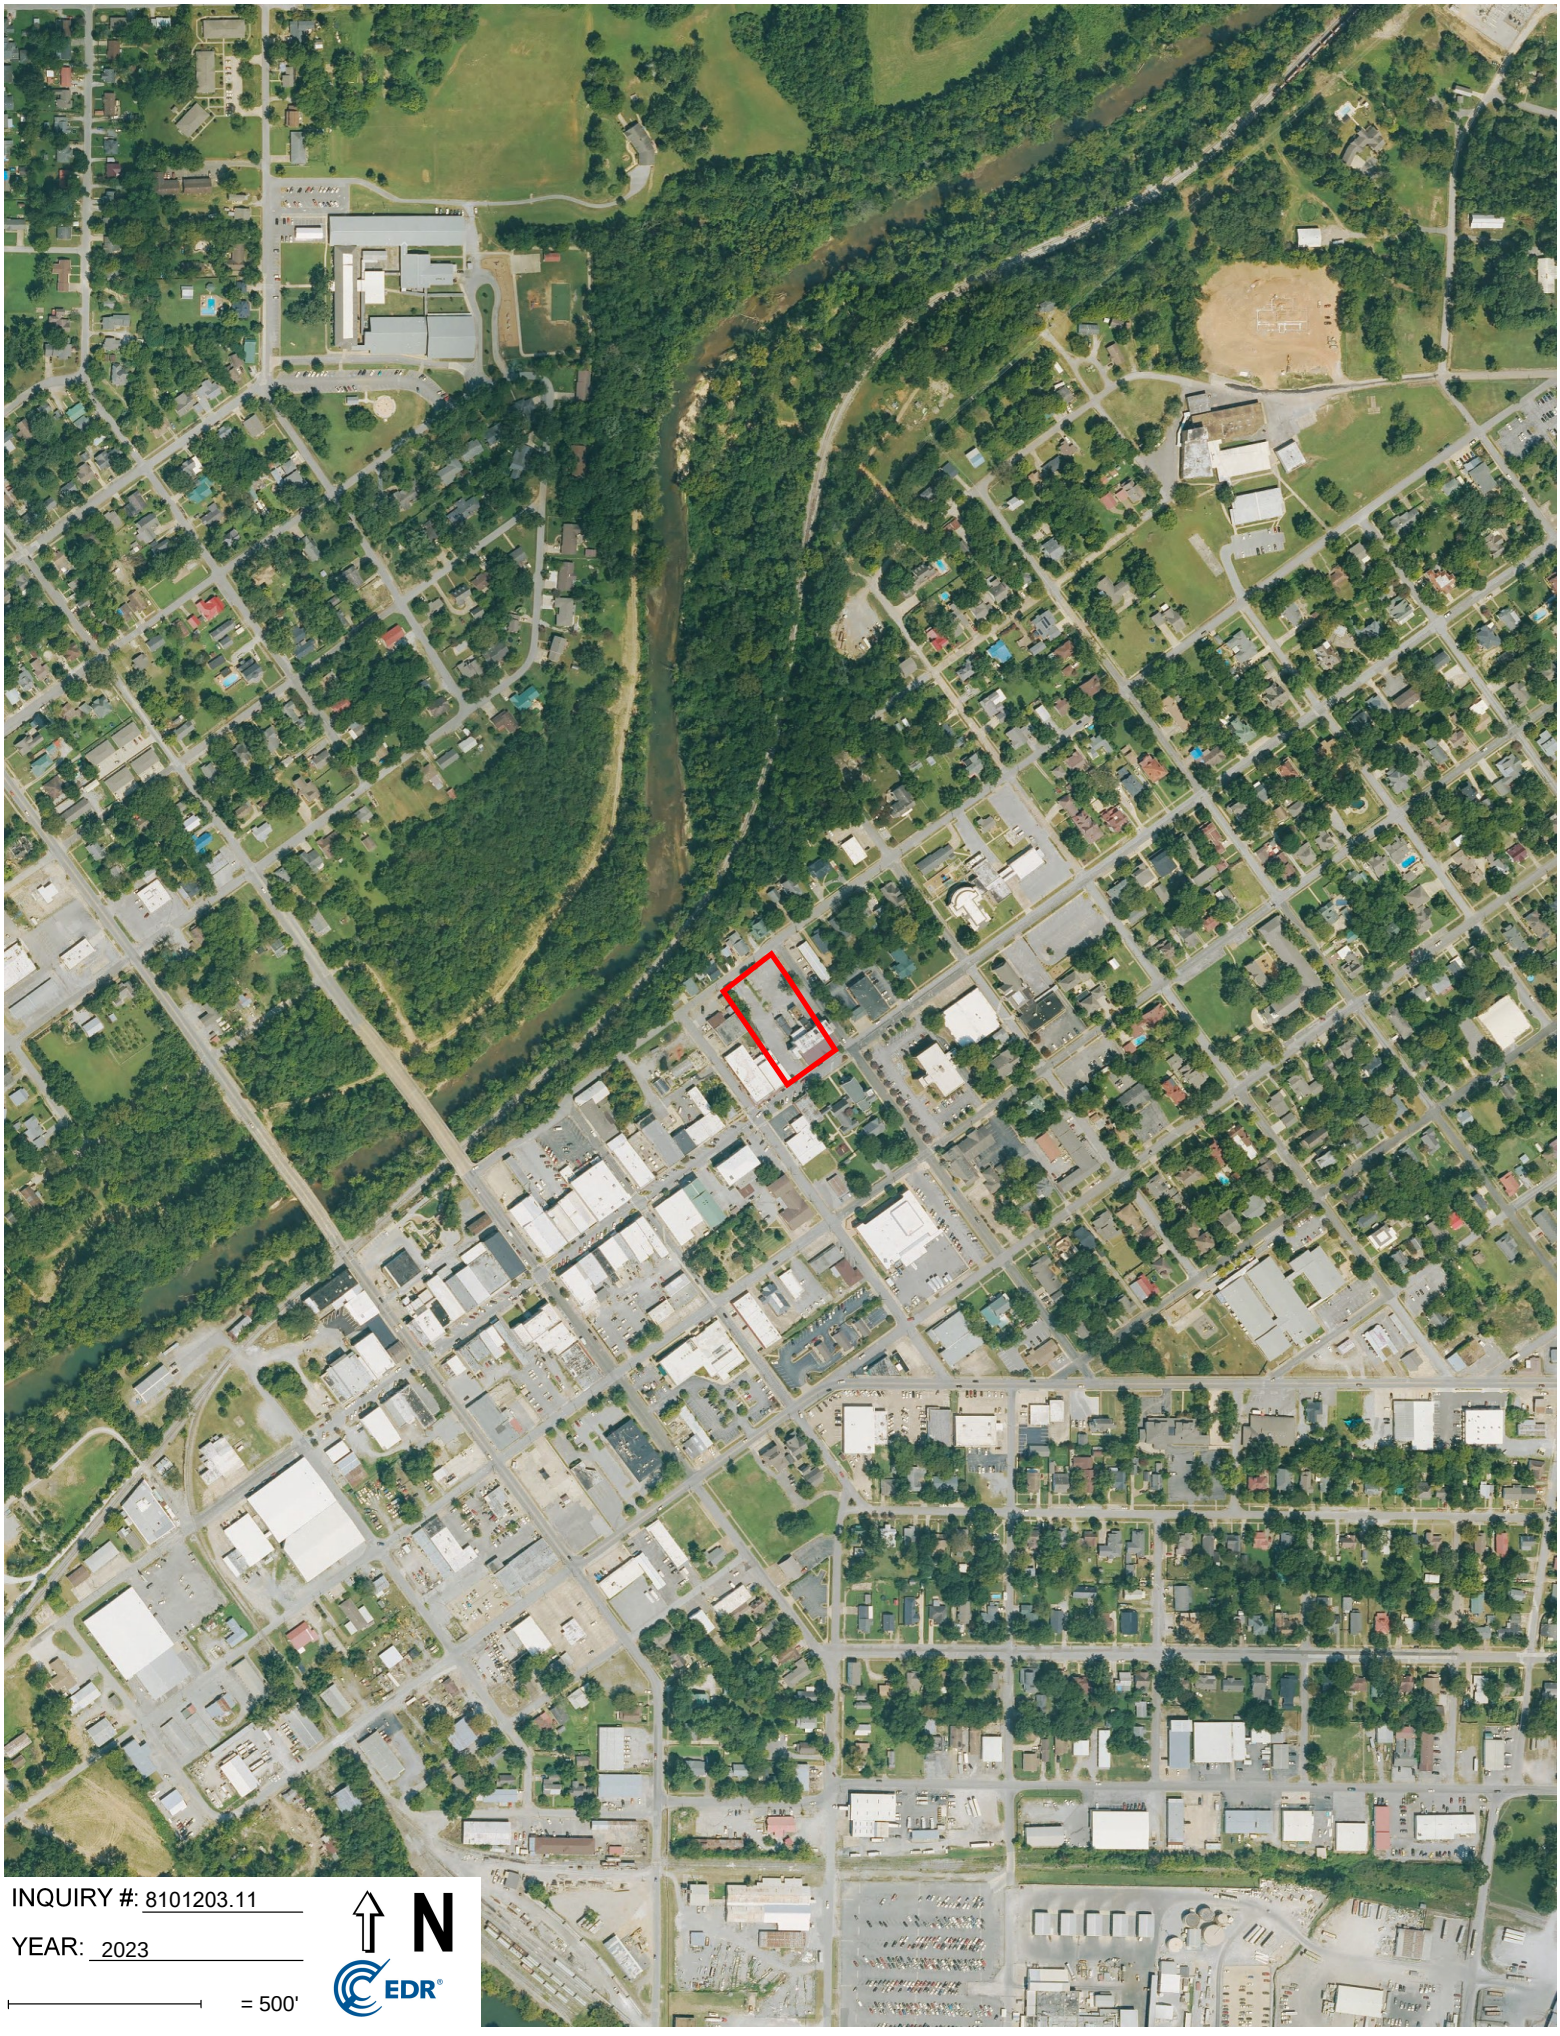
INQUIRY #: 8101203.11
YEAR: 2023
= 500'
N
EDR

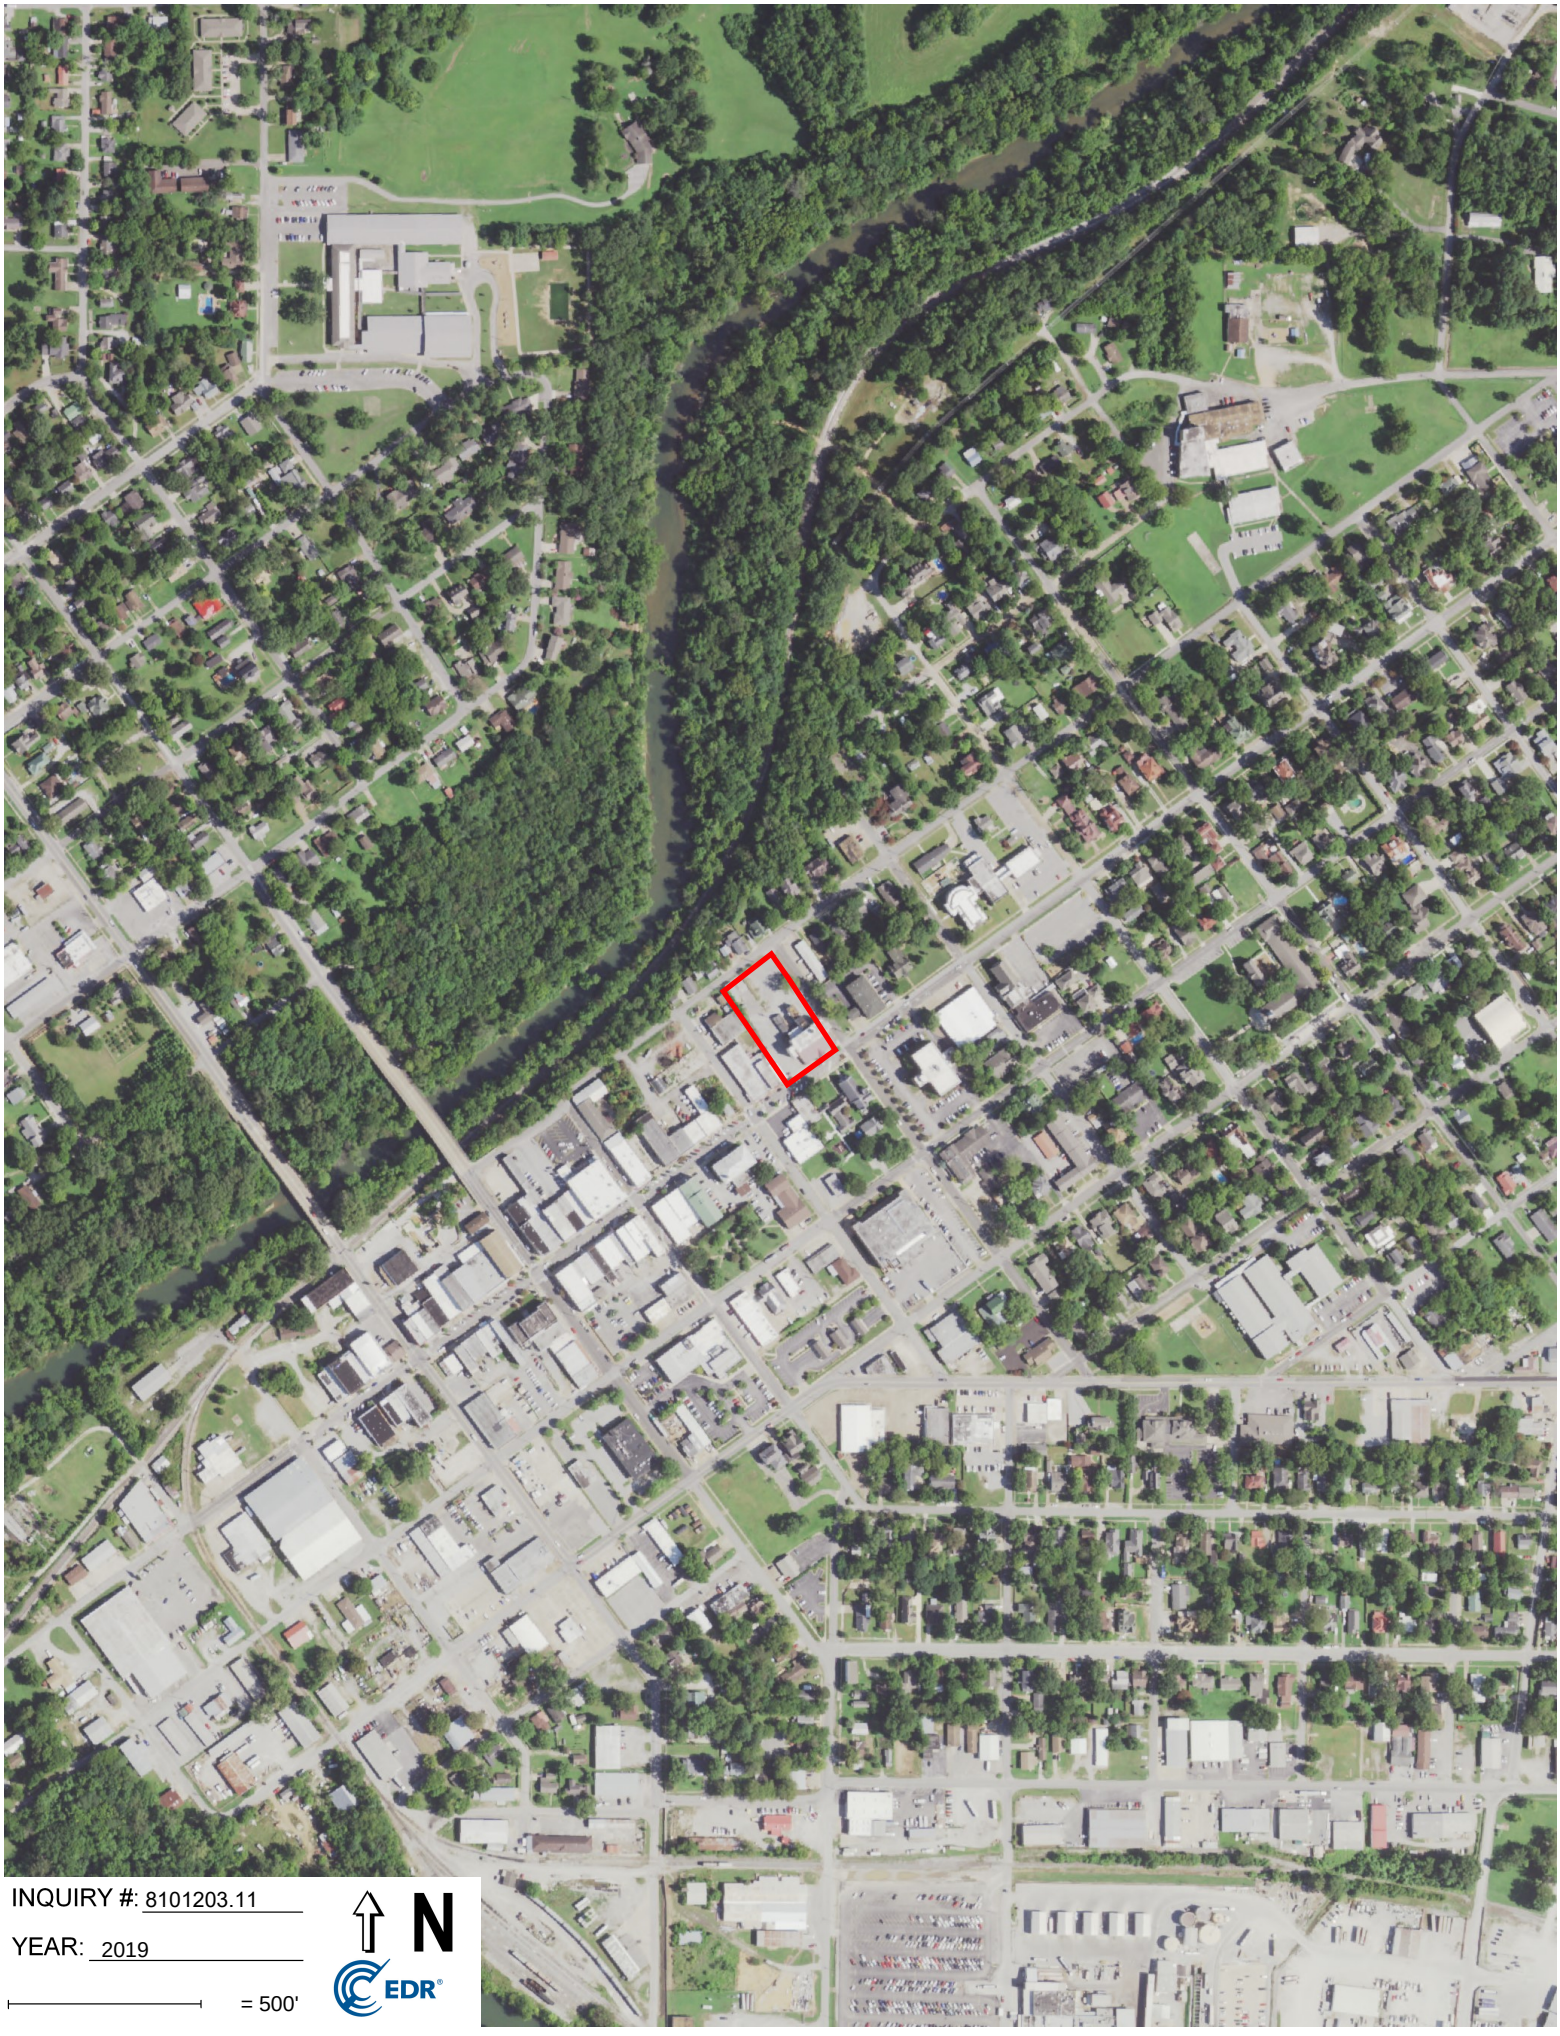
INQUIRY #: 8101203.11
YEAR: 2019
= 500'
N
EDR

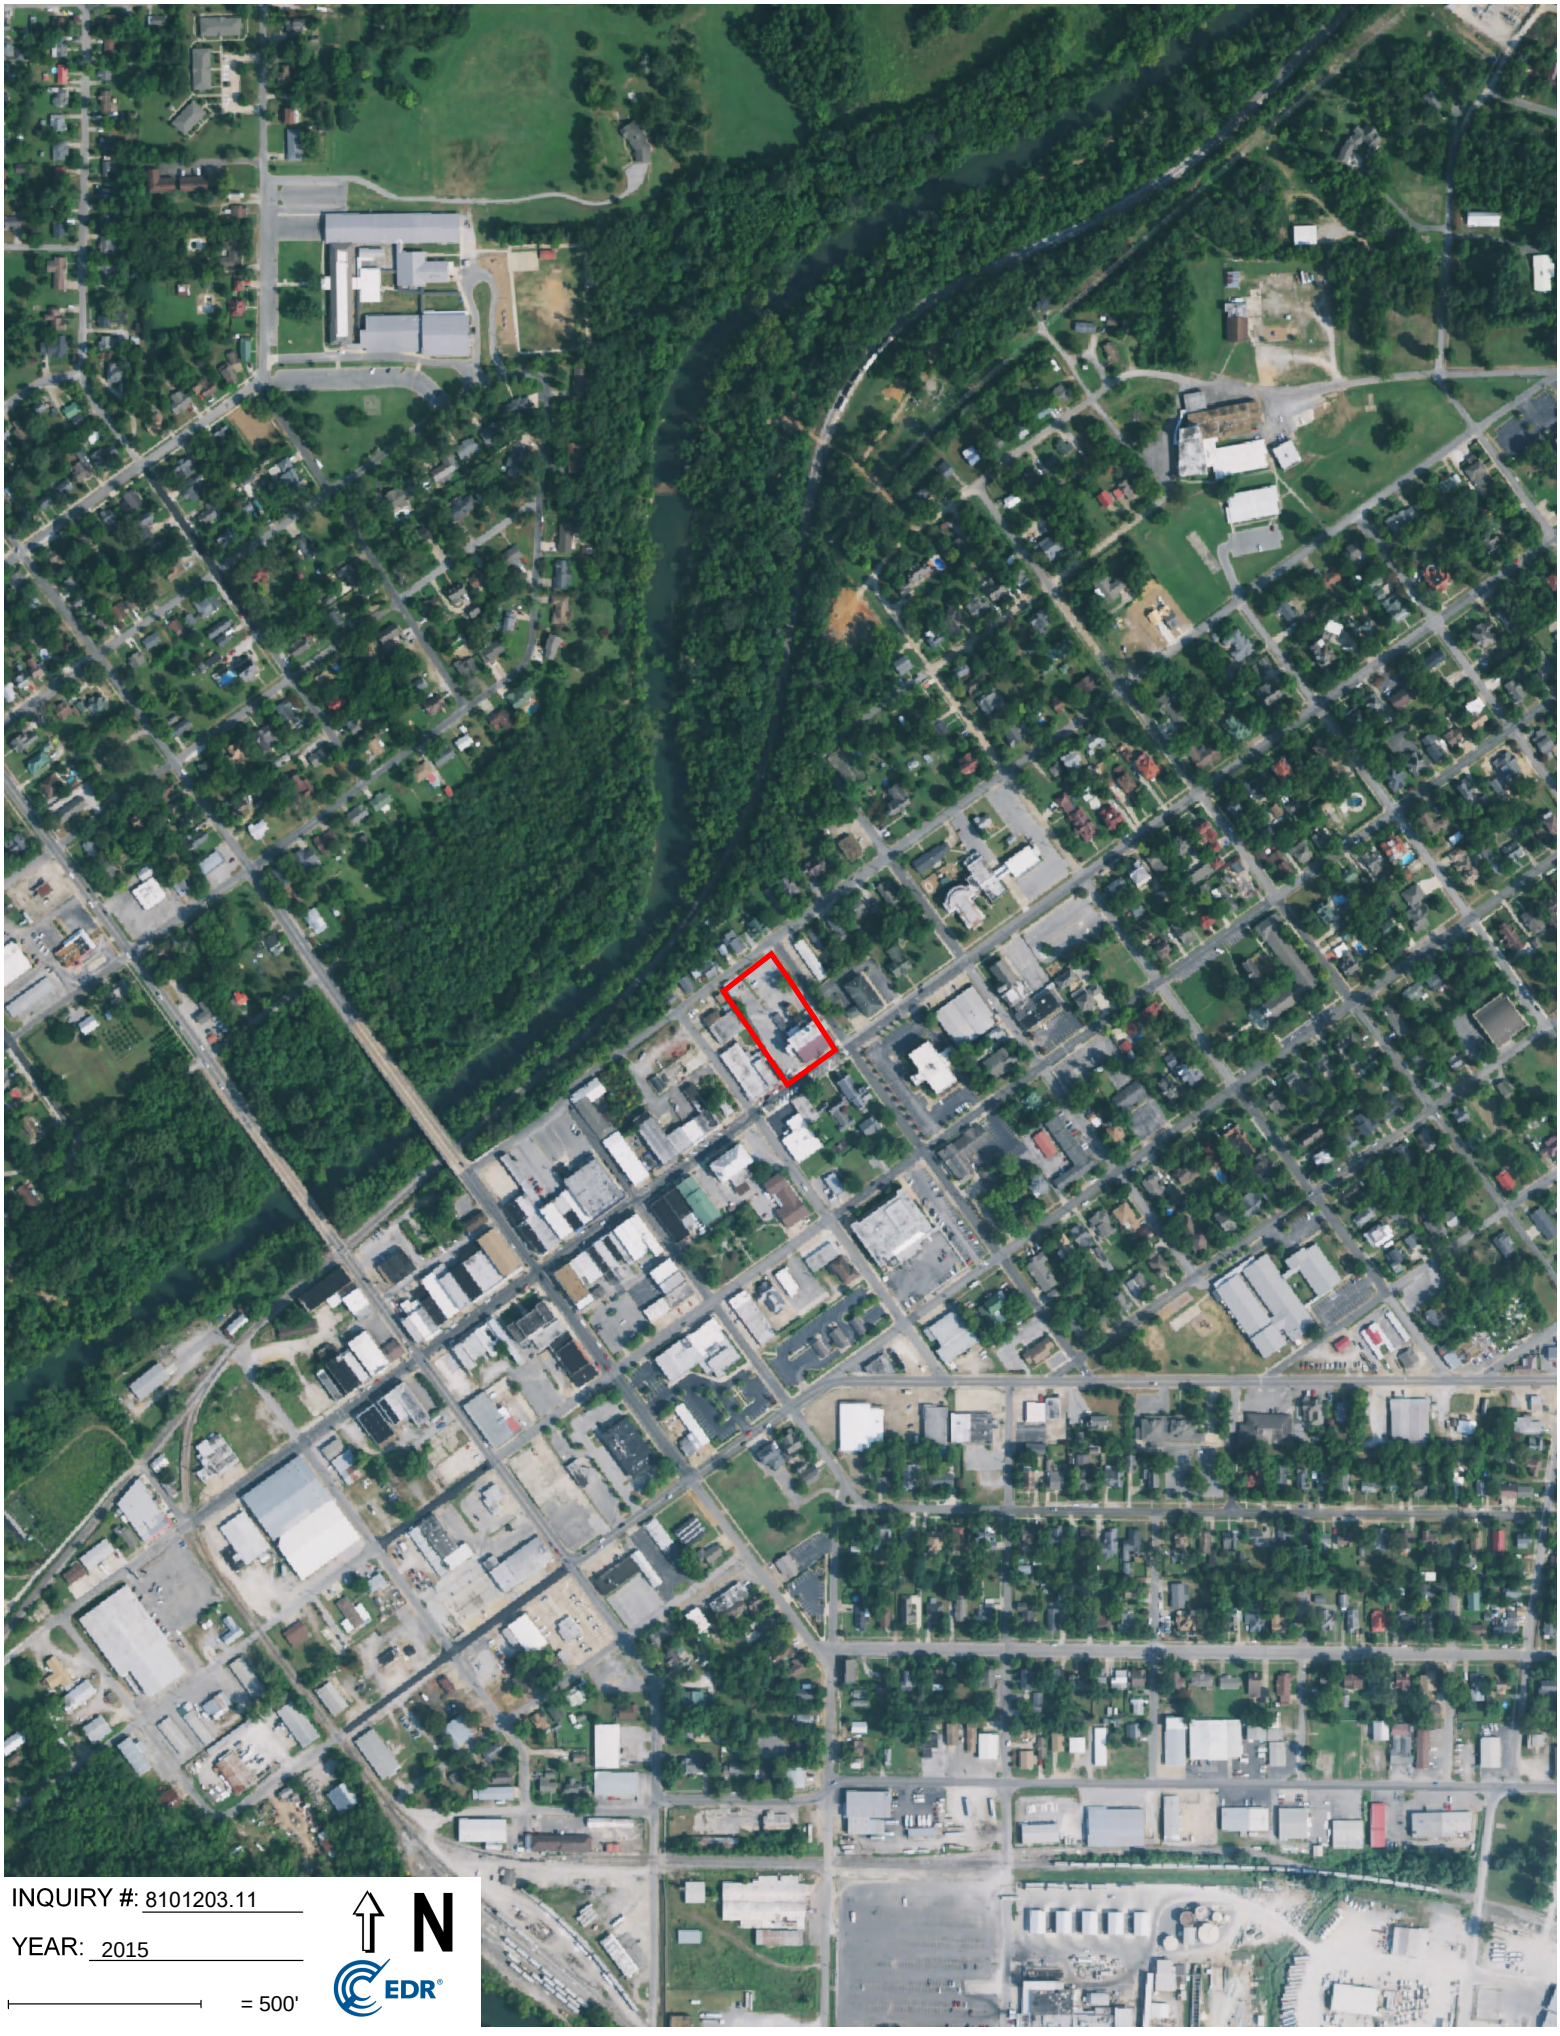
INQUIRY #: 8101203.11
YEAR: 2015
= 500'
N
EDR

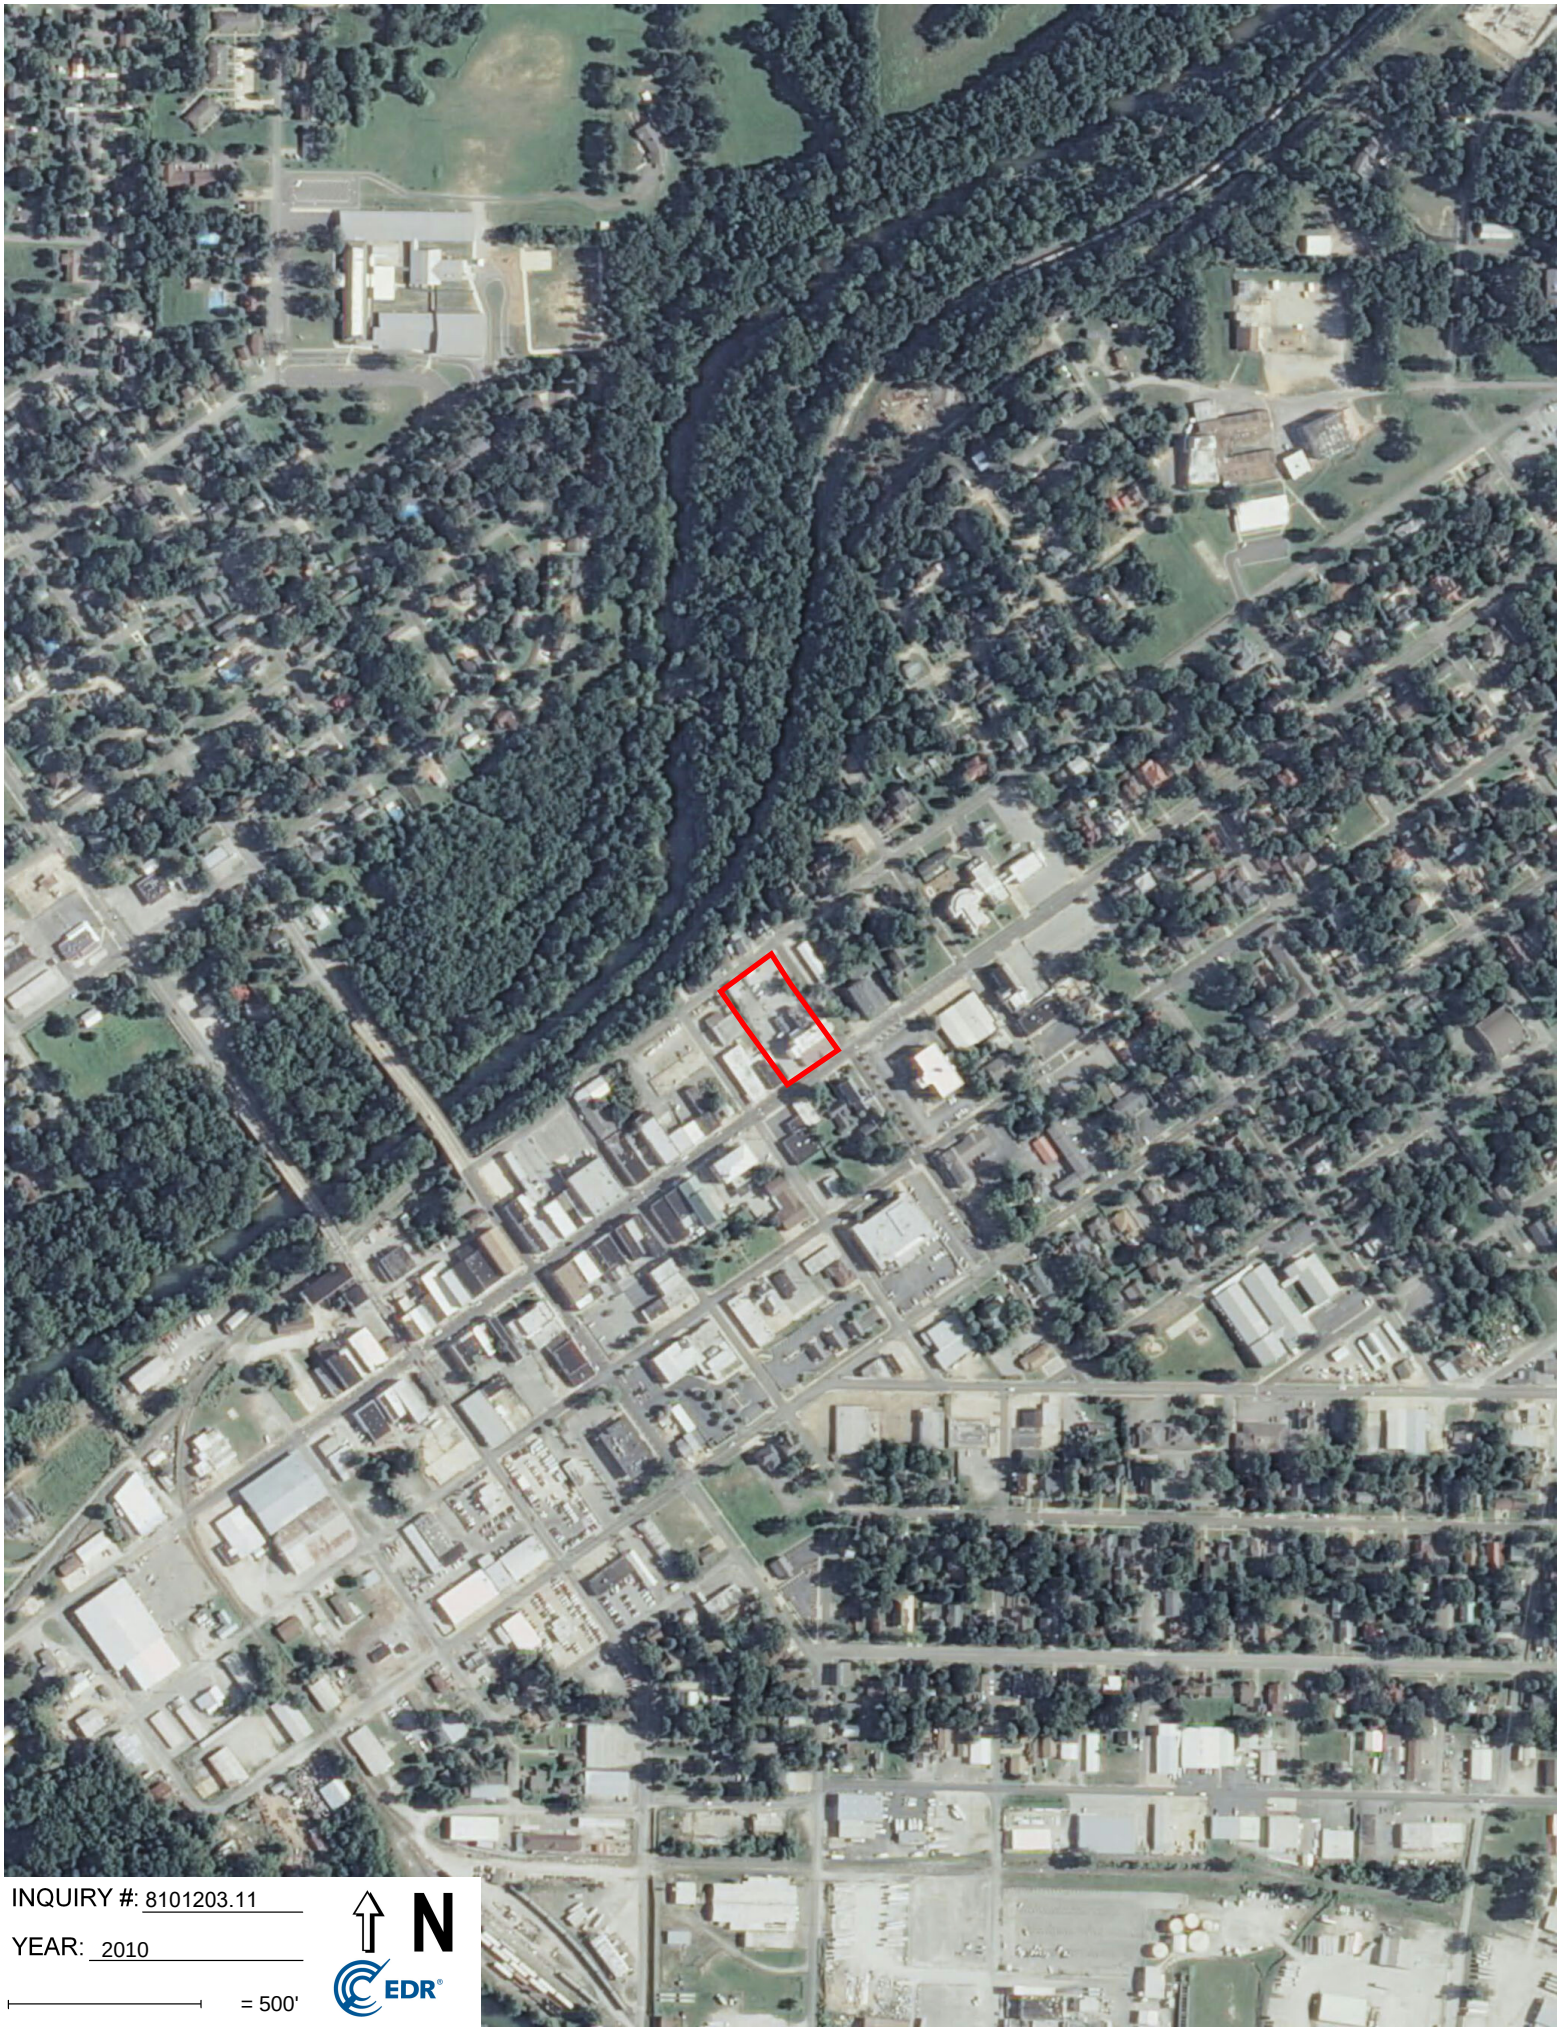

INQUIRY #: 8101203.11

YEAR: 2010

= 500'

N

EDR

INQUIRY #: 8101203.11
YEAR: 2006
= 500'
N
EDR

INQUIRY #: 8101203.11
YEAR: 2001
= 500'
N
EDR

INQUIRY #: 8101203.11
YEAR: 1994
= 500'
N
EDR

INQUIRY #: 8101203.11

YEAR: 1986

= 500'

N

EDR

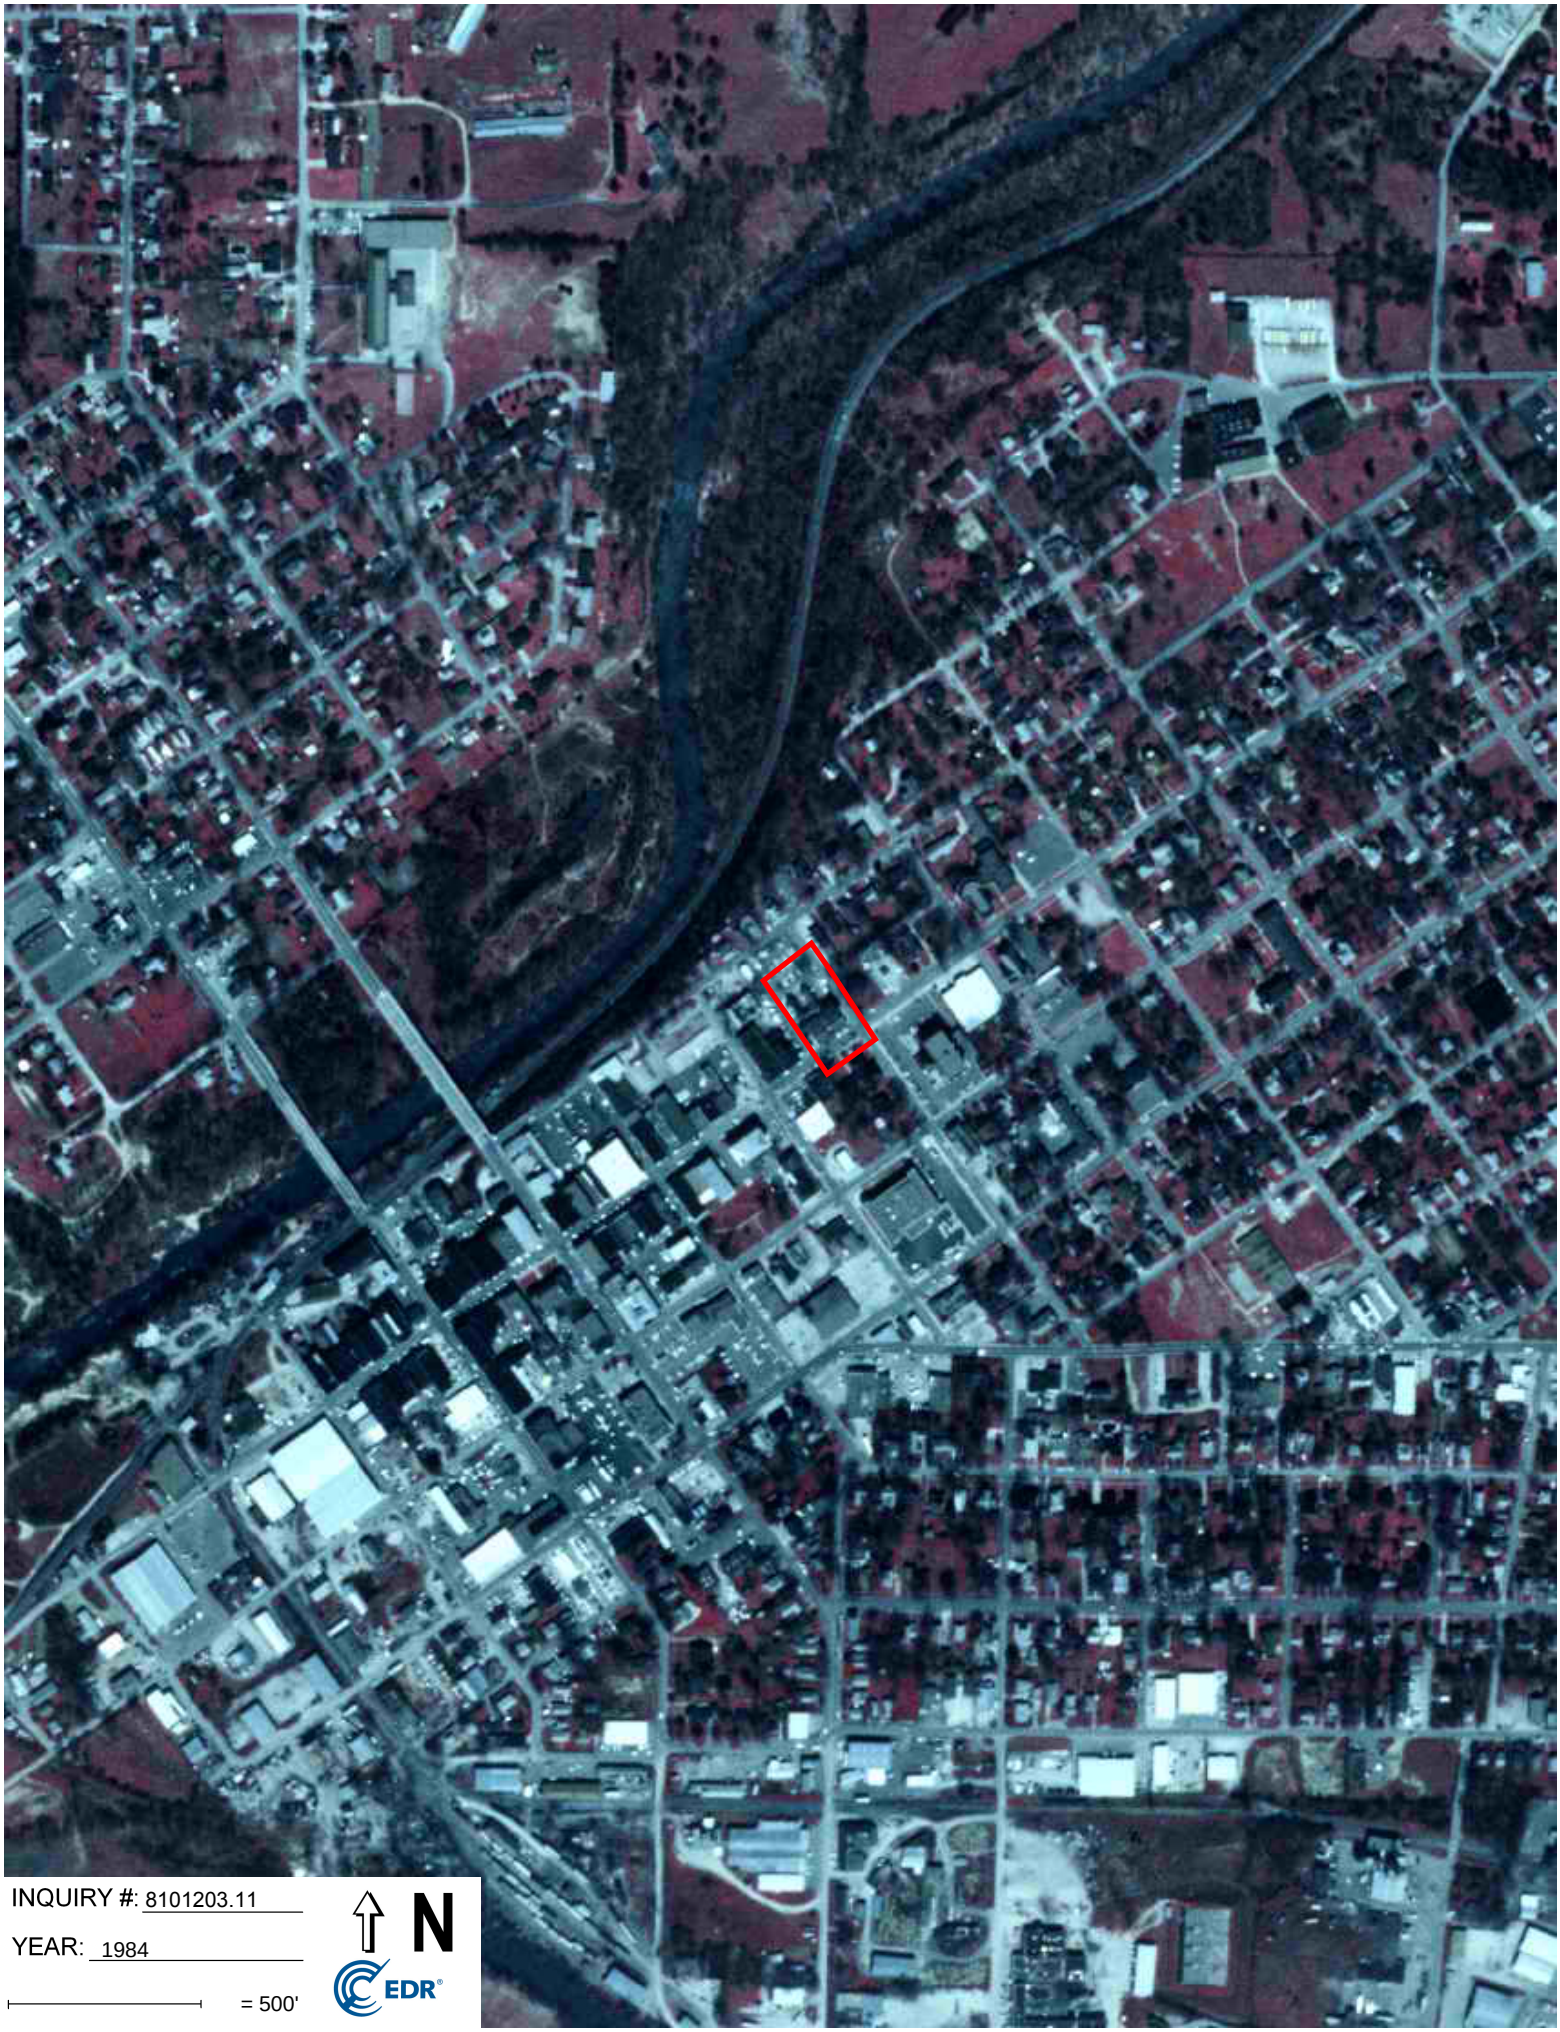
INQUIRY #: 8101203.11
YEAR: 1984
= 500'
N
EDR

INQUIRY #: 8101203.11

YEAR: 1979

= 500'

N

EDR

INQUIRY #: 8101203.11

YEAR: 1942

= 500'

N

EDR

Former Grays Hospital
477 East Main Street
Batesville, AR 72501

Inquiry Number: 8101203.4
September 08, 2025

EDR Historical Topo Map Report

with QuadMatch™

6 Armstrong Road, 4th floor
Shelton, CT 06484
Toll Free: 800.352.0050
www.edrnet.com

EDR Historical Topo Map Report

09/08/25

Site Name:

Former Grays Hospital
477 East Main Street
Batesville, AR 72501
EDR Inquiry # 8101203.4

Client Name:

Tetra Tech EMI
415 Oak Street
Kansas City, MO 64106
Contact: Allie Cook

EDR Topographic Map Library has been searched by EDR and maps covering the target property location as provided by Tetra Tech EMI were identified for the years listed below. EDR's Historical Topo Map Report is designed to assist professionals in evaluating potential liability on a target property resulting from past activities. EDRs Historical Topo Map Report includes a search of a collection of public and private color historical topographic maps, dating back to the late 1800s.

Search Results:

P.O.# 103S9501016.001

Project: Former Gray s Hospital

Coordinates:

Latitude:	35.772488 35° 46' 21" North
Longitude:	-91.650919 -91° 39' 3" West
UTM Zone:	Zone 15 North
UTM X Meters:	621941.34
UTM Y Meters:	3959553.83
Elevation:	322.00' above sea level

Maps Provided:

2020	1891
2017	
2014	
1989	
1981	
1975	
1945	
1942, 1943	

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA), ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT. Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2025 by Environmental Data Resources, Inc. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, Inc., or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

Topo Sheet Key

This EDR Topo Map Report is based upon the following USGS topographic map sheets.

2020 Source Sheets

Batesville
2020
7.5-minute, 24000



Sulphur Rock
2020
7.5-minute, 24000

Jamestown
2020
7.5-minute, 24000



Salado
2020
7.5-minute, 24000

2017 Source Sheets

Batesville
2017
7.5-minute, 24000



Sulphur Rock
2017
7.5-minute, 24000



Jamestown
2017
7.5-minute, 24000



Salado
2017
7.5-minute, 24000

2014 Source Sheets



Batesville
2014
7.5-minute, 24000



Sulphur Rock
2014
7.5-minute, 24000



Jamestown
2014
7.5-minute, 24000



Salado
2014
7.5-minute, 24000

1989 Source Sheets

Sulphur Rock
1989
7.5-minute, 24000
Aerial Photo Revised 1986

Batesville
1989
7.5-minute, 24000
Aerial Photo Revised 1986

Topo Sheet Key

This EDR Topo Map Report is based upon the following USGS topographic map sheets.

1981 Source Sheets

Batesville
1981
7.5-minute, 24000
Aerial Photo Revised 1980

Jamestown
1981
7.5-minute, 24000
Aerial Photo Revised 1980

Sulphur Rock
1981
7.5-minute, 24000
Aerial Photo Revised 1980

Salado
1981
7.5-minute, 24000
Aerial Photo Revised 1980

1975 Source Sheets

Batesville
1975
7.5-minute, 24000
Aerial Photo Revised 1975

Sulphur Rock
1975
7.5-minute, 24000
Aerial Photo Revised 1975

1945 Source Sheets



SALADO
1945
7.5-minute, 31680

BATESVILLE
1945
7.5-minute, 31680

1942, 1943 Source Sheets

Salado
1942
7.5-minute, 24000

Jamestown
1942
7.5-minute, 24000

Batesville
1943
7.5-minute, 24000

Sulphur Rock
1943
7.5-minute, 24000

Topo Sheet Key

This EDR Topo Map Report is based upon the following USGS topographic map sheets.

1891 Source Sheets



Batesville
1891
30-minute, 125000

Historical Topo Map

2020

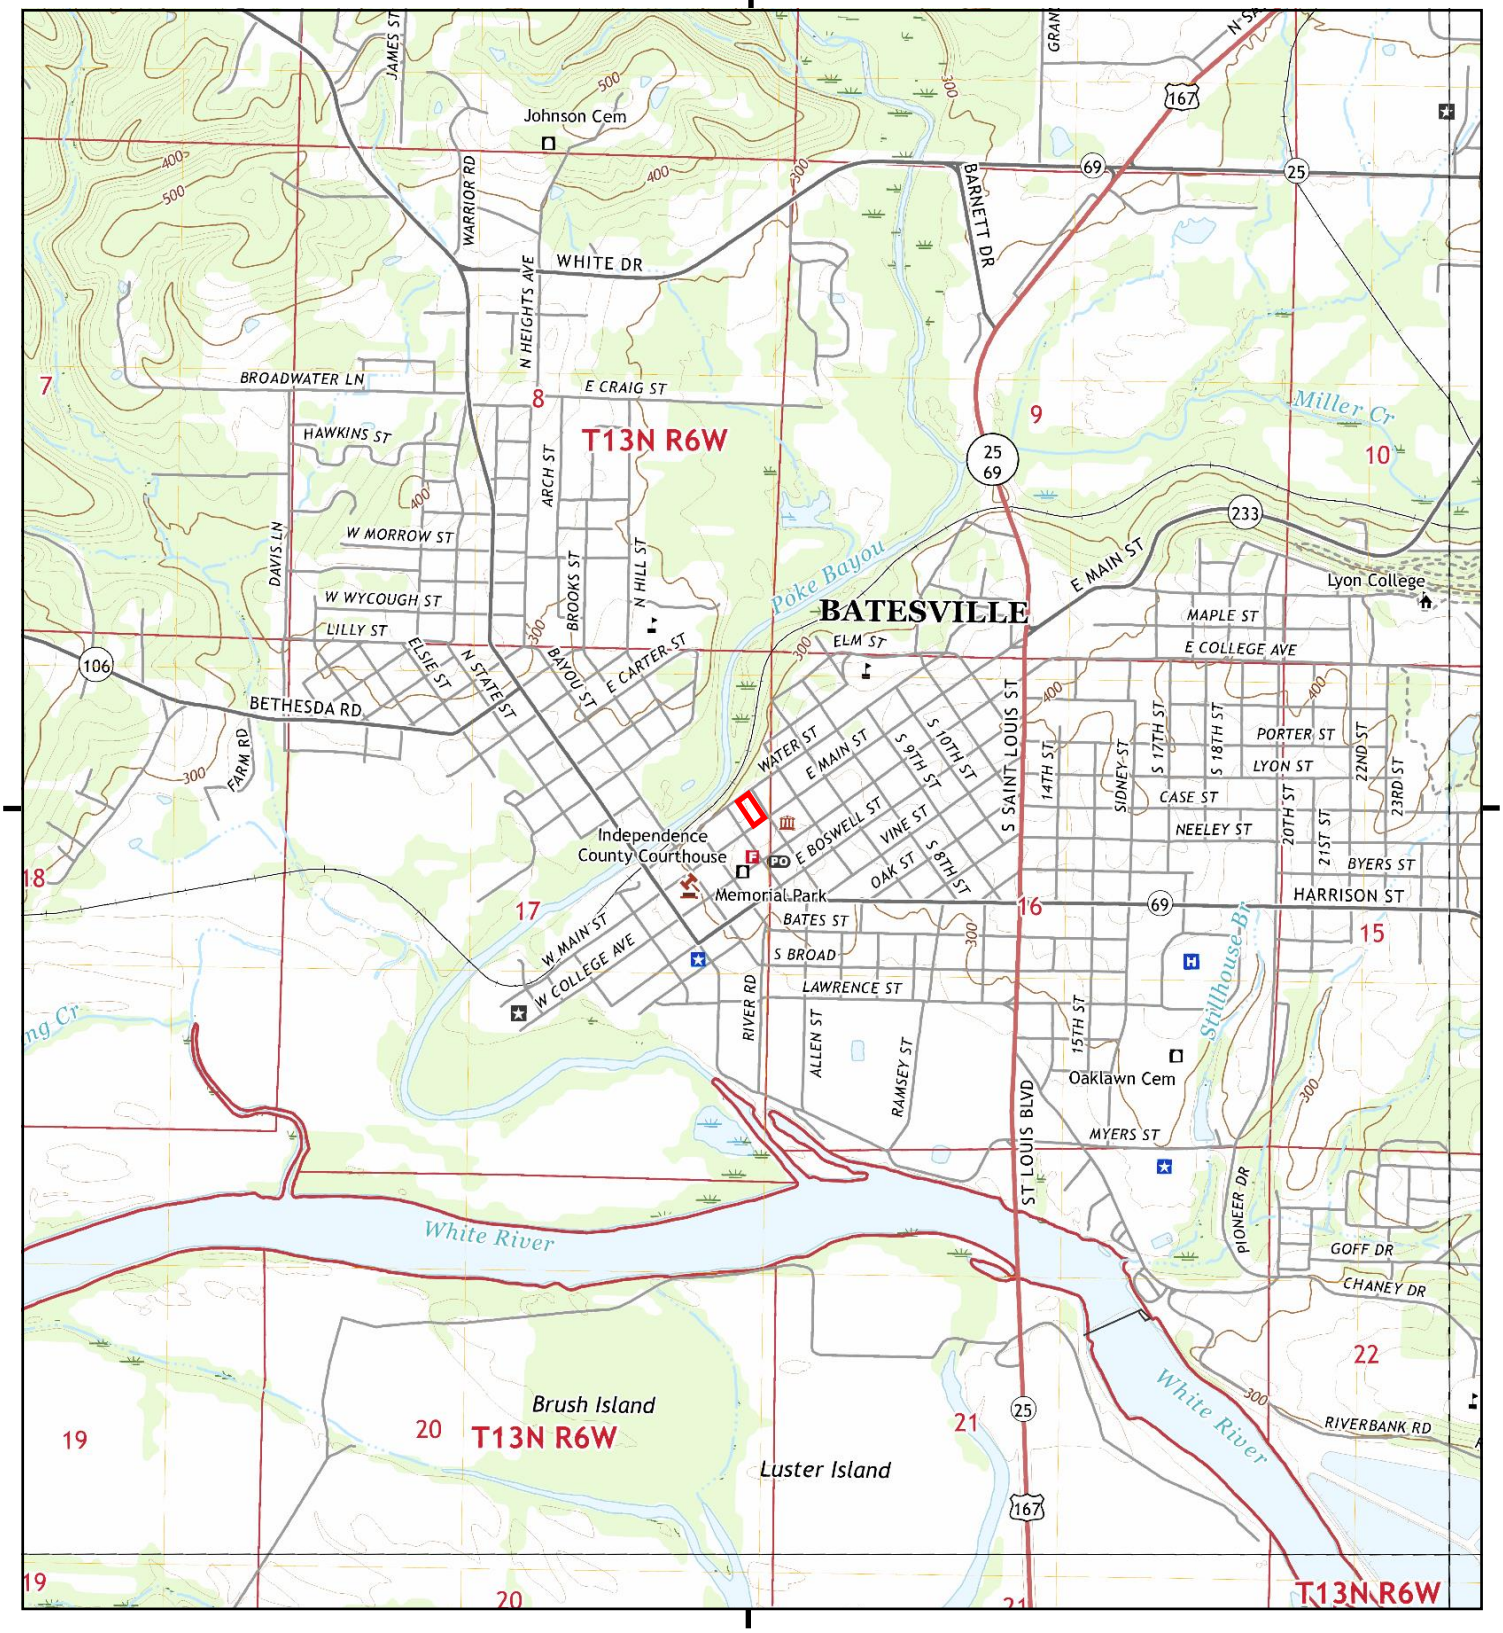

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 2020, 7.5-minute
NE, Sulphur Rock, 2020, 7.5-minute
SE, Salado, 2020, 7.5-minute
S, Jamestown, 2020, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

Historical Topo Map

2017

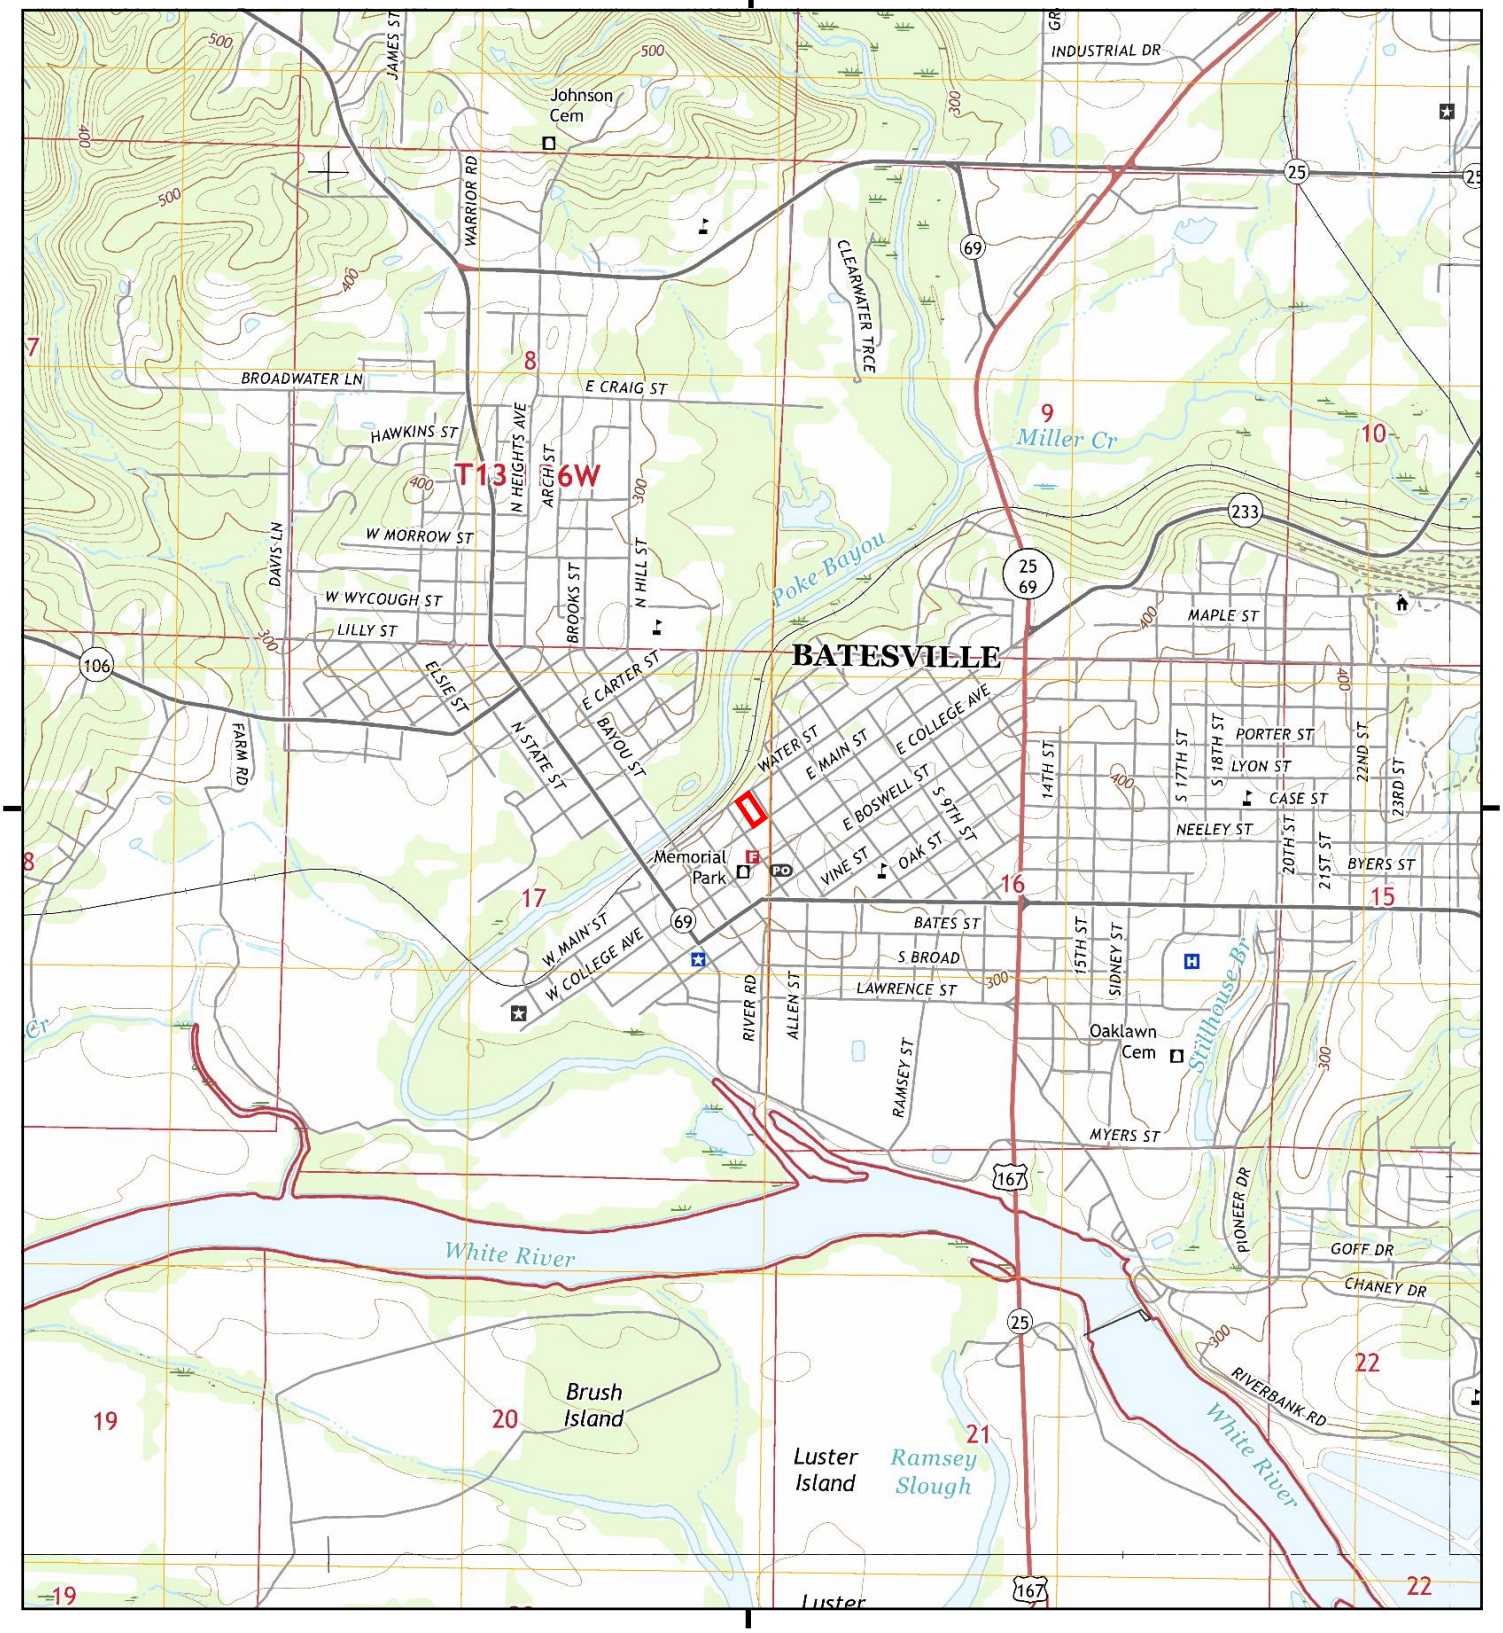

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 2017, 7.5-minute
NE, Sulphur Rock, 2017, 7.5-minute
SE, Salado, 2017, 7.5-minute
S, Jamestown, 2017, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

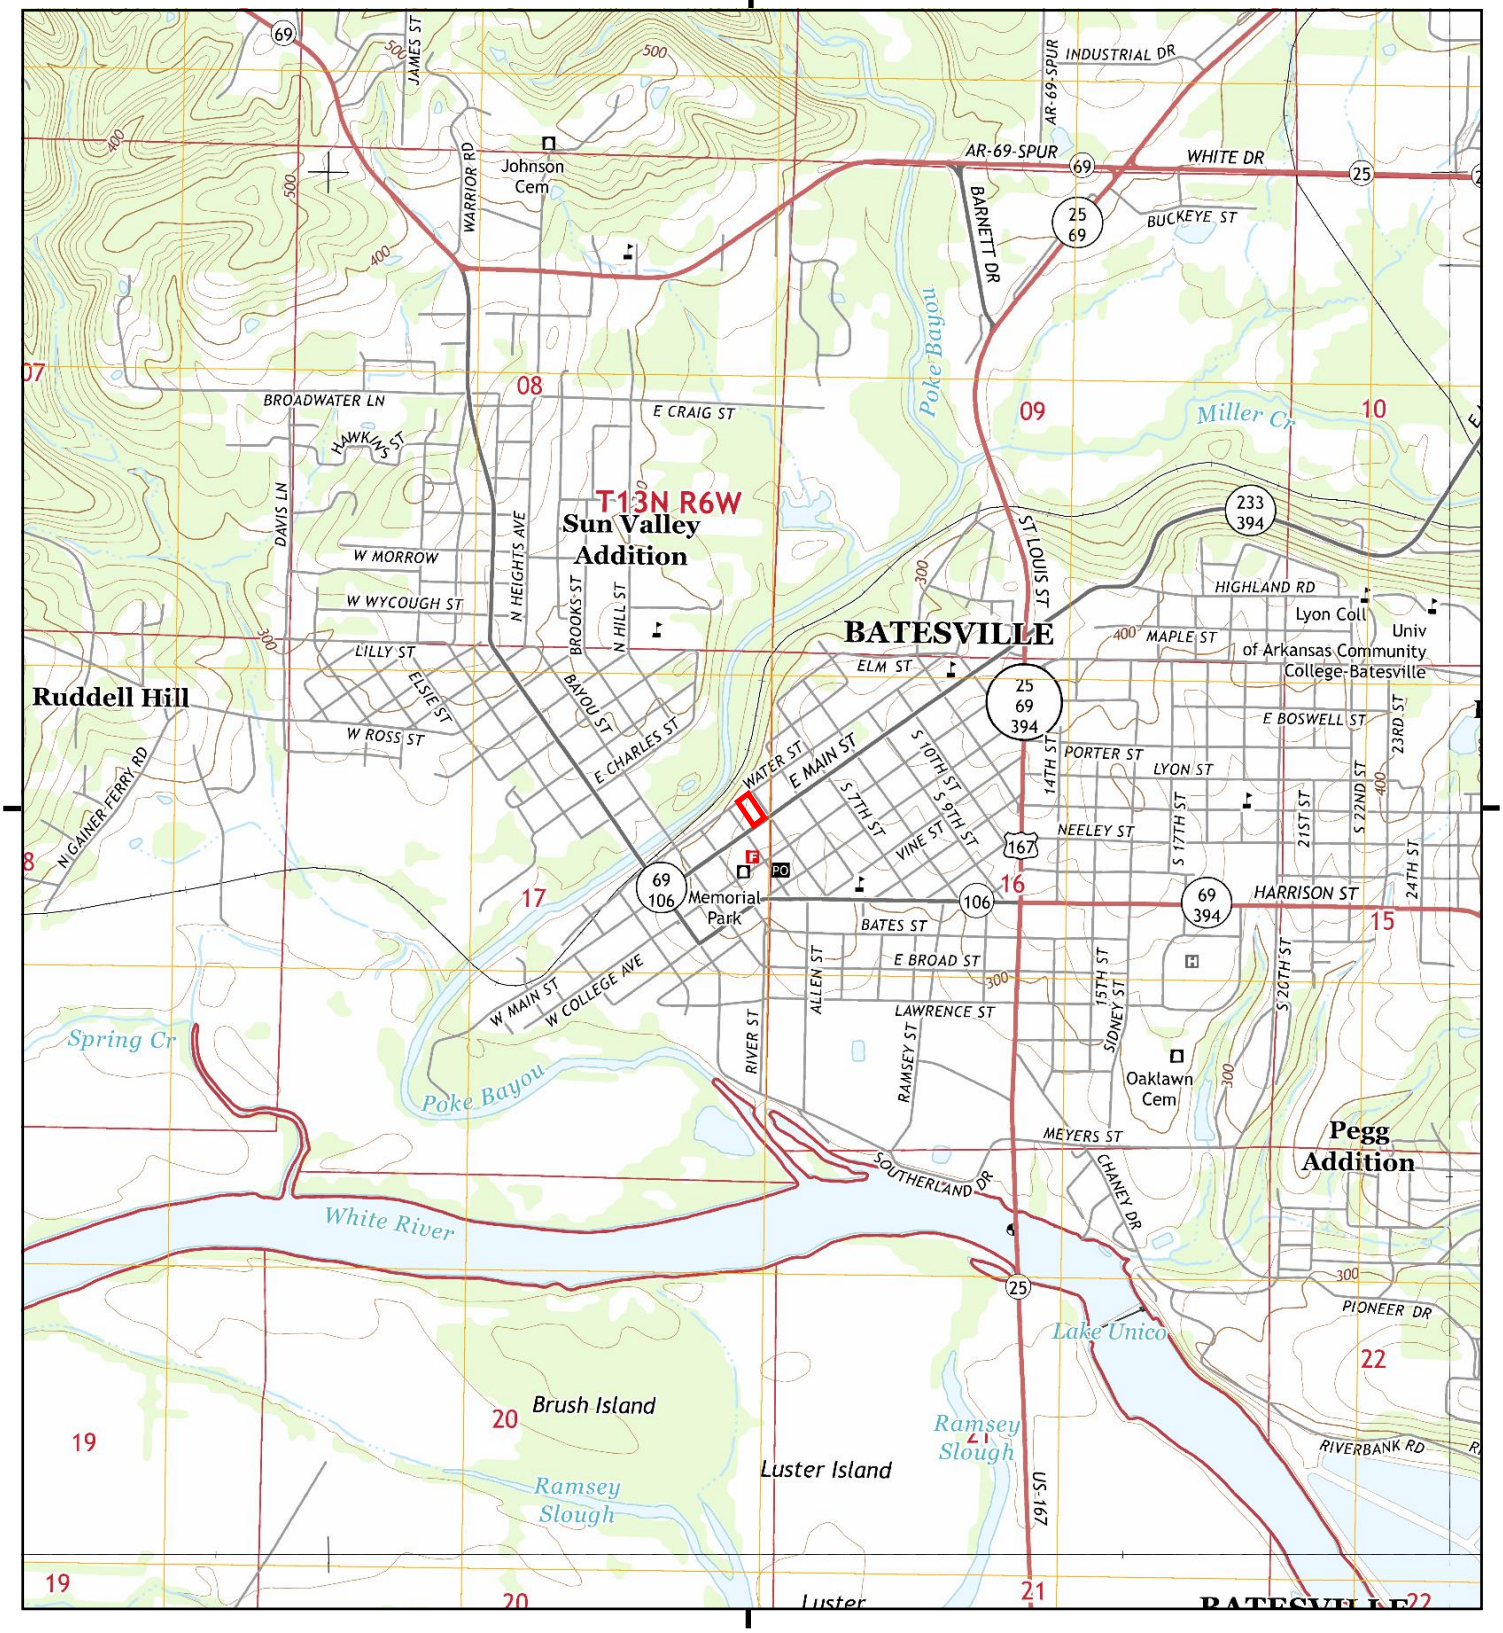

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 2014, 7.5-minute
NE, Sulphur Rock, 2014, 7.5-minute
SE, Salado, 2014, 7.5-minute
S, Jamestown, 2014, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

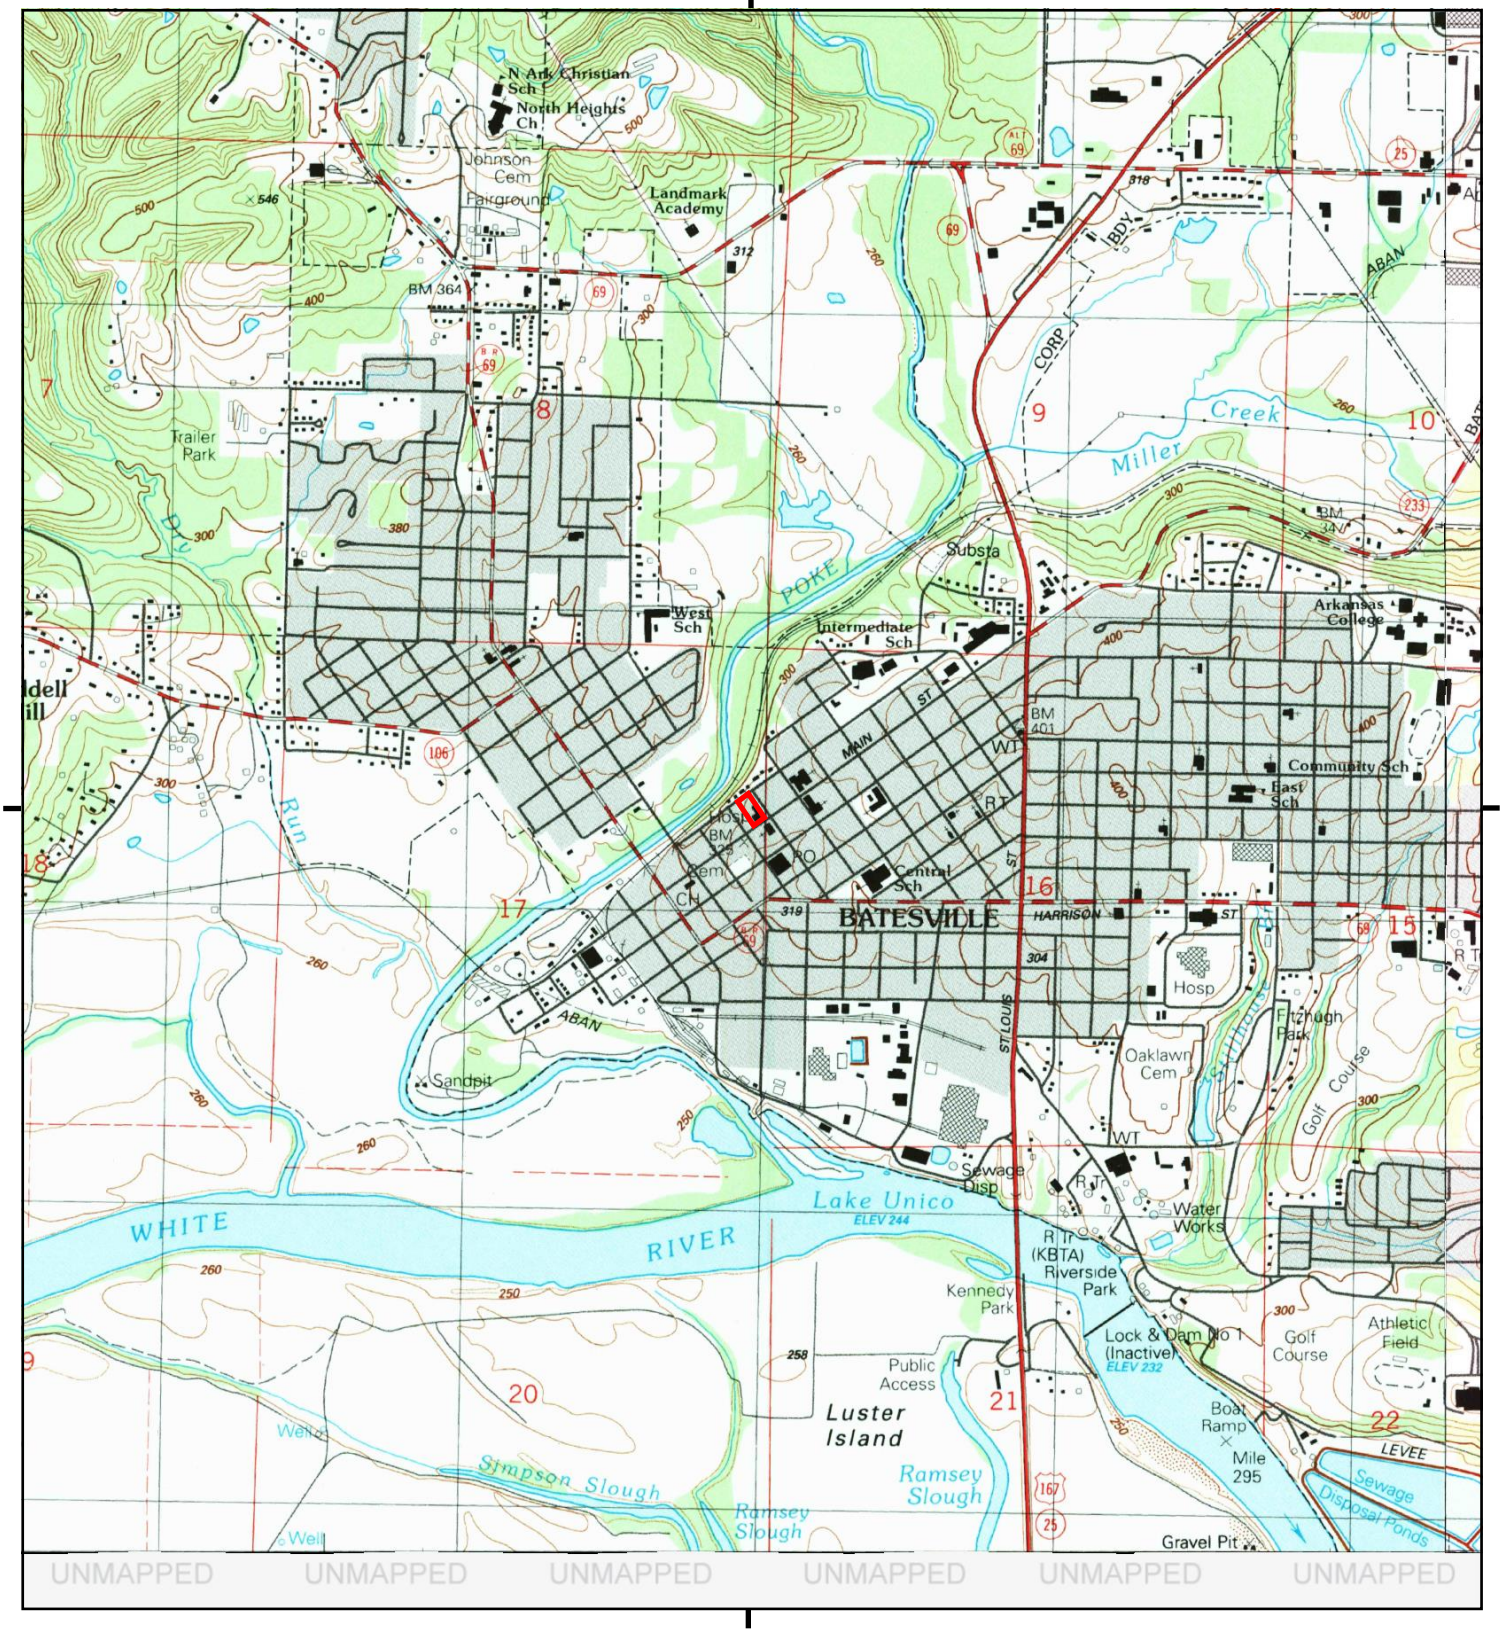

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 1989, 7.5-minute
NE, Sulphur Rock, 1989, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

Historical Topo Map

1981

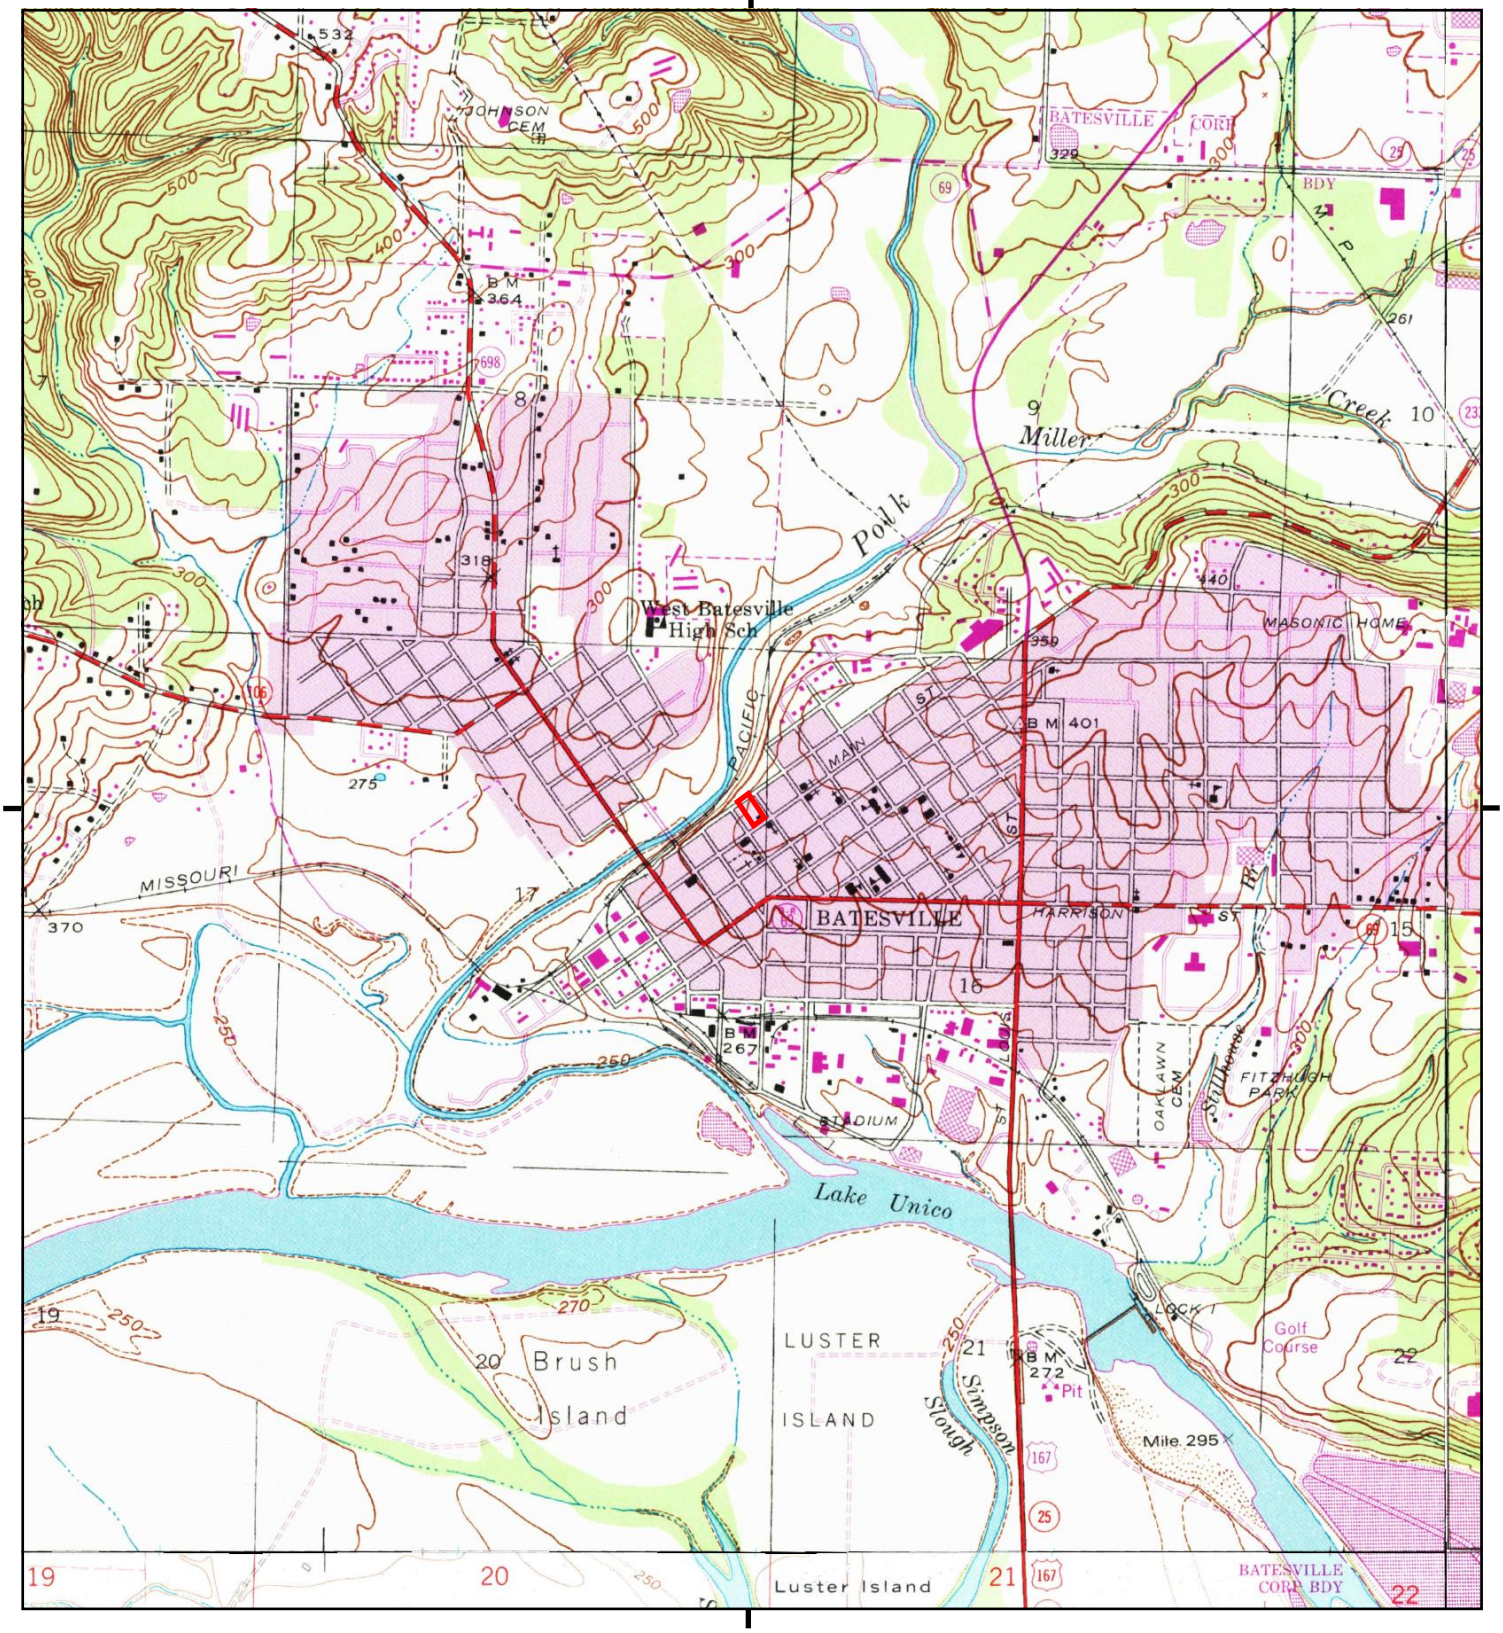

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 1981, 7.5-minute
NE, Sulphur Rock, 1981, 7.5-minute
SE, Salado, 1981, 7.5-minute
S, Jamestown, 1981, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

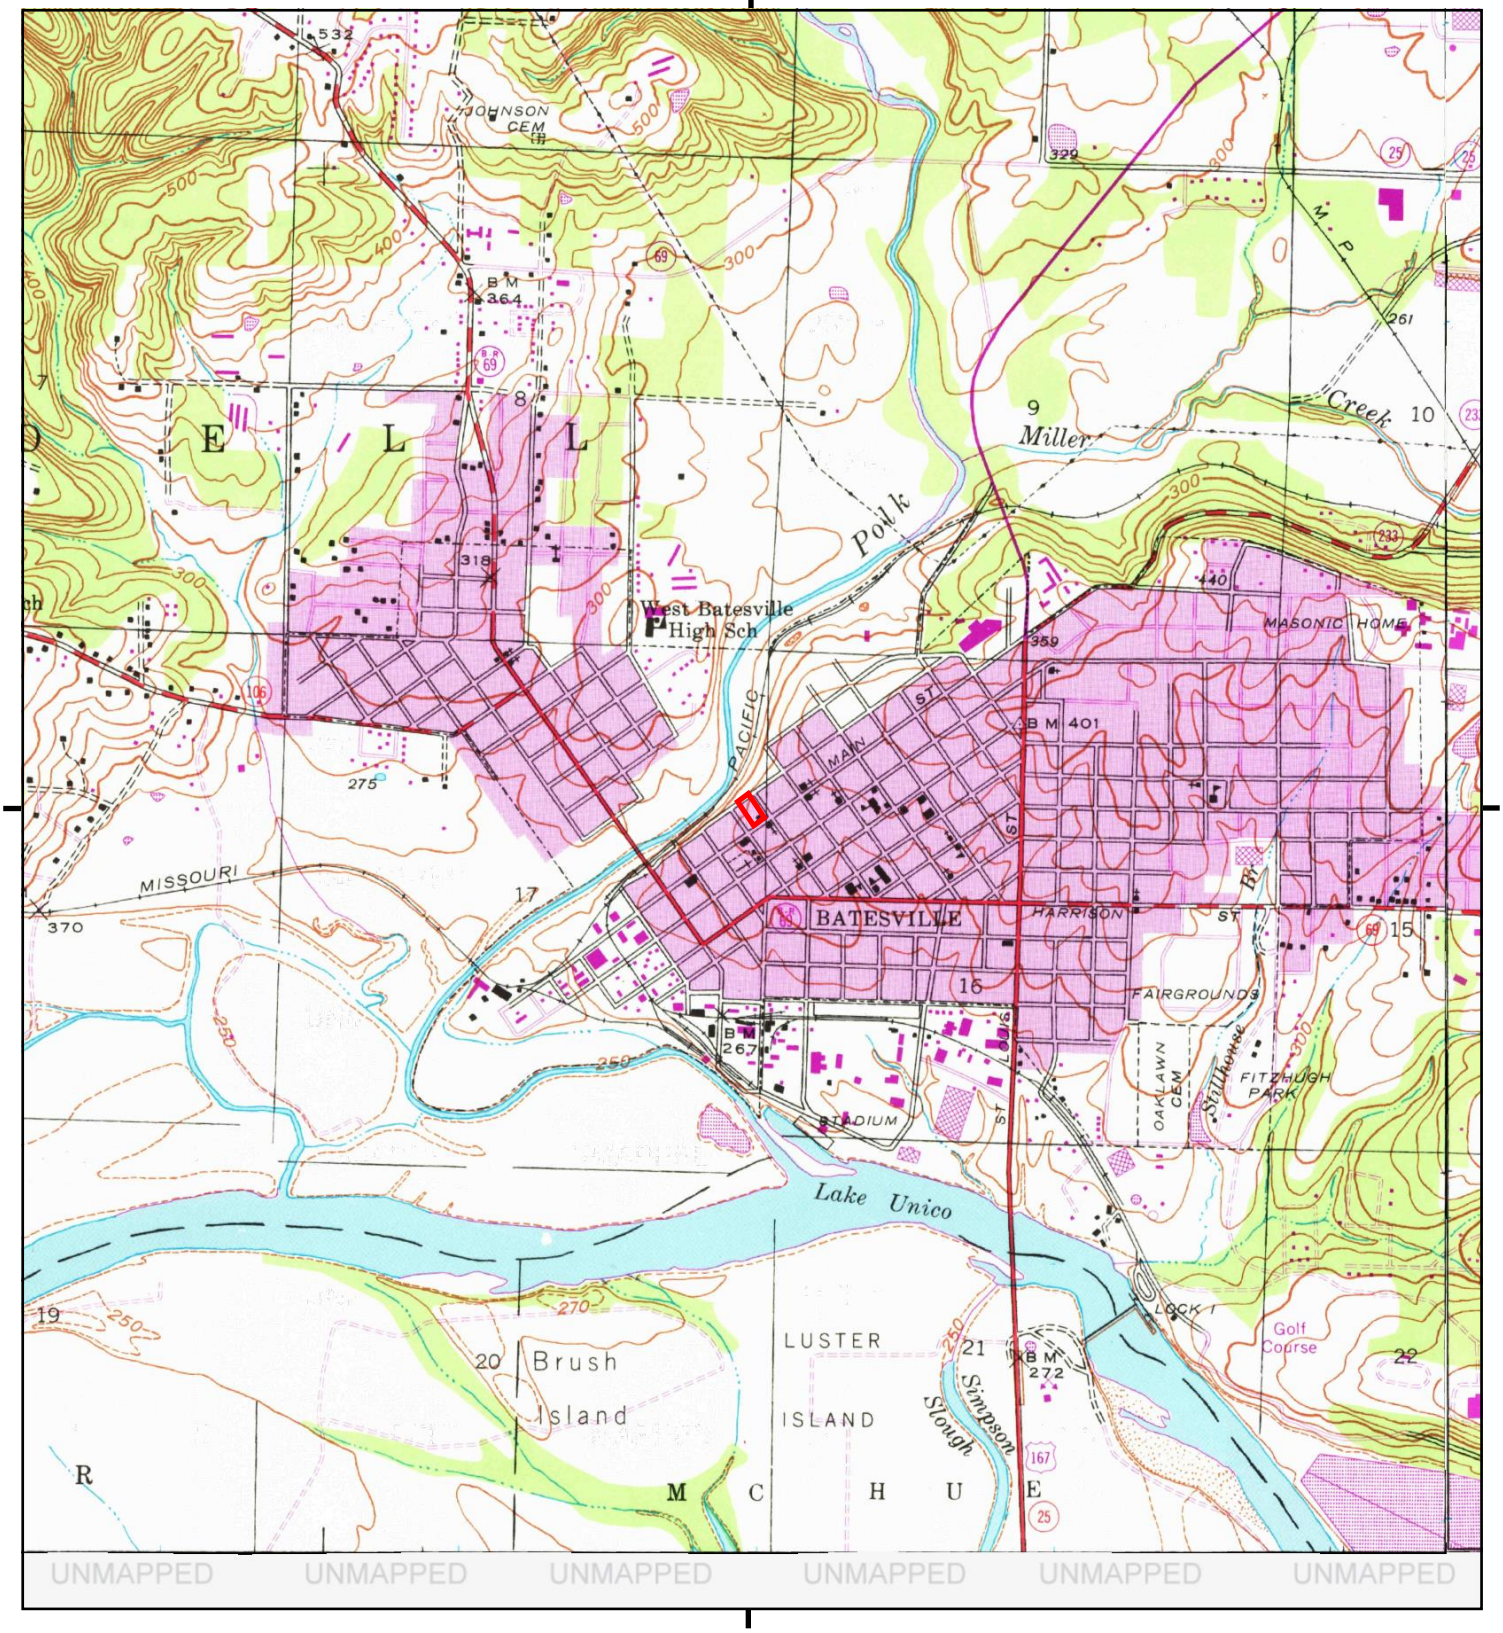

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 1975, 7.5-minute
NE, Sulphur Rock, 1975, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

Historical Topo Map

1945

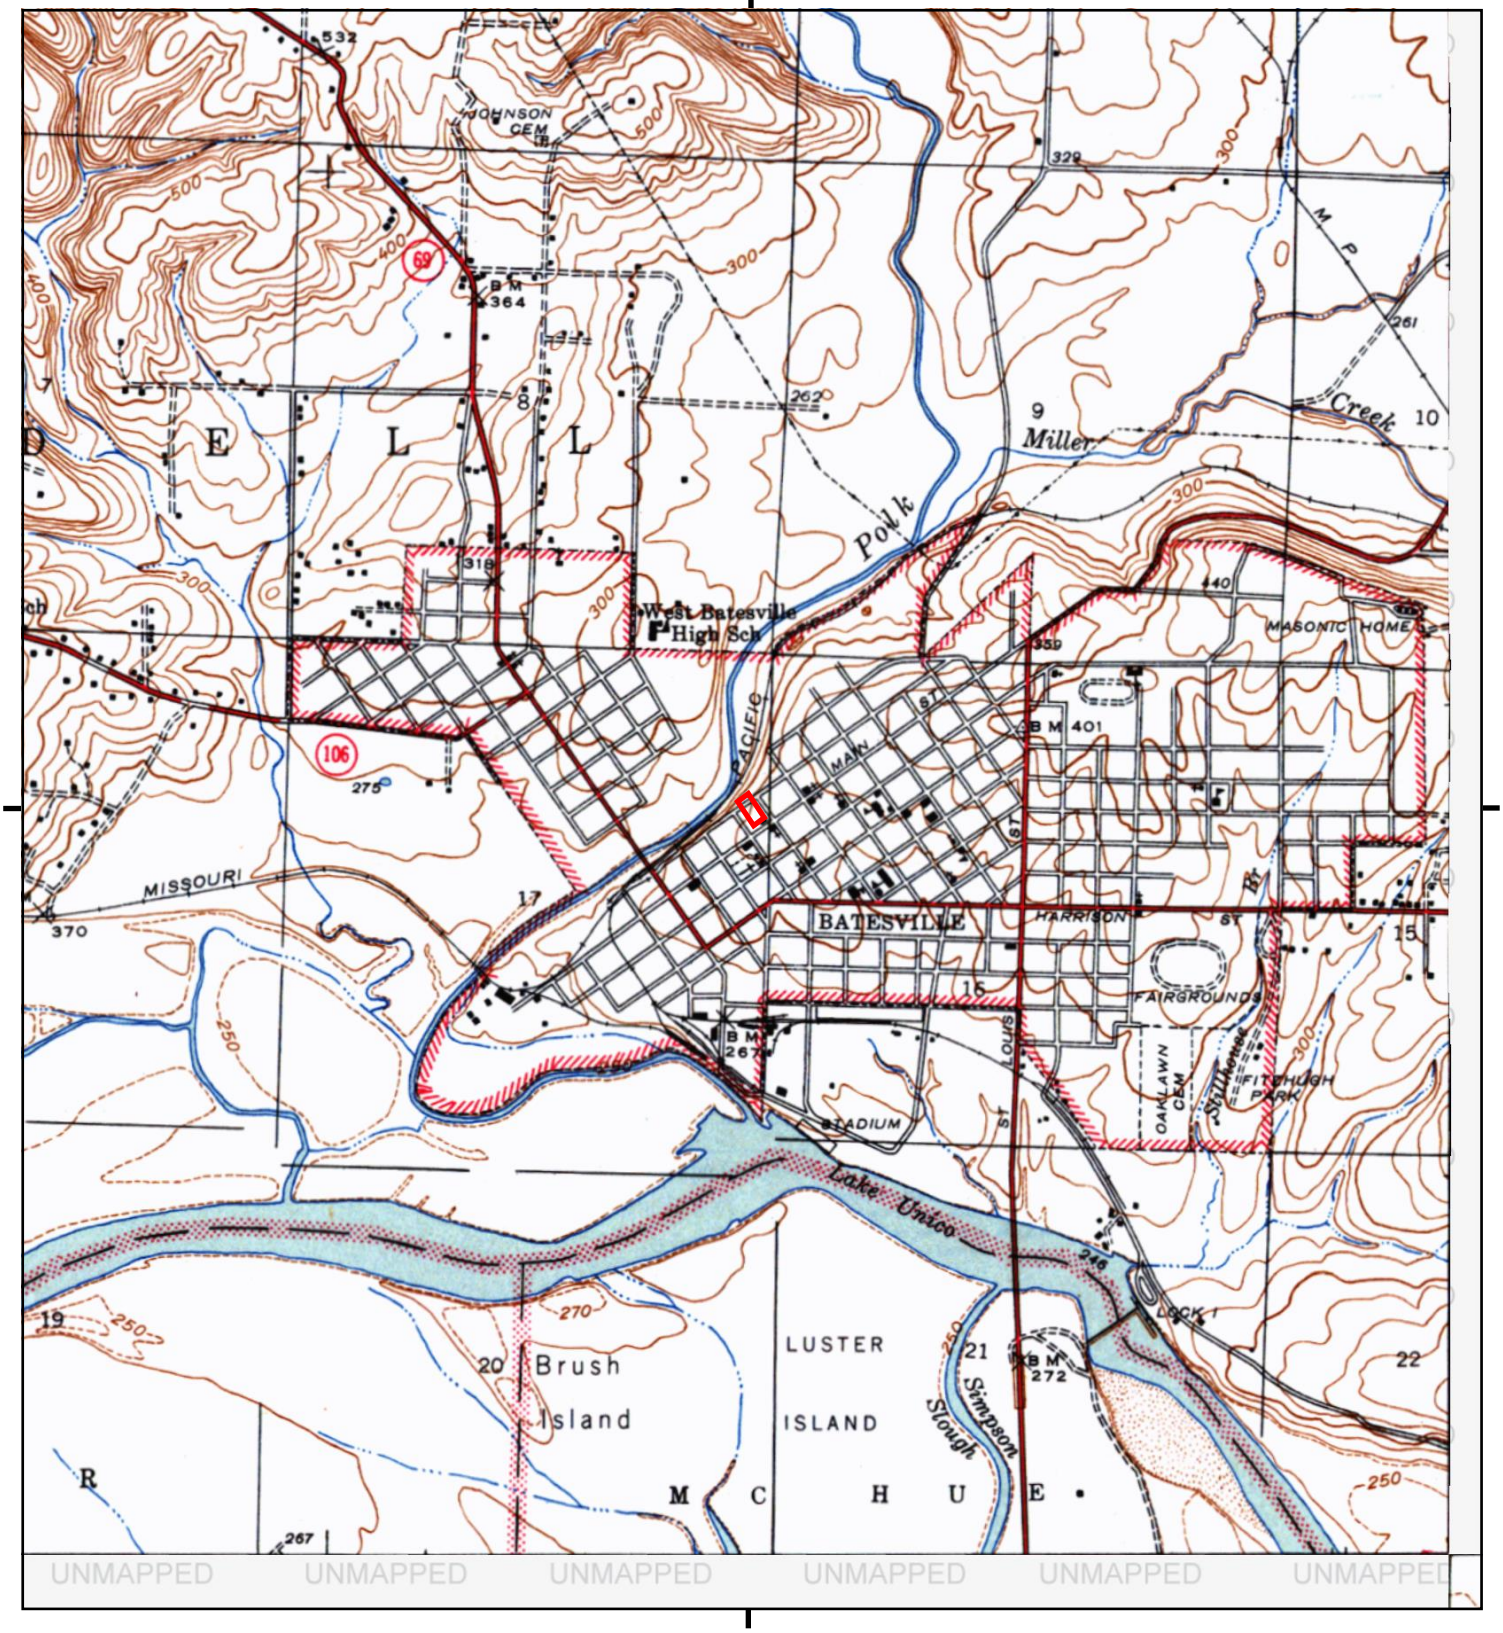

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, BATESVILLE, 1945, 7.5-minute
SE, SALADO, 1945, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

Historical Topo Map

1942, 1943

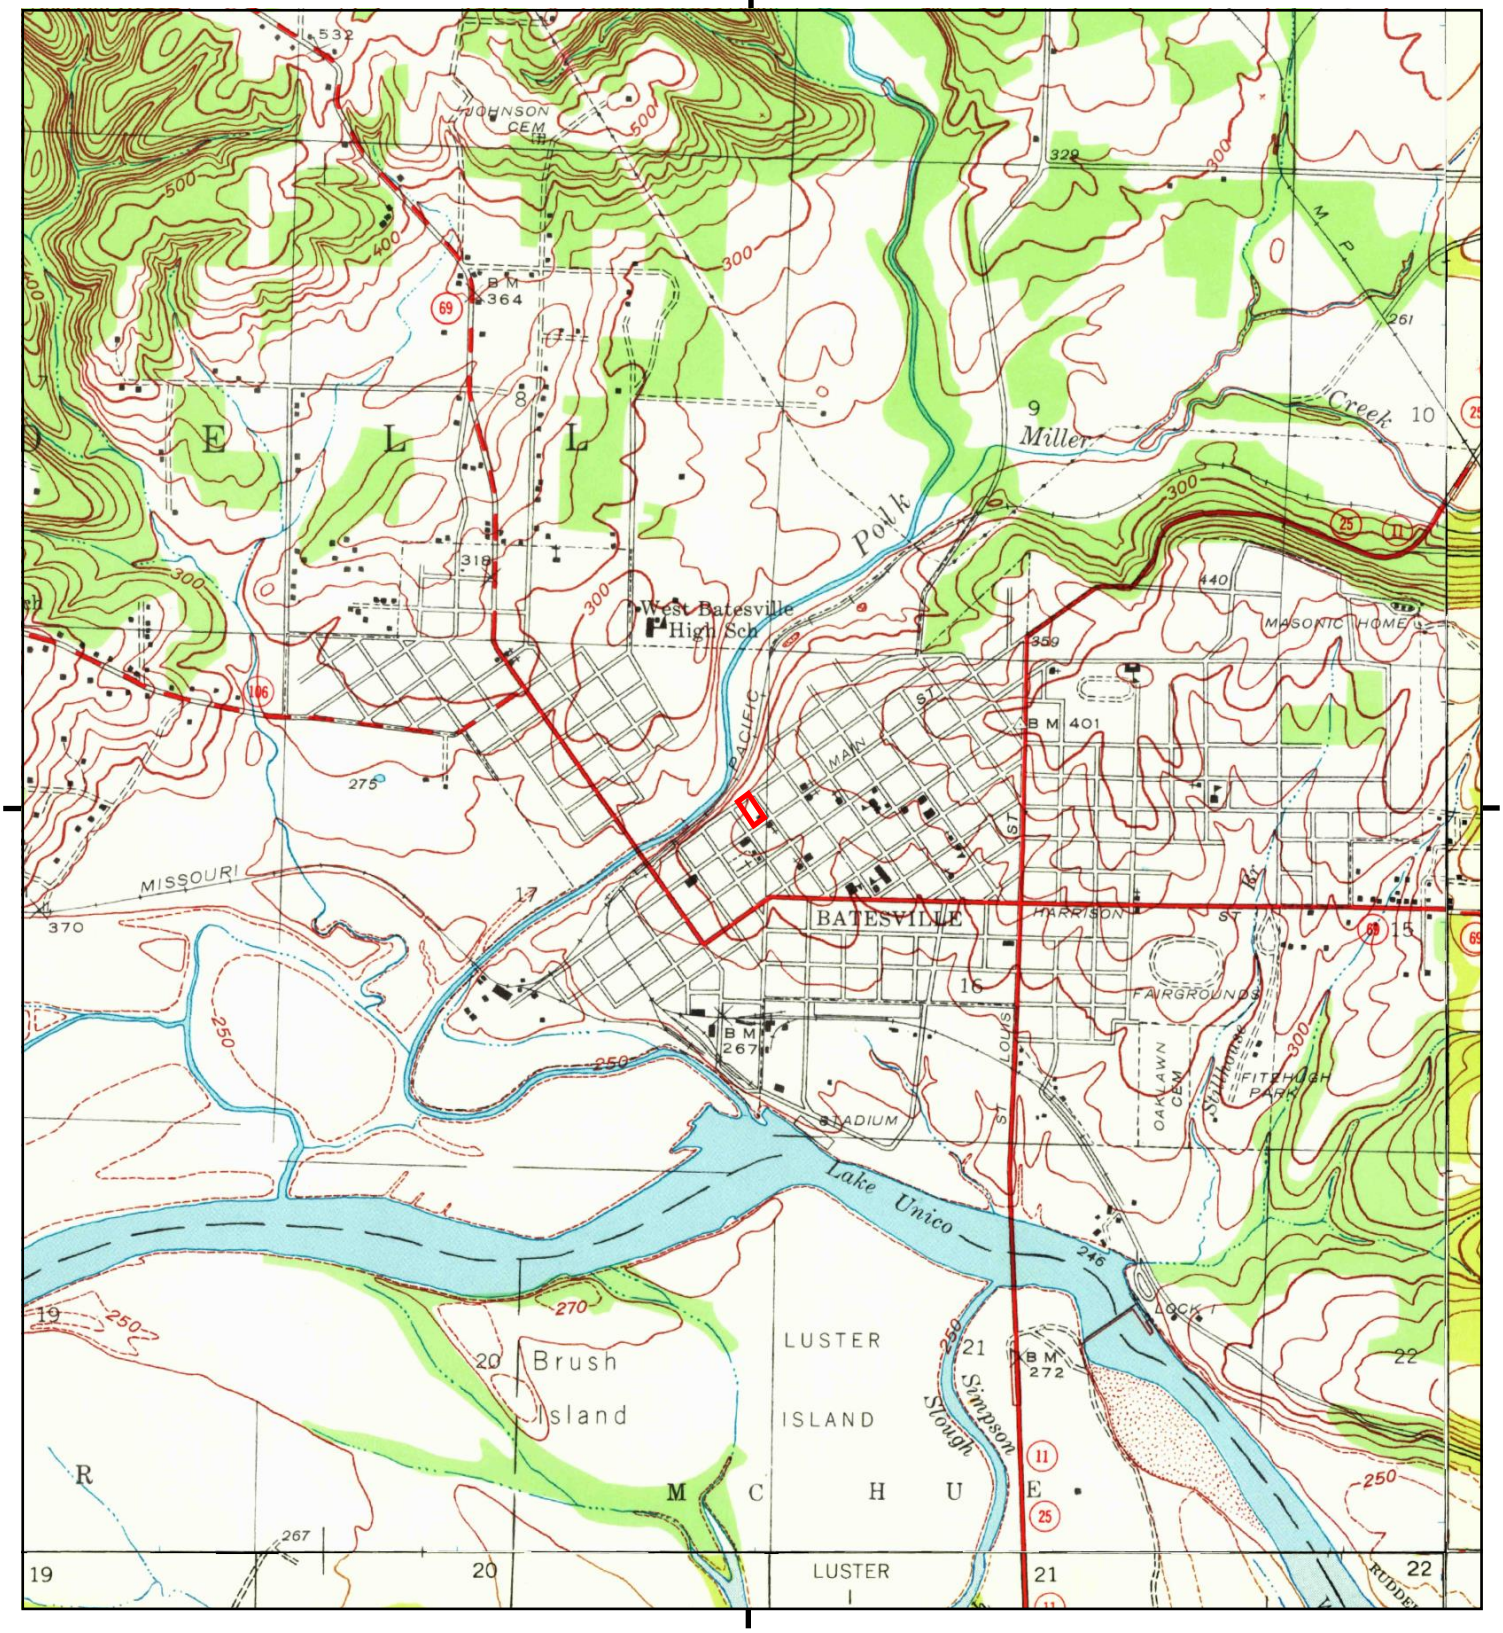

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 1943, 7.5-minute
NE, Sulphur Rock, 1943, 7.5-minute
SE, Salado, 1942, 7.5-minute
S, Jamestown, 1942, 7.5-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

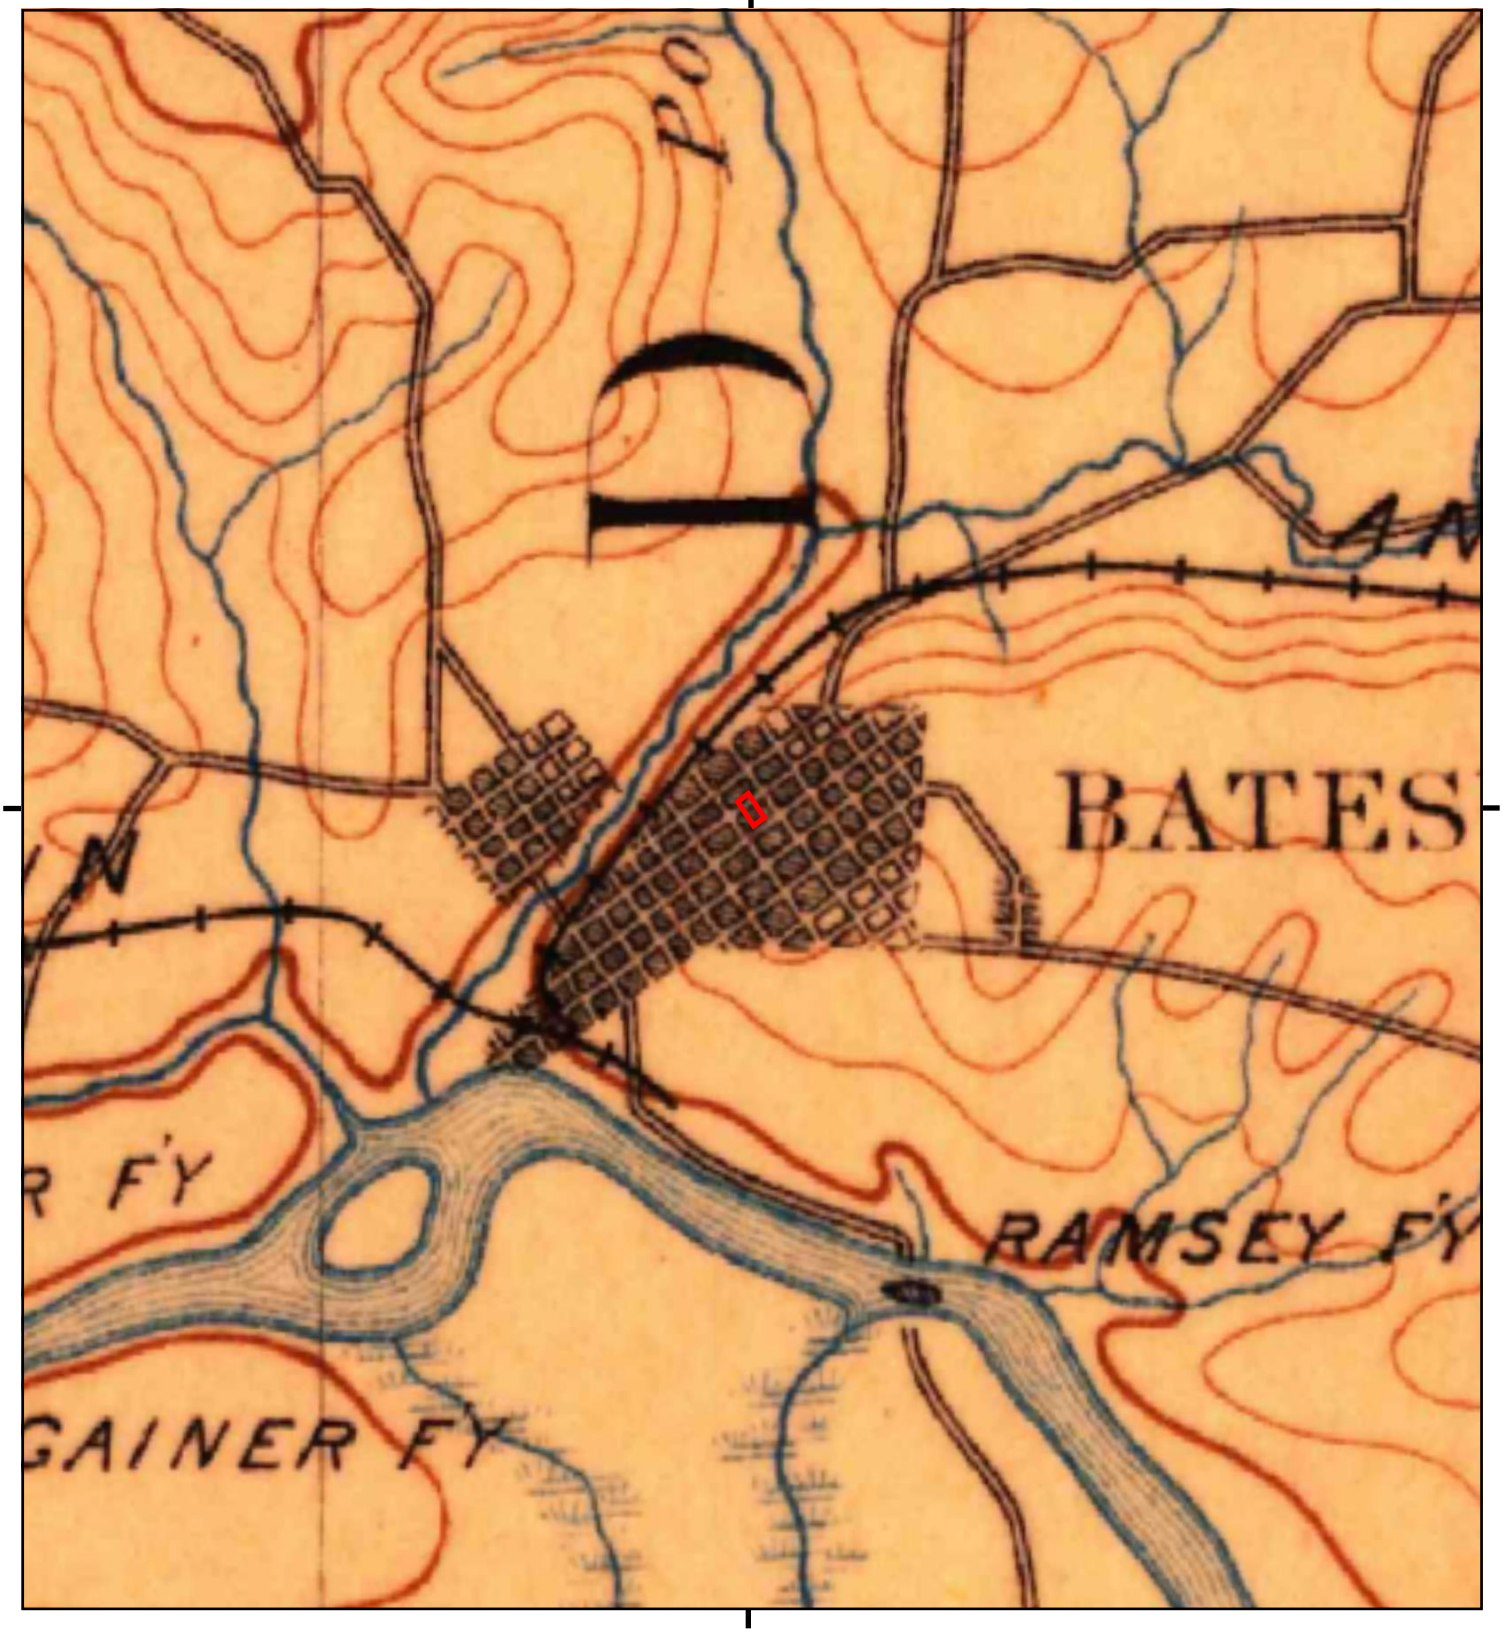

This report includes information from the following map sheet(s).

0 Miles 0.25 0.5 1 1.5

NW N NE
W E
SW S SE

TP, Batesville, 1891, 30-minute

SITE NAME: Former Grays Hospital
ADDRESS: 477 East Main Street
Batesville, AR 72501
CLIENT: Tetra Tech EMI

N

Former Grays Hospital
477 East Main Street
Batesville, AR 72501

Inquiry Number: 8101203.3
September 08, 2025

Certified Sanborn® Map Report

6 Armstrong Road, 4th floor
Shelton, CT 06484
Toll Free: 800.352.0050
www.edrnet.com

Certified Sanborn® Map Report

09/08/25

Site Name:

Former Grays Hospital
477 East Main Street
Batesville, AR 72501
EDR Inquiry # 8101203.3

Client Name:

Tetra Tech EMI
415 Oak Street
Kansas City, MO 64106
Contact: Allie Cook

The Sanborn Library has been searched by EDR and maps covering the target property location as provided by Tetra Tech EMI were identified for the years listed below. The Sanborn Library is the largest, most complete collection of fire insurance maps. The collection includes maps from Sanborn, Bromley, Perris & Browne, Hopkins, Barlow, and others. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by the Sanborn Library LLC, the copyright holder for the collection. Results can be authenticated by visiting www.edrnet.com/sanborn.

The Sanborn Library is continually enhanced with newly identified map archives. This report accesses all maps in the collection as of the day this report was generated.

Certified Sanborn Results:

Certification # 8D28-4037-A7DB

PO # 103S9501016.001

Project Former Gray s Hospital

Maps Provided:

1960
1947
1930
1923
1914
1908
1901
1897
1892

Sanborn® Library search results

Certification #: 8D28-4037-A7DB

The Sanborn Library includes more than 1.2 million fire insurance maps from Sanborn, Bromley, Perris & Browne, Hopkins, Barlow and others which track historical property usage in approximately 12,000 American cities and towns. Collections searched:

- ☑ Library of Congress
- ☑ University Publications of America
- ☑ EDR Private Collection

The Sanborn Library LLC Since 1866™

Limited Permission To Make Copies

Tetra Tech EMI (the client) is permitted to make up to FIVE photocopies of this Sanborn Map transmittal and each fire insurance map accompanying this report solely for the limited use of its customer. No one other than the client is authorized to make copies. Upon request made directly to an EDR Account Executive, the client may be permitted to make a limited number of additional photocopies. This permission is conditioned upon compliance by the client, its customer and their agents with EDR's copyright policy; a copy of which is available upon request.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA), ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT. Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2025 by Environmental Data Resources, Inc. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, Inc., or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

Sanborn Sheet Key

This Certified Sanborn Map Report is based upon the following Sanborn Fire Insurance map sheets.

1960 Source Sheets

Volume 1, Sheet 4
1960

Volume 1, Sheet 2
1960

1947 Source Sheets

Volume 1, Sheet 2
1947

Volume 1, Sheet 4
1947

1930 Source Sheets

Volume 1, Sheet 4
1930

Volume 1, Sheet 2
1930

1923 Source Sheets

Volume 1, Sheet 4
1923



Volume 1, Sheet 3
1923

Sanborn Sheet Key

This Certified Sanborn Map Report is based upon the following Sanborn Fire Insurance map sheets.

1914 Source Sheets

Volume 1, Sheet 4
1914

Volume 1, Sheet 6
1914

1908 Source Sheets



Volume 1, Sheet 4
1908

Volume 1, Sheet 3
1908

1901 Source Sheets

Volume 1, Sheet 3
1901

Volume 1, Sheet 4
1901

1897 Source Sheets

Volume 1, Sheet 4
1897

Volume 1, Sheet 3
1897

Sanborn Sheet Key

This Certified Sanborn Map Report is based upon the following Sanborn Fire Insurance map sheets.

1892 Source Sheets



Volume 1, Sheet 1
1892

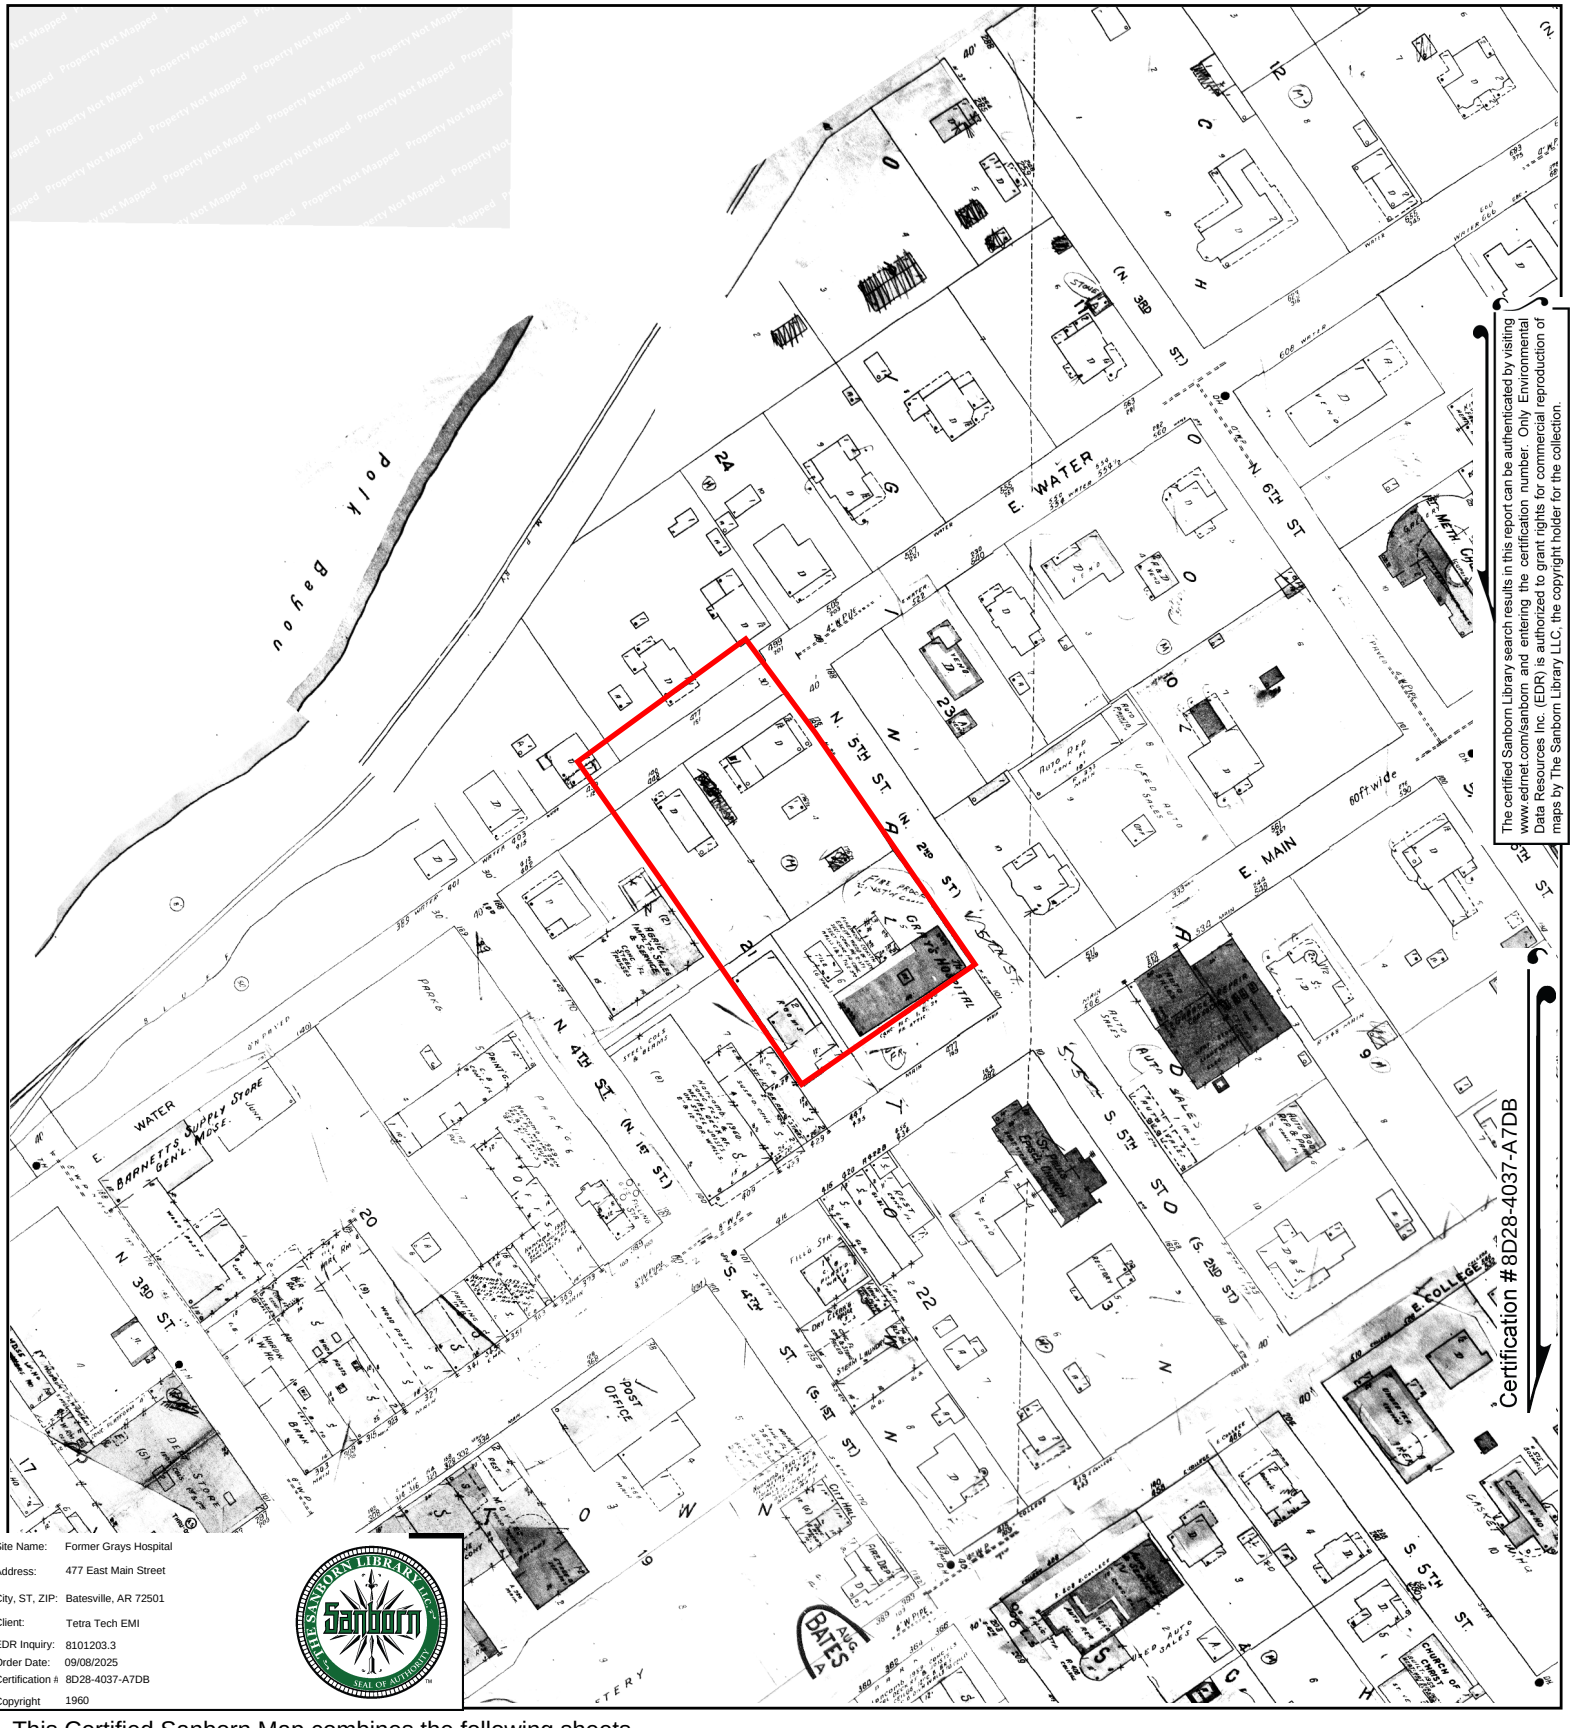

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #	8D28-4037-A7DB
Copyright	1960

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.



Volume 1, Sheet 2
Volume 1, Sheet 4

0 Feet 150 300 600

N

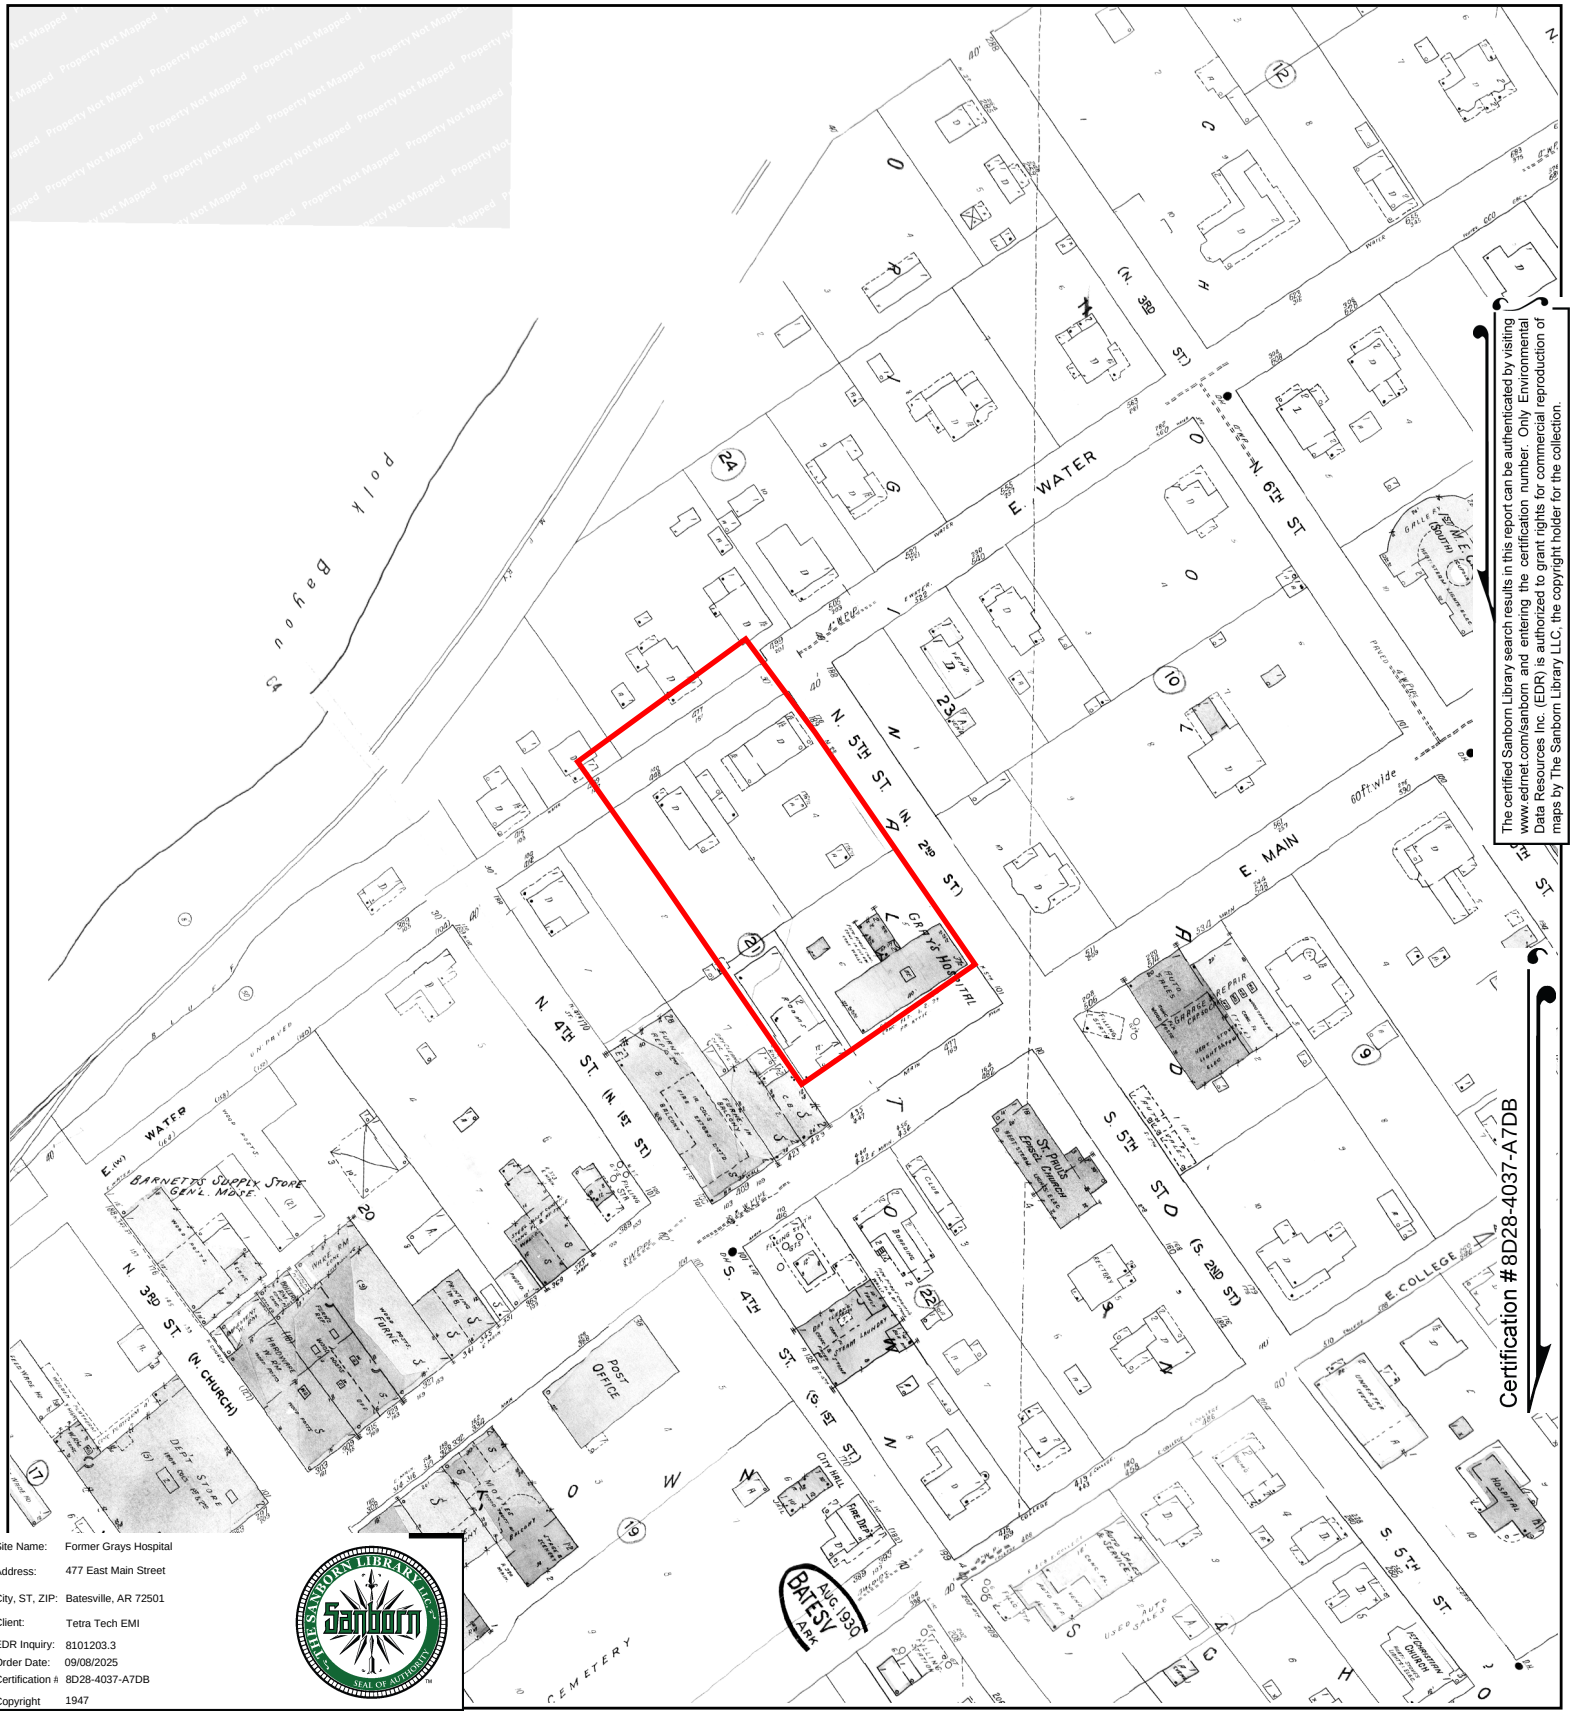

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #:	8D28-4037-A7DB
Copyright	1947

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.



Volume 1, Sheet 4
Volume 1, Sheet 2

0 Feet 150 300 600

N

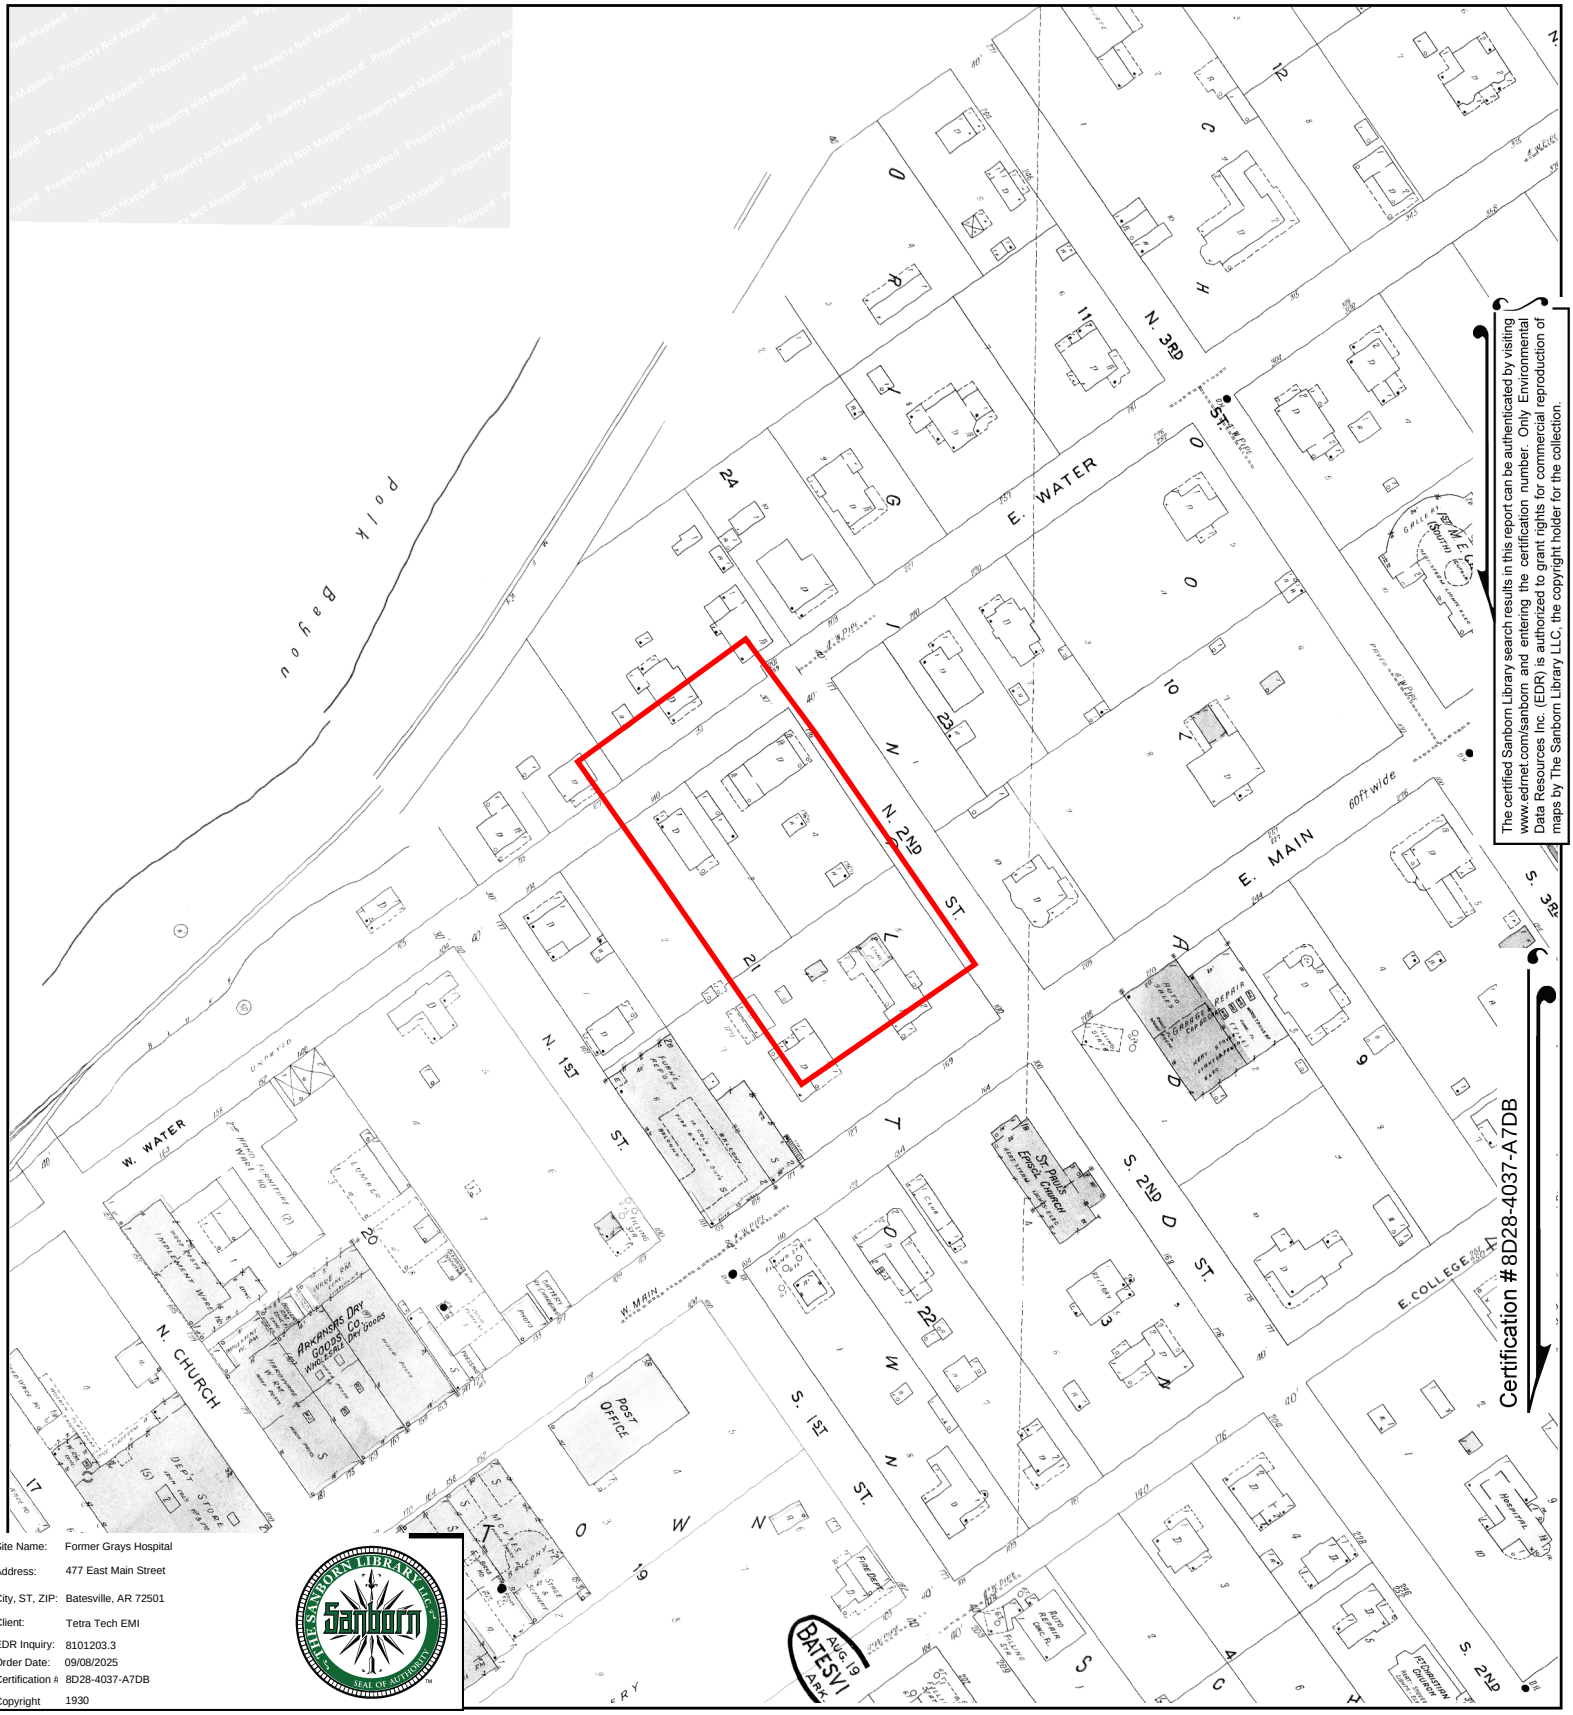

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #	8D28-4037-A7DB
Copyright	1930

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.



Volume 1, Sheet 2
Volume 1, Sheet 4

0 Feet 150 300 600

N

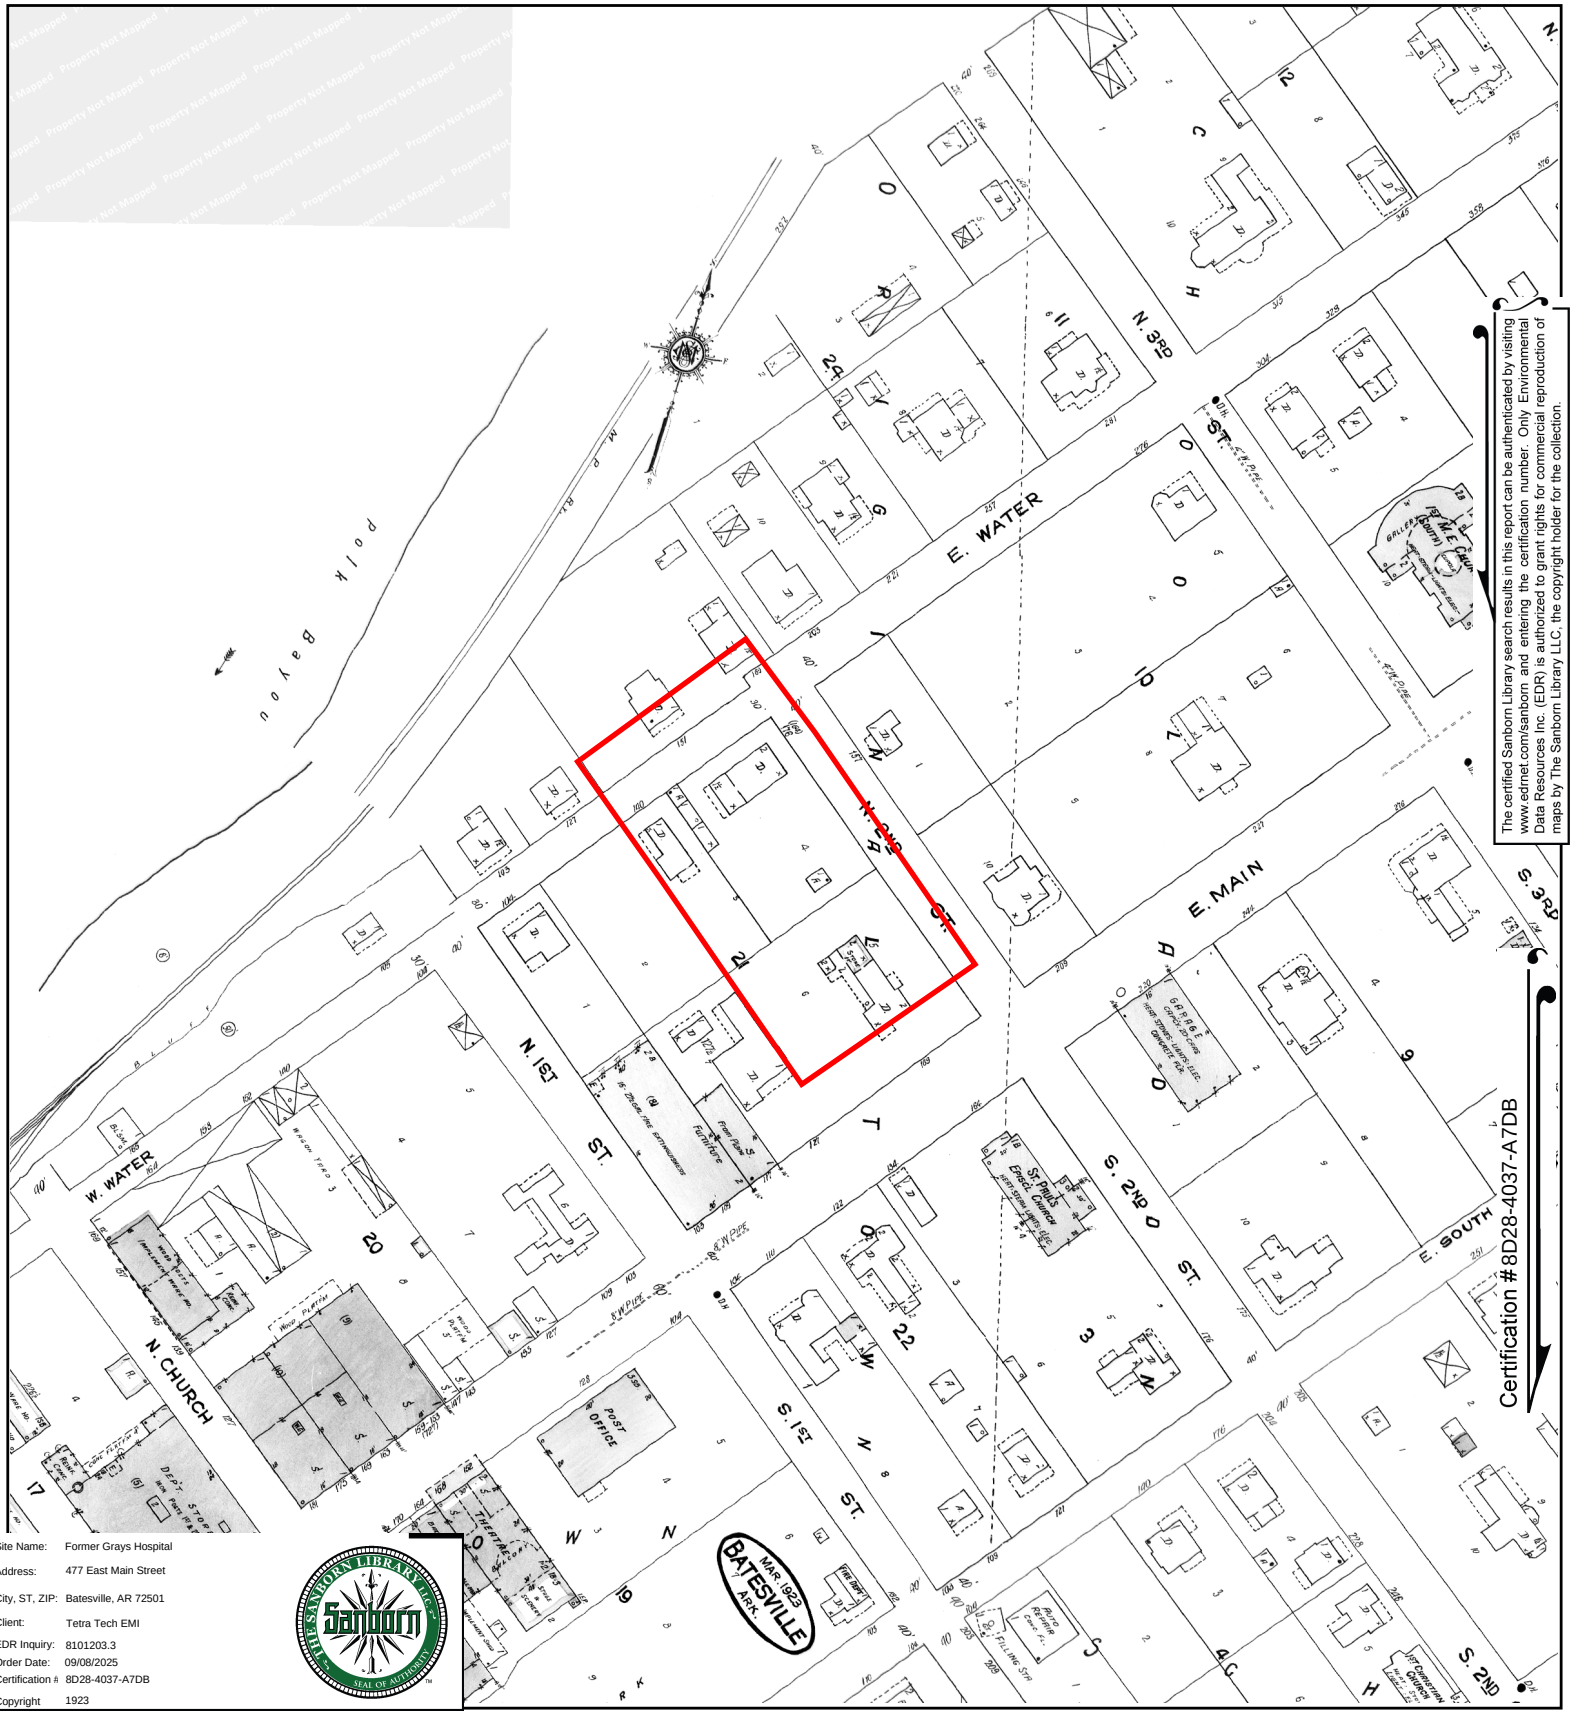

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #	8D28-4037-A7DB
Copyright	1923

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.

0 Feet 150 300 600



Volume 1, Sheet 3
Volume 1, Sheet 4

N

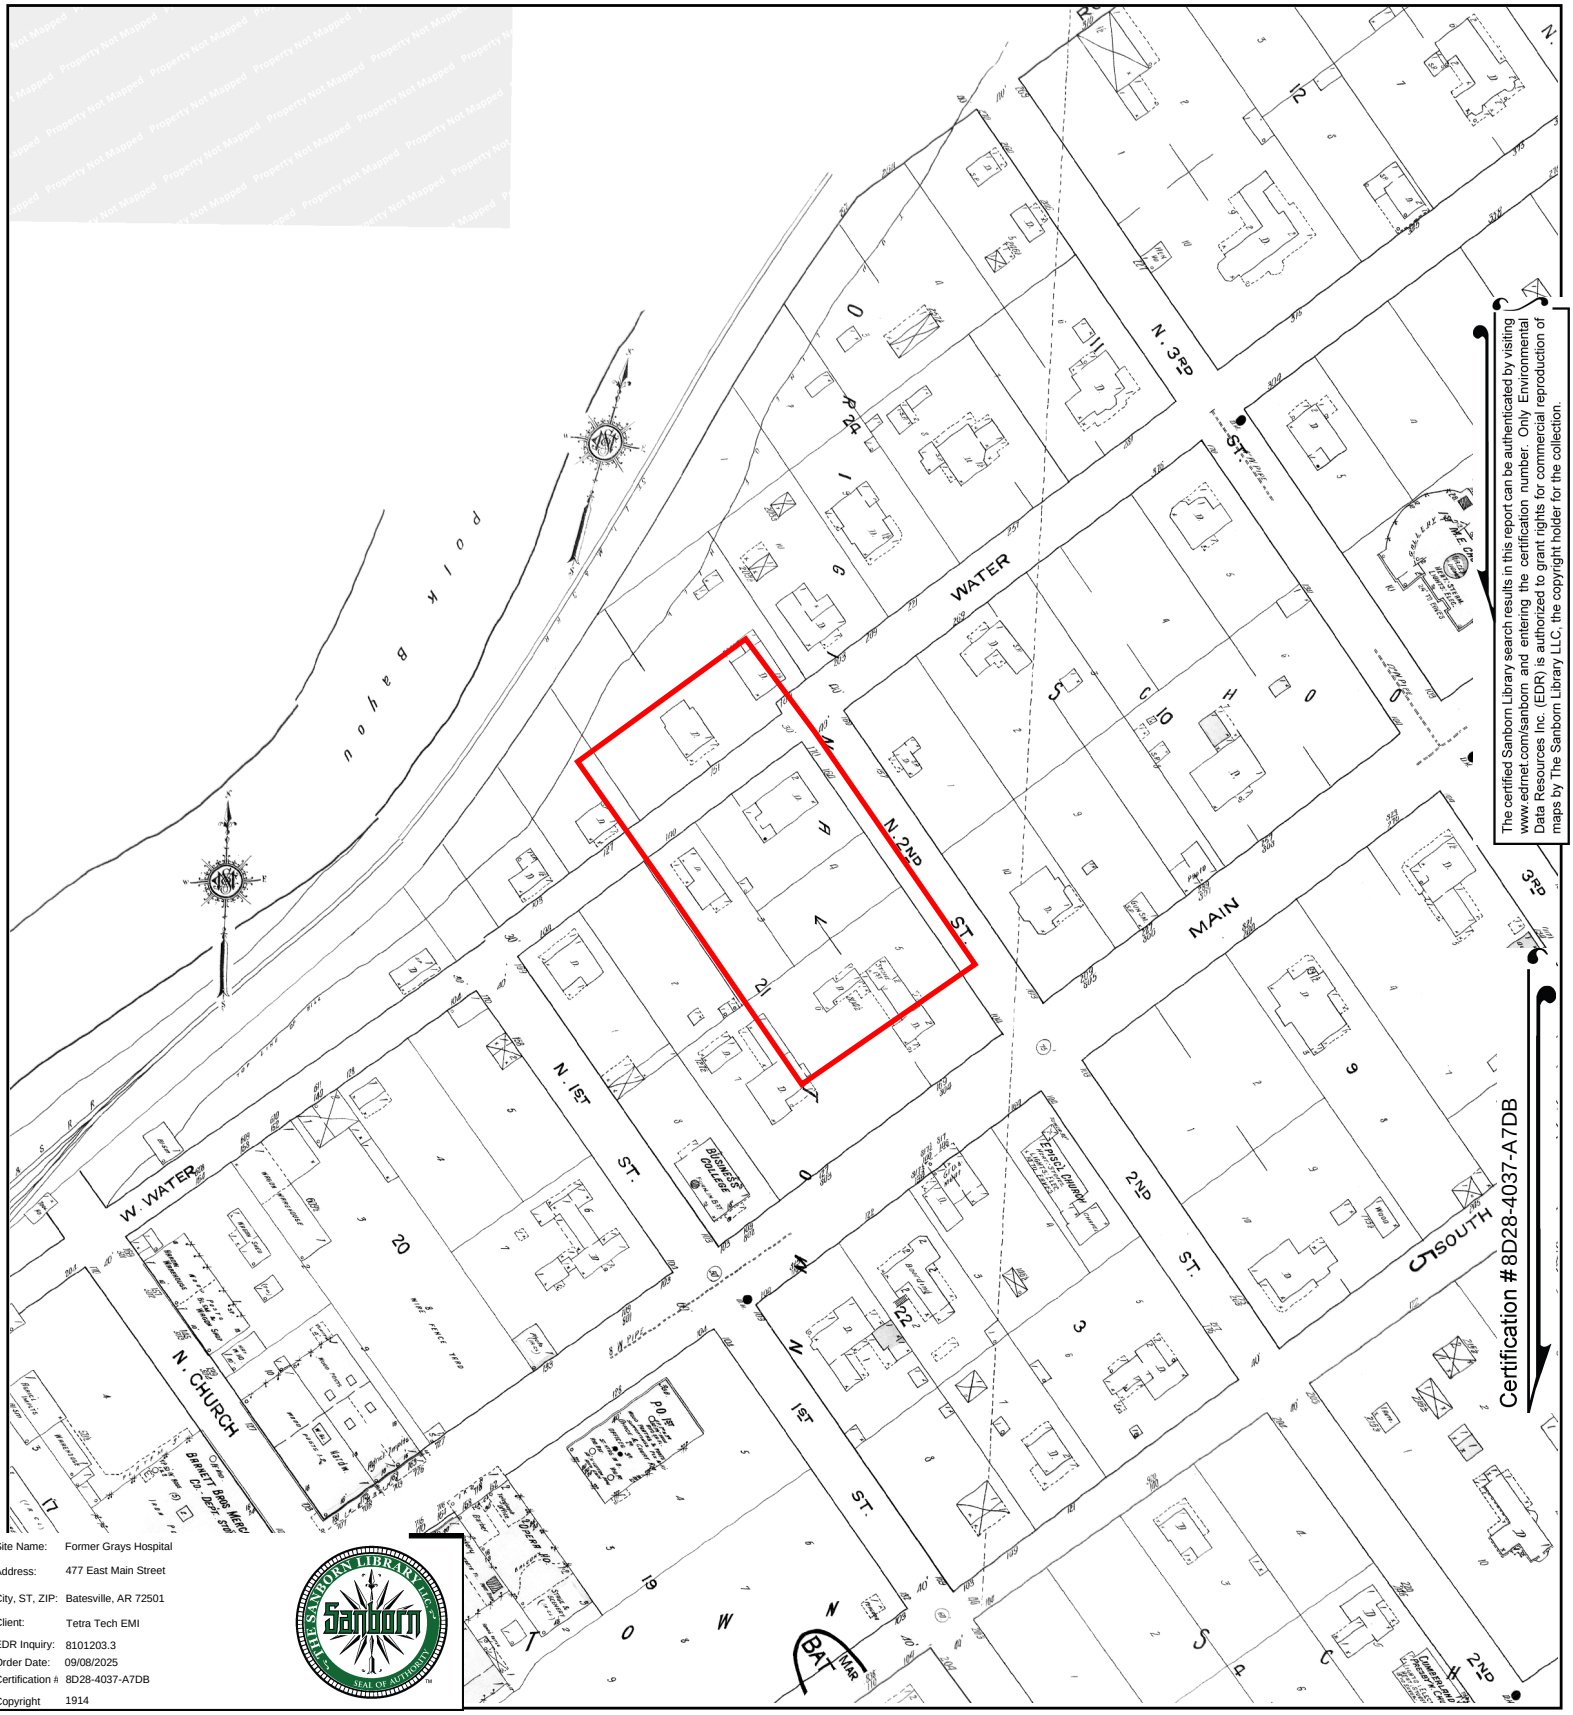

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #	8D28-4037-A7DB
Copyright	1914

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.





Volume 1, Sheet 6
Volume 1, Sheet 4

0 Feet 150 300 600

N

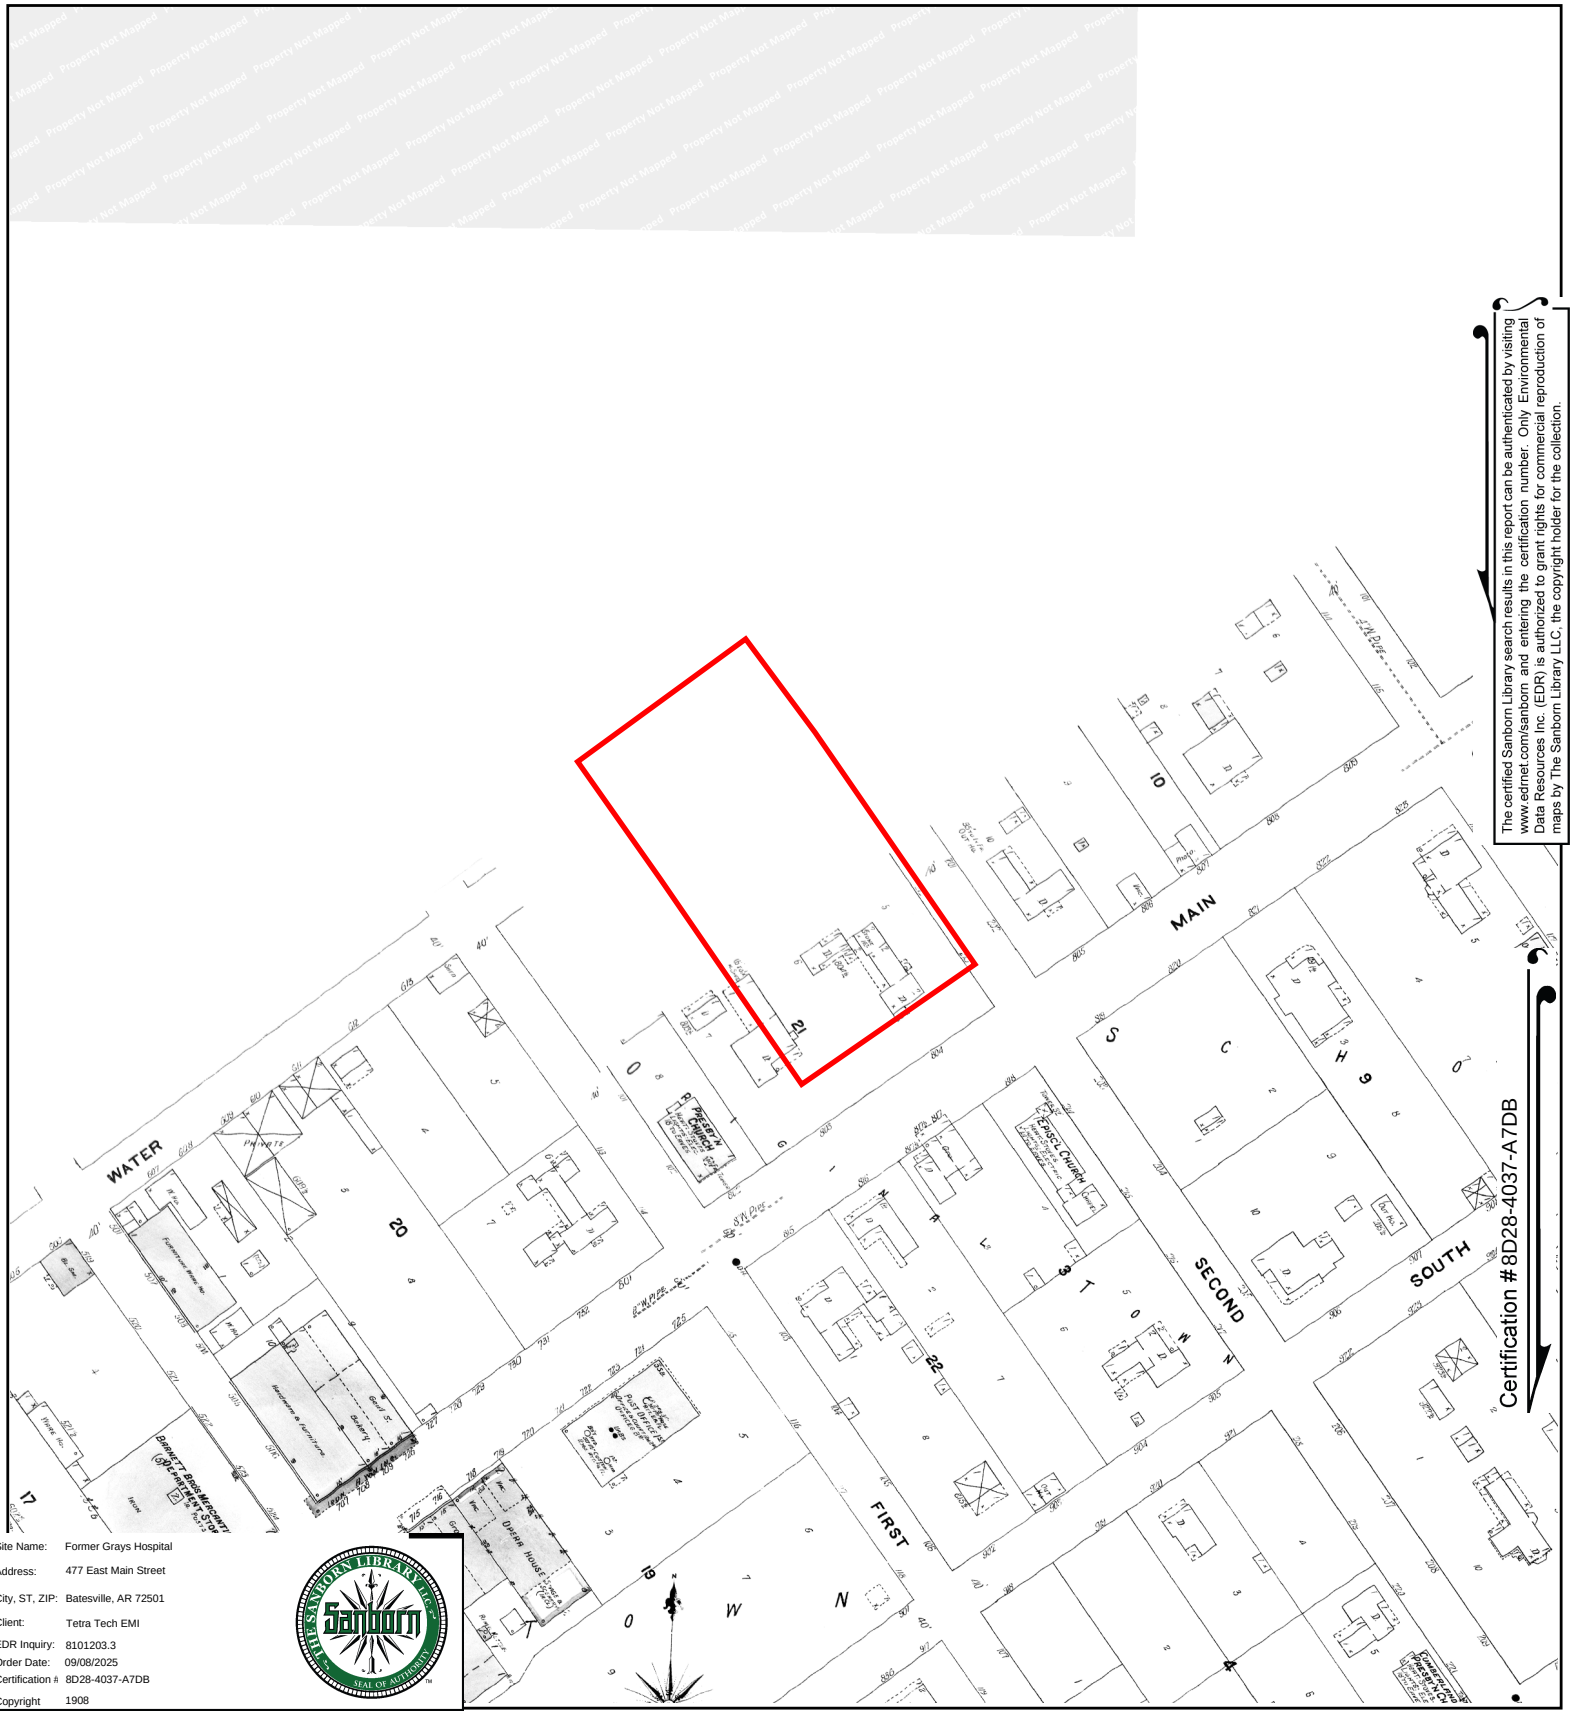

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #:	8D28-4037-A7DB
Copyright	1908

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.

Volume 1, Sheet 3
Volume 1, Sheet 4

0 Feet 150 300 600

N

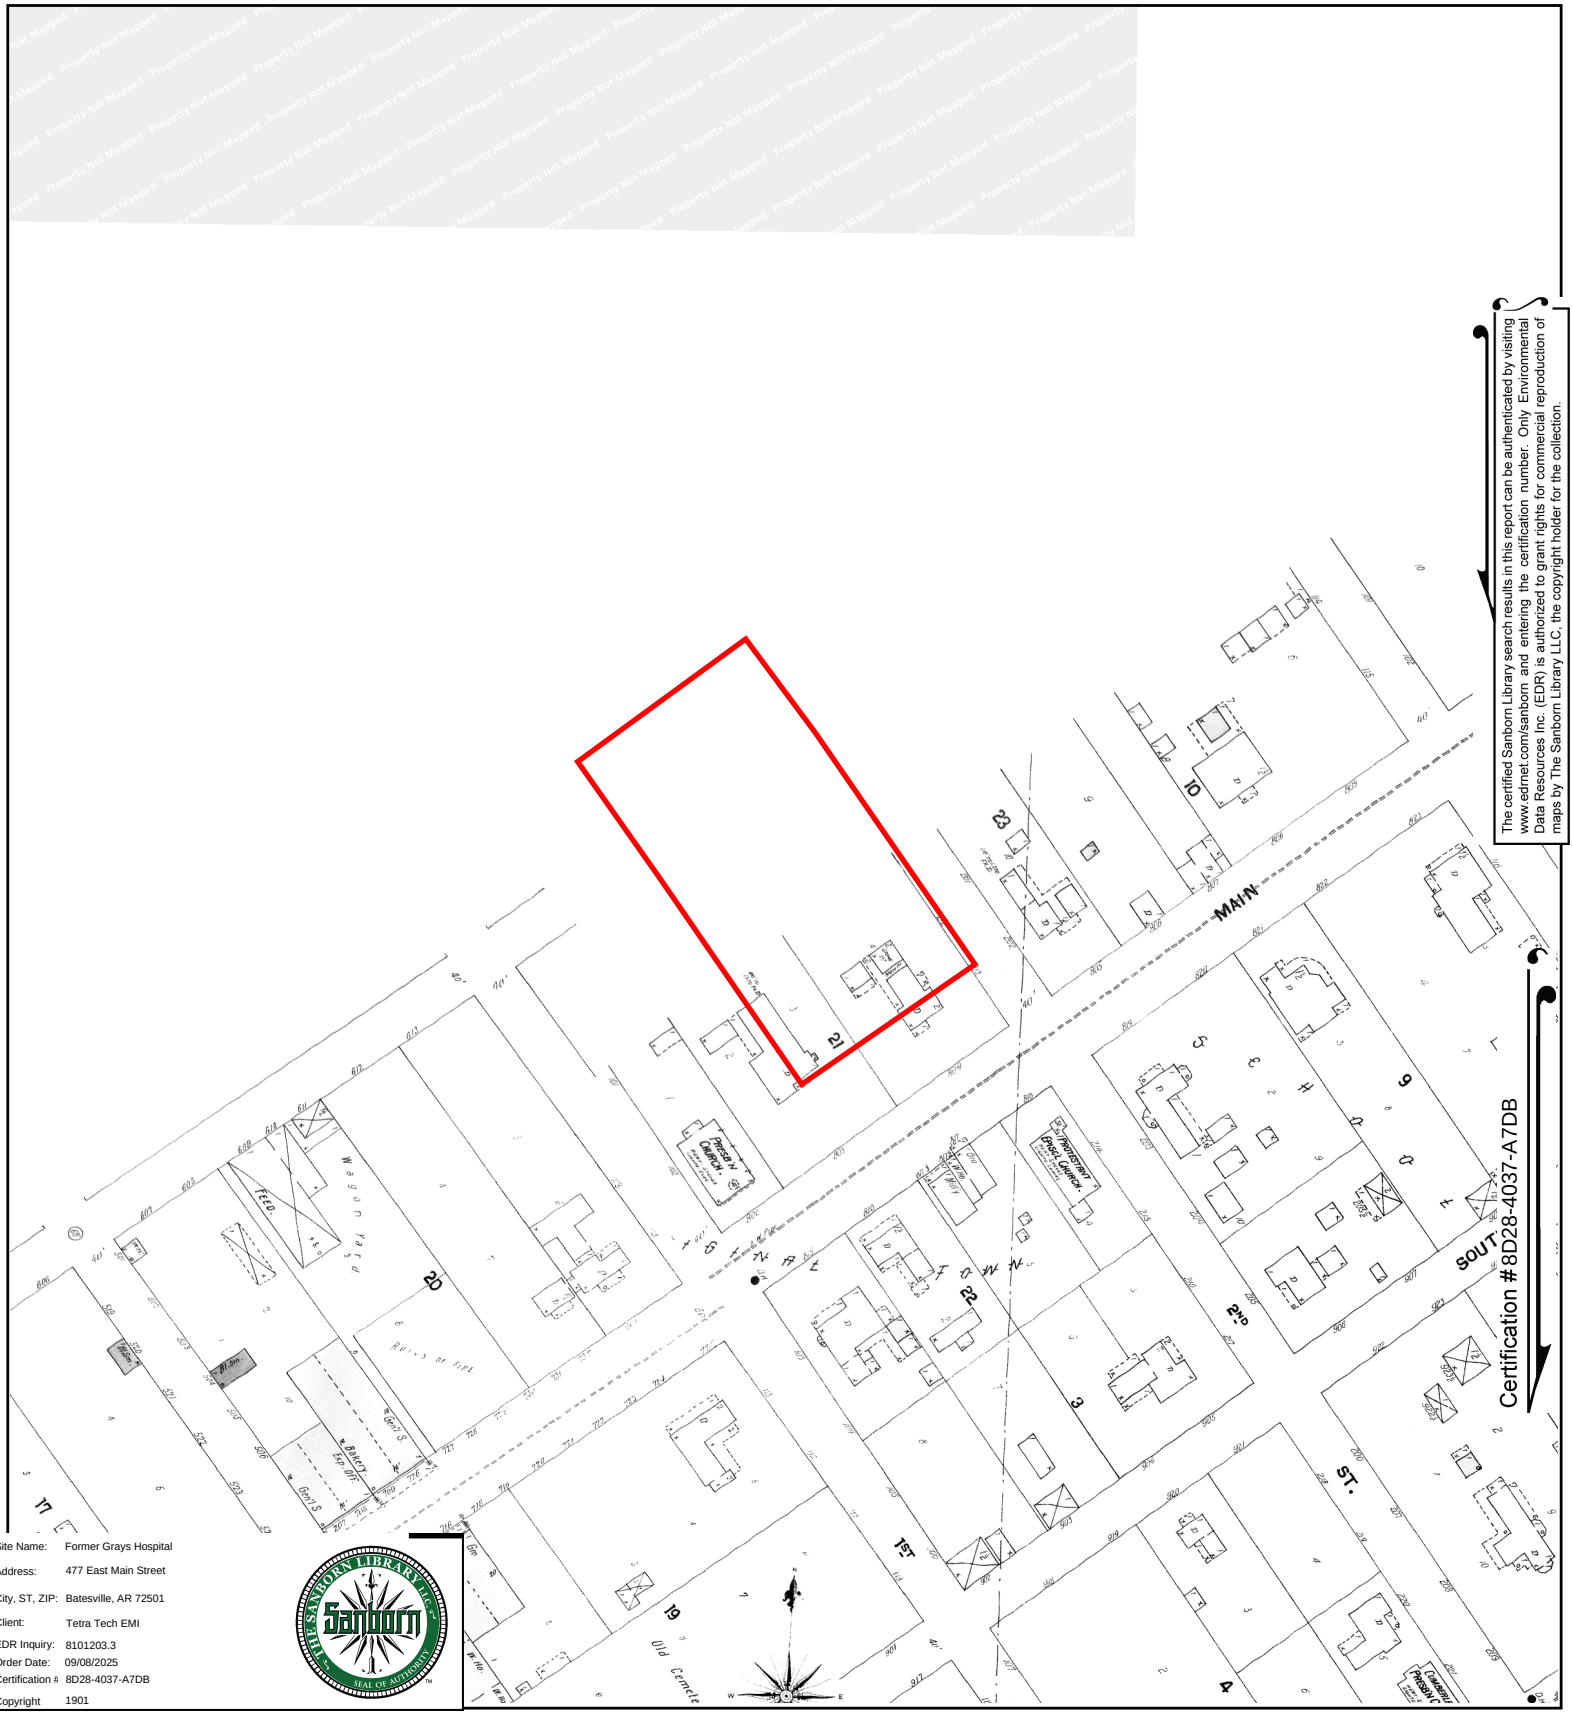

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #:	8D28-4037-A7DB
Copyright	1901

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.

Volume 1, Sheet 4
Volume 1, Sheet 3

0 Feet 150 300 600

N

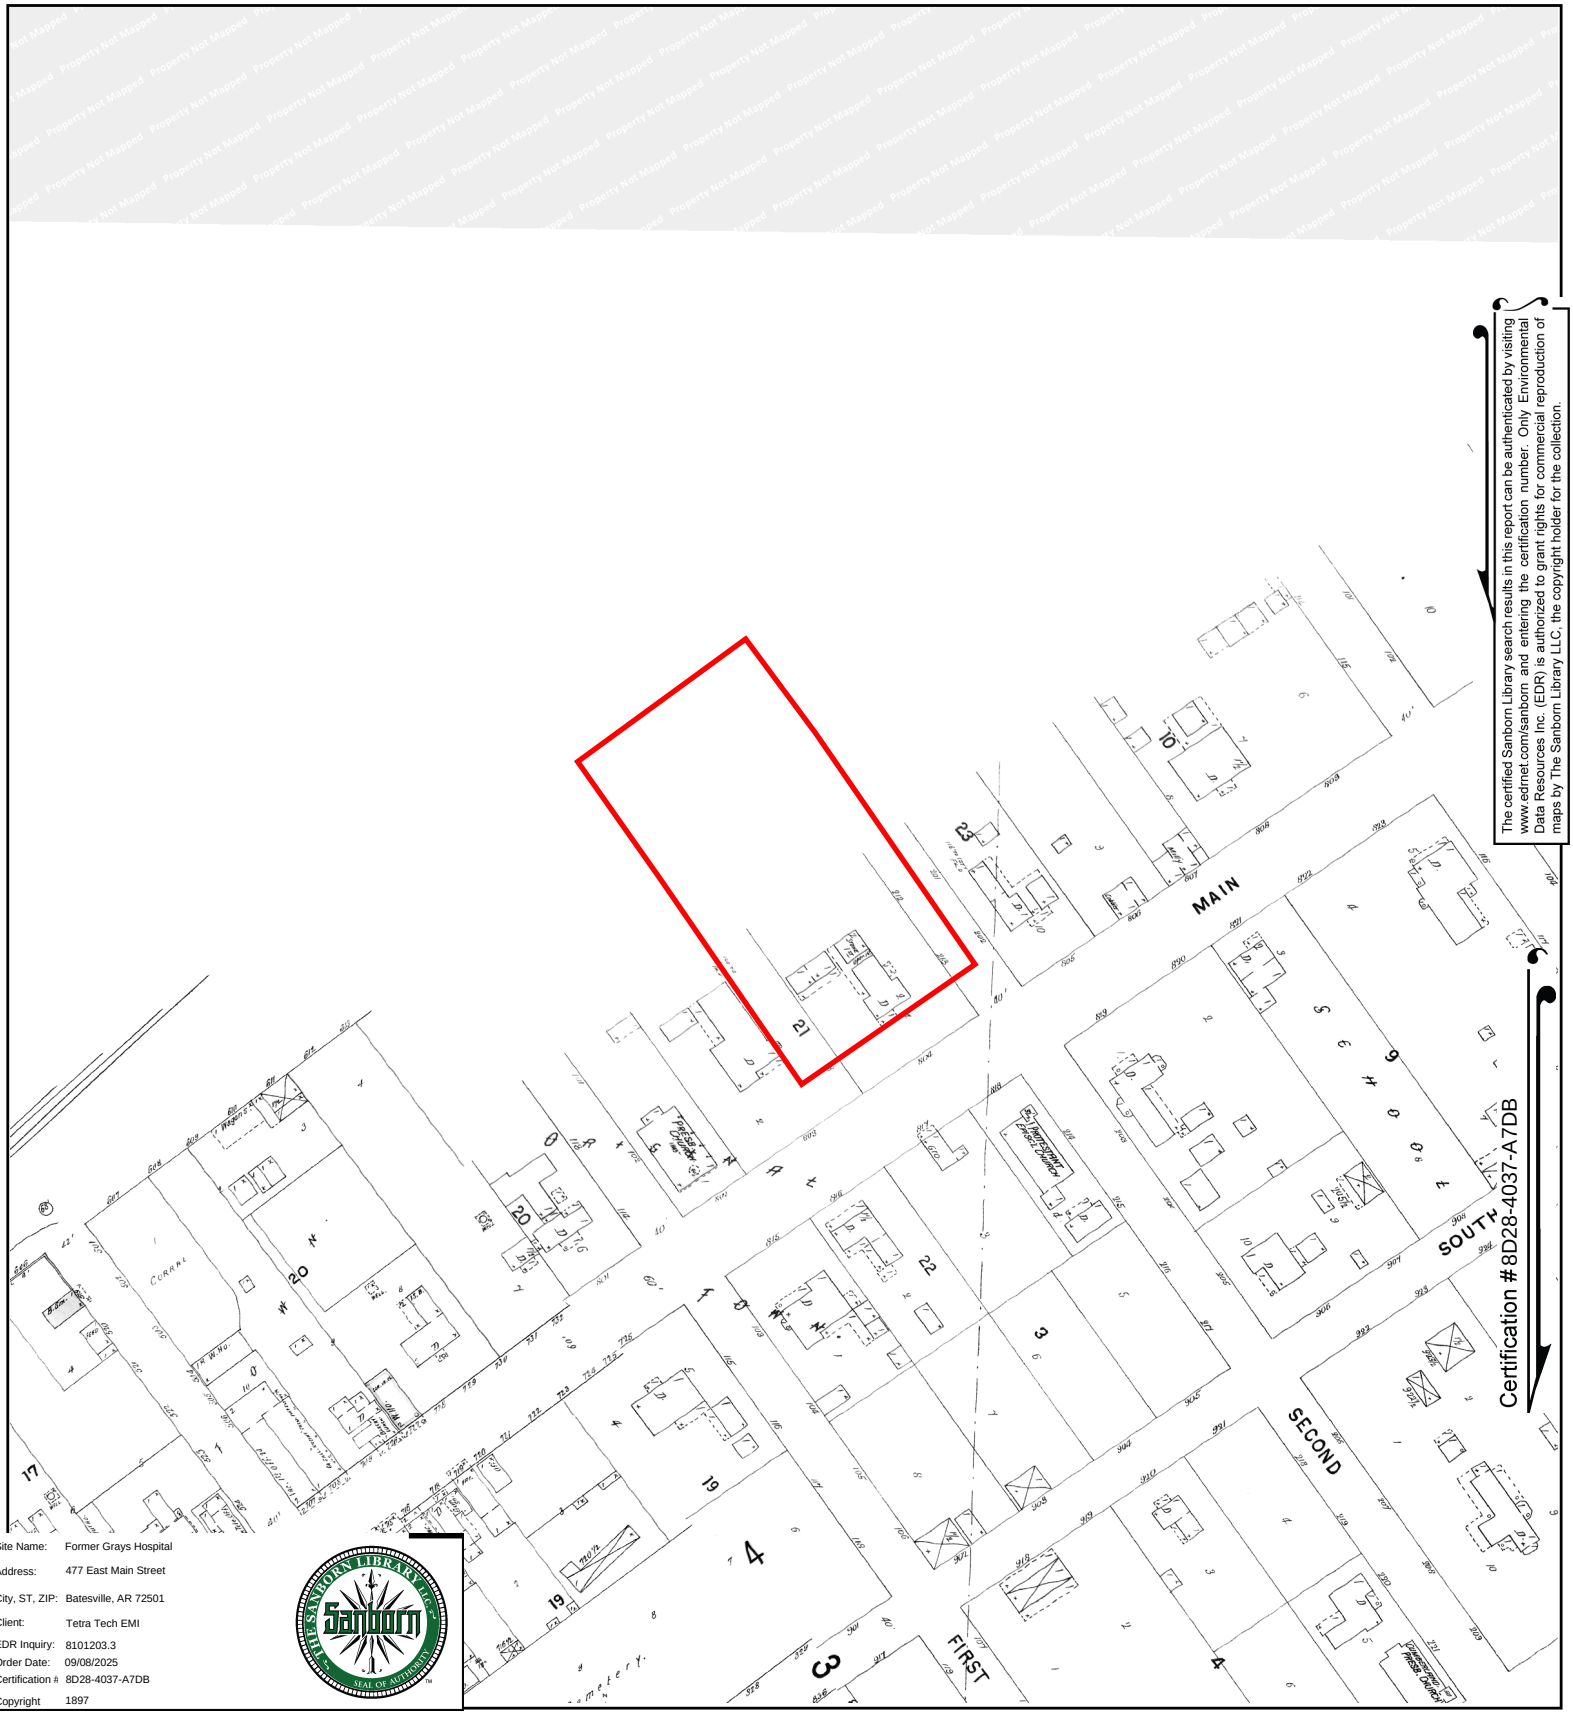

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #	8D28-4037-A7DB
Copyright	1897

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.



Volume 1, Sheet 3
Volume 1, Sheet 4

0 Feet 150 300 600

N

The certified Sanborn Library search results in this report can be authenticated by visiting www.edrnet.com/sanborn and entering the certification number. Only Environmental Data Resources Inc. (EDR) is authorized to grant rights for commercial reproduction of maps by The Sanborn Library LLC, the copyright holder for the collection.

Certification #8D28-4037-A7DB

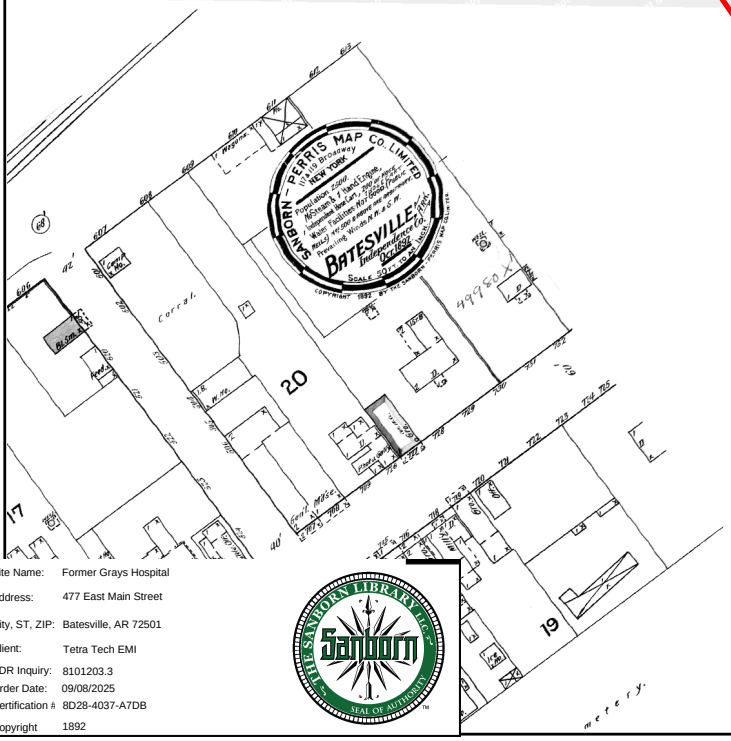

Site Name:	Former Grays Hospital
Address:	477 East Main Street
City, ST, ZIP:	Batesville, AR 72501
Client:	Tetra Tech EMI
EDR Inquiry:	8101203.3
Order Date:	09/08/2025
Certification #:	8D28-4037-A7DB
Copyright	1892

This Certified Sanborn Map combines the following sheets.
Outlined areas indicate map sheets within the collection.

0 Feet 150 300 600





Volume 1, Sheet 1

N

Former Grays Hospital
477 East Main Street
Batesville, AR 72501

Inquiry Number: 8101203.5
September 10, 2025

The EDR-City Directory Image Report

EDR® Environmental Data Resources Inc

6 Armstrong Road
Shelton, CT 06484
800.352.0050
www.edrnet.com

TABLE OF CONTENTS

SECTION

Executive Summary

Findings

City Directory Images

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, LLC. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. This Report is provided on an "AS IS", "AS AVAILABLE" basis. **NO WARRANTY EXPRESS OR IMPLIED IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, LLC AND ITS SUBSIDIARIES, AFFILIATES AND THIRD PARTY SUPPLIERS DISCLAIM ALL WARRANTIES, OF ANY KIND OR NATURE, EXPRESS OR IMPLIED, ARISING OUT OF OR RELATED TO THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT, INCLUDING WITHOUT LIMITATION, ANY WARRANTIES REGARDING ACCURACY, QUALITY, CORRECTNESS, COMPLETENESS, COMPREHENSIVENESS, SUITABILITY, MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, NON-INFRINGEMENT, MISAPPROPRIATION, OR OTHERWISE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, LLC OR ITS SUBSIDIARIES, AFFILIATES OR THIRD PARTY SUPPLIERS BE LIABLE TO ANYONE FOR ANY DIRECT, INCIDENTAL, INDIRECT, SPECIAL, CONSEQUENTIAL OR OTHER DAMAGES OF ANY TYPE OR KIND (INCLUDING BUT NOT LIMITED TO LOSS OF PROFITS, LOSS OF USE, OR LOSS OF DATA), ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS REPORT OR ANY OF THE DATA AND INFORMATION PROVIDED IN THIS REPORT.** Any analyses, estimates, ratings, environmental risk levels, or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only an assessment performed by a qualified environmental professional can provide findings, opinions or conclusions regarding the environmental risk or conditions in, on or at any property.

Copyright 2023 by Environmental Data Resources, LLC. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, LLC, or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, LLC or its affiliates. All other trademarks used herein are the property of their respective owners.

EXECUTIVE SUMMARY

DESCRIPTION

Environmental Data Resources, Inc.'s (EDR) City Directory Report is a screening tool designed to assist environmental professionals in evaluating potential liability on a target property resulting from past activities. EDR's City Directory Report includes a search of available business directory data at approximately five year intervals.

RECORD SOURCES

The EDR City Directory Report accesses a variety of business directory sources, including Haines, InfoUSA, Polk, Cole, Bresser, and Stewart. Listings marked as EDR Digital Archive access Cole and InfoUSA records. The various directory sources enhance and complement each other to provide a more thorough and accurate report.

EDR is licensed to reproduce certain City Directory works by the copyright holders of those works. The purchaser of this EDR City Directory Report may include it in report(s) delivered to a customer.

RESEARCH SUMMARY

The following research sources were consulted in the preparation of this report. A check mark indicates where information was identified in the source and provided in this report.

Year	*Target Street*	*Cross Street*	*Source*
2022	☑	☑	EDR Digital Archive
2017	☑	☐	Cole Information
2014	☑	☑	Cole Information
2010	☑	☑	Cole Information
2005	☑	☑	Cole Information
2000	☑	☐	Cole Information
1995	☑	☑	Cole Information
1992	☑	☑	Cole Information

FINDINGS

TARGET PROPERTY STREET

477 East Main Street
Batesville, AR 72501

Year	*CD Image*	*Source*
E MAIN ST		
2022	pg A2	EDR Digital Archive
2017	pg A6	Cole Information
2014	pg A7	Cole Information
2010	pg A10	Cole Information
2005	pg A13	Cole Information
2000	pg A16	Cole Information
1995	pg A17	Cole Information
1992	pg A20	Cole Information

FINDINGS

CROSS STREETS

Year	*CD Image*	*Source*	
S 5TH ST			
2022	pg. A5	EDR Digital Archive	
2017	-	Cole Information	Target and Adjoining not listed in Source
2014	pg. A9	Cole Information	
2010	pg. A12	Cole Information	
2005	pg. A15	Cole Information	
2000	-	Cole Information	Target and Adjoining not listed in Source
1995	pg. A19	Cole Information	
1992	pg. A21	Cole Information	

City Directory Images

Target Street	Cross Street	Source
✓	-	EDR Digital Archive

E MAIN ST 2022

101	BIGS OF BATESVILLE
	SHERRY STOTT
115	CIX MAIN
	HIDDEN TREASURES
120	CLARA JANE & JAX
129	AUTRYS WHITE RIVER FURNITURE
	TODD AUTRY
140	MAIN STREET MASSAGE & BODYWORK
	STREET MAIN
143	BRYCES BAIL BONDING
157	PRIMEVAL LABS TRAINING CENTER MAIN STREET GYM
192	BRADLEY COUNTY. COMMITTEE CO
	BRIAN PRESLEY
	CITY OF INDEPENDENCE CLERKS OFFICE
	COUNTY INDEPENDENCE
	DEBORAH WYATT
	FAMILY VIOLENCE PREVENTION
	FAMILY VIOLENCE PREVENTION INC
	GLEN WILLIS
	GWEN WARNETT
	HARKEY JOHN NORMAN OFC
	INDEPENDENCE ARKANSAS
	INDEPENDENCE COUNTY OEM
	INDEPENDENCE COUNTY OF
	INDEPENDENCE COUNTY YARD
	INDEPENDENCE RECORDER OF DEEDS
	INDEPENDENCE, COUNTY OF
	JONATHAN PICKERING
	LISA RODRIGUEZ
	MARGARET BOOTHBY
	ROBERT BOB TREADWAY
	VETERANS SERVICE OFFICE
206	BATESVILLE BALLET ETC
	CINDY HOVERT
	NORTH ARKANSAS DANCE THEATRE
215	BREAD OF LIFE
	PHYLLIS COWAN
226	BATESVILLE AREA ARTS COUNCIL
	COLLEEN JACKSON
231	ELIZABETH WHITE
	ELIZABETHS RESTAURANT & CATERING
243	ALINE MCCRACKEN
	CHARLIES ANGELS
	GALLERY 246
	KATHY INSELL
246	BRYANT & WELBORN
	JILLENE ROBERTSON
	JILLS ALTERATIONS
	MARSHA COLE
	PAIGE DIRKSEN

Target Street	Cross Street	Source
✓	-	EDR Digital Archive

E MAIN ST 2022 (Cont'd)

246	VIRTUE BOUTIQUE
248	BATESVILLE TITLE SERVICES
	ERIC BRAY
250	BABBS UPHOLSTERY
266	QUEEN ANNS LACE FLOWERS GIFTS
267	A AMERICAN BANKRUPTCY LAWYER
	FRANK NEWTON
	INDEPENDENCE COUNTY EMERGENCY
	INDEPENDENCE COUNTY LIBRARY
	MAIN STREET BATESVILLE
	PRO-LYCO
	TS BOXED LUNCHESES
	VANESSA ADAMS
276	FELLOWSHIP BIBLE CHURCH O
	JOHN RUTTER
286	MAXFIELDS ANTIQUESES
301	EARTH STATION NURSERY
	FIRST COMMUNITY BANK
	PLATTER INN MUSIC STORE
308	SCHWEGMANS OFFICE SUPPLY
	TERRY KING
325	POCKET PARK
347	JIM WANN
	WANN OFFICE SUPPLY
363	BENEATH THE WILLOW
	ELAINE HUNTERM
	HOME HOLIDAYS AND MORE
368	DON MCSPADDEN
	DRUG TASK FORCE
	INDEPENDENCE JUVENILE COURT
	INDEPENDENCE, COUNTY OF
	INDEPENDENCE-COUNTY PROSECUTING ATTORNEY
	LEE HARROD
	VANESSA ADAMS
	VOLUNTEER CLEARING HOUSE
	WHITE RIVER REGIONAL LIBRARY
369	EMBROIDERY & BEYOND
377	BEVERLY PITTS
	PETALS AND PLANTS FLORIST
407	OLD TOWN MALL
	TERRI CHESTER
410	T-SHIRT EXPRESS
424	JOHN DRYMON
	SAINT PAULS EPISCOPAL CHURCH
500	ALAN COCKRILL
	BATESVILLE WATER UTILITIES
	BELEW & BELL
	BLAIR & STROUD
	CAROL HELM
	CITY OF BATESVILLE

Target Street	Cross Street	Source
✓	-	EDR Digital Archive

E MAIN ST 2022 (Cont'd)

500	CITY OF BATESVILLE CITY HALL
	CITY OF BATESVILLE CODE ENFORCEMENT
	CITY OF BATESVILLE LANDSDCAPING DEPARTMENT
	DAMON JOHNSON
	DAVID H BLAIR
	JOHN BELEW
	MATTHEW FREDERICK
	METHODIST FAMILY CLINIC
	MICHELLE C HUFF ATTORNEY
	MICHELLE HUFF
	NORTH ARKANSAS SEAMLESS GUTTERS
	ROBERT D STROUD
	ROBERT D STROUD ATTORNEY
	STEVE BELL
555	ARNOLD BLAIR
	DONNIE WASHAM
	JERRY BRIGHTWELL
	MERCHANTS & PLANTERS BANK
	MERCHANTS AND PLANTERS BANK
561	DIANE TEBBETTS
	ELEANORE TEBBETTS
	ELENORE TEBBETTS
	TERRELL TEBBETTS
610	FIRST BAPTIST CHURCH
	GENE TULBERG
615	BATESVILLE FIRST UNITED METHODIST CHURCH
	MARK MCDONALD

Target Street	Cross Street	Source
-	✓	EDR Digital Archive

S 5TH ST 2022

106 ANDREW MCDONALD
CATHERINE MCDONALD
JAMES MCDONALD

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2017

101	BIGS OF BATESVILLE
109	JOHNSONS RESTAURANT & STORE FIXTURE
129	AUTRYS WHITE RIVER FURNITURE
130	THE STYLING ROOM
140	BATESVILLE GUN & PAWN
146	RANDYS MUSIC
187	FURNITURE 4 LESS
192	COUNTY OF INDEPENDENCE
	FAMILY VIOLENCE PREVENTION
	WHITE RIVER HYDRO PROJECT
206	NADT DANCE ACADEMY
220	CHILL FACTORY
231	ELIZABETHS RESTAURANT & CATERING
243	GALLERY ART
246	BATESVILLE AREA ARTS COUNCIL
248	BATESVILLE TITLE SERVICES
255	THOMPSONS JEWELRY STORE
267	MAIN STREET BATESVILLE
276	FELLOWSHIP BIBLE CHURCH
301	EARTH STATION NURSERY
308	SCHWEGMANS OFFICE SUPPLY
309	DANCING ROBIN DANCEWEAR THE
325	OLD WORLD LANTERNS BY BENOIT
327	ELECTRIC WONDERLAND
345	FRINGE SALON
347	WANN OFFICE SUPPLY
359	JILLS ALTERATIONS
363	HOME FOR THE HOLIDAYS
368	COUNTY OF INDEPENDENCE
377	PETALS & PLANTS FLORIST
407	OLD TOWN MALL
410	TSHIRT EXPRESS
417	EMBROIDERY & BEYOND
424	ST PAULS EPISCOPAL CHURCH
500	BATESVILLE WATER UTILITIES
	BELL STEVE
	BLAIR & STROUD
	CASTLEBERRY, T
	CITY OF BATESVILLE
	METHODIST FAMLY CLINIC
	STEVE BELL ATTORNEY AT LAW
	STROUD-ROBERT, DEBORAH L
	T LINDSEY CASTLEBERRY ATTORNEY AT LA
555	J T SKINNER ATTORNEY
	MERCHANTS & PLANTERS BANK
	MURPHY THOMPSON ARNOLD SKINNER & CAS
561	TEBBETTS, TERRELL L
610	FIRST BAPTIST CHURCH
615	FIRST UNITED METHODIST CHURCH

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2014

101	BIGS OF BATESVILLE
109	IMPULSE
129	AUTRYS WHITE RIVER FURNITURE
130	STYLING ROOM THE
	VELMAS FAMILY SALON
140	BATESVILLE GUN & PAWN
143	BRYCES BAIL BONDING INC
146	RANDYS MUSIC
158	LA KORITA
187	FURNITURE 4 LESS
192	COUNTY OF INDEPENDENCE
	FAMILY VIOLENCE PREVENTIO
	HARKEY JOHN NORMAN OFC
	MAIN ST BATESVILLE
	US DEPARTMENT OF VETERANS AFFAIRS
	WHITE RIVER HYDRO PROJECT
206	NADT DANCE ACADEMY
217	BACK IN TIME ANTIQUES
226	HEUERS FAMILY SHOES
231	ELIZABETHS RESTAURANT & CATERING
246	BATESVILLE AREA ARTS COUNCIL
248	BATESVILLE TITLE SERVICES
255	THOMPSONS JEWELRY STORE
262	FLORES, KATHRYN
267	PRO DENTEC
276	FELLOWSHIP BIBLE CHURCH OF BATESVILL
301	EARTH STATION NURSERY
308	SCHWEGMANS OFFICE SUPPLY
309	LOUS MUSIC STORE
	TREBLE CLEF MUSIC STORE
325	OLD WORLD LANTERNS BY BENOIT
327	ELECTRIC WONDERLAND
345	INDEPENDENCE COUNTY ECONOMIC DEVELOP
347	WANN OFFICE SUPPLY
359	JILLS ALTERATIONS
368	COUNTY OF INDEPENDENCE
	WHITE RIVER REGIONAL LIBRARY
377	VINTAGE VINE
407	OLDE TOWNE MALL ANTIQUES & FLEA MA
409	PIONEER GENERAL STORE
417	EMBROIDERY & BEYOND
424	ST PAULS EPISCOPAL CHURCH
500	BATESVILLE WATER UTILITIES
	BELL STEVE ATTORNEY AT LAW
	BLAIR & STROUD ATTYS
	BLAIR H DAVID ATTY
	BLAIR, DAVID
	CASTLEBERRY T LINDSEY ATTORNEY AT LA
	CASTLEBERRY, T
	CITY OF BATESVILLE

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2014 (Cont'd)

500	HUFF MICHELLE C ATTY
	METHODIST COUNSELING CLINIC
	PFEIFFER WATER ASSOCIATION
	STALKER SCOTT M ATTY
	STROUD ROBERT D ATTY
555	MERCHANTS & PLANTERS BANK
561	OCCUPANT UNKNOWN,

Target Street	Cross Street	Source
-	✓	Cole Information

S 5TH ST 2014

106 OCCUPANT UNKNOWN,
345 OCCUPANT UNKNOWN,

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2010

129	AUTRYS WHITE RIVER FURNITURE
130	VELMAS FAMILY HAIR SALON
134	RENEES UPHOLSTERY
140	BATESVILLE GUN & PAWN SHOP
143	BRYCES BAIL BONDING
	ETTAS ATTIC
146	RANDYS MUSIC
148	LA KORITA
158	NANCYS EMBROIDERY
187	FURNITURE 4 LESS
192	BUILDING MAINTENANCE
	FAMILY VIOLENCE PREVENTION
	INDEPENDENCE CIRCUIT CLERK
	INDEPENDENCE CIRCUIT JUDGE
	INDEPENDENCE CIRCUIT REPORTER
	INDEPENDENCE CLERKS OFFICE
	INDEPENDENCE COUNTY CLERKS
	INDEPENDENCE COUNTY JUDGE
	INDEPENDENCE COUNTY SUPPLY YD
	INDEPENDENCE RECORDER OF DEEDS
	INDEPENDENCE TREASURERS OFC
	WHITE RIVER HYDRO PROJECT
206	BATESVILLE BALLET ETC
217	BACK IN TIME ANTIQUES
220	DEES HAIR & SCULPTURE NAIL
226	HEUERS FAMILY SHOES
231	ELIZABETHS RESTAURANT & CTRNG
243	CHARLIES ANGELS
246	BATESVILLE AREA ARTS COUNCIL
248	BATESVILLE TITLE SVC
250	CHARLIES MENS WEAR
255	THOMPSONS JEWELRY STORE
262	FLORES, KATHRYN
267	PRO DENTEC
286	MY MYRA ANTIQUES & UNIQUES
296	SKINNERS JEWELRY
301	PLATTER INN MUSIC STORE
306	TEXARKANA MUSIC CTR
309	TREBLE CLEF MUSIC STORE
327	ANOTHER SEASON II
347	WANN OFFICE SUPPLY
359	JILLS ALTERATIONS
368	DRUG TASK FORCE
	INDEPENDENCE CNTY AUDITOR
	INDEPENDENCE CNTY HOT CHECK
	INDEPENDENCE COUNTY EMERGENCY
	INDEPENDENCE JUVENILE COURT
	INDEPENDENCE JUVENILE JUDGE
	INDEPENDENCE PROSECUTING ATTY
	POLICE DISPATCH

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2010 (Cont'd)

368	VOLUNTEER CLEARING HOUSE
	WHITE RIVER REGIONAL LIBRARY
377	HIDDEN TREASURES
407	OLD TOWN MALL
409	PIONEER GENERAL STORE INC
500	BATESVILLE CITY HALL
	BATESVILLE CITY YARD
	BATESVILLE CODE ENFORCEMENT
	BATESVILLE WATER UTILITIES
	BELEW & BELL
	BIS OF ARKANSAS
	GRADY, JERRIE L
	JUDY BELEW REALTORS
	STROUD-ROBERT, DEBORAH L
561	TEBBETTS, TERRELL L
615	EARLY LEARNING CTR
	FIRST UNITED METHODIST CHURCH
655	PLANTLIFE

Target Street	Cross Street	Source
-	✓	Cole Information

S 5TH ST 2010

106 OCCUPANT UNKNOWN,
345 HEARN, HUGH M

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2005

101	GOOD OLD DAYS ANTIQUE MALL
115	ELECTRONICS UNLIMITED
134	RENEES UPHOLSTERY
140	B & H PAWN & GUN SHOP
146	RANDYS MUSIC
157	PO BOYS FURNITURE
	POBOYS FURNITURE
158	NANCYS EMBROIDERY
187	FURNITURE 4 LESS
	WILLIAM E HOLIFIELD
192	BUILDING MAINTENANCE
	COUNTY JUDGES OFFICE
	FAMILY VIOLENCE PREVENTION
	INDEPENDENCE COUNTY OF RECORDER
217	BACK IN TIME ANTIQUES
220	DEES HAIR & SCULPTURE NAIL
226	HEUERS FAMILY SHOES
243	CHARLIES ANGEL
246	BARTLESVILLE AREA ART COUNCIL
248	BARTLESVILLE TITLE SERVICES
250	CHARLIES MENS WEAR
	JUNIOR JUNCTION
266	AFFORDABLE PC
	MONDAY SHOE STORE INC
296	SKINNERS JEWELRY
301	PLATTER INN MUSIC STORE
308	SCHWEGMANS
309	TREBLE CLEF MUSIC STORE
327	ANOTHER SEASON
347	WANN OFFICE SUPPLY
359	JILLS ALTERATIONS
368	INDEPENDENCE COUNTY LIBRARY
	INDEPENDENCE COUNTY OF JUVENILE COUR
	WHITE RIVER REGIONAL LIBRARY
377	CATALOG OUTLET
409	GUNSMITH INC
424	SAINT PAULS EPISCOPAL CHURCH
500	BARTLESVILLE WATER UTILITIES
	BELEW AND BELL
	BELEW, JUDY R
	BIS OF ARKANSAS
	CITYBATESVILLE
	CIVIL SERVICES INC
	GRADY, JERRIE L
	LAW OFFICE OF JERRIE L GRADY
	S RIDER LLC
	SCOTT M STALKER
	STROUD, ROBERT
	UNITED STATES HOUSE REP
	UNITED STT GOVERNMENT U S REP MRN

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2005 (Cont'd)

500	WILSON KATHARINE C
	WOLFGANG PROFESSIONAL SERVICES INC
555	BARTLESVILLE MERCHANTS & PLANTERS BA
561	TEBBETTS, TERRELL L
610	FIRST BAPTIST CHURCH
615	DAY OUT PRE SCHOOL
	FIRST UNITED METHODIST CHURCH

Target Street	Cross Street	Source
-	✓	Cole Information

S 5TH ST 2005

345 HEARN, HUGH M

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 2000

115	RADIO SHACK DEALER STORE/ELECTRONICS UNLIMITED
130	VELMAS FAMILY HAIR SALON
143	GARY EDWARDS BONDING INCORPORATED
146	GLYNN WOOD INSURANCE AGENCY
	RANDYS MUSIC
157	CLOSET DOOR THE
158	TOLLIVERS
187	DOLLAR GENERAL STORE
192	HARKEY JOHN NORMAN
217	BACK IN TIME ANTIQUES
226	HEUERS FAMILY SHOES
231	DON QUIXOTES DOS
	OCCUPANT UNKNOWN,
243	HAIL DRY GOODS COMPANY INCORPORATED
246	MERLE NORMAN COSMETIC STUDIO
250	CHARLIES MENS WEAR
255	THOMPSON, DAVID
309	TREBLE CLEF MUSIC STORE
310	BATESVILLE BOOKSTORE
327	MARKS SPORTS CARDS
359	GRAMMER, JOHN S
368	HIVELY T J ATTORNEY
369	BRADS VACUUM & SEWING CENTER
418	DOMINIQUES FASHION CAFE
424	BYARS W RANDALL INTERIORS
	RANDALLS II
447	BIRCH TREE COMMUNITY INCORPORATED THE
500	BATESVILLE CITY OF MAYORS OFFICE
	BATESVILLE CITY OF WATER DEPARTMENT
	BELEW JUDY REALTOR
	BELL STEVE ATTORNEY
	BLANKENSHIP LEROY ATTORNEY
	COUCH BILL CPA
	COUCH, B
	DAVIDSON J SCOTT ATTORNEY
	DAVIDSON, J
	HUGHES ROBERT J JR CPA
	MCGAHA, BOBBY
535	BALL NELS & SONS MOTOR COMPANY
555	MERCHANTS & PLANTERS BANK
561	TEBBETTS, TERRELL
620	BLANTON, NATHAN
633	OCCUPANT UNKNOWN,

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 1995

101	ARMY & NAVY STORE
115	RADIO SHACK ELECTRONICS
117	GUN RACK
129	AUTRYS WHITE RIVER FURNITURE
130	VELMAS FAMILY HAIR SALON
134	FINAL TOUCH GIFT SHOP
143	J E BOND & PAWN
148	FACTORY CONNECTION
157	KAYS SHOES
187	DOLLAR GENERAL STORE
192	BUILDING MAINTENANCE
	FAMILY VIOLENCE PREVENTION
	INDEPENDENCE BOARD EDUCATION
	INDEPENDENCE CHANCERY JUDGE
	INDEPENDENCE CIRCUIT CLERK
	INDEPENDENCE CIRCUIT JUDGE
	INDEPENDENCE CIRCUIT REPORTER
	INDEPENDENCE CLERKS OFFICE
	INDEPENDENCE COUNTY JUDGES
	INDEPENDENCE JUVENILE INTAKE
	INDEPENDENCE JUVENILE JUDGE
	INDEPENDENCE RECORDER OF DEEDS
	INDEPENDENCE SUPPLY YARD
	INDEPENDENCE TREASURERS OFC
201	ULTIMATE FASHION OUTLET
206	DIFFERENT LOOKS
217	SKINNERS FURNITURE STORE INC
220	BATESVILLE BOUTIQUE
226	HEUERS FAMILY SHOES
243	HAIL DRY GOODS CO
	JUNIOR JUNCTION
246	MERLE NORMAN COSMETIC STUDIO
248	KIDS & CO
250	CHARLIES MENS WEAR
266	MONDAYS SHOE STORE
267	SHEIDS FURNITURE APPLIANCE CO
286	CITY DRUG STORE & GIFT SHOP
296	SKINNERS JEWELRY
301	PLATTER INN MUSIC STORE
307	MCCUBBIN, MINNIE
309	TREBLE CLEF MUSIC STORE
310	BATESVILLE BOOKSTORE
312	TOLLIVERS
325	ROBERT O SEAT PHOTOGRAPHY
327	JANETS
330	HAHNS LOCK & KEY
332	LANDERS THEATRE
334	SMALL WORLD GROOMING SHOP
345	HIVELY & KETZ
	T J HIVELY

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 1995 (Cont'd)

345 VICKIE J WARNER
347 WANN OFFICE SUPPLY
355 CARTER, M
368 CHILD SUPPORT ENFORCEMENT
INDEPENDENCE COUNTY LIBRARY
INDEPENDENCE EMERGENCY SVC
INDEPENDENCE EMPLOYEE CU
INDEPENDENCE MUNICIPAL COURT
INDEPENDENCE PROSECUTING ATTY
INDEPENDENCE SHERIFFS OFFICE
INDEPENDENCE UNITED WAY
369 CUSTOMIZED COMPUTERS
377 DEVAZIER, RICHARD H
FIRST IMPRESSIONS CATALOG
400 DRUG TASK FORCE
409 PIONEER GENERAL STORE
416 GARCIAS EXXON & WRECKER SVC
418 BONNIES USED FURNITURE
ECONOMY MOVERS
LAWRENCE, RON
419 EASTMAN, V
424 DONS TV
MCINTIRE, DON
500 AUTO RENTAL RESOUCE CTR
BATESVILLE CITY HALL
BATESVILLE MAYORS OFFICE
BATESVILLE WATER UTILITY MAIN
BELEW & BELL
JOHN BELEW
509 SOUTHARD, BESSIE
535 NELS BALL & SONS MOTOR
561 TEBBETTS, TERRELL
610 FIRST BAPTIST CHURCH
615 FIRST UNITED METHODIST CHURCH

Target Street	Cross Street	Source
-	✓	Cole Information

S 5TH ST 1995

106 MCLEAN, JAMES R JR

Target Street	Cross Street	Source
✓	-	Cole Information

E MAIN ST 1992

55	SMITH, GENE
424	MCINTIRE, DON
500	HUGHES, ROBERT J JR
	MILLIGAN, TOMMY J
	WELCH, JOHN E

Target Street	Cross Street	Source
-	✓	Cole Information

S 5TH ST 1992

106 MCLEAN, JAMES R JR
345 PRIDDY, C M

APPENDIX G PREVIOUS ENVIRONMENTAL REPORTS

ASBESTOS INSPECTION REPORT

Former Grays Hospital
477 E. Main Street
Batesville, AR

prepared for:
Markowski Investment Holdings, LLC
ATTN: Mr. Joey Markowski and their assigns
3001 Harrison Street
Batesville, AR 72501
joeymarkowski@hotmail.com

prepared by:
Snyder Environmental
7705 Northshore Place
North Little Rock, AR 72118
P: (501)801-2776 F: (501)907-1129
E: jstuart@snyderenvironmental.com

SnyderEnvironmental.com

Table of Contents

Introduction 3

Purpose of Study 3

Sampling Plan 3

Analytical Methodology 4

Findings 4-8

Positive ACM/RACM Materials 8

Report of findings 8-9

Limitations 9

Regulatory requirement and recommendations 10-13

Disclaimer 13

Appendix A – Laboratory Analysis Reports

Appendix B – Photographs

Appendix C – Site Diagrams

Appendix D - Certifications

ASBESTOS INSPECTION REPORT

Former Grays Hospital
477 E. Main Street
Batesville, AR

Introduction

This report summarizes findings and recommendations regarding the potential presence of asbestos-containing materials (ACM) in the former Grays Hospital located at 477 E. Main Street in Batesville, Arkansas. ADEQ Licensed Inspectors, Justin Stuart & Lyle Bradshaw, performed the on-site study to: 1) identify suspect homogeneous materials, 2) collect bulk samples for analysis, and 3) quantify suspect homogeneous materials. The on-site investigation was performed on 12 & 13 April 2018.

Purpose of Study

The purpose of this study was to confirm or deny the presence of asbestos in the site materials intended to be disturbed, or likely to be disturbed during the course of future renovation or demolition projects, to identify the location of the ACM, to provide response action recommendations, and to facilitate the renovation or demolition schedule. This inspection meets the Arkansas Department of Environmental Quality's (ADEQ) requirement for a "thorough inspection" for asbestos.

Sampling Plan

DEFINITIONS: Homogeneous materials are those building materials that, by visual and manual inspection, are similar in texture, color, composition and use in the building, and are deemed to be the same material. Suspect homogeneous materials are homogeneous materials that are likely to or are suspected of containing asbestos. Friable materials are those materials that are easily crumbled, crushed or pulverized. A building material is defined as an "asbestos-containing" material (ACM) by the U.S. EPA and state regulations if that material contains >1% asbestos.

If all samples collected of a homogeneous material, subsequent to analysis by an EPA accredited laboratory, result in ≤1% or "no asbestos" being detected, the material is deemed to be asbestos free for the purpose of EPA regulations.

Approximately one to three samples were collected from each suspect asbestos containing material. All samples were collected in a random fashion in order to evaluate the asbestos content of each homogeneous material. Determination of homogeneous materials includes material type, texture, pattern, color, and size.

Analytical Methodology

Asbestos samples are sent to Environmental Enterprise Group (EEG) in Russellville, AR NVLAP number 101587-0. Samples are analyzed via Polarized Light Microscopy (PLM) with dispersion staining.

Findings

During the inspection, a total of eighty-four (84) suspect homogenous materials were identified and one hundred sixty-one (161) bulk samples were collected. The table below summarizes the suspect homogenous materials sampled and the analytical results:

Sample #	Description	Location	Percent Asbestos	Condition
Roof Samples				
477R-01-01	Lower Roof – Field Roofing	Roof of Back Middle Building	ND	Good
477R-02-02	**Lower Roof – Penetration Mastic**	**Penetrations on Back Middle Building**	**20% Chrysotile**	**Good**
477R-03-03	Middle Roof – Field Roofing	Breezeway Area	ND	Good
477R-04-04	**Middle Roof – Penetration Mastic**	**Penetrations on Breezeway Area**	**15% Chrysotile**	**Good**
477R-05-05	Side Roof – Field Roofing	Over Generator Building	ND	Good
477R-06-06	Side Roof – Penetration Mastic	Penetrations on Roof Over Generator	ND	Good
477R-07-07	Side Roof – Flashing	Flashing on Roof Over Generator	ND	Good
477R-08-08	Upper Roof – Field Roofing	Roof of Main Structure	ND	Good
477R-09-09	Upper Roof – Penetration Mastic	Penetrations on Main Structure	ND	Good
4th Floor Samples				
4774-01-01 4774-01-02	**Lt. Brown Cove Base & Mastic**	**Interior Rooms of 4th Floor**	**2% Chrysotile**	**Good**
4774-02-03 4774-02-04	Dark Brown Cove Base & Mastic	Hallways of 4th Floor	ND	Good
4774-03-05 4774-03-06	**Dark Tan 9x9 FT / Mastic**	**Throughout 4th Floor**	**10% Chrysotile**	**Good**
4774-04-07 4774-04-08	**Lt. Tan 9x9 FT / Mastic**	**Patch Areas of 4th Floor**	**8% Chrysotile**	**Good**
4774-05-09 4774-05-10	2x4 Lay-in Ceiling Tile (Type I)	Throughout 4th Floor	ND	Good
4774-06-11 4774-06-12	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas of 4th Floor	ND	Good
4774-07-13 4774-07-14	Spray-on Fire Proofing	Above Ceiling - Throughout	ND	Good
4774-08-15 4774-08-16	Pipe Insulation	Above Ceiling - Throughout	ND	Good
4774-09-17 4774-09-18	Wall Plaster	Throughout 4th Floor	ND	Good
4774-10-19 4774-10-20	Drapery Material	Interior Room Windows	ND	Good
4774-11-21 4774-11-22	White Perimeter Window Caulk	Exterior Windows of 4th Floor	ND	Good

3rd Floor Samples				
4773-01-01 4773-01-02	Dark Brown Cove Base & Mastic	Throughout 3rd Floor	ND	Good
4773-02-03 4773-02-04	2x4 Lay-in Ceiling Tile (Type I)	Hallways of 3rd Floor	ND	Good
4773-03-05 4773-03-06	Wall Plaster	Throughout 3rd Floor	ND	Good
4773-04-07 4773-04-08	Ceiling Plaster	Throughout 3rd Floor – Above Grid	ND	Good
4773-05-09 4773-05-10	**Tan 12x12 FT / Mastic**	**Throughout 3rd Floor – Layered with 9x9 FT / Mastic**	**10% Chrysotile**	**Good**
4773-06-11 4773-06-12	**Gray 12x12 FT / Mastic**	**Patch Areas on 3rd Floor – Layered with 9x9 FT / Mastic**	**4% Chrysotile**	**Good**
4773-07-13 4773-07-14	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas in 3rd Floor Hallways	ND	Good
4773-08-15 4773-08-16	**FT / Mastic under Carpeting**	**Room off North "T" at Rear of 3rd Floor**	**8% Chrysotile**	**Good**
4773-09-17 4773-09-18	Window Glazing	Exterior Windows of 3rd Floor	ND	Good
2nd Floor Samples				
4772-01-01 4772-01-02	Dark Brown Cove Base & Mastic	Throughout 2nd Floor	ND	Good
4772-02-03 4772-02-04	2x4 Lay-in Ceiling Tile (Type I)	Hallways of 2nd Floor	ND	Good
4772-03-05 4772-03-06	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas of 2nd Floor	ND	Good
4772-04-07 4772-04-08	2x4 Lay-in Ceiling Tile (Type III)	Patch Areas of 2nd Floor	ND	Good
4772-05-09 4772-05-10	**Tan 12x12 FT / Mastic**	**Throughout 2nd Floor**	**2% Chrysotile**	**Good**
4772-06-11 4772-06-12	**Gray 12x12 FT / Mastic**	**Patch Area of 2nd Floor**	**4% Chrysotile**	**Good**
4772-07-13 4772-07-14	White/Black 12x12 FT / Mastic	West End of 2nd Floor	ND	Good
4772-08-15 4772-08-16	**Flat Black 9x9 FT / Mastic**	**File Room – West End of 2nd Floor**	**4% Chrysotile**	**Good**
4772-09-17 4772-09-18	12x12 Ceiling Tiles	Hallways of 2nd Floor – Above Grid	ND	Good
4772-10-19 4772-10-20	Yellow Mastic Pucks	Hallways of 2nd Floor – Above Grid	ND	Good
4772-11-21 4772-11-22	**Black Mastic Pucks**	**Hallways of 2nd Floor – Above Grid**	**3% Chrysotile**	**Good**
4772-12-23 4772-12-24	Brown 12x12 FT / Mastic	W Corner Room – 2nd Floor	ND	Good

4772-13-25 4772-13-26	**Fire Door Insulation**	**Entrance to Stairwell**	**10% Amosite**	**Good**
4772-14-27 4772-14-28	Wall Plaster	Throughout 2nd Floor	ND	Good
4772-15-29 4772-15-30	Ceiling Plaster	Throughout 2nd Floor	ND	Good
4772-16-31 4772-16-32	**Gray 9x9 FT / Mastic**	**2nd Floor Kitchen Wing**	**10% Chrysotile**	**Good**
4772-17-33 4772-17-34	**Off-White 12x12 FT / Mastic**	**Newer Kitchen Wing – 2nd Floor**	**10% Chrysotile**	**Good**
4772-18-35 4772-18-36	6" Cove Base & Mastic	Older Kitchen Wing – 2nd Floor	ND	Good
4772-19-37 4772-19-38	Perimeter Window Caulk	Exterior Windows of Kitchen Area	ND	Good
4772-20-39 4772-20-40	Window Glazing	Patient Room Windows	ND	Good
4772-21-41 4772-21-42	Drywall / Joint Compound	Bathroom Partitions	ND	Good
4772-22-43 4772-22-44	**Glossy 4x24 FT / Mastic**	**File Room Border – West End of 2nd Floor**	**4% Chrysotile**	**Good**
1st Floor Samples				
4771-01-01 4771-01-02	Perimeter Door Caulk	Exterior Doors – 1st Floor	ND	Good
4771-02-03 4771-02-04	Perimeter Window Caulk	Exterior Windows – 1st Floor	ND	Good
4771-03-05 4771-03-06	Window Glazing	Exterior Windows – East Rear Area	ND	Good
4771-04-07 4771-04-08	Exterior Surfacing	1st Floor Rear Wing (Morgue)	ND	Good
4771-05-09 4771-05-10	Stair Tread Material	All Stairwells in Middle of Structure	ND	Good
4771-06-11 4771-06-12	**Dark Brown 9x9 FT / Mastic**	**Mop Room by Rear Entrance**	**10% Chrysotile**	**Good**
4771-07-13 4771-07-14	Wall Plaster	Throughout Original 1st Floor Structure	ND	Good
4771-08-15 4771-08-16	Ceiling Plaster	Throughout Original 1st Floor Structure	ND	Good
4771-09-17 4771-09-18	Drywall / Joint Compound	Partitions in Front 1st Floor Addition	ND	Good
4771-10-19 4771-10-20	**Yellow/Tan 12x12 FT / Mastic**	**Throughout Original 1st Floor Structure**	**2% Chrysotile**	**Good**
4771-11-21 4771-11-22	**Tan 12x12 FT / Mastic**	**Throughout 1st Floor Front Addition**	**8% Chrysotile**	**Good**
4771-12-23 4771-12-24	**Brown 12x12 FT / Mastic**	**Accents in 1st Floor Front Addition**	**4% Chrysotile**	**Good**

4771-13-25 4771-13-26	**12x12 FT / Mastic under Carpeting**	**Various Rooms in Original 1st Floor Structure & New Addition**	**3% Chrysotile**	**Good**
4771-14-27 4771-14-28	2x4 Lay-in Ceiling Tile (Type I)	Hallway of Original 1st Floor Structure	ND	Good
4771-15-29 4771-15-30	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas in Original 1st Floor Structure	ND	Good
4771-16-31 4771-16-32	12x12 Ceiling Tile (Type I)	Above Grid in Original 1st Floor Area	ND	Good
4771-17-33 4771-17-34	12x12 Ceiling Tile (Type II)	Exposed in (1) Room – NE Hall Area	ND	Good
4771-18-35 4771-18-36	12x12 Ceiling Tile (Type III)	Exposed in (2) Rooms – NE Hall Area & by Old/New Junction	ND	Good
4771-19-37 4771-19-38	**Dark Tan 12x12 FT / Mastic**	**SW Room at End of Hall – Original 1st Floor Area**	**5% Chrysotile**	**Good**
4771-20-39 4771-20-40	**Floral Print Sheet Vinyl Flooring**	**Bathrooms in NE Rooms – 1st Floor Original Area**	**4% Chrysotile**	**Good**
4771-21-41 4771-21-42	Gray Cove Base & Mastic	Throughout Original 1st Floor Area	ND	Good
4771-22-43 4771-22-44	2x4 Lay-in Ceiling Tile (Type I)	1st Floor New Addition - Throughout	ND	Good
4771-23-45 4771-23-46	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas in 1st Floor New Addition	ND	Good
4771-24-47 4771-24-48	2x4 Lay-in Ceiling Tile (Type III)	Patch Areas in 1st Floor New Addition	ND	Good
4771-25-49 4771-25-50	Brown/Tan 12x12 FT / Mastic	West End Restrooms in New Addition 1st Floor	ND	Good
4771-26-51 4771-26-52	Fire Door Insulation	Throughout 1st Floor	ND	Good
4771-27-53 4771-27-54	Tan Sheet Vinyl Flooring	Restroom at Rear of Building	ND	Good
Former Morgue				
477M-01-01 477M-01-02 477M-01-03 477M-01-04	**Tan 12x12 FT / Mastic**	**Throughout Former Morgue**	**2% Chrysotile**	**Good**
477M-02-05 477M-02-06	2x4 Lay-in Ceiling Tile	Throughout Former Morgue	ND	Good
Generator Building				
477G-01-01 477G-01-02	2x4 Lay-in Ceiling Tile	Throughout Generator Room	ND	Good
Food Storage Building				
477F-01-01 477F-01-02	Drywall Ceiling	Ceilings Throughout	ND	Good

477F-02-03 477F-02-04	Window Glazing	Exterior Windows of Structure	ND	Good
477F-03-05 477F-03-06	Shingle Roofing	Roof	ND	Good

* ND - No Asbestos Detected

Positive ACM Materials

The samples of the suspect homogeneous areas were analyzed for asbestos content. Analysis was performed via polarized light microscopy. Twenty-four (24) of the homogeneous materials returned with regulated amounts of asbestos.

Report of Findings

Twenty-four (24) materials tested positive for greater than 1% asbestos. The following table lists the homogeneous areas that were found to contain greater than 1% asbestos.

Sample#	Description	Location	Percent Asbestos	Quantity
477R-02-02	Lower Roof – Penetration Mastic	Penetrations on Back Middle Building	20% Chrysotile	8 ea.
477R-04-04	Middle Roof – Penetration Mastic	Penetrations on Breezeway Area	15% Chrysotile	3 ea.
4774-01-01 4774-01-02	Lt. Brown Cove Base & Mastic	Interior Rooms of 4th Floor	2% Chrysotile	Approx. 674 LF
4774-03-05 4774-03-06	Dark Tan 9x9 FT / Mastic	Throughout 4th Floor	10% Chrysotile	Approx. 3,014 SF
4774-04-07 4774-04-08	Lt. Tan 9x9 FT / Mastic	Patch Areas of 4th Floor	8% Chrysotile	N/A
4773-05-09 4773-05-10	Tan 12x12 FT / Mastic	Throughout 3rd Floor – Layered with 9x9 FT / Mastic	10% Chrysotile	Approx. 3,100 SF
4773-06-11 4773-06-12	Gray 12x12 FT / Mastic	Patch Areas on 3rd Floor – Layered with 9x9 FT / Mastic	4% Chrysotile	N/A
4773-08-15 4773-08-16	FT / Mastic under Carpeting	Room off North "T" at Rear of 3rd Floor	8% Chrysotile	Approx. 323 SF
4772-05-09 4772-05-10	Tan 12x12 FT / Mastic	Throughout 2nd Floor	2% Chrysotile	Approx. 2,744 SF
4772-06-11 4772-06-12	Gray 12x12 FT / Mastic	Patch Area of 2nd Floor	4% Chrysotile	Approx. 42 SF
4772-08-15 4772-08-16	Flat Black 9x9 FT / Mastic	File Room – West End of 2nd Floor	4% Chrysotile	Approx. 112 SF
4772-11-21 4772-11-22	Black Mastic Pucks	Hallways of 2nd Floor – Above Grid	3% Chrysotile	N/A
4772-13-25 4772-13-26	Fire Door Insulation	Entrance to Stairwell	10% Amosite	1 ea.

4772-16-31 4772-16-32	Gray 9x9 FT / Mastic	2nd Floor Kitchen Wing	10% Chrysotile	Approx. 1,313 SF
4772-17-33 4772-17-34	Off-White 12x12 FT / Mastic	Newer Kitchen Wing – 2nd Floor	10% Chrysotile	Approx. 805 SF
4772-22-43 4772-22-44	Glossy 4x24 FT / Mastic	File Room Border – West End of 2nd Floor	4% Chrysotile	Approx. 100 SF
4771-06-11 4771-06-12	Dark Brown 9x9 FT / Mastic	Mop Room by Rear Entrance	10% Chrysotile	Approx. 24 SF
4771-10-19 4771-10-20	Yellow/Tan 12x12 FT / Mastic	Throughout Original 1st Floor Structure	2% Chrysotile	Approx. 2,979 SF
4771-11-21 4771-11-22	Tan 12x12 FT / Mastic	Throughout 1st Floor Front Addition	8% Chrysotile	Approx. 4,728 SF
4771-12-23 4771-12-24	Brown 12x12 FT / Mastic	Accents in 1st Floor Front Addition	4% Chrysotile	N/A
4771-13-25 4771-13-26	12x12 FT / Mastic under Carpeting	Various Rooms in Original 1st Floor Structure & New Addition	3% Chrysotile	Approx. 1,155 SF
4771-19-37 4771-19-38	Dark Tan 12x12 FT / Mastic	SW Room at End of Hall – Original 1st Floor Area	5% Chrysotile	Approx. 221 SF
4771-20-39 4771-20-40	Floral Print Sheet Vinyl Flooring	Bathrooms in NE Rooms – 1st Floor Original Area	4% Chrysotile	Approx. 72 SF
477M-01-01 477M-01-02 477M-01-03 477M-01-04	Tan 12x12 FT / Mastic	Throughout Former Morgue	2% Chrysotile	Approx. 1,350 SF

Limitations

No plumbing system components that are subsurface or encased inside walls and considered inaccessible were inspected, sampled or analyzed. Snyder Environmental, Inc. does not suspect these types of plumbing materials to be asbestos containing based on observation of above grade plumbing components. Fiberglass materials, wood fiber materials and wood/metal materials were not sampled and/or analyzed due to these materials are assumed not to contain asbestos containing materials. Wire Housing and/or electrical components will not be sampled unless a licensed electrical contractor has disconnected all power and lock out/tag out procedures are in place as per OSHA Regulation.

Every effort was made during the assessment to determine the existence of ACM within the subject structure. However, no absolute guaranty or warranty is given regarding the existence or non-existence of asbestos in the building materials. Any suspect materials subsequently discovered during repair, renovation, or demolition that were not sampled, should be sampled, if practicable, and analyzed for asbestos content.

Regulatory Requirements and Recommendations

EPA and OSHA regulations require proper training and monitoring of all personnel involved in the regulated asbestos removal and/or the renovation/demolition activities. Demolition activities will require a 10 day Notice of Intent to ADEQ, regardless of the presence of asbestos containing materials. Renovation activities involving regulated asbestos containing material (RACM) in quantities greater than 160 square feet or 260 linear feet will require a 10 day Notice of Intent to ADEQ before abatement.

Asbestos Containing Roof Penetration Mastic (Sample #477R-02-02 & 04-04): The asbestos containing roof penetration mastic located on the lower and middle roofs of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Lt. Brown Cove Base Mastic (Sample #4774-01-01 & 02): The asbestos containing cove base mastic located on the light brown cove base found in the patient rooms of the 4th floor is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Dark Tan 9x9 FT / Mastic (Sample #4774-03-05 & 06): The asbestos containing dark tan 9x9 floor tile and mastic located throughout the 4th floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Lt. Tan 9x9 FT / Mastic (Sample #4774-04-07 & 08): The asbestos containing light tan 9x9 floor tile and mastic located in patch areas throughout the 4th floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Tan 12x12 FT / Mastic (Sample #4773-05-09 & 10): The asbestos containing tan 12x12 floor tile and mastic located throughout the 3rd floor of the structure (layered with 9x9 floor tile) is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Gray 12x12 FT / Mastic (Sample #4773-08-15 & 16): The asbestos containing gray 12x12 floor tile and mastic located in patch areas throughout the 3rd floor of the structure (layered with 9x9 floor tile) is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing FT / Mastic Beneath Carpeting (Sample #4773-06-11 & 12): The asbestos containing floor tile and mastic beneath carpeting located in the room off the north "T" at the rear of the 3rd floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Tan 12x12 FT / Mastic (Sample #4772-05-09 & 10): The asbestos containing tan 12x12 floor tile and mastic located throughout the 2nd floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Gray 12x12 FT / Mastic (Sample #4772-06-11 & 12): The asbestos containing floor tile and mastic located in patch areas throughout the 2nd floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Flat Black 9x9 FT / Mastic (Sample #4772-08-15 & 16): The asbestos containing flat black 9x9 floor tile and mastic located in the file room on the west end of the 2nd floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Black Mastic Pucks (Sample #4772-11-21 & 22): The asbestos containing black mastic pucks located above the ceiling grid of the 2nd floor of the structure are considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Fire Door Insulation (Sample #4772-13-25 & 26): The asbestos containing fire door insulation located in the door at the entrance of the 2nd floor stairwell is considered a Regulated Asbestos Containing Material (RACM). These materials must be removed by an ADEQ certified Asbestos Abatement Contractor prior to their disturbance by future demolition or renovation projects.

Asbestos Containing Gray 9x9 FT / Mastic (Sample #4772-16-31 & 32): The asbestos containing gray 9x9 floor tile and mastic located in the 2nd floor kitchen wing is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Off-white 12x12 FT / Mastic (Sample #4772-17-33 & 34): The asbestos containing off-white 12x12 floor tile and mastic located in the newer kitchen wing of the 2nd floor is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Glossy 4x24 FT / Mastic (Sample #4772-22-43 & 44): The asbestos containing glossy 4x24 floor tile and mastic located as a border in the file room on the west end of the 2nd floor is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Dark Brown 9x9 FT / Mastic (Sample #4771-06-11 & 12): The asbestos containing dark brown 9x9 floor tile and mastic located in the mop room by the rear entrance of the 1st floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Yellow/Tan 12x12 FT / Mastic (Sample #4771-10-19 & 20): The asbestos containing yellow/tan 12x12 floor tile and mastic located throughout the original 1st floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Tan 12x12 FT / Mastic (Sample #4771-11-21 & 22) The asbestos containing tan 12x12 floor tile and mastic located throughout the new addition to the 1st floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Brown 12x12 FT / Mastic (Sample #4771-12-23 & 24) The asbestos containing brown 12x12 floor tile and mastic located as an accent throughout the new addition to the 1st floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing 12x12 FT / Mastic Beneath Carpeting (Sample #4771-13-25 & 26): The asbestos containing 12x12 floor tile and mastic beneath carpeting located in various rooms of the original 1st floor and new addition is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Dark Tan 12x12 FT / Mastic (Sample #4771-19-37 & 38) The asbestos containing dark tan 12x12 floor tile and mastic located southwest room at the end of the hall in the original 1st floor area of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Floral Print Sheet Vinyl Flooring (Sample #4771-20-39 & 40) The asbestos containing floral print sheet vinyl flooring located bathrooms in the northeast rooms of the original 1st floor of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Asbestos Containing Tan 12x12 FT / Mastic (Sample #477M-01-01 thru 04) The asbestos containing tan 12x12 floor tile and mastic located throughout the former morgue of the structure is considered a Category I Non-Friable asbestos containing material (ACM). It is recommended that these materials be removed by an ADEQ certified Asbestos Abatement Contractor prior to its disturbance by future demolition or renovation projects.

Disclaimer

Conclusions presented are based on laboratory results of random samples taken from what appear to be homogeneous materials. Snyder Environmental, Inc. is not responsible for the analysis of those samples. Inferences drawn from sampling are subject to error, and the company is not responsible for this error.

This Report Prepared by:

Justin Stuart
Project Coordinator
Certified Inspector #015878
Snyder Environmental

This Report Reviewed by:

Justin Dixon
President
Certified Inspector #013021
Snyder Environmental

Appendix A

Laboratory Analysis Reports

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

ROOF SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
1	477R-01-01	Lower Roof – Field Roofing	Roof of Back Middle Building	Good	684 SF
2	477R-02-02	Lower Roof – Penetration Mastic	Penetrations on Back Middle Building	Good	8 ea.
3	477R-03-03	Middle Roof – Field Roofing	Breezeway Area	Good	703 SF
4	477R-04-04	Middle Roof – Penetration Mastic	Penetrations on Breezeway Area	Good	3 ea.
5	477R-05-05	Side Roof – Field Roofing	Over Generator Building	Good	545 SF
6	477R-06-06	Side Roof – Penetration Mastic	Penetrations on Roof Over Generator	Good	6 ea.
7	477R-07-07	Side Roof – Flashing	Flashing on Roof Over Generator	Good	53 LF
8	477R-08-08	Upper Roof – Field Roofing	Roof of Main Structure	Good	4,200 SF
9	477R-09-09	Upper Roof – Penetration Mastic	Penetrations on Main Structure	Good	32 ea.

RELINQUISHED BY: [signature] TIME: 1400 DATE: 12 Apr. 18

RECEIVED BY: S. Ness TIME: 1405 DATE: 4/18/18

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
153	477R-01-01	Yes 1	None Detected	Cellulose	<1%	Calcite	3%
				Quartz	10%	Particulate Matter	87%

Sample Description: Brown/Black
Roofing - Tar & Rocks
Roof of Back Middle Building

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
153	477R-01-01	Yes 2	None Detected	Cellulose	75%	Calcite	2%
				Quartz	<1%	Particulate Matter	23%

Sample Description: Black
Roofing - Tar Paper
Roof of Back Middle Building

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
154	477R-02-02	No	Positive	Chrysotile Asbestos	20%	Cellulose	1%
				Calcite	2%	Quartz	1%
				Perlite	76%		

Sample Description: Black
Penetration Mastic
Penetratons on Back Middle Building

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
155	477R-03-03	Yes 1	None Detected	Cellulose	1%	Fiberglass	40%
				Calcite	6%	Quartz	1%
				Particulate Matter	52%		

Sample Description: Black
Roofing - Built-Up Roof
Breezeway Area

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
155	477R-03-03	Yes 2	None Detected

Sample Description: Black
Roofing - Tar Paper
Breezeway Area

This material contains approximately

Cellulose	3%	Fiberglass	1%
Calcite	3%	Quartz	1%
Particulate Matter	92%		

Sample #	Client Sample ID:	Layered	Analysis
155	477R-03-03	Yes 3	None Detected

Sample Description: Black
Roofing - Tar Paper
Breezeway Area

This material contains approximately

Cellulose	65%	Fiberglass	1%
Calcite	3%	Quartz	<1%
Particulate Matter	31%		

Sample #	Client Sample ID:	Layered	Analysis
156	477R-04-04	No	Positive

Sample Description: Black
Penetration Mastic
Penetrations on Breezeway Area

This material contains approximately

Chrysotile Asbestos	15%	Cellulose	1%
Calcite	20%	Quartz	3%
Particulate Matter	61%		

Sample #	Client Sample ID:	Layered	Analysis
157	477R-05-05	Yes 1	None Detected

Sample Description: Silver
Roof - Coating
Over Generator Building

This material contains approximately

Cellulose	1%	Calcite	3%
Quartz	3%	Particulate Matter	93%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
157	477R-05-05	Yes 2	None Detected	Cellulose	1%	Fiberglass	1%
				Synthetic Fiber	40%	Calcite	20%
Sample Description: Black Roof - Built-Up Roof Over Generator Building				Quartz	2%	Particulate Matter	36%

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
157	477R-05-05	Yes 3	None Detected	Cellulose	50%	Fiberglass	10%
				Calcite	4%	Quartz	<1%
Sample Description: Black Roof - Tar Paper Over Generator Building				Particulate Matter	36%		

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
157	477R-05-05	Yes 4	None Detected	Cellulose	70%	Perlite	20%
				Particulate Matter	10%		
Sample Description: Brown Roof - Insulation Over Generator Building							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
158	477R-06-06	Yes 1	None Detected	Cellulose	1%	Calcite	4%
				Quartz	3%	Particulate Matter	92%
Sample Description: Silver Roof - Coating Penetrations on Roof Over Generator							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
158	477R-06-06	Yes 2	None Detected	Cellulose	<1%	Calcite	45%
				Quartz	2%	Particulate Matter	53%

Sample Description: Gray
Roof - Penetration Mastic
Penetrations on Roof Over Generator

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
159	477R-07-07	Yes 1	None Detected	Cellulose	1%	Calcite	4%
				Quartz	3%	Particulate Matter	92%

Sample Description: Silver
Flashing - Coating
Flashing on Roof Over Generator

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
159	477R-07-07	Yes 2	None Detected	Cellulose	<1%	Fiberglass	30%
				Calcite	30%	Quartz	2%
				Particulate Matter	38%		

Sample Description: Black
Flashing
Flashing on Roof Over Generator

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
160	477R-08-08	Yes 1	None Detected	Cellulose	1%	Fiberglass	1%
				Calcite	3%	Quartz	3%
				Particulate Matter	92%		

Sample Description: Silver
Roofing - Coating
Roof of Main Structure

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
160	477R-08-08	Yes 2	None Detected	Synthetic Fiber	30%	Calcite	35%
				Quartz	2%	Particulate Matter	33%

Sample Description: Black
Roofing - Built-Up Roof
Roof of Main Structure

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
160	477R-08-08	Yes 3	None Detected	Cellulose	60%	Calcite	3%
				Quartz	<1%	Particulate Matter	37%

Sample Description: Black
Roofing - Paper
Roof of Main Structure

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
160	477R-08-08	Yes 4	None Detected	Cellulose	3%	Fiberglass	25%
				Calcite	15%	Quartz	3%
				Particulate Matter	54%		

Sample Description: Black
Roofing - Built-Up Roof
Roof of Main Structure

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
160	477R-08-08	Yes 5	None Detected	Cellulose	65%	Calcite	<1%
				Perlite	20%	Particulate Matter	15%

Sample Description: Brown
Roofing - Insulation
Roof of Main Structure

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Roofs
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
161	477R-09-09	Yes 1	None Detected	Cellulose	1%	Calcite	4%
				Quartz	3%	Particulate Matter	92%
Sample Description: Silver Roofing - Coating Penetrations on Main Structure							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
161	477R-09-09	Yes 2	None Detected	Cellulose	1%	Calcite	40%
				Quartz	4%	Particulate Matter	55%
Sample Description: Gray Roofing - Penetration Mastic Penetrations on Main Structure							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

4TH FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
1	4774-01-01 4774-01-02	Lt. Brown Cove Base & Mastic	Interior Rooms of 4th Floor	Good	674 LF
2	4774-02-03 4774-02-04	Dark Brown Cove Base & Mastic	Hallways of 4th Floor	Good	212 SF
3	4774-03-05 4774-03-06	Dark Tan 9x9 FT / Mastic	Throughout 4th Floor	Good	3,014 SF
4	4774-04-07 4774-04-08	Lt. Tan 9x9 FT / Mastic	Patch Areas on 4th Floor	Good	N/A
5	4774-05-09 4774-05-10	2x4 Lay-in Ceiling Tile (Type I)	Throughout 4th Floor	Good	3,014 SF
6	4774-06-11 4774-06-12	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas on 4th Floor	Good	N/A
7	4774-07-13 4774-07-14	Spray-on Fire Proofing	Above Ceiling – Throughout	Good	3,000 SF
8	4774-08-15 4774-08-16	Pipe Insulation	Above Ceiling – Throughout	Good	536 LF
9	4774-09-17 4774-09-18	Wall Plaster	Throughout 4th Floor	Good	1,000 LF x 10'
10	4774-10-19 4774-10-20	Drapery Material	Interior Room Windows	Good	28 sets
11	4774-11-21 4774-11-22	White Perimeter Window Caulk	Exterior Windows of 4th Floor	Good	28 ea.

RELINQUISHED BY: [signature] TIME: 1400 DATE: 13 Apr. 18

RECEIVED BY: S. Ness TIME: 1809 DATE: 4/18/18

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
117	4774-01-01	Yes 1	None Detected	Calcite	15%	Quartz	2%
				Particulate Matter	83%		

Sample Description: Brown
Covebase
Interior Rooms of 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
117	4774-01-01	Yes 2	Positive	Chrysotile Asbestos	2%	Cellulose	<1%
				Calcite	2%	Quartz	<1%
				Particulate Matter	96%		

Sample Description: Brown
Covebase Mastic
Interior Rooms of 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
119	4774-02-03	Yes 1	None Detected	Calcite	50%	Quartz	3%
				Particulate Matter	47%		

Sample Description: Brown
Covebase
Hallways of 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
119	4774-02-03	Yes 2	None Detected	Cellulose	1%	Calcite	2%
				Quartz	1%	Particulate Matter	96%

Sample Description: Brown
Covebase Mastic
Hallways of 4th Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R. Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
120	4774-02-04	Yes 1	None Detected	Calcite	50%	Quartz	2%
				Particulate Matter	48%		

Sample Description: Brown
Covebase
Hallways of 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
120	4774-02-04	Yes 2	None Detected	Cellulose	1%	Calcite	1%
				Quartz	1%	Particulate Matter	97%

Sample Description: Brown
Covebase Mastic
Hallways of 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
121	4774-03-05	Yes 1	Positive	Chrysotile Asbestos	3%	Calcite	50%
				Quartz	2%	Particulate Matter	45%

Sample Description: Tan
Floor Tile
Throughout 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
121	4774-03-05	Yes 2	Positive	Chrysotile Asbestos	10%	Cellulose	1%
				Calcite	3%	Quartz	1%
				Particulate Matter	85%		

Sample Description: Black
Mastic
Throughout 4th Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatchin
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
123	4774-04-07	Yes 1	Positive

Sample Description: Tan
Floor Tile
Patch Areas on 4th Floor

This material contains approximately

Chrysotile Asbestos	3%	Calcite	50%
Quartz	3%	Particulate Matter	44%

Sample #	Client Sample ID:	Layered	Analysis
123	4774-04-07	Yes 2	Positive

Sample Description: Black
Mastic
Patch Areas on 4th Floor

This material contains approximately

Chrysotile Asbestos	8%	Calcite	3%
Quartz	1%	Particulate Matter	88%

Sample #	Client Sample ID:	Layered	Analysis
125	4774-05-09	No	None Detected

Sample Description: White/Pink
Ceiling Tile
Throughout 4th Floor

This material contains approximately

Cellulose	30%	Mineral Wool	35%
Perlite	15%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
126	4774-05-10	No	None Detected

Sample Description: White/Pink
Ceiling Tile
Throughout 4th Floor

This material contains approximately

Cellulose	25%	Mineral Wool	35%
Calcite	<1%	Perlite	25%
Particulate Matter	15%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
127	4774-06-11	No	None Detected

Sample Description: White/Pink
Ceiling Tile
Patch Areas on 4th Floor

This material contains approximately

Cellulose	30%	Mineral Wool	35%
Calcite	1%	Perlite	15%
Particulate Matter	19%		

Sample #	Client Sample ID:	Layered	Analysis
128	4774-06-12	No	None Detected

Sample Description: White/Pink
Ceiling Tile
Patch Areas on 4th Floor

This material contains approximately

Cellulose	25%	Mineral Wool	35%
Calcite	1%	Perlite	20%
Particulate Matter	19%		

Sample #	Client Sample ID:	Layered	Analysis
129	4774-07-13	No	None Detected

Sample Description: White
Fireproofing
Above Ceiling - Throughout

This material contains approximately

Cellulose	1%	Calcite	5%
Quartz	1%	Perlite	15%
Gypsum Mortar	50%	Particulate Matter	28%

Sample #	Client Sample ID:	Layered	Analysis
130	4774-07-14	No	None Detected

Sample Description: White
Fireproofing
Above Ceiling - Throughout

This material contains approximately

Cellulose	<1%	Calcite	5%
Quartz	1%	Perlite	20%
Gypsum Mortar	50%	Particulate Matter	24%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
131	4774-08-15	Yes 1	None Detected	Cellulose	60%	Fiberglass	3%
				Calcite	1%	Quartz	<1%
				Particulate Matter	36%		

Sample Description: Tan
Pipe Insulation - Covering Material
Above Ceiling - Throughout

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
131	4774-08-15	Yes 2	None Detected	Cellulose	<1%	Calcite	<1%
				Quartz	1%	Particulate Matter	99%

Sample Description: Black
Pipe Insulation - Mastic
Above Ceiling - Throughout

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
131	4774-08-15	Yes 3	None Detected	Fiberglass	98%	Particulate Matter	2%

Sample Description: Yellow
Pipe Insulation
Above Ceiling - Throughout

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
132	4774-08-16	Yes 1	None Detected	Cellulose	55%	Fiberglass	7%
				Calcite	1%	Particulate Matter	37%

Sample Description: Tan
Pipe Insulation - Covering Material
Above Ceiling - Throughout

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
132	4774-08-16	Yes 2	None Detected	Fiberglass	1%	Calcite	<1%
				Quartz	<1%	Particulate Matter	99%

Sample Description: Black
Pipe Insulation - Mastic
Above Ceiling - Throughout

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
132	4774-08-16	Yes 3	None Detected	Fiberglass	99%	Particulate Matter	1%

Sample Description: Yellow
Pipe Insulation
Above Ceiling - Throughout

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
133	4774-09-17	No	None Detected	Calcite	50%	Quartz	4%
				Particulate Matter	46%		

Sample Description: White/Blue
Plaster
Throughout 4th Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
134	4774-09-18	No	None Detected	Cellulose	<1%	Calcite	55%
				Quartz	3%	Particulate Matter	42%

Sample Description: White/Blue
Plaster
Throughout 4th Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 4th Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
135	4774-10-19	No	None Detected	Synthetic Fiber	98%	Calcite	<1%
				Particulate Matter	2%		
Sample Description: Brown/White Drapery Interior Room Windows							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
136	4774-10-20	No	None Detected	Synthetic Fiber	98%	Calcite	<1%
				Particulate Matter	2%		
Sample Description: Brown/White Drapery Interior Room Windows							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
137	4774-11-21	No	None Detected	Calcite	55%	Quartz	3%
				Particulate Matter	42%		
Sample Description: White Caulk Exterior Windows of 4th Floor							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
138	4774-11-22	No	None Detected	Calcite	55%	Quartz	3%
				Particulate Matter	42%		
Sample Description: White Caulk Exterior Windows of 4th Floor							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatchw
Analyst
NVLAP Signatory

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

3rd FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
1	4773-01-01 4773-01-02	Dark Brown Cove Base & Mastic	Throughout 3rd Floor	Good	1,204 LF
2	4773-02-03 4773-02-04	2x4 Lay-In Ceiling Tile (Type I)	Hallways of 3rd Floor	Good	3,100 SF
3	4773-03-05 4773-03-06	Wall Plaster	Throughout 3rd Floor	Good	1,204 LF x 10'
4	4773-04-07 4773-04-08	Ceiling Plaster	Throughout 3rd Floor – Above Grid	Good	3,100 SF
5	4773-05-09 4773-05-10	Tan 12x12 FT / Mastic	Throughout 3rd Floor – Layered with 9x9 FT / Mastic	Good	3,100 SF
6	4773-06-11 4773-06-12	Gray 12x12 FT / Mastic	Patch Areas on 3rd Floor – Layered with 9x9 FT / Mastic	Good	N/A
7	4773-07-13 4773-07-14	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas in 3rd Floor Hallways	Good	N/A
8	4773-08-15 4773-08-16	FT / Mastic under Carpeting	Room Off North "T" at Rear of 3rd Floor	Good	323 SF
9	4773-09-17 4773-09-18	Window Glazing	Exterior Windows of 3rd Floor	Good	15 ea.

RELINQUISHED BY: [signature] TIME: 1400 DATE: 17 Apr. 18

RECEIVED BY: S. Ness TIME: 1405 DATE: 4/18/18

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
99	4773-01-01	Yes 1	None Detected

Sample Description: Brown/Black
Covebase
Throughout 3rd Floor

This material contains approximately			
Cellulose	<1%	Calcite	55%
Quartz	2%	Particulate Matter	43%

Sample #	Client Sample ID:	Layered	Analysis
99	4773-01-01	Yes 2	None Detected

Sample Description: Yellow
Covebase Mastic
Throughout 3rd Floor

This material contains approximately			
Cellulose	1%	Synthetic Fiber	1%
Calcite	10%	Quartz	1%
Particulate Matter	87%		

Sample #	Client Sample ID:	Layered	Analysis
100	4773-01-02	Yes 1	None Detected

Sample Description: Brown/Black
Covebase
Throughout 3rd Floor

This material contains approximately			
Calcite	55%	Quartz	2%
Particulate Matter	43%		

Sample #	Client Sample ID:	Layered	Analysis
100	4773-01-02	Yes 2	None Detected

Sample Description: Yellow
Covebase Mastic
Throughout 3rd Floor

This material contains approximately			
Cellulose	1%	Calcite	10%
Quartz	1%	Particulate Matter	88%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
101	4773-02-03	No	None Detected	Cellulose	30%	Mineral Wool	30%
				Perlite	20%	Particulate Matter	20%

Sample Description: White
Ceiling Tile
Hallways of 3rd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
102	4773-02-04	No	None Detected	Cellulose	35%	Mineral Wool	30%
				Perlite	20%	Particulate Matter	15%

Sample Description: White
Ceiling Tile
Hallways of 3rd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
103	4773-03-05	Yes 1	None Detected	Calcite	10%	Quartz	7%
				Gypsum Mortar	40%	Particulate Matter	43%

Sample Description: White
Plaster - Skim
Throughout 3rd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
103	4773-03-05	Yes 2	None Detected	Cellulose	1%	Calcite	6%
				Quartz	25%	Gypsum Mortar	30%
				Particulate Matter	38%		

Sample Description: Tan
Plaster
Throughout 3rd Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R. Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
104	4773-03-06	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout 3rd Floor

This material contains approximately			
Calcite	10%	Quartz	7%
Gypsum Mortar	40%	Particulate Matter	43%

Sample #	Client Sample ID:	Layered	Analysis
104	4773-03-06	Yes 2	None Detected

Sample Description: Tan
Plaster
Throughout 3rd Floor

This material contains approximately			
Cellulose	2%	Calcite	5%
Quartz	25%	Gypsum Mortar	35%
Particulate Matter	33%		

Sample #	Client Sample ID:	Layered	Analysis
105	4773-04-07	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout 3rd Floor - Above Grid

This material contains approximately			
Calcite	8%	Quartz	7%
Gypsum Mortar	45%	Particulate Matter	40%

Sample #	Client Sample ID:	Layered	Analysis
105	4773-04-07	Yes 2	None Detected

Sample Description: Tan
Plaster
Throughout 3rd Floor - Above Grid

This material contains approximately			
Cellulose	1%	Calcite	5%
Quartz	25%	Gypsum Mortar	40%
Particulate Matter	29%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.
220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
106	4773-04-08	Yes 1	None Detected

Sample Description: White
Plaster - Skim Coat
Throughout 3rd Floor - Above Grid

This material contains approximately			
Cellulose	<1%	Calcite	7%
Quartz	7%	Gypsum Mortar	40%
Particulate Matter	46%		

Sample #	Client Sample ID:	Layered	Analysis
106	4773-04-08	Yes 2	None Detected

Sample Description: Tan
Plaster
Throughout 3rd Floor - Above Grid

This material contains approximately			
Cellulose	1%	Synthetic Fiber	<1%
Calcite	6%	Quartz	20%
Gypsum Mortar	50%	Particulate Matter	23%

Sample #	Client Sample ID:	Layered	Analysis
107	4773-05-09	Yes 1	Positive

Sample Description: Tan
Floor Tile
Throughout 3rd Floor - Layered with 9x9 & Mastic

This material contains approximately			
Chrysotile Asbestos	2%	Cellulose	<1%
Calcite	45%	Quartz	3%
Particulate Matter	50%		

Sample #	Client Sample ID:	Layered	Analysis
107	4773-05-09	Yes 2	Positive

Sample Description: Black
Mastic
Throughout 3rd Floor - Layered with 9x9 & Mastic

This material contains approximately			
Chrysotile Asbestos	10%	Cellulose	1%
Calcite	3%	Quartz	1%
Particulate Matter	85%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
107	4773-05-09	Yes 3	Positive

Sample Description: Black
Floor Tile
Throughout 3rd Floor - Layered with 9x9 & Mastic

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	<1%
Calcite	35%	Quartz	4%
Particulate Matter	57%		

Sample #	Client Sample ID:	Layered	Analysis
109	4773-06-11	Yes 1	None Detected

Sample Description: Gray
Floor Tile
Patch Areas on 3rd Floor - Layered with 9x9/Mastic

This material contains approximately

Cellulose	2%	Calcite	50%
Quartz	2%	Particulate Matter	46%

Sample #	Client Sample ID:	Layered	Analysis
109	4773-06-11	Yes 2	None Detected

Sample Description: Yellow
Mastic
Patch Areas on 3rd Floor - Layered with 9x9/Mastic

This material contains approximately

Cellulose	1%	Synthetic Fiber	<1%
Calcite	7%	Quartz	1%
Particulate Matter	91%		

Sample #	Client Sample ID:	Layered	Analysis
109	4773-06-11	Yes 3	Positive

Sample Description: Brown
Floor Tile
Patch Areas on 3rd Floor - Layered with 9x9/Mastic

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	<1%
Calcite	40%	Quartz	3%
Particulate Matter	53%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
111	4773-07-13	No	None Detected

Sample Description: White
Ceiling Tile
Patch Areas in 3rd Floor Hallway

This material contains approximately			
Cellulose	25%	Mineral Wool	35%
Calcite	1%	Perlite	25%
Particulate Matter	14%		

Sample #	Client Sample ID:	Layered	Analysis
112	4773-07-14	No	None Detected

Sample Description: White
Ceiling Tile
Patch Areas in 3rd Floor Hallways

This material contains approximately			
Cellulose	25%	Mineral Wool	35%
Calcite	<1%	Perlite	20%
Particulate Matter	20%		

Sample #	Client Sample ID:	Layered	Analysis
113	4773-08-15	Yes 1	Positive

Sample Description: Off White
Floor Tile
Room off North "T" at Rear of 3rd Floor

This material contains approximately			
Chrysotile Asbestos	2%	Cellulose	<1%
Calcite	45%	Quartz	2%
Particulate Matter	51%		

Sample #	Client Sample ID:	Layered	Analysis
113	4773-08-15	Yes 2	None Detected

Sample Description: Yellow
Mastic
Room off North "T" at Rear of 3rd Floor

This material contains approximately			
Synthetic Fiber	3%	Calcite	2%
Quartz	2%	Particulate Matter	93%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG Inc
Megan R Hatchew
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
113	4773-08-15	Yes 3	Positive

Sample Description: Black
Mastic
Room off North "T" at Rear of 3rd Floor

This material contains approximately

Chrysotile Asbestos	2%	Cellulose	1%
Calcite	7%	Quartz	2%
Particulate Matter	88%		

Sample #	Client Sample ID:	Layered	Analysis
113	4773-08-15	Yes 4	Positive

Sample Description: Tan
Floor Tile
Room off North "T" at Rear of 3rd Floor

This material contains approximately

Chrysotile Asbestos	3%	Cellulose	<1%
Calcite	45%	Quartz	3%
Particulate Matter	49%		

Sample #	Client Sample ID:	Layered	Analysis
113	4773-08-15	Yes 5	Positive

Sample Description: Black
Mastic
Room off North "T" at Rear of 3rd Floor

This material contains approximately

Chrysotile Asbestos	8%	Cellulose	<1%
Calcite	5%	Quartz	1%
Particulate Matter	86%		

Sample #	Client Sample ID:	Layered	Analysis
115	4773-09-17	No	None Detected

Sample Description: White
Glazing
Exterior Windows of 3rd Floor

This material contains approximately

Cellulose	<1%	Calcite	55%
Quartz	2%	Particulate Matter	43%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 3rd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
116	4773-09-18	No	None Detected	Calcite	55%	Quartz	3%
				Particulate Matter	42%		
Sample Description: White Glazing Exterior Windows of 3rd Floor							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

2nd FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
1	4772-01-01 4772-01-02	Dark Brown Cove Base & Mastic	Throughout 2nd Floor	Good	1,313 LF
2	4772-02-03 4772-02-04	2x4 Lay-in Ceiling Tile (Type I)	Hallways of 2nd Floor	Good	805 SF
3	4772-03-05 4772-03-06	2x4 Lay-in Ceiling Tile (Type II)	Patch Areas on 2nd Floor	Good	N/A
4	4772-04-07 4772-04-08	2x4 Lay-in Ceiling Tile (Type III)	Patch Areas on 2nd Floor	Good	N/A
5	4772-05-09 4772-05-10	Tan 12x12 FT / Mastic	Throughout 2nd Floor	Good	2,744 SF
6	4772-06-11 4772-06-12	Gray 12x12 FT / Mastic	Patch Area on 2nd Floor	Good	42 SF
7	4772-07-13 4772-07-14	White/Black 12x12 FT / Mastic	West End of 2nd Floor	Good	100 SF
8	4772-08-15 4772-08-16	Flat Black 9x9 FT / Mastic	File Room – West End of 2nd Floor	Good	112 SF
9	4772-09-17 4772-09-18	12x12 Ceiling Tiles	Hallways of 2nd Floor – Above Grid	Good	805 SF
10	4772-10-19 4772-10-20	Yellow Mastic Pucks	Hallways of 2nd Floor – Above Grid	Good	N/A
11	4772-11-21 4772-11-22	Black Mastic Pucks	Hallways of 2nd Floor – Above Grid	Good	N/A
12	4772-12-23 4772-12-24	Brown 12x12 FT / Mastic	NW Corner Room – 2nd Floor	Good	252 SF
13	4772-13-25 4772-13-26	Fire Door Insulation	Entrance to Stairwell	Good	1 ea.
14	4772-14-27 4772-14-28	Wall Plaster	Throughout 2nd Floor	Good	1,400 LF x 10'
15	4772-15-29 4772-15-30	Ceiling Plaster	Throughout 2nd Floor	Good	4,200 SF

RELINQUISHED BY: [signature] TIME: 1400 DATE: 18 April 18

RECEIVED BY: S. Ness TIME: 1705 DATE: 4/18/18

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

2nd FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
16	4772-16-31 4772-16-32	Gray 9x9 FT / Mastic	2nd Floor King Wing	Good	1,313 LF
17	4772-17-33 4772-17-34	Off-White 12x12 FT / Mastic	Newer Kitchen Wing of 2nd Floor	Good	805 SF
18	4772-18-35 4772-18-36	6" Cove Base & Mastic	Older Kitchen Wing of 2nd Floor	Good	N/A
19	4772-19-37 4772-19-38	Perimeter Window Caulk	Exterior Windows of Kitchen Area	Good	8 ea.
20	4772-20-39 4772-20-40	Window Glazing	Patient Room Windows	Good	10 ea.
21	4772-21-41 4772-21-42	Drywall / Joint Compound	Bathroom Partitions	Good	42 SF
22	4772-22-43 4772-22-44	Glossy 4x24 FT / Mastic	File Room Border – West End of 2nd Floor	Good	100 SF

RELINQUISHED BY: [signature] TIME: 1400 DATE: 12 Apr. 18

RECEIVED BY: S Ness TIME: 1405 DATE: 4/18/18

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
55	4772-01-01	No	None Detected

Sample Description: Brown
Covebase Mastic
Throughout 2nd Floor

This material contains approximately

Cellulose	1%	Calcite	15%
Quartz	3%	Particulate Matter	81%

Sample #	Client Sample ID:	Layered	Analysis
56	4772-01-02	No	None Detected

Sample Description: Brown
Covebase Mastic
Throughout 2nd Floor

This material contains approximately

Cellulose	2%	Calcite	15%
Quartz	2%	Particulate Matter	81%

Sample #	Client Sample ID:	Layered	Analysis
57	4772-02-03	No	None Detected

Sample Description: White
Ceiling Tile
Hallways of 2nd Floor

This material contains approximately

Cellulose	35%	Mineral Wool	30%
Perlite	15%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
58	4772-02-04	No	None Detected

Sample Description: White
Ceiling Tile
Hallways of 2nd Floor

This material contains approximately

Cellulose	30%	Mineral Wool	35%
Calcite	1%	Perlite	15%
Particulate Matter	19%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
59	4772-03-05	No	None Detected	Cellulose	40%	Mineral Wool	20%
				Perlite	25%	Particulate Matter	15%
Sample Description: White Ceiling Tile Patch Areas on 2nd Floor							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
60	4772-03-06	No	None Detected	Cellulose	40%	Mineral Wool	20%
				Calcite	<1%	Perlite	25%
				Particulate Matter	15%		
Sample Description: White Ceiling Tile Patch Areas on 2nd Floor							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
61	4772-04-07	No	None Detected	Cellulose	60%	Perlite	20%
				Particulate Matter	20%		
Sample Description: White Ceiling Tile Patch Areas on 2nd Floor							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
62	4772-04-08	No	None Detected	Cellulose	60%	Calcite	<1%
				Perlite	20%	Particulate Matter	20%
Sample Description: White Ceiling Tile Patch Areas on 2nd Floor							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
63	4772-05-09	Yes 1	Positive

Sample Description: Tan
Floor Tile
Throughout 2nd Floor

This material contains approximately			
Chrysotile Asbestos	2%	Cellulose	1%
Calcite	50%	Quartz	2%
Particulate Matter	45%		

Sample #	Client Sample ID:	Layered	Analysis
63	4772-05-09	Yes 2	Trace

Sample Description: Black
Mastic
Throughout 2nd Floor

This material contains approximately			
Chrysotile Asbestos	<1%	Cellulose	1%
Calcite	3%	Quartz	1%
Particulate Matter	95%		

Sample #	Client Sample ID:	Layered	Analysis
63	4772-05-09	Yes 3	None Detected

Sample Description: Brown
Mastic
Throughout 2nd Floor

This material contains approximately			
Cellulose	3%	Calcite	15%
Quartz	3%	Particulate Matter	79%

Sample #	Client Sample ID:	Layered	Analysis
63	4772-05-09	Yes 4	None Detected

Sample Description: Black
Floor Tile
Throughout 2nd Floor

This material contains approximately			
Cellulose	1%	Calcite	45%
Quartz	3%	Particulate Matter	51%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
65	4772-06-11	Yes 1	None Detected	Calcite	55%	Quartz	3%
				Particulate Matter	42%		

Sample Description: Gray
Floor Tile
Patch Area on 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
65	4772-06-11	Yes 2	None Detected	Cellulose	1%	Calcite	20%
				Quartz	3%	Particulate Matter	76%

Sample Description: Yellow
Mastic
Patch Area on 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
65	4772-06-11	Yes 3	Positive	Chrysotile Asbestos	4%	Cellulose	<1%
				Calcite	40%	Quartz	3%
				Particulate Matter	53%		

Sample Description: Brown
Floor Tile
Patch Area on 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
65	4772-06-11	Yes 4	Positive	Chrysotile Asbestos	2%	Cellulose	<1%
				Calcite	2%	Quartz	2%
				Particulate Matter	94%		

Sample Description: Black
Mastic
Patch Area on 2nd Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
67	4772-07-13	Yes 1	None Detected	Cellulose	1%	Calcite	45%
				Quartz	3%	Particulate Matter	51%

Sample Description: White/Black
Floor Tile
West End of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
67	4772-07-13	Yes 2	None Detected	Calcite	10%	Quartz	1%
				Particulate Matter	89%		

Sample Description: Black
Mastic
West End of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
68	4772-07-14	Yes 1	None Detected	Calcite	45%	Quartz	3%
				Particulate Matter	52%		

Sample Description: White/Black
Floor Tile
West End of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
68	4772-07-14	Yes 2	None Detected	Cellulose	1%	Synthetic Fiber	2%
				Calcite	7%	Quartz	2%
				Particulate Matter	88%		

Sample Description: Black
Mastic
West End of 2nd Floor

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R. Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
69	4772-08-15	Yes 1	Positive

Sample Description: Green
Floor Tile
File Room - West End of 2nd Floor

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	<1%
Calcite	40%	Quartz	5%
Particulate Matter	51%		

Sample #	Client Sample ID:	Layered	Analysis
69	4772-08-15	Yes 2	None Detected

Sample Description: Black
Mastic
File Room - West End of 2nd Floor

This material contains approximately

Cellulose	1%	Calcite	2%
Quartz	1%	Particulate Matter	96%

Sample #	Client Sample ID:	Layered	Analysis
71	4772-09-17	No	None Detected

Sample Description: White
Ceiling Tile
Hallways of 2nd Floor - Above Grid

This material contains approximately

Cellulose	30%	Mineral Wool	40%
Perlite	15%	Particulate Matter	15%

Sample #	Client Sample ID:	Layered	Analysis
72	4772-09-18	No	None Detected

Sample Description: White
Ceiling Tile
Hallways of 2nd Floor - Above Grid

This material contains approximately

Cellulose	30%	Mineral Wool	40%
Calcite	<1%	Perlite	15%
Particulate Matter	15%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
73	4772-10-19	No	None Detected

Sample Description: Yellow
Mastic
Hallways of 2nd Floor - Above Grid

This material contains approximately			
Cellulose	2%	Mineral Wool	1%
Calcite	5%	Quartz	3%
Particulate Matter	89%		

Sample #	Client Sample ID:	Layered	Analysis
74	4772-10-20	No	None Detected

Sample Description: Yellow
Mastic
Hallways of 2nd Floor - Above Grid

This material contains approximately			
Cellulose	1%	Mineral Wool	1%
Calcite	5%	Quartz	2%
Particulate Matter	91%		

Sample #	Client Sample ID:	Layered	Analysis
75	4772-10-21	No	Positive

Sample Description: Black
Mastic
Hallways of 2nd Floor - Above Grid

This material contains approximately			
Chrysotile Asbestos	3%	Cellulose	1%
Mineral Wool	1%	Calcite	2%
Quartz	1%	Particulate Matter	92%

Sample #	Client Sample ID:	Layered	Analysis
77	4772-12-23	Yes 1	None Detected

Sample Description: Brown
Floor Tile
NW Corner Room - 2nd Floor

This material contains approximately			
Cellulose	1%	Mineral Wool	2%
Calcite	50%	Quartz	2%
Particulate Matter	45%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
77	4772-12-23	Yes 2	None Detected

Sample Description: Black
Mastic
NW Corner Room - 2nd Floor

This material contains approximately

Cellulose	1%	Mineral Wool	1%
Calcite	15%	Quartz	3%
Particulate Matter	80%		

Sample #	Client Sample ID:	Layered	Analysis
78	4772-12-24	Yes 1	None Detected

Sample Description: Brown
Floor Tile
NW Corner Room - 2nd Floor

This material contains approximately

Cellulose	1%	Mineral Wool	1%
Calcite	50%	Quartz	3%
Particulate Matter	45%		

Sample #	Client Sample ID:	Layered	Analysis
78	4772-12-24	Yes 2	None Detected

Sample Description: Black
Mastic
NW Corner Room - 2nd Floor

This material contains approximately

Cellulose	1%	Mineral Wool	1%
Calcite	15%	Quartz	2%
Particulate Matter	81%		

Sample #	Client Sample ID:	Layered	Analysis
79	4772-13-25	No	Positive

Sample Description: White
Insulation
Entrance to Stairwell

This material contains approximately

Chrysotile Asbestos	<1%	Amosite Asbestos	10%
Cellulose	<1%	Mineral Wool	1%
Calcite	45%	Quartz	4%
Particulate Matter	40%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.
220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
81	4772-14-27	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout 2nd Floor

This material contains approximately			
Calcite	10%	Quartz	8%
Gypsum Mortar	35%	Particulate Matter	47%

Sample #	Client Sample ID:	Layered	Analysis
81	4772-14-27	Yes 2	None Detected

Sample Description: Tan
Plaster
Throughout 2nd Floor

This material contains approximately			
Cellulose	1%	Calcite	10%
Quartz	20%	Gypsum Mortar	30%
Particulate Matter	39%		

Sample #	Client Sample ID:	Layered	Analysis
82	4772-14-28	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout 2nd Floor

This material contains approximately			
Calcite	10%	Quartz	7%
Gypsum Mortar	40%	Particulate Matter	43%

Sample #	Client Sample ID:	Layered	Analysis
82	4772-14-28	Yes 2	None Detected

Sample Description: Tan
Plaster
Throughout 2nd Floor

This material contains approximately			
Cellulose	2%	Calcite	10%
Quartz	20%	Gypsum Mortar	30%
Particulate Matter	38%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
83	4772-15-29	No	None Detected

Sample Description: White
Plaster
Throughout 2nd Floor

This material contains approximately			
Cellulose	1%	Calcite	10%
Quartz	5%	Gypsum Mortar	40%
Particulate Matter	44%		

Sample #	Client Sample ID:	Layered	Analysis
84	4772-15-30	No	None Detected

Sample Description: White/Pink
Plaster
Throughout 2nd Floor

This material contains approximately			
Cellulose	1%	Calcite	8%
Quartz	8%	Gypsum Mortar	40%
Particulate Matter	43%		

Sample #	Client Sample ID:	Layered	Analysis
85	4772-16-31	Yes 1	Positive

Sample Description: Gray
Floor Tile
2nd Floor King Wing

This material contains approximately			
Chrysotile Asbestos	3%	Cellulose	<1%
Calcite	50%	Quartz	2%
Particulate Matter	45%		

Sample #	Client Sample ID:	Layered	Analysis
85	4772-16-31	Yes 2	None Detected

Sample Description: Black
Mastic (Top)
2nd Floor King Wing

This material contains approximately			
Synthetic Fiber	1%	Calcite	7%
Quartz	1%	Particulate Matter	91%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
85	4772-16-31	Yes 3	Positive

Sample Description: Black
Mastic (Bottom)
2nd Floor King Wing

This material contains approximately

Chrysotile Asbestos	10%	Cellulose	1%
Calcite	3%	Quartz	1%
Particulate Matter	85%		

Sample #	Client Sample ID:	Layered	Analysis
86	4772-17-33	Yes 1	None Detected

Sample Description: Off White
Floor Tile
Newer Kitchen Wing of 2nd Floor

This material contains approximately

Cellulose	1%	Calcite	55%
Quartz	2%	Particulate Matter	42%

Sample #	Client Sample ID:	Layered	Analysis
86	4772-17-33	Yes 2	Positive

Sample Description: Black
Mastic
Newer Kitchen Wing of 2nd Floor

This material contains approximately

Chrysotile Asbestos	10%	Cellulose	1%
Calcite	3%	Quartz	1%
Particulate Matter	85%		

Sample #	Client Sample ID:	Layered	Analysis
89	4772-18-35	Yes 1	None Detected

Sample Description: Black
Covebase
Older Kitchen Wing of 2nd Floor

This material contains approximately

Calcite	50%	Quartz	2%
Particulate Matter	48%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
89	4772-18-35	Yes 2	None Detected	Cellulose	1%	Synthetic Fiber	3%
				Calcite	15%	Quartz	3%
				Particulate Matter	78%		

Sample Description: Brown
Covebase Mastic
Older Kitchen Wing of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
90	4772-18-36	Yes 1	None Detected	Cellulose	1%	Calcite	55%
				Quartz	1%	Particulate Matter	43%

Sample Description: Black
Covebase
Older Kitchen Wing of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
90	4772-18-36	Yes 2	None Detected	Cellulose	2%	Synthetic Fiber	3%
				Calcite	10%	Quartz	2%
				Particulate Matter	83%		

Sample Description: Brown
Covebase Mastic
Older Kitchen Wing of 2nd Floor

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
91	4772-19-37	No	None Detected	Cellulose	<1%	Calcite	55%
				Quartz	3%	Particulate Matter	42%

Sample Description: Gray
Caulk
Exterior WIndows of Kitchen Area

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
92	4772-19-38	No	None Detected

Sample Description: Gray
Caulk
Exterior Windows of Kitchen Area

This material contains approximately

Cellulose	<1%	Calcite	55%
Quartz	1%	Particulate Matter	44%

Sample #	Client Sample ID:	Layered	Analysis
93	4772-20-39	No	None Detected

Sample Description: White
Glazing
Patient Room Windows

This material contains approximately

Cellulose	<1%	Calcite	60%
Quartz	2%	Particulate Matter	38%

Sample #	Client Sample ID:	Layered	Analysis
94	4772-20-40	No	None Detected

Sample Description: White
Glazing
Patient Room Windows

This material contains approximately

Calcite	60%	Quartz	2%
Particulate Matter	38%		

Sample #	Client Sample ID:	Layered	Analysis
95	4772-21-41	No	Trace

Sample Description: White
Joint Compound
Bathroom Partitions

This material contains approximately

Chrysotile Asbestos	<1%	Cellulose	1%
Calcite	50%	Quartz	3%
Particulate Matter	46%		

urrent information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only ıethodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage ported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
est measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the xclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or ignature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. amples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary aboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R. Hatcher
Analyst

NVLAP Signatory

EEG
Environmental Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
96	4772-21-42	No	Trace

Sample Description: White
Joint Compound
Bathroom Partitions

This material contains approximately

Chrysotile Asbestos	<1%	Cellulose	1%
Calcite	55%	Quartz	2%
Particulate Matter	42%		

Sample #	Client Sample ID:	Layered	Analysis
97	4772-22-43	Yes 1	Positive

Sample Description: Black
Floor Tile
File Room Border - West End of 2nd Floor

This material contains approximately

Chrysotile Asbestos	3%	Cellulose	1%
Calcite	35%	Quartz	2%
Particulate Matter	59%		

Sample #	Client Sample ID:	Layered	Analysis
97	4772-22-43	Yes 2	Trace

Sample Description: Black
Mastic
File Room Border - West End of 2nd Floor

This material contains approximately

Chrysotile Asbestos	<1%	Cellulose	1%
Synthetic Fiber	3%	Calcite	3%
Quartz	1%	Particulate Matter	92%

Sample #	Client Sample ID:	Layered	Analysis
97	4772-22-43	Yes 3	Positive

Sample Description: Green
Floor Tile
File Room Border - West End of 2nd Floor

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	1%
Calcite	30%	Quartz	6%
Particulate Matter	59%		

ırrent information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only ethodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage ported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
ɜst measurements are traccable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the clusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or gnature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. mples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary ıboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan L Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: 2nd Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
97	4772-22-43	Yes 4	Trace	Chrysotile Asbestos	<1%	Cellulose	1%
				Synthetic Fiber	1%	Calcite	3%
Sample Description: Black Mastic File Room Border - West End of 2nd Floor				Quartz	1%	Particulate Matter	94%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 13 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

1st FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
1	4771-01-01 4771-01-02	Perimeter Door Caulk	Exterior Doors – 1st Floor	Good	7 ea.
2	4771-02-03 4771-02-04	Perimeter Window Caulk	Exterior Windows – 1st Floor	Good	11 ea.
3	4771-03-05 4771-03-06	Window Glazing	Exterior Windows – East Rear Area	Good	8 ea.
4	4771-04-07 4771-04-08	Exterior Surfacing	1st Floor Rear Wing (Morgue)	Good	1,350 LF x 30'
5	4771-05-09 4771-05-10	Stair Tread Material	All Stairwells in Middle of Structure	Good	64 treads
6	4771-06-11 4771-06-12	Dark Brown 9x9 FT / Mastic	Mop Room by Rear Entrance	Good	24 SF
7	4771-07-13 4771-07-14	Wall Plaster	Throughout Original 1st Floor Structure	Good	3,115 SF x 10'
8	4771-08-15 4771-08-16	Ceiling Plaster	Throughout Original 1st Floor Structure	Good	3,115 SF
9	4771-09-17 4771-09-18	Drywall / Joint Compound	Partitions in Front 1st Floor Addition	Good	4,600 SF x 10'
10	4771-10-19 4771-10-20	Yellow/Tan 12x12 FT / Mastic	Throughout Original 1st Floor Structure	Good	2,979 SF
11	4771-11-21 4771-11-22	Tan 12x12 FT / Mastic	Throughout 1st Floor Front Addition	Good	4,728 SF
12	4771-12-23 4771-12-24	Brown 12x12 FT / Mastic	Accents in 1st Floor Front Addition	Good	N/A
13	4771-13-25 4771-13-26	12x12 FT / Mastic under Carpeting	Various Rooms in Original 1st Floor Structure & New Addition	Good	1,155 SF
14	4771-14-27 4771-14-28	2x4 Lay-in Ceiling Tile (Type I)	Hallway of Original 1st Floor Structure	Good	805 SF
15	4771-15-29 4771-15-30	2x4 Lay-in Ceiling Tile (Type II)	Path Areas in Original 1st Floor Structure	Good	N/A

RELINQUISHED BY: _____ TIME: 1400 DATE: 13 Apr 18

RECEIVED BY: _____ TIME: 1105 DATE: 4/18/18

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

1st FLOOR SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
16	4771-16-31 4771-16-32	12x12 Ceiling Tile (Type I)	Above Grid in Original 1st Floor Area	Good	922 SF
17	4771-17-33 4771-17-34	12x12 Ceiling Tile (Type II)	Exposed in (1) Room – NE Hall Area	Good	117 SF
18	4771-18-35 4771-18-36	12x12 Ceiling Tile (Type III)	Exposed in (2) Rooms – NE Hall Area & by Old/New Junction	Good	321 SF
19	4771-19-37 4771-19-38	Dark Tan 12x12 FT / Mastic	SW Room at End of Hall – Original 1st Floor Area	Good	221 SF
20	4771-20-39 4771-20-40	Floral Print Sheet Vinyl Flooring	Bathrooms in NE Rooms – 1st Floor Original Area	Good	72 SF
21	4771-21-41 4771-21-42	Gray Cove Base & Mastic	Throughout Original 1st Floor Area	Good	1,046 LF
22	4771-22-43 4771-22-44	2x4 Lay-in Ceiling Tile (Type I)	1st Floor New Addition - Throughout	Good	4,728 SF
23	4771-23-45 4771-23-46	2x4 Lay-in Ceiling Tile (Type II)	Path Areas in 1st Floor New Addition	Good	N/A
24	4771-24-47 4771-24-48	2x4 Lay-in Ceiling Tile (Type III)	Path Areas in 1st Floor New Addition	Good	N/A
25	4771-25-49 4771-25-50	Brown/Tan 12x12 FT / Mastic	West End Restrooms in New Addition 1st Floor	Good	60 SF
26	4771-26-51 4771-26-52	Fire Door Insulation	Throughout 1st Floor	Good	15 ea.
27	4771-27-53 4771-27-54	Tan Sheet Vinyl Flooring	Restroom at Rear of Building	Good	36 SF

RELINQUISHED BY: T. Snyder TIME: 1400 DATE: 18 Apr 18

RECEIVED BY: S Ness TIME: 1405 DATE: _____

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
1	4771-01-01	No	None Detected	Cellulose	1%	Synthetic Fiber	2%
				Calcite	50%	Quartz	4%
Sample Description: Gray Caulk Exterior Doors - 1st Floor				Particulate Matter	43%		

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
2	4771-01-02	No	None Detected	Cellulose	1%	Synthetic Fiber	2%
				Calcite	50%	Quartz	3%
Sample Description: Gray Caulk Exterior Doors - 1st Floor				Particulate Matter	44%		

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
3	4771-02-03	No	None Detected	Calcite	60%	Quartz	3%
				Particulate Matter	37%		
Sample Description: Gray Caulk Exterior Windows - 1st Floor							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
4	4771-02-04	No	None Detected	Calcite	60%	Quartz	3%
				Particulate Matter	37%		
Sample Description: Gray Caulk Exterior Windows - 1st Floor							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
5	4771-03-05	No	None Detected	Cellulose	1%	Calcite	60%
				Quartz	2%	Particulate Matter	37%
Sample Description: White Glazing Exterior Windows - East Rear Area							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
6	4771-03-06	No	None Detected	Cellulose	<1%	Calcite	60%
				Quartz	2%	Particulate Matter	38%
Sample Description: White Glazing Exterior Windows - East Rear Area							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
7	4771-04-07	No	None Detected	Cellulose	<1%	Calcite	45%
				Quartz	25%	Particulate Matter	30%
Sample Description: White/Gray Surfacing 1st Floor Rear Wing (Morgue)							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
8	4771-04-08	No	None Detected	Cellulose	<1%	Calcite	45%
				Quartz	20%	Particulate Matter	35%
Sample Description: White/Gray Surfacing 1st Floor Rear Wing (Morgue)							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
9	4771-05-09	No	None Detected

Sample Description: White/Green/Brown
Stair Tread Material
All Stairwells - Middle of Structure

This material contains approximately

Calcite	3%	Quartz	2%
Particulate Matter	95%		

Sample #	Client Sample ID:	Layered	Analysis
10	4771-05-10	No	None Detected

Sample Description: White/Green/Brown
Stair Tread Material
All Stairwells - Middle of Structure

This material contains approximately

Cellulose	<1%	Calcite	2%
Quartz	2%	Particulate Matter	96%

Sample #	Client Sample ID:	Layered	Analysis
11	4771-06-11	Yes 1	Positive

Sample Description: Brown
Floor Tile
Mop Room by Rear Entrance

This material contains approximately

Chrysotile Asbestos	3%	Cellulose	<1%
Calcite	45%	Quartz	3%
Particulate Matter	49%		

Sample #	Client Sample ID:	Layered	Analysis
11	4771-06-11	Yes 2	Positive

Sample Description: Black
Mastic
Mop Room by Rear Entrance

This material contains approximately

Chrysotile Asbestos	10%	Cellulose	1%
Calcite	4%	Quartz	1%
Particulate Matter	84%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
13	4771-07-13	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout Original 1st Floor Structure

This material contains approximately

Calcite	7%	Quartz	4%
Gypsum Mortar	50%	Particulate Matter	39%

Sample #	Client Sample ID:	Layered	Analysis
13	4771-07-13	Yes 2	None Detected

Sample Description: Off White
Plaster - Skim
Throughout Original 1st Floor Structure

This material contains approximately

Cellulose	1%	Quartz	25%
Gypsum Mortar	45%	Particulate Matter	29%

Sample #	Client Sample ID:	Layered	Analysis
14	4771-07-14	Yes 1	None Detected

Sample Description: White
Plaster - Skim
Throughout Original 1st Floor Structure

This material contains approximately

Cellulose	<1%	Calcite	6%
Quartz	4%	Gypsum Mortar	50%
Particulate Matter	40%		

Sample #	Client Sample ID:	Layered	Analysis
14	4771-07-14	Yes 2	None Detected

Sample Description: Off White
Plaster - Skim
Throughout Original 1st Floor Structure

This material contains approximately

Cellulose	1%	Calcite	2%
Quartz	20%	Hair	45%
Particulate Matter	32%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
15	4771-08-15	No	None Detected	Cellulose	1%	Calcite	6%
				Quartz	3%	Gypsum Mortar	55%
				Particulate Matter	35%		
Sample Description: White/Red Plaster Throughout Original 1st Floor Structure							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
16	4771-08-16	No	None Detected	Cellulose	<1%	Calcite	7%
				Quartz	3%	Gypsum Mortar	50%
				Particulate Matter	40%		
Sample Description: White/Red Plaster Throughout Original 1st Floor Structure							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
17	4771-09-17	No	None Detected	Calcite	55%	Quartz	3%
				Particulate Matter	42%		
Sample Description: White/Pink Joint Compound Partitions in Front 1st Floor Addition							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
18	4771-09-18	No	None Detected	Cellulose	<1%	Calcite	55%
				Quartz	3%	Particulate Matter	42%
Sample Description: White/Pink Joint Compound Partitions in Front 1st Floor Addition							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R. Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
19	4771-10-19	Yes 1	None Detected

Sample Description: Tan
Floor Tile
Throughout Original 1st Floor Structure

This material contains approximately

Calcite	50%	Quartz	3%
Particulate Matter	47%		

Sample #	Client Sample ID:	Layered	Analysis
19	4771-10-19	Yes 2	Positive

Sample Description: Black
Mastic
Throughout Original 1st Floor Structure

This material contains approximately

Chrysotile Asbestos	2%	Cellulose	2%
Calcite	15%	Quartz	2%
Particulate Matter	79%		

Sample #	Client Sample ID:	Layered	Analysis
21	4771-11-21	Yes 1	None Detected

Sample Description: Tan
Floor Tile
Throughout 1st Floor Front Addition

This material contains approximately

Calcite	55%	Quartz	3%
Particulate Matter	42%		

Sample #	Client Sample ID:	Layered	Analysis
21	4771-11-21	Yes 2	Positive

Sample Description: Black
Mastic
Throughout 1st Floor Front Addition

This material contains approximately

Chrysotile Asbestos	8%	Cellulose	<1%
Calcite	4%	Quartz	1%
Particulate Matter	87%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
23	4771-12-23	Yes 1	Positive

Sample Description: Brown
Floor Tile
Accents in 1st Floor Front Addition

This material contains approximately

Chrysotile Asbestos	2%	Cellulose	<1%
Calcite	50%	Quartz	3%
Particulate Matter	45%		

Sample #	Client Sample ID:	Layered	Analysis
23	4771-12-23	Yes 2	Positive

Sample Description: Black
Mastic
Accents in 1st Floor Front Addition

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	1%
Calcite	20%	Quartz	3%
Particulate Matter	72%		

Sample #	Client Sample ID:	Layered	Analysis
25	4771-13-25	Yes 1	None Detected

Sample Description: Off White
Floor Tile
Various Rooms in Original 1st Floor & New Addition

This material contains approximately

Calcite	55%	Quartz	2%
Particulate Matter	43%		

Sample #	Client Sample ID:	Layered	Analysis
25	4771-13-25	Yes 2	None Detected

Sample Description: Yellow
Mastic
Various Rooms in Original 1st Floor & New Addition

This material contains approximately

Cellulose	1%	Calcite	15%
Quartz	1%	Particulate Matter	83%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
25	4771-13-25	Yes 3	Positive

Sample Description: Black
Mastic
Various Rooms in Original 1st Floor & New Addition

This material contains approximately

Chrysotile Asbestos	3%	Cellulose	1%
Calcite	20%	Quartz	1%
Particulate Matter	75%		

Sample #	Client Sample ID:	Layered	Analysis
27	4771-14-27	No	None Detected

Sample Description: White/Off White
Ceiling Tile
Hallway of Original 1st Floor Structure

This material contains approximately

Cellulose	60%	Perlite	25%
Particulate Matter	15%		

Sample #	Client Sample ID:	Layered	Analysis
28	4771-14-28	No	None Detected

Sample Description: White/Off White
Ceiling Tile
Hallway of Original 1st Floor Structure

This material contains approximately

Cellulose	60%	Mineral Wool	<1%
Perlite	20%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
29	4771-15-29	No	None Detected

Sample Description: White/Off White
Ceiling Tile
Path Areas in Original 1st Floor Structure

This material contains approximately

Cellulose	60%	Perlite	25%
Particulate Matter	15%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
30	4771-15-30	No	None Detected

Sample Description: White/Off White
Ceiling Tile
Path Areas in Original 1st Floor Structure

This material contains approximately

Cellulose	60%	Calcite	<1%
Perlite	20%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
31	4771-16-31	No	None Detected

Sample Description: White
Ceiling Tile
Above Grid in Original 1st Floor Area

This material contains approximately

Cellulose	35%	Mineral Wool	30%
Perlite	20%	Particulate Matter	15%

Sample #	Client Sample ID:	Layered	Analysis
32	4771-16-32	No	None Detected

Sample Description: White
Ceiling Tile
Above Grid in Original 1st Floor Area

This material contains approximately

Cellulose	30%	Mineral Wool	30%
Calcite	<1%	Perlite	25%
Particulate Matter	15%		

Sample #	Client Sample ID:	Layered	Analysis
33	4771-16-33	No	None Detected

Sample Description: White/Brown
Ceiling Tile
Exposed in 1 Room - NE Hall Area

This material contains approximately

Cellulose	98%	Particulate Matter	2%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
34	4771-17-34	No	None Detected

Sample Description: White/Brown
Ceiling Tile
Exposed in 1 Room - NE Hall Area

This material contains approximately

Cellulose	98%	Particulate Matter	2%

Sample #	Client Sample ID:	Layered	Analysis
35	4771-18-35	No	None Detected

Sample Description: White/Brown
Ceiling Tile
Exposed in 2 Rooms - NE Hall & by Old/New Junction

This material contains approximately

Cellulose	98%	Calcite	<1%
Particulate Matter	2%		

Sample #	Client Sample ID:	Layered	Analysis
36	4771-18-36	No	None Detected

Sample Description: White/Brown
Ceiling Tile
Exposed in 2 Rooms - NE Hall & by Old/New Junction

This material contains approximately

Cellulose	98%	Calcite	<1%
Particulate Matter	2%		

Sample #	Client Sample ID:	Layered	Analysis
37	4771-19-37	Yes 1	Positive

Sample Description: Tan
Floor Tile
SW Room at Ed of Hall - Original 1st Floor Area

This material contains approximately

Chrysotile Asbestos	2%	Cellulose	1%
Calcite	50%	Quartz	2%
Particulate Matter	45%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
37	4771-19-37	Yes 2	Positive

Sample Description: Black
Mastic
SW Room at Ed of Hall - Original 1st Floor Area

This material contains approximately

Chrysotile Asbestos	5%	Cellulose	1%
Calcite	3%	Quartz	4%
Particulate Matter	87%		

Sample #	Client Sample ID:	Layered	Analysis
39	4771-20-39	Yes 1	None Detected

Sample Description: White
Vinyl Sheet Flooring
Bathrooms in NE Rooms - 1st Floor Original Area

This material contains approximately

Cellulose	1%	Fiberglass	3%
Calcite	45%	Quartz	2%
Particulate Matter	49%		

Sample #	Client Sample ID:	Layered	Analysis
39	4771-20-39	Yes 2	None Detected

Sample Description: Tan
Floor Tile
Bathrooms in NE Rooms - 1st Floor Original Area

This material contains approximately

Calcite	55%	Quartz	2%
Particulate Matter	43%		

Sample #	Client Sample ID:	Layered	Analysis
39	4771-20-39	Yes 3	Positive

Sample Description: Black
Mastic
Bathrooms in NE Rooms - 1st Floor Original Area

This material contains approximately

Chrysotile Asbestos	4%	Cellulose	1%
Calcite	15%	Quartz	1%
Particulate Matter	79%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
41	4771-21-41	Yes 1	None Detected

Sample Description: Gray
Covebase
Throughout Original 1st Floor Area

This material contains approximately

Cellulose	1%	Calcite	3%
Quartz	1%	Particulate Matter	95%

Sample #	Client Sample ID:	Layered	Analysis
41	4771-21-41	Yes 2	None Detected

Sample Description: Brown
Covebase Mastic
Throughout Original 1st Floor Area

This material contains approximately

Cellulose	1%	Calcite	5%
Quartz	2%	Particulate Matter	92%

Sample #	Client Sample ID:	Layered	Analysis
42	4771-21-42	Yes 1	None Detected

Sample Description: Gray
Covebase
Throughout Original 1st Floor Area

This material contains approximately

Cellulose	1%	Calcite	3%
Quartz	1%	Particulate Matter	95%

Sample #	Client Sample ID:	Layered	Analysis
42	4771-21-42	Yes 2	None Detected

Sample Description: Brown
Covebase Mastic
Throughout Original 1st Floor Area

This material contains approximately

Cellulose	1%	Calcite	6%
Quartz	1%	Particulate Matter	92%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
43	4771-22-43	No	None Detected

Sample Description: White
Ceiling Tile
1st Floor New Addition - Throughout

This material contains approximately

Cellulose	30%	Mineral Wool	30%
Perlite	20%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
44	4771-22-44	No	None Detected

Sample Description: White
Ceiling Tile
1st Floor New Addition - Throughout

This material contains approximately

Cellulose	30%	Mineral Wool	30%
Perlite	20%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
45	4771-23-45	No	None Detected

Sample Description: White
Ceiling Tile
Path Areas in 1st Floor New Addition

This material contains approximately

Cellulose	35%	Mineral Wool	30%
Perlite	20%	Particulate Matter	15%

Sample #	Client Sample ID:	Layered	Analysis
46	4771-23-46	No	None Detected

Sample Description: White
Ceiling Tile
Path Areas in 1st Floor New Addition

This material contains approximately

Cellulose	30%	Mineral Wool	30%
Calcite	1%	Perlite	25%
Particulate Matter	14%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
47	4771-24-47	No	None Detected

Sample Description: White
Ceiling Tile
Path Areas in 1st Floor New Addition

This material contains approximately

Cellulose	30%	Mineral Wool	35%
Perlite	20%	Particulate Matter	15%

Sample #	Client Sample ID:	Layered	Analysis
48	4771-24-48	No	None Detected

Sample Description: White
Ceiling Tile
Path Areas in 1st Floor New Addition

This material contains approximately

Cellulose	30%	Mineral Wool	30%
Calcite	1%	Perlite	20%
Particulate Matter	19%		

Sample #	Client Sample ID:	Layered	Analysis
49	4771-25-49	Yes 1	Positive

Sample Description: Brown/Tan
Floor Tile
West End Restrooms in NE Addition 1st Floor

This material contains approximately

Chrysotile Asbestos	2%	Calcite	50%
Quartz	3%	Particulate Matter	45%

Sample #	Client Sample ID:	Layered	Analysis
49	4771-25-49	Yes 2	Positive

Sample Description: Black
Mastic
West End Restrooms in NE Addition 1st Floor

This material contains approximately

Chrysotile Asbestos	3%	Cellulose	1%
Calcite	10%	Quartz	2%
Particulate Matter	84%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
51	4771-26-51	No	None Detected

Sample Description: White
Insulation
Throughout 1st Floor

This material contains approximately

Cellulose	1%	Calcite	3%
Quartz	3%	Perlite	40%
Particulate Matter	53%		

Sample #	Client Sample ID:	Layered	Analysis
52	4771-26-52	No	None Detected

Sample Description: White
Insulation
Throughout 1st Floor

This material contains approximately

Cellulose	1%	Calcite	3%
Quartz	3%	Perlite	35%
Particulate Matter	58%		

Sample #	Client Sample ID:	Layered	Analysis
53	4771-27-053	Yes 1	None Detected

Sample Description: Tan
Vinyl Sheet Flooring
Restroom at Rear of Building

This material contains approximately

Cellulose	30%	Fiberglass	3%
Calcite	30%	Quartz	3%
Particulate Matter	34%		

Sample #	Client Sample ID:	Layered	Analysis
53	4771-27-053	Yes 2	None Detected

Sample Description: White
Floor Tile
Restroom at Rear of Building

This material contains approximately

Calcite	55%	Quartz	2%
Particulate Matter	43%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Gray's Hospital / Batesville - 1st Floor
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/18/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
54	4771-27-054	Yes 1	None Detected

Sample Description: Tan
Vinyl Sheet Flooring
Restroom at Rear of Building

This material contains approximately

Cellulose	30%	Fiberglass	3%
Calcite	30%	Quartz	2%
Particulate Matter	35%		

Sample #	Client Sample ID:	Layered	Analysis
54	4771-27-054	Yes 2	None Detected

Sample Description: White
Floor Tile
Restroom at Rear of Building

This material contains approximately

Calcite	55%	Quartz	3%
Particulate Matter	42%		

Sample #	Client Sample ID:	Layered	Analysis
54	4771-27-054	Yes 3	None Detected

Sample Description: Yellow
Mastic
Restroom at Rear of Building

This material contains approximately

Cellulose	1%	Synthetic Fiber	<1%
Calcite	6%	Quartz	1%
Particulate Matter	92%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst
NVLAP Signatory

SNYDER ENVIRONMENTAL

ACM SAMPLES

SNYDER ENVIRONMENTAL
6709 WAYNE DRIVE
NORTH LITTLE ROCK, AR 72118

PHONE: 501-801-2773
FAX: 501-907-1129

PROJECT #: 184128S

INSPECTION FIELD SHEET

DATE SAMPLED: 12 April 2018

INSPECTOR: J. STUART

PROJECT NAME: Former Gray's Hospital
PROJECT ADDRESS: 477 E. Main Street
Batesville, AR

OUT BUILDING SAMPLES

#	SAMPLE #	MATERIAL	LOCATION	CONDITION	SF/LF
			FORMER MORGUE		
1	477M-01-01 477M-01-02 477M-01-03 477M-01-04	Tan 12x12 FT / Mastic	Throughout Former Morgue	Good	1,350 SF
2	477M-02-05 477M-02-06	2x4 Lay-in Ceiling Tile	Throughout Former Morgue	Good	1,350 SF
			GENERATOR ROOOM		
1	477G-01-01 477G-01-02	2x4 Lay-in Ceiling Tile	Throughout Generator Room	Good	238 SF
			FOOD STORAGE BUILDING		
1	477F-01-01 477F-01-02	Drywall Ceiling	Ceilings Throughout	Good	1,007 SF
2	477F-02-03 477F-02-04	Window Glazing	Exterior Windows of Structure	Good	3 ea.
3	477F-03-05 477F-03-06	Shingle Roofing	Roof	Good	1,007 SF

RELINQUISHED BY: A. Snyder TIME: 1400 DATE: 13 Apr. 18

RECEIVED BY: S. Ness TIME: 1405 DATE: 4/18/18

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Former Morgue
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
139	477M-01-01	Yes 1	Positive

Sample Description: Tan
Floor Tile
Throughout Former Morgue

This material contains approximately			
Chrysotile Asbestos	2%	Cellulose	<1%
Calcite	55%	Quartz	2%
Particulate Matter	41%		

Sample #	Client Sample ID:	Layered	Analysis
139	477M-01-01	Yes 2	None Detected

Sample Description: Yellow
Mastic
Throughout Former Morgue

This material contains approximately			
Cellulose	1%	Calcite	5%
Quartz	1%	Particulate Matter	93%

Sample #	Client Sample ID:	Layered	Analysis
143	477M-02-05	No	None Detected

Sample Description: White
Ceiling Tile
Throughout Former Morgue

This material contains approximately			
Cellulose	30%	Mineral Wool	30%
Perlite	20%	Particulate Matter	20%

Sample #	Client Sample ID:	Layered	Analysis
144	477M-02-06	Yes 1	None Detected

Sample Description: White
Ceiling Tile
Throughout Former Morgue

This material contains approximately			
Cellulose	30%	Mineral Wool	35%
Perlite	20%	Particulate Matter	15%

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Generator Room/Outbuilding
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
145	477G-01-01	No	None Detected	Cellulose	60%	Perlite	30%
				Particulate Matter	10%		
Sample Description: White Ceiling Tile Throughout Generator Room							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
146	477G-01-02	No	None Detected	Cellulose	55%	Calcite	<1%
				Perlite	30%	Particulate Matter	15%
Sample Description: White Ceiling Tile Throughout Generator Room							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent.
Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.
220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Food Storage/Outbuilding
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
147	477F-01-01	No	None Detected	Cellulose	35%	Fiberglass	1%
				Gypsum Mortar	50%	Particulate Matter	14%
Sample Description: White/Brown Drywall Ceilings Throughout							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
148	477F-01-02	No	None Detected	Cellulose	30%	Fiberglass	1%
				Gypsum Mortar	60%	Particulate Matter	9%
Sample Description: White/Brown Drywall Ceilings Throughout							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
149	477F-02-03	No	None Detected	Cellulose	1%	Calcite	60%
				Quartz	5%	Particulate Matter	34%
Sample Description: White Glazing Exterior Windows of Structure							

Sample #	Client Sample ID:	Layered	Analysis	This material contains approximately			
150	477F-02-04	No	None Detected	Cellulose	1%	Calcite	55%
				Quartz	5%	Particulate Matter	39%
Sample Description: White Glazing Exterior Windows of Structure							

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101587-0

Respectfully Submitted,
EEG, Inc
Megan R Hatcher
Analyst

NVLAP Signatory

EEG
Environmental
Enterprise Group, Inc.

220 North Knoxville Russellville, Arkansas 72801
Phone (479) 968-6767 Fax (479) 968-1956
www.eegonline.com

Client: Snyder Environmental & Construction, Inc.
Client Project: 184128S
Methodology: EPA-600/R-93/116
Sample(s) Taken From: Food Storage/Outbuilding
Received: 4/18/2018 **Shipped Via:** FedEx

Job Number: 00297- B2018-0254
Sampled By: J. Stuart

Date Sampled: 4/13/2018
Reported: 4/19/2018

Bulk Asbestos Report

Sample #	Client Sample ID:	Layered	Analysis
151	477F-03-05	No	None Detected

Sample Description: Gray/Black
Shingle
Roof

This material contains approximately			
Cellulose	<1%	Fiberglass	20%
Calcite	25%	Quartz	6%
Particulate Matter	49%		

Sample #	Client Sample ID:	Layered	Analysis
152	477F-03-06	No	None Detected

Sample Description: Gray/Black
Shingle
Roof

This material contains approximately			
Cellulose	<1%	Fiberglass	20%
Calcite	30%	Quartz	5%
Particulate Matter	45%		

Current information listed above applies to the standards or procedures identified and the samples actually tested. The methodology(s) listed in this report is the only methodology(s) used. The methodology listed in this report is a deviation from NVLAP's specific scope of accreditation (EPA-600/M-4-82-020 method). Each percentage reported above is a visual estimation of total composition, unless otherwise noted in this report. Asbestos detection limit is less than 1 percent. Test measurements are traceable to Standard Reference Material 1866a and 1867. The results are valid only for the materials tested. The information listed above is for the exclusive use of the client listed above. Sample results shall not be reproduced in any form or fashion for advertising or other purposes in connection with EEG's name or signature without consent from EEG. Sample results shall not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. Samples not consumed in analysis will be retained for a maximum of 30 days. Samples may be returned to the client upon request. Accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of Accreditation under NVLAP code 101587-0.

NVLAP®
NVLAP LAB CODE 101687-0

Respectfully Submitted,
EEG, Inc
Megan R Hatchw
Analyst

NVLAP Signatory

Appendix B

Photographs

477R-01-01: Lower Roof - Field Roofing	
477R-02-02: Lower Roof - Penetration Mastic - 20% Chrysotile	
477R-03-03: Middle Roof - Field Roofing	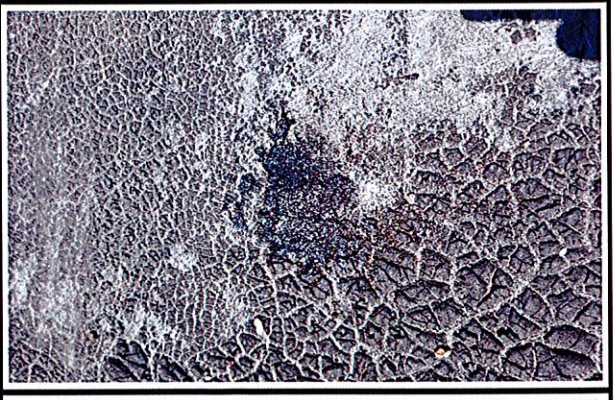
477R-04-04: Middle Roof - Penetration Mastic - 15% Chrysotile	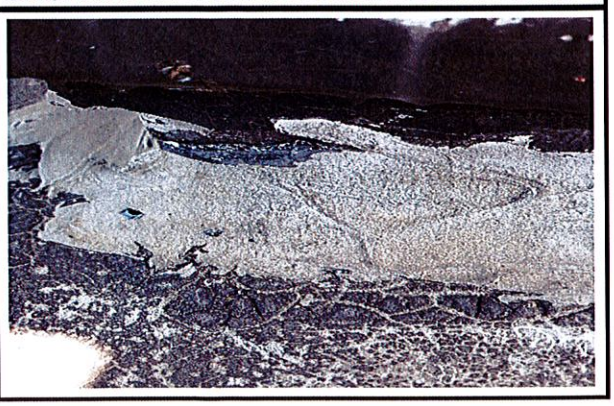

477R-05-05: Side Roof - Field Roofing	
477R-06-06: Side Roof - Penetration Mastic	
477R-07-07: Side Roof - Flashing	
477R-08-08: Upper Roof - Field Roofing	

477R-09-09: Upper Roof - Penetration Mastic	

4774-01-01 & 02: Lt. Brown Cove Base & Mastic - 2% Chrysotile	
4774-02-03 & 04: Dark Brown Cove Base & Mastic	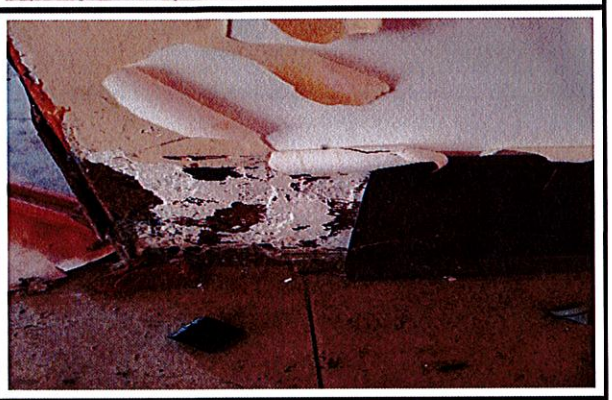
4774-03-05 & 06: Dark Tan 9x9 FT / Mastic - 10% Chrysotile	
4774-04-07 & 08: Lt. Tan 9x9 FT / Mastic - 8% Chrysotile	

4774-05-09 & 10: 2x4 Lay-in Ceiling Tile (Type I)	
4774-06-11 & 12: 2x4 Lay-in Ceiling Tile (Type II)	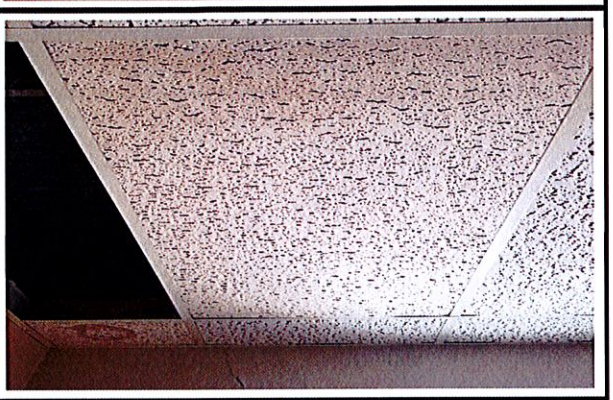
4774-07-13 & 14: Spray-on Fire Proofing	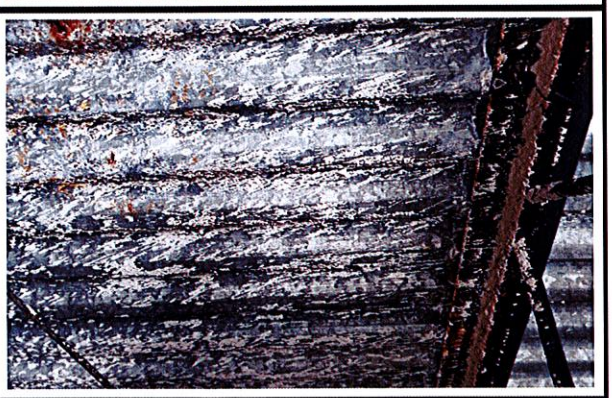
4774-08-15 & 16: Pipe Insulation	

4774-09-17 & 18: Wall Plaster	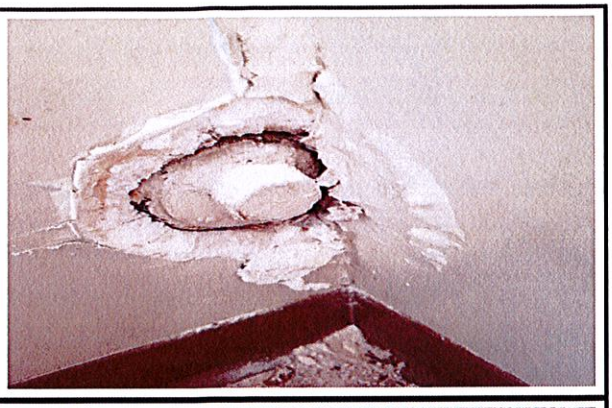
4774-10-19 & 20: Drapery Material	
4774-11-21 & 22: White Perimeter Window Caulk	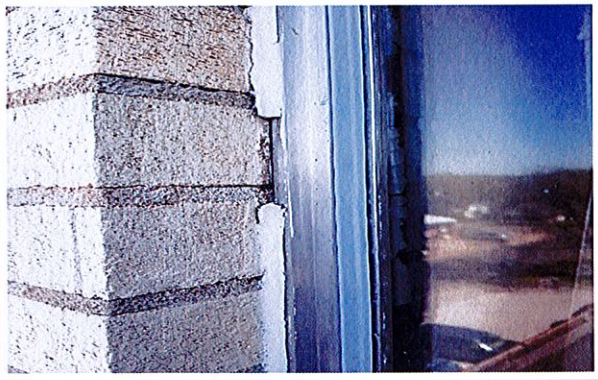

4773-01-01 & 02: Dark Brown Cove Base & Mastic	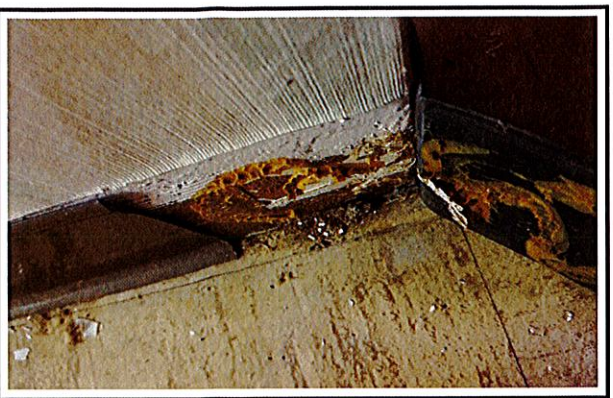
4773-02-03 & 04: 2x4 Lay-in Ceiling Tile (Type I)	
4773-03-05 & 06: Wall Plaster	
4773-04-07 & 08: Ceiling Plaster	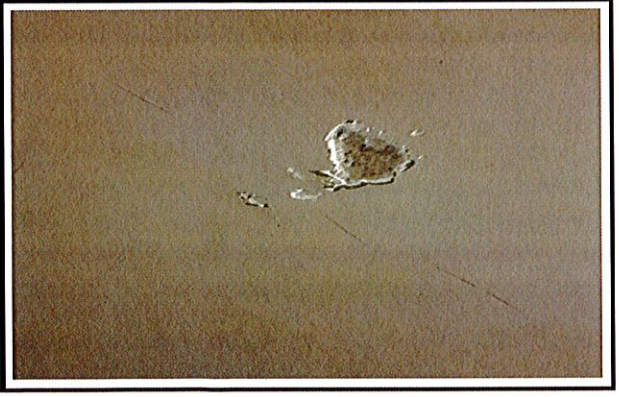

4773-05-09 & 10: Tan 12x12 FT / Mastic - ***10% Chrysotile***	
4773-06-11 & 12: Gray 12x12 FT / Mastic - ***4% Chrysotile***	
4773-07-13 & 14: 2x4 Lay-in Ceiling Tile (Type II)	
4773-08-15 & 16: FT / Mastic Under Carpeting - ***8% Chrysotile***	

4773-09-17 & 18: Window Glazing	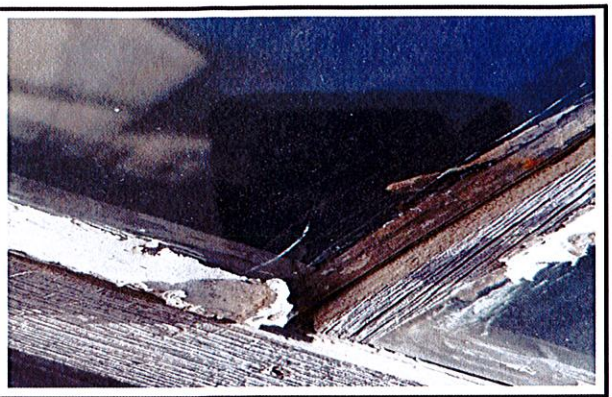

4772-01-01 & 02: Dark Brown Cove Base & Mastic	
4772-02-03 & 04: 2x4 Lay-in Ceiling Tile (Type I)	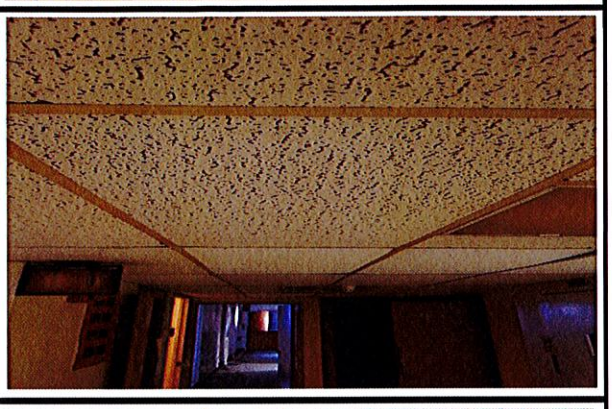
4772-03-05 & 06: 2x4 Lay-in Ceiling Tile (Type II)	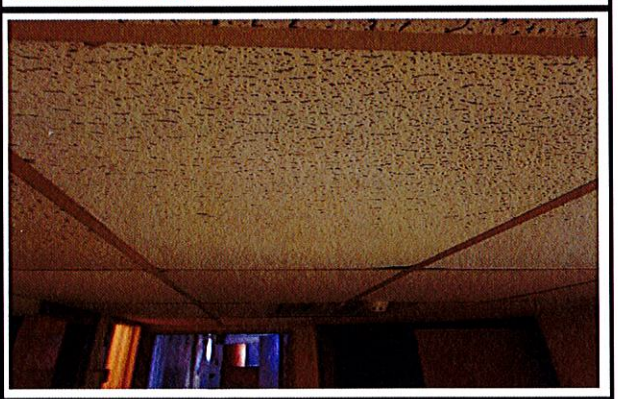
4772-04-07 & 08: 2x4 Lay-in Ceiling Tile (Type III)	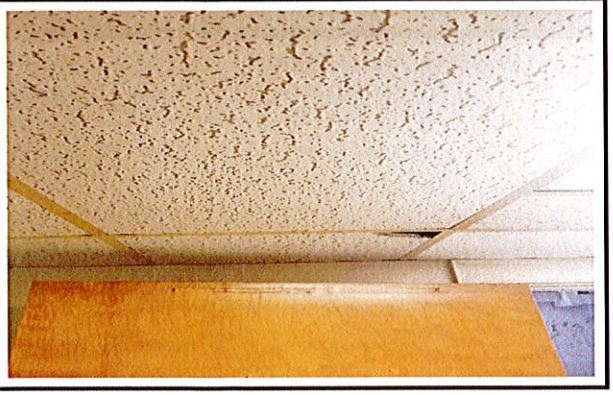

4772-05-09 & 10: Tan 12x12 FT / Mastic - 2% Chrysotile	
4772-06-11 & 12: Gray 12x12 FT / Mastic - 4% Chrysotile	
4772-07-13 & 14: White/Black 12x12 FT / Mastic	
4772-08-15 & 16: Flat Black 9x9 FT - 4% Chrysotile	

4772-09-17 & 18: 12x12 Ceiling Tiles	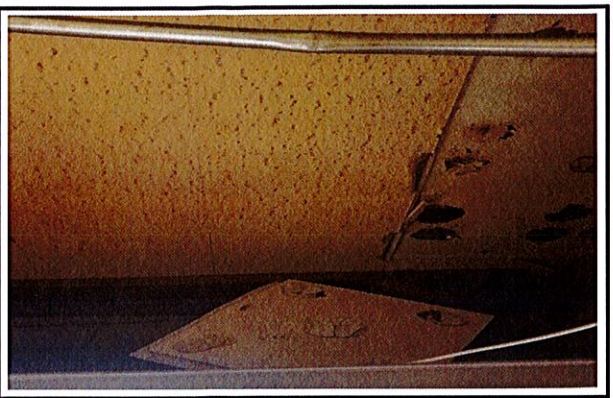
4772-10-19 & 20: Yellow Mastic Pucks	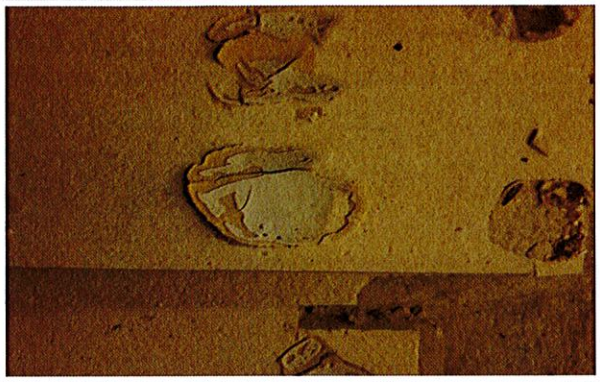
4772-11-21 & 22: Black Mastic Pucks - 3% Chrysotile	
4772-12-23 & 24: Brown 12x12 FT / Mastic	

4772-13-25 & 26: Fire Door Insulation - 10% Amosite	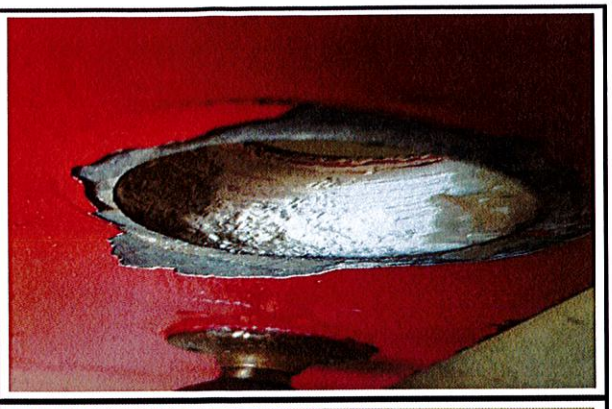
4772-14-27 & 28: Wall Plaster	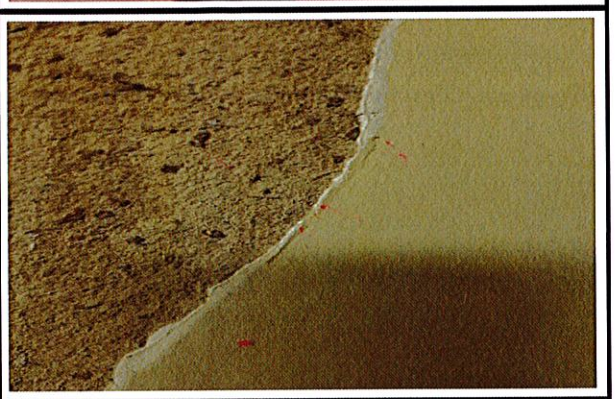
4772-15-29 & 30: Ceiling Plaster	
4772-16-31 & 32: Gray 9x9 FT / Mastic - 10% Chrysotile	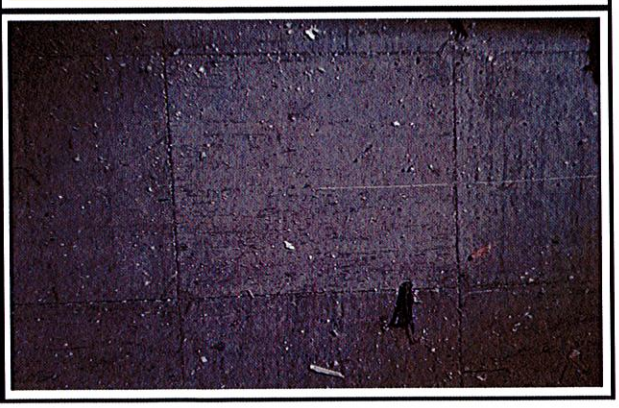

4772-17-33 & 34: Off-White 12x12 FT / Mastic - 10% Chrysotile	
4772-18-35 & 36: 6" Cove Base & Mastic	
4772-19-37 & 38: Perimeter Window Caulk	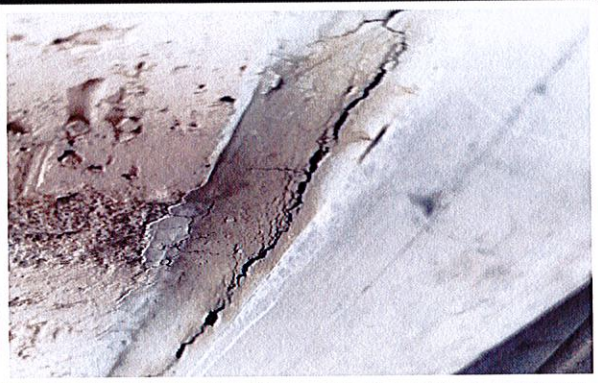
4772-20-39 & 40: Window Glazing	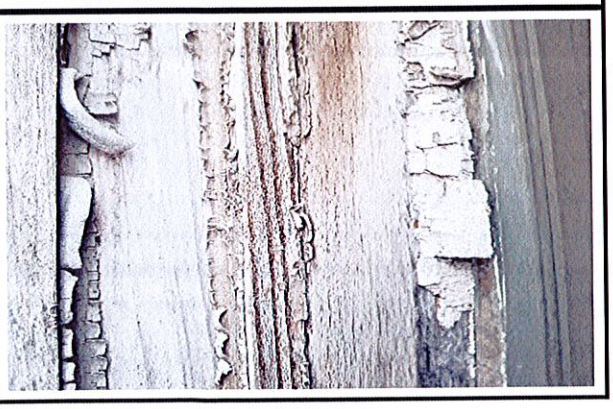

4772-21-41 & 42: Drywall / Joint Compound	
4772-22-43 & 44: Glossy 4x24 FT / Mastic - ***4% Chrysotile***	

4771-01-01 & 02: Perimeter Door Caulk	
4771-02-03 & 04: Perimeter Window Caulk	
4771-03-05 & 06: Window Glazing	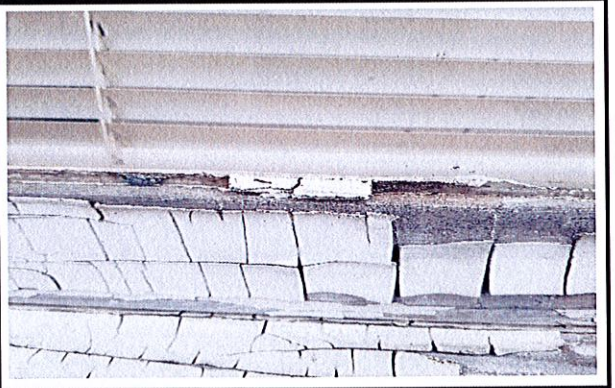
4771-04-07 & 08: Exterior Surfacing	

4771-05-09 & 10: Stair Tread Material	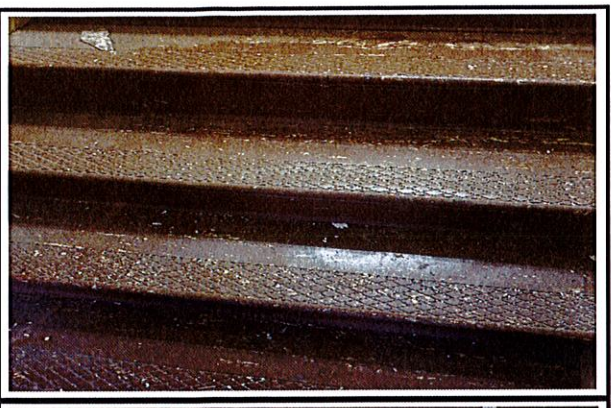
4771-06-11 & 12: Dark Brown 9x9 FT / Mastic - 10% Chrysotile	
4771-07-13 & 14: Wall Plaster	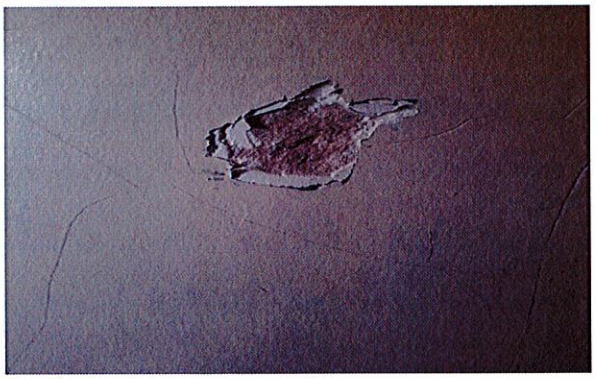
4771-08-15 & 16: Ceiling Plaster	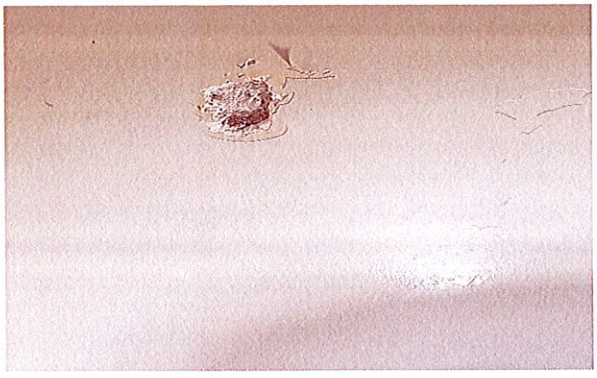

4771-09-17 & 18: Drywall / Joint Compound	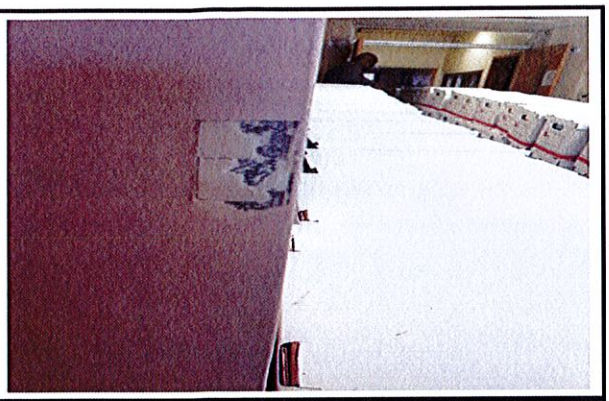
4771-10-19 & 20: Yellow/Tan 12x12 FT / Mastic - 2% Chrysotile	
4771-11-21 & 22 Tan 12x12 FT / Mastic - 8% Chrysotile	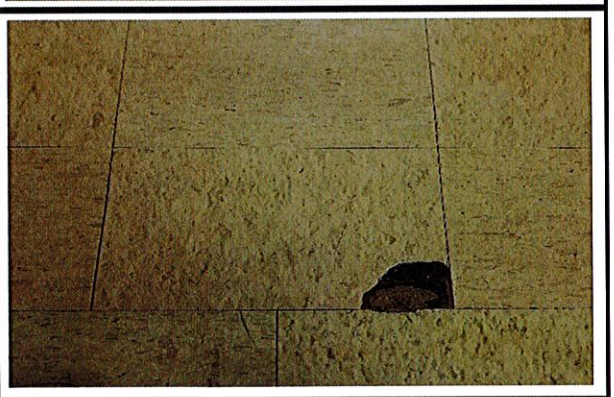
4771-12-23 & 24 Brown 12x12 FT / Mastic - 4% Chrysotile	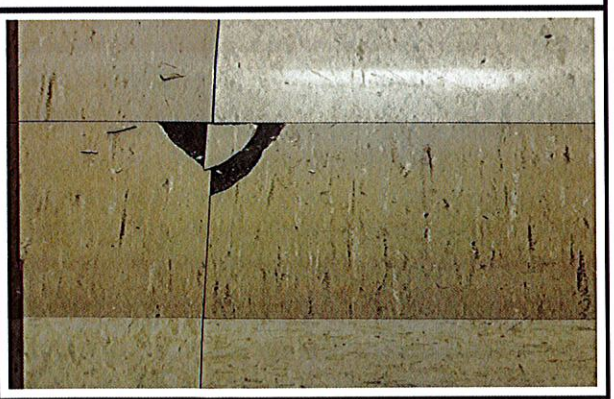

4771-13-25 & 26: 12x12 FT/ Mastic under Carpeting - 3% Chrysotile	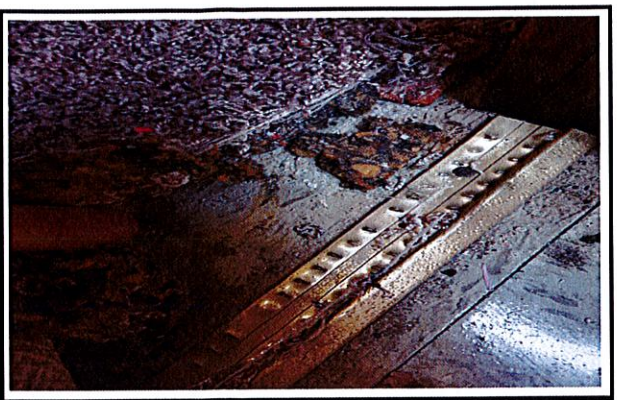
4771-14-27 & 28: 2x4 Lay-in Ceiling Tile (Type I)	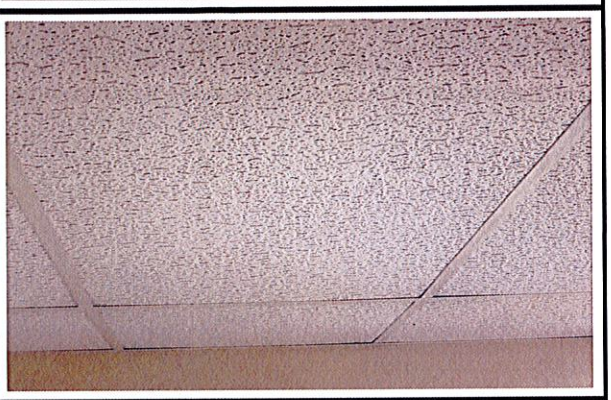
4771-15-29 & 30 2x4 Lay-in Ceiling Tile (Type II)	
4771-16-31 & 32: 12x12 Ceiling Tile (Type I)	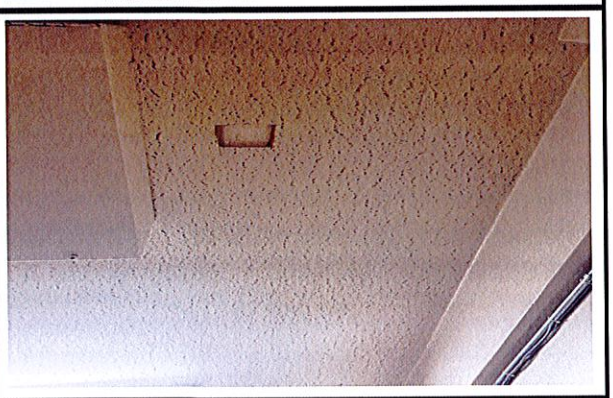

4771-17-33 & 34 12x12 Ceiling Tile (Type II)	
4771-18-35 & 36 12x12 Ceiling Tile (Type III)	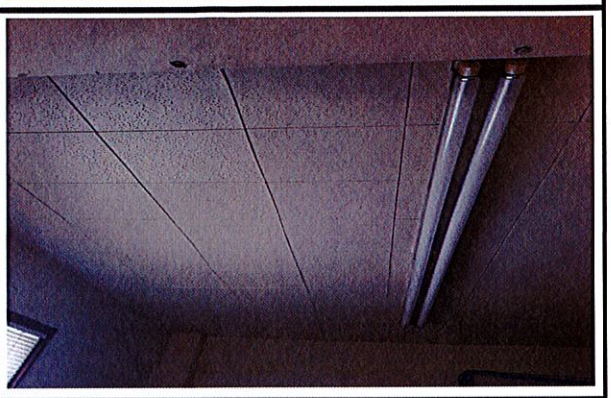
4771-19-37 & 38: Dark Tan 12x12 FT / Mastic - 5% Chrysotile	
4771-20-39 & 40: Floral Print Sheet Vinyl Flooring - 4% Chrysotile	

4771-21-41 & 42: Gray Cove Base & Mastic	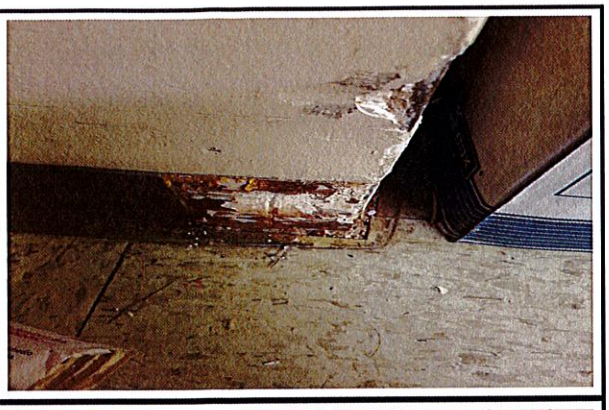
4771-22-43 & 44: 2x4 Lay-in Ceiling Tile (Type I)	
4771-23-35 & 46 2x4 Lay-in Ceiling Tile (Type II)	
4771-24-47 & 48 2x4 Lay-in Ceiling Tile (Type III)	

4771-25-49 & 50: Brown/Tan 12x12 FT / Mastic - 3% Chrysotile	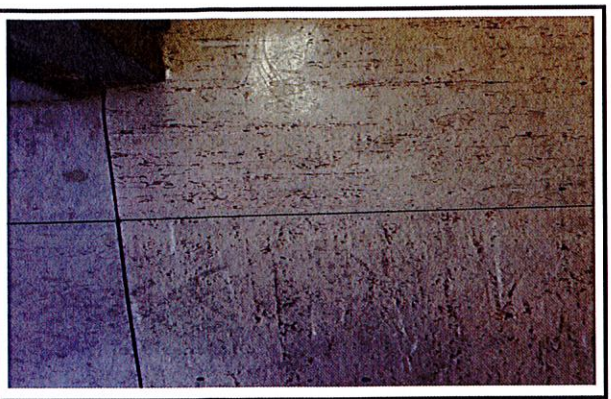
4771-26-51 & 52: Fire Door Insulation	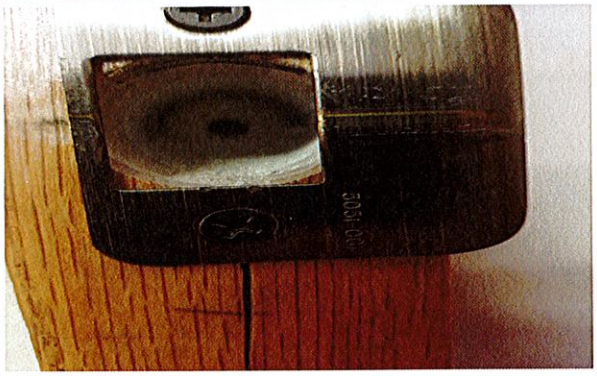
4771-27-53 & 54: Tan Sheet Vinyl Flooring	

477M-01-01 thru 04: Tan 12x12 FT / Mastic - 2% Chrysotile	**NO PICTURE AVAILABLE**
477M-02-05 & 06: 2x4 Lay-in Ceiling Tile	**NO PICTURE AVAILABLE**
477G-01-01 & 02: 2x4 Lay-in Ceiling Tile	**NO PICTURE AVAILABLE**

477F-01-01 & 02: Drywall Ceiling	**NO PICTURE AVAILABLE**
477F-02-03 & 04: Window Glazing	**NO PICTURE AVAILABLE**
477F-03-05 & 06: Shingle Roofing	**NO PICTURE AVAILABLE**

Appendix C

Site Diagrams

FORMER GRAY'S HOSPITAL - 477 E. MAIN STREET - BATESVILLE, AR

4TH FLOOR

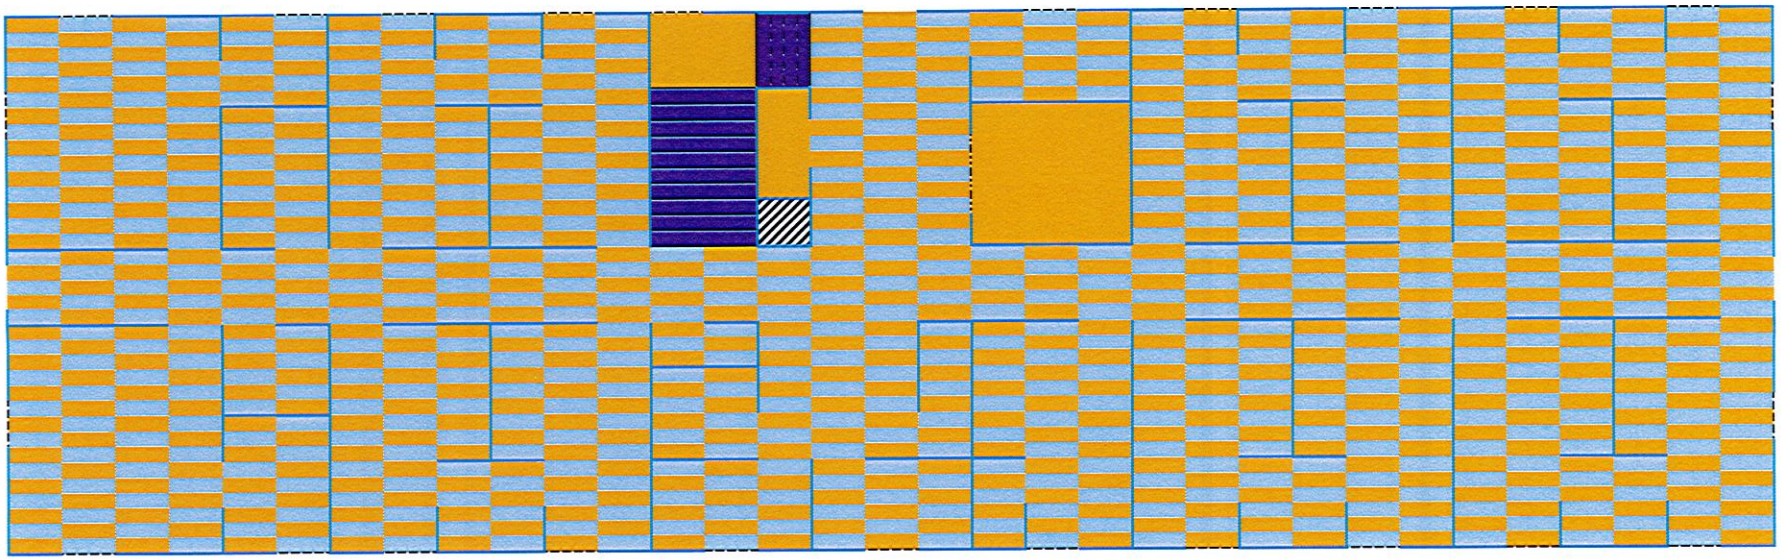

DARK TAN 9X9 FT

2X4 CEILING TILE

WALL PLASTER

STAIR TREAD

FORMER GRAY'S HOSPITAL - 477 E. MAIN STREET - BATESVILLE, AR

3RD FLOOR

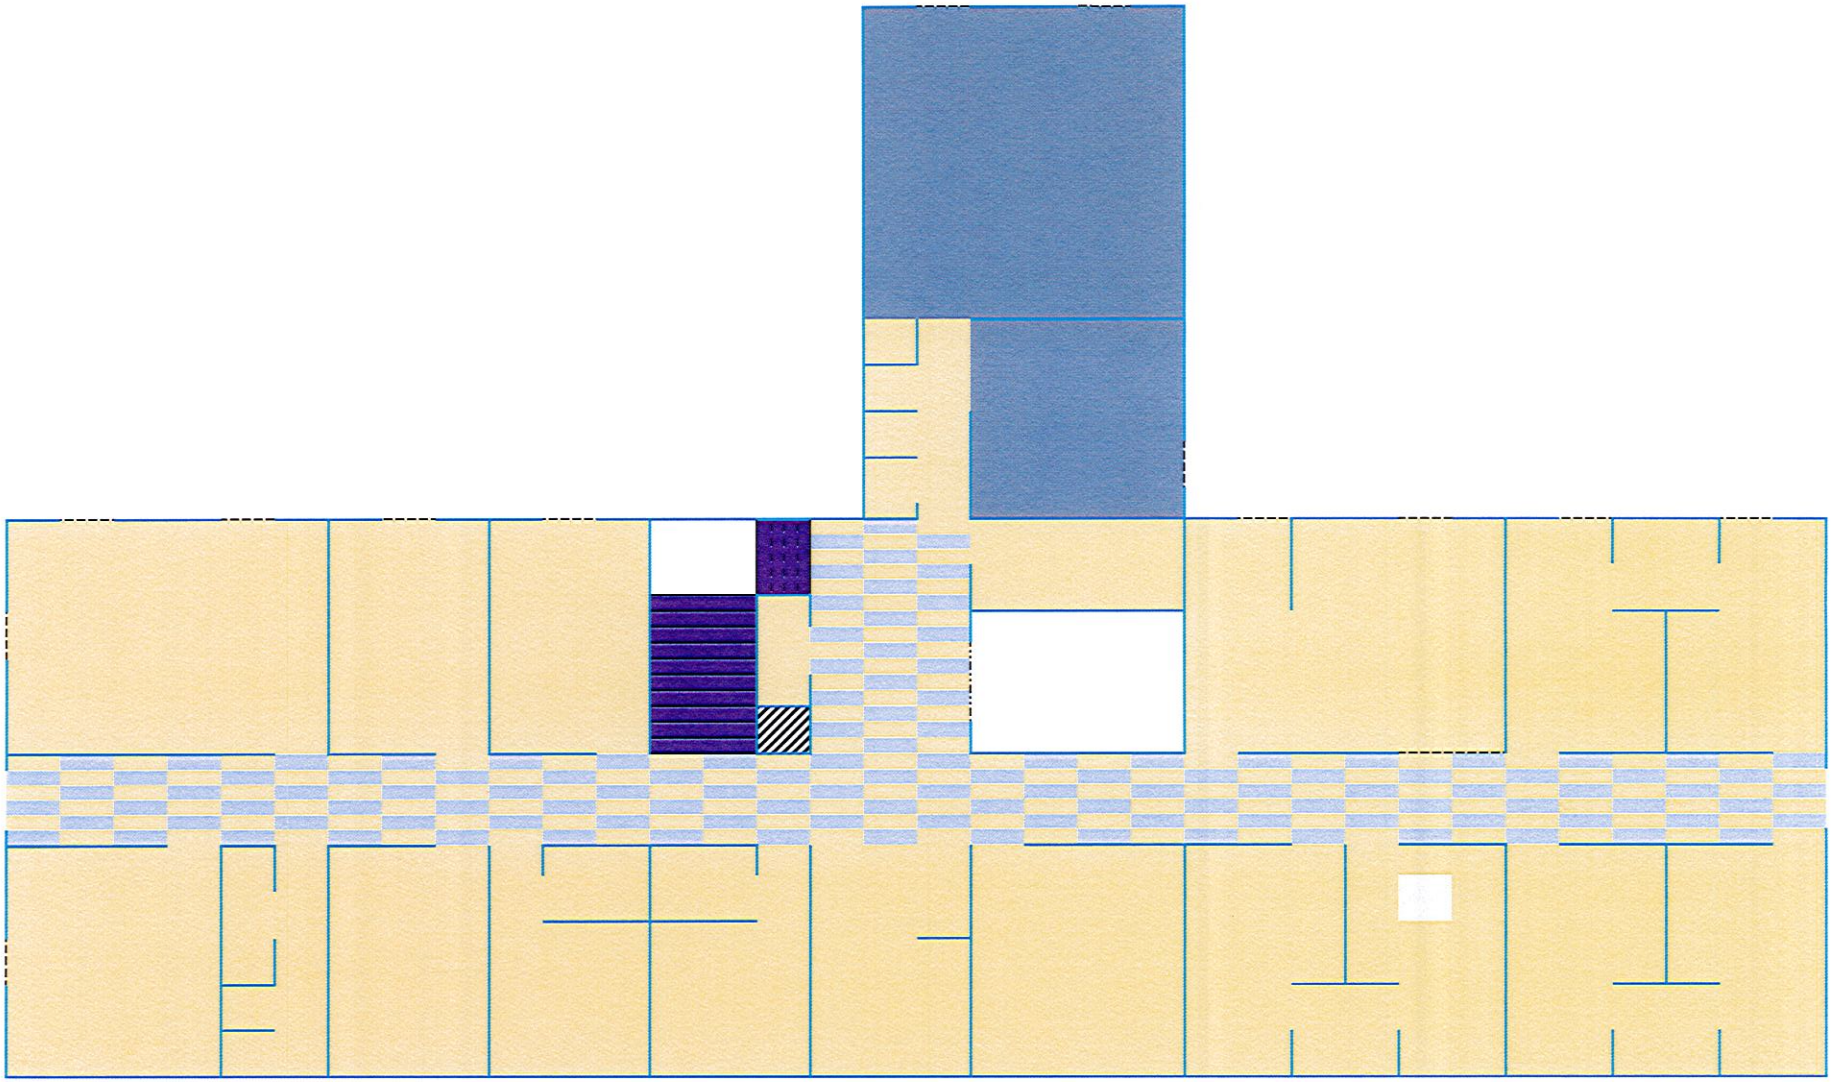

Tan 12x12 FT | Wall Plaster | 2x4 Ceiling Tile | Gray 12x12 FT | FT Under Carpeting | Stair Tread

FORMER GRAY'S HOSPITAL - 477 E. MAIN STREET - BATESVILLE, AR

2ND FLOOR

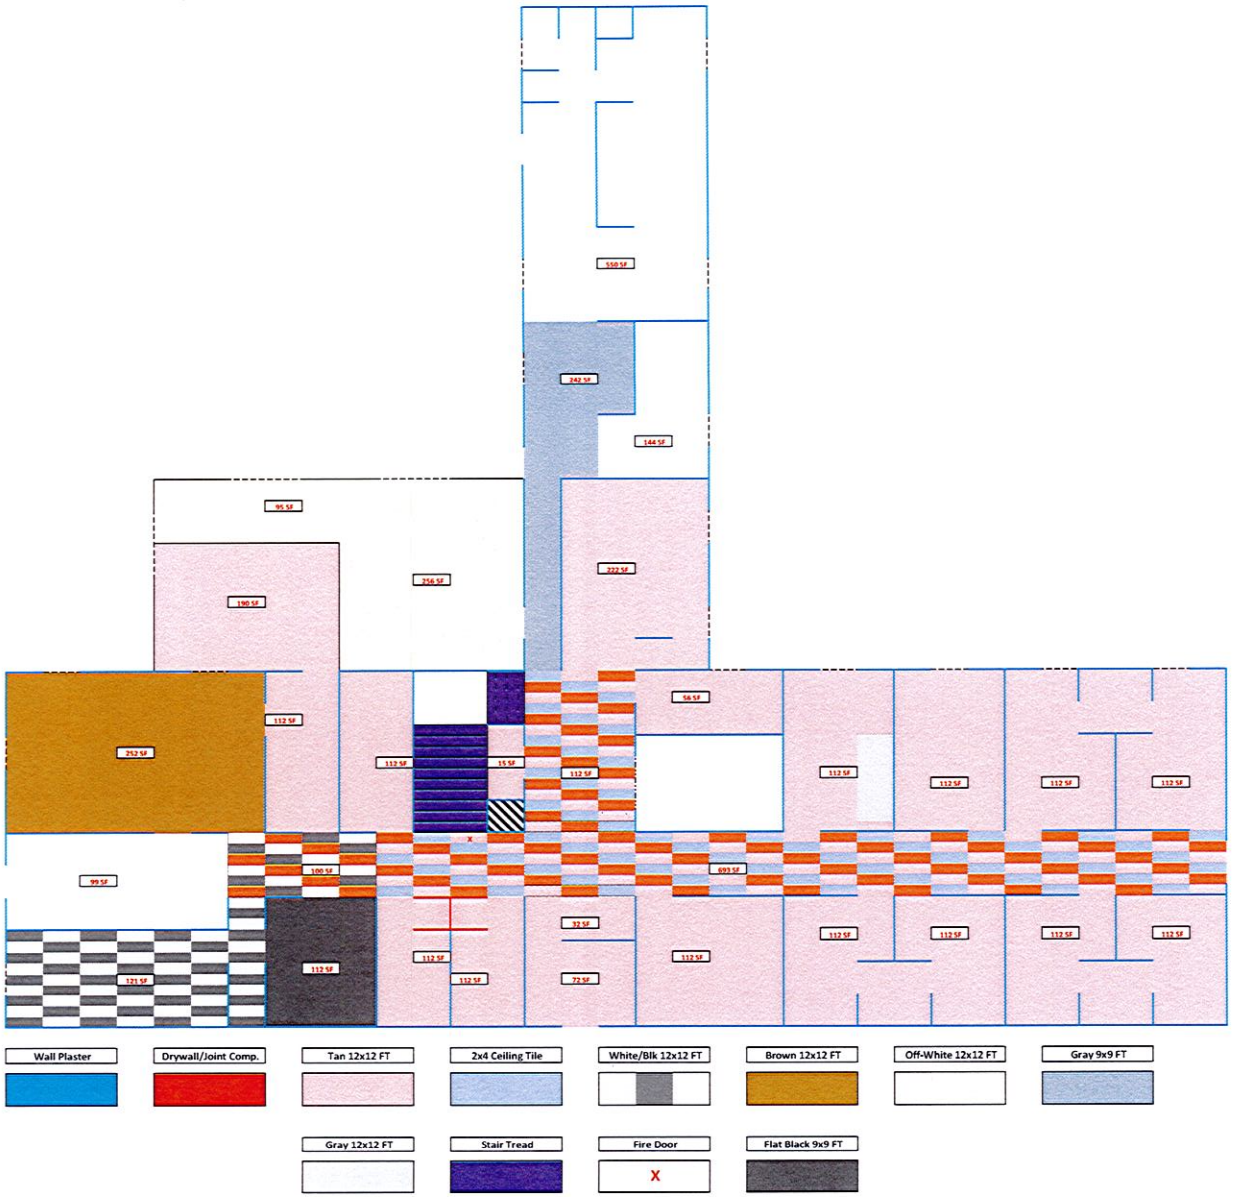

FORMER GRAY'S HOSPITAL - 477 E. MAIN STREET - BATESVILLE, AR

1ST FLOOR

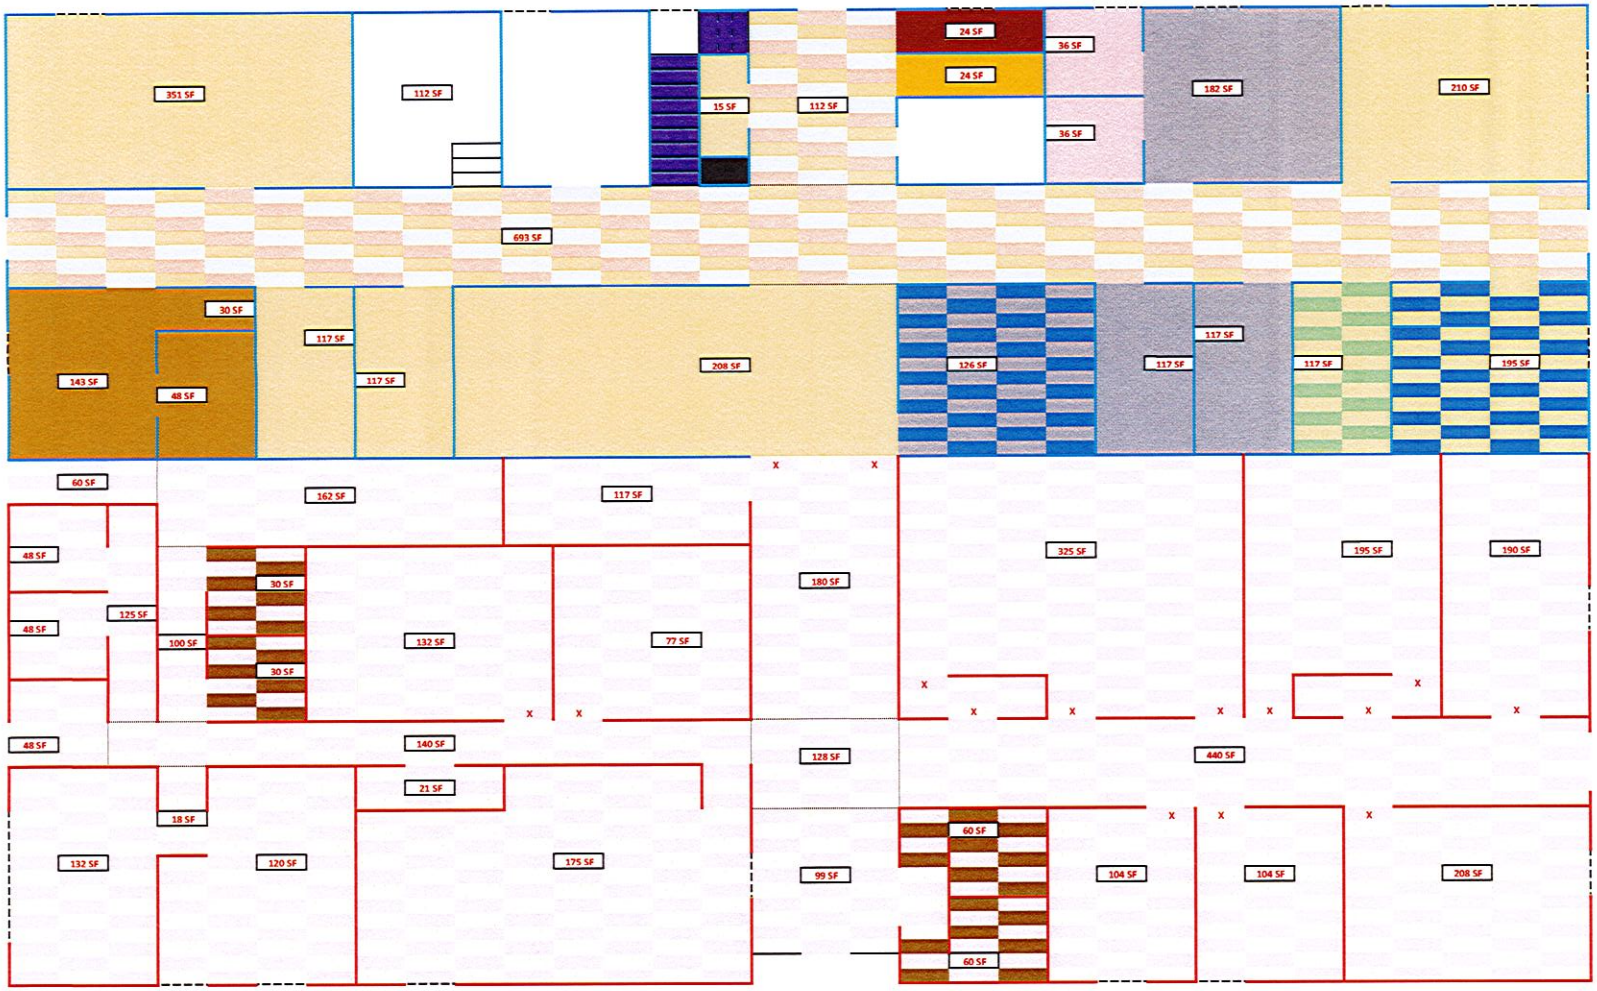

Tan 12x12 FT	Drywall/Joint Comp.	2x4 Ceiling Tile	Brown Tan 12x12 FT	Wall Plaster	Stair Treads	Yellow/Tan 12x12 FT	Dark Tan 12x12 FT	12x12 Ceiling Tile

12x12 Under Carpet	12x12 Ceiling Tile	12x12 Ceiling Tile	2x4 Ceiling Tile	Floral SVF	Tan SVF	Dark Brown 9x9	Fire Door Insulation
							X

Appendix D

Certifications

Arkansas Department of Environmental Quality

015878 JUSTIN STUART

having satisfied the requirements necessary to meet the provisions of AHERA/ASHARA under TSCA Title II and the Arkansas Pollution Control and Ecology Commission's Regulation 21 and is hereby certified in the State of Arkansas in the discipline(s) of Asbestos

Contractor/Supervisor 2/28/2019

Inspector 5/31/2018

ARKANSAS DEPARTMENT OF ENVIRONMENTAL QUALITY

Effective: 3/8/2018

Certificate Issued: 3/8/2018

Becky W. Keogh

Becky W. Keogh
ADEQ Director

Arkansas Department of Environmental Quality

016906 LYSLE BRADSHAW

having satisfied the requirements necessary to meet the provisions of AHERA/ASHARA under TSCA Title II and the Arkansas Pollution Control and Ecology Commission's Regulation 21 and is hereby certified in the State of Arkansas in the discipline(s) of Asbestos

Contractor/Supervisor 8/31/2018
Inspector 11/30/2018

Effective: 3/27/2018
Certificate Issued: 3/27/2018

Becky W. Keogh
ADEQ Director

APPENDIX H QUALIFICATIONS OF ENVIRONMENTAL PROFESSIONALS

TETRA TECH

Kenneth B. Edge
Environmental Scientist

EXPERIENCE SUMMARY

Mr. Edge is an environmental scientist providing technical support for START V and EMI. Mr. Edge has assisted START V with Phase I site inspections and reporting, Phase II sampling efforts, and Emergency Responses. At his previous employer (Geosyntec) Mr. Edge was a Staff Geologist in Jefferson City, Missouri, and conducted field work related to Superfund Sites, mines, sampling of different types of media, logging core, as well as project support. Mr. Edge was involved in several events where he performed oversight of drilling and monitoring well installations using percussion, rotary, and sonic drilling, as well as cone penetration testing; lithologic logging in accordance with the United States Classification System (USCS); sampling of a multitude of media (e.g., soil, sediment, bedrock, mine tailings, ground water, and surface water), and well development. In addition, Mr. Edge has provided support with industry software such as ESRI ArcGIS and Microsoft Office Suite.

RELEVANT EXPERIENCE

Environmental Geology / Environmental Science

SMDC Mahurin Drilling and Excavating Phase I ESA, Bozeman, Montana, 2025. Mr. Edge conducted a literary review for the Phase I site assessment of the SMDC Mahurin Drilling and Excavating Phase I ESA, collecting information on past and current uses, site condition, and development and use of buildings in the surrounding area. Mr. Edge also assisted in the preparation of the SMDC Mahurin Drilling and Excavating Phase I ESA Report.

GESC Fillmore Duplexes Phase I & II ESA, USEPA, Denver, Colorado, 2024-2025. Mr. Edge conducted an onsite investigation and literary review for the Phase I site assessment of the Fillmore Duplex property, collecting information on past and current uses, site condition, and development and use of buildings in the surrounding area. Mr. Edge also prepared the GESC Fillmore Duplexes Phase I ESA report. Mr. Edge also assisted in the drilling/logging and groundwater sampling of 3 monitoring wells for the Phase II ESA.

EDUCATION

Master of Science (MS), Geology, University of Missouri – Columbia, 2022

Bachelor of Science (BS), Geology, Sam Houston State University, 2019

AREAS OF EXPERTISE

Geology

Groundwater

KEY TRAINING/ CERTIFICATIONS

40-hour OSHA HAZWOPER with 8-hour Refreshers, 2024

CPR and Standard First Aid, 2024

Center for Domestic Preparedness & Countering Weapons of Mass Destruction – Biowatch, 2024

IS-100, -200, -700, & -800 FEMA Certificates, 2024

OFFICE

Denver, CO

YEARS OF EXPERIENCE

8

CONTACT

713-854-5296

Kenny.Edge@tetratech.com

Grand Junction Solvents Emergency Response, USEPA, Grand Junction, Colorado, 2025. Mr. Edge assisted in the START V emergency response (ER) for the sampling of 320 drums and containers in Grand Junction, Colorado. The ER required responders to be outfitted in level B personal protective equipment (PPE) and have high awareness of hazardous substances. Sampling required careful attention to labels, drum condition, and surrounding air quality. Sampling required the use of a Ludlum survey meter, Toxic Vapor Analyzer (TVA) 2020, Multi-RAE, and drum thief. Mr. Edge also assisted in the QA/QC of laboratory data.

Occidental Petroleum Denver-Julesburg Basin Soil Exploration, OXY, Denver-Julesburg Basin, Colorado, 2025. Mr. Edge assisted in the collection of soil samples up to a depth of 8 feet below ground surface (ft bgs) throughout the Denver-Julesburg Basin (DJ Basin). Sampling required hand auguring up to a depth of 8 ft bgs, sampling in 1-2 ft intervals in pre-selected locations. Sampling involved the use of hand augers, Trimble R1 GPS units, photo inventory of sampled areas.

ULC Brunetti Lofts Phase I ESA, USEPA, Denver, Colorado, 2024. Mr. Edge conducted a literary review for the Phase I site assessment of the ULC Brunetti Lofts Phase I ESA, collecting information on past and current uses, site condition, and development and use of buildings in the surrounding area. Mr. Edge also assisted in the preparation of the Phase I ESA Report.

Helena YWCA Building Phase I ESA, USEPA, Helena, Montana, 2024. Mr. Edge conducted a literary review for the Phase I site assessment of the Helena YWCA Building in Helena, Montana. The Phase I ESA involved collecting information on past and current uses, site condition, and development and use of buildings in the surrounding area. Mr. Edge also assisted in the preparation of the Helena YWCA Building Phase I ESA report.

GESC Brighton Boulevard Phase I ESA, USEPA, Denver, Colorado, 2024. Mr. Edge conducted an onsite investigation and literary review for the Phase I site assessment of the GESC Brighton Boulevard property, collecting information on past and current uses, site condition, and development and use of buildings in the surrounding area. Mr. Edge also prepared the GESC Brighton Boulevard Phase I ESA report.

Rocky Boy's Reservation Old Stone Child Building Cleanup Planning and Cost Estimate, USEPA, Box Elder, Montana, 2024. Mr. Edge prepared an Analysis of Brownfields Cleanup Alternatives (ABCA) for the Rocky Boy's Reservation Old Stone Child Building (subject property). The analysis involved the estimate of hazardous material and estimate of removal. The ABCA also involved the analysis of environmental impacts on the subject property following investment.

New Method Laundry Phase II ESA, USEPA, Canon City, Colorado, 2024. Mr. Edge assisted in the sampling efforts of the New Method Laundry Phase II ESA in Canon City, Colorado. The event involved groundwater sampling 19 monitoring wells within the area of Canon City and drilling 3 monitoring wells within the footprint of New Method Laundry.

Headwaters RC&D: Phoenix Building and Caretakers Cottage Phase II ESA, USEPA, Butte, Montana, 2024. Mr. Edge assisted in the preparation of the Phase II ESA reports for both Phoenix Building and Caretakers Cottage as part of the Headwaters RC&D Phase II ESA Report in Butte, Montana.

Burlington Gymnasium Analysis of Brownfields Cleanup Alternatives (ABCA), USEPA, Burlington, Colorado, 2024. Mr. Edge assisted in the Analysis of Brownfields Cleanup Alternatives (ABCA) for the Burlington Gymnasium (subject property) in Burlington, Colorado. The analysis involved the estimate of hazardous material and estimate of removal. The ABCA also involved the analysis of environmental impacts on the subject property following investment.

Heart of America Medical Center Campus Analysis of Brownfields Cleanup Alternatives (ABCA), USEPA, Rugby, North Dakota, 2024. Mr. Edge prepared the Analysis of Brownfields Cleanup Alternatives (ABCA) for the Heart of America Medical Center Campus (subject property) in Rugby, North Dakota. The analysis involved the estimate of hazardous material and estimate of removal. The ABCA also involved the analysis of environmental impacts on the subject property following investment.

Doepke Holliday Superfund Site, USEPA, North Johnson County, Kansas, 2022-2024. Mr. Edge assisted in the collection of groundwater and wastewater at the Doepke Holliday Superfund site. This sampling event consisted of monitoring and sampling of 7 wells and 8 groundwater seeps. The removal and replacement of an oil-absorbent sock from one of the wells which contains LNAPL was also completed. Mr. Edge also developed the Annual Report for the 2022 and 2023 monitoring event.

ILRI Galatia, ILRI, Galatia, IL, 2022-2024 Mr. Edge was the Field Team Leader during the Quarterly Sampling Events at the Galatia Mine. He was responsible for coordinating supplies and vendors for the event and conducted sampling in the field. This sampling event consisted of monitoring and sampling 16 wells and 11 staff gauges.

Semi-Annual Groundwater Sampling and Reporting Event, Buick Resource Recycling Facility, Boss, MO, 2022-2024. Mr. Edge assisted in the collection of groundwater samples at the BRRF site. This site required staff to sample groundwater via bladder, Grundfos, and non-dedicated pumping equipment that required the coordination with a subcontractor. This site is also a lead contaminated site and requires staff to don full PPE. Mr. Edge also researched the equipment, and its accessories required for the sampling of deep (>125 feet) wells specific to the site.

Sweetwater Mine, Mach Mining, Macedonia, IL, 2022-2023. Mr. Edge assisted in the collection of surface water samples for the analysis of PFAS. This event consisted of sampling 60 locations around the vicinity of Sweetwater mine through a multitude of terrain including around and on top of the refuse, swamplands, and associated retention ponds. Sampling required the coordination of mine services and the use of mine vehicles/equipment. Sampling locations were located via aerial photographs.

City of Chester, City of Chester Municipality, Chester, IL, 2023. Mr. Edge collected groundwater samples from the city monitoring well via bladder pump, and river surface water samples from the Mississippi River alongside the city's raw water river intake.

EKPC Site Inspection, Eastern Kentucky Power Cooperative, Somerset, KY, 2024. Mr. Edge performed monthly site inspection events gauging monitoring wells, inspecting dams, and monitoring areas with known formation of sink holes surrounding an ash pond around the EKPC plant. Mr. Edge also performed groundwater sampling via peristaltic pump during two separate events that covered 6 monitoring wells.

GPI Interim Site, Invensys/Schneider Electric, Abilene, KS, 2023-2024. Mr. Edge performed tree well inspections for tree health and progression. The determination of tree health and its progression included the inspection of bark, leaf color and vitality, branch brittleness, growth of mold, parasite habitation, and other vegetation growing within the area of the tree well. Mr. Edge used existing information on vegetation types to determine if invading vegetation will pose a problem to the continual growth of the tree well, and if so, to economically schedule the clearing of such vegetation.

Project Bulldog, Norfolk Southern, East Palestine, OH, 2023-2024. Mr. Edge provided project support to the derailment efforts in East Palestine, OH.

Project Sandman, St. Louis and Kansas City, MO, 2023. Mr. Edge performed a Phase I site inspection at two recycling facilities and prepared a Phase I report.

Geology / Hydrogeology

Exploratory Drilling Program for the Wolf Mountain Site, IKO, Ironton, MO, 2023. Mr. Edge was tasked with developing a sampling analysis plan (SAP) and developing a summary report. Mr. Edge was the Field Team Leader during the IKO Exploratory event. This event consisted of percussion drilling oversight, logging, and sampling of fourteen 100 ft boreholes. Mr. Edge also prepared samples for laboratory analysis by sieving 800lbs of cuttings collected from the fourteen boreholes.

ILRI Galatia, ILRI, Galatia, Illinois, 2023. Mr. Edge acted as a staff geologist during the drilling and sampling of 4 wells and 1 piezometer. Mr. Edge logged wells that ranged from 20-80 feet through clay and sandstone. Sampling was carried out via split-spoon and Shelby-tube.

IKO Test Well for the Wolf Mountain Site, IKO, Ironton, MO, 2023-2024. Mr. Edge acted as assistant project manager and field lead. Mr. Edge performed oversight and logging of two 360 ft wells for the installation and development of a domestic water well and performed a step-test and 24-hour pump test.

Williams Energy East Slip Investigation, Williams Energy, Johnston City, IL, 2023-2024. Mr. Edge oversaw cone penetration testing of 12 locations on the north, east, and south side of a coal refuse pile. Mr. Edge also oversaw mud rotary drilling with sampling intervals that covered 2.5 ft until the bottom of the refuse, and 1.5ft after the bottom using split-spoon, Shelby-tube, and incorporating vane sheers. Drilling performed to install inclinometers and vibrating wire piezometers.

Monitoring Well Abandonment and Rehabilitation, Doe Run Sweetwater and West Fork Mines, Reynolds County, Missouri, 2022. Mr. Edge was the team lead for the abandonment, installation, and development of groundwater wells at the Sweetwater and West Fork Mine. Mr. Edge repaired and redeveloped 2 monitoring wells and provided oversight for the abandonment of four, 2-inch diameter wells. Also assisted in the preparation of a technical memorandum.

GIS

Ironton Well Evaluation, *IKO, Ironton, MO.* Mr. Edge was responsible for evaluating local wells and their corresponding yield. This project consisted of researching the area around the proposed site for wells with a high yield production potential. Prepared a memorandum outlining research and proposed project direction.

North Plant Intakes Feasibility Study, Missouri American Water, Florissant, MO, 2023. Mr. Edge aided in constructing a contour map of the area surrounding the East Intake and West Intake in ArcGIS pro. Mr. Edge also created horizontal cross-sections for the reference of a datum plane for the extension of pumps.

City of Chester, City of Chester Municipality, Chester, IL, 2023-2024. Mr. Edge prepared figures and memorandum.

CF Industries, Woodward, OK. 2024. Mr. Edge prepared site figures outlining well locations and groundwater contours.

CF Industries Phase I, Woodward, OK, 2024. Mr. Edge prepared site figures for the incorporation into a Phase I report.

ADDITIONAL EXPERIENCE

MS Excel, MS Word, MS Outlook, MS Access, ArcGIS

EMPLOYMENT HISTORY

2024 - Present	Environmental Scientist, Tetra Tech, Inc., Denver, Colorado
2022 – 2024	Staff Geologist, Geosyntec Consultants, Inc., Jefferson City, Missouri
2019-2022	Researcher and Teaching Assistant, University of Missouri, Columbia
2018-2019	Well-site Geologist, Edge Systems, Inc., Houston, Texas
2016-2018	Geology Laboratory Instructor, Sam Houston State University, Huntsville, Texas
2016	YMCA Boys Outdoor Leadership Development (BOLD) Instructor, Trinity, Texas
2010-2012	Engineer Intern, Alta Mesa, Houston Texas

TETRA TECH

Jessica Donahoe
Environmental Scientist

EXPERIENCE SUMMARY

Ms. Donahoe is an Environmental Scientist with more than 10 years of experience managing projects and providing technical support for clients in the government and private sectors. Areas of experience includes Phase I environmental site assessments (ESAs), Phase II ESAs, environmental compliance, natural resource reviews, HUD Environmental Assessments/Reviews, and National Environmental Protection Act (NEPA) evaluations. She has conducted, managed, or reviewed over 500 Phase I ESAs for clients in the petroleum industry (filling stations, oil change facilities, bulk petroleum plants, etc.); commercial property development industry; and for industrial, vehicle maintenance/repair, governmental, transportation, energy, and proposed construction properties. Ms. Donahoe works with national commercial clients with locations throughout the United States.

Prior to Tetra Tech, Ms. Donahoe served as the primary environmental due diligence project manager for Chicago-area offices of a national construction engineering company managing Phase I ESAs, transaction screens, and desktop environmental reviews for real estate transactions for commercial, retail, industrial, logistics, petroleum, governmental (municipal, state, and federal), transportation, agricultural, and proposed construction properties.

RELEVANT EXPERIENCE

Environmental Compliance Management

Auto Auction / Auto Salvage Properties – Nationwide Ms. Donahoe has completed Tier II EPCRA hazardous waste reporting, prepared permit applications, permit renewals, and other required reports for hazardous waste facilities, SPCC, SWPPP, air emissions, and other regulatory programs. Responsibilities also include maintaining and tracking ongoing compliance, sampling and monitoring, and reporting for environmental compliance for multiple facilities located nationwide.

Environmental Due Diligence / Site Assessments

Filling Station Portfolios – Illinois, Ohio, Indiana, Kentucky Ms. Donahoe has managed and conducted Phase I ESAs, oversaw Phase II investigations, and completed file reviews for multiple national petroleum company clients to aid in environmental due diligence prior to real estate transaction, redevelopment, enrollment in remediation programs, and/or client regulatory compliance.

Warehouse Logistics Facility Properties – Illinois, Indiana, Wisconsin Ms. Donahoe managed and conducted Phase I ESAs of industrial, residential, commercial, and agricultural properties ranging in size from 10 to 80 acres to aid in due diligence prior to development of warehouse logistics facilities as well as environmental assessment of various existing warehouse logistics distribution facilities.

EDUCATION

B.S., Natural Resources & Environmental Science, Purdue University, 1997

AREAS OF EXPERTISE

Phase I and Phase II Environmental Site Assessments/Due Diligence

Environmental Compliance

Natural Resource Reviews

HUD Environmental Assessments / Reviews

Environmental Sampling

KEY TRAINING/ CERTIFICATIONS

40-hour OSHA HAZWOPER with 8-hour Refreshers

HUD Environmental Assessment Training for ESA Professionals, 2023

AIHce Stewardship and Sustainability Conference 2014

AIHA Product Stewardship Society since 2014

Ohio VAP Seminar – 8-hour for Certified Professionals. 2000

OFFICE

Kansas City, MO

WORK LOCATION

Batavia, IL

YEARS OF EXPERIENCE

11

CONTACT

816-412-1780

jessica.donahoe@tetratech.com

Restaurant Portfolios – Illinois, Indiana, Ohio. Ms. Donahoe managed and conducted Phase I ESAs for multiple proposed restaurant facilities for national accounts on developed properties and undeveloped land to aid in due diligence prior to acquiring or redeveloping properties.

Oil Change Facility Portfolios – Multiple locations Ms. Donahoe managed and conducted Phase I ESAs, Phase I ESA Updates, and Phase II Investigations for oil change facilities, automotive repair facilities, and truck stop/travel plazas in Illinois, Indiana, Ohio, North Carolina, and Kentucky.

Office Buildings – Multiple sites in Illinois, Ohio, Indiana, Michigan, Wisconsin Ms. Donahoe has conducted Phase I ESA for single and multi-story office buildings in urban developed areas to aid in environmental due diligence prior to pending real estate transactions.

Railroad Properties – Illinois, Indiana, Ohio Ms. Donahoe has conducted Phase I ESA for railroad service yard and maintenance facilities, and business office as part of a national portfolio. Site conditions included industrial maintenance operations and hazardous chemical storage unique to the rail industry.

City of Chicago, Department of Assets, Information, and Services (AIS) – Chicago, IL Ms. Donahoe completed Phase I ESAs for a various industrial, residential, commercial, vacant multi-site properties, a former sanitation truck yard, and former laboratory equipment manufacturer properties in the City of Chicago as part of the fulfillment of on-call Task Order Requests (TOR) for the City of Chicago to assist in development of future property use development and/or site remediation.

City of Chicago Housing Authority (CHA) Portfolio – Chicago, IL Ms. Donahoe has conducted Phase I ESAs for office buildings, commercial buildings, and vacant lots in Chicago with on-site and adjoining historical filling stations, dry cleaners, and auto repair facilities.

Chicago Ashland Avenue Project – Chicago, IL Baseline Phase I ESAs of a former furniture manufacturing facility that was destroyed by a large-scale fire to aid in due diligence prior to redevelopment into logistics facilities. Historical operations spanning over 120 years in in Chicago with a wide range of contaminants of concern associated with various industry practices and operations. Findings of the ESAs prompted Limited Site Investigations (LSIs) and enrollment into the Illinois Environmental Protection Agency's (IEPA) Site Remediation Program (SRP).

Senior Care Portfolios – Illinois Ms. Donahoe managed and conducted multiple Phase I ESAs for operating independent living, assisted living, and long-term care medical facilities to aid in environmental due diligence. Ms. Donahoe also conducted multiple Phase I ESAs for potential construction of senior living facilities with additional scope of evaluation of potential wetlands, floodplains, Threatened and Endangered (T&E) species, and critical habitat review.

Senior and/or Multi-Family Housing Phase I ESA / IDHA /HUD Environmental Reviews – Illinois Ms. Donahoe conducted Phase I ESAs, Illinois Department of Housing Authority (IDHA) Environmental Reviews, and/or Housing and Urban Development (HUD) Environmental Assessments on existing or proposed senior / multi-family living facilities or on proposed undeveloped land per the IDHA Environmental Review standard and HUD requirements often including prime farmland assessments, evaluation of potential wetlands, floodplains, threatened and endangered (T&E) species, and critical habitat review, and historical preservation checklist.

O'Hare International Airport Radar Equipment – Chicago, IL Ms. Donahoe has conducted Phase I ESAs of radar systems operated by the Federal Aviation Administration (FAA) located within the runway system of O'Hare International Airport prior to demolition of systems for future airport renovations and expansion project.

Former NIKE Missile Base Office/Park Development– Naperville, IL Ms. Donahoe has conducted Phase I ESA reports for office buildings on land formerly used as a NIKE Missile Base to aid in environmental due diligence prior to real estate transactions.

Food Distribution/Meat Processing Facilities – Illinois Ms. Donahoe has conducted Phase I ESAs on multiple food distribution packaging warehouse facilities, food processing facilities with wastewater pre-treatment plants, cold storage facilities, and dry-storage facilities.

Plastics, Scrap metal, Cardboard, Electronics, and Cloth Recycling Facilities – Illinois Ms. Donahoe has conducted Phase I ESAs of a plastics, scrap metal, cardboard, electronics, and cloth recycling facilities at multiple facilities in Illinois.

Auto and Truck Repair Facilities – Illinois, Indiana, Wisconsin, Ohio Ms. Donahoe has conducted Phase I ESAs for operating or historical auto and truck/trailer repair facilities or automotive repair retail operations for national clients. Due diligence services for these clients have included Limited Environmental Compliance Assessments (LECAs), as requested.

Drum Manufacturing Facility – Chicago, IL Ms. Donahoe has conducted Phase I ESAs for a drum manufacturing facility in the Pilsen area of Chicago with a history of on-site and adjoining historical Chicago Transit Authority (CTA) station, transformer substation, and former foundry within the Heart of Chicago Soils clean-up area.

Medical Campus and Medical Office Portfolios – Illinois Ms. Donahoe has conducted and managed Phase I ESAs for medical offices, medical campuses, and medical campus expansions to aid in environmental due diligence for property or facility transactions or construction of future medical facilities.

Auto Auction / Auto Salvage Properties – Nationwide Ms. Donahoe has conducted Phase I ESAs for various properties throughout the United States for a national client to aid in environmental due diligence prior to real estate transaction, redevelopment, and/or client regulatory compliance.

Proposed Telecommunications Towers – Multiple sites – IL, MO, GA, FL, AR, TN Ms. Donahoe assisted in NEPA assessments as directed by the Federal Communications Commission (FCC) for proposed telecommunications towers/utility easements across United States. NEPA scopes included presence/ absence of wetlands, floodplains, federal/tribal land, T&E species, critical habitat, historic resources, and archaeological resources impacted by the proposed tower.

ADDITIONAL EXPERIENCE

Microsoft Word, Microsoft Excel, Microsoft Outlook, Microsoft Access Database

EMPLOYMENT HISTORY

2023 - Present	Environmental Scientist, Tetra Tech Inc., Kansas City, Missouri
2018 - 2023	Project Manager/Staff Scientist, Terracon Consultants Inc., Glendale Heights, Illinois
2001 - 2002	Project Geologist, Handex of Illinois Inc., Naperville, Illinois
1999 - 2001	Environmental Scientist, Hull and Associates Inc., Cincinnati, Ohio
1997-1999	Environmental Analyst, Green Environmental Ltd., Wheaton, Illinois